

## European Technical Approval ETA-11/0514

English translation prepared by DIBt - Original version in German language

Handelsbezeichnung  
*Trade name*

MKT Injektionssystem VMU eco für Bewehrungsanschlüsse  
*MKT Injection system VMU eco for rebar connections*

Zulassungsinhaber  
*Holder of approval*

MKT  
Metall-Kunststoff-Technik GmbH & Co. KG  
Auf dem Immel 2  
67685 Weilerbach  
DEUTSCHLAND

Zulassungsgegenstand  
und Verwendungszweck  
*Generic type and use  
of construction product*

Nachträglich eingemörtelter Bewehrungsanschluss mit dem MKT  
Injektionssystem VMU eco  
*Post- installed rebar connection with MKT injection System VMU eco*

Geltungsdauer:  
*Validity:* vom  
from  
bis  
to

28 November 2011  
6 October 2014

Herstellwerk  
*Manufacturing plant*

Werk 2, D

Diese Zulassung umfasst  
*This Approval contains*

20 Seiten einschließlich 11 Anhänge  
*20 pages including 11 annexes*

## I LEGAL BASES AND GENERAL CONDITIONS

- 1 This European technical approval is issued by Deutsches Institut für Bautechnik in accordance with:
  - Council Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations and administrative provisions of Member States relating to construction products<sup>1</sup>, modified by Council Directive 93/68/EEC<sup>2</sup> and Regulation (EC) N° 1882/2003 of the European Parliament and of the Council<sup>3</sup>;
  - *Gesetz über das In-Verkehr-Bringen von und den freien Warenverkehr mit Bauprodukten zur Umsetzung der Richtlinie 89/106/EWG des Rates vom 21. Dezember 1988 zur Angleichung der Rechts- und Verwaltungsvorschriften der Mitgliedstaaten über Bauprodukte und anderer Rechtsakte der Europäischen Gemeinschaften (Bauproduktengesetz - BauPG) vom 28. April 1998<sup>4</sup>, as amended by law of 31 October 2006<sup>5</sup>;*
  - Common Procedural Rules for Requesting, Preparing and the Granting of European technical approvals set out in the Annex to Commission Decision 94/23/EC<sup>6</sup>;
  - Guideline for European technical approval of "Metal anchors for use in concrete - Part 5: Bonded anchors", ETAG 001-05.
- 2 Deutsches Institut für Bautechnik is authorized to check whether the provisions of this European technical approval are met. Checking may take place in the manufacturing plant. Nevertheless, the responsibility for the conformity of the products to the European technical approval and for their fitness for the intended use remains with the holder of the European technical approval.
- 3 This European technical approval is not to be transferred to manufacturers or agents of manufacturers other than those indicated on page 1, or manufacturing plants other than those indicated on page 1 of this European technical approval.
- 4 This European technical approval may be withdrawn by Deutsches Institut für Bautechnik, in particular pursuant to information by the Commission according to Article 5(1) of Council Directive 89/106/EEC.
- 5 Reproduction of this European technical approval including transmission by electronic means shall be in full. However, partial reproduction can be made with the written consent of Deutsches Institut für Bautechnik. In this case partial reproduction has to be designated as such. Texts and drawings of advertising brochures shall not contradict or misuse the European technical approval.
- 6 The European technical approval is issued by the approval body in its official language. This version corresponds fully to the version circulated within EOTA. Translations into other languages have to be designated as such.

<sup>1</sup> Official Journal of the European Communities L 40, 11 February 1989, p. 12  
<sup>2</sup> Official Journal of the European Communities L 220, 30 August 1993, p. 1  
<sup>3</sup> Official Journal of the European Union L 284, 31 October 2003, p. 25  
<sup>4</sup> *Bundesgesetzblatt Teil I 1998*, p. 812  
<sup>5</sup> *Bundesgesetzblatt Teil I 2006*, p. 2407, 2416  
<sup>6</sup> Official Journal of the European Communities L 17, 20 January 1994, p. 34

## II SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL

### 1 Definition of product/ products and intended use

#### 1.1 Definition of the construction product

The subject of this approval is the post-installed connection, by anchoring or overlap connection joint, of reinforcing bars (rebar) in existing structures made of normal weight concrete, using the "MKT Injection system VMU eco for rebar connection" in accordance with the regulations for reinforced concrete construction.

Reinforcing bars made of steel with a diameter  $\varnothing$  from 8 to 25 mm according to Annex 1 and the MKT injection mortar VMU eco used for rebar connections. The rebar is placed into a drilled hole filled with injection adhesive and is anchored via the bond between embedded element, injection mortar and concrete.

#### 1.2 Intended use

The rebar connection may be used in normal weight concrete of a minimum grade of C12/15 and maximum grade C50/60 according to EN 206-1:2000. It may be used in non-carbonated concrete with allowable chloride content of 0.40 % (CL 0.40) related to the cement content according to EN 206-1.

Rebar connections with reinforcing bars may be used under predominantly static loads only.

The fire resistance of post-installed rebar connections is not covered by this European technical approval. Fatigue, dynamic or seismic loading of post-installed rebar connections are not covered by this European technical approval.

Rebar connections may only be carried out in a manner, which is also possible with cast-in straight reinforcing bars, e.g. those in the following applications (see Annex 2):

- an overlap joint with existing reinforcement in a building component (Figures 1 and 2),
- anchoring of the reinforcement at a slab or beam support, (e.g. according to Figure 3: end support of a slab, designed simply supported, as well as an appropriate general reinforcement for restraint forces),
- anchoring of reinforcement of building components stressed primarily in compression (Figure 4),
- anchoring of reinforcement to cover the envelope line of tensile force in the bending member (Figure 5).

The post-installed rebar connections may be used in the temperature range of -40 °C to +80 °C (max short term temperature +80 °C and max long term temperature +50 °C).

This European technical approval covers anchoring in bore holes made with hammer drilling or compressed air drilling. The post-installed rebar connection may be installed in dry or wet concrete. It must not be installed in flooded holes.

The provisions made in this European technical approval are based on an assumed working life of the post-installed rebar connection of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

## **2 Characteristics of the product and methods of verification**

### **2.1 Characteristics of the product**

The post-installed rebar connection corresponds to the drawings and provisions given in Annexes 1 to 3. The characteristic material values, dimensions and tolerances not indicated in Annexes 1 to 3 shall correspond to the respective values laid down in the technical documentation<sup>7</sup> of this European technical approval.

The two components of the injection adhesive are delivered in unmixed condition in coaxial cartridges in side-by-side cartridges according to Annex 1. Each cartridge is marked with the identifying mark "MKT Injection Adhesive VMU eco" with the processing notes, charge code, shelf life, hazard code, curing time and processing time (depending on temperature).

The rebar shall comply with the specifications given in Annex 3.

### **2.2 Methods of verification**

The assessment of fitness of the post-installed rebar connection for the intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Essential Requirements 1 and 4 has been made in accordance with the "Guideline for European technical approval of Metal Anchors for Use in Concrete", Part 1 "Anchors in general" and Part 5 "Bonded anchors" and EOTA Technical Report TR 023 "Assessment of post-installed rebar connections"<sup>8</sup>.

In addition to the specific clauses relating to dangerous substances contained in this European technical approval, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Directive, these requirements need also to be complied with, when and where they apply.

## **3 Evaluation and attestation of conformity and CE marking**

### **3.1 System of attestation of conformity**

According to the Decision 96/582/EC of the European Commission<sup>9</sup> system 2(i) (referred to as System 1) of the attestation of conformity applies.

This system of attestation of conformity is defined as follows:

System 1: Certification of the conformity of the product by an approved certification body on the basis of:

- (a) Tasks for the manufacturer:
  - (1) factory production control;
  - (2) further testing of samples taken at the factory by the manufacturer in accordance with a prescribed control plan;

<sup>7</sup> The technical documentation of this European technical approval is deposited at the Deutsches Institut für Bautechnik and, as far as relevant for the tasks of the approved bodies involved in the attestation of conformity procedure, is handed over to the approved bodies.

<sup>8</sup> The Technical Report TR 023 "Assessment of post-installed rebar connections" is published on EOTA website [www.EOTA.eu](http://www.EOTA.eu).

<sup>9</sup> Official Journal of the European Communities L 254 of 08.10.1996

- (b) Tasks for the approved body:
- (3) initial type-testing of the product;
  - (4) initial inspection of factory and of factory production control;
  - (5) continuous surveillance, assessment and approval of factory production control.

Note: Approved bodies are also referred to as "notified bodies".

### 3.2 Responsibilities

#### 3.2.1 Tasks for the manufacturer

##### 3.2.1.1 Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall insure that the product is in conformity with this European technical approval.

The manufacturer may only use initial/raw/constituent materials stated in the technical documentation of this European technical approval.

The factory production control shall be in accordance with the control plan which is part of the technical documentation of this European technical approval. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited with Deutsches Institut für Bautechnik.<sup>10</sup>

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

##### 3.2.1.2 Other tasks for the manufacturer

The manufacturer shall, on the basis of a contract, involve a body which is approved for the tasks referred to in section 3.1 in the field of anchors in order to undertake the actions laid down in section 3.2.2. For this purpose, the control plan referred to in sections 3.2.1.1 and 3.2.2 shall be handed over by the manufacturer to the approved body involved.

The manufacturer shall make a declaration of conformity, stating that the construction product is in conformity with the provisions of this European technical approval.

#### 3.2.2 Tasks for the approved bodies

The approved body shall perform the

- initial type-testing of the product,
- initial inspection of factory and of factory production control,
- continuous surveillance, assessment and approval of factory production control,

in accordance with the provisions laid down in the control plan.

The approved body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The approved certification body involved by the manufacturer shall issue an EC certificate of conformity of the product stating the conformity with the provisions of this European technical approval.

In cases where the provisions of the European technical approval and its control plan are no longer fulfilled the certification body shall withdraw the certificate of conformity and inform Deutsches Institut für Bautechnik without delay.

<sup>10</sup>

The control plan is a confidential part of the European technical approval and only handed over to the approved body involved in the procedure of attestation of conformity. See section 3.2.2.

### 3.3 CE marking

The CE marking shall be affixed on each packaging of the injection mortar. The letters "CE" shall be followed by the identification number of the approved certification body, where relevant, and be accompanied by the following additional information:

- the name and address of the holder of the approval (legal entity responsible for the manufacture),
- the last two digits of the year in which the CE marking was affixed,
- the number of the EC certificate of conformity for the product,
- the number of the European technical approval,
- the number of the guideline for European technical approval.

## 4 Assumptions under which the fitness of the product for the intended use was favourably assessed

### 4.1 Manufacturing

The European technical approval is issued for the product on the basis of agreed data/information, deposited with Deutsches Institut für Bautechnik, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, should be notified to Deutsches Institut für Bautechnik before the changes are introduced. Deutsches Institut für Bautechnik will decide whether or not such changes affect the approval and consequently the validity of the CE marking on the basis of the approval and if so whether further assessment or alterations to the approval shall be necessary.

### 4.2 Drafting

Rebar connections must be designed in keeping with good engineering practice. Considering the loads to be anchored, design calculations and design drawings must be produced which can be checked. At least the following items must be stated in the design drawings:

- grade of concrete strength,
- diameter, drilling technique, concrete cover, spacing and embedment depth of the rebar,
- length for markings  $\ell_m$  and  $\ell_v$  on the injection extension according to Annex 9,
- use of a guide device (drilling aid) for drilling holes close to edges (if necessary),
- kind of preparation of the joint between building component being connected including the diameter and thickness of concrete layer that has to be removed.

### 4.3 Design

#### 4.3.1 General

The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing.

The design of post-installed rebar connections according to Annex 2 and determination of the internal section forces to be transferred in the construction joint shall be verified in accordance with EN 1992-1-1:2004. When ascertaining the tensile force in the rebar, allowance shall be made for the statically effective height of the bonded-in reinforcement.

The verification of the immediate local force transfer to the concrete has been provided.

The verification of the transfer of the loads to be anchored to the building component shall be provided.

#### 4.3.2 Determination of the basic anchorage length

The required basic anchorage length  $\ell_{b,rqd}$  shall be determined in accordance with EN 1992-1-1, Section 8.4.3:

$$\ell_{b,rqd} = (\varnothing / 4) \times (\sigma_{sd} / f_{bd})$$

with:  $\varnothing$  = diameter of the rebar

$\sigma_{sd}$  = calculated design stress of the rebar

$f_{bd}$  = design value of bond strength according to Annex 5, Table 4 in consideration of the coefficient related to the quality of bond conditions

#### 4.3.3 Determination of the design anchorage length

The required design anchorage length  $\ell_{bd}$  shall be determined in accordance with EN 1992-1-1, Section 8.4.4:

$$\ell_{bd} = \alpha_1 \alpha_2 \alpha_3 \alpha_4 \alpha_5 \ell_{b,rqd} \geq \ell_{b,min}$$

with:  $\ell_{b,rqd}$  = according to section 4.3.2

$\alpha_1$  = 1.0 for straight bars

$\alpha_2$  = 0.7...1.0 calculated acc. to EN 1992-1-1, Table 8.2

$\alpha_3$  = 1.0 because of no transverse reinforcement

$\alpha_4$  = 1.0 because of no welded transverse reinforcement

$\alpha_5$  = 0.7...1.0 for influence of transverse pressure acc. to EN 1992-1-1, Table 8.2

$\ell_{b,min}$  = minimum anchorage length acc. to EN 1992-1-1

= 1.5 max {0.3  $\ell_{b,rqd}$ ; 10  $\varnothing$ ; 100 mm} under tension

= 1.5 max {0.6  $\ell_{b,rqd}$ ; 10  $\varnothing$ ; 100 mm} under compression

The maximum permissible embedment depth is given in Annex 5 depending on diameter of the rebar.

#### 4.3.4 Overlap joints

The required design lap length  $\ell_0$  shall be determined in accordance with EN 1992-1-1, Section 8.7.3:

$$\ell_0 = \alpha_1 \alpha_2 \alpha_3 \alpha_5 \alpha_6 \ell_{b,rqd} \geq \ell_{0,min}$$

with:  $\ell_{b,rqd}$  = according to Section 4.3.2

$\alpha_1$  = 1.0 for straight bars

$\alpha_2$  = 0.7...1.0 calculated acc. to EN 1992-1-1, Table 8.2

$\alpha_3$  = 1.0 because of no transverse reinforcement

$\alpha_5$  = 0.7...1.0 for influence of transverse pressure acc. to EN 1992-1-1, Table 8.2

$\alpha_6$  = 1.0...1.5 for influence of percentage of lapped bars relative to the total cross-section area acc. to EN 1992-1-1, Table 8.3

$\ell_{0,min}$  = minimum lap length acc. to EN 1992-1-1

= 1.5 max {0.3  $\alpha_6 \ell_{b,rqd}$ ; 15  $\varnothing$ ; 200 mm}

The maximum permissible embedment depth is given in Annex 5 depending on diameter of the rebar.



#### 4.3.5 Embedment depth for overlap joints

For calculation of the effective embedment depth of overlap joints the concrete cover at end-face of bonded-in rebar  $c_1$  shall be considered (see Annex 4, Figure 7):

$$\ell_v \geq \ell_0 + c_1$$

with:  $\ell_0$  = required lap length acc. to Section 4.3.4 and to EN 1992-1-1

$c_1$  = concrete cover at end-face of bonded-in rebar (see also Annex 4)

If the clear distance between the overlapping rebar is greater than  $4 \varnothing$  the lap length shall be enlarged by the difference between the clear distance and  $4 \varnothing$ .

#### 4.3.6 Concrete cover

The concrete cover required for bonded-in rebar is shown in Annex 5, Table 2, in relation to the drilling method and the hole tolerance.

Furthermore the minimum concrete cover given in EN 1992-1-1, Section 4.4.1.2 shall be observed.

#### 4.3.7 Transverse reinforcement

The requirements of transverse reinforcement in the area of the post-installed rebar connection shall comply with EN 1992-1-1, Section 8.7.4.

#### 4.3.8 Connection joint

The transfer of shear forces between new concrete and existing structure shall be designed according to EN 1992-1-1. The joints for concreting must be roughened to at least such an extent that aggregate protrude.

In case of a carbonated surface of the existing concrete structure the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of  $\varnothing + 60$  mm prior to the installation of the new rebar.

The depth of concrete to be removed shall correspond to at least the minimum concrete cover for the respective environmental conditions in accordance with EN 1992-1-1:2004.

The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions.

### 4.4 Installation

The fitness for use of the post-installed rebar connection can only be assumed if the rebar is installed as follows:

- the installation of post-installed rebar shall be done only by suitable trained installer and under supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for supervision on site are up to the Member States in which the installation is done,
- use of the injection system only as supplied by the manufacturer without exchanging the components of the Injection system,
- installation in accordance with the manufacturer's specifications and drawings using the tools indicated in the technical documentation of this European technical approval,
- checks before rebar installation to ensure that the strength class of the concrete in which the post-installed rebar connection is to be placed is in the range given and is not lower than that of the concrete to which the characteristic loads apply,
- check of concrete being well compacted, e.g. without significant voids,
- check the position of the existing rebar (if the position of existing rebar is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint),
- keeping the anchorage depth as specified in the design drawings,



- keeping of concrete cover and spacing as specified in the design drawings,
- positioning of the drill holes without damaging the reinforcement,
- in case of aborted drill hole the drill hole shall be filled with mortar,
- the post-installed rebar connection must not be installed in flooded holes,
- the drilling and cleaning of the hole and the installation shall be performed only with the equipment specified by the manufacturer according to the manufacturer's installation instructions (see Annexes 6 to 9), it shall be ensured that this equipment is available on site and it is used,
- during curing of the injection adhesive the temperature of the building component must not be less than 0 °C and must not exceed +40 °C; observing the curing time given in Annex 8.

## **5 Indications to the manufacturer**

### **5.1 Responsibility of the manufacturer**

It is in the responsibility of the manufacturer to ensure that the information on the specific conditions according to sections 1 and 2 including Annexes referred to as well as sections 4 and 5.2 is given to those who are concerned. This information may be made by reproduction of the respective parts of the European technical approval. In addition all installation data shall be shown clearly on the package and/or on an enclosed instruction sheet, preferably using illustration(s).

The minimum data required are:

- drill bit diameter,
- diameter of rebar,
- admissible service temperature range,
- curing time of the injection mortar,
- Installation instructions including cleaning of the drill hole,
- reference to any special installation equipment needed,
- identification of the manufacturing batch,

All data shall be presented in a clear and explicit form.

### **5.2 Packaging, transport and storage**

The mortar cartridges shall be protected against sun radiation and shall be stored according to the manufacture's installation instructions in dry condition at temperatures of at least +5 °C to not more than +25 °C.

Mortar cartridges with expired shelf life must no longer be used.

Georg Feistel  
Head of Department

*beglaubigt:*  
Baderschneider


## Product description and intended use

- Only for design of rebar connections based on EN 1992-1-1:2004
- Non carbonated concrete C12/15 – C50/60 according to EN 206-1:2000
- Reinforcement bars, diameter  $\varnothing = 8 \text{ mm} - 25 \text{ mm}$  according to Annex 3, Table 1
- Maximum long term temperature  $+50 \text{ }^{\circ}\text{C}$ , maximum short term temperature  $+80 \text{ }^{\circ}\text{C}$
- Maximum anchorage length see Annex 5, Table 3
- Installation in dry or wet concrete, no installation in flooded holes


Sealing cap



Adhesive cartridge  
type „coaxial“

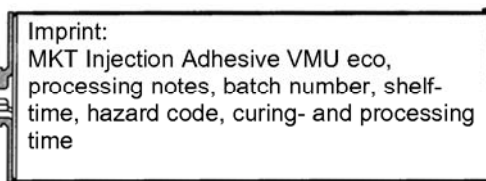

type „side-by-side“

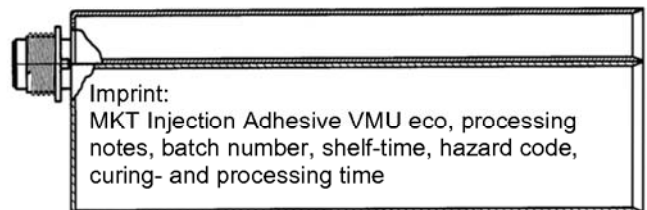

Air hose




Air valve


Blow-out pump




Brush



Brush Extension




SDS Plus Adapter




Retaining washer




Extension pipe



Static mixer

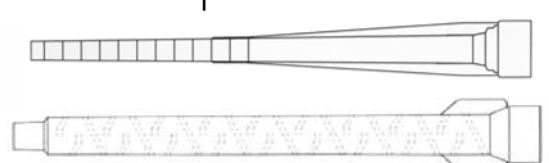

Dispenser

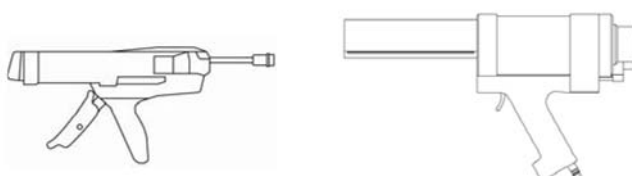

MKT Injection System VMU eco for rebar connection

Product description and intended use

Annex 1

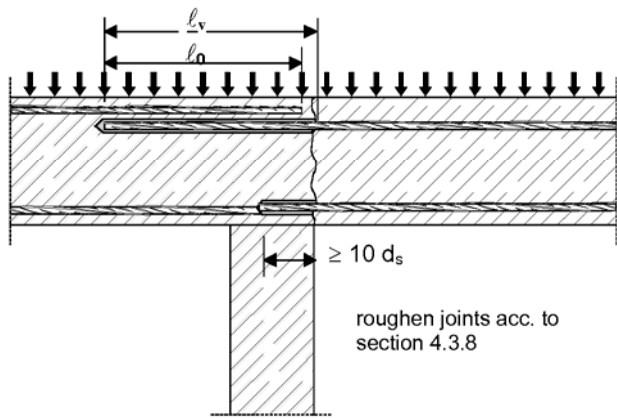


Figure 1: Overlap joint in slabs and beams

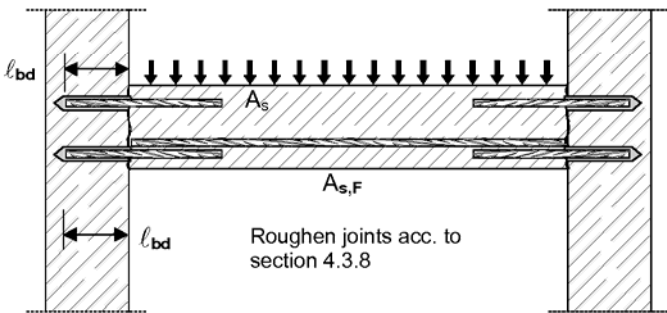


Figure 3: End anchoring of slabs or beams, designed as simply supported

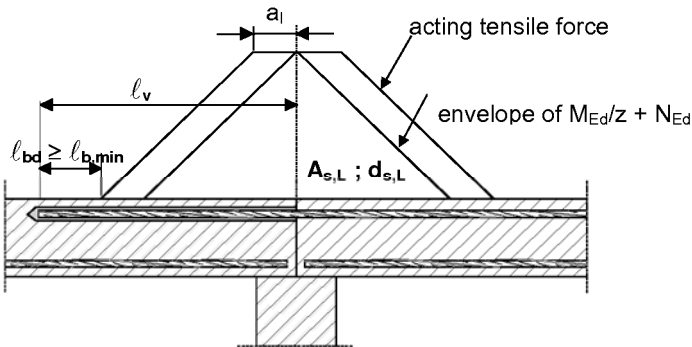


Figure 5: Anchoring of reinforcement to cover the line of acting tensile force

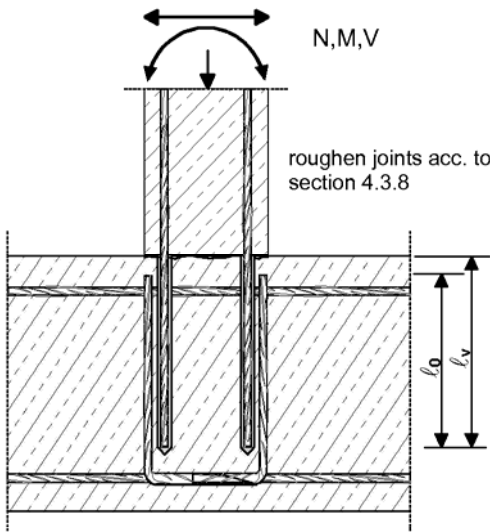


Figure 2: Overlap joint in a foundation of a column or wall where the rebars are stressed in tension

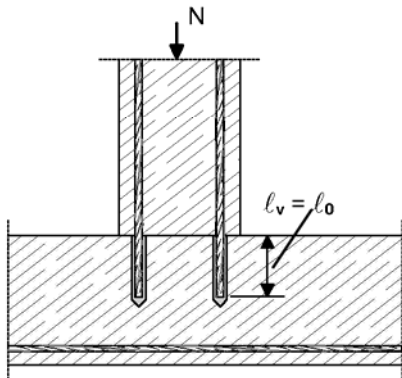



Figure 4: Rebar connection of components stressed primarily in compression. The rebars are stressed in compression

**Notes to Figure 1 – 5:**  
No transverse reinforcement is plotted, the transverse reinforcement as required by EN 1992-1-1 shall be present. The shear transfer between old and new concrete shall be designed according to EN 1992-1-1. Notations and definitions of anchorage and overlap joints see Annex 4.

MKT Injection System VMU eco for rebar connection

Application examples of post-installed rebars

Annex 2



**Figure 6:** Properties of reinforcement bars “rebars”

**Table 1: Materials**

a) Abstract of EN 1992-1-1 Annex C, Table C.1, Properties of reinforcement

Product form		Bars and de-coiled rods	
Class		B	C
Characteristic yield strength $f_{yk}$ or $f_{0.2k}$ (N/mm <sup>2</sup> )		400 to 600	
Minimum value of $k = (f_t / f_y)_k$		$\geq 1.08$	$\geq 1.15$ $< 1.35$
Characteristic strain at maximum force $\epsilon_{uk}$ (%)		$\geq 5.0$	$\geq 7.5$
Bendability		Bend / Rebend test	
Maximum deviation from nominal mass (individual bar) (%)	Nominal bar size (mm)		
	$\leq 8$	$\pm 6.0$	
	$> 8$	$\pm 4.5$	

b) Abstract of EN 1992-1-1 Annex C, Table C.2N, Properties of reinforcement


Product form		Bars and de-coiled rods	
Class		B	C
Minimum value of related rib area $f_{R,min}$	Nominal diameter of the rebar (mm)		
	8 to 12	0.040	
	$> 12$	0.056	

Rib height of the bar shall be in the range  $0,05d \leq h \leq 0,07d$ .  
(d: Nominal diameter of the bar; h: Rib height of the bar)

**MKT Injection System VMU eco for rebar connection**

**Properties of reinforcement**

**Annex 3**

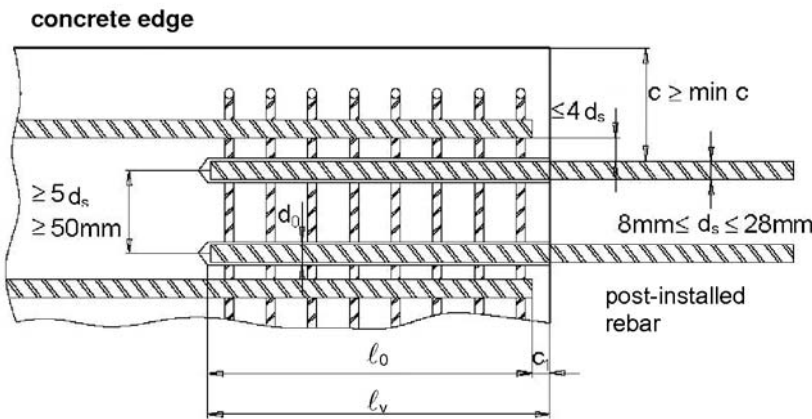

**Figure 7:** General rules for post-installed rebar connections

- c concrete cover of post-installed reinforcement
- c<sub>1</sub> concrete cover at front end of cast in place rebar
- min c minimum concrete cover according to Table 2
- d<sub>s</sub> diameter of post-installed rebar
- l<sub>0</sub> lap length
- l<sub>v</sub> anchorage length
- d<sub>0</sub> nominal drill bit diameter according to Annex 7, Table 5

The following notes must be observed:

- Bond strength f<sub>bd</sub> according to EN 1992-1-1 may be applied
- l<sub>0</sub> and l<sub>v</sub> according to sections 4.3.4 and 4.3.5
- Transverse reinforcement according to EN 1992-1-1.
- If the clear distance of overlapping bars is greater than 4 d<sub>s</sub> mm, the lap length must be increased by a length equal to the clear space where it exceeds 4 d<sub>s</sub> mm.
- The minimum concrete cover according to EN 1992-1-1 shall be kept.

MKT Injection System VMU eco for rebar connection


General rules for post-installed rebar connections

Annex 4

**Table 2: Minimum concrete cover min c of post-installed rebars depending on drilling method and drilling tolerances**

Drilling method	Rebar diameter	Without drilling aid device	With aid device
Hammer drilling	< 25 mm	$30 \text{ mm} + 0.06 \cdot \ell_v \geq 2 d_s$	$30 \text{ mm} + 0.02 \cdot \ell_v \geq 2 d_s$
	= 25 mm	$40 \text{ mm} + 0.06 \cdot \ell_v \geq 2 d_s$	$40 \text{ mm} + 0.02 \cdot \ell_v \geq 2 d_s$
Compressed air drilling	< 25 mm	$50 \text{ mm} + 0.08 \cdot \ell_v$	$50 \text{ mm} + 0.02 \cdot \ell_v$
	= 25 mm	$60 \text{ mm} + 0.08 \cdot \ell_v$	$60 \text{ mm} + 0.02 \cdot \ell_v$

The minimum concrete cover according to EN 1992-1-1:2004 shall be kept.

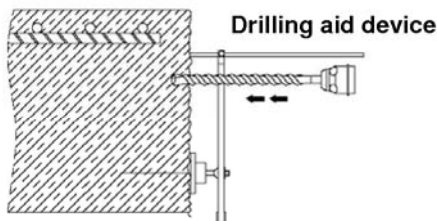

**Table 3: Minimum anchorage length<sup>1)</sup> and lap length for C20/25 and maximum anchorage length  $l_{\max}$**

Rod		$l_{b,\min}$ [mm]	$l_{o,\min}$ [mm]	$l_{\max}$ [mm]
$\varnothing d_s$ [mm]	$f_{y,k}$ [N/mm <sup>2</sup> ]			
8	500	170	300	1000
10	500	213	300	1000
12	500	255	300	1200
14	500	298	315	1400
16	500	340	360	1600
20	500	425	450	2000
22	500	468	495	2000
24	500	510	540	2000
25	500	532	563	2000

<sup>1)</sup> according to EN 1992-1-1: 2004:  $l_{b,\min}$  (8.6) and  $l_{o,\min}$  (8.11) for good bond conditions and  $\alpha_6 = 1.0$  for maximum yield strength of BSt 500 S reinforcement bars and  $\gamma_M = 1.15$

**Table 4: Design values of ultimate bond stress  $f_{bd}$ <sup>2)</sup>**

Concrete strength class	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
Design values of ultimate bond stress $f_{bd}$ [N/mm <sup>2</sup> ]	1.6	2.0	2.3	2.7	3.0	3.4	3.7	4.0	4.3

<sup>2)</sup> The values  $f_{bd}$  are valid for 'good' bond conditions according to EN 1992-1-1:2004. For all other bond conditions  $f_{bd}$  has to be multiplied by 0.7.












**MKT Injection System VMU eco for rebar connection**

**Minimum concrete cover,  
Minimum anchorage length,  
Design values of ultimate bond stress  $f_{bd}$**

**Annex 5**



## Installation instructions

1.		Select drill bit diameter according to Table 5. Build drill hole by hammer drilling or compressed air drilling. <b>Drill hole must be cleaned directly prior to installation of the anchor.</b>
2a.	 or 	Starting from the bottom blow out the hole with compressed air (min. 6 bar) or blow-out pump at minimum four times. If the bore hole ground is not reached an extension shall be used.  For drill holes deeper 240 mm compressed air (min. 6 bar) <b>must</b> be used.
2b.		Brush the drill hole at least 4x by using an appropriate sized wire brush according to Table 5 (the minimum brush diameter $d_{b,min}$ has to be checked) with an drilling machine or a battery screwdriver. If the bore hole ground is not reached with the brush, a brush extension shall be used.
2c.	 or 	Finally blow out the hole again with compressed air (min. 6 bar) or a blow-out pump a minimum of four times. If the bore hole ground is not reached an extension shall be used.  For bore holes deeper 240 mm compressed air (min. 6 bar) <b>must</b> be used.
3.		Attach a supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool. For every working interruption longer than the recommended working time (Table 6) as well as for new cartridges, a new static-mixer shall be used.
4.		Prior to inserting the anchor rod into the filled bore hole, the position of the anchorage length shall be marked on the rebar (e.g. with tape). Then insert the rebar in the empty hole in order to verify the correct hole depth.
5.		Prior to dispensing into the anchor hole, squeeze out separately a minimum of three full strokes and discard non-uniformly mixed adhesive components until the mortar shows a consistent grey colour.
6.		Starting from the bottom or back of the cleaned anchor hole fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid creating air pockets. For embedment larger than 190 mm an extension nozzle shall be used. For overhead and horizontal installation as well as in bore holes deeper 240 mm a piston plug and extension nozzle (Annex 9) shall be used. Observe the gel-/ working times given in Table 6.
7.		Push the reinforcing bar into the hole while turning slightly to ensure positive distribution of the adhesive until the anchorage length is reached.  The anchor should be free of dirt, grease, oil or other foreign material.




## MKT Injection System VMU eco for rebar connection

## Installation instructions

## Annex 6



## Installation instructions (continuation)

8.		Be sure that the anchor is fully seated up to the full anchorage length and that excess mortar is visible at the top of the hole. If the hole is not completely filled, pull out anchor rod and start again from step no. 6. For overhead installation fix embedded part (e.g. wedges).
9.		Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (attend Table 6).
10.		Remove excess mortar.

## Steel brush



Table 5: Parameters for cleaning and installation tools

$d_s$ Rebar - Ø	$d_0$ Drill bit - Ø	$d_b$ Brush - Ø	$d_{b,min}$ min. Brush - Ø
[mm]	[mm]	[mm]	[mm]
8	12	14	12.5
10	14	16	14.5
12	16	18	16.5
14	18	20	18.5
16	20	22	20.5
20	25	27	25.5
22	28	30	28.5
24	32	34	32.5
25	32	34	32.5

MKT Injection System VMU eco for rebar connection

Installation instructions (continuation),  
Cleaning and setting tools

Annex 7

**Table 6: Maximum processing time and minimum curing time**

Temperature of base material	Maximum processing time <sup>1)</sup>	Minimum curing time in dry concrete <sup>4)</sup>
	$t_{gel}$	$t_{cure,dry}$
0°C to + 4°C	45 <sup>2)</sup> min	7 h
+ 5°C to + 9°C	25 <sup>2)</sup> min	2 h
+ 10°C to + 19°C	15 <sup>2)</sup> min	80 min
+ 20°C to + 24°C	6 <sup>2)</sup> min	45 min
+ 25°C to + 29°C	4 <sup>2)</sup> min	25 min
+ 30°C to + 40°C	2.5 <sup>3)</sup> min	15 min









<sup>1)</sup>  $t_{gel}$ : Maximum of time between the injection of the mortar and the end of the setting process.

<sup>2)</sup> The cartridge temperature **must** be between + 5°C and + 25°C.

<sup>3)</sup> The cartridge temperature **must** be below + 20°C.

<sup>4)</sup> The curing time  $t_{cure,dry}$  shall be doubled in wet concrete.


**Table 7: Dispensing tools**

Cartridge type/size	Hand tool		Pneumatic tool
Coaxial cartridges 150, 280, 300, 330 ml	 VM-P 330		-
Coaxial cartridges 380, 410, 420 ml	 VM-P 380	 VM-P 380 Profi	 VM-P 380 Pneumatic
Side-by-side cartridges 235, 345 ml	 VM-P 345	 VM-P 345 Profi	 VM-P 345 Pneumatic
Side-by-side cartridge 865 ml	-	-	 VM-P 865 Pneumatic

**MKT Injection System VMU eco for rebar connection**

**Processing time and curing time,  
Dispensing tools**

**Annex 8**

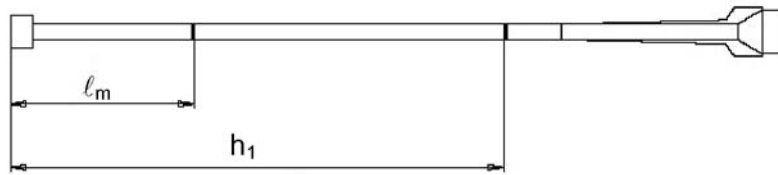

**Figure 8:** Marking lengths  $\ell_m$  on extension pipe for injection of adhesive

**Equation 1:**  $\ell_m = h_1 \cdot (1.2 \cdot d_s^2 / d_0^2 - 0.2)$  [mm]

As a rough estimate  $\ell_m = 1/3 h_1$  can be assumed. Fill the hole with mortar until the marking of  $\ell_m$  is visible.

$\ell_m$  distance from end of retaining washer to marking on extension pipe  
 $h_1$  anchorage length = drill hole depth  
 $d$  rebar diameter  
 $d_0$  nominal drill bit diameter

**Table 8: Retaining washer, maximum anchorage length and extension pipe**

Rebar- $\varnothing$ $d_s$	Drill bit - $\varnothing$		Retaining washer	Cartridge: coaxial (all) , side-by-side (235, 345 ml)				Cartridge: side-by-side (865 ml)		
				Manual dispenser		Pneumatic dispenser		Pneumatic dispenser		
	hammer drilled	compressed air drilled		$l_{max}$	Extension pipe	$l_{max}$	Extension pipe	$l_{max}$	Extension pipe	
[mm]	[mm]		No.	[cm]		[cm]		[cm]		
8	12	-	-	70	VM-XLE 10	80	VM-XLE 10	80	VM-XLE 10	
10	14	-	VM-IA 14					100		
12	16		VM-IA 16			100		120		VM-XLE 16
14	18		VM-IA 18					140		
16	20		VM-IA 20					160		
20	25	26	VM-IA 25	50	VM-XLE 10 VM-XLE 16	70	200	VM-XLE 16		
22	28		VM-IA 28			50			VM-XLE 16	
24	32		VM-IA 32							
25	32		VM-IA 32							

**MKT Injection System VMU eco for rebar connection**

**Marking length,  
Retaining washer, maximum anchorage length and extension pipe**

**Annex 9**

**Table 9: Values for pre-design of anchorings**  
Example for C20/25, good bond conditions, B500 A

Rebar-Ø d <sub>s</sub>	$\alpha_1 = \alpha_2 = \alpha_3 = \alpha_4 = \alpha_5 = 1.0$			$\alpha_2 \text{ or } \alpha_5 = 0.5$ $\alpha_1 = \alpha_3 = \alpha_4 = 1.0$		
	Anchorage length l <sub>bd</sub>	Design value N <sub>Rd</sub>	Mortar volume	Anchorage length l <sub>bd</sub>	Design value N <sub>Rd</sub>	Mortar volume
[mm]	[mm]	[kN]	[ml]	[mm]	[kN]	[ml]
8	170*	9.83	13	170*	14.04	13
	220	12.72	17	190	15.69	14
	270	15.61	20	220	18.17	17
	378	21.85	29	265	21.85	20
10	213*	15.39	19	213*	21.99	19
	280	20.23	25	240	24.77	22
	340	24.57	31	270	27.87	24
	410	29.63	37	300	30.97	27
	473	34.15	43	331	34.15	30
12	255*	22.11	27	255*	31.59	27
	330	28.61	35	290	35.92	31
	410	35.55	43	330	40.88	35
	490	42.49	52	360	44.59	38
	567	49.17	60	397	49.17	42
14	298*	30.15	36	298*	43.06	36
	390	39.45	47	340	49.13	41
	480	48.56	58	380	54.92	46
	570	57.66	69	420	60.7	51
	662	66.93	80	463	66.93	56
16	340*	39.31	46	340*	56.15	46
	440	50.87	60	390	64.41	53
	550	63.59	75	430	71.02	58
	650	75.15	88	480	79.28	65
	756	87.42	103	529	87.42	72
20	425*	61.42	90	425*	87.74	90
	560	80.93	119	480	99.09	102
	690	99.71	146	540	111.48	115
	820	118.5	174	600	123.87	127
	945	136.59	200	662	136.59	140
22	468*	74.4	132	468*	106.28	132
	610	96.97	172	530	120.36	150
	750	119.22	212	600	136.26	170
	900	143.07	254	660	149.88	187
	1040	165.28	294	728	165.28	206
24	510*	88.44	215	510*	126.35	215
	670	116.19	283	580	143.69	245
	820	142.2	346	650	161.03	274
	980	169.95	414	720	178.37	304
	1134	196.69	479	794	196.69	335
25	532*	96.1	200	532*	137.29	200
	690	124.64	259	610	157.42	229
	860	155.35	323	680	175.48	256
	1020	184.25	384	750	193.54	282
	1181	213.42	444	827	213.42	311

\* minimum anchorage length see Annex 5, Table 3

The values apply to 'good' bonding conditions according to EN 1992-1-1. For all other bond conditions the values has to be multiplied by 0.7.

The mortar volume was calculated as follows:  $V = 1.2 \cdot (d_o^2 - d_s^2) \cdot \pi \cdot l_b / 4$

**MKT Injection System VMU eco for rebar connection**

**Values for pre-design of anchorings**  
**Example for C20/25, good bond conditions, B500 A**

**Annex 10**

**Table 10: Values for pre-design of overlap joints**

Example for C20/25, 'good' bond conditions, B500 A

Rebar-Ø d <sub>s</sub>	$\alpha_1 = \alpha_2 = \alpha_3 = \alpha_4 = \alpha_5 = 1.0$			$\alpha_2 \text{ or } \alpha_5 = 0.5$ $\alpha_1 = \alpha_3 = \alpha_4 = 1.0$		
	Anchorage length l <sub>bd</sub>	Design value N <sub>Rd</sub>	Mortar volume	Anchorage length l <sub>bd</sub>	Design value N <sub>Rd</sub>	Mortar volume
[mm]	[mm]	[kN]	[ml]	[mm]	[kN]	[ml]
8	300*	9.83	23	300*	14.04	23
	320	12.72	24	290	15.69	22
	340	15.61	26	280	18.17	21
	378	21.85	29	265	21.85	20
10	300*	15.39	27	300*	21.99	27
	340	20.23	31	310	24.77	28
	390	24.57	35	320	27.87	29
	430	29.63	39	320	30.97	29
	473*	34.15	43	331*	34.15	30
12	300*	22.11	32	300*	31.59	32
	370	28.61	39	320	35.92	34
	430	35.55	45	350	40.88	37
	500	42.49	53	370	44.59	39
	567	49.17	60	397	49.17	42
14	315*	30.15	38	315*	43.06	38
	400	39.45	48	350	49.13	42
	490	48.56	59	390	54.92	47
	570	57.66	69	430	60.7	52
	662	66.93	80	463	66.93	56
16	360*	39.31	49	360*	56.15	49
	460	50.87	62	400	64.41	54
	560	63.59	76	440	71.02	60
	660	75.15	90	490	79.28	67
	756	87.42	103	529	87.42	72
20	450*	61.42	95	450*	87.74	95
	570	80.93	121	500	99.09	106
	700	99.71	148	560	111.48	119
	820	118.5	174	610	123.87	129
	945	136.59	200	662	136.59	140
22	495*	74.4	140	495*	106.28	140
	630	96.97	178	550	120.36	156
	770	119.22	218	610	136.26	172
	900	143.07	254	670	149.88	189
	1040	165.28	294	728	165.28	206
24	540*	88.44	228	540*	126.35	228
	690	116.19	291	600	143.69	253
	840	142.2	355	670	161.03	283
	990	169.95	418	730	178.37	308
	1134	196.69	479	794	196.69	335
25	563*	96.1	212	563*	137.29	212
	720	124.64	271	630	157.42	237
	870	155.35	327	700	175.48	263
	1030	184.25	387	760	193.54	286
	1181	213.42	444	827	213.42	311

\* minimum anchorage length see Annex 5, Table 3

The values apply to 'good' bonding conditions according to EN 1992-1-1. For all other bond conditions the values has to be multiplied by 0.7.

The mortar volume was calculated as follows:  $V = 1.2 \cdot (d_o^2 - d_s^2) \cdot \pi \cdot l_b / 4$

**MKT Injection System VMU eco for rebar connection**

**Values for pre-design of overlap joints**  
**Example for C20/25, good bond conditions, B500 A**

**Annex 11**