

## European Technical Approval ETA-09/0058

English translation prepared by DIBt - Original version in German language

Handelsbezeichnung  
*Trade name*

StoTherm Classic 5

Zulassungsinhaber  
*Holder of approval*

Sto Aktiengesellschaft  
Ehrenbachstraße 1  
79780 Stühlingen  
DEUTSCHLAND

Zulassungsgegenstand  
und Verwendungszweck  
*Generic type and use  
of construction product*

Außenseitiges Wärmedämm-Verbundsystem mit Putzschicht zur  
Wärmedämmung von Gebäuden

*External Thermal Insulation Composite System with rendering for the  
use as external insulation of building walls*

Geltungsdauer:  
*Validity:* vom  
*from*  
bis  
*to*

20 June 2013

20 June 2018

Herstellwerk  
*Manufacturing plant*

Sto Aktiengesellschaft  
Ehrenbachstraße 1  
79780 Stühlingen  
DEUTSCHLAND

Diese Zulassung umfasst  
*This Approval contains*

24 Seiten einschließlich 2 Anhänge  
*24 pages including 2 annexes*

Diese Zulassung ersetzt  
*This Approval replaces*

ETA-09/0058 mit Geltungsdauer vom 25.07.2011 bis 19.04.2014  
*ETA-09/0058 with validity from 25.07.2011 to 19.04.2014*

## I LEGAL BASES AND GENERAL CONDITIONS

- 1 This European technical approval is issued by Deutsches Institut für Bautechnik in accordance with:
  - Council Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations and administrative provisions of Member States relating to construction products<sup>1</sup>, modified by Council Directive 93/68/EEC<sup>2</sup> and Regulation (EC) N° 1882/2003 of the European Parliament and of the Council<sup>3</sup>;
  - *Gesetz über das In-Verkehr-Bringen von und den freien Warenverkehr mit Bauprodukten zur Umsetzung der Richtlinie 89/106/EWG des Rates vom 21. Dezember 1988 zur Angleichung der Rechts- und Verwaltungsvorschriften der Mitgliedstaaten über Bauprodukte und anderer Rechtsakte der Europäischen Gemeinschaften (Bauproduktengesetz - BauPG) vom 28. April 1998<sup>4</sup>, as amended by Article 2 of the law of 8 November 2011<sup>5</sup>;*
  - Common Procedural Rules for Requesting, Preparing and the Granting of European technical approvals set out in the Annex to Commission Decision 94/23/EC<sup>6</sup>;
  - Guideline for European technical approval of "External Thermal Insulation Composite Systems with Rendering", ETAG 004, edition March 2000.
- 2 Deutsches Institut für Bautechnik is authorized to check whether the provisions of this European technical approval are met. Checking may take place in the manufacturing plant. Nevertheless, the responsibility for the conformity of the products to the European technical approval and for their fitness for the intended use remains with the holder of the European technical approval.
- 3 This European technical approval is not to be transferred to manufacturers or agents of manufacturers other than those indicated on page 1, or manufacturing plants other than those laid down in the context of this European technical approval.
- 4 This European technical approval may be withdrawn by Deutsches Institut für Bautechnik, in particular pursuant to information by the Commission according to Article 5(1) of Council Directive 89/106/EEC.
- 5 Reproduction of this European technical approval including transmission by electronic means shall be in full. However, partial reproduction can be made with the written consent of Deutsches Institut für Bautechnik. In this case partial reproduction has to be designated as such. Texts and drawings of advertising brochures shall not contradict or misuse the European technical approval.
- 6 The European technical approval is issued by the approval body in its official language. This version corresponds fully to the version circulated within EOTA. Translations into other languages have to be designated as such.

<sup>1</sup> Official Journal of the European Communities L 40, 11 February 1989, p. 12  
<sup>2</sup> Official Journal of the European Communities L 220, 30 August 1993, p. 1  
<sup>3</sup> Official Journal of the European Union L 284, 31 October 2003, p. 25  
<sup>4</sup> *Bundesgesetzblatt Teil I 1998*, p. 812  
<sup>5</sup> *Bundesgesetzblatt Teil I 2011*, p. 2178  
<sup>6</sup> Official Journal of the European Communities L 17, 20 January 1994, p. 34

## II SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL

### 1 Definition of products and intended use

The External Thermal Insulation Composite System "StoTherm Classic 5" called ETICS in the following text, is designed and installed in accordance with the ETA-holder design and installation instructions, deposited with the Deutsches Institut für Bautechnik (DIBt). The ETICS comprises the following components, which are factory-produced by the ETA-holder or a supplier. It's made up on site from these. The ETA-holder is ultimately responsible for the ETICS.

Depending on the European market, different trade names are used for same component. To simplify, only the "German" trade names appear in the following text. Annex 1 gives the corresponding "French" and "English" trade names.

#### 1.1 Definition of the construction product

	Components (see clause 2.3 for further description, characteristics and performances)	Coverage [kg/m <sup>2</sup> ]	Thickness [mm]
Insulation material with associated method of fixing	<b>Bonded ETICS:</b> <ul style="list-style-type: none"> <li>Insulation product factory-prefabricated expanded polystyrene (EPS) to EN 13163:2008 <ul style="list-style-type: none"> <li>standard EPS</li> <li>elastified EPS</li> </ul> </li> <li><b>Adhesives</b> <ul style="list-style-type: none"> <li><b>Sto-Baukleber</b> (cement based powder requiring addition of 21 – 23 % of water)</li> <li><b>StoLevell Duo plus</b> (cement based powder requiring addition of about 25 % of water)</li> <li><b>StoLevell Uni</b> (cement based powder requiring addition of 24 - 26 % of water)</li> <li><b>Sto-Dispersionskleber</b> (organic based ready to use paste)</li> <li><b>Sto PrefaColl</b> (organic based ready to use paste)</li> <li><b>Sto PrefaColl 500</b> (organic based ready to use paste)</li> </ul> </li> </ul>	— — 3.0 to 5.0 (powder) 4.0 to 4.5 (powder) 3.0 to 4.5 (powder) 1.0 to 1.5 (prepared) 0.8 to 1.5 (prepared) about 1.3 (prepared)	≤ 400 ≤ 200 — — — — — —
	<b>Mechanically fixed ETICS with profiles and supplementary adhesive:</b> <ul style="list-style-type: none"> <li>Insulation product factory-prefabricated expanded polystyrene (EPS) to EN 13163:2008 <ul style="list-style-type: none"> <li>standard EPS</li> </ul> </li> <li><b>Supplementary adhesive</b> (equal to bonded ETICS)</li> </ul>	—	60 to 200

	<b>Components</b> (see clause 2.3 for further description, characteristics and performances)	<b>Coverage</b> [kg/m <sup>2</sup> ]	<b>Thickness</b> [mm]
<b>Insulation material with associated method of fixing</b>	<ul style="list-style-type: none"> <li>• <b>Profiles</b> <ul style="list-style-type: none"> <li>- Sto-Halteleiste PVC and</li> <li>- Sto-Verbindungsleiste PVC</li> </ul> </li> <li>• <b>Anchors for profiles</b> <ul style="list-style-type: none"> <li>- ejotherm SK U</li> <li>- WS 8 L</li> <li>- WS 8 N</li> <li>- ejotherm SDK U</li> <li>- IsoFux ND-8Z</li> <li>- SDF-K plus, SDF-S plus</li> <li>- ejotherm NK U</li> </ul> </li> </ul>		
	<p><b>Mechanically fixed ETICS with anchors and supplementary adhesive:</b></p> <ul style="list-style-type: none"> <li>• <b>Insulation product</b> factory-prefabricated expanded polystyrene (EPS) to EN 13163:2008 <ul style="list-style-type: none"> <li>- standard EPS</li> <li>- elastified EPS</li> </ul> </li> <li>• <b>Supplementary adhesive</b> (equal to bonded ETICS)</li> <li>• <b>Anchors for insulation product</b> all anchors with ETA according to ETAG 014<sup>7</sup> with characteristics defined in clause 2.3.2</li> </ul>	<p>–</p> <p>–</p>	<p>60 to 400</p> <p>60 to 200</p>
<b>Base coat</b>	<p><b>StoArmat Classic plus</b> Ready to use paste (cement free): acrylic copolymer binder, silicate fillers, fibres and additives</p> <p><b>StoArmat Classic plus QS</b> Ready to use paste (cement free): acrylic copolymer binder, silicate fillers, fibres and specific additives (application between 0 °C and 15 °C)</p>	<p>3.5 to 4.0</p> <p>about 3.5</p>	<p>2.5 to 3.0*</p> <p>Mean (dry): 2.0*</p> <p>Minimal (dry): 1.8</p>
<b>Glass fibre mesh</b>	<p><b>Sto-Glasfasergewebe</b> Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 150 g/m<sup>2</sup> and mesh size of about 6.0 mm x 6.0 mm.</p>	–	–
	<p><b>Sto-Glasfasergewebe F</b> Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 160 g/m<sup>2</sup> and mesh size of about 4.0 mm x 4.0 mm.</p>	–	–

<sup>7</sup>

ETAG 014

Plastic anchors for fixing of external thermal insulation composite systems with rendering

	Components (see clause 2.3 for further description, characteristics and performances)	Coverage [kg/m <sup>2</sup> ]	Thickness [mm]
<b>Glass fibre mesh</b>	<p><b>Sto-Fibre de Verre Ra 60</b> Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 175 g/m<sup>2</sup> and mesh size of about 4.0 mm x 4.0 mm.</p> <p><b>Sto-Panzergerewebe</b> (reinforced mesh implemented in addition to the meshes described above to improve the impact resistance) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 500 g/m<sup>2</sup> and mesh size of about 7.5 mm x 7.5 mm.</p> <p><b>Sto-Abschirmgerewebe AES</b> (special mesh including a thin stainless yarn to reduce radiation of electric fields) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 170 g/m<sup>2</sup> and mesh size of about 4.0 mm x 4.0 mm.</p>	<p>–</p> <p>–</p> <p>–</p>	<p>–</p> <p>–</p> <p>–</p>
<b>Finishing coat</b>	<ul style="list-style-type: none"> <li>Ready to use pastes - acrylic binder: <ul style="list-style-type: none"> <li><b>Stolit K</b> (particle size 1.0 to 6.0 mm)</li> <li><b>Stolit R</b> (particle size 1.5 to 6.0 mm)</li> <li><b>Stolit Effect</b> (particle size 3.0 mm)</li> <li><b>Stolit MP</b> (thin, middle or thick layer)</li> <li><b>Stolit Milano</b></li> <li><b>Stolit K</b> (particle size 1.5 mm) + <b>Stolit Milano</b></li> <li><b>Sto-Ispolit K</b> *** (particle size 1.5 – 2.5 and 3.5 mm)</li> <li><b>StoSuperlit K</b> *** (particle size 1.5 to 2.0 mm)</li> <li><b>StoLotusan K</b> (particle size 1.0 to 3.0 mm)</li> <li><b>StoLotusan MP</b> (thin, middle or thick layer)</li> </ul> </li> <li>Ready to use paste - acrylic binder - associated with a decorative paint: <ul style="list-style-type: none"> <li><b>StoNivellit +</b></li> <li><b>StoSilco Color</b> (acrylic/ siloxane binder)</li> </ul> </li> <li>Ready to use paste - acrylic binder - associated with synthetic briquettes: <ul style="list-style-type: none"> <li><b>Sto-Klebe- und Fugenmörtel +</b></li> <li><b>Sto-Flachverblender - size I, II and III</b> ***</li> </ul> </li> </ul>	<p>2.0 to 6.5</p> <p>2.2 to 6.1</p> <p>4.5 to 5.5</p> <p>2.2 to 4.7</p> <p>2.0 to 4.0</p> <p>about 2.3 + about 3.0</p> <p>2.3 to 4.3</p> <p>4.5 to 6.0</p> <p>2.0 to 5.0</p> <p>2.2 to 4.7</p> <p>3.0 to 3.5</p> <p>0.2 to 0.4 l/m<sup>2</sup></p> <p>3.0 to 4.0</p> <p>76, 64 and 48 pieces/m<sup>2</sup>**</p>	<p>} Regulated by particle size*</p> <p>1.5 to 3.5</p> <p>1.0* to 2.0</p> <p>2.0 to 3.0</p> <p>1.5 to 3.5</p> <p>1.0* to 1.5</p> <p>4.0 to 7.0</p>
<b>Finishing coat</b>	<ul style="list-style-type: none"> <li>Ready to use pastes – acrylic/ siloxane binder: <ul style="list-style-type: none"> <li><b>Sto-Silkolit K</b> *** (particle size 1.5 – 2.5 and 3.5 mm)</li> <li><b>StoSilco K</b> (particle size 1.0 to 3.0 mm)</li> <li><b>StoSilco R</b> (particle size 1.5 to 3.5 mm)</li> <li><b>StoSilco MP</b> (thin, middle or thick layer)</li> </ul> </li> </ul>	<p>2.3 to 4.3</p> <p>2.0 to 5.0</p> <p>2.9 to 4.5</p> <p>2.2 to 4.7</p>	<p>} Regulated by particle size*</p> <p>1.5 to 3.5</p>

	<b>Components</b> (see clause 2.3 for further description, characteristics and performances)	<b>Coverage</b> [kg/m²]	<b>Thickness</b> [mm]
<b>Finishing coat</b>	<ul style="list-style-type: none"><li>Ready to use paste – acrylic binder: (application between 0 °C and 15 °C): <b>Stolit QS K</b> (particle size 1.0 to 3.0 mm) <b>Stolit QS R</b> (particle size 1.5 to 3.0 mm) <b>Stolit QS MP</b> (thin, middle or thick layer)</li><li>Ready to use paste – acrylic/ siloxane binder (application between 0 °C and 15 °C): <b>StoSilco QS K</b> (particle size 1.0 to 3.0 mm) <b>StoSilco QS R</b> (particle size 1.5 to 3.0 mm) <b>StoSilco QS MP</b> (thin, middle or thick layer)</li><li>Ready to use pastes - silicate binder: <b>StoSiliqua K</b> (particle size 1.0 to 3.0 mm)</li></ul>	<div>2.0 to 4.8 2.2 to 4.5 2.2 to 4.7</div> <div>2.0 to 5.0 2.9 to 4.5 2.2 to 4.7</div> <div>2.2 to 4.3</div>	<div>} Regulated by particle size 1.5 to 3.5</div> <div>} Regulated by particle size 1.5 to 3.5</div> <div>Regulated by particle size</div>
<b>Decorative paint</b>	<ul style="list-style-type: none"><li>Ready to use paint with acrylic/siloxane binder: <b>StoSilco Color</b></li></ul>	0.2 to 0.4 l/m²	–
<b>Ancillary material</b>	Description in accordance with clause 3.2.2.5 of ETAG 004 and decorative coatings compatible with the ETICS to be applied to the finishing coat. Remains the responsibility of the ETA-holder.		
<div>* The minimum thickness of the rendering system (base coat + finishing coat) is 4.0 mm.</div> <div>** Depend on the size of the pieces (I, II or III).</div> <div>*** Applicable with the base coat "StoArmat Classic plus" only</div>			

## 1.2 Intended use

This ETICS is intended to be used as external insulation to the walls of buildings made of masonry (bricks, blocks, stones ...) or concrete (cast on site or as prefabricated panels) with and without rendering (Class A1 or A2 - s1,d0 according to EN 13501-1:2007). It shall be designed to give the wall to which it is applied satisfactory thermal insulation.

The ETICS is no load-bearing construction element. It does not contribute directly to the stability of the wall on which it is installed, but it can contribute to durability by providing enhanced protection from the effects of weathering.

The ETICS can be used on new or existing (retrofit) vertical walls.

The ETICS is not intended to ensure the air tightness of the building structure.

The choice of the method of fixing depends on the characteristics of the substrate, which could need preparation (see clause 7.2.1 of ETAG 004) and on the national instructions.

The provisions made in this European Technical Approval (ETA) based upon the assumed intended working life of the ETICS of at least 25 years, provided that the conditions laid down in sections 4.2, 5.1 and 5.2 for the packaging, transport, storage, installation as well as appropriate use, maintenance and repair are met. The indications given as to the working life cannot be interpreted as a guarantee given by the manufacturer or the Approval Body, but should only be regarded as a means to choosing the appropriate products in relation to the expected, economically reasonable working life of the works.

## 2 Characteristics of products and methods of verification

### 2.1 General

The assessment of the fitness for use of the ETICS for the intended use according to the Essential Requirements was carried out in compliance with ETAG 004, "Guideline for European Technical Approval of External Thermal Insulation Composite Systems with rendering", edition March 2000 (called ETAG 004 in this ETA).

Characteristics (of the components as well as of the ETICS), not mentioned in this ETA nor in the annexes shall correspond to the respective values laid down in the technical documentation of this ETA.

### 2.2 Characteristics of the ETICS

#### 2.2.1 Reaction to fire

Rendering system: Base coat with finishing coat indicated hereafter	Maximum declared organic content	Class according to EN 13501-1: 2007	Maximum declared organic content	Class according to EN 13501-1: 2007
	"StoArmatClassic plus"		"StoArmat Classic plus QS"	
Stolit K/R (particle size 3.5 to 6.0 mm)	Base coat ≤ 7.6 % Finishing coat ≤ 9.8 %	C – s2,d0	Base coat ≤ 9.3 % Finishing coat ≤ 9.8 %	C – s2,d0
Stolit K/R (particle size 1.0 to 3.0 mm)	Base coat ≤ 7.6 % Finishing coat ≤ 9.8 %	B – s2,d0	Base coat ≤ 9.3 % Finishing coat ≤ 9.8 %	
Stolit Effect/MP				
Stolit Milano				
Stolit K1.5 + Stolit Milano				
Sto-Ispolit K *				-
StoLotusan K/MP	Base coat ≤ 7.6 % Finishing coat ≤ 9.8 %	B – s2,d0	Base coat ≤ 9.3 % Finishing coat ≤ 9.8 %	C – s2,d0
StoNivellit + StoSilco Color				-
Sto-Silkolit K *				C – s2,d0
StoSilco K/R/MP				
Stolit QS K/R/MP				
StoSilco QS K/R/MP	Base coat ≤ 7.6 % Finishing coat ≤ 8.4 %	B – s2,d0	Base coat ≤ 9.3 % Finishing coat ≤ 8.4 %	-
Sto-Klebe- und Fu- genmörtel + Sto- Flachverblender *				
StoSuperlit K * StoSiliqua K				

\* Applicable with the base coat "StoArmat Classic plus" only

\* Applicable with the base coat "StoArmat Classic plus" only



Mounting and fixing, ETICS with base coat "StoArmat Classic plus"

Class B – s2,d0

(for all end use applications given in clause 1.2 of the ETA)

The assessment of reaction to fire is based on tests with a maximum insulation layer thickness of 180 mm (testing according to EN 13823:2002 - SBI test), resp. about 50 mm (testing according to EN ISO 11925-2:2002) and a maximum insulation material (EPS) density of 20 kg/m<sup>3</sup> as well as a organic based rendering systems with highest organic content.

The manufacturer of the tested EPS is laid down in the technical documentation of this ETA. EPS with higher density than tested or with other chemical composition or of another manufacturer, which fulfils the requirements of clause 2.3.1 and is deposited with the DIBt, can be used if it fulfils the requirements of Class E according to EN 13501-1:2007 by testing specimens with a thickness of 10 mm and with the highest possible density.

For rendering systems with organic based ready to use paste finishing coats the assessment of reaction to fire is based on tests with a particle size of 3 mm.

For the rendering system with the finishing coat "Sto-Klebe- und Fugenmörtel + Sto-Flachverblander" the assessment of reaction to fire is based on tests with a layer thickness of about 6 mm.

For the SBI test, the ETICS was mounted directly to a calcium silicate substrate (Class A2 - s1,d0) according to EN 13238 with a thickness of 11 mm.

For testing according to EN ISO 11925-2:2002 no substrate was used.

The installation of the ETICS was carried out by the approval holder following his design and installation instructions using a single mesh "Sto-Panzergerewebe" all over the test specimen (no overlapping glass fibre mesh).

The tests specimens were prefabricated and did not include any joints.

For the SBI-test the lateral edges were covered with the rendering system.

For testing according to EN ISO 11925-2:2002 the edges were not covered with the rendering system (cut edges). The tests were performed with surface flaming of the front side and edge flaming.

Anchors were not included in the tested ETICS as they have no influence on the test result.

Mounting and fixing, ETICS with base coat "StoArmat Classic plus"

Class C – s2,d0

(for all end use applications given in clause 1.2 of the ETA)

The assessment of reaction to fire is based on tests with a maximum insulation layer thickness of 180 mm (testing according to EN 13823:2002 - SBI test), resp. about 40 mm (testing according to EN ISO 11925-2:2002) and a maximum insulation material (EPS) density of 20 kg/m<sup>3</sup> as well as a the organic based rendering system with the highest organic content.

The manufacturer of the tested EPS is laid down in the technical documentation of this ETA. EPS with higher density than tested or with other chemical composition or of another manufacturer, which fulfils the requirements of clause 2.3.1 and is deposited with the DIBt, can be used if it fulfils the requirements of Class E according to EN 13501-1:2007 by testing specimens with a thickness of 10 mm and with the highest possible density.

The assessment of reaction to fire is based on tests with a rendering system with a finishing coat particle size of 6 mm.

For the SBI test, the ETICS was mounted directly to a calcium silicate substrate (Class A2 - s1,d0) according to EN 13238.

For testing according to EN ISO 11925-2:2002 no substrate was used.



The installation of the ETICS was carried out by the approval holder following his design and installation instructions using a single mesh "Sto-Glasfasergewebe" all over the test specimen (no overlapping glass fibre mesh).

The tests specimens were prefabricated and did not include any joints.

For the SBI-test the lateral edges were covered with the rendering system.

For testing according to EN ISO 11925-2:2002 the edges were not covered with the rendering system (cut edges). The tests were performed with surface flaming of the front side and edge flaming.

Anchors were not included in the tested ETICS as they have no influence on the test result.

Mounting and fixing, ETICS with base coat "StoArmat Classic plus QS"

Class C – s2,d0

(for all end use applications given in clause 1.2 of the ETA)

The assessment of reaction to fire is based on tests with a maximum insulation layer thickness of 100 mm (testing according to EN 13823:2002 - SBI test and to EN ISO 11925-2:2002) and a maximum insulation material (EPS) density of 20 kg/m<sup>3</sup> as well as a the organic based rendering system with the highest organic content.

The manufacturer of the tested EPS is laid down in the technical documentation of this ETA. EPS with higher density than tested or with other chemical composition or of another manufacturer, which fulfils the requirements of clause 2.3.1 and is deposited with the DIBt, can be used if it fulfils the requirements of Class E according to EN 13501-1:2010 by testing specimens with a thickness of 10 mm and with the highest possible density.

The assessment of reaction to fire is based on tests with a rendering system with a finishing coat particle size of 6 mm.

For the SBI test and for testing according to EN ISO 11925-2:2002, the ETICS was applied on standard plasterboards (Class A2 - s1,d0) according to EN 13238.

The installation of the ETICS was carried out by the approval holder following his design and installation instructions using a single mesh "Sto-Glasfasergewebe" all over the test specimen (no overlapping glass fibre mesh).

The tests specimens were prefabricated and did not include any joints.

For the SBI-test the lateral edges were covered with the rendering system.

For testing according to EN ISO 11925-2:2002 the edges were not covered with the rendering system (cut edges). The tests were performed with surface flaming of the front side and edge flaming.

Anchors were not included in the tested ETICS as they have no influence on the test result.

Note:

A European reference fire scenario for façades has not been laid down. In some Member States, the classification of ETICS according to EN 13501-1:2007 might not be sufficient for the use in facades. An additional assessment of ETICS according to national provisions (e. g. on the basis of a large scale test) might be necessary to comply with Member State regulations, until the existing European classification system has been completed.

## 2.2.2 Water absorption (capillarity test)

Base coat	Water absorption after 1 h < 1 kg/m <sup>2</sup>	Water absorption after 24 h < 0.5 kg/m <sup>2</sup>
StoArmat Classic plus	x	x
StoArmat Classic plus QS	x	x

Rendering system: Both base coats with compatible finishing coat indicated hereafter	Water absorption after 24 h	
	< 0.5 kg/m <sup>2</sup>	≥ 0.5 kg/m <sup>2</sup>
Stolit K/R/Effect/MP	x	
Stolit Milano	x	
Stolit K1.5 + Stolit Milano	x	
Sto-Ispolit K *	x	
StoLotusan K/MP	x	
Sto-Klebe- und Fugenmörtel + Sto-Flachverblender *	x	
StoSuperlit K *	x	
StoNivellit + StoSilco Color	x	
Sto-Silkolit K *	x	
StoSilco K/R/MP	x	
Stolit QS K/R/MP	x	
StoSilco QS K/R/MP	x	
StoSiliqua K	x	
* Applicable with the base coat "StoArmat Classic plus" only		

## 2.2.3 Hygrothermal behaviour

Hygrothermal cycles have been performed with both base coats each on a rig. None of the following defects occur during the testing:

- blistering or peeling of any finishing
- failure or cracking associated with joints between insulation product boards or profiles fitted with system
- detachment of render
- cracking allowing water penetration to the insulation layer.

The ETICS is so assessed resistant to hygrothermal cycles.

## 2.2.4 Freeze/thaw behaviour

The water absorption of the base coat as well as the rendering system is less than 0.5 kg/m<sup>2</sup> after 24 hours for all configurations of the ETICS. The ETICS is so assessed as freeze/thaw resistant.

## 2.2.5 Impact resistance

The verified resistance to hard body impact and to perforation of the ETICS lead to the following classification into categories (Standard mesh: "Sto-Glasfasergewebe", "Sto-Glasfasergewebe F" or "Sto-Fibre de Verre Ra 60").

Rendering system: Base coat with finishing coat indicated hereafter	Single standard mesh +		"Sto-Abschirm-gewebe AES" + "StoArmat Classic plus"	Double mesh: Sto-Glasfaser-gewebe +		Standard mesh + Sto-Panzer-gewebe both base coats
	"StoArmat Classic plus"	"StoArmat Classic plus QS"		"StoArmat Classic plus"	"StoArmat Classic plus QS"	
Stolit K/R/Effect/MP	Category II	Category II	Category II	Category II	Category I	Category I
Stolit Milano	Category II	Category II	Category II	Category II	Category I	Category I
Stolit K1.5 + Stolit Milano	Category II	Category II	Category II	Category I	Category I	Category I
Sto-Ispolit K*	Category II	-	npd	Category II	-	Category I
StoLotusan K/MP	Category II	Category II	Category II	Category II	Category I	Category I
Sto-Klebe- und Fugenmörtel/Sto-Flachverbinder*	Category I	-	Category I	Category I	-	Category I
StoSuperlit K*	Category II	-	Category II	Category I	-	Category I
StoNivellit + StoSilco Color	Category III	Category II	Category III	Category II	Category I	Category I
Sto-Silkolit K*	Category II	-	npd	Category II	-	Category I
StoSilco K/R/MP	Category II	Category II	Category II	Category II	Category I	Category I
Stolit QS K/R/MP	Category II	Category II	Category II	Category II	Category I	Category I
StoSilco QS K/R/MP	Category II	Category II	Category II	Category I	Category I	Category I
StoSiliqua K	Category II	Category II	npd	Category II	Category I	Category I
* Applicable with the base coat "StoArmat Classic plus" only						

## 2.2.6 Water vapour permeability

Rendering system: Base coat with finishing coat indicated hereafter	Equivalent air thickness $s_d$	
	"StoArmat Classic plus"	"StoArmat Classic plus QS"
Stolit K/R/Effect/MP	$\leq 1.5$ m (Test result obtained with Stolit K2: 1.0 m)	$\leq 1.0$ m (Test result obtained with Stolit K2: 0.85 m)
Stolit Milano	$\leq 1.5$ m (Test result obtained with $d = 1$ mm: 1.1 m)	$\leq 1.0$ m (Test result obtained with $d = 1$ mm: 0.95 m)
Stolit K1.5 + Stolit Milano	$\leq 2.0$ m (Test result obtained with $d = 2.5$ mm: 1.4 m)	$\leq 2.0$ m (Test result obtained with $d = 2.5$ mm: 1.3 m)

Rendering system: Base coat with finishing coat indicated hereafter	Equivalent air thickness $s_d$	
	"StoArmat Classic plus"	"StoArmat Classic plus QS"
Sto-Ispolit K*	≤ 1.0 m (Test result obtained with d = 2.5 mm: 0.41 m)	-
StoLotusan K/MP	≤ 1.0 m (Test result obtained with StoLotusan K2: 0.8 m)	≤ 1.0 m (Test result obtained with StoLotusan K2: 0.7 m)
Sto-Klebe- und Fugenmörtel + Sto-Flachverblender*	≤ 1.0 m (Test result obtained with size III: 0.8 m)	-
StoSuperlit K*	≤ 1.0 m (Test result obtained with "Farbsand" (specialcolour coated grain) K2: 1.0 m) (Test result obtained with "Silmer" (natural coloured grain) K2: 0.9 m)	-
StoNivellit + StoSilco Color	≤ 1.0 m (Test result: 0.9 m)	≤ 1.0 m (Test result: 0.75 m)
Sto-Silkolit K*	≤ 1.0 m (Test result obtained with d = 2.5 mm: 0.21 m)	-
StoSilco K/R/MP	≤ 1.0 m (Test result obtained with StoSilco K2: 0.9 m)	≤ 1.0 m (Test result obtained with StoSilco K2: 0.75 m)
Stolit QS K/R/MP	≤ 1.0 m (Test result obtained with Stolit QS K2: 0.9 m)	≤ 1.0 m (Test result obtained with Stolit QS K2: 0.75 m)
StoSilco QS K/R/MP	≤ 1.0 m (Test result obtained with StoSilco QS K2: 0.9 m)	≤ 1.0 m (Test result obtained with StoSilco QS K2: 0.75 m)
StoSiliqua K	≤ 1.0 m (Test result obtained with StoSiliqua K2: 0.7 m)	≤ 1.0 m (Test result obtained with StoSiliqua K2: 0.55 m)
* Applicable with the base coat "StoArmat Classic plus" only		

## 2.2.7 Emission of dangerous substances and radiation

The ETICS comply with the provisions of Guidance Paper H ("A harmonized approach related to dangerous substances under the construction product directives Revision August 2002").

In addition to the specific clauses relating to dangerous substances contained in this ETA, there may be other requirements applicable to the ETICS falling within its scope (e. g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Directive, these requirements need also to be complied with, when and where they apply.

## 2.2.8 Safety in use

### 2.2.8.1 Bond strengths

Bond strength between base coat and insulation product (EPS)

Base coat	Conditioning		
	Initial state	After hygrothermal cycles on the rig	After freeze/thaw test
StoArmat Classic plus	≥ 0.08 MPa	≥ 0.08 Mpa	Test not required because freeze/thaw cycles not necessary
StoArmat Classic plus QS	≥ 0.08 MPa	≥ 0.08 MPa	

Bond strength between adhesive and substrate resp. insulation product (EPS)

Adhesive	Substrate resp. insulation product	Conditioning		
		Initial state	2 d immersion in water + 2 h drying	2 d immersion in water + 7 d drying
Sto-Baukleber	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
StoLevell Duo Plus	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
StoLevell Uni	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
Sto-Dispersions- kleber	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	Brick	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
StoPrefa Coll	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	Brick	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
StoPrefa Coll 500	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	Brick	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	EPS	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa

For bonded ETICS the calculated minimal bonded surface area, according to ETAG 004 clause 6.1.4.1.3 is 40 %.

2.2.8.2 Fixing strength (displacement test)

Test not required because the ETICS fulfils the following criterion to clause 5.1.4.2 of ETAG 004:

-  $E \cdot d < 50\,000 \text{ N/mm}$

(E: modulus of elasticity of the base coat – d: mean dried thickness of the base coat)

2.2.8.3 Wind load resistance

Safety in use of mechanically fixed ETICS using profiles

The following failure loads only apply to the listed combination (EPS panel's characteristics)/ (way of fixing the profiles) and the characteristics of the insulation product given in clause 2.3.1.

Characteristics of the EPS (standard EPS)	Dimensions	500 mm x 500 mm
	Thickness	≥ 60 mm
	Tensile strength perpendicular to the faces	≥ 150 kPa
	Shear modulus	≥ 1.0 N/mm <sup>2</sup>
Failure loads [N/panel] (Static Foam Block Test)	Horizontal profiles fixed every 30 cm and 49.4 cm long vertical connection profiles	Minimal: 950 Average: 1010

Safety in use of mechanically fixed ETICS using anchors

The following failure loads only apply to the listed combination (EPS panel's characteristics)/ (anchor plate's characteristics) and the characteristics of the insulation product given in clause 2.3.1.

Apply to all anchors listed in the Table in clause 1.1 mounted on the insulation panels surface				
Characteristics of the EPS (standard EPS)	Thickness		≥ 60 mm	
	Tensile strength perpendicular to the faces		≥ 100 kPa	
	Shear modulus		≥ 1.0 N/mm <sup>2</sup>	
Plate diameter of anchor			Ø 60 mm	Ø 90 mm
Failure loads [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R <sub>panel</sub>	Minimal: 510 Average: 520	Minimal: 720 Average: 730
	Anchors placed at the panel joints (Pull-through test)	R <sub>joint</sub>	Minimal : 400 Average: 430	Minimal: 430 Average: 470

Apply to all anchors listed in the Table in clause 1.1 mounted on the insulation panels surface			
Characteristics of the EPS (elastified EPS)	Thickness		≥ 60 mm
	Tensile strength perpendicular to the faces		≥ 80 kPa
	Shear modulus		≥ 0.3 N/mm²
Plate diameter of anchor			Ø 60 mm
Failure loads [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R <sub>panel</sub>	Minimal: 350 Average: 360
	Anchors placed at the panel joints (Pull-through test)	R <sub>joint</sub>	Minimal: 300 Average: 310

The failure loads specified above for a plate diameter of anchor of 60 mm apply to the following anchors with deep mounting but only on the following conditions of installation:

Anchor	Thickness of the EPS [d]	Conditions of installation*
ejotharm STR U, ejotharm STR U 2G (ETA-04/0023)	100 mm > d ≥ 80 mm (for standard and elastified EPS)	– Maximum installation depth of the anchor plate: 15 mm (△ thickness of insulation cover) – Maximum depth of die: 5 mm
	≥ 100 mm (for standard and elastified EPS)	– Maximum installation depth of the anchor plate: 15 mm (△ thickness of insulation cover) – Maximum depth of die: 20 mm
IsoFux NDT8LZ (ETA-05/0080)	≥ 80 mm (for standard and elastified EPS)	– Maximum depth of countersink: 20 mm
TERMOZ 8 SV (ETA-06/0180)	≥ 80 mm (for standard EPS only)	– Maximum installation depth of the anchor plate: 15 mm (△ thickness of insulation cover)
* According to the appropriate ETA of anchor		

The wind load resistance R<sub>d</sub> of the ETICS is calculated as follows:

$$R_d = \frac{R_{\text{panel}} \cdot n_{\text{panel}} + R_{\text{joint}} \cdot n_{\text{joint}}}{\gamma}$$

$n_{\text{panel}}$ : number (per m<sup>2</sup>) of anchors not placed at the panel joints

$n_{\text{joint}}$ : number (per m<sup>2</sup>) of anchors placed at the panel joint

$\gamma$ : national safety factor

## 2.2.9 Thermal resistance

The nominal value of the additional thermal resistance  $R$  provided by the ETICS to the substrate wall is calculated in accordance with EN ISO 6946:2007 from the nominal value of the insulation product's thermal resistance  $R_D$  given accompanied to the CE marking and from the thermal resistance of the rendering system  $R_{\text{render}}$  which is about 0.02 (m<sup>2</sup> · K)/W.

$$R = R_D + R_{\text{render}}$$

The thermal bridges caused by anchors increase the thermal transmittance  $U$ . This influence had to take into account according to EN ISO 6946:2007.

$$U_c = U + \chi_p \cdot n$$

Corrected thermal transmittance

where:  $\chi_p \cdot n$

influence of thermal bridges, not need to be taken into account if  $\leq 0.04 \text{ W}/(\text{m}^2 \cdot \text{K})$

$n$

number of anchors per m<sup>2</sup>

$\chi_p$

local influence of thermal bridge caused by an anchor. The values listed below can be taken into account, if not specified in the anchor's technical approval

$$\chi_p = 0.004 \text{ W/K}$$

for anchors with a galvanized steel screw with the head covered by a plastic material

$$\chi_p = 0.002 \text{ W/K}$$

for anchors with a stainless steel screw with the head covered by plastic material, and for anchors with an air gap at the head of the screw

The thermal bridges caused by profiles are negligible.

## 2.2.10 Aspects of durability and serviceability

Bond strength after ageing

<b>Rendering system:</b> Both base coats with finishing coat indicated hereafter	Stolit K/R/Effect/MP	≥ 0.08 MPa
	Stolit Milano	
	Stolit K1.5 + Stolit Milano	
	Sto-Ispolit K*	
	StoLotusan K/MP	
	Sto-Klebe- und Fugenmörtel + Sto-Flachverblander*	
	StoSuperlit K*	
	StoNivellit + StoSilco Color	
	Sto-Silkolit K*	
	StoSilco K/R/MP	
	Stolit QS K/R/MP	
	StoSilco QS K/R/MP	
	StoSiliqua K	
* Applicable with the base coat "StoArmat Classic plus" only		



### 2.3 Characteristics of the components

Detailed information on the chemical composition and other identifying characteristics of the components, following Annex C of ETAG 004 has been deposited with the DIBt.

Further information can be observed from the product data sheets, which are part of the technical documentation for this ETA.

#### 2.3.1 Thermal insulation product

Factory-prefabricated, uncoated panels made of expanded polystyrene (EPS) to EN 13163:2008 shall be used, having the description and characteristics defined in the Table below.

Description and characteristics	For bonded ETICS	For mechanically fixed ETICS	
		with anchors and supplementary adhesive	with profiles and supplementary adhesive
Reaction to fire; EN 13501-1:2007	Class E*		
Thermal resistance [(m²·K)/W]	Defined in the CE marking in reference to EN 13163:2008		
<b>Tolerances</b>			
Length; EN 822:1994	± 0.6 % or ± 3 mm whichever gives the greatest numerical tolerance (class L1 or class L2)		
Width [mm]; EN 822:1994	± 2 (class W2)		
Thickness [mm]; EN 823:1994	± 1 (class T2)		
Squareness [mm/m]; EN 824:1994	± 2 (class S2)		
Flatness [mm/m]; EN 825:1994	5 (class P4)		
<b>Dimensional stability under</b>			
- laboratory conditions [%]; EN 1603:1996	± 0.2 (class DS(N)2)		
- specified temperature and humidity conditions [%]; EN 1604:1996	2 (level DS(70,-)2 or level DS(70,-)1)		
Water absorption (long term partial immersion) [kg/m²]; EN 12087:1997	W <sub>lp</sub> ≤ 0.5		
Water vapour diffusion resistance factor; EN 12086:1997	μ = 20 – 70		
Tensile strength perpendicular to the faces in dry conditions** [kPa]; EN 1607:1996			
- standard EPS	σ <sub>mt</sub> ≥ 80	σ <sub>mt</sub> ≥ 100	σ <sub>mt</sub> ≥ 150
- elastified EPS***	σ <sub>mt</sub> ≥ 80	σ <sub>mt</sub> ≥ 80	not used
Bending strength** [kPa]; EN 12089:1997	σ <sub>b</sub> ≥ 50		
Apparent density [kg/m³]; EN 1602:1996	ρ <sub>a</sub> ≤ 30		
Shear strength** [kPa]; EN 12090:1997	20 ≤ f <sub>tk</sub> ≤ 170		

Description and characteristics	For bonded ETICS	For mechanically fixed ETICS	
		with anchors and supplementary adhesive	with profiles and supplementary adhesive
Shear modulus [MPa]; EN 12090:1997	$1.0 \leq G_m \leq 3.8$		
- standard EPS			
- elastified EPS***	$0.3 \leq G_m \leq 1.0$	$0.3 \leq G_m \leq 1.0$	not used
Testing of characteristics see EN 13163:2008.			
<p>* See the conditions of clause 2.2.1 for the EPS.</p> <p>** Minimal value of all single values</p> <p>*** Elastified EPS is made from standard EPS by short time high load pressing to reduce the dynamic stiffness. The protection against noise of the entire wall is improved by the use of elastified EPS related to an ETICS with standard EPS.</p>			

Thermal insulation materials for mechanically fixed ETICS with profiles must circumferentially at the edges, 24 mm from the inner surface, get an approx. 3 mm wide and 13 to 18 mm deep groove cut-in at the factory.

### 2.3.2 Anchors

All anchors with ETA according to ETAG 014<sup>7</sup> with characteristics having the description below shall be used in the mechanically fixed ETICS:

- plate diameter of anchor  $\geq 60$  mm resp.  $\geq 90$  mm
- plate stiffness  $\geq 0.3$  kN/mm
- load resistance of the anchor plate  $\geq 1.0$  kN

These characteristics and the characteristic tension resistance of the anchors shall be taken from the corresponding ETA.

The anchors listed in the Table in clause 1.1 with reference to the respective ETA shall be used in the mechanically fixed ETICS with profiles for fixing the horizontal profiles.

Trade name	ETA-number
ejothem SK U	ETA-02/0018
WS 8 L	ETA-02/0019
WS 8 N	ETA-03/0019
ejothem SDK U	ETA-04/0023
IsoFux ND-8Z	ETA-04/0032
SDF-K plus, SDF-S plus	ETA-04/0064
ejothem NK U	ETA-05/0009

### 2.3.3 Profiles

Polyvinyl chloride (PVC) profiles, PVC-U, EGL, 082-05-T33 to EN ISO 1163-1:1999, with the measurements according to Annex 2 are to be used in the mechanically fixed ETICS with profiles.

The Pull-through resistance of fixings from profiles is  $\geq 500$  N.

### 2.3.4 Render (base coat)

No cracks occurred during the Render Strip Tensile Test of both base coats reinforced with the glass fibre mesh "Sto-Glasfasergewebe" at a render strain value of 1 %.

### 2.3.5 Reinforcement (glass fibre mesh)

Characteristics (alkalis resistance): Pass

	"Sto-Glasfaser-gewebe"		"Sto-Glasfaser-gewebe F"		"Sto-Fibre de Verre Ra 60"	
	Warp	Weft	Warp	Weft	Warp	Weft
Residual strength after ageing [N/mm]	≥ 20	≥ 25	≥ 20	≥ 20	≥ 25	≥ 25
Relative residual resistance after ageing in % of the strength in the as-delivered state	≥ 55	≥ 50	≥ 50	≥ 50	≥ 60	≥ 60

	Sto-Abschirmgewebe AES	
	Warp	Weft
Residual strength after ageing: [N/mm]	≥ 20	≥ 25
Relative residual resistance after ageing in % of the strength in the as-delivered state	≥ 50	≥ 55

## 3 Evaluation and attestation of conformity and CE-marking

### 3.1 System of attestation of conformity

According to the decision 97/556/EC of the European Commission<sup>8</sup> amended by 2001/596/EC<sup>9</sup> system 1 or 2+ of the attestation of conformity applies depending on reaction to fire.

Considering Class B and C for reaction to fire of the ETICS, the systems of attestation of conformity are system 1 regarding reaction to fire characteristic and system 2+ regarding other characteristics than reaction to fire.

Considering Class F for reaction to fire of the ETICS, the system of attestation of conformity is system 2+ regarding all characteristics.

These systems of attestation of conformity are defined as follows:

System 1: Certification of the conformity of the product by a notified certification body on the basis of:

- (a) Tasks for the manufacturer:
  - (1) factory production control;
  - (2) further testing of samples taken at the factory by the manufacturer in accordance with a prescribed test plan;
- (b) Tasks for the notified body:
  - (3) initial type-testing of the product;
  - (4) initial inspection of factory and of factory production control;
  - (5) continuous surveillance, assessment and approval of factory production control.

System 2+: Declaration of conformity of the product by the manufacturer on the basis of:

- (a) Tasks for the manufacturer:
  - (1) initial type-testing of the product;
  - (2) factory production control;
  - (3) testing of samples taken at the factory in accordance with a prescribed test plan;

<sup>8</sup> Official Journal of the European Communities/Union L229/14 of 20.08.1997

<sup>9</sup> Official Journal of the European Communities/Union L 209/33 of 2.8.2001

(b) Tasks for the notified body:

(4) certification of factory production control on the basis of:

- initial inspection of factory and of factory production control;
- continuous surveillance, assessment and approval of factory production control.

## 3.2 Responsibilities

### 3.2.1 Tasks for the manufacturer

#### 3.2.1.1 Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall insure that the ETICS and the components are in conformity with this ETA.

The manufacturer shall only use raw materials stated in the technical documentation of this ETA. The incoming raw materials are subjected to verifications by the manufacturer before acceptance.

The factory production control shall be in accordance with the "Control plan"<sup>10</sup> which is part of the technical documentation of this ETA. The "Control plan"<sup>10</sup> has been agreed between the manufacturer and the DIBt and is laid down in the context of the factory production control system operated by the manufacturer and deposited with the DIBt.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the "Control plan"<sup>10</sup>. The records include at least the following information:

- designation of the product, the basic materials and components;
- type of control or testing;
- date of manufacture of the product and date of testing of the product or basic materials or components;
- result of control and testing and, if appropriate, comparison with requirements;
- signature of person responsible for factory production control.

The records shall be presented to the notified body involved in continuous surveillance. On request they shall be presented to the DIBt.

#### 3.2.1.2 Other tasks for the manufacturer

For initial type-testing of the ETICS and the components regarding other characteristics than reaction to fire the results of the tests performed as part of the assessment for the ETA shall be used unless there are changes in the production line or plant. In such cases the necessary initial type-testing has to be agreed with the DIBt.

The manufacturer shall, on the basis of a contract, involve a body which is notified for the tasks referred to in clause 3.1 in the field of ETICS in order to undertake the actions laid down in clause 3.2.2. For this purpose, the "Control plan"<sup>10</sup> referred to in clauses 3.2.1.1 and 3.2.2 shall be handed over by the manufacturer to the notified bodies involved.

The manufacturer shall make a declaration of conformity, stating that the ETICS is in conformity with the provisions of ETA-09/0058 issued on 20 June 2013.

<sup>10</sup>

The "Control plan" is a confidential part of the European technical approval and only handed over to the notified body involved in the procedure of attestation of conformity. See section 3.2.2.

### 3.2.2 Tasks for the notified bodies

The notified body shall perform the

- initial type-testing of the ETICS and the components regarding reaction to fire characteristic,
- initial inspection of factory and of factory production control,
- continuous surveillance, assessment and approval of factory production control,

in accordance with the provisions laid down in the "Control plan"<sup>10</sup>.

The notified body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The notified certification body involved by the manufacturer shall issue an EC certificate of conformity of the ETICS which includes the certification of factory production control stating the conformity with the provisions of this ETA.

In cases where the provisions of the ETA and its "Control plan"<sup>10</sup> are no longer fulfilled the notified certification body shall withdraw the certificate of conformity and inform the DIBt without delay.

### 3.3 Marking

#### 3.3.1 CE marking

The CE marking shall be affixed on the accompanying commercial document. The letters "CE" shall be followed by the identification number of the notified certification body and be accompanied by the following additional information:

- the name and address of the ETA-holder (legal entity responsible for the manufacture),
- the last two digits of the year in which the CE marking was affixed,
- the number of the EC certificate of conformity for the ETICS,
- the number of the ETA,
- the number of the ETAG,
- the ETICS trade name.

#### 3.3.2 Additional marking

The respective trade name of the individual components of the ETICS shall be given on the packaging.

In addition to the trade name the following information shall be given in the accompanying commercial document and/or on the packaging of the thermal insulation product:

- minimum value of the tensile strength perpendicular to the faces of the insulation product,
- shear modulus of the insulation product.

**4 Assumptions under which the fitness of the product for the intended use was favourably assessed**

**4.1 Manufacturing**

The composition and manufacturing process used for the components of the ETICS shall comply with those on which the approval tests were based. Composition and manufacturing process are deposited at the DIBt.

The ETA is issued for the ETICS on the basis of agreed data/information, deposited with the DIBt, which identifies the ETICS that has been assessed and judged. Changes to the ETICS or the components or their production process, which could result in this deposited data/information being incorrect, should be notified to the DIBt before the changes are introduced. DIBt will decide whether or not such changes affect the approval and consequently the validity of the CE marking on the basis of the approval and if so whether further assessment or alterations to the approval shall be necessary.

**4.2 Installation, design and execution**

**4.2.1 General**

The wall on which the ETICS is applied shall be sufficiently stable and airtight. Its stiffness shall be large enough to ensure that the ETICS is not subjected to deformations, which could lead to damage.

The requirements given in ETAG 004, chapter 7, have to be considered.

**4.2.2 Installation**

The ETICS is installed on site. The approval holder is obliged to instruct all those entrusted with the design and execution of the ETICS about the specific conditions of this ETA and all other details necessary for perfect execution.

Only the components whose trade name is given in clause 1.1 and which have the characteristics according to clause 2.3 may be used for the ETICS.

**4.2.3 Design**

**4.2.3.1 Requirements for the substrate**

As to the requirements for the substrate and its preparation, ETAG 004, clause 7.2.1 applies.

The substrate for mechanically fixed systems should have a sufficient resistance for the use of anchors according to clause 2.3.2. The conditions of the ETA for the anchor concerned apply.

**4.2.3.2 Resistance to wind load**

Judging of sufficient resistance to wind load should be on the basis of the resistance of the fixings according to clause 2.2.8.3 and of the characteristic tension resistance of the used anchor according to clause 2.3.2. Taking into account the national safety factors the design values of resistance are determined. The smaller one of the design resistances of the ETICS ( $R_d$ ) and of the anchor ( $N_{Rd}$ ) is decisive.

The determined design wind load suction  $S_d$  (taking into account the national safety factors) is compared with the design resistance.

**4.2.4 Execution**

The manufacturer's design and installation instructions, which are part of the technical documentation for this ETA, shall be observed with respect to the installation of the ETICS and drying times of rendering products.

## **5 Indications to the manufacturer**

### **5.1 Packaging, transport and storage**

Packaging of the components has to be such that they are protected against moisture during transport and storage, unless other measures are foreseen by the manufacturer for this purpose.

The components are to be protected against damage.

### **5.2 Use, maintenance, repair**

To the indications on use, maintenance and repair ETAG 004, clause 7.3 applies.

Christian Herold  
p. p. Head of Department

*beglaubigt:*  
Wachner




Component	«German» trade name	«French» trade name	«English» trade name
<b>Adhesive</b>	Sto-Baukleber	Sto-Mortier Colle B	Sto ADH - B
	StoLevell Duo plus		
	StoLevell Uni		
	Sto-Dispersionskleber	Sto-Colle dispersion	Sto-Dispersion Adhesive
	StoPrefa Coll		
	StoPrefa Coll 500		
	StoLevell Duo Plus		
<b>Profiles</b>	Sto-Halteleiste PVC	Sto-Profil Intermédiaire en PVC	Sto PVC Intermediate Track
	Sto-Verbindungsleiste PVC	Sto-Profil Raidisseur en PVC	Sto PVC T-Spline
<b>Base coat</b>	StoArmat Classic plus / StoArmat Classic plus QS		
<b>Glass fibre mesh</b>	Sto-Glasfasergewebe	«Not available»	Sto Glass Fibre Mesh
	Sto-Glasfasergewebe F	Sto-Fibre de verre Standard	«Not available»
	Sto-Fibre de Verre Ra 60		
	Sto-Panzergerewebe	Sto-Fibre de verre de Blindage	Sto-Amour Mesh
	Sto-Abschirmgerewebe AES	Sto-Fibre AES	Sto-Shield Mesh AES
<b>Finishing coat</b>	No different trade names are used, besides:		
	Sto-Klebe- und Fugenmörtel + Sto-Flachverblender	Sto-Colle pour Briquette + Sto-Brique de parement	StoAdhesive and Joint Mortar + Sto-Brick Slips

ETICS "StoTherm Classic 5"


Trade names of the components

Annex 1

Horizontal profile – "Sto-Halteleiste PVC" (dimensions in millimetres)

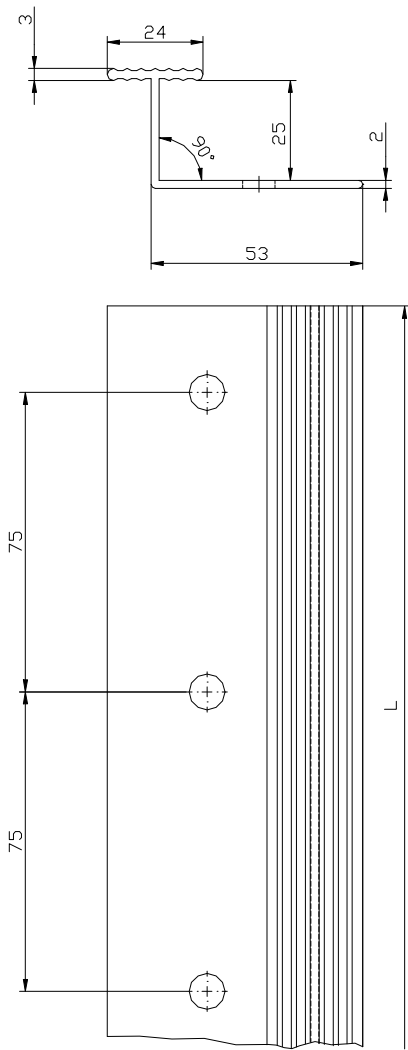

Vertical connection profile "Sto-Verbindungsleiste PVC" (dimensions in millimetres)

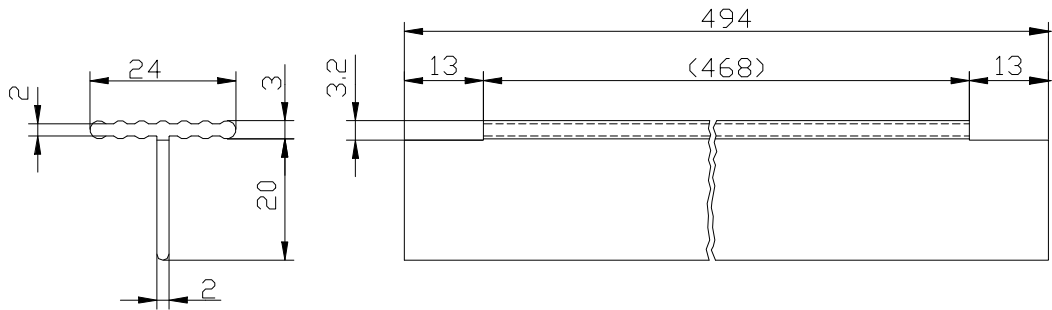

ETICS "StoTherm Classic 5"	Annex 2
Horizontal and vertical PVC profiles	