



## European Technical Approval ETA-12/0092

English translation prepared by DIBt - Original version in German language

|   |   |                                |
|---|---|--------------------------------|
| Handelsbezeichnung<br><i>Trade name</i>   | weber.tec 971   |                                |
| Zulassungsinhaber<br><i>Holder of approval</i>  | Saint-Gobain Weber GmbH<br>Schanzenstraße 84<br>40549 Düsseldorf<br>DEUTSCHLAND   |                                |
| Zulassungsgegenstand<br>und Verwendungszweck<br><br><i>Generic type and use<br/>of construction product</i> | weber.tec 971<br>als Bestandteil des Fugenabdichtungssystems der<br>Saint-Gobain Weber GmbH zur Verwendung in Anlagen zum Lagern,<br>Abfüllen und Umschlagen wassergefährdender Stoffe<br><br><i>weber.tec 971 as a component of the joint sealing system of the Saint-<br/>Gobain Weber GmbH used in facilities for the storage, handling and<br/>filling of substances hazardous to water</i> |                                |
| Geltungsdauer:<br><i>Validity:</i>  | vom<br><i>from</i><br>bis<br><i>to</i>  | 30 May 2013<br><br>30 May 2018 |
| Herstellwerke<br><i>Manufacturing plants</i>  | Werk 160<br>Plant 160   |                                |

Diese Zulassung umfasst  
*This Approval contains*

23 Seiten einschließlich 10 Anhänge  
*23 pages including 10 annexes*

Diese Zulassung ersetzt  
*This Approval replaces*

ETA-12/0092 mit Geltungsdauer vom 21.02.2012 bis 09.12.2015  
*ETA-12/0092 with validity from 21.02.2012 to 09.12.2015*

## I LEGAL BASES AND GENERAL CONDITIONS

- 1 This European technical approval is issued by Deutsches Institut für Bautechnik in accordance with:
  - Council Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations and administrative provisions of Member States relating to construction products<sup>1</sup>, modified by Council Directive 93/68/EEC<sup>2</sup> and Regulation (EC) N° 1882/2003 of the European Parliament and of the Council<sup>3</sup>;
  - *Gesetz über das In-Verkehr-Bringen von und den freien Warenverkehr mit Bauprodukten zur Umsetzung der Richtlinie 89/106/EWG des Rates vom 21. Dezember 1988 zur Angleichung der Rechts- und Verwaltungsvorschriften der Mitgliedstaaten über Bauprodukte und anderer Rechtsakte der Europäischen Gemeinschaften (Bauproduktengesetz - BauPG) vom 28. April 1998<sup>4</sup>, as amended by Article 2 of the law of 8 November 2011<sup>5</sup>;*
  - Common Procedural Rules for Requesting, Preparing and the Granting of European technical approvals set out in the Annex to Commission Decision 94/23/EC<sup>6</sup>.
- 2 Deutsches Institut für Bautechnik is authorized to check whether the provisions of this European technical approval are met. Checking may take place in the manufacturing plant. Nevertheless, the responsibility for the conformity of the products to the European technical approval and for their fitness for the intended use remains with the holder of the European technical approval.
- 3 This European technical approval is not to be transferred to manufacturers or agents of manufacturers other than those indicated on page 1, or manufacturing plants other than those indicated on page 1 of this European technical approval.
- 4 This European technical approval may be withdrawn by Deutsches Institut für Bautechnik, in particular pursuant to information by the Commission according to Article 5(1) of Council Directive 89/106/EEC.
- 5 Reproduction of this European technical approval including transmission by electronic means shall be in full. However, partial reproduction can be made with the written consent of Deutsches Institut für Bautechnik. In this case partial reproduction has to be designated as such. Texts and drawings of advertising brochures shall not contradict or misuse the European technical approval.
- 6 The European technical approval is issued by the approval body in its official language. This version corresponds fully to the version circulated within EOTA. Translations into other languages have to be designated as such.

<sup>1</sup> Official Journal of the European Communities L 40, 11 February 1989, p. 12  
<sup>2</sup> Official Journal of the European Communities L 220, 30 August 1993, p. 1  
<sup>3</sup> Official Journal of the European Union L 284, 31 October 2003, p. 25  
<sup>4</sup> *Bundesgesetzblatt Teil I 1998*, p. 812  
<sup>5</sup> *Bundesgesetzblatt Teil I 2011*, p. 2178  
<sup>6</sup> Official Journal of the European Communities L 17, 20 January 1994, p. 34

## II SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL

### 1 Definition of product/ products and intended use

#### 1.1 Definition of the construction product

(1) The joint sealing system "weber.tec 971" of the Saint-Gobain Weber GmbH (in the following called "joint sealing system"), is made of:

- Primer,
- stable joint sealing compound "weber.tec 971", (in the following called "joint sealing compound") and
- backfill material.

(2) Certain primers are predefined especially by the approval holder of the joint sealing system for the respective contact material.

(3) A closed-cell backfill material, compatible with the joint sealing compound, is used.

(4) The joint sealing compound is placed in the prepared joint recesses of finished structural elements made from different construction materials (contact material) in a plastic state. There it reacts to form a joint sealing compound with predominantly elastic properties.

(5) The joint sealing compound and the respective primer are matched with the intended contact material. The respective suitable primer is applied to the joint sidewalls before the joint sealing compound is placed.

(6) The joint sealing compound system is applied with a defined ratio of thickness "d" to width "b" (see Annex 1). Evidence of suitability of the respective joint geometry was provided within the scope of the approval tests.

#### 1.2 Intended use

(1) The joint sealing system is intended for use in facilities for the storage, handling and filling of certain substances hazardous to water both inside as well as outside of buildings.

(2) The joint sealing system shall be used for sealing of movement joints, which shall allow unrestrained deformation of structural elements (e.g. shrinkage, temperature-dependent alterations in length or the effects of different ground deformations) and, with regard to their sealing function, shall not be adversely affected.

(3) The joint sealing system may be used under constantly changing mechanical actions due to traffic actions by pneumatic tyres.

(4) The joint sealing compound system may be installed at normal environmental, structural element and material temperatures (usually within a range of +5 °C to +40 °C) and used at temperatures between -20 °C and +70 °C. The temperature of the water contaminating liquid in contact with the joint sealing system shall not be higher than +30 °C.

(5) The joint sealing system and the respective primer shall be used for the repair of joint sealing compound systems made of joint sealing compound of this ETA in existing facilities for the storage, handling and filling of liquid chemicals (substances hazardous to water).

(6) The intended working life of the joint sealing compound for the intended use in the meaning of the directive 89/106/EEC is 10 years. The indications given on the working life of a product cannot be interpreted as a guarantee given by the producer, but are regarded only as a means for choosing the right products in relation to the expected economically working life of the works.

## 2 Characteristics of the product and methods of verification

### 2.1 General

(1) The joint sealing system shall correspond to the drawings and the details of the annexes of this approval.

(2) The chemical composition or the formula of the joint sealing compound and of the primer shall correspond to the information deposited with Deutsches Institut für Bautechnik.

(3) The characteristics of the material, the dimensions and tolerances which are not declared in this approval shall correspond to the information laid down in the technical documentation<sup>7</sup> of this European technical approval.

### 2.2 Characteristics

(1) The joint sealing system:

- is resistant to the liquids listed in Annex 2 and/or Annex 3, Table 1 for the stress level S1, H1, F1 "low", S2, H2, F2 "medium" and/or S3, F3, "high" (definition of stress levels see Annex 10),
- is resistant to hydrolysis in consideration of ISO 868:2003-03 and weather according to EN 14187-8:2003-06,
- is stable,
- is suitable to be attached to certain admissible contact materials (see Annex 5, Table 1) and
- is suitable to be directly applied onto joint sealing compound of this approval that has already hardened.

(2) The joint sealing system (see Annex 1 and Annex 3 Table 2 and figure 1):

- is accessible for pedestrians according to the level of trafficability "t0" and/or passable by vehicles according to the level of trafficability "t1" (see Annex 4, Table 1 in conjunction with Annex 3, Table 1 and 2),
- is classified in the class of wear and tear "XM1" (see Annex 4, Table 1),
- is suitable to take up the extension-, compression and shear deformations documented in Annex 7, Table 1 in the area of parallel joint side walls as well as tee and cross intersections without becoming leaky,
- under consideration of the determinations of Annex 3, figure 1 prevents migration of the liquids listed in Annex 2 and Annex 3, Table 1 in the area of the joint and
- meets the requirements for the slipping behaviour at built-in state at temperature actions of up to 200 °C.

(3) The joint sealing compound together with the respective primer used between contact materials according to clause 1.1 (2) meets the requirements of the reaction-to-fire class E in accordance with EN 13501-1<sup>8</sup> (see Annex 4, Table 1). The used backfill material has at least to meet the requirements for building products of reaction-to-fire class E in accordance with EN 13501-1<sup>8</sup>.

<sup>7</sup> The technical documentation of this European technical approval is deposited with Deutsches Institut für Bautechnik and shall be made available to the approved bodies, who are involved in the procedure of conformity attestation, for the fulfilment of their tasks.

<sup>8</sup> EN 13501-1: Fire classification of construction products and building elements

## 2.3 Composition

(1) The joint sealing system is made of:

- **joint sealing compound**

"weber.tec 971"

consisting of the components A and B, the basis material of which is polysulfide.

- **primer**

"weber.tec 973"

consisting of the components A and B, the base material of which is epoxy resin.

"weber.tec 974"

is a one-component primer on silane base.

"weber.tec 975"

consisting of the components A and B, the base material of which is epoxy resin.

The before mentioned primers are useable for special contact materials according Annex 5.

- **Backfill material**

A closed-cell backfill material, compatible with the joint sealing compound, is to be chosen and to be used in accordance with the provisions by the approval holder according to the following criteria:

- A backfill material is to be chosen which prevents the adhesion of the joint sealing compound to the ground of the joint. The backfill material has to be installed sufficiently stable and with the same height "d" (see Annex 1) to observe the dimensions of the joint depth.
- The backfill material shall be installed in such a way that it shows an elliptical cross-section (see Annex 1). It shall be compatible with the joint sealing compound and shall be closed-cell.
- The backfill material shall not inadmissibly impede the change in shape of the joint sealing compound and shall not contain any substances which weaken the adhesion of the joint sealing compound on the joint sidewalls.
- The backfill material may not cause discolorations or bubbles.
- At built-in state the backfill material shall offer sufficient resistance when placing the joint sealing compound.

(2) More information about the individual components of the joint sealing system (mix ratio, airing out, etc.) is given in Annex 4, Table 1.

## 2.4 Emission of dangerous substances

(1) According to the approval holder's declaration the joint sealing system taking account of the EU database<sup>9</sup> does not contain any dangerous substances.

(2) Within the scope of this approval there may be other requirements applicable to dangerous substances resulting from transposed European legislation or applicable national regulations and administrative provisions. These requirements need also to be complied with.

(3) There may be other requirements applicable to the products resulting from other applicable national regulations and administrative provisions. These requirements need also to be complied with.

<sup>9</sup> References in Guidance Paper H: A harmonised approach with regard to the handling of dangerous substances according to the Construction Products Directive, Brussels 18 February 2000

### 3 Evaluation and attestation of conformity and CE marking

#### 3.1 System of attestation of conformity

The European Commission according to its decision on the procedure of attestation of conformity 2003/656/EC of 12 September 2003 (Official Journal of the European Union No L 231 of 17 September 2003) has laid down for joint sealing compounds (EOTA-Nr. 06.05/11) system 2+ for the procedure of attestation of conformity (AoC) (Annex III, clause 2(ii) first possibility of Directive 89/106/EEC) for this type of material.

The AoC System 2+ provides:

- a) Tasks for the approval holder:
- Initial type-testing of the joint sealing compound and the primer,
  - Factory production control including continuous testing of samples taken at the factory.

- b) Tasks for the approved bodies:

Inspection body: Initial inspection as well as continuous surveillance, assessment and approval of factory production control.

Certification body: Granting of a certificate of conformity.

#### 3.2 Responsibilities

##### 3.2.1 Tasks for the approval holder

###### 3.2.1.1 Factory production control

(1) The approval holder shall set up and perform a factory production control. Factory production control means the continuous surveillance of the production to be performed by the respective approval holder, whereby it is ensured that the products manufactured by him correspond to the provisions of the European technical approval.

(2) The approval holder has to perform continuous surveillance of the production process in accordance with the prescribed control plan<sup>10</sup>.

(3) The approval holder may only use initial materials in accordance with the information deposited (according to) in section 2.1(2). He shall inspect or control the initial materials on acceptance according to the prescribed control plan.

(4) The factory production control follows the properties given in the Common Understanding of Assessment Procedure. They are specified in the technical documentation.

(5) The results of the factory production control shall be recorded and evaluated. The records shall include at least the following information:

- description of the product, of the initial materials,
- type of inspection or test,
- date of the manufacture of the product, batch N°, if need be, and date of the inspection or test of the product / the initial materials,
- results of the inspections or tests and, if applicable, comparison with the requirements,
- signature of the person responsible for the factory production control.

<sup>10</sup> The control plan is deposited with Deutsches Institut für Bautechnik and contains the required information on the factory production control and on the initial type-testing. As far as this is relevant to the tasks of the approved body involved in the procedure of attestation of conformity the control plan will be handed over to the approved body.



(6) The records shall be kept for a minimum of five years. On request they shall be presented to Deutsches Institut für Bautechnik.

(7) Details concerning extent, type and frequency of the tests or inspections to be performed within the scope of the factory production control shall correspond to the prescribed control plan<sup>10</sup> which is part of the technical documentation to this ETA.

#### 3.2.1.2 Other tasks for the approval holder

The approval holder shall, on the basis of a contract, involve a body which is approved for the tasks referred to in section 3.1 in the field of joint sealing compounds for the sealing of construction works for the storage, handling and filling of substances hazardous to water in order to undertake the actions laid down in section 3.2.2.

The approval holder shall make a declaration of conformity, stating that the construction product is in conformity with the provisions of this European technical approval.

### 3.2.2 Tasks for the approved bodies

#### 3.2.2.1 Inspection body

(1) In each factory where the joint sealing compound is manufactured an initial inspection as well as the factory production control shall be performed by an inspection body.

(2) An inspection body shall continuously control, assess and approve the effectiveness of the factory production control in accordance with the requirements of the control plan<sup>10</sup>. The continuous surveillance shall take place at least twice a year.

(3) On demand the results of the surveillance shall be presented by the inspection body to Deutsches Institut für Bautechnik and, if necessary, to the relevant authority.

(4) The verifications, on which the ETA is based, were carried out on samples taken from the current production, thus a reduced testing in terms of the initial type-testing according the control plan<sup>10</sup> shall be performed. The reduced testing shall be carried out by a testing centre which is competent for joint sealing systems. The results of the reduced testing shall be presented to Deutsches Institut für Bautechnik.

(5) Observance of the required property values shall be ascertained by the inspection body.

#### 3.2.2.2 Certification body

(1) The certification of the factory production control by a certification body is based on the initial inspection of the manufacturing plant and of the factory production control as well as of the continuous surveillance, assessment and approval of factory production control according to the provisions given in clause 3.2.1.1.

(2) The approved certification body involved by the approval holder shall issue an EC certificate of conformity of the factory production control stating the conformity with the provisions of this European technical approval.

(3) In cases where the provisions of the European technical approval and its control plan are no longer fulfilled the certification body shall withdraw the certificate of conformity and inform Deutsches Institut für Bautechnik without delay.

### 3.3 CE marking

The CE marking<sup>11</sup> (CE marking and identification number of the certification body) shall be affixed on the delivery containers, on the packaging of the components of the joint sealing system, on the delivery note, on signs or labels.

The CE marking shall be accompanied by the following:

- Name or identifying mark of the manufacturing plant,
- last two digits of the year in which the CE marking was affixed,
- number of the certificate on the factory production control (system 2+),

<sup>11</sup> Notes on the CE marking and the declaration of conformity by the manufacturer are stated in Guidance Paper D "CE marking under the Construction Products Directive", Brussels, 01 August 2002

**European technical approval****ETA-12/0092****Page 8 of 23 | 30 May 2013****English translation prepared by DIBt**

- name of the product,
- number of the ETA,
- essential properties:
  - reaction-to-fire class,
  - admissible contact material,
  - admissible extension, compression and shear distances in millimetres,
  - admissible levels of road serviceability and
  - resistance to media shall be given with the wording "*Resistance to media in accordance with Annex 2 and 3 of the ETA*".

**4 Assumptions under which the fitness of the product for the intended use was favourably assessed****4.1 Manufacturing**

(1) The manufacture and or the make of the individual components of the joint sealing compound and the primer shall be in accordance with the details deposited with Deutsches Institut für Bautechnik and carried out in Germany at the manufacturing plant 160 of the holder of the approval. Modifications are subject to prior consent by Deutsches Institut für Bautechnik.

(2) The European technical approval is issued for the product on the basis of agreed data/information, deposited with Deutsches Institut für Bautechnik, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, should be notified to Deutsches Institut für Bautechnik before the changes are introduced. Deutsches Institut für Bautechnik will decide whether or not such changes affect the approval and consequently the validity of the CE marking on the basis of the approval and if so whether further assessment or alterations to the approval shall be necessary.

**4.2 Installation****4.2.1 Conditions for the installation**

(1) The joint sealing system is planned and designed by expert designers only.

(2) The joints are designed such that they can be controlled during subsequent use.

(3) For the proper installation of the joint sealing system the approval holder draws up installation and handling instructions, which are deposited as part of the technical documentation with Deutsches Institut für Bautechnik.

(4) Joint sealing compounds which are installed in potentially explosive areas do not insulate conductive parts.

(5) The additional instructions and technical advice given by the approval holder are paid attention to, e.g. concerning the condition of the joint side walls and adjacent building components or surface sealants.

(6) The serviceability for the respective intended use results from the contact material and the indicated levels and/or performance classes of the categories of use.

(7) Controllable calculations and construction drawings (e.g. joint plans) are made up taking account of the requirements at national level of the respective Member States and the stresses and loadings to be expected.

(8) The movable joints are arranged such that the admissible extension, compression and shear distances referred to in Annex 7, Table 1 are complied with.



(9) The following is considered for design and dimensioning:

- Joint sealing compounds are arranged such that they can be used – within the scope of the stress level "low", "medium" and/or "high" according to Annex 2 and/or Annex 3– with liquids hazardous to water or that an accumulation of a mixture of dirt and liquids hazardous to water is avoided on the joint sealing compounds. In particular, it is ensured that there is no joint sealing system in the immediate area under filling points.
- The concrete joint side walls shall have enough strength and load-bearing capacity that they are able to accept the occurring stresses acting on them through the joint sealing compound.
- The liquid proof surfaces and/or constructions to be connected shall be designed such that the admissible deformations according to Annex 7, Table 1 (e.g. due to temperature, residual shrinkage or creep) are observed.
- In accordance with the national requirements of the respective Member States, the surface sealant according Annex 5 in which and/or on which the joint sealing system is installed, may only show limited penetration depths of liquids. The characteristic penetration depth of the respective liquid in the surface sealant, e.g. made of concrete, shall be smaller than the area of the joint side wall protected by the joint sealing compound "d<sub>H</sub>" (see also Annex 3, figure 1).

#### 4.2.2 Processing

(1) Requirements for the performing company can result from national provisions of the Member States.

(2) Furthermore the installation of joint sealing systems is carried out by companies who (including their specialists) are authorised and trained by the approval holder.

(3) Fitness for use of the installed joint sealing systems can only be assumed, if the processing is performed according to the provisions of this ETA and according to the supplementing installation and processing instructions by the approval holder.

(4) It is to be checked whether the system components of the sealing compound and the primer were not exchanged.

(5) It is to be guaranteed that the maximum admissible joint width according to Annex 3, Table 2 will be warranted observed.

(6) Before the installation of the joint sealing system the suitability of the joints side walls and the building components to be connected is to be ascertained.

- In the case of concrete sealing constructions the concrete of the contact surfaces shall have reached at the time of jointing at least 70 % of the 28-days-strength and be at least 7 days old.
- The joint side walls shall be dry and may not show any impurities.
- Accumulations of precipitation behind joint sealing compounds already installed are to be prevented.
- The surface temperature of the building elements in the area of the joints shall be at least 3 K above thawing temperature during the installation of the joint sealing compound.
- The primer shall be applied evenly on the respective joint side walls. The primer will be applied according to the installation instructions by the approval holder
- The classification of the different primers to the respective contact materials shall be strictly observed (see Annex 5).

(7) When installing the joint sealing system the specifications made by the approval holder or the expert designer (see e.g. the drawing of the joint) shall be observed.

(8) At temperatures of the building component below +5 °C and above +40 °C jointing may not be performed.

(9) The joint sealing compound may not be applied on layers of condensation moisture.

(10) The joint sealing compound and the respective primer shall be mixed according to approval holder's instructions.

(11) The time interval given in Annex 4, Table 1, between applying the primer and installing the joint sealing compound (airing out) may not fall below or be exceeded.

(12) The primer and the joint sealing compound are to be applied evenly and as blister-free as possible.

(13) The release for mechanical and chemical stresses of the sealing construction may only be performed after the period indicated in Annex 4, Table 1 after complete installation of the joint sealing system. For the period of reaction the sealing compound shall be protected from atmospheric exposure in accordance with the definitions by the approval holder.

(14) The attestation of conformity of the installed joint sealing system with the determinations of this ETA and according to the supplementing installation and processing instructions by the approval holder will take place by the installing firm according to section 4.2.2(1) and (2) by means on a report on the production (see Annex 9) based on the controls of the execution in accordance with section 4.2.4.

#### 4.2.3 Correction of defects

(1) Companies according to clause 4.2.2 (1) and (2) are charged with the correction of defects.

(2) The section to be repaired shall be separated from the intact section by conducting a vertical cut.

(3) The defective material shall be removed completely. Unevenness, defects or edges in the area of the joint side walls shall be repaired in accordance with the determinations of section 4.2.1 to 4.2.4. When reprofiling the joint side walls with repair systems the evidence of suitability shall be furnished prior to the use according to the national regulations of the respective Member State (Annex 5).

(4) The determinations of section 4.1 and 4.2 will be complied with.

#### 4.2.4 Control of the execution

(1) Before, during and after the installation of the joint sealing system the following controls are made:

(2) Before the installation:

- For sealing layers made of concrete the strength class of concrete and the water-cement ratio according to EN 206-1 and/or according to the national stipulations of the respective Member States (e.g. G: according to the *DAfStb-Richtlinie "Betonbau im Umgang mit wassergefährdenden Stoffen (BUmWS)"* ('Concrete construction for handling substances hazardous to water') shall be proven before placing the joint sealing system on site.
- Control of the joint width, the joint distance and the depth of the joint's space according to Annex 1 and/or Annex 3, Table 2 respectively, of the design documents e.g. design of the joint (see section 4.2.1) and/or the processing instructions by the approval holder.
- Control of the condition of the contact areas (bond areas). Dirt accumulations shall be removed thoroughly before the installation.
- Determination of the surface temperature and comparison (3 K above thawing temperature) in accordance with section 4.2.2.

(3) After the installation:

- The installed joint sealing system is examined in full length for flank adhesion. This test can be performed with one of the following methods:
  - Ball stick test  
In doing this, a stick hemispherical at one end of half a joint width will be impressed approx. 2 mm in the joint.

– Pulley test

By using a circular metal disc of roughly 100 mm in diameter, the thickness of which is half as wide as the joint width and where the circumferential surface is semicircular, the impression test will be carried out continuously. For doing that the disc is provided with an axle and installed in a device which will be sufficiently loaded (impress approx. 2 mm deep). The device prepared like this will be pulled slowly over the joint sealing system.

#### 4.2.5 Repair works in used facilities

(1) The repair works shall be planned and designed by expert designers only based on this ETA, an expertise of the construction level and the repair concept, based on this expertise.

The respective repair works shall be designed in such a way that the interaction between the selected joint sealing systems on the sealing construction will be considered, e.g. penetration behaviour of the liquid and the resulting joint width from it. The determination of the penetration behaviour into the concrete sealing construction shall be performed according to the national regulations of the respective Member State (in G.: TRwS 786, section 9).

(2) The repair of the connected sealing construction (contact material) shall be performed only based on the verification of applicability of the respective sealing construction.

(3) Before the repair works starts make sure, that the detected damages of the sealing construction and there reasons according to the expertise of the construction level are cleared away.

(4) For the repair of the joint sealing system apply the provisions of this ETA and the addition provisions of the approval holder.

(5) With the repair works only firms in accordance with section 4.2.2(1) and (2) shall be assigned.

(6) If there are essential repair works necessary the inspection of the correct state of the facility by an approved expert shall be arranged by the operator of the facility before putting the facility into operation again.

#### 4.3 Responsibilities for the approval holder

It is the approval holder's responsibility to make sure that all those who use his joint sealing system will be appropriately informed about the specific conditions according to sections 1, 2, 4, and 5 including the annex to this ETA, the installation and processing instructions by the approval holder and the not confidential part of the technical documentation to this ETA.

This information can be given by reproduction of the corresponding parts of the European technical approval.

### 5 Indications to the approval holder

#### 5.1 Packaging, transport and storage

(1) Packaging, transport and storage of the single components of the joint sealing system shall be such that the fitness for the intended use will not be affected. All components of the joint sealing system and the respective primer shall in particular be stored in closed original containers/packs protected against moisture preferably at room temperatures. The maximum storage time indicated on the containers/packs shall be observed.

(2) The components of the joint sealing system shall not be exposed to direct solar radiation. They are to be stored such that the temperature of the material at the time of processing is higher than +10 °C and lower than +40 °C.

(3) The information on requirements from other fields of the law (e.g. law relating to hazardous substances and/or law relating to transport) given on the containers/packs shall be observed.

## 5.2 Use, maintenance, repair

(1) In order to ensure the fitness for use of the joint sealing system after their installation in the construction works, the measures given in clauses (2) to (7) are recommended. It is the task of the approval holder to make sure that all parties involved are adequately informed.

(2) The operator of the respective facility establishes operating instructions including, among others, the description of the necessary measures

- for the control of the proper condition
- for ensuring proper operation
- for maintenance and repair

of the joints as well as the description of measures to be taken in case of damage. The inspection intervals are specified according to the stress levels given in Annex 2 and Annex 3, Table 1 in conjunction with Annex 10 of this ETA. The inspection results are documented.

(3) Major drip losses and/or accumulations of already minor liquid quantities are directly removed.

(4) Leaked out substances hazardous to water will immediately be bound with suitable means. The polluted bonding agent is taken up and recycled duly and without loss or is disposed of. Appropriate materials and/or employment devices are specified in the operating instructions and are constantly ready in sufficient quantity. For the disposal and treatment, respectively, of the materials resulting in waste reference is made to the applicable regulations of the respective Member State (e.g. in G: *Kreislaufwirtschaftsgesetz* ('Act for Life-Cycle Management')).

(5) Before the operation of a facility and after repair measures of larger extent start-up inspections are carried out as follows:

- The start-up inspection is carried out by expert personnel only. Further requirements for the individuals can result from national regulations of the Member States.
- The person put in charge of the inspection will constantly be kept informed on the process of the work. The person is given the possibility to participate in the controls of the joint sealing system before and after the installation according to section 4.2.4 and to evaluate the results of the controls.
- Checking the condition of the installed joint sealing systems is done via visual inspection of the surface of all joints of the respective sealing construction.
- The person put in charge of the inspection examines the intended control intervals (according to section 5.2 (2)) of the operating instructions by the operator of the respective facility.

(6) One year after every start-up inspection, then after four years and then every fifth year recurring inspections shall be performed as follows:

- The recurring inspections are carried out by expert individuals. Further requirements for the individuals can result from national regulations of the Member States.
- The investigation of the condition of the joint sealing system is done via visual check of the joint sealing in all areas of the respective sealing construction. Particular attention shall be paid to possible edge spalling in the chamfer area.
- In addition the examination for tightness shall be carried out by audit-testing of the joint sealing system for side wall bonding following section 4.2.4(3) (ball stick or pulley test).

- On the basis of the documentation in accordance with section 5.2 (2) it is checked whether
    - the check intervals were kept,
    - the specifications of the operating instructions are observed, and
    - no longer contact has occurred between the joint sealing compound and the liquids hazardous to water in the course of use.
  - If doubts arise about the tightness of the joint sealing system (e.g. due to softening of the surface of the joint sealing compound) further examinations become necessary. For that purpose samples (drilling core) will be taken from the section concerned, if need be. It can be done without the taking of samples from the soil underneath the joint sealing systems, if demonstrably no complete penetration of the joint sealing system occurred by liquids hazardous to water.
- (7) Further national regulations of the Member States shall remain unaffected.

## 6 Recommendations for the operator of a facility for storing, filling and handling of substances hazardous to water

(1) Reference is made to the necessity of a permanent surveillance by the operator of the facility for tightness and operability of the joint sealing system in accordance with the requirements of the national regulations of the respective Member States.

(2) An operating instruction shall be prepared by the operator of the respective facility which takes the following points into account:

- The contents of the regulations to be applied by the employee working in these fields will be presented in the operating instructions in a comprehensible and clear way and be laid out or put up at a suitable place of the facility. The operating instruction can be part of operating instructions in accordance with other fields of law of the respective Member States.
- The employees working in these fields will be instructed in the possible threats to water when storing, filling and handling substances hazardous to water as well as in the measures of hazard control. Before working in this field, they will be instructed before working with these substances and afterwards at least once per year.
- All essential measures of control by the operator, the maintenance and the repair will be specified in the operating instructions. The realization of the measures will be noted in each case in the company journal.
- In this operating instruction the operator lays down his inspection intervals with regard to the stress level specified in this ETA in accordance with Annex 2 and Annex 3, Table 1 in conjunction with Annex 10. These records are ready and will be presented to the person responsible according to the national regulations in force of the respective Member States.

(3) The operator of a facility for the storing, filling and handling of substances hazardous to water commissions companies with maintenance, repair and cleaning of the joint sealing systems according to section 4.2.2 (1) and (2).

(4) After each repair work and/or touch up of a larger extent a start-up check will be carried out and the recurring test shall be repeated by the person charged with the test, respectively, in accordance with the effective national regulations of the respective Member States.

(5) The joint sealing system is driven on only with vehicles supplied with pneumatic tyres.

Dirk Brandenburger  
Head of Department


*beglaubigt:*  
Dr.-Ing. Westphal-Kay

## Joint sealing system, weber.tec 971 by Saint-Gobain Weber GmbH


used in facilities made of special contact materials

**trafficable joint construction**

**not trafficable joint construction**

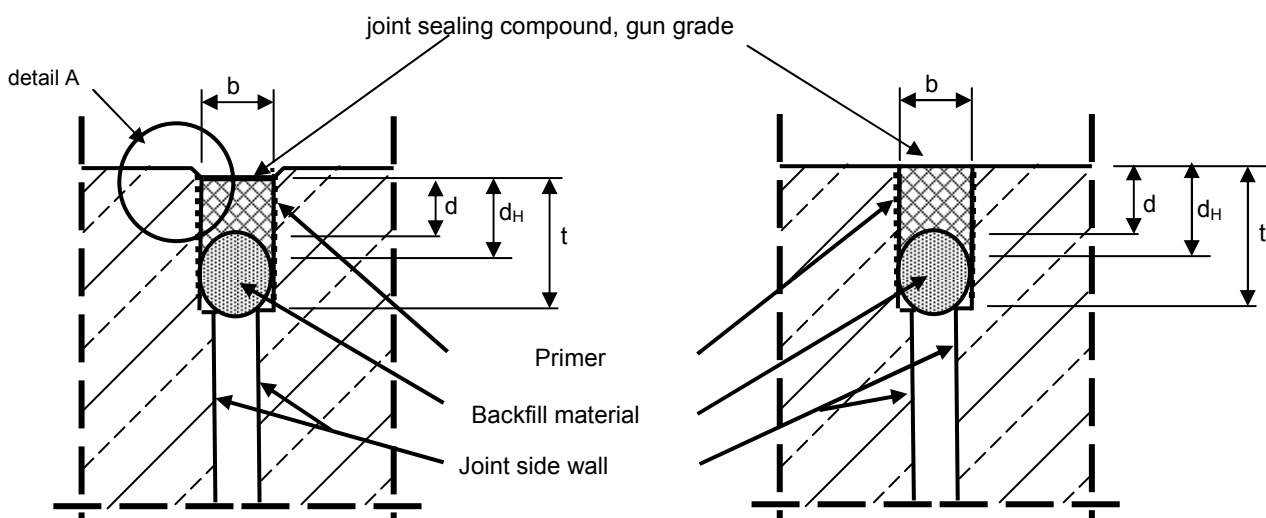

**Detail A:**

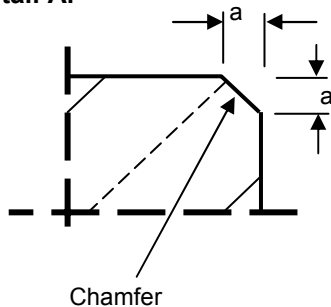

- a** = Chamfer edge (3 to 5) mm
- b** = Joint width
- d** = Thickness of the joint sealing compound
- d<sub>H</sub>** = Joint sealing compound bonding or contact surface on the joint side wall ( $d_H = d + 1/2b$ )
- t** = Depth of the joint chamber

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Product and built-in state

Annex 1



The joint sealing system used in plants for the containment, handling and filling of substances hazardous to water is impermeable and chemically resistant to the following liquids (stress level: S<sub>1</sub>, H<sub>1</sub>, F<sub>1</sub> "low", S<sub>2</sub>, H<sub>2</sub>, F<sub>2</sub> "medium" and S<sub>3</sub>, F<sub>3</sub> "high", see Annex 10).

Table 1 to Table 3, use according to level of trafficability "t1" (see Annex 4, Table 1)  
– trafficable with pneumatic tyres –

**Table 1:** List of liquids for stress level S<sub>1</sub>, H<sub>1</sub> and F<sub>1</sub> "low"

| Group No. | liquids                                 |
|-----------|---|
| DF 4a     | Benzene and mixtures containing benzene |

**Table 2:** List of liquids for stress level S<sub>2</sub>, H<sub>2</sub> and F<sub>2</sub> "medium"

| Group No. | liquids  |
|-----------|--|
| DF 1      | Gasoline for spark ignition engines, super and normal (according to EN 228:2004-03) with a maximum of 5 volume percent of bio-alcohol  |
| DF 1a     | Gasoline for spark ignition engines, super and normal (according to EN 228:2004-03) with a maximum of 20 volume percent of bio-alcohol   |
| DF 2      | Aviation gasoline  |
| DF 3      | Fuel EL<br>Unused combustion engine oil<br>Unused motor vehicle gear oil<br>Mixture of saturated and aromatic hydrocarbons with an aromatic content ≤ 20 wt.-% and a flash point > 55 °C |
| DF 3a     | Diesel fuel (according to EN 590) with a maximum of 5 volume percent of bio-diesel fuel  |
| DF 3b     | Diesel fuel (according to EN 590) with a maximum of 20 volume percent of bio-diesel fuel   |
| DF 4b     | Crude oils   |
| DF 4c     | Used internal combustion engine oils and used vehicle gear oils with a point of ignition of > 55 °C  |
| DF 5      | Monovalent and polyvalent alcohol (up to a maximum of 48 volume percent of methanol), glycols and polyglycols as well as their monoethers  |
| DF 5a     | alcohol and glycol ethers  |
| DF 5b     | Monovalent and polyvalent alcohol ≥ C <sub>2</sub> (up to a maximum of 48 volume percent of ethanol)   |
| DF 7b     | bio-diesel fuel  |
| DF 8      | Aqueous solutions of aliphatic aldehyde up to 40 %   |
| DF 9      | Aqueous solutions of organic acids (carboxylic) up to 10 % as well as their salts in aqueous solutions   |
| DF 10     | Mineral acids up to 20 % as well as acidic, hydrolyzed inorganic salts in aqueous solution (pH < 6), except for hydrofluoric acids and acids with an oxidizing effect and their salts    |
| DF 11     | Inorganic lye as well as alkaline hydrolysing inorganic salts in aqueous solution (pH > 8), except oxidising salt solutions (e.g. hypochlorite)  |
| DF 12     | Aqueous solutions of inorganic non-oxidising salts with a pH value between 6 und 8   |
| DF 13     | Amines as well as their salts (in aqueous solutions)   |
| -         | Single liquid: Skydrol LD 4  |

**Table 3:** List of liquids for stress level S<sub>3</sub> and F<sub>3</sub> "high"

| Group No. | liquids   |
|-----------|---|
| -         | Single liquid: Urea with max. 35% in aqueous solution |

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Lists of liquids

Annex 2

The joint sealing system used in plants for the containment, handling and filling of substances hazardous to water is impermeable and chemically resistant to the following liquids (stress level: S<sub>2</sub>, H<sub>2</sub> and F<sub>2</sub> "medium", see Annex 10).

**Table 1:** List of liquids for stress level S<sub>2</sub>, H<sub>2</sub> and F<sub>2</sub> "medium" and use according to level of trafficability "t0" (see Annex 4, Table 1) – trafficable with pedestrians only –

| Group No. | liquids  |
|-----------|--|
| DF 4      | All hydrocarbons and mixtures containing benzene with a maximum of 5 volume percent of benzene, except fuels |

**Table 2:** Dimensions of the joint construction<sup>1), 2)</sup>


| Level of trafficability "t1"<br>– trafficable with pneumatic tyres– |    |                |
|---|----|----------------|
| b   | d  | d <sub>H</sub> |
| mm  |    |                |
| 10  | 10 | 15             |
| Intermediate values can be interpolated                             |    |                |
| 20  | 20 | 30             |

| Level of trafficability "t0"<br>–trafficable with pedestrians– |    |                |
|--|----|----------------|
| b  | d  | d <sub>H</sub> |
| mm   |    |                |
| 10   | 10 | 15             |
| Intermediate values can be interpolated                        |    |                |
| 40   | 40 | 60             |

<sup>1)</sup> compare with Annex 1

<sup>2)</sup> For joints which are only suited for traffic with pedestrians ("t0", according to Annex 4, Table 1), the admissible joint width is max. 40 mm. The other dimensions of the joint construction (d, d<sub>H</sub> and t) are to be adapted according to the table mentioned above.

**Figure 1:** Migration behaviour in the area of the embedded joint sealing system<sup>1)</sup>

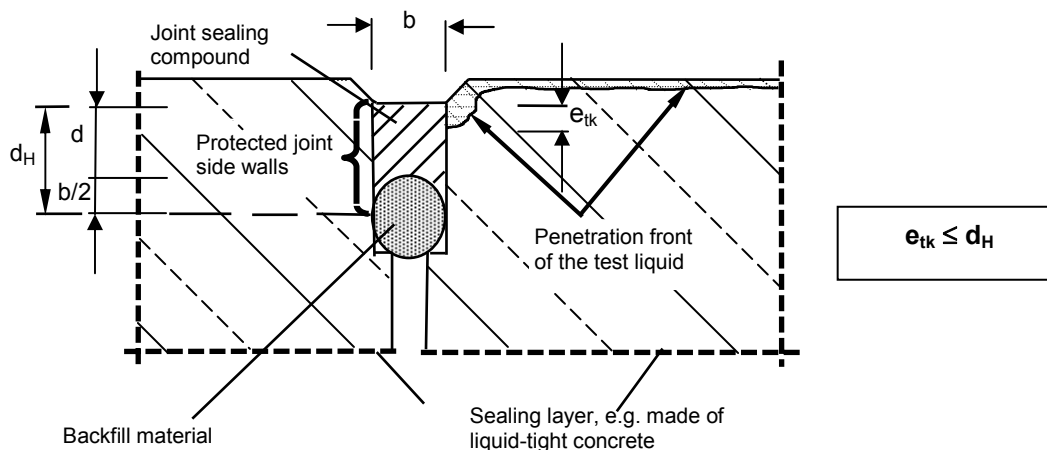

- d<sub>H</sub> = bond area and/or contact surface of the joint sealing compound at the joint side wall; d<sub>H</sub> = d + b/2
- b = width of the joint sealing compound
- d = thickness of the joint sealing compound; d = (0.8 to 1.0) x b
- e<sub>tm</sub> = average penetration depth of the water-endangering liquid
- e<sub>tk</sub> = characteristic penetration depth of the water-endangering liquid; e<sub>tk</sub> = e<sub>t,m</sub> x 1.35

<sup>1)</sup> see also Annex 6, Table 1

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

List of liquids and dimensions of the joint construction and migration behaviour

Annex 3

**Table 1:** Characteristics, levels, classes and characteristic values

| No. | Characteristics / level / classes  | unit  | characteristic values for the joint sealing system facing   |                     |               |
|-----|--|---|---|---------------------|---------------|
|     |  |   | contact materials according to Annex 5, Table 1:<br>– concrete, – polymer-concrete (UP resin based) <sup>3)</sup> – non-alloyed steel (uncoated),<br>– fibre concrete – CD-coated steel <sup>1)</sup> |                     |               |
| 1   | <b>Primer</b>  |   | weber.tec 973   | weber.tec 974       | weber.tec 975 |
| 2   | <b>Airing out</b> (at 23°C) of the primer <sup>2)</sup> minimum:   | minutes   | 60  | 10                  | 120           |
| 3   | <b>max. storage time</b> <sup>2)</sup> (at 0 - 40°C) sealing compound: component A component B<br>Primer: component A component B                                      | months  | 6<br>6  |                     |               |
|     |  |   | 12<br>12  | one-component<br>12 | 12<br>12      |
| 4   | <b>Mixing ratio</b> sealing compound: (comp. A : comp. B) primer: (comp. A : comp. B)  | parts by weight   | 10 : 1  |                     |               |
|     |  |   | 3 : 2   | one-component       | 10 : 1        |
| 5   | Working life (Pot-life)  | minutes   | min. 120 (depending on weather)   |                     |               |
| 6   | <b>Minimum cure time</b> until the complete chemical and mechanical design resistance  | hours   | 24 to 48 (depending on weather)   |                     |               |
| 7   | <b>waiting time</b> until trafficability   | hours   | 24 to 48 (depending on weather)   |                     |               |
| 8   | <b>shade</b> sealing compound: primer <sup>2)</sup> :  | -   | grey  |                     |               |
|     |  |   | light yellow  | colourless          | green         |
| 9   | <b>Backfill material</b>   | -   | according to ETA and to the additional provisions by the manufacturer   |                     |               |
|     | Reaction to fire class according to EN 13501-1   |   | at least class E  |                     |               |
| 10  | surface temperature of the pavement sealing system in areas of joints during installation  | °C<br>K   | ≥ 5°C und ≤ 40°C,<br>≥ 3 K above temperature of dew point   |                     |               |
| 11  | Reaction to fire class of the joint sealing compound together with the primer weber.tec 973, weber.tec 974, weber.tec 975: "E", classification according to EN 13501-1 |   |   |                     |               |
| 12  | Level of trafficability  | "t0": suited for traffic with pedestrians only,<br>"t1": suited for traffic with pneumatic tyres only <sup>4)</sup> |   |                     |               |
| 13  | Class of wear and tear "XM1": permissible stress by vehicles with pneumatic tyres  |   |   |                     |               |

1) CD-coated steel (cathodic dip coating as corrosion protection) only permitted on the basis of aminated, water-insoluble epoxy resin on bisphenol-A  
 2) in original container/ pack  
 4) not for liquids according to Annex 3, Table 1

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Characteristic values for the material

Annex 4

**Table 1:** Admissible contact materials

| No | contact materials   | comments  |
|----|---|---|
| 1  | sealing constructions made of uncoated non-alloyed and CD-coated steel <sup>1)</sup>  | <ul style="list-style-type: none"> <li>- according to the statutory provisions implementing Directives of the European Community, which include the specific requirements of the building authority as well as the law relating to water and which bear the marking of the European Community (CE marking) and/or</li> <li>- according to national provisions of the respective countries, which also include the specific requirements of the building authority as well as the law relating to water and are marked with the intended conformity marking in accordance with the national provisions of the respective countries.</li> </ul> |
| 2  | sealing constructions made of polymer-concrete on UP resin base <sup>2)</sup><br><br>with ≤ 15 percent by weight organic components |   |
| 3  | sealing constructions made of concrete <sup>3)</sup> : pre-fabricated elements with and without fibres <sup>4)</sup>                |   |
| 4  | sealing constructions made of concrete <sup>5)</sup> : in-situ concrete with and without fibres                                     |   |

- 1) CD-coated steel (cathodic dip coating as corrosion protection) only permitted on the basis of aminated, water-insoluble epoxy resin on bisphenol-A
- 2) e.g.: polymer-concrete, granted and marked in accordance with an *allgemeine bauaufsichtliche Zulassung* ('national technical approval') (G) for gutters (drains) made of polymer-concrete for the use in plants for the containment, handling and filling of substances hazardous to water
- 3) e.g.: vehicle pre-fabricated load-bearing elements made of liquid tight concrete granted and marked in accordance with an *allgemeine bauaufsichtliche Zulassung* ('national technical approval') (G) for the use in plants for the containment, handling and filling of substances hazardous to water
- 4) e.g.: gutters (drains) made of fibre concrete, granted and marked in accordance with an *allgemeine bauaufsichtliche Zulassung* ('national technical approval') (G) for the use in plants for the containment, handling and filling of substances hazardous to water
- 5) e.g.: liquid tight slabs made of in-situ concrete

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Admissible contact materials

Annex 5

**Table 1:** Properties of the contact materials

| No   | Property                                  | Characteristic value                                 | Requirements (comments)   |
|--|---|--|---|
| 1  | 2   | 3  | 4   |
| contact materials according to Annex 5, Table 1:                                       |   |  |   |
| 1  | migration behaviour                       | characteristic penetration depth, "e <sub>tk</sub> " | In accordance with the national requirements of the respective countries the characteristic penetration depth "e <sub>tk</sub> " (e <sub>tk</sub> = e <sub>tm</sub> × 1.35) of the respective test liquid in the concrete has to be smaller than the joint side wall protected by the joint sealing compound (d <sub>H</sub> ), see also Annex 3; Figure 1. |
| In addition to concrete according to Annex 5, Table 1, No 3 and 4                      |   |  |   |
| 2  | concrete strength                         | compressive strength class, C                        | ≥ C30/37<br>≤ C50/60<br>(EN 206-1, Table 7)   |
| 3  | tightness                                 | water/cement ratio, w/c                              | w/c ≤ 0.5<br>(EN 206-1, Table F.1)  |
| In addition to fibre concrete <sup>1)</sup> according to Annex 5, Table 1, No 3 and 4: |   |  |   |
| 4  | tightness                                 | water/cement ratio, w/c                              | - w/c < 0.45  |
| 5  | fibres<br>- kind<br>- content<br>- length | -<br>volume, V<br>length of fibre, l                 | - glass fibre<br>- (0.5 ≤ V ≤ 5) vol.-%<br>- l ≤ 25 mm  |

<sup>1)</sup> Only glass fibres may be used, which are marked with the conformity mark foreseen (e.g. in Germany *allgemeine bauaufsichtliche Zulassung* ('national technical approval')) according to national provisions of the respective Member States

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Properties of the contact materials

Annex 6

**Table 1:** Admissible deformation distances for planning and design

| No | Characteristic values/Notes   | Admissible deformations as a result of extension, compressive strain and shear stress |
|----|---|---|
|    | horizontal: <sup>2)</sup>   |   |
| 1  | <b>extension and compressive strain</b> and the sum resulting from extension, compressive strain in the area of parallel joint side walls and in the area of Tee and/or cruciform joints            | 10 mm joint width: 2.5 mm<br>20 mm joint width: 5.0 mm                                |
|    | vertical: <sup>2)</sup>   |   |
| 2  | <b>shear</b> in the area of parallel joint side walls and in the area of Tee and cruciform joints   | 10 mm joint width: 2.5 mm<br>20 mm joint width: 5.0 mm                                |
|    | resulting: <sup>1), 2)</sup>  |   |
| 3  | <b>Combination</b> of horizontal and vertical deformation in the area of parallel joint side walls and in the area of Tee and cruciform joints  | 10 mm joint width: 2.5 mm<br>20 mm joint width: 5.0 mm                                |
| 4  | The effect of the movement behaviour of the adjacent sealing construction (e.g. as a result of temperature, residual shrinkage or creep (concrete)) on the joint width is to be taken into account. |   |

1) **Simultaneous extension and/or compressive stress and shear:**

Taking account of the real stresses, joint sealing compounds may be used placing more emphasis on the extension and/or compression capacity or on the shear capacity according to the following equation.

$$\frac{x_{DS,p}^2}{x_{DS}^2} + \frac{x_{S,p}^2}{x_S^2} \leq 1$$

with:

- $x_{DS}$  admissible horizontal deformation
- $x_{DS,p}$  extension distance and/or compressive strain distance to be expected (for planning)
- $x_S$  admissible shear distance
- $x_{S,p}$  shear distance to be expected (for planning)

2) Intermediate values are to be interpolated linear

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water


Admissible deformation distances for planning and design

Annex 7



**Details of trafficable joint constructions for individual contact materials**


**Figure 1:**

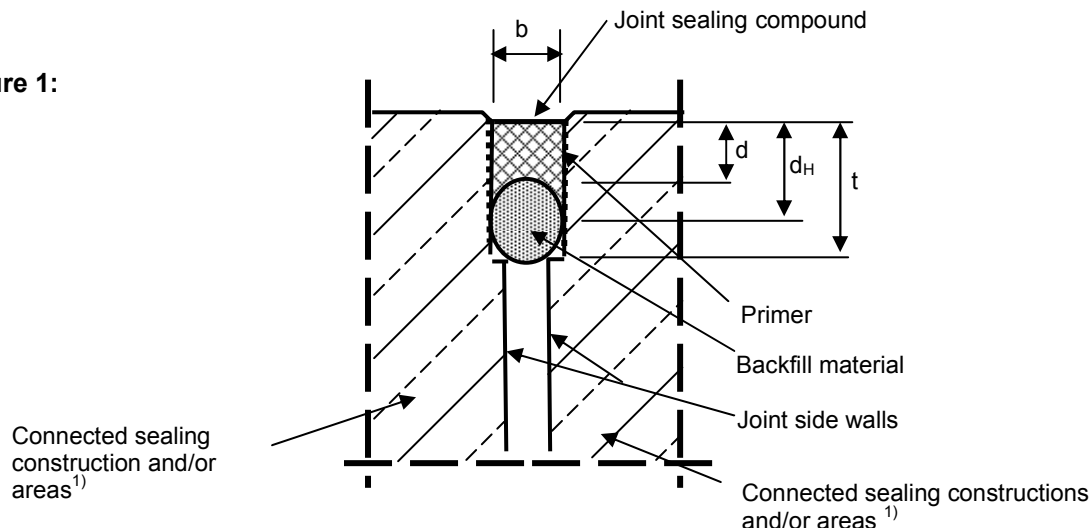

- <sup>1)</sup> admissible contact material:
- concrete
  - fibre concrete
  - polymer-concrete (UP resin base)

**Figure 2:**

steel (uncoated non-alloyed and CD-coated <sup>1)</sup>)

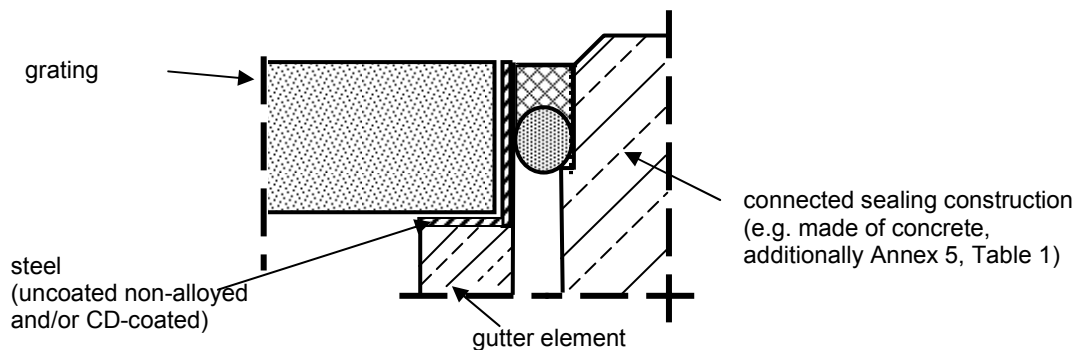

- <sup>1)</sup> CD-coated steel only permitted with cathodic dip coating (corrosion protection) based on aminated, water-insoluble epoxy resin on bisphenol-A

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Examples of trafficable joint construction

Annex 8

## Confirmation by the executing company

No

1. Project - Name.....  
- Size .....

2. storage substance: .....

3. Joint sealing system: weber.tec 971  
as a component of the joint sealing system of the Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

4. Approval: ETA-12/0092 dated on 30.05.2013

5.a Holder of the approval: Saint-Gobain Weber GmbH  
Schanzenstraße 84  
40579 Düsseldorf  
Phone: +49 (0) 73 31 / 97 97-22  
Fax.: +49 (0) 73 31 / 97 97-44

5.b Name of company installing according to .....  
ETA section 4.2.2 (1): .....

5.c Construction period: .....

|   |                                      |
|---|--------------------------------------|
| 6. The qualified personnel of the executing company was instructed by the holder of the European technical approval mentioned above in the proper processing. | Confirmation is on-hand:<br>yes / no |
|---|--------------------------------------|

**7. Evaluations and controls before and during the installation of the joint sealing system**

- a) Before the installation:
- Compare concrete compressive strength class C (C30/37 ≤ C ≤ C50/60) and water-cement ratio (≤ 0.5) with the documentation of the building side journal. Note the characteristic values of the building side journal  
C ...../..... / w/c-ratio: .....
  - joint width / joint distance / depth of the joint space in mm: ...../...../.....
  - surface temperature / thawing temperature in °C: ...../.....
  - bond areas/contact areas are dry: yes / no
  - bond areas/contact areas are free from all contaminations: yes / no
  - system component in accordance with the approval: yes / no
  - Marking of all components in accordance with the approval: yes /
- b) During and after the installation:
- Records of the weather conditions are enclosed: yes / no
  - Visual test: no objections objections  
(see comments)
  - side wall adhesion acc. to section 4.2.4(3): no objections objections  
(see comments)

Remarks:

Date: .....

Signature / firm stamp

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Example of a Confirmation by the executing company

Annex 9

### Stress levels for the effective hourly capacity of water-contaminating substances

The level of chemical exposure shall be chosen in accordance with the following Tables 5.1 and 5.2. The Tables indicate the time and/or the frequency (period of exposure and frequency, respectively) as well as the appropriate time (test period) during which the test liquid (see list of test liquids) acts on the joint sealing compound (during the test).

**Table 5.1:** Stress level related to the period of stress during storage in a test liquid

| Stress level<br>1    | Description<br>2 | Period of stress<br>3 | Test period<br>4        |
|----------------------|------------------|-----------------------|-------------------------|
| <b>Storage (S)</b>   |                  |                       |                         |
| <b>S<sub>1</sub></b> | low              | up to 8 hours         | 8 hours                 |
| <b>S<sub>2</sub></b> | mean             | up to 72 hours        | 72 hours                |
| <b>S<sub>3</sub></b> | high             | up to 3 months        | ≥ 21 days <sup>1)</sup> |

- 1) As far as no change is visible. Otherwise the test period can be prolonged until stability of mass, however up to 42 days at the most.

**Table 5.2:** Stress level related to the frequency of filling and/or handling period of test liquids

| Stress level<br>1                   | Description<br>2 | Period of stress<br>3         | Test period<br>4        |
|-------------------------------------|------------------|-------------------------------|-------------------------|
| <b>Handling (H) and Filling (F)</b> |                  |                               |                         |
| <b>H<sub>1</sub>, F<sub>1</sub></b> | low              | maximum of 4 times per year   | 8 hours                 |
| <b>H<sub>2</sub>, F<sub>2</sub></b> | mean             | maximum of 200 times per year | 72 hours                |
| <b>F<sub>3</sub></b>                | high             | more than 200 times per year  | ≥ 21 days <sup>1)</sup> |

- 1) As far as no change is visible. Otherwise the test period can be prolonged until stability of mass, however up to 42 days at the most.

weber.tec 971 as a component of the joint sealing system of Saint-Gobain Weber GmbH used in facilities for the storage, handling and filling of substances hazardous to water

Stress levels

Annex 10