



Approval body for construction products and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and Laender Governments



European Technical Assessment

ETA-09/0161 of 22 July 2014

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Stair with load-bearing handrail System H + I

Prefabricated stair with steps and a load bearing handrail made of solid wood for use as an indoor stair in buildings

H + I Treppentechnik AG
Eschnerstraße 51
9487 BENDERN
FÜRSTENTUM LIECHTENSTEIN

H+I Treppentechnik Werk 1-99

15 pages including 3 annexes which form an integral part of this assessment

Guideline for European technical approval of "Prefabricated stair kits", ETAG 008 Part 1: "Prefabricated stair kits in general (excluding severe climatic conditions)", January 2002, used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011.



Page 2 of 15 | 22 July 2014

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to Article 25 Paragraph 3 of Regulation (EU) No 305/2011.



Page 3 of 15 | 22 July 2014

English translation prepared by DIBt

Specific Part

1 Technical description of the product

The Stair with load-bearing handrail System H +I is a prefabricated stair system, which consists of steps, a railing (consisting of handrail, posts and balusters), fasteners, load-bearing bolts and wall ties. The stair can also be formed as a folded plate stair by additional risers.

On the wall-free side the steps are connected with each other by a load-bearing bolt and via balusters with the load-bearing handrail. On the wall side each step is equipped with two wall ties which are anchored in the staircase wall. Alternatively, the staircase wall may also be replaced by a stringer or as on the wall-free side by a load-bearing handrail.

The steps, the handrail, the posts and the distance sleeves are made of solid wood, the balusters are made of steel or solid wood the fasteners, load-bearing bolts and wall ties are made of steel.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the stair is used in compliance with the specifications and conditions given in Annex B.

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the stair of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.



Page 4 of 15 | 22 July 2014

English translation prepared by DIBt

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|------------------------------------|--|
| Load-bearing capacity | See Annex C2 |
| Load/displacement behaviour | See Annex C2 |
| Vibration behaviour | First natural frequency: $f_1 \ge 5$ Hz (inclusive a single mass of 100 kg) Deflection under a single load F = 1 kN: $w \le 5$ mm |
| Prevention of progressive collapse | Failure of individual components of the stair does not lead to a progressive collapse of the complete stair |
| Residual load-bearing capacity | Local material failure does not lead to an abrupt total loss of load-bearing capacity of the steps. |
| Long-term behaviour | Load-bearing capacity are ensured under an appropriate use and maintenance over the indicated working life |
| Resistance to earthquakes | No performance determined (NPD) |
| Resistance of fixings | See technical documentation of this European Technical Assessment |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance | | | |
|--------------------------|---------------------------------|--|--|--|
| Reaction to fire | See Annex A5 | | | |
| Fire resistance | No performance determined (NPD) | | | |

3.3 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances there may be requirements (e.g. transposed European legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this European Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.



Page 5 of 15 | 22 July 2014

English translation prepared by DIBt

3.4 Safety in use (BWR 4)

| Essential characteristic | Performance | | |
|---------------------------------------|---|--|--|
| Geometry | See Annex C1 | | |
| Slipperiness | No performance determined (NPD) | | |
| Equipment of the stair for a safe use | Barrier and handrail are components of the stair (see Annex C1) | | |
| | Vertical balusters, arranged between step and handrail, are used as fill-in elements. Thereby climb ability for infants will not be supported | | |
| | Tactility and visibility: No performance determined (NPD) | | |
| Safe breakage of components | No brittle failure of individual components | | |
| Impact resistance | No performance determined (NPD) | | |

3.5 Protection against noise (BWR 5)

Not applicable.

3.6 Energy economy and heat retention (BWR 6)

Not applicable.

3.7 Sustainable use of natural resources (BWR 7)

The sustainable use of natural resources was not investigated.

3.8 General aspects

| Essential characteristic | Performance |
|--|---|
| Resistance to deterioration caused by physical, chemical and biological agents | Adequate resistance for the intended use under an appropriate use and maintenance |
| Finishes and surface layers | Components made of solid wood can be coated with varnish on all sides or they are oiled |





Page 6 of 15 | 22 July 2014

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision of the Commission of 3 February 1999 (99/89/EC) (OJ L 029 of 25.01.1999 p. 34-37)) the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

| Product | Intended use | Level or class | System |
|--------------------------|-----------------------------------|----------------|--------|
| Prefabricated stair kits | For dwellings and other buildings | - | 2+ |

Additional according to Decision of the Commission of 8 January 2001 (2001/596/EC) (OJ L 209 of 02.08.2001 p. 33-42) the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

| Product | Intended use | Level or class | System |
|--------------------------|---|-----------------------------------|--------|
| Prefabricated stair kits | For uses subject to regulations on reaction to fire | According to Annex A5, Table 1 | 4 |


5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 22 July 2014 by Deutsches Institut für Bautechnik

Uwe Benderbeglaubigt:Head of DepartmentWittstock




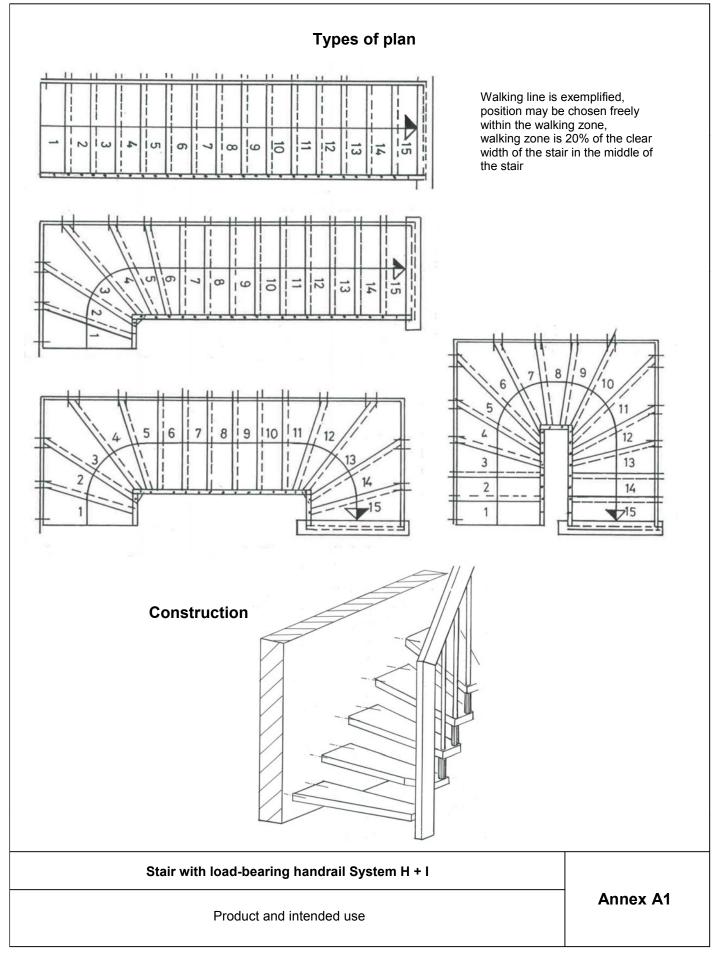



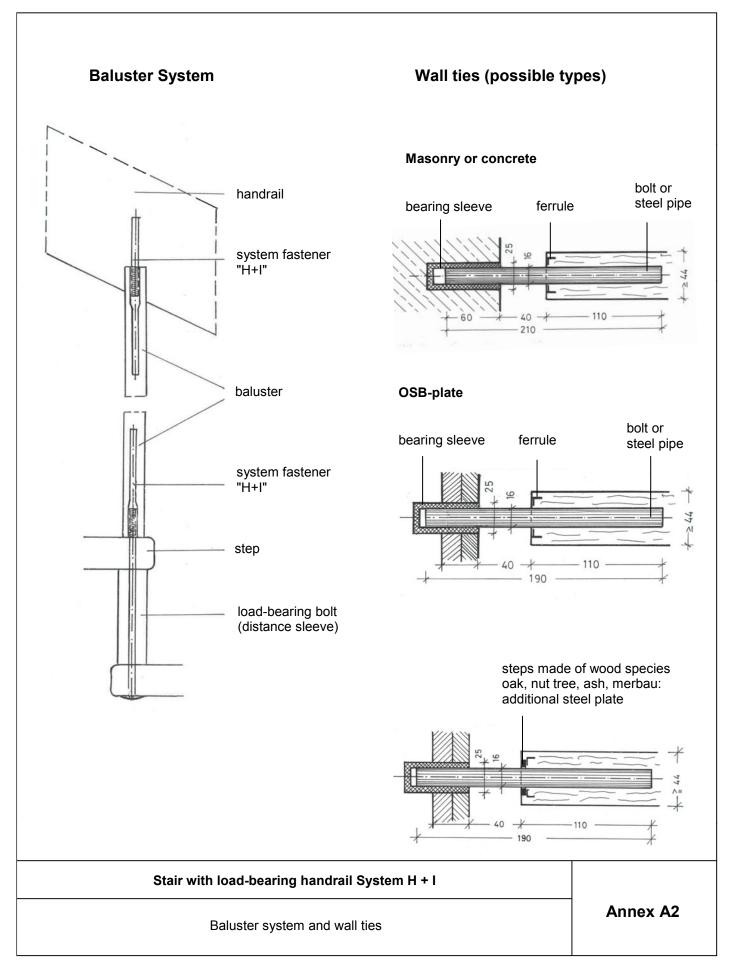



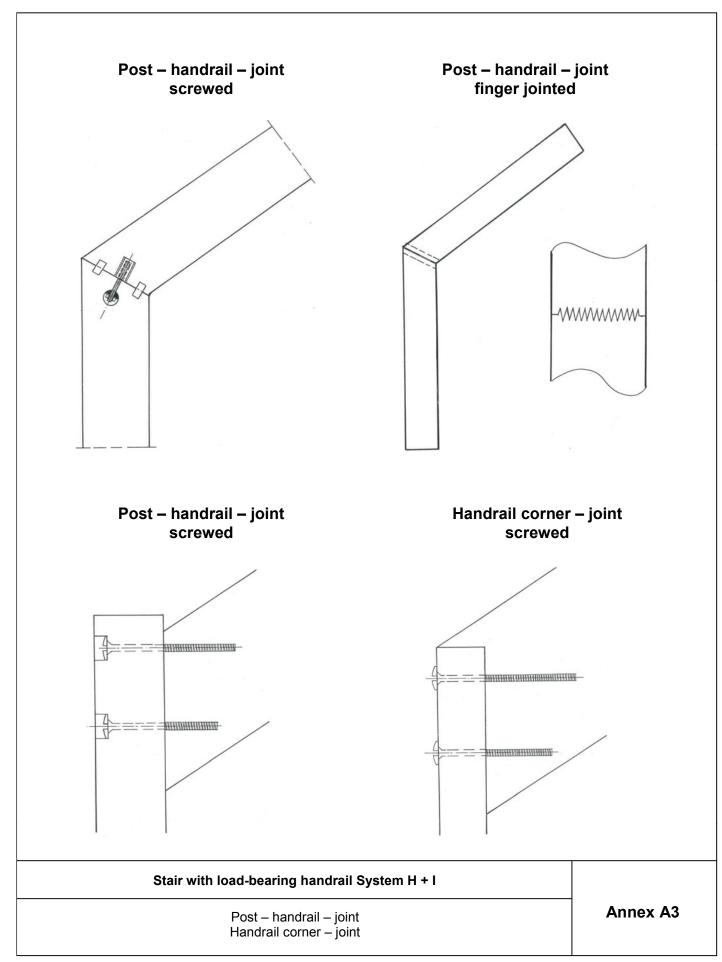

English translation prepared by DIBt



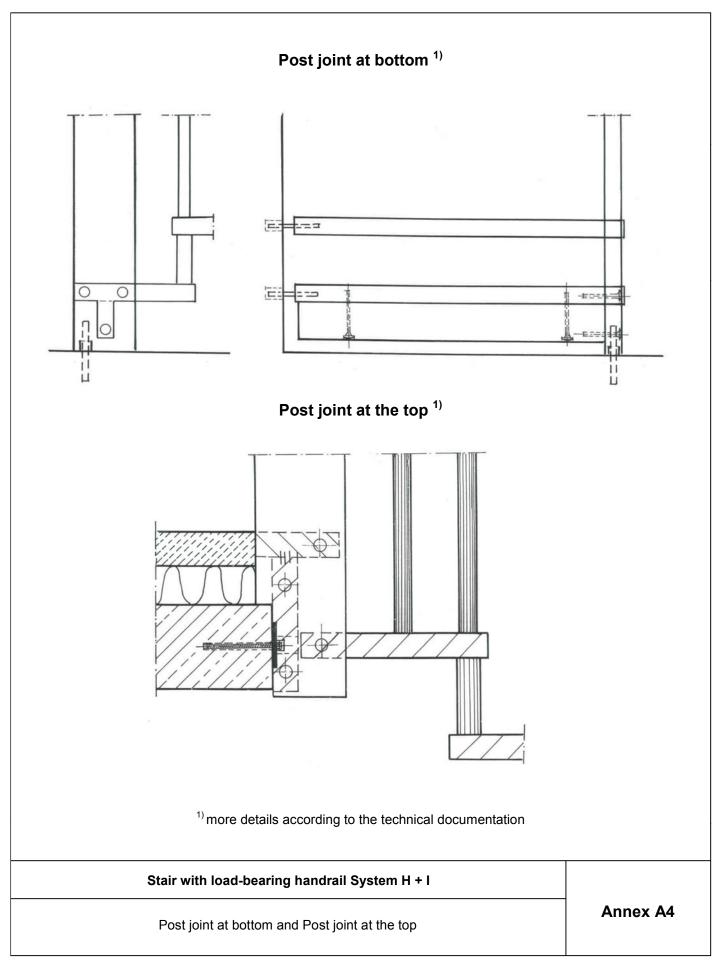




Table 1: Minimum dimensions of relevant stair components and reaction to fire

| Comp | Component of stair Material ¹⁾ Dimension | | Value | Reaction to fire ³⁾ | | |
|-----------------------------|---|------------------|---------------------------------|--------------------------------|-----------------------------|---------------------------|
| | step | solid wood 2) | thickness | [mm] | 44 | D-s2, d0 (2003/593/EC) |
| upper flange of the railing | straight flights only finger jointed | solid wood 2) | height / width | [mm] | 160 / 53 (45) ⁴⁾ | D-s2, d0 (2003/593/EC) |
| (handrail) | other flights | solid wood 2) | height / width | [mm] | 160 / 45 | (2000/000/20) |
| | straight flights only finger jointed | solid wood 2) | height / width | [mm] | 160 / 53 (45) ⁴⁾ | D-s2, d0 |
| posts | other flights | solid wood 2) | height / width | [mm] | 160 / 45 80 / 80 | (2003/593/EC) |
| | baluster | | diameter | [mm] | 30 | D-s2, d0 (2003/593/EC) |
| | | | diameter | [mm] | 10 | A1 (96/603/EC) |
| load-bearing | bolt / system fastener | steel | diameter | [mm] | 10 | A1 (96/603/EC) |
| distance slee | distance sleeve (load-bearing bolt) | | diameter | [mm] | 40 | D-s2, d0 (2003/593/EC) |
| | | | diameter | [mm] | 16 | |
| all Kaa | | round steel | diameter x wall thickness | [mm] | 16 x 2.0 | A4 (06/603/EC) |
| | wall ties | or steel pipe | embedment depth wall | [mm] | 60 (32) ⁵⁾ | A1 (96/603/EC) |
| | | | embedment depth step | [mm] | 110 | |
| bearing | sleeve (wall tie) | plastic | diameter | [mm] | 25 | not relevant |

¹⁾ characteristic values of material according to technical documentation

| Stair with load-bearing handrail System H + I | |
|--|----------|
| Minimum dimensions of relevant stair components and reaction to fire | Annex A5 |

Z35465.14 8.05.06-17/14

only hardwood of the following species: beech, oak, maple, acacia, nut tree, ash, merbau

³⁾ according to the EC decisions

⁴⁾ value in brackets if handrail is horizontal fixed in height of the floor slab

⁵⁾ value in brackets for OSB-wall



Specification of intended use (Part 1)

Intended use:

- European Technical Assessment applies for a construction system.
- For the specific case of use the corresponding type of stair is manufactured within the context of the values defined in this European Technical Assessment.
- Values of this ETA apply to all types of stairs, the real dimensions follow in accordance with the relevant case of use.

Stair subject to:

Static and quasi static loads

Use conditions:

- Indoor stair
- Air temperatures between +5 °C and +30 °C
- Relative air humidity between 30% and 70%

Design:

- Design of the stair according to the annexes and the technical documentation of this European Technical Assessment.
- Fastening of the stair to the construction works according to the annexes and the technical documentation of this Technical European Assessment.
- Verification of the transmission of loads to the construction works by the civil engineer responsible for the construction works.
- Load bearing capacity at ultimate limit state:

$$q_k \cdot \gamma_Q \leq q_{Rk} / \gamma_M$$

 $Q_k \cdot \gamma_Q \leq Q_{Rk} / \gamma_M$
 $h_k \cdot \gamma_Q \cdot \psi_0 \leq h_{Rk} / \gamma_M$

with

 $q_{Rk},\,Q_{Rk},\,h_{Rk:}$ characteristic values of resistance; see Table 3

 $\gamma_{\rm M}$: recommended material partial safety factor; see Table 3

 q_k, Q_k, h_k : characteristic values of imposed loads according to EN 1991-1-1:2010-12 $\gamma_Q = 1.5$: recommended partial safety factor, in absence of other national regulations $\psi_0 = 0.7$: recommended combination factor, in absence of other national regulations

 Maximum characteristic values of imposed loads under consideration of the partial factors mentioned above; see Table 5

Stair with load-bearing handrail System H + I

Annex B1

Specification of intended use (Part 1)

Z35465.14 8.05.06-17/14





Specification of intended use (Part 2)

Installation:

- Installation by personal appropriately trained and authorized by the holder of the approval by means of the technical documentation of this European Technical Assessment
- Installation only in the way as specified in the technical documentation of this European Technical Assessment
- Installation of timber components when moisture content of timber components is 8 \pm 2 %
- Sufficient support of the stair when assembling
- Installation of stair components without imposed deformations
- Installation of stair components without significant defects and cracks
- Replacing of stair components, which begin tearing when assembling
- Bolted connection are protected such that they will not be loosened by vibrations

Indication of the manufacturer:

- Ensure that all persons involved will be appropriately informed about the specific conditions according to sections 1 and 2 (including the annexes to which reference is being made as well as the not confidential parts of the technical documentation deposited to this European Technical Assessment)
- Packaging of timber components such that the wood moisture is 8 ± 2 % during transport and storage
- Instructions for use should provide information as to use, maintenance and repair of the stair. Including the information of avoidance of moisture penetration of the timber components and of retightens the bolting of the load-bearing bolts and connections according to Annexes A2 to A4 after the first heating season

Stair with load-bearing handrail System H + I

Specification of intended use (Part 2)

Annex B2


Z35465.14 8.05.06-17/14



Table 2: Geometry

| Designation | | | Dimension | | | |
|------------------|--|---------|---------------------|----------------------|--|--|
| Designation | | minimum | maximum | | | |
| | step on walking line 1) | [mm] | 210 | 370 ²⁾ | | |
| going | tapered step | [mm] | 60 ^{2) 3)} | 540 ^{2) 4)} | | |
| rise of the sta | airs 1) | [mm] | 140 ²⁾ | 210 | | |
| pitch of the w | valking line 1) | [°] | 21 | 45 | | |
| overlap of | wall side | [mm] | 30 | _ 5) | | |
| steps | wall-free side | [mm] | 60 | _ 5) | | |
| number of ris | es | [-] | 3 | 16 | | |
| openings | between barrier and other parts of the stair | [mm] | 0 | 0 | | |
| | between stairs and wall | [mm] | _ 5) | 40 | | |
| | between consecutive steps | [mm] | - ⁵⁾ | 166 | | |
| | between balusters | [mm] | 40 | 140 | | |
| clear width of | stairs | [mm] | 500 | 1000 | | |
| minimum headroom | | [mm] | _ 5) | | | |
| length of the | flight | [mm] | - ⁵⁾ | 3900 | | |
| thickness of | steps | [mm] | 45 | _ 5) | | |
| upper flange | of the railing / handrail | [mm] | 900 | 1000 | | |
| | width | [mm] | 45 | 53 | | |
| handrail | height | [mm] | 160 | _ 5) | | |
| | clear distance to adjacent components | [mm] | 50 | _ 5) | | |

- 1) values are constant within one flight
- $^{2)}$ tolerance between nominal value and actual value = $\pm\,5$ mm
- 3) inside of tapered step
- outside of tapered step
- 5) not relevant
 - 1 going
 - 2 rise
 - 3 overlap
 - 4 opening between consecutive steps
 - 5 length of the flight
 - 6 thickness of steps
 - 7 height of the railing / barrier
 - 8 opening between balusters

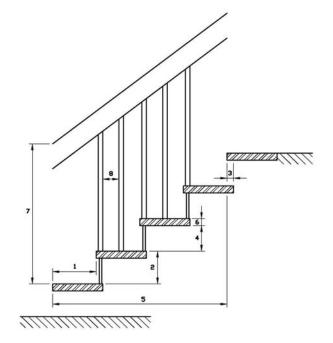

Stair with load-bearing handrail System H + I

Annex C1

Geometry of the stair

Z35465.14



Table 3: Load-bearing capacity - Characteristic values of resistance

| Type of loading | Characteristic values of resistance | | γ _M 1) | |
|---|-------------------------------------|---------|-------------------|-----|
| vertical variable uniformly distributed load | q_{Rk} | [kN/m²] | 7.8 | |
| vertical variable single load | Q_{Rk} | [kN] | 4.5 | 1.5 |
| horizontal variable uniformly distributed load on barrier | h _{Rk} | [kN/m] | 1.1 | |

¹⁾ Recommended partial safety factor, in absence of other national regulations

Table 4: Deflections under loading

| Deflection of the flight under uniformly distributed load | | | | |
|---|----------------|---------|---------|--|
| uniformly distributed load | q _k | [kN/m²] | 3.5 | |
| length of the median line of the flight | L | [mm] | 3900 | |
| deflection under load F _S related to the median line of the flight | w | [-] | ≤ L/200 | |
| Deflection of the step under single point load | | | | |
| single load | Q _k | [kN] | 2.0 | |
| clear width of the stair | L | [mm] | 1000 | |
| deflection under load F _S related to the clear width of the stair | w | [-] | ≤ L/200 | |

Table 5: Imposed loads

| Type of loading | Imposed loads | | |
|---|---------------|---------|-----|
| vertical variable uniformly distributed load | q | [kN/m²] | 3.5 |
| vertical variable single load | Q | [kN] | 2.0 |
| horizontal variable uniformly distributed load on barrier | h | [kN/m] | 0.5 |

Stair with load-bearing handrail System H + I

Load-bearing capacity – Characteristic values of resistance,

Deflections under loading,

Imposed loads

Annex C2