

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-04/0092  
of 22 April 2015

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

MKT Injection System VMZ

Product family  
to which the construction product belongs

Torque controlled bonded anchor with  
anchor rod VMZ-A and internal threaded rod VMZ-IG  
for use in concrete

Manufacturer

MKT  
Metall-Kunststoff-Technik GmbH & Co. KG  
Auf dem Immel 2  
67685 Weilerbach

Manufacturing plant

MKT  
Metall-Kunststoff-Technik GmbH & Co. KG  
Auf dem Immel 2  
67685 Weilerbach

This European Technical Assessment  
contains

32 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

Guideline for European technical approval of "Metal  
anchors for use in concrete", ETAG 001 Part 5: "Bonded  
anchors", April 2013,  
used as European Assessment Document (EAD)  
according to Article 66 Paragraph 3 of Regulation (EU)  
No 305/2011.

This version replaces

ETA-04/0092 issued on 26 January 2015

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to Article 25 Paragraph 3 of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The Injection System VMZ is a torque controlled bonded anchor consisting of a cartridge with injection mortar VMZ or VMZ Express and an anchor rod with expansion cones and external connection thread (type VMZ-A) or with internal connection thread (type VMZ-IG).

The load transfer is realised by mechanical interlock of several cones in the bonding mortar and then via a combination of bonding and friction forces in the anchorage ground (concrete).

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance of VMZ-A	See Annex C1 to C7
Displacements under tension and shear loads for VMZ-A	See Annex C8 and C9
Characteristic resistance of VMZ-IG	See Annex C10 to C12
Displacements under tension and shear loads for VMZ-IG	See Annex C12

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorage satisfy requirements for Class A1
Resistance to fire	No performance determined (NPD)

#### 3.3 Hygiene, health and the environment (BWR 3)

Not applicable.

#### 3.4 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

#### 3.5 Protection against noise (BWR 5)

Not applicable.

#### 3.6 Energy economy and heat retention (BWR 6)

Not applicable.

English translation prepared by DIBt

**3.7 Sustainable use of natural resources (BWR 7)**

The sustainable use of natural resources was not investigated.

**3.8 General aspects**

The verification of durability is part of testing the essential characteristics. Durability is only ensured if the specifications of intended use according to Annex B are taken into account.

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

According to Decision of the Commission of 24 June 1996 (96/582/EC) (OJ L 254 of 08.10.96 p. 62-65), the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Metal anchors for use in concrete (heavy-duty type)	For fixing and/or supporting concrete structural elements or heavy units such as cladding and suspended ceilings	—	1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

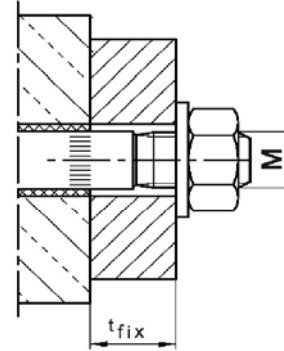
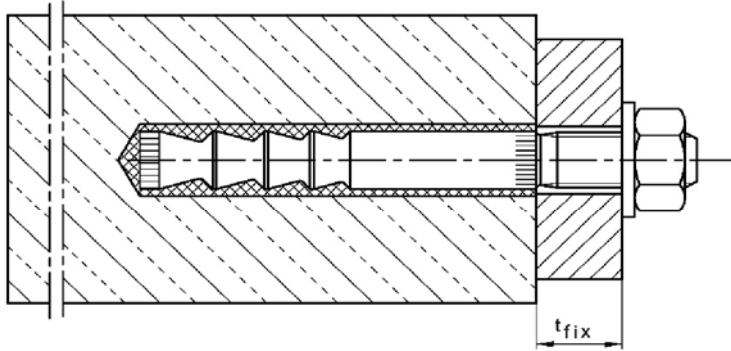
Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 22 April 2015 by Deutsches Institut für Bautechnik



Andreas Kummerow  
p.p. Head of Department

*beglaubigt:*  
Baderschneider

### Anchor rod VMZ-A




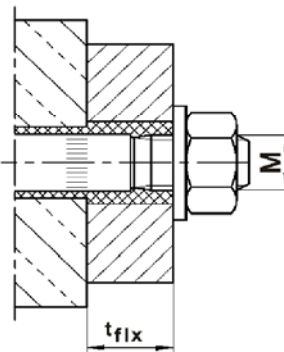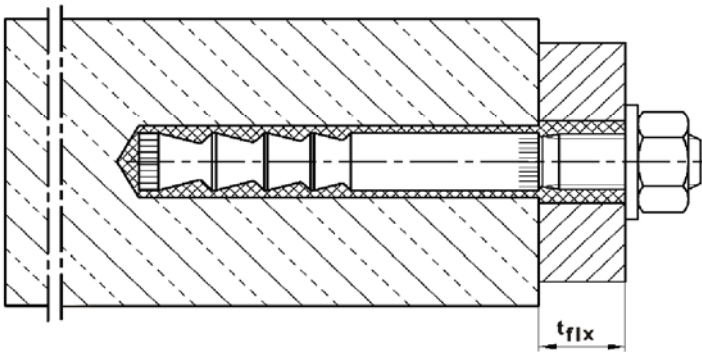**Pre-setting  
installation**  
(and through-setting  
installation  
VMZ-A 75 M12,  
see Annex B8)



**Through-setting  
installation**

### Anchor rod **VMZ-IG** <sup>1)</sup>

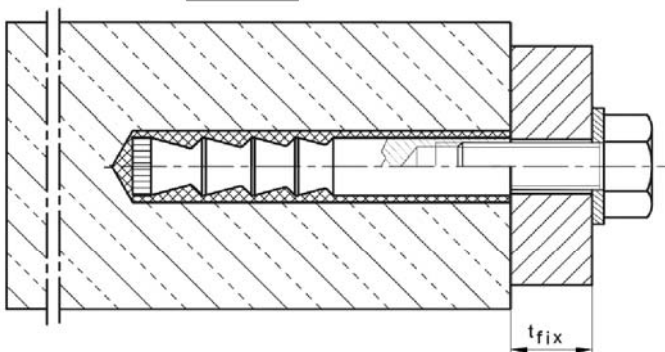

<sup>1)</sup> Illustration with hexagon head screw exemplified; other screws or threaded rods also permitted (see Annex A5, requirements of the fastening screw or threaded rod)

Anchor version	Product description	Intended use	Performance
VMZ-A	Annex A1 – Annex A4	Annex B1 – Annex B8	Annex C1 – Annex C9
<b>VMZ-IG</b>	Annex A1 – Annex A2; Annex A5	Annex B1 – Annex B2; Annex B9 – Annex B11	Annex C10 – Annex C12





### Injection System VMZ

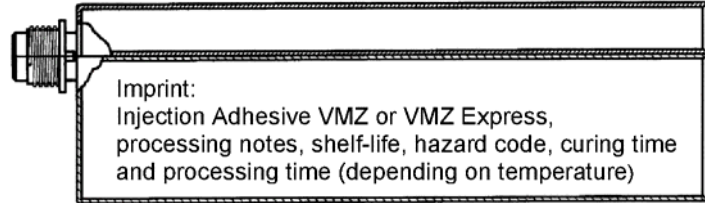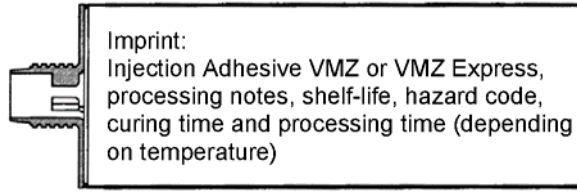Product description  
Installation situation

**Annex A1**

## Injection System VMZ




Mortar cartridge




Sealing cap



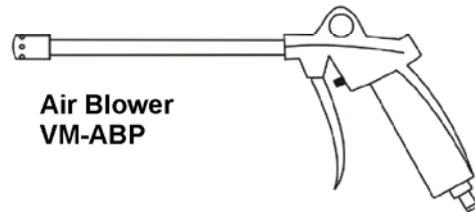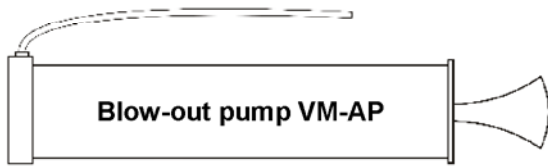Static mixer VM-X




Cleaning Brush RB




Anchor rod VMZ-A

Washer

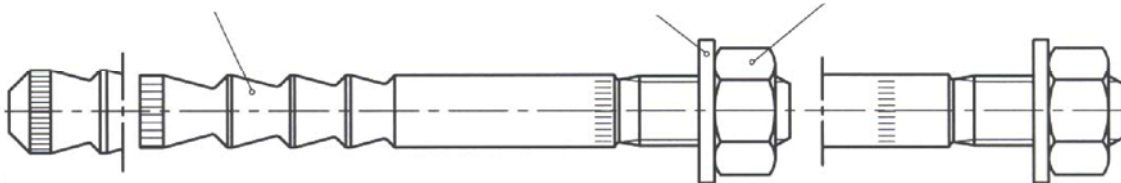Hexagon nut



Anchor rod VMZ-IG



### Injection System VMZ

Product description  
Cartridges / Cleaning tools / Anchor types

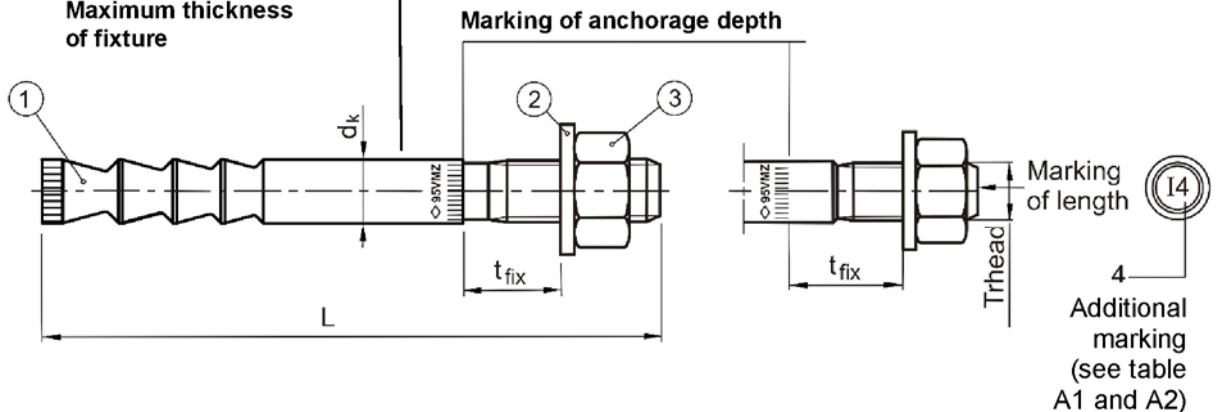
Annex A2

Marking: e.g.  $\diamond$  95 VMZ 12-25 ...

- $\diamond$  Identifying mark of manufacturing plant
- 95 Anchorage depth
- VMZ Trade name
- 12 Size of thread
- 25 Maximum thickness of fixture

A4 additional marking of stainless steel A4

HCR additional marking of high corrosion resistant steel HCR



Marking of length	B	C	D	E	F	G	H	I	J	K	L	M
Length of anchor min $\geq$	50,8	63,5	76,2	88,9	101,6	114,3	127,0	139,7	152,4	165,1	177,8	190,5
Length of anchor max $<$	63,5	76,2	88,9	101,6	114,3	127,0	139,7	152,4	165,1	177,8	190,5	203,2

Marking of length	N	O	P	Q	R	S	T	U	V	W	X	Y	Z	>Z
Length of anchor min $\geq$	203,2	215,9	228,6	241,3	254,0	279,4	304,8	330,2	355,6	381,0	406,4	431,8	457,2	482,6
Length of anchor max $<$	215,9	228,6	241,3	254,0	279,4	304,8	330,2	355,6	381,0	406,4	431,8	457,2	482,6	

Table A1: Dimensions of anchor rod, VMZ-A M8 – M12

Anchor size VMZ-A		40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Additional marking		1	2	1	2	1	2	3	4	5	6	7
1	Anchor rod Thread	M8	M8	M10	M10	M12	M12	M12	M12	M12	M12	M12
	Number of cones	2	3	3	3	3	3	4	4	6	6	6
	$d_k =$	8,0	8,0	9,7	9,7	10,7	12,5	12,5	12,5	12,5	12,5	12,5
	Length L	$52+t_{fix}$	$63+t_{fix}$	$75+t_{fix}$	$90+t_{fix}$	$95+t_{fix}$	$90+t_{fix}$	$100+t_{fix}$	$115+t_{fix}$	$120+t_{fix}$	$130+t_{fix}$	$145+t_{fix}$
3	Hexagon nut SW	13	13	17	17	19	19	19	19	19	19	19

Dimensions in mm

Injection System VMZ

Product description  
Anchor parts / Marking / Anchor dimensions VMZ-A M8 – M12

Annex A3

**Table A2: Dimensions of anchor rod, VMZ-A M16 – M24**

Anchor size VMZ-A		90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Additional marking		1	2	3	4	5	1	2	3	1	2	3
1	Anchor rod											
	Thread	M16	M16	M16	M16	M16	M20	M20	M20	M24	M24	M24
	Number of cones	3	4	6	6	6	3	6	6	6	6	6
	$d_k =$	16,5	16,5	16,5	16,5	16,5	19,7	22,0	22,0	24,0	24,0	24,0
	Length L	114	129	150	170	185	143	203	223	210	240	265
		+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>	+t <sub>fix</sub>
3	Hexagon nut SW	24	24	24	24	24	30	30	30	36	36	36

Dimensions in mm

**Table A3: Materials VMZ-A**

Part	Designation	Steel, zinc plated			Stainless steel A4	High corrosion resistant steel (HCR)
		galvanised	hot-dip galvanised $\geq 40\mu\text{m}$	sherardized $\geq 40\mu\text{m}$		
1	Anchor rod	Steel acc. to EN 10087:1998, galvanised and coated	Steel acc. to EN 10087:1998, hot-dip galvanised and coated	Steel acc. to EN 10087:1998, sherardized and coated	Stainless steel, 1.4401, 1.4404, 1.4571, 1.4362, EN 10088:2005, coated	High corrosion resistant steel 1.4529, 1.4565 acc. to EN 10088:2005, coated
2	Washer	Steel, zinc plated	Steel, zinc plated	Steel, zinc plated	Stainless steel, 1.4401, 1.4571, EN 10088:2005	High corrosion resistant steel 1.4529 or 1.4565, acc. to EN 10088:2005
3	Hexagon nut	Property class 8 acc. to EN ISO 898-2:2012, galvanised	Property class 8 acc. to EN ISO 898-2:2012, hot-dip galvanised	Property class 8 acc. to EN ISO 898-2:2012, sherardized	ISO 3506:2009, A4-70, 1.4401, 1.4571, EN 10088:2005	ISO 3506:2009, Property class 70, high corrosion resistant steel 1.4529 or 1.4565, EN 10088:2005
4	Mortar cartridge	Vinylester resin, styrene free, mixing ratio 1:10				

**Injection System VMZ**

**Product description**  
Anchor dimensions VMZ-A M16 – M24 / Materials VMZ-A

**Annex A4**



Marking: e.g.  $\diamond$  80 VMZ M10

- $\diamond$  Identifying mark of manufacturing plant
- 80 Anchorage depth
- VMZ Trade name
- M10 Size of internal thread

A4 additional marking of stainless steel A4

HCR additional marking of high corrosion resistant steel HCR

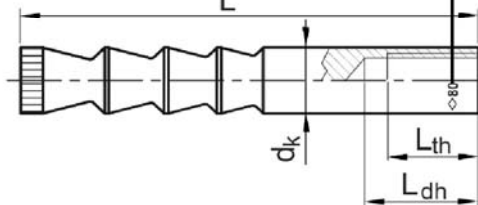


Table A4: Dimensions of anchor rod **VMZ-IG**

Anchor size <b>VMZ-IG</b>		40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Internal thread	-	M6	M6	M8	M8	M10	M10	M12	M12	M12	M16	M16	M20
Number of cones	-	2	3	3	3	3	4	3	4	6	3	6	6
Outer diameter	$d_k$ [mm]	8,0	8,0	9,7	10,7	12,5	12,5	16,5	16,5	16,5	19,7	22,0	24,0
Thread length	$L_{th}$ [mm]	12	15	16	19	20	23	24	27	30	32	32	40
Total length	$L$ [mm]	41	52	63	78	74	84	94	109	130	120	180	182
Length identifier	[mm]	$L_{dh}$ < 18	$L_{dh}$ > 19	$L_{dh}$ < 22,5	$L_{dh}$ > 23,5	$L_{dh}$ < 27	$L_{dh}$ > 28	$L_{dh}$ < 31,5	32,5 < $L_{dh}$ < 34,5	$L_{dh}$ > 35,5	$d_k$ < 21	$d_k$ > 21	-

Table A5: Materials **VMZ-IG**

Part	Designation	Steel, zinc plated		Stainless steel A4	High corrosion resistant steel (HCR)
		galvanized	sherardized $\geq 40\mu\text{m}$		
1	Anchor rod	Steel acc. to EN 10087:1998, galvanized and coated	Steel acc. to EN 10087:1998, sherardized and coated	Stainless steel, 1.4401, 1.4404, 1.4571, 1.4362, EN 10088:2005, coated	High corrosion resistant steel 1.4529, 1.4565 acc. to EN 10088:2005, coated
4	Mortar cartridge	Vinylester resin, styrene free, mixing ratio 1:10			

**Requirements of the fastening screw or the threaded rod and nut**

- Minimum screw-in depth  $L_{sdmin}$  see Table B8:
- The length of screw or the threaded rod must depending on the thickness of fixture  $t_{fix}$ , available thread length  $L_{th}$  (= maximum available thread length, see Table B8:) and the minimum screw-in depth  $L_{sdmin}$  be established.
- $A_5 > 8\%$  ductility

**Steel, zinc plated**

- Minimum property class 8.8 according to EN ISO 898-1:2013 or EN ISO 898-2:2012

**Stainless steel A4**

- Material 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 according to EN 10088:2005
- Minimum property class 70 according to EN ISO 3506:2009

**High corrosion resistant steel (HCR)**

- Material 1.4529; 1.4565 according to EN 10088:2005
- Minimum property class 70 according to EN ISO 3506:2009

**Injection System VMZ**

**Product description**

Anchor parts / anchor dimensions / Materials **VMZ-IG**

**Annex A5**

### Specifications of intended use

Injection System VMZ-A	M8	M10	M12	M16	M20	M24
Static or quasi-static action	✓					
Seismic action, category C1 and C2	-	✓	✓	✓	✓	✓
Cracked and non-cracked	✓					
Injection System <b>VMZ-IG</b>	M6	M8	M10	M12	M16	M20
Static or quasi-static action	✓					
Seismic action	-					
Cracked and non-cracked	✓					

#### Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000
- Strength classes C20/25 to C50/60 according to EN 206-1:2000

#### Temperature Range:

- Temperature Range I: -40 °C to +80 °C (max short term temperature +80 °C and max long term temperature +50 °C)
- Temperature Range II: -40 °C to +120 °C (max short term temperature +120 °C and max long term temperature +72 °C)

#### Use conditions:

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions (high corrosion resistant steel).  
Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

#### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed in accordance with:
  - ETAG 001, Annex C, design method A, Edition August 2010 or
  - CEN/TS 1992-4:2009, design method A
- Anchorages under seismic actions (cracked concrete) are designed in accordance with:
  - EOTA Technical Report TR 045, Edition February 2013
  - Anchorages shall be positioned outside of critical regions (e.g. plastic hinges) of the concrete structure.
  - Fastenings in stand-off installation or with a grout layer are not allowed.

### Injection System VMZ

Intended Use  
Specifications

Annex B1

**Table B1: Installation conditions**

- Anchor installation is carried out by appropriately qualified personnel and under the supervision of the construction manager.
- Water filled bore holes (where admissible) must not be polluted – otherwise the cleaning of the drill hole must be repeated.
- The anchor component installation temperature shall be at least +5 °C; during curing of the injection mortar the temperature of the concrete must not fall below -5 °C. Curing time must be observed prior to loading the anchor.

Anchor size VMZ-A		M8	M10 and 75 M12	70 M12 and 80 M12 - M24
Nominal diameter of drill hole	d <sub>0</sub> [mm]	< 14		≥ 14
Installation allowable in	dry concrete	-	yes	yes
	wet concrete	-	yes	yes
	water-filled hole	-	no	yes
Hole drilling by	Hammer drill bit	-	yes	yes
	Diamond drill bit (not under seismic action)	-	no	yes

Anchor size VMZ-IG		M6 – M8	M10 – M20
Nominal diameter of drill hole	d <sub>0</sub> [mm]	< 14	≥ 14
Installation allowable in	dry concrete	-	yes
	wet concrete	-	yes
	water-filled hole	-	no
Hole drilling by	Hammer drill bit	-	yes
	Diamond drill bit	-	no

**Table B2: Processing time and curing time VMZ**

Temperature [°C] in the drill hole	Maximum processing time	Minimum curing time	
		dry concrete	wet concrete
+ 40 °C	1,4 min	15 min	30 min
+ 35 °C to + 39 °C	1,4 min	20 min	40 min
+ 30 °C to + 34 °C	2 min	25 min	50 min
+ 20 °C to + 29 °C	4 min	45 min	1:30 h
+ 10 °C to + 19 °C	6 min	1:20 h	2:40 h
+ 5 °C to + 9 °C	12 min	2:00 h	4:00 h
0 °C to + 4 °C	20 min	3:00 h	6:00 h
- 4 °C to - 1 °C	45 min	6:00 h	12:00 h
- 5 °C	1:30 h	6:00 h	12:00 h

**Table B3: Processing time and curing time VMZ Express**

Temperature [°C] in the drill hole	Maximum processing time	Minimum curing time	
		dry concrete	wet concrete
+ 30 °C	1 min	10 min	20 min
+ 20 °C to + 29 °C	1 min	20 min	40 min
+ 10 °C to + 19 °C	3 min	40 min	80 min
+ 5 °C to + 9 °C	6 min	1:00 h	2:00 h
+ 0 °C to + 4 °C	10 min	2:00 h	4:00 h
- 4 °C to - 1 °C	20 min	4:00 h	8:00 h
- 5 °C	40 min	4:00 h	8:00 h

**Injection System VMZ**

**Intended Use**

Installation conditions / processing and curing time

**Annex B2**

**Table B4: Installation parameters, VMZ-A M8 – M12**

Anchor size VMZ-A			40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Effective anchorage depth	$h_{ef} \geq$	[mm]	40	50	60	75	75	70	80	95	100	110	125
Nominal diameter of drill hole	$d_0 =$	[mm]	10	10	12	12	12	14	14	14	14	14	14
Depth of drill hole	$h_0 \geq$	[mm]	42	55	65	80	80	75	85	100	105	115	130
Diameter of cleaning brush	$D \geq$	[mm]	10,8	10,8	13,0	13,0	13,0	15,0	15,0	15,0	15,0	15,0	15,0
Installation torque	$T_{inst} \leq$	[Nm]	10	10	15	15	25	25	25	25	30	30	30
Diameter of clearance hole in the fixture													
Pre-setting installation	$d_f \leq$	[mm]	9	9	12	12	14	14	14	14	14	14	14
Through-setting installation	$d_f \leq$	[mm]	-	-	14	14	14 <sup>1)</sup> / 16	16	16	16	16	16	16

<sup>1)</sup> see Annex B8

**Table B5: Installation parameters, VMZ-A M16 – M24**

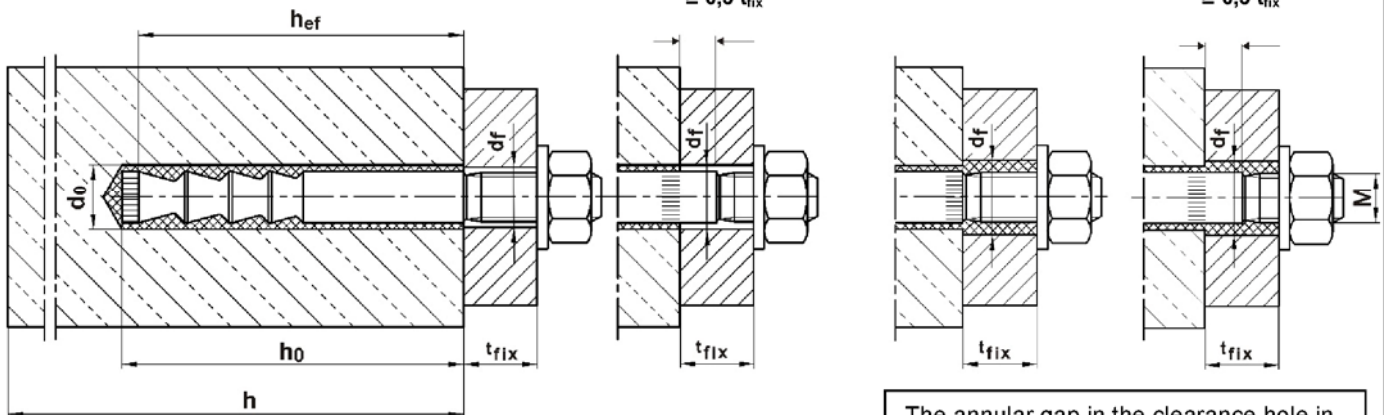
Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Effective anchorage depth	$h_{ef} \geq$	[mm]	90	105	125	145	160	115	170	190	170	200	225
Nominal diameter of drill hole	$d_0 =$	[mm]	18	18	18	18	18	22	24	24	26	26	26
Depth of drill hole	$h_0 \geq$	[mm]	98	113	133	153	168	120	180	200	185	215	240
Diameter of cleaning brush	$D \geq$	[mm]	19,0	19,0	19,0	19,0	19,0	23,0	25,0	25,0	27,0	27,0	27,0
Installation torque	$T_{inst} \leq$	[Nm]	50	50	50	50	50	80	80	80	100	120	120
Diameter of clearance hole in the fixture													
Pre-setting installation	$d_f \leq$	[mm]	18	18	18	18	18	22	24 (22)	24 (22)	26	26	26
Through-setting installation	$d_f \leq$	[mm]	20	20	20	20	20	24	26	26	28	28	28

**Pre-setting installation**

**Through-setting installation**

size M20 + M24  
 $\geq 0,5 t_{fix}$

size M20 + M24  
 $\geq 0,5 t_{fix}$



The annular gap in the clearance hole in the fixture has to be filled completely by excess mortar!

**Injection System VMZ**

**Intended Use**  
Installation parameters VMZ-A

**Annex B3**

**Table B6: Minimum spacing and edge distance, VMZ-A M8 – M12**

Anchor size VMZ-A		40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Minimum thickness of concrete	$h_{min}$ [mm]	80	80	100	110 100 <sup>1)</sup>	110	110	110	130 125 <sup>1)</sup>	130	140	160
<b>Cracked concrete</b>												
Minimum spacing	$s_{min}$ [mm]	40	40	40	40	50	55	40	40	50	50	50
Minimum edge distance	$c_{min}$ [mm]	40	40	40	40	50	55	50	50	50	50	50
<b>Non-cracked concrete</b>												
Minimum spacing	$s_{min}$ [mm]	40	40	50	50	50	55	55	55	80 <sup>2)</sup>	80 <sup>2)</sup>	80 <sup>2)</sup>
Minimum edge distance	$c_{min}$ [mm]	40	40	50	50	50	55	55	55	55 <sup>2)</sup>	55 <sup>2)</sup>	55 <sup>2)</sup>

**Table B7: Minimum spacing and edge distance, VMZ-A M16 – M24**

Anchor size VMZ-A		90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Minimum thickness of concrete	$h_{min}$ [mm]	130	150	170 160 <sup>1)</sup>	190 180 <sup>1)</sup>	205 200 <sup>1)</sup>	160	230 220 <sup>1)</sup>	250 240 <sup>1)</sup>	230 220 <sup>1)</sup>	270 260 <sup>1)</sup>	300 290 <sup>1)</sup>
<b>Cracked concrete</b>												
Minimum spacing	$s_{min}$ [mm]	50	50	60	60	60	80	80	80	80	80	80
Minimum edge distance	$c_{min}$ [mm]	50	50	60	60	60	80	80	80	80	80	80
<b>Non-cracked concrete</b>												
Minimum spacing	$s_{min}$ [mm]	50	60	60	60	60	80	80	80	80	105	105
Minimum edge distance	$c_{min}$ [mm]	50	60	60	60	60	80	80	80	80	105	105

<sup>1)</sup> The remote face of the concrete member shall be inspected to ensure there has been no break-through by drilling. In case of break-through, the ground of the drill hole shall be closed with high strength mortar. The full bonded length  $h_{ef}$  shall be achieved and any potential loss of injection mortar shall be compensated.

<sup>2)</sup> For an edge distance  $c \geq 80$  mm a minimum spacing  $s_{min} = 55$  mm is applicable.













**Injection System VMZ**

**Intended Use**  
Minimum spacing and edge distance, VMZ-A

**Annex B4**

## Installation instructions VMZ-A

### Making and cleaning of hammer drilled holes









1	Pre-setting installation V		Use Hammer drill or air drill with drill bit and depth gauge. Drill perpendicular to concrete surface.
	Through-setting installation D		<b>Drill hole must be cleaned directly prior to installation of the anchor.</b> It must be ensured that icing does not occur in the drill hole.
2	V		<b>VMZ-A M8 - M16:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times. The Extension Tube with reduced diameter must be added to the Blow-out pump for the diameter M8.
			<b>VMZ-A M20 - M24:</b> Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.
	D		<b>VMZ-A M10 - M16:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times.
			<b>VMZ-A M20 - M24:</b> Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.
3	V		Check diameter of cleaning brush RB. If brush can be pushed into the drill hole without any resistance, it must be replaced. Chuck brush into drill machine. Turn on drill machine. Brush drill hole back and forth along the entire drill hole depth at least two times while rotated by drill machine.
	D		
4	V		<b>VMZ-A M8 - M16:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times. The Extension Tube with reduced diameter must be added to the Blow-out pump for the diameter M8.
			<b>VMZ-A M20 - M24:</b> Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.
	D		<b>VMZ-A M10 - M16:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times.
			<b>VMZ-A M20 - M24:</b> Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.

### Injection System VMZ

**Intended Use**  
Installation instructions VMZ-A  
Making and cleaning of hammer drilled holes

**Annex B5**












**Making and cleaning of diamond core drilled holes**

1	Pre-setting installation V		Use diamond drill with diamond drill bit and depth gauge. Drill perpendicular to concrete surface.
	Through-setting installation D		<b>Drill hole must be cleaned directly prior to installation of the anchor.</b> It must be ensured that icing does not occur in the drill hole.
2	V		Remove drill core at least up to the nominal hole depth and check drill hole depth.
	D		
3	V		Flushing of drill hole: Flush drill hole with water, starting from the bottom, until clear water gets out of the drill hole.
	D		
4	V		Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.
	D		

**Injection System VMZ**

**Intended Use**  
Installation instructions VMZ-A  
Making and cleaning of diamond core drilled holes

**Annex B6**

Injection			
5	D+V		Check expiration date on VMZ cartridge. Never use when expired. Remove cap from VMZ cartridge. Screw Mixer Nozzle VM-X on cartridge. When using a new cartridge always use a new Mixer Nozzle. Never use cartridge without Mixer Nozzle and never use Mixer Nozzle without helix inside.
6	D+V		Insert cartridge in Dispenser. Before injecting discard mortar (at least 2 full strokes or a line of 10 cm) until it shows a consistent grey colour. Never use this mortar.
7	V		Prior to injection, check if Mixer Nozzle VM-X reaches the bottom of the drill hole. If it does not reach the bottom, plug Mixer Extension VM-XE onto Mixer Nozzle in order to fill the drill hole properly. Fill hole with a sufficient quantity of injection mortar. Start from the bottom of the drill hole and work out to avoid trapping air pockets.
	D		
Insertion of anchor rod			
8	V		Insert the anchor rod VMZ-A by hand, rotating slightly up to the full embedment depth as marked on the anchor rod. The anchor rod is properly set when excess mortar seeps from the hole. If the hole is not completely filled, pull out anchor rod, let mortar cure, drill out hole and repeat entire cleaning process.
	D		
9	V		Follow minimum curing time shown in Table B2 or Table B3 During curing time, anchor rod must not be moved or loaded.
	D		
10	V		Remove excess mortar.
	D		
11	D+V		The fixture can be mounted after curing time. Apply installation torque $T_{inst}$ according to Table B4 or Table B5 by using torque wrench.
<b>Injection System VMZ</b>			<b>Annex B7</b>
Intended Use Installation instructions VMZ-A Anchor installation			







## Installation instructions VMZ-A 75 M12

### Through-setting installation with clearance between concrete and anchor plate

Work step 1-7 as illustrated in Annexes B5 – B7

**Requirement: Diameter of clearance hole in the fixture  $d_f \leq 14$  mm**

8		<p>Insert the anchor rod VMZ-A by hand, rotating slightly up to the full embedment depth.</p>
9		<p>Check if excess mortar seeps from the hole. If the hole is not completely filled, pull out anchor rod, let mortar cure, drill out hole and repeat the entire cleaning process.</p> <p><b>The annular gap in the fixture does not have to be filled.</b></p>
10		<p>During curing time according to Table B2 or Table B3 anchor rod must not be moved or loaded.</p>
11		<p>Washer and nut can be mounted after curing time and backfilling of anchor plate. Apply installation torque <math>T_{inst}</math> according to Table B4 by using torque wrench.</p>

### Injection System VMZ

#### Intended Use

Installation instructions **VMZ-A 75 M12**


Through-setting installation with clearance between concrete and anchor plate

**Annex B8**

**Table B8: Installation parameters VMZ-IG**

Anchor size <b>VMZ-IG</b>			40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Effective anchorage depth	$h_{ef} =$	[mm]	40	50	60	75	70	80	90	105	125	115	170	170
Nominal diameter of drill hole	$d_0 =$	[mm]	10	10	12	12	14	14	18	18	18	22	24	26
Depth of drill hole	$h_0 \geq$	[mm]	42	55	65	80	80	85	98	113	133	120	180	185
Diameter of cleaning brush	$D \geq$	[mm]	10,8	10,8	13,0	13,0	15,0	15,0	19,0	19,0	19,0	23,0	25,0	27,0
Installation torque	$T_{inst} \leq$	[Nm]	8	8	10	10	15	15	25	25	25	50	50	80
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7	7	9	9	12	12	14	14	14	18	18	22
Available thread length	$L_{th}$	[mm]	12	15	16	19	20	23	24	27	30	32	32	40
Minimum screw-in depth	$L_{sdmin}$	[mm]	7	7	9	9	12	12	14	14	14	18	18	22
Minimum thickness of concrete	$h_{min}$	[mm]	80	80	100	110	110	110	130	150	170 160 <sup>1)</sup>	160	230 220 <sup>1)</sup>	230 220 <sup>1)</sup>
<b>Cracked concrete</b>														
Minimum spacing	$s_{min}$	[mm]	40	40	40	40	55	40	50	50	60	80	80	80
Minimum edge distance	$c_{min}$	[mm]	40	40	40	40	55	50	50	50	60	80	80	80
<b>Non-cracked concrete</b>														
Minimum spacing	$s_{min}$	[mm]	40	40	50	50	55	55	50	60	60	80	80	80
Minimum edge distance	$c_{min}$	[mm]	40	40	50	50	55	55	50	60	60	80	80	80
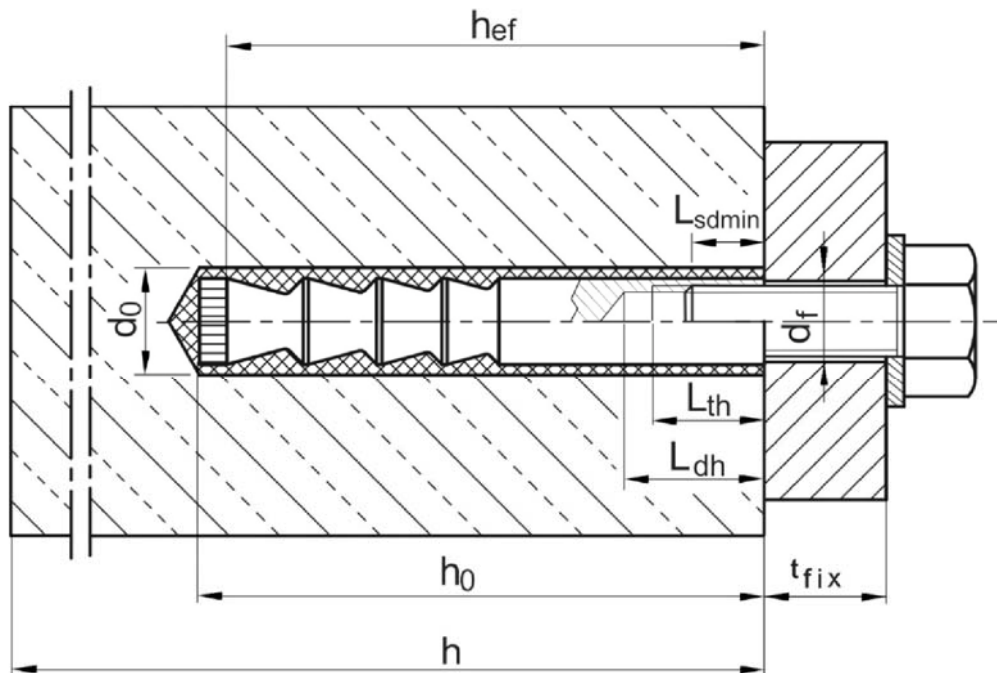
<sup>1)</sup> The remote face of the concrete member shall be inspected to ensure there has been no break-through by drilling. In case of break-through the ground of the drill hole shall be closed with high strength mortar. The full bonded length  $h_{ef}$  shall be achieved and any potential loss of injection mortar shall be compensated.



**Injection System VMZ**

**Intended Use**  
Installation parameters **VMZ-IG**

**Annex B9**

## Installation instructions **VMZ-IG**

### Making and cleaning of hammer drilled holes

1		Use Hammer drill or air drill with drill bit and depth gauge. Drill perpendicular to concrete surface.
		<b>Drill hole must be cleaned directly prior to installation of the anchor.</b> It must be ensured that icing does not occur in the drill hole.
2		<b>VMZ-IG M6 - M12:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times. The Extension Tube with reduced diameter must be added to the Blow-out pump for the diameter M6.
		<b>VMZ-IG M16 - M20:</b> Connect MKT Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.
3		Check diameter of Cleaning Brush RB. If brush can be pushed into the drill hole without any resistance, it must be replaced. Chuck brush into drill machine. Turn on drill machine. Brush drill hole back and forth along the entire drill hole depth at least two times while rotated by drill machine.
4		<b>VMZ-IG M6 - M12:</b> Blow out drill hole from the bottom with Blow-out pump VM-AP at least two times. The Extension Tube with reduced diameter must be added to the Blow-out pump for the diameter M6.
		<b>VMZ-IG M16 - M20:</b> Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.

### Making and cleaning of diamond drilled holes




1		Use diamond drill with diamond drill bit and depth gauge. Drill perpendicular to concrete surface.
		<b>Drill hole must be cleaned directly prior to installation of the anchor.</b> It must be ensured that icing does not occur in the drill hole.
2		Remove drill core at least up to the nominal hole depth and check drill hole depth.
3		Flushing of drill hole: Flush drill hole with water, starting from the bottom, until clear water gets out of the drill hole.
4		Connect Air Blower VM-ABP to compressed air (min. 6 bar, oil-free). Open air valve and blow out drill hole along the entire depth with back and forth motion at least two times.

### Injection System VMZ





Intended Use  
Installation instructions **VMZ-IG**  
Drilling and cleaning

Annex B10

### Injection

5		<p>Check expiration date on VMZ cartridge. Never use when expired. Remove cap from VMZ cartridge. Screw Mixer Nozzle VM-X on cartridge. When using a new cartridge always use a new Mixer Nozzle. Never use cartridge without Mixer Nozzle and never use Mixer Nozzle without helix inside.</p>
6		<p>Insert cartridge in dispenser. Before injecting discard mortar (at least 2 full strokes or a line of 10 cm) until it shows a consistent grey colour. Never use this mortar.</p>
7		<p>Prior to injection, check if Mixer Nozzle VM-X reaches the bottom of the drill hole. If it does not reach the bottom, plug Mixer Extension VM-XE onto Mixer Nozzle in order to fill the drill hole properly. Fill cleaned drill hole with a sufficient quantity of injection mortar. Start from the bottom of the drill hole and work out to avoid trapping air pockets.</p>

### Setting of anchor

8		<p>Insert the anchor rod <b>VMZ-IG</b> by hand, rotating slightly up to about 1mm below the concrete surface in the drill hole. The anchor rod is properly set when excess mortar seeps from the hole. If the hole is not completely filled, pull out anchor rod, let mortar cure, drill out hole and repeat the entire cleaning process.</p>
9		<p>Follow minimum curing time shown in Table B2 and Table B3. During curing time anchor rod must not be moved or loaded.</p>
10		<p>Remove excess mortar.</p>
11		<p>The fixture can be mounted after curing time. Apply installation torque <math>T_{inst}</math> according to Table B8 by using torque wrench.</p>

### Injection System VMZ

Intended Use  
Installation instructions **VMZ-IG**  
Anchor installation

Annex B11

**Table C1:** Characteristic values for **tension loads, VMZ-A M8 – M12,**  
**cracked concrete,** static and quasi-static action  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A			40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure</b>													
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated	[kN]	15	18	25	35	49	54	57				
	A4, HCR	[kN]	15	18	25	35	49	54	57				
Partial safety factor	$\gamma_{Ms}$	[-]	1,5										
<b>Pull-out</b>													
Characteristic resistance $N_{Rk,p}$ in concrete C20/25	50°C / 80°C <sup>2)</sup>	[kN]	1)										
	72°C / 120°C <sup>2)</sup>	[kN]	5	7,5	12	12	12	16	20	20	30	30	30
Increasing factor	$\psi_C$	[-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$										
<b>Concrete cone failure</b>													
Effective anchorage depth	$h_{ef} \geq$	[mm]	40	50	60	75	75	70	80	95	100	110	125
Factor acc. to CEN/TS 1992-4	$k_{cr}$	[-]	7,2										

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Table C2:** Characteristic values for **tension loads, VMZ-A M16 – M24,**  
**cracked concrete,** static and quasi-static action  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure</b>													
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated	[kN]	88	95	111	97	96	188	222				
	A4, HCR	[kN]	88	95	111	97	114	165	194				
Partial safety factor	$\gamma_{Ms}$	[-]	1,5				1,68	1,5	1,5				
<b>Pull-out</b>													
Characteristic resistance $N_{Rk,p}$ in concrete C20/25	50°C / 80°C <sup>2)</sup>	[kN]	1)										
	72°C / 120°C <sup>2)</sup>	[kN]	25	30	50	51	30	60	75				
Increasing factor	$\psi_C$	[-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$										
<b>Concrete cone failure</b>													
Effective anchorage depth	$h_{ef} \geq$	[mm]	90	105	125	145	160	115	170	190	170	200	225
Factor acc. to CEN/TS 1992-4	$k_{cr}$	[-]	7,2										

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**

Characteristic values for **tension loads, VMZ-A in cracked concrete,** static and quasi-static action  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C1**

**Table C3:** Characteristic values for **tension loads, VMZ-A M8 – M12 in non-cracked concrete**, static and quasi-static action (Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A			40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure</b>													
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated	[kN]	15	18	25	35	49	54	57				
	A4, HCR	[kN]	15	18	25	35	49	54	57				
Partial safety factor	$\gamma_{Ms}$	[-]	1,5										
<b>Pull-out</b>													
Characteristic resistance $N_{Rk,p}$ in non-cracked concrete C20/25	50°C / 80°C <sup>2)</sup>	[kN]	9	1) <sup>1)</sup>	1) <sup>1)</sup>	1) <sup>1)</sup>			40	1) <sup>1)</sup>	50	50	
	72°C / 120°C <sup>2)</sup>	[kN]	6	9	16	16	16	25	25	30	30	30	
<b>Splitting</b>													
Splitting for <b>standard thickness of concrete member</b> (The higher resistance of Case 1 and Case 2 may be applied.)													
Standard thickness of concrete	$h_{std} \geq 2 h_{ef}$	[mm]	100	120	150	150	140	160	190	200	220	250	
<b>Case 1</b> ( $N_{Rk,c}^0$ has to be replaced by $N_{Rk,sp}^0$ )													
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,sp}^0$	[kN]	7,5	9	16	20	20	20	1) <sup>1)</sup>	30	40	40	40
Spacing (edge distance)	$s_{cr,sp} (= 2 C_{cr,sp})$	[mm]	3 $h_{ef}$										
<b>Case 2</b>													
Spacing (edge distance)	$s_{cr,sp} (= 2 C_{cr,sp})$	[mm]	6 $h_{ef}$	5 $h_{ef}$	7 $h_{ef}$	7 $h_{ef}$	5 $h_{ef}$	3 $h_{ef}$	5 $h_{ef}$	4 $h_{ef}$	6 $h_{ef}$	5 $h_{ef}$	
Splitting for <b>minimum thickness of concrete member</b> (The higher resistance of Case 1 and Case 2 may be applied.)													
Minimum thickness of concrete	$h_{min} \geq$	[mm]	80	100	110	110	110	125	130	140	160		
<b>Case 1</b> ( $N_{Rk,c}^0$ has to be replaced by $N_{Rk,sp}^0$ )													
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,sp}^0$	[kN]	7,5	-	16	16	20	25	25	30	30	30	
Spacing (edge distance)	$s_{cr,sp} (= 2 C_{cr,sp})$	[mm]	3 $h_{ef}$	-	3 $h_{ef}$	3 $h_{ef}$							
<b>Case 2</b>													
Spacing (edge distance)	$s_{cr,sp} (= 2 C_{cr,sp})$	[mm]	6 $h_{ef}$	7 $h_{ef}$	6 $h_{ef}$	7 $h_{ef}$	7 $h_{ef}$	7 $h_{ef}$	6 $h_{ef}$	7 $h_{ef}$	6 $h_{ef}$	6 $h_{ef}$	6 $h_{ef}$
Increasing factor for $N_{Rk,p}$ and $N_{Rk,sp}^0$	$\psi_C$	[-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$										
<b>Concrete cone failure</b>													
Effective anchorage depth	$h_{ef} \geq$	[mm]	40	50	60	75	75	70	80	95	100	110	125
Factor acc. to CEN/TS 1992-4	$k_{ucr}$	[-]	10,1										

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**

Characteristic values for **tension loads, VMZ-A M8 – M12, non-cracked concrete**, static and quasi-static action (Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C2**

**Table C4:** Characteristic values for **tension loads, VMZ-A M16 – M24, non-cracked concrete**, static and quasi-static action,  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)	
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0											
<b>Steel failure</b>														
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated	[kN]	88	95	111	111	97	96	188	188	222	222	222	
	A4, HCR	[kN]	88	95	111	111	97	114	165	165	194	194	194	
Partial safety factor	$\gamma_{Ms}$	[-]	1,5					1,68	1,5		1,5			
<b>Pull-out</b>														
Characteristic resistance $N_{Rk,p}$ in non-cracked concrete C20/25	50°C / 80°C <sup>2)</sup>	[kN]	1)			75	90	1)			1)			
	72°C / 120°C <sup>2)</sup>	[kN]	25	35	50	50	53	40	75	75	95	95	95	
<b>Splitting</b>														
Splitting for <b>standard thickness of concrete</b> (The higher resistance of Case 1 and Case 2 may be applied.)														
Standard thickness of concrete	$h_{std} \geq 2 h_{ef}$	[mm]	180	200	250	290	320	230	340	380	340	400	450	
<b>Case 1</b> ( $N_{Rk,c}$ has to be replaced by $N_{Rk,sp}^0$ )														
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,sp}^0$	[kN]	40	50	50	60	80	1)		115	1)		140	
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$	[mm]	3 $h_{ef}$											
<b>Case 2</b>														
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$	[mm]	4 $h_{ef}$	4 $h_{ef}$	4 $h_{ef}$	4 $h_{ef}$	4 $h_{ef}$	3 $h_{ef}$	3 $h_{ef}$	4 $h_{ef}$	3 $h_{ef}$	3 $h_{ef}$	3,6 $h_{ef}$	
Splitting for <b>minimum thickness of concrete</b> (The higher resistance of Case 1 and Case 2 may be applied.)														
Minimum thickness of concrete	$h_{min} \geq$	[mm]	130	150	160	180	200	160	220	240	220	260	290	
<b>Case 1</b> ( $N_{Rk,c}$ has to be replaced by $N_{Rk,sp}^0$ )														
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,sp}^0$	[kN]	35	50	40	50	71	-	75	75	1)		115	115
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$	[mm]	3 $h_{ef}$											
<b>Case 2</b>														
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$	[mm]	5 $h_{ef}$	5 $h_{ef}$	6 $h_{ef}$	5 $h_{ef}$	5 $h_{ef}$	5 $h_{ef}$	5,2 $h_{ef}$	4,4 $h_{ef}$	5,2 $h_{ef}$	4,4 $h_{ef}$	4,4 $h_{ef}$	
Increasing factor for $N_{Rk,p}$ and $N_{Rk,sp}^0$	$\psi_c$	[-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$											
<b>Concrete cone failure</b>														
Effective anchorage depth	$h_{ef} \geq$	[mm]	90	105	125	145	160	115	170	190	170	200	225	
Factor acc. to CEN/TS 1992-4	$k_{ucr}$	[-]	10,1											

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**

Characteristic values for **tension loads, VMZ-A M16 – M24, non-cracked concrete**, static and quasi-static action,  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C3**

**Table C5:** Characteristic values for **shear load, VMZ-A M8 – M12, cracked and non-cracked concrete**, static and quasi-static action  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A			40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure without lever arm</b>													
Characteristic shear resistance $V_{Rk,s}$	Steel, zinc plated	[kN]	14	21	34								
	A4, HCR	[kN]	15	23	34								
Partial safety factor	$\gamma_{Ms}$	[-]	1,25										
Factor for ductility	$k_2$	[-]	1,0										
<b>Steel failure with lever arm</b>													
Characteristic bending moments $M_{Rk,s}^0$	Steel, zinc plated	[Nm]	30	60	105								
	A4, HCR	[Nm]	30	60	105								
Partial safety factor	$\gamma_{Ms}$	[-]	1,25										
<b>Concrete pry-out failure</b>													
Factor k acc ETAG 001, Annex C or $k_3$ acc. CEN/TS 1992-4	$k_{(\beta)}$	[-]	2										
<b>Concrete edge failure</b>													
Effective length of anchor in shear load	$l_f$	[mm]	40	50	60	75	75	70	80	95	100	110	125
Diameter of anchor	$d_{nom}$	[mm]	10		12		12		14				

**Injection System VMZ**

**Performance**

Characteristic values for **shear load, VMZ-A M8 – M12, cracked and non-cracked concrete**, static and quasi-static action  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)


**Annex C4**



**Table C6:** Characteristic values for **shear load, VMZ-A M16 – M24, cracked and non-cracked concrete**, static and quasi-static action (Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-A		90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Installation safety factor	$\gamma_2 = \gamma_{inst}$ [-]	1,0										
<b>Steel failure without lever arm</b>												
Characteristic shear resistance	Steel, zinc plated [kN]	63					70	149 <sup>1)</sup> (98)		178 <sup>1)</sup> (141)		
$V_{Rk,s}$	A4, HCR [kN]	63					86	131 <sup>1)</sup> (86)		156 <sup>1)</sup> (123)		
Partial safety factor	$\gamma_{Ms}$ [-]	1,25					1,4	1,25		1,25		
Factor for ductility	$k_2$ [-]	1,0										
<b>Steel failure with lever arm</b>												
Characteristic bending moments	Steel, zinc plated [Nm]	266					392	519		896		
$M_{Rk,s}^0$	A4, HCR [Nm]	266						454		784		
Partial safety factor	$\gamma_{Ms}$ [-]	1,25					1,4	1,25		1,25		
<b>Concrete pry-out failure</b>												
Factor k acc ETAG 001, Annex C or k <sub>3</sub> acc. CEN/TS 1992-4	$k_{(3)}$ [-]	2										
<b>Concrete edge failure</b>												
Effective length of anchor in shear load	$l_f$ [mm]	90	105	125	145	160	115	170	190	170	200	225
Diameter of anchor	$d_{nom}$ [mm]	18					22	24		26		
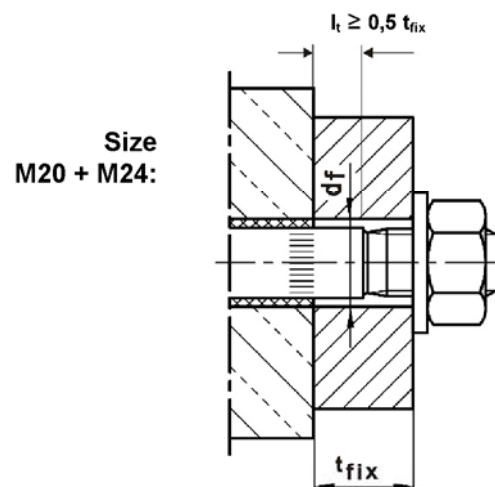
<sup>1)</sup> This value may only be applied if  $l_t \geq 0,5 t_{fix}$



**Injection System VMZ**

**Performance**

Characteristic values for **shear load, VMZ-A M16 – M24, cracked and non-cracked concrete**, static and quasi-static action (Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C5**

**Table C7:** Characteristic resistances for **seismic tension loading**  
**VMZ-A M10 – M12** performance category **C1** and **C2**  
(Design according to EOTA Technical Report TR045)

Anchor size VMZ-A			60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0								
<b>Steel failure, steel zinc plated</b>											
Characteristic resistance <b>C1</b>	$N_{Rk,s,seis,C1}$	[kN]	25	35	49		54			57	
Characteristic resistance <b>C2</b>	$N_{Rk,s,seis,C2}$	[kN]	25	35	49		54			57	
<b>Steel failure, stainless steel A4, HCR</b>											
Characteristic resistance <b>C1</b>	$N_{Rk,s,seis,C1}$	[kN]	25	35	49		54			57	
Characteristic resistance <b>C2</b>	$N_{Rk,s,seis,C2}$	[kN]	25	35	49		54			57	
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,5								
<b>Pull-out</b>											
Characteristic resistance <b>C1</b>	$N_{Rk,p,seis,C1}$	50°C / 80°C <sup>1)</sup>	[kN]	14,5		14,5				30,6	
		72°C / 120°C <sup>1)</sup>	[kN]	10,9		10,9				20,0	
Characteristic resistance <b>C2</b>	$N_{Rk,p,seis,C2}$	50°C / 80°C <sup>1)</sup>	[kN]	7,4		7,4				8,7	
		72°C / 120°C <sup>1)</sup>	[kN]	5,1		5,1				6,5	

**Table C8:** Characteristic resistances for **seismic tension loading**  
**VMZ-A M16 – M24** performance category **C1** and **C2**  
(Design according to EOTA Technical Report TR045)

Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure, steel zinc plated</b>													
Characteristic resistance <b>C1</b>	$N_{Rk,s,seis,C1}$	[kN]	88	95	111		97	96	188			222	
Characteristic resistance <b>C2</b>	$N_{Rk,s,seis,C2}$	[kN]	88	95	111		97	96	188			222	
<b>Steel failure, stainless steel A4, HCR</b>													
Characteristic resistance <b>C1</b>	$N_{Rk,s,seis,C1}$	[kN]	88	95	111		97	114	165			194	
Characteristic resistance <b>C2</b>	$N_{Rk,s,seis,C2}$	[kN]	88	95	111		97	114	165			194	
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,5					1,68	1,5			1,5	
<b>Pull-out</b>													
Characteristic resistance <b>C1</b>	$N_{Rk,p,seis,C1}$	50°C / 80°C <sup>1)</sup>	[kN]	30,6		43,7		30,6	88,2			90,7	
		72°C / 120°C <sup>1)</sup>	[kN]	20,0		38,5		20,0	55,8			59,3	
Characteristic resistance <b>C2</b>	$N_{Rk,p,seis,C2}$	50°C / 80°C <sup>1)</sup>	[kN]	13,5	16,1	26,1		16,1	59,7			59,7	
		72°C / 120°C <sup>1)</sup>	[kN]	10,0	12,0	19,5		11,0	44,4			44,4	

<sup>1)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**  
Characteristic resistances for **seismic tension loading, VMZ-A**,  
performance category **C1** and **C2** (Design according to TR045)

**Annex C6**

**Table C9:** Characteristic resistances for **seismic shear loading**  
**VMZ-A M10 – M12** performance category **C1** and **C2**  
(Design according to EOTA Technical Report TR045)

Anchor size VMZ-A			60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0								
<b>Steel failure without lever arm, steel zinc plated</b>											
Characteristic resistance <b>C1</b>	$V_{Rk,s,seis,C1}$	[kN]	11,8	27,2							
Characteristic resistance <b>C2</b>	$V_{Rk,s,seis,C2}$	[kN]	12,6	27,2							
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,25								
<b>Steel failure without lever arm, stainless steel A4, HCR</b>											
Characteristic resistance <b>C1</b>	$V_{Rk,s,seis,C1}$	[kN]	12,9	27,2							
Characteristic resistance <b>C2</b>	$V_{Rk,s,seis,C2}$	[kN]	13,8	27,2							
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,25								
<b>Steel failure with lever arm</b>											
Characteristic bending moment <b>C1</b>	$M^0_{Rk,s,seis,C1}$	[Nm]	no performance determined								
Characteristic bending moment <b>C2</b>	$M^0_{Rk,s,seis,C2}$	[Nm]	no performance determined								

**Table C10:** Characteristic resistances for **seismic shear loading**  
**VMZ-A M16 – M24** performance category **C1** and **C2**  
(Design according to EOTA Technical Report TR045)

Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0										
<b>Steel failure without lever arm, steel zinc plated</b>													
Characteristic resistance <b>C1</b>	$V_{Rk,s,seis,C1}$	[kN]	39,1				39,1	82,3		107			
Characteristic resistance <b>C2</b>	$V_{Rk,s,seis,C2}$	[kN]	50,4				51,0	108,8 <sup>1)</sup> (71,5)		154,9 <sup>1)</sup> (122,7)			
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,25				1,4	1,25		1,25			
<b>Steel failure without lever arm, stainless steel A4, HCR</b>													
Characteristic resistance <b>C1</b>	$V_{Rk,s,seis,C1}$	[kN]	39,1				39,1	72,2		93			
Characteristic resistance <b>C2</b>	$V_{Rk,s,seis,C2}$	[kN]	50,4				62,6	95,6 <sup>1)</sup> (62,8)		135,7 <sup>1)</sup> (107)			
Partial safety factor	$\gamma_{Ms,seis}$	[-]	1,25				1,4	1,25		1,25			
<b>Steel failure with lever arm</b>													
Characteristic bending moment <b>C1</b>	$M^0_{Rk,s,seis,C1}$	[Nm]	no performance determined										
Characteristic bending moment <b>C2</b>	$M^0_{Rk,s,seis,C2}$	[Nm]	no performance determined										

<sup>1)</sup> This value may only be applied if  $l_t \geq 0,5 t_{fix}$  (see Annex C5)

**Injection System VMZ**

**Performance**  
Characteristic resistances for **seismic shear loading, VMZ-A,**  
performance category **C1** and **C2** (Design according to TR045)

**Annex C7**

**Table C11: Displacements under tension loads, VMZ-A M8 – M12**

Anchor size VMZ-A			40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Tension load in cracked concrete	N	[kN]	4,3	6,1	8,0	11,1	11,1	10,0	12,3	15,9	17,1	19,8	24,0
Displacement	$\delta_{N0}$	[mm]	0,5	0,5	0,5	0,6	0,6	0,6	0,6	0,6	0,6	0,7	0,7
	$\delta_{N\infty}$	[mm]	1,3										
Tension load in non-cracked concrete	N	[kN]	4,3	8,5	11,1	15,6	15,6	14,1	17,2	19,0	24,0	23,8	23,8
Displacement	$\delta_{N0}$	[mm]	0,2	0,4	0,4	0,4	0,4	0,4	0,4	0,4	0,4	0,6	0,6
	$\delta_{N\infty}$	[mm]	1,3										
<b>Displacements under seismic tension loads C2</b>													
Displacements for DLS	$\delta_{N,seis,C2(DLS)}$	[mm]	-	-	1,0	1,0	1,3						
Displacements for ULS	$\delta_{N,seis,C2(ULS)}$	[mm]	-	-	3,0	3,0	3,9						

**Table C12: Displacements under tension loads, VMZ-A M16 – M24**

Anchor size VMZ-A			90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Tension load in cracked concrete	N	[kN]	14,6	18,4	24,0	30,0	34,7	21,1	38,0	44,9	38,0	48,5	57,9
Displacement	$\delta_{N0}$	[mm]	0,7	0,7	0,7	0,8	1,2	0,7	0,8	0,8	0,8	0,9	0,9
	$\delta_{N\infty}$	[mm]	1,3				1,6	1,1	1,3		1,3		
Tension load in non-cracked concrete	N	[kN]	20,5	25,9	33,0	35,7	48,1	29,6	53,3	63,0	53,3	67,9	81,1
Displacement	$\delta_{N0}$	[mm]	0,6	0,6	0,6	0,6	0,8	0,5	0,6	0,6	0,6	0,6	0,6
	$\delta_{N\infty}$	[mm]	1,3				1,6	1,1	1,3		1,3		
<b>Displacements under seismic tension loads C2</b>													
Displacements for DLS	$\delta_{N,seis,C2(DLS)}$	[mm]	1,5				1,9			1,9			
Displacements for ULS	$\delta_{N,seis,C2(ULS)}$	[mm]	4,4				4,5			4,5			

**Injection System VMZ**

**Performance**  
Displacements under tension loads, VMZ-A

**Annex C8**

**Table C13: Displacements under shear loads VMZ-A M8 – M12**

Anchor size VMZ-A		40 M8	50 M8	60 M10	75 M10	75 M12	70 M12	80 M12	95 M12	100 M12	110 M12	125 M12
Shear load	V [kN]	8,3		13,3		19,3						
Displacements	$\delta_{V0}$ [mm]	2,4	2,5	2,9		3,3						
	$\delta_{V\infty}$ [mm]	3,6	3,8	4,4		5,0						
Displacements under seismic shear loads C2												
Displacements for DLS	$\delta_{V,seis,C2(DLS)}$ [mm]	-	-	2,1		2,5						
Displacements for ULS	$\delta_{V,seis,C2(ULS)}$ [mm]	-	-	3,7		5,1						

**Table C14: Displacements under shear loads VMZ-A M16 – M24**

Anchor size VMZ-A		90 M16	105 M16	125 M16	145 M16	160 M16	115 M20	170 M20 (LG)	190 M20 (LG)	170 M24 (LG)	200 M24 (LG)	225 M24 (LG)
Shear load	V [kN]	36				44		75 (49)		89 (71)		
Displacements	$\delta_{V0}$ [mm]	3,8				3,0		4,3 (3,0)		4,6 (3,5)		
	$\delta_{V\infty}$ [mm]	5,7				4,5		6,5 (4,5)		6,9 (5,3)		
Displacements under seismic shear loads C2												
Displacements for DLS	$\delta_{V,seis,C2(DLS)}$ [mm]	2,9				3,5		3,7				
Displacements for ULS	$\delta_{V,seis,C2(ULS)}$ [mm]	6,8				9,3		9,3				

Injection System VMZ

Performance  
Displacements under shear loads, VMZ-A

Annex C9

**Table C15:** Characteristic values for **tension load, VMZ-IG**, cracked concrete  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size <b>VMZ-IG</b>			40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20	
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0												
<b>Steel failure</b>															
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated	[kN]	15	16	19	29	35			67			52	125	108
	A4, HCR	[kN]	11		19	21	33			47			65	88	94
Partial safety factor	$\gamma_{Ms}$	[-]	1,5												
<b>Pull-out</b>															
Characteristic resistance $N_{Rk,p}$ in cracked concrete C20/25	50°C / 80°C <sup>2)</sup>	[kN]	1)												
	72°C / 120°C <sup>2)</sup>	[kN]	5	7,5	12		16	20	20	30	50	30	60	75	
Increasing factor	$\psi_c$	[-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$												
<b>Concrete cone failure</b>															
Effective anchorage depth	$h_{ef}$	[mm]	40	50	60	75	70	80	90	105	125	115	170	170	
Factor acc. to CEN/TS 1992-4	$k_{cr}$	[-]	7,2												

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**

Characteristic values for **tension load, VMZ-IG**, cracked concrete  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C10**

**Table C16:** Characteristic values for **tension load, VMZ-IG, non-cracked concrete**  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size <b>VMZ-IG</b>		40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Installation safety factor	$\gamma_2 = \gamma_{inst}$ [-]	1,0											
<b>Steel failure</b>													
Characteristic tension resistance $N_{Rk,s}$	Steel, zinc plated [kN]	15	16	19	29	35			67		52	125	108
	A4, HCR [kN]	11		19	21	33			47		65	88	94
Partial safety factor	$\gamma_{Ms}$ [-]	1,5											
<b>Pull-out</b>													
Characteristic resistance $N_{Rk,p}$ in non-cracked concrete C20/25	50°C / 80°C <sup>2)</sup> [kN]	9	1)		1)								
	72°C / 120°C <sup>2)</sup> [kN]	6	9	16	16	25	25	35	50	40	75	95	
<b>Splitting</b>													
<b>Splitting for standard thickness of concrete</b> (The higher resistance of Case 1 and Case 2 may be applied.)													
Standard thickness of concrete	$h_{std} \geq 2h_{ef}$ [mm]	100	120	150	140	160	180	200	250	230	340	340	
<b>Case 1</b> ( $N_{Rk,c}^0$ has to be replaced by $N_{Rk,sp}^0$ )													
Characteristic resistance in concrete C20/25	$N_{Rk,sp}^0$ [kN]	7,5	9	16	20	20	1)	40	50	50	1)	1)	
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$ [mm]	3 $h_{ef}$											
<b>Case 2</b>													
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$ [mm]	6 $h_{ef}$	6 $h_{ef}$	5 $h_{ef}$	7 $h_{ef}$	5 $h_{ef}$	3 $h_{ef}$	4 $h_{ef}$	4 $h_{ef}$	4 $h_{ef}$	3 $h_{ef}$	3 $h_{ef}$	3 $h_{ef}$
<b>Splitting for minimum thickness of concrete</b> (The higher resistance of Case 1 and Case 2 may be applied.)													
Minimum thickness of concrete	$h_{min} \geq$ [mm]	80	100	110	110	130	150	160	160	220	220		
<b>Case 1</b> ( $N_{Rk,c}^0$ has to be replaced by $N_{Rk,sp}^0$ )													
Characteristic resistance in concrete C20/25	$N_{Rk,sp}^0$ [kN]	7,5	-	16	20	25	35	50	40	-	75	1)	
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$ [mm]	3 $h_{ef}$											
<b>Case 2</b>													
Spacing (edge distance)	$s_{cr,sp} (= 2 c_{cr,sp})$ [mm]	6 $h_{ef}$	7 $h_{ef}$	6 $h_{ef}$	7 $h_{ef}$	7 $h_{ef}$	6 $h_{ef}$	5 $h_{ef}$	5 $h_{ef}$	6 $h_{ef}$	5 $h_{ef}$	5,2 $h_{ef}$	5,2 $h_{ef}$
Increasing factor for $N_{Rk,p}$ and $N_{Rk,sp}$	$\psi_c$ [-]	$\left(\frac{f_{ck,cube}}{25}\right)^{0,5}$											
<b>Concrete cone failure</b>													
Effective anchorage depth	$h_{ef}$ [mm]	40	50	60	75	70	80	90	105	125	115	170	170
Factor acc. to CEN/TS 1992-4	$k_{ucr}$ [-]	10,1											

<sup>1)</sup> Pull-out failure is not decisive

<sup>2)</sup> Maximum long term temperature / Maximum short term temperature

**Injection System VMZ**

**Performance**

Characteristic values for tension loads, **VMZ-IG**, non-cracked concrete  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

**Annex C11**

**Table C17: Characteristic values for shear load, VMZ-IG, cracked and non-cracked concrete**  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4)

Anchor size VMZ-IG			40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Installation safety factor	$\gamma_2 = \gamma_{inst}$	[-]	1,0											
<b>Steel failure without lever arm</b>														
Characteristic shear resistance $V_{Rk,s}$	Steel, zinc plated	[kN]	8,0	9,5	15	18			34			26	63	54
	A4, HCR	[kN]	5,5	9,5	10	16			24			32	44	47
Partial safety factor	$\gamma_{Ms}$	[-]	1,25											
Factor for ductility	$k_2$	[-]	1,0											
<b>Steel failure with lever arm</b>														
Characteristic bending moments $M_{Rk,s}^0$	Steel, zinc plated	[kN]	12		30	60			105			212	266	519
	A4, HCR	[kN]	8,5		21	42			74			187	187	365
Partial safety factor	$\gamma_{Ms}$	[-]	1,25											
<b>Concrete pry-out failure</b>														
Factor k acc ETAG 001, Annex C or $k_3$ acc. CEN/TS 1992-4	$k_{(3)}$	[-]	2											
<b>Concrete edge failure</b>														
Effective length of anchor in shear load	$l_f$	[mm]	40	50	60	75	70	80	90	105	125	115	170	170
Diameter of anchor	$d_{nom}$	[mm]	10		12		14		18			22	24	26

**Table C18: Displacements under tension loads, VMZ-IG**

Anchor size VMZ-IG			40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Tension load in cracked concrete	N	[kN]	4,3	6,1	8,0	11,1	10,0	12,3	14,6	18,4	24,0	21,1	38,0	38,0
Displacement	$\delta_{N0}$	[mm]	0,5		0,5	0,6		0,6		0,7		0,7	0,8	0,8
	$\delta_{N\infty}$	[mm]										1,1	1,3	1,3
Tension load in non-cracked concrete	N	[kN]	4,3	8,5	11,1	15,6	14,1	17,2	20,5	25,9	33,0	29,6	53,3	53,3
Displacement	$\delta_{N0}$	[mm]	0,2	0,4		0,4		0,4		0,6		0,5	0,6	0,6
	$\delta_{N\infty}$	[mm]										1,1	1,3	1,3

**Table C19: Displacements under shear loads, VMZ-IG**

Anchor size VMZ-IG			40 M6	50 M6	60 M8	75 M8	70 M10	80 M10	90 M12	105 M12	125 M12	115 M16	170 M16	170 M20
Shear load	V	[kN]	4,6		5,4	8,4	10,1			19,3		14,8	35,8	30,7
Displacement	$\delta_{V0}$	[mm]	0,4		0,5	0,4	0,5			1,2		0,8	1,9	1,2
	$\delta_{V\infty}$	[mm]	0,7		0,8	0,7	0,8			1,9		1,2	2,8	1,9
Shear load	V	[kN]	3,2		5,4	5,9	9,3			13,5		18,5	25,2	26,9
Displacement	$\delta_{V0}$	[mm]	0,3		0,5	0,3	0,5			0,9		1,0	1,4	1,1
	$\delta_{V\infty}$	[mm]	0,4		0,7	0,5	0,7			1,4		1,5	2,1	1,6

**Injection System VMZ**

**Performance**

Characteristic values for shear load, VMZ-IG, cracked and non-cracked concrete  
(Design method A according to ETAG 001, Annex C or CEN/TS 1992-4), Displacements

**Annex C12**