

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-10/0457**  
**of 13 September 2016**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Berner Simplexanchor BAZ, BAZ A4, BAZ C

Product family  
to which the construction product belongs

Torque controlled expansion anchor  
for use in concrete

Manufacturer

Berner Trading Holding GmbH  
Bernerstraße 6  
74653 Künzelsau  
DEUTSCHLAND

Manufacturing plant

Berner Herstellwerk 6  
Berner manufacturing plant 6

This European Technical Assessment  
contains

21 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

Guideline for European technical approval of "Metal  
anchors for use in concrete", ETAG 001 Part 2: "Torque  
controlled expansion anchors", April 2013,  
used as European Assessment Document (EAD)  
according to Article 66 Paragraph 3 of Regulation (EU)  
No 305/2011.

This version replaces

ETA-10/0457 issued on 7 May 2015

**European Technical Assessment**

**ETA-10/0457**

English translation prepared by DIBt

**Page 2 of 21 | 13 September 2016**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The Berner Simplexanchor BAZ, BAZ A4, BAZ C is an anchor made of galvanised steel (BAZ) or made of stainless steel (BAZ A4) or high corrosion resistant steel (BAZ C) which is placed into a drilled hole and anchored by torque-controlled expansion.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for static and quasi static action	See Annex C 1 to C 3
Characteristic resistance for seismic performance categories C1 and C2	See Annex C 6 to C 7
Displacements under static and quasi static action	See Annex C 8
Displacements under seismic action	See Annex C 9

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchors satisfy requirements for Class A1
Characteristic resistance under fire exposure	See Annex C 4 and C 5

#### 3.3 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with guideline for European technical approval ETAG 001, April 2013 used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1


**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 13 September 2016 by Deutsches Institut für Bautechnik

Andreas Kummerow  
p.p. Head of Department

*beglaubigt:*  
Baderschneider

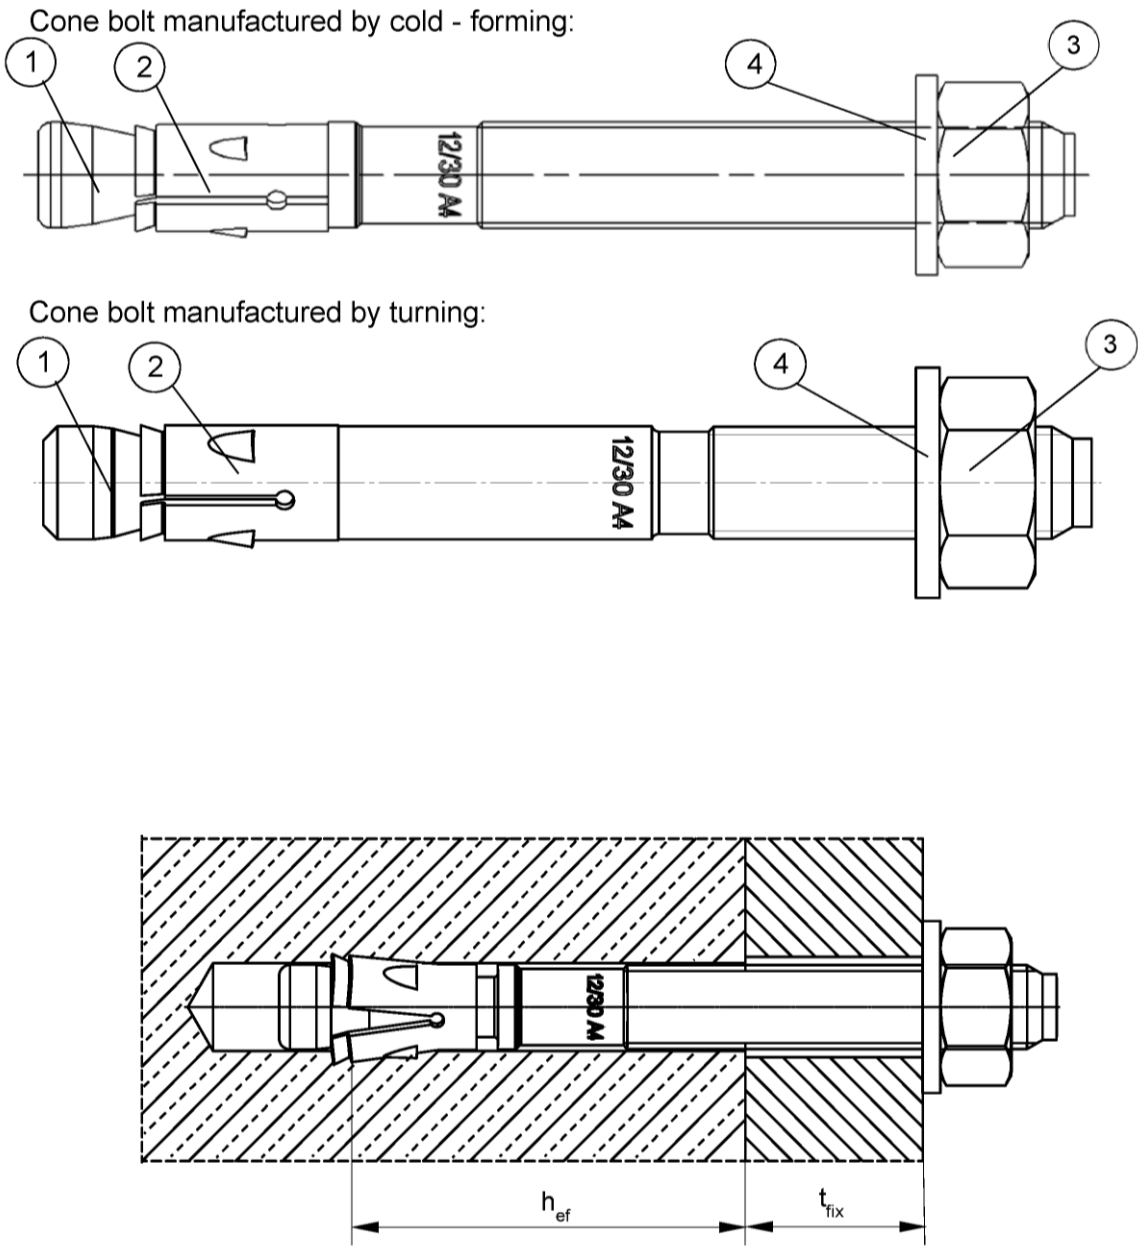

- ① Cone bolt (cold – formed or turned)
- ② Expansion sleeve
- ③ Hexagon nut
- ④ Washer


$h_{ef}$  = Effective anchorage depth  
 $t_{fix}$  = Thickness of fixture

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Product description**  
Installed condition

**Annex A 1**



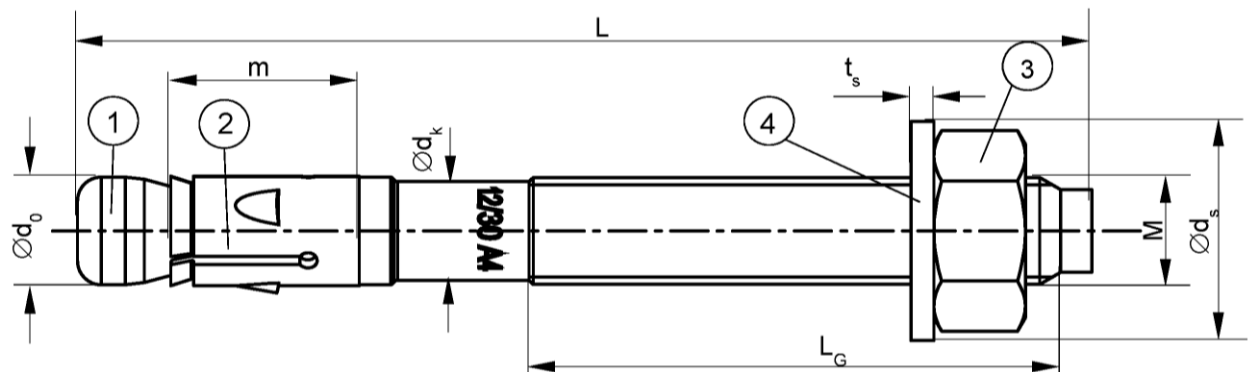

**Table A3:** Anchor dimensions [mm]

Part	Designation			BAZ, BAZ A4, BAZ C					
				M8	M10	M12	M16	M20	M24
1	Cone bolt	thread size M		M8	M10	M12	M16	M20	M24
		Ø d <sub>0</sub>		7,8	9,8	11,8	15,7	19,8	23,5
		Ø d <sub>k</sub>		7,1	8,9	10,7	14,5	18,2	21,8
		L <sub>G</sub>	≥	19	26	31	40	50	57
2	Expansion sleeve	m		17,8	20,0	20,6	27,5	33,4	40,2
		sheet thickness		1,3	1,4	1,6	2,4	2,4	3,0
3	Hexagon nut	wrench size		13	17	19	24	30	36
4	Washer	t <sub>s</sub>	≥	1,4	1,8	2,3	2,7	2,7	3,7
		Ø d <sub>s</sub>	≥	15	19	23	29	36	43
Thickness of fixture		t <sub>fix</sub>	≥	0	0	0	0	0	0
			≤	200	250	300	400	500	600
Length of anchor		L <sub>min</sub>	=	54,5	64,5	79	102	141	174
		L <sub>max</sub>	=	267	336	401	525	644	777

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Product description**  
Anchor dimensions

**Annex A 3**

**Table A4: Materials BAZ**

Part	Designation	Material
1	Cone bolt	Cold form steel or free cutting steel (zinc plated) Nominal steel tensile strength: $f_{uk} \leq 1000 \text{ N/mm}^2$ (thread)
2	Expansion sleeve	Cold strip, EN 10139:2016 (zinc plated) <sup>1)</sup>
3	Hexagon nut	Steel, property class min. 8, EN ISO 898-2:2012 (zinc plated)
4	Washer	Cold strip, EN 10139: 2016 (zinc plated)

<sup>1)</sup> Optional stainless steel EN 10088:2014

**Table A5: Materials BAZ A4**

Part	Designation	Material
1	Cone bolt	stainless steel EN 10088:2014 Nominal steel tensile strength: $f_{uk} \leq 1000 \text{ N/mm}^2$ (thread)
2	Expansion sleeve	stainless steel EN 10088:2014
3	Hexagon nut	stainless steel EN 10088:2014; ISO 3506-2: 2009; property class – min. 70
4	Washer	stainless steel EN 10088:2014

**Table A6: Materials BAZ C**

Part	Designation	Material
1	Cone bolt	high corrosion resistant steel EN 10088:2014 Nominal steel tensile strength: $f_{uk} \leq 1000 \text{ N/mm}^2$ (thread)
2	Expansion sleeve	stainless steel EN 10088:2014
3	Hexagon nut	high corrosion resistant steel EN 10088:2014; ISO 3506-2:2009; property class – min. 70
4	Washer	high corrosion resistant steel EN 10088:2014

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Product description**  
Materials

**Annex A 4**



## Specifications of intended use

### Anchorage subject to:

Standard anchorage depth				✓			
Bolt Anchor BAZ, BAZ A4, BAZ C	M8	M10	M12	M16	M20	M24	
Static and quasi-static loads				✓			
Cracked and uncracked concrete				✓			
Fire exposure				✓			
Seismic action for Performance Category	C1			✓			
	C2 <sup>1)</sup>	-		✓			-
Reduced anchorage depth			✓				
Bolt Anchor BAZ, BAZ A4, BAZ C	M8 <sup>2)</sup>	M10	M12	M16			
Static and quasi-static loads			✓				
Cracked and uncracked concrete			✓				
Fire exposure			✓				
Seismic action for Performance Category	C1		✓				
	C2 <sup>1)</sup>	-	✓				

<sup>1)</sup> BAZ C: Only valid for cold-formed version (see A1)

<sup>2)</sup> Use restricted to anchoring of structural components which are statically indeterminate

### Base materials:

- Reinforced and unreinforced normal weight concrete (cracked and uncracked) according to EN 206-1:2000
- Strength classes C20/25 to C50/60 according to EN 206-1:2000

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (BAZ, BAZ A4, BAZ C)
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (BAZ A4, BAZ C)
- Structures subject to external atmospheric exposure and permanently damp internal condition, if other particular aggressive conditions exist (BAZ C)

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

### Design:

- Anchorage are to be designed under the responsibility of an engineer experienced in anchorages and concrete work
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)
- Anchorage under static or quasi-static actions are to be designed in accordance with (please choose the relevant design method):
  - ETAG 001, Annex C, design method A, Edition August 2010 or
  - CEN/TS 1992-4:2009, design method A
- Anchorage under seismic actions (cracked concrete) are to be designed in accordance with:
  - EOTA Technical Report TR 045, Edition February 2013
  - Anchorage shall be positioned outside of critical regions (e.g. plastic hinges) of the concrete structure
  - Fastenings in stand-off installation or with a grout layer under seismic action are not allowed
- Anchorage under fire exposure are to be designed in accordance with:
  - EOTA Technical Report TR 020, Edition May 2004
  - CEN/TS 1992-4:2009, Annex D
  - It must be ensured that local spalling of the concrete cover does not occur

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Intended Use**  
Specifications


**Annex B 1**

**Table B1:** Installation parameters

Type of anchor / size		BAZ, BAZ A4, BAZ C					
		M8	M10	M12	M16	M20	M24
Nominal drill hole diameter	$d_0 = [\text{mm}]$	8	10	12	16	20	24
Cutting diameter of drill bit	$d_{\text{cut}} \leq [\text{mm}]$	8,45	10,45	12,5	16,5	20,55	24,55
Standard anchorage depth	$h_{\text{ef,sta}} \geq [\text{mm}]$	45	60	70	85	100	125
Depth of drill hole in concrete for $h_{\text{ef,sta}}$	$h_{1,\text{sta}} \geq [\text{mm}]$	55	75	90	110	125	155
Reduced anchorage depth	$h_{\text{ef,red}} \geq [\text{mm}]$	35 <sup>2)</sup>	40	50	65	-	-
Depth of drill hole in concrete for $h_{\text{ef,red}}$	$h_{1,\text{red}} \geq [\text{mm}]$	45 <sup>2)</sup>	55	70	90	-	-
Diameter of clearance hole in the fixture <sup>1)</sup>	$d_f \leq [\text{mm}]$	9	12	14	18	22	26
Required torque moment	$T_{\text{inst}} = [\text{Nm}]$	20	45	60	110	200	270

<sup>1)</sup> If a larger diameter of the clearance hole in the fixture is used, see Chapter 4.2.2.1 of ETAG 001, Annex C

<sup>2)</sup> Use restricted to anchoring of structural components which are statically indeterminate

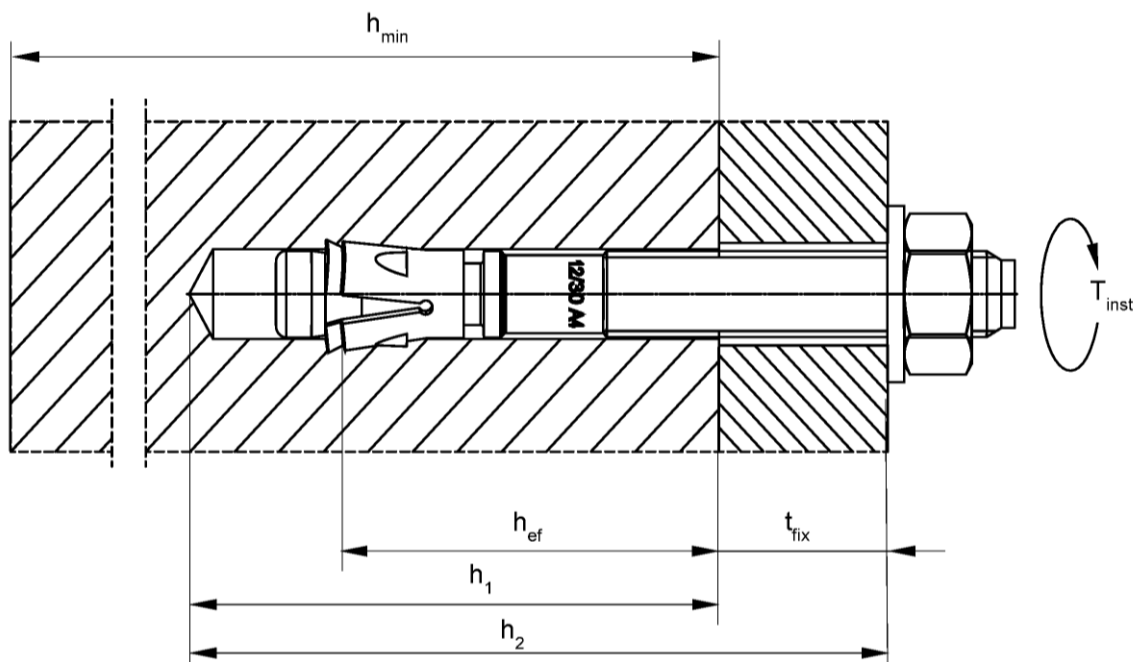

$h_{\text{ef}}$  = Effective anchorage depth  
 $t_{\text{fix}}$  = Thickness of fixture  
 $h_1$  = Drill hole depth  
 $h_2$  = Min.drill hole depth for push-through installation  
 $h_{\text{min}}$  = Thickness of concrete member  
 $T_{\text{inst}}$  = Required torque moment

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Intended Use**  
Installation parameters

**Annex B 2**

**Table B2:** Minimum thickness of concrete members, minimum spacings and minimum edge distances of anchors for **standard anchorage depth ( $h_{ef, sta}$ )**

Type of anchor / size			BAZ, BAZ A4, BAZ C					
			M8	M10	M12	M16	M20	M24
Standard effective anchorage depth $h_{ef,sta} \geq$ [mm]			45	60	70	85	100	125
Applications with concrete members of thickness $\geq 2 \times h_{ef,sta}$	Minimum thickness of concrete member $h_{min, 1}$ [mm]		100	120	140	170	200	250
	Uncracked concrete							
	Minimum spacing	$s_{min}$ [mm]	40	40	50	65	95	100
		for $c \geq$ [mm]	50	60	70	95	180	200
	Minimum edge distance	$c_{min}$ [mm]	40	45	55	65	95	135
		for $s \geq$ [mm]	100	80	110	150	190	235
	Cracked concrete							
	Minimum spacing	$s_{min}$ [mm]	35	40	50	65	95	100
		for $c \geq$ [mm]	50	55	70	95	140	170
	Minimum edge distance	$c_{min}$ [mm]	40	45	55	65	85	100
		for $s \geq$ [mm]	70	80	110	150	190	220
Applications with concrete members of thickness $< 2 \times h_{ef,sta}$	Minimum thickness of concrete member $h_{min, 2}$ [mm]		80	100	120	140	160	200
	Cracked and uncracked concrete							
	Minimum spacing	$s_{min}$ [mm]	35	40	50	80	125	150
		for $c \geq$ [mm]	70	100	90	130	220	230
	Minimum edge distance	$c_{min}$ [mm]	40	60	60	65	125	135
		for $s \geq$ [mm]	100	90	120	180	230	235

Intermediate values for  $s_{min}$  and  $c_{min}$  inside of the same thickness of concrete member by linear interpolation.

**Table B3:** Minimum thickness of concrete members, minimum spacings and minimum edge distances of anchors for **reduced anchorage depth ( $h_{ef, red}$ )**

Type of anchor / size			BAZ, BAZ A4, BAZ C			
			M8	M10	M12	M16
Reduced effective anchorage depth $h_{ef,red} \geq$ [mm]			35 <sup>1)</sup>	40	50	65
Applications with concrete members of thickness $\geq 2 \times h_{ef,red}$	Minimum thickness of concrete member $h_{min, 3}$ [mm]		80	80	100	140
	Uncracked concrete					
	Minimum spacing	$s_{min}$ [mm]	40	40	50	65
		for $c \geq$ [mm]	100	100	110	130
	Minimum edge distance	$c_{min}$ [mm]	45	45	55	65
		for $s \geq$ [mm]	180	180	220	250
	Cracked concrete					
	Minimum spacing	$s_{min}$ [mm]	40	40	50	65
		for $c \geq$ [mm]	90	90	110	130
	Minimum edge distance	$c_{min}$ [mm]	45	45	55	65
for $s \geq$ [mm]		180	180	220	250	

Intermediate values for  $s_{min}$  and  $c_{min}$  by linear interpolation.

<sup>1)</sup> Only in anchoring structural components which are statically indeterminate

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Intended Use**

Minimum thickness of member, minimum spacings and edge distances

**Annex B 3**


**Table B4:** Minimum spacings and minimum edge distances of anchors  
according to **TR 020 and ETAG 001, Annex C** under **fire exposure** and  
according to **CEN/TS 1992-4: 2009, Annex D** under **fire exposure**

Type of anchor / size			BAZ, BAZ A4, BAZ C					
			M8	M10	M12	M16	M20	M24
Spacing	$s_{min}$	[mm]	35	40	50	60	95	100
Edge distance	$c_{min}$	[mm]	$c_{min} = 2 \times h_{ef}$ , for fire exposure from more than one side $c_{min} \geq 300$ mm					

## Installation instructions

The fitness for use of the anchor can only be assumed if the anchor is installed as follows:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Use of the anchor only as supplied by the manufacturer without exchanging the components of the anchor
- Checking before placing the anchor to ensure that the strength class of the concrete in which the anchor is to be placed is in the range given and is not lower than that of the concrete to which the characteristic loads apply
- Check of concrete being well compacted, e.g. without significant voids
- Edge distances and spacing not less than the specified values without minus tolerances
- Drill hole perpendicular to concrete surface, positioning without damaging the reinforcement. In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application

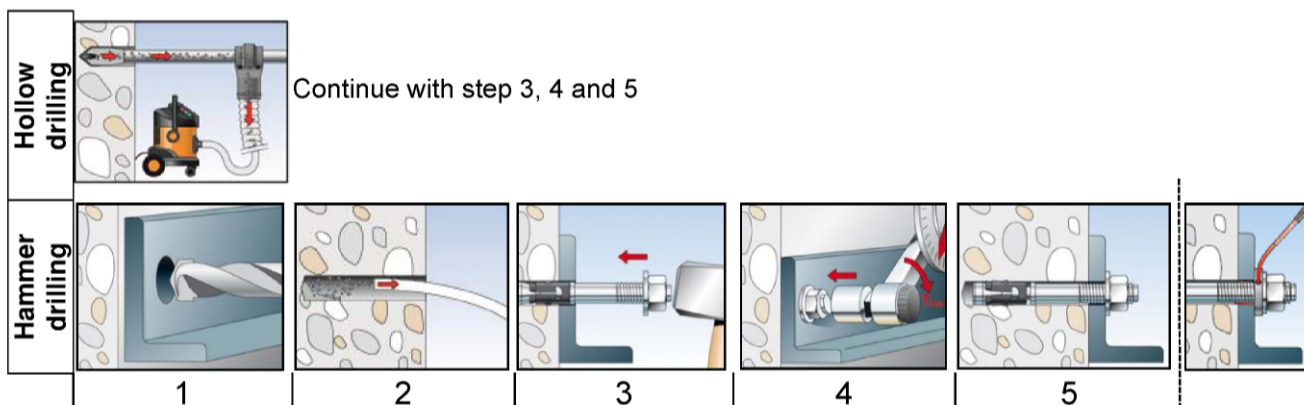

No.	Description	
1	Create drill hole with hammer drill	Create drill hole with hollow drill and vacuum cleaner
2	Clean bore hole	-
3	Set anchor	
4	Expand anchor with prescribed installation torque $T_{inst}$	
5	Finished installation	

Optional	The gap between bolt and fixture may be filled with mortar; compressive strength $\geq 50$ N/mm <sup>2</sup> for example: MCS UNI Plus and MCS DIAMOND
----------	--

Types of drills	
Hammer drill	
Hollow drill	

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Intended Use**  
Minimum spacings and minimum edge distances of anchors  
Installation parameters

**Annex B 4**



**Table C1:** Characteristic values of **tension** resistance for **standard anchorage depth** under static and quasi-static action (Design method A, according to **ETAG 001, Annex C** or **CEN/TS 1992-4:2009**)

Type of anchor / size				BAZ, BAZ A4, BAZ C					
				M8	M10	M12	M16	M20	M24
Steel failure for standard anchorage depth									
Characteristic resistance	BAZ	$N_{Rk,s}$	[kN]	16,0	27,0	41,5	66,0	111,0	150,0
	BAZ A4/C	$N_{Rk,s}$	[kN]	17,0	27,2	44,3	70,6	111,0	160,8
Partial safety factor		$\gamma_{Ms}$		1,5					
Pullout failure for standard anchorage depth									
Effective anchorage depth		$h_{ef,sta} \geq$	[mm]	45	60	70	85	100	125
Characteristic resistance in cracked concrete C20/25		$N_{Rk,p}$	[kN]	7,5	12	20	- <sup>1)</sup>		
Characteristic resistance in uncracked concrete C20/25		$N_{Rk,p}$	[kN]	9	16	25	- <sup>1)</sup>		
Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete		$\psi_c$	C25/30	1,10					
			C30/37	1,22					
			C35/45	1,34					
			C40/50	1,41					
			C45/55	1,48					
			C50/60	1,55					
Installation safety factor		$\gamma_2^{3)} = \gamma_{inst}^{4)}$		1,0					
Concrete cone and splitting failure for standard anchorage depth in applications with concrete members of thickness $\geq 2x h_{ef,sta}$									
Effective anchorage depth		$h_{ef}$	[mm]	45	60	70	85	100	125
Factor for uncracked concrete		$k_{ucr}^{4)}$	[-]	10,1					
Factor for cracked concrete		$k_{cr}$	[-]	7,2					
Min. thickness of concrete member		$h_{min,1}$	[mm]	100	120	140	170	200	250
Characteristic spacing		$s_{cr,N}$	[mm]	3 $h_{ef}$					
Characteristic edge distance		$c_{cr,N}$	[mm]	1,5 $h_{ef}$					
Spacing (splitting failure) <sup>2)</sup>		$s_{cr,sp}$	[mm]	140	180	210	260	370	430
Edge distance (splitting failure) <sup>2)</sup>		$c_{cr,sp}$	[mm]	70	90	105	130	185	215
Concrete cone and splitting failure for standard anchorage depth in applications with concrete members of thickness $< 2x h_{ef,sta}$									
Effective anchorage depth		$h_{ef}$	[mm]	45	60	70	85	100	125
Factor for uncracked concrete		$k_{ucr}^{4)}$	[-]	10,1					
Factor for cracked concrete		$k_{cr}$	[-]	7,2					
Min. thickness of concrete member		$h_{min,2}$	[mm]	80	100	120	140	160	200
Characteristic spacing		$s_{cr,N}$	[mm]	3 $h_{ef}$					
Characteristic edge distance		$c_{cr,N}$	[mm]	1,5 $h_{ef}$					
Spacing (splitting failure) <sup>2)</sup>		$s_{cr,sp}$	[mm]	180	240	280	340	480	550
Edge distance (splitting failure) <sup>2)</sup>		$c_{cr,sp}$	[mm]	90	120	140	170	240	275

<sup>1)</sup> Pullout failure not relevant.

<sup>2)</sup> Intermediate values for  $s_{cr,sp}$  and  $c_{cr,sp}$  between concrete thickness  $h_{min,2}$  and  $h_{min,1}$  by linear interpolation.

<sup>3)</sup> Parameter relevant for design according to ETAG 001, Annex C

<sup>4)</sup> Parameter relevant for design according to CEN/TS 1992-4:2009

Berner Simplexanchor BAZ, BAZ A4, BAZ C

#### Performances

Characteristic values of resistance under tension loads for standard anchorage depth

**Annex C 1**

**Table C2:** Characteristic values of **tension** resistance for **reduced anchorage depth** under static and quasi-static action (Design method A, according to **ETAG 001, Annex C** or **CEN/TS 1992-4:2009**)

Type of anchor / size				BAZ, BAZ A4, BAZ C			
				M8	M10	M12	M16
Steel failure for reduced anchorage depth							
Characteristic resistance	BAZ	$N_{Rk,s}$	[kN]	16,0	27,0	41,5	66,0
	BAZ A4/C	$N_{Rk,s}$	[kN]	17,0	27,2	44,3	70,6
Partial safety factor			$\gamma_{Ms}$	1,5			
Pullout failure for reduced anchorage depth							
Effective anchorage depth			$h_{ef,red} \geq$ [mm]	35 <sup>2)</sup>	40	50	65
Characteristic resistance in cracked concrete C20/25			$N_{Rk,p}$ [kN]	5	- <sup>1)</sup>		
Characteristic resistance in uncracked concrete 20/25			$N_{Rk,p}$ [kN]	- <sup>1)</sup>			
Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete			$\psi_c$	C25/30	1,10		
				C30/37	1,22		
				C35/45	1,34		
				C40/50	1,41		
				C45/55	1,48		
				C50/60	1,55		
Installation safety factor			$\gamma_2^{3)} = \gamma_{inst}^{4)}$	1,0			
Concrete cone and splitting failure for reduced anchorage depth							
Effective anchorage depth			$h_{ef}$ [mm]	35 <sup>2)</sup>	40	50	65
Factor for uncracked concrete			$k_{ucr}^{4)}$ [-]	10,1			
Factor for cracked concrete			$k_{cr}^{4)}$ [-]	7,2			
Min. thickness of concrete member			$h_{min,3}$ [mm]	80	80	100	140
Characteristic spacing			$s_{cr,N}$ [mm]	3 $h_{ef}$			
Characteristic edge distance			$c_{cr,N}$ [mm]	1,5 $h_{ef}$			
Spacing (splitting failure)			$s_{cr,sp}$ [mm]	140	160	200	260
Edge distance (splitting failure)			$c_{cr,sp}$ [mm]	70	80	100	130

<sup>1)</sup> Pullout failure not relevant.

<sup>2)</sup> Use restricted to anchoring of structural components which are statically indeterminate

<sup>3)</sup> Parameter relevant for design according to ETAG 001, Annex C

<sup>4)</sup> Parameter relevant for design according to CEN/TS 1992-4:2009

Berner Simplexanchor BAZ, BAZ A4, BAZ C

#### Performances

Characteristic values of resistance under tension for reduced anchorage depth

**Annex C 2**

**Table C3:** Characteristic values of **shear** resistance for **standard and reduced anchorage depth** under static and quasi-static action (Design method A, according to **ETAG 001, Annex C** or **CEN/TS 1992-4:2009**)

Type of anchor / size				BAZ, BAZ A4, BAZ C					
				M8	M10	M12	M16	M20	M24
Steel failure without lever arm for standard and reduced anchorage depth									
Characteristic resistance	BAZ	$V_{Rk,s}$	[kN]	12,0	20,0	29,5	55,0	70,0	86,0
	BAZ A4/C	$V_{Rk,s}$		17,6	23,8	36,5	70,9	94,4	138,2
Partial safety factor		$\gamma_{Ms}$		1,25					
Factor for ductility		$k_2^{2)}$	[-]	1,0					
Standard anchorage depth									
Steel failure with lever arm									
Characteristic bending resistance	BAZ	$M_{Rk,s}^0$	[Nm]	26	52	92	233	487	769
	BAZ A4/C	$M_{Rk,s}^0$		29	56	94	256	454	785
Partial safety factor		$\gamma_{Ms}$		1,25					
Factor for ductility		$k_2^{2)}$	[-]	1,0					
Concrete pryout failure									
Factor k according to ETAG 001, Annex C or $k_3$ according to CEN/TS 1992-4		$k^{1)}=k_{(3)}^{2)}$	[-]	2,2		2,4	2,8		
Concrete edge failure									
Effective length of anchor in shear loading		$l_f$	[mm]	45	60	70	85	100	125
Effective diameter of anchor		$d_{nom}$	[mm]	8	10	12	16	20	24
Installation safety factor			$\gamma_2^{1)} = \gamma_{inst}^{2)}$	1,0					
Reduced anchorage depth									
Steel failure with lever arm									
Characteristic bending resistance	BAZ	$M_{Rk,s}^0$	[Nm]	15	38,3	89	171	-	-
	BAZ A4/C	$M_{Rk,s}^0$		18,9	38,3	90,7	179,5	-	-
Partial safety factor		$\gamma_{Ms}$		1,25					
Factor for ductility		$k_2^{2)}$	[-]	1,0					
Concrete pryout failure									
Factor k according to ETAG 001, Annex C or $k_3$ according to CEN/TS 1992-4		$k^{1)} = k_{(3)}^{2)}$	[-]	1,0	2,0	2,3	-	-	
Concrete edge failure									
Effective length of anchor in shear loading		$l_f$	[mm]	35	40	50	65	-	-
Effective diameter of anchor		$d_{nom}$	[mm]	8	10	12	16	-	-

<sup>1)</sup> Parameter relevant for design according to ETAG 001, Annex C

<sup>2)</sup> Parameter relevant for design according to CEN/TS 1992-4:2009

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances**

Characteristic values of resistance under shear loads

**Annex C 3**

**Table C4:** Characteristic values of **tension** resistance under **fire exposure** in cracked and uncracked concrete for **standard and reduced anchorage depth** (Design according to TR 020 and ETAG 001, Annex C or CEN/TS 1992-4: 2009, Annex D)

Type of anchor / size <b>BAZ, BAZ A4, BAZ C</b>	<b>R30</b> Fire resistance 30 minutes			<b>R60</b> Fire resistance 60 minutes		
	$N_{Rk,s,fi,30}$ [kN]	$N_{Rk,p,fi,30}$ [kN]	$N^0_{Rk,c,fi,30}$ [kN]	$N_{Rk,s,fi,60}$ [kN]	$N_{Rk,p,fi,60}$ [kN]	$N^0_{Rk,c,fi,60}$ [kN]
<b>Standard anchorage depth</b>						
M8	1,4	2,0	2,4	1,2	2,0	2,4
M10	2,8	3,3	5,0	2,3	3,3	5,0
M12	5,0	5,0	7,4	4,1	5,0	7,4
M16	9,4	7,1	12,0	7,7	7,1	12,0
M20	14,7	9,0	18,0	12,0	9,0	18,0
M24	21,1	12,6	31,4	17,3	12,6	31,4
<b>Reduced anchorage depth</b>						
M8	0,9 <sup>1)</sup> (0,6) <sup>2)</sup>	0,9 <sup>1)</sup> (0,6) <sup>2)</sup>	0,9 <sup>1)</sup> (0,6) <sup>2)</sup>	0,8 <sup>1)</sup> (0,6) <sup>2)</sup>	0,8 <sup>1)</sup> (0,6) <sup>2)</sup>	0,8 <sup>1)</sup> (0,6) <sup>2)</sup>
M10	2,8	2,3	1,8	2,3	2,3	1,8
M12	5,0	3,2	3,2	4,1	3,2	3,2
M16	9,4	4,7	6,1	7,7	4,7	6,1
	<b>R90</b> Fire resistance 90 minutes			<b>R120</b> Fire resistance 120 minutes		
	$N_{Rk,s,fi,90}$ [kN]	$N_{Rk,p,fi,90}$ [kN]	$N^0_{Rk,c,fi,90}$ [kN]	$N_{Rk,s,fi,120}$ [kN]	$N_{Rk,p,fi,120}$ [kN]	$N^0_{Rk,c,fi,120}$ [kN]
<b>Standard anchorage depth</b>						
M8	0,9	2,0	2,4	0,8	1,6	1,9
M10	1,9	3,3	5,0	1,6	2,6	4,0
M12	3,2	5,0	7,4	2,8	4,0	5,9
M16	6,0	7,1	12,0	5,2	5,6	9,6
M20	9,4	9,0	18,0	8,1	7,2	14,4
M24	13,5	12,6	31,4	11,6	10,1	25,1
<b>Reduced anchorage depth</b>						
M8	0,5	0,5	0,5	0,3	0,3	0,3
M10	1,9	2,3	1,8	1,6	1,8	1,4
M12	3,2	3,2	3,2	2,8	2,5	2,5
M16	6,0	4,7	6,1	5,2	3,8	4,9

<sup>1)</sup> Values for  $s_{cr,fi} = 120$  mm and  $c_{cr,fi} = 60$  mm

<sup>2)</sup> Values for  $s_{cr,fi} = 100$  mm and  $c_{cr,fi} = 50$  mm

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**  
Characteristic values of resistance under tension loads

**Annex C 4**



**Table C5:** Characteristic values of **shear** resistance under **fire exposure** in cracked and uncracked concrete for **standard and reduced anchorage depth** (Design according to **TR 020** and **ETAG 001, Annex C** or **CEN/TS 1992-4:2009, Annex D**)

Type of anchor / size <b>BAZ, BAZ A4, BAZ C</b>	<b>R30</b> Fire resistance 30 minutes			<b>R60</b> Fire resistance 60 minutes		
	$V_{Rk,s,fi,30}$ [kN]	$M^0_{Rk,s,fi,30}$ [Nm]	k(3)	$V_{Rk,s,fi,60}$ [kN]	$M^0_{Rk,s,fi,60}$ [Nm]	k(3)
<b>Standard anchorage depth</b>						
M8	1,8	1,4	2,2	1,6	1,2	2,2
M10	3,6	3,6	2,2	2,9	3,0	2,2
M12	6,3	7,8	2,4	4,9	6,4	2,4
M16	11,7	19,9	2,8	9,1	16,3	2,8
M20	18,2	39,0	2,8	14,2	31,8	2,8
M24	26,3	67,3	2,8	20,5	55,0	2,8
<b>Reduced anchorage depth</b>						
M8	1,8	1,4	1,0	1,6	1,2	1,0
M10	3,6	3,6	2,0	2,9	3,0	2,0
M12	6,3	7,8	2,3	4,9	6,4	2,3
M16	11,7	20,0	2,3	9,1	16,3	2,3
	<b>R90</b> Fire resistance 90 minutes			<b>R120</b> Fire resistance 120 minutes		
	$V_{Rk,s,fi,90}$ [kN]	$M^0_{Rk,s,fi,90}$ [Nm]	k(3)	$V_{Rk,s,fi,120}$ [kN]	$M^0_{Rk,s,fi,120}$ [Nm]	k(3)
<b>Standard anchorage depth</b>						
M8	1,3	1,0	2,2	1,2	0,8	2,2
M10	2,2	2,4	2,2	1,9	2,1	2,2
M12	3,5	5,0	2,4	2,8	4,3	2,4
M16	6,6	12,6	2,8	5,3	11,0	2,8
M20	10,3	24,6	2,8	8,3	21,4	2,8
M24	14,8	42,6	2,8	11,9	37,0	2,8
<b>Reduced anchorage depth</b>						
M8	1,3	1,0	1,0	1,2	0,9	1,0
M10	2,2	2,4	2,0	1,9	2,1	2,0
M12	3,5	5,0	2,3	2,8	4,3	2,3
M16	6,6	12,6	2,3	5,3	11,0	2,3

**Concrete pryout failure:** In Equation (5.6) of ETAG 001, Annex C, 5.2.3.3 the  $k_{(3)}$ -factor of Table C5 and the relevant values of  $N_{0Rk,c,fi}$  of Table C4 have to be considered.

**Concrete edge failure:** The characteristic resistance  $V^0_{Rk,c,fi}$  in concrete C20/25 to C50/60 is determined by:  $V^0_{Rk,c,fi} = 0,25 \times V^0_{Rk,c}$  (R30, R60, R90),  $V^0_{Rk,c,fi} = 0,20 \times V^0_{Rk,c}$  (R120) with  $V^0_{Rk,c}$  as initial value of the characteristic resistance in cracked concrete C20/25 under normal temperature according to ETAG 001, Annex C, 5.2.3.4.

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**  
Characteristic values of resistance under shear loads and fire exposure

**Annex C 5**

**Table C6:** Valid anchor sizes for seismic design, **performance category C1, standard and reduced anchorage depth**

Type of anchor / size		BAZ, BAZ A4, BAZ C					
		M8	M10	M12	M16	M20	M24
<b>Standard effective anchorage depth</b>	$h_{ef,sta} \geq [\text{mm}]$	45	60	70	85	100	125
Thickness of fixture	$t_{fix,min} = [\text{mm}]$	0	0	0	0	0	0
	$t_{fix,max} = [\text{mm}]$	100	100	120	160	250	300
Length of anchor	$L_{min} = [\text{mm}]$	54,5	84,5	99	122	141	174
	$L_{max} = [\text{mm}]$	167	186	221	285	394	477
<b>Reduced effective anchorage depth</b>	$h_{ef,red} \geq [\text{mm}]$	-	40	50	65	-	-
Thickness of fixture	$t_{fix,min} = [\text{mm}]$		0	0	0		
	$t_{fix,max} = [\text{mm}]$		120	140	180		
Length of anchor	$L_{min} = [\text{mm}]$		64,5	79	102		
	$L_{max} = [\text{mm}]$		186	221	285		

**Table C7:** Valid anchor sizes for seismic design, **performance category C2, standard and reduced anchorage depth**

Type of anchor / size		BAZ, BAZ A4, BAZ C <sup>1)</sup>					
		M8	M10	M12	M16	M20	M24
<b>Standard effective anchorage depth</b>	$h_{ef,sta} \geq [\text{mm}]$	-	60	70	85	100	-
Thickness of fixture	$t_{fix,min} = [\text{mm}]$		0	0	0	0	
	$t_{fix,max} = [\text{mm}]$		100	120	160	250	
Length of anchor	$L_{min} = [\text{mm}]$		84,5	99	122	141	
	$L_{max} = [\text{mm}]$		186	221	285	394	
<b>Reduced effective anchorage depth</b>	$h_{ef,red} \geq [\text{mm}]$	-	40	50	65	-	-
Thickness of fixture	$t_{fix,min} = [\text{mm}]$		0	0	0		
	$t_{fix,max} = [\text{mm}]$		120	140	180		
Length of anchor	$L_{min} = [\text{mm}]$		64,5	79	102		
	$L_{max} = [\text{mm}]$		186	221	284,5		

<sup>1)</sup> BAZ C: Only valid for cold-formed version (see A1)

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**  
Valid sizes in cracked concrete for seismic design

**Annex C 6**

**Table C8:** Characteristic values of **tension and shear** resistance for **standard- and reduced anchorage depth** under **seismic action**  
(Design according to **TR 045: Performance category C1**)

Type of anchor / size			BAZ, BAZ A4, BAZ C					
			M8	M10	M12	M16	M20	M24
Steel failure for standard anchorage depth								
Characteristic resistance tension load C1	$\frac{h_{ef,sta}}{h_{ef,red.}}$	$N_{Rk,s,C1}$ [kN]	16,0	27,0	41,0	66,0	111,0	150,0
			-				-	-
Partial safety factor $\gamma_{Ms,C1}$ [-]			1,5					
Pullout failure for standard anchorage depth								
Characteristic resistance tension load in cracked concrete C1	$\frac{h_{ef,sta}}{h_{ef,red.}}$	$N_{Rk,p,C1}$ [kN]	4,6	8,0	16,0	28,2	36,0	50,3
			-				-	-
Installation safety factor $\gamma_{2,C1}$ [-]			1,0					
Steel failure without lever arm for standard anchorage depth								
Characteristic resistance shear load C1	$\frac{h_{ef,sta}}{h_{ef,red.}}$	$V_{Rk,s,C1}$ [kN]	11	17	27	47	56	69
			-				-	-
Partial safety factor $\gamma_{Ms,C1}$ [-]			1,25					

**Table C9:** Characteristic values of **tension and shear** resistance for **standard- and reduced anchorage depth** under **seismic action**  
(Design according to **TR 045: Performance category C2**)

Type of anchor / size	BAZ, BAZ A4, BAZ C <sup>1)</sup>					
	M8	M10	M12	M16	M20	M24
Steel failure for standard anchorage depth						
Characteristic resistance tension load C2 $\frac{h_{ef,sta}}{h_{ef,red.}}$ N <sub>Rk,s,C2</sub> [kN]	-	27	41	66	111	-
					-	
Partial safety factor $\gamma_{Ms,C2}$ [-]	1,5					
Pullout failure for standard anchorage depth						
Characteristic resistance tension load in cracked concrete C2 $\frac{h_{ef,sta}}{h_{ef,red.}}$ N <sub>Rk,p,C2</sub> [kN]	-	5,1	7,4	21,5	30,7	-
		2,7	4,4	16,4	-	
Installation safety factor $\gamma_{2,C2}$ [-]	1,0					
Steel failure without lever arm for standard anchorage depth						
Characteristic resistance shear load C2 $\frac{h_{ef,sta}}{h_{ef,red.}}$ V <sub>Rk,s,C2</sub> [kN]	-	10,0	17,4	27,5	39,9	-
		7,0	12,7	22,0	-	
Partial safety factor $\gamma_{Ms,C2}$ [-]	1,25					

<sup>1)</sup> BAZ C: Only valid for cold-formed version (see A1)

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**

Characteristic values of resistance under tension and shear loads under seismic action

**Annex C 7**

**Table C10:** Displacements due to tension loads for **standard and reduced anchorage depth**  
(Design method A, according to **ETAG 001, Annex C** or **CEN/TS 1992-4:2009**)

Type of anchor / size			BAZ, BAZ A4, BAZ C					
			M8	M10	M12	M16	M20	M24
Values for standard anchorage depth								
Tension load in cracked concrete	N	[kN]	2,3	4,2	7,5	13,2	16,4	22,9
Displacement	$\delta_{N0}$	[mm]	0,5	0,5	0,7	1,0	1,2	1,2
	$\delta_{N\infty}$	[mm]	1,8	1,7	1,4	1,2	1,4	1,5
Tension load in uncracked concrete	N	[kN]	4,2	7,5	11,7	18,7	23,3	32,5
Displacement	$\delta_{N0}$	[mm]	0,3	0,3	0,5	0,7	1,2	1,2
	$\delta_{N\infty}$	[mm]	1,2				1,4	1,5
Values for reduced anchorage depth								
Tension load in cracked concrete	N	[kN]	2,3	4,2	6,0	9,0	-	-
Displacement	$\delta_{N0}$	[mm]	0,5	0,5	0,7	1,0		
	$\delta_{N\infty}$	[mm]	1,2					
Tension load in uncracked concrete	N	[kN]	4,2	5,7	8,5	12,6	-	-
Displacement	$\delta_{N0}$	[mm]	0,3	0,3	0,5	0,7		
	$\delta_{N\infty}$	[mm]	1,2					

**Table C11:** Displacements due to shear loads for **standard and reduced anchorage depth**  
(Design method A, according to **ETAG 001, Annex C** or **CEN/TS 1992-4:2009**)

Type of anchor / size			BAZ					
			M8	M10	M12	M16	M20	M24
Shear load in cracked and uncracked concrete	V	[kN]	6,9	11,4	16,9	31,4	39,4	48,5
Displacement	$\delta_{V0}$	[mm]	2,4	4,2	4,5	3,0	3,6	3,6
	$\delta_{V\infty}$	[mm]	3,6	6,3	6,8	4,5	5,4	5,4
Dübeltyp / Größe			BAZ A4, BAZ C					
			M8	M10	M12	M16	M20	M24
Querlast in gerissenem und ungerissenem Beton	V	[kN]	10,1	13,6	20,9	40,5	53,9	79,0
Verschiebung	$\delta_{V0}$	[mm]	1,8	2,0	2,2	3,0	1,9	4,7
	$\delta_{V\infty}$	[mm]	2,7	3,0	3,4	4,5	2,9	7,1

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**  
Displacements under tension and shear loads

**Annex C 8**

**Table C12:** Displacements due to tension loads for **standard and reduced anchorage depth**  
(Design according to **TR 045: Performance category C2**)

Type of anchor / size	BAZ, BAZ A4, BAZ C					
	M8	M10	M12	M16	M20	M24
<b>Values for standard anchorage depth</b>						
Displacement DLS $\delta_{N,C2}$ (DLS) [mm]	-	2,7	4,4	4,4	5,6	-
Displacement ULS $\delta_{N,C2}$ (ULS) [mm]	-	11,5	13,0	12,3	14,4	-
<b>Values for reduced anchorage depth</b>						
Displacement DLS $\delta_{N,C2}$ (DLS) [mm]	-	2,7	4,4	4,4	-	-
Displacement ULS $\delta_{N,C2}$ (ULS) [mm]	-	11,5	13,0	12,3	-	-

**Table C13:** Displacements due to shear loads for **standard and reduced anchorage depth**  
(Design according to **TR 045: Performance category C2**)

Type of anchor / size	BAZ, BAZ A4, BAZ C					
	M8	M10	M12	M16	M20	M24
<b>Values for standard anchorage depth</b>						
Displacement DLS $\delta_{V,C2}$ (DLS) [mm]	-	4,1	4,4	4,3	4,8	-
Displacement ULS $\delta_{V,C2}$ (ULS) [mm]	-	6,2	7,8	8,1	11,2	-
<b>Values for reduced anchorage depth</b>						
Displacement DLS $\delta_{V,C2}$ (DLS) [mm]	-	3,6	4,7	5,5	-	-
Displacement ULS $\delta_{V,C2}$ (ULS) [mm]	-	5,0	7,5	10,1	-	-

Berner Simplexanchor BAZ, BAZ A4, BAZ C

**Performances:**  
Displacements under tension and shear loads under seismic action

**Annex C 9**