

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments

★ ★ ★ ★ ★
★ Designated
according to
Article 29 of Regula-
tion (EU) No 305/2011
and member of EOTA
(European Organi-
sation for Technical
Assessment)
★ ★ ★ ★ ★

European Technical Assessment

ETA-13/0332
of 21 November 2016

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Trade name of the construction product

Product family
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment
contains

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Rathscheck KEIL undercut anchor for Rathscheck sleete

Anchor for the rear fixing of façade panels made of
selected natural stones according to EN 1469:2015

Rathscheck Schiefer und Dach-Systeme
ZN der Wilh. Werhahn KG Neuss
St. -Barbara-Straße 3
56727 Mayen-Katzenberg
DEUTSCHLAND

Herstellwerk 1

27 pages including 4 annexes which form an integral part
of this assessment

EAD 330030-00-0601

European Technical Assessment

ETA-13/0332

English translation prepared by DIBt

Page 2 of 27 | 21 November 2016

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part**1 Technical description of the product**

The Rathscheck KEIL undercut anchor KH is a special anchor made of stainless steel consisting of a crosswise slotted anchor sleeve with an M6 internal thread, at the upper edge of which a hexagon is formed to it and a respective hexagon bolt with an integrated tooth lock washer as well as distance washer for levelling of thickness tolerances $\Delta d_p = +6 \text{ mm} / \pm 0 \text{ mm}$. Alternatively, instead of the hexagon bolt with an integrated tooth lock washer, a threaded pin or threaded rod is used. The anchor is put into an undercut drill hole and by driving-in the screw it is placed form-fitted and deformation-controlled.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchors of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment**3.1 Mechanical resistance and stability (BWR 1)**

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See Annex C 1
Anchor distances and spacing	See Annex C 1

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 330030-00-0601 the applicable European legal act is: [97/161/EG].

The system to be applied is: 2+

European Technical Assessment

ETA-13/0332

English translation prepared by DIBt

Page 4 of 27 | 21 November 2016

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 21 November 2016 by Deutsches Institut für Bautechnik

Dipl.-Ing. Andreas Kummerow
p. p. Head of Department


beglaubigt:
Aksünger

Installed anchor

Example without distance washer

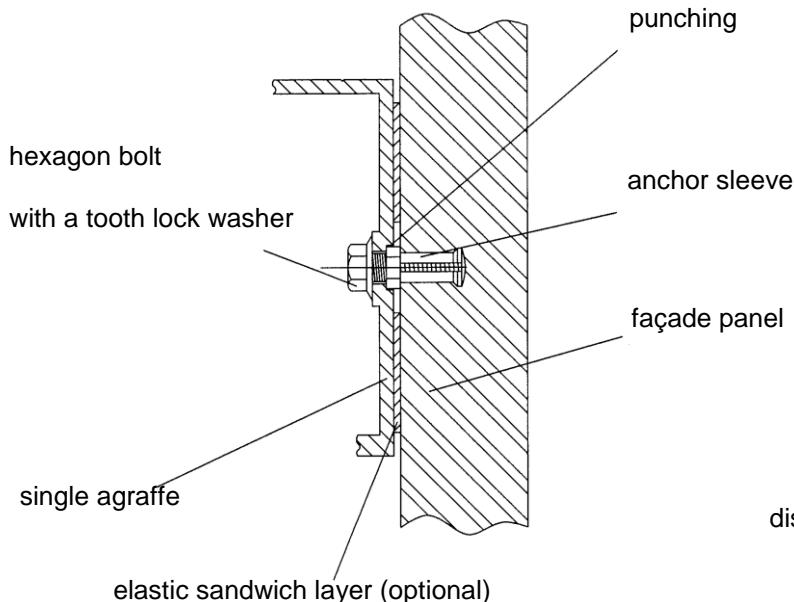


Example with distance washer

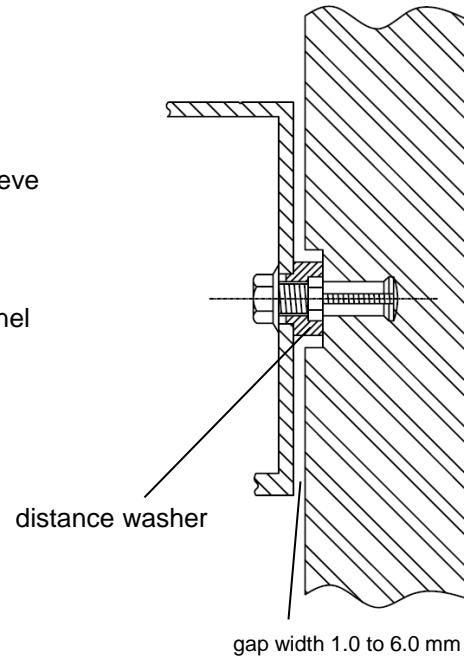


Stand-off fixing

- for facade panel
- not applicable in slate

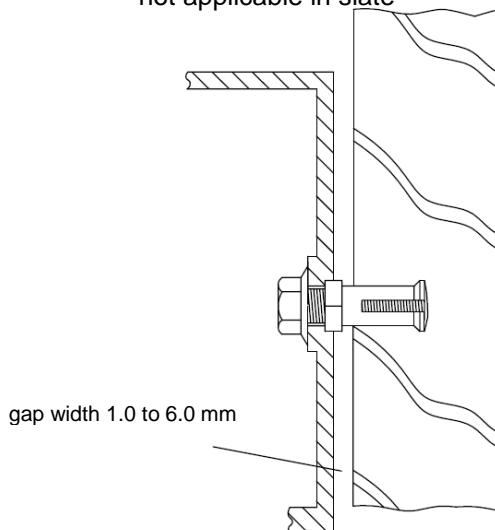

Flush fixing

- for reveal panel
- applicable for slate panels

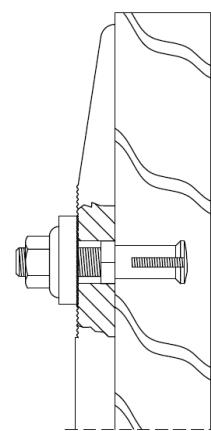


Rathscheck KEIL undercut anchor for Rathscheck slette


Product description
Installed anchor

Annex A 1

Example of a substructure

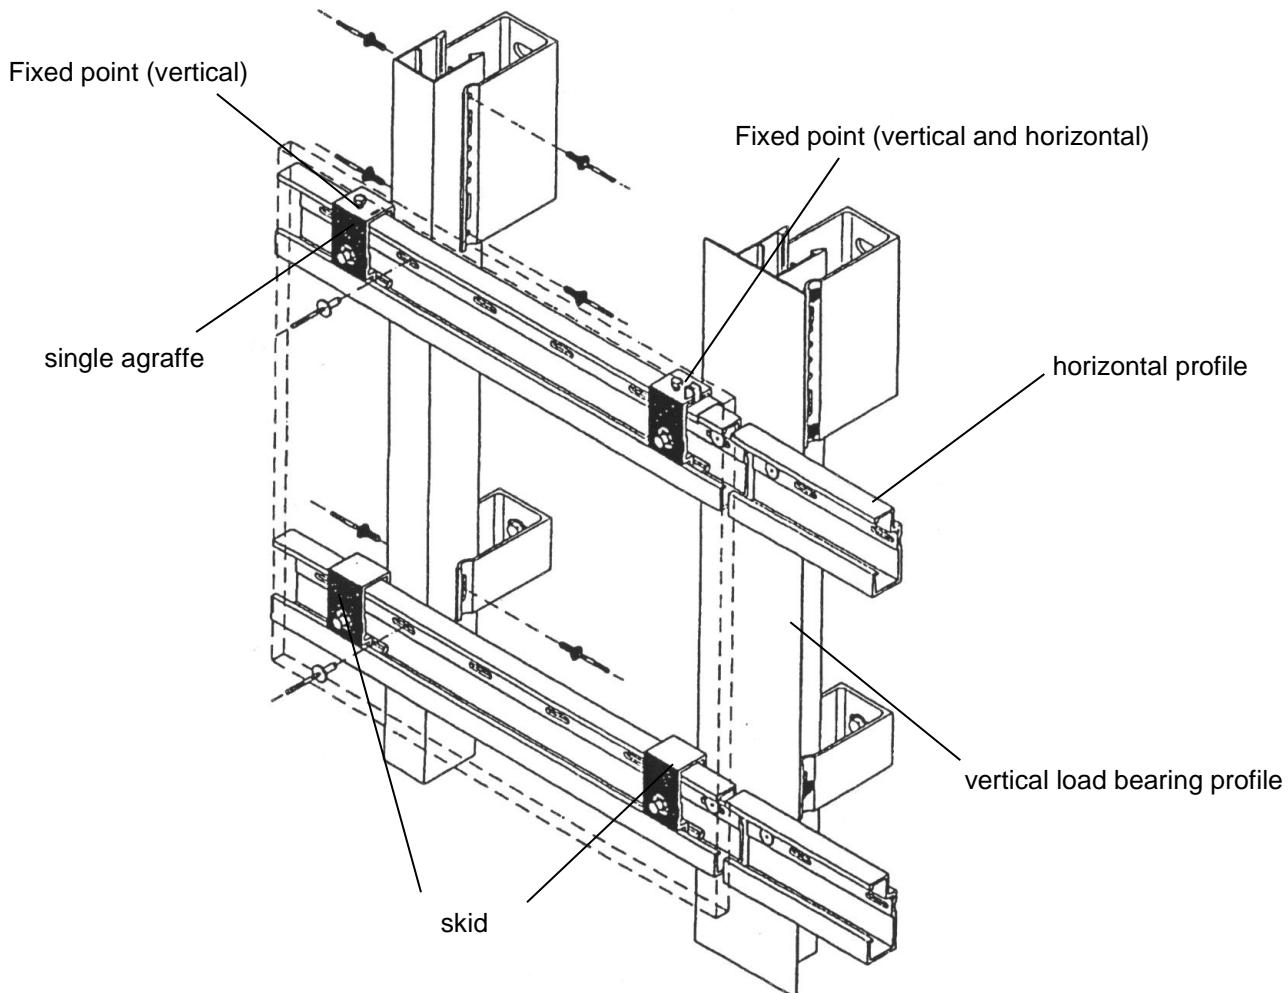

Anchor (dimensions in mm)

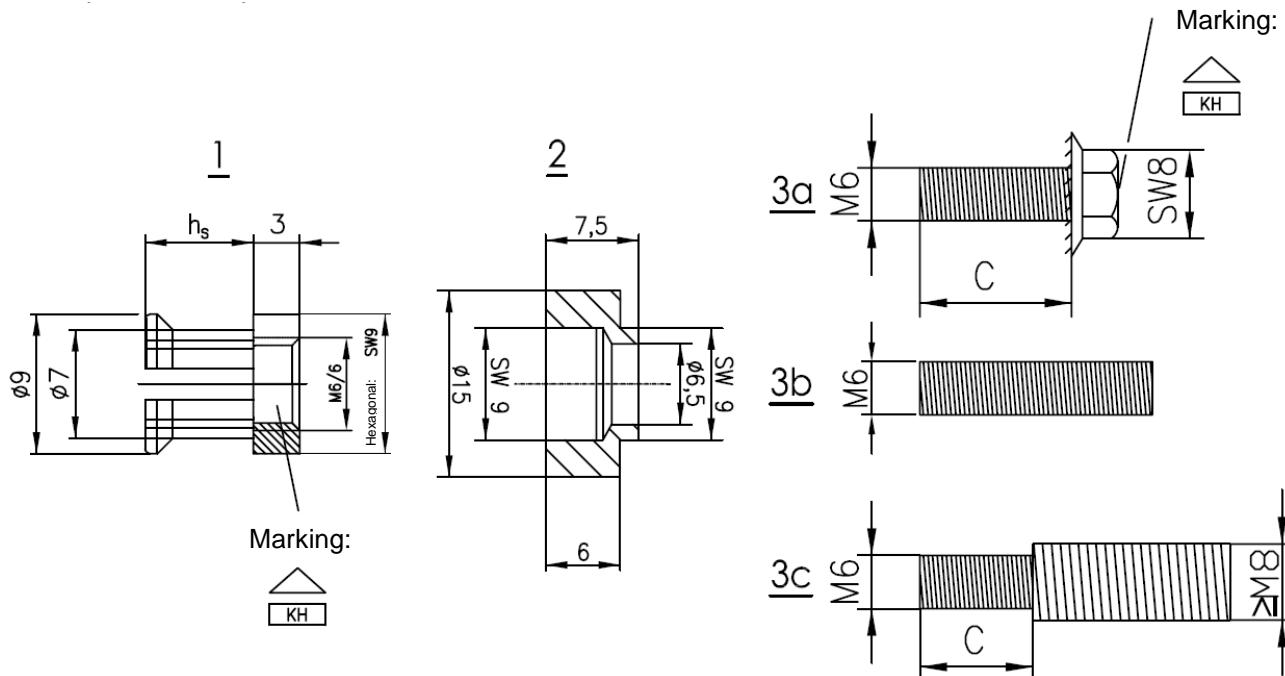

c: The screw length must be adjusted to the respective design

Table A1: Dimensions and Materials

Anchor type			KH 7	KH 10	KH 15
anchorage depth	hs = [mm]		7,0	10	15
screw length	c = [mm]		$h_s + 3\text{mm} + t_{fix}$		
installation torque moment	T _{inst} [Nm]		$2,5 \leq T_{inst} \leq 4,0$		
Materials					
1	anchor sleeve		stainless steel 1.4404 according to EN 10 088:2014		
2	washer		aluminum 3.1645/ EN AW-2007 according to EN 573-3:2013-12		
3a	hexagon screw with tooth lock washer		stainless steel 1.4401, 1.4404 or 1.4578 according to EN 10 088:2014		
3b	threaded pin		stainless steel 1.4401, 1.4404 or 1.4578 according to EN 10 088:2014		
3c	threaded bold		stainless steel 1.4401, 1.4404 or 1.4578 according to EN 10 088:2014		
Rathscheck KEIL undercut anchor for Rathscheck splete					
Product description Example of substructure and fixing of the panel			Annex A 3		

Specifications of intended use

Anchors subject to:

Static and quasi-static loads.

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions.
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist.

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Base materials:

- natural stone façade panels shall correspond according to EN 1469:2015
- the material used is free of crevices and mechanical effective cracks and alterations.
- Natural stone according to Table B1
- Parameters of facade panel according to Table B2 and B3

Table B1: Dimensions and materials

Group of stone		Natural stone	Conditions
I	High-quality intrusive rocks (plutonic rocks)	granite, granitite, syenite, tonalite, diorite, monzonite, gabbro other magmatic plutonic rocks	none
II	Metamorphic rocks with "hard stone character"	quartzite, granulite, gneiss, migmatite, slate ¹	slate type: only ColorSIN CS 50, InterSIN SIN 120 and InterSIN SIN 150 according to Table B2
III	High-quality extrusive rocks (volcanic rocks)	basalt and basaltlava damaging ingredients (see Sonnenbrennerbasalt) may not existent	Density: basalt: $\rho \geq 2,7 \text{ kg/dm}^3$ basaltlava: $\rho \geq 2,2 \text{ kg/dm}^3$
IV	Sedimentary rocks with "hard stone character" ^{3,4}	sandstone and limestone	sandstone: $\rho \geq 2,1 \text{ kg/dm}^3$

¹ For façade panels made of natural stones with planes of anisotropy, the difference between the bending strengths determined parallel to the planes of anisotropy and perpendicular to the edges of the planes of anisotropy shall not be more than 50 %.

Tabelle B2: Characteristic values of anchors and façade and reveal panel made of sleeve ColorSIN CS 50, InterSIN SIN 120 or InterSIN SIN 150

Sleete	CS 50	SIN 120	SIN 150
Panel thickness $h_{\text{nom}} \geq [\text{mm}]$	10		
Maximum size of panel $A \leq [\text{m}^2]$	1,0		
Maximum side length $H \text{ oder } L \leq [\text{m}]$	1,2		
Number of anchors (rectangular arrangement) [-]	4 or 6	4	4
Density $\gamma = [\text{kN/m}^3]$	28,0		
E-Modulus $E = [\text{N/mm}^2]$	130000	120000	90000
Bending stress $\sigma_{5\%} \geq [\text{N/mm}^2]$	40	25	30

Rathscheck KEIL undercut anchor for Rathscheck sleete

Intended use
Specifications

Annex B 1

Tabelle B3: Characteristic values of anchors and facade and reveal panel made of natural stone

Natural stone exceed slate		
Panel thickness	h_{nom} [mm]	$20 \text{ (} 30 \text{)}^1) \leq h_{\text{nom}} \leq 70$
Maximum size of panel	$A \leq [\text{m}^2]$	3,0
Maximum side length	$H \text{ or } L \leq [\text{m}]$	3,0
Number of anchors (rectangular arrangement)	[\cdot]	4
Anchorage depth	$h_s = [\text{mm}]$	10 or 15
Nominal diameter of drill hole	$\emptyset d_0 = [\text{mm}]$	7
Edge distance of anchor	$a_r = [\text{mm}]$	$50 \text{ mm} \leq a_r \leq 0,25L \text{ or } 0,25H$
Spacing of anchor for reveal panel	$b_r = [\text{mm}]$	$40 \text{ mm} \leq b_r = 0,2H \text{ or } 0,2L$
Spacing	$a \geq [\text{mm}]$	$8 h_s$
Screw length	without distance washer	$h_s + 3 \text{ mm} + t_{\text{fix}}$
	with distance washer	$h_s + 7,5 \text{ mm} + t_{\text{fix}}$
Remaining wall thickness ²⁾	$R \geq [\text{mm}]$	$0,4 h_{\text{nom}}$
Bending stress	Epprechtstein yellow	$\sigma_{5\%} \geq [\text{N/mm}^2]$
	Padang light	$\sigma_{5\%} \geq [\text{N/mm}^2]$
	Sto-Kilzinger sandstone	$\sigma_{5\%} \geq [\text{N/mm}^2]$

¹⁾ for sandstone, limestone and basaltlava: panel thickness $h_{\text{nom}} \geq 30 \text{ mm}$, if from the panel manufacturer warrented lowest expect-value (5% fractile) oft he bending tensile strength is $< 8 \text{ N/mm}^2$.

²⁾ only stand-off fixing

Design:

- 1 Admissible wind loads for selective panel sizes and bearing conditions for slate panels ColorSIN CS 50, InterSIN SIN 120 and InterSIN SIN 150

1.1 General

In Annex D several panel systems are listed as a function of the panel thickness, anchorage depth, edge distance, panel size, number of agraffes and the kind of support. The substructure has to be symmetrical.

For flush-fixed profiles following has to be considered:


c_H = height of the agraffe

Classification of the profiles in the following ratios:

$$e/c_H \leq 0,75$$

$$e/c_H \leq 0,54$$

$$e/c_H \leq 0,33$$



e = distance between of the facade panel and
shear centre of the horizontal profile
(s. figure 1)

figure 1: Open profile with shear centre

The proof of structural stability is fulfilled if Eq. (1) is satisfied.

$$w_{Ek} \leq w_{Tab} \quad (1)$$

mit: w_{Ek} = characteristic wind load according to EN 1991-1-4

w_{Tab} = value of admissible wind loads, see Annex D

Following partial safety factors are fundamental for evaluation:

$$\gamma_G = 1,35; \gamma_Q = 1,5; \gamma_M = 1,8.$$

The constructional requirements of Annex D 1 for the support with 6 fixing points must be fulfilled.

For subframes supporting three fixing points of a one panel or unsymmetrical supported panels with 4 fixing points, the moment of inertia of profiles must be at minimum:

$$I_Y [\text{cm}^4] = 65,2 \cdot L_i [\text{m}] - 58,5 \quad (\text{gilt für: } 0,9 \text{ m} \leq L_i \leq 1,4 \text{ m}) \quad (2)$$

with: L_i = equivalent support width (Anhang D 1)

I_Y = moment of inertia of profiles (y-axis of the profile: parallel to the façade panel layer)

The module of elasticity of the profiles has to be $E \geq 70.000 \text{ N/mm}^2$.

Rathscheck KEIL undercut anchor for Rathscheck slate

Intended use
Specifications

Annex B 3

1.2 Smaller panel dimensions

In case of smaller panel dimensions for panels supported with 4 anchors Eq. (3) must be satisfied. For positioning of the fixings the relation of edge distance to length of the panel must be kept. The minimum edge distances can be taken from the respective Tables (Annex D).

$$w_{Ek} \leq 0,9 \times \frac{A_{Tab}}{A_{vorh}} w_{Tab} \quad (3)$$

mit: w_{Ek} = characteristic wind load according to EN 1991-1-4

w_{Tab} = value of admissible wind loads aus Anhang D

A_{Tab} = panel size given in the Tables (Annex D), related to admissible wind loads of the Tables

A_{vorh} = existing panel size (area)

1.3 Unsymmetrical substructure

Unsymmetrical substructures can only be applied for panels supported with 4 fixing points. In this case Eq. (4) has to be fulfilled.

$$w_{Ek} \leq 0,5 w_{Tab} \quad (4)$$

mit: w_{Ek} = characteristic wind load according to EN 1991-1-4

w_{Tab} = value of admissible wind loads according to Annex D

Installation:

- The drillings are done at the factory or on site under workshop conditions; when making the drillings on site the execution is supervised by the responsible project supervisor or a skilled representative of the project supervisor.
- Making of the undercut drilling is done with the drill bit according to Annex B 5 and a special drilling device in accordance with the information deposited with Deutsches Institut für Bautechnik.
- The drill dust must be removed from the borehole.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole.
- the geometry of the drill hole is checked on 1 % of all drillings. The following dimensions shall be checked and documented according to manufacturer's information and testing instructions by means of a measuring device according to Annex B 5:
 - Volume of the undercut drill hole
 - Depth position of the undercut; the distance between the lower edge of the measuring device and the façade panel is between 0,0 and 0,3 mm (see Annex B 5).

If the tolerances are exceeded, the geometry of the drill hole shall be checked on 25% of the drillings performed. No further drill hole may exceed the tolerances otherwise all the drill holes shall be controlled. Drilling holes falling below or exceeding the tolerances shall be rejected.

Note: Checking the geometry of the drill hole on 1 % of all drillings means that on one of the 25 panels (this corresponds to 100 drillings in façade panels with four anchors) one drilling shall be checked. If the tolerances given in Annex B 22 are exceeded the extent of the control shall be increased to 25 % of the drillings, i.e. one drilling each shall be checked on all the 25 panels.

- During transport and storage on site the façade panels are protected from damages; the façade panels are not be hung up jerkily (if need be lifters shall be used for hanging up the façade panels); façade panels and reveal panels respectively with incipient cracks are not be installed.
- Between agraffe and façade panel an elastic sandwich layer may be placed.


Rathscheck KEIL undercut anchor for Rathscheck splete

Intended use
Specifications


Annex B 4

Geometry of the KEIL facade drill for KEIL facade drill bit 7/9


Dia without countersink

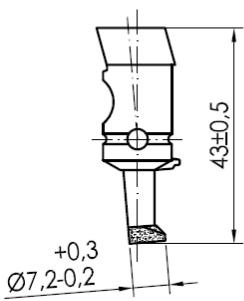


Dia with countersink

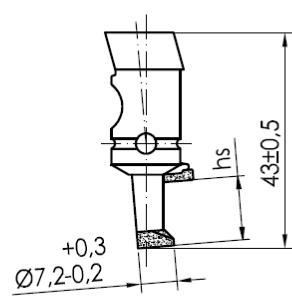

CNC without countersink

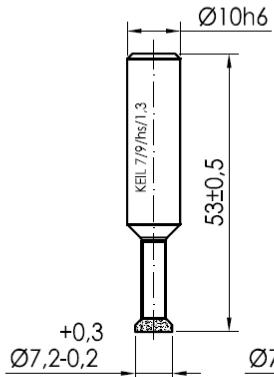


CNC with countersink

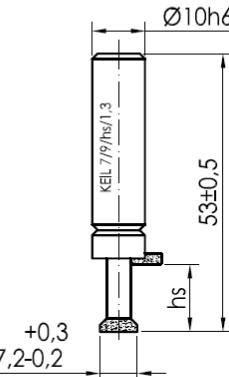


Geometry of the drill hole


without countersink

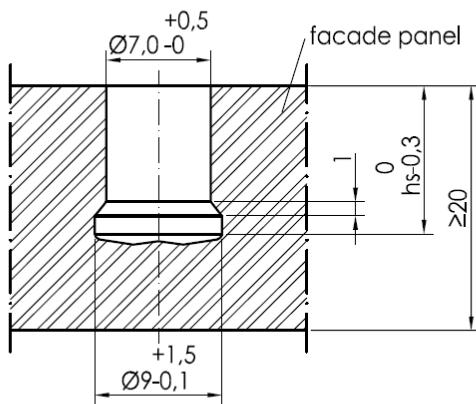

with countersink

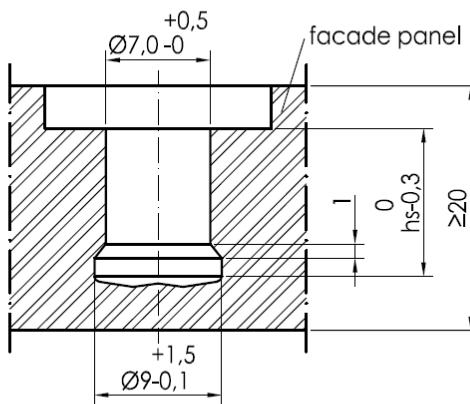

KEIL measuring device

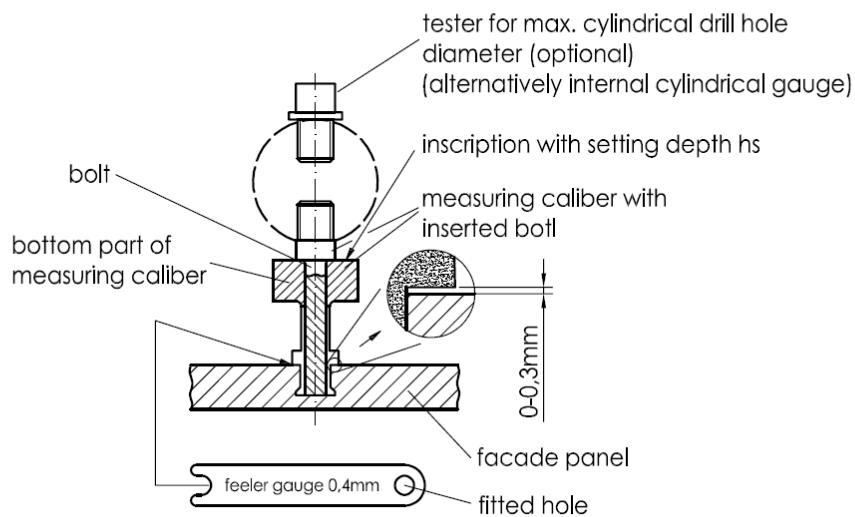

Drawing scale not true to real scale


Rathscheck KEIL undercut anchor for Rathscheck splete

Intended use

Setting tools and testing equipment

Annex B 5

Supports – Definition of edge distances and spacing

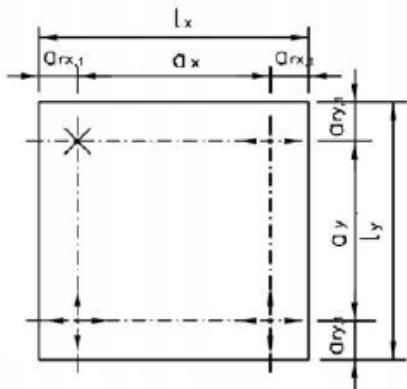

Legend:

- a_{rx}, a_{ry} = edge distance – anchor distance to the panel edge
 a_x, a_y = spacing – distance between the anchors
 l_x = length of the panel in horizontal direction
 l_y = length of the panel in vertical direction
X = fixed bearing (fixed support)
↔ = horizontal slide bearing (slide support)
↔↑ = horizontal and vertical slide bearing (slide support)

Figure 2: Façade panel with 4 agraffes – support condition 1

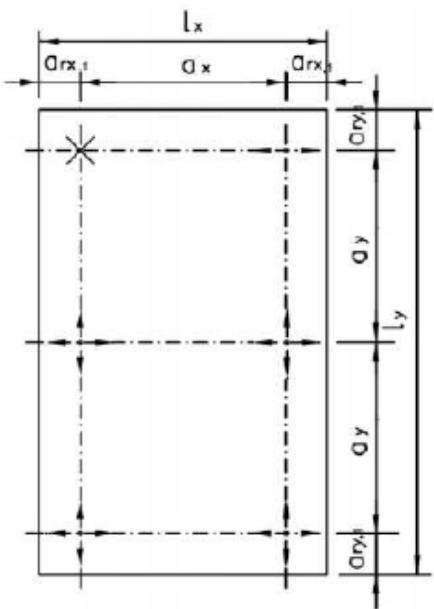


Figure 3: Façade panel with 6 agraffes – support condition 2

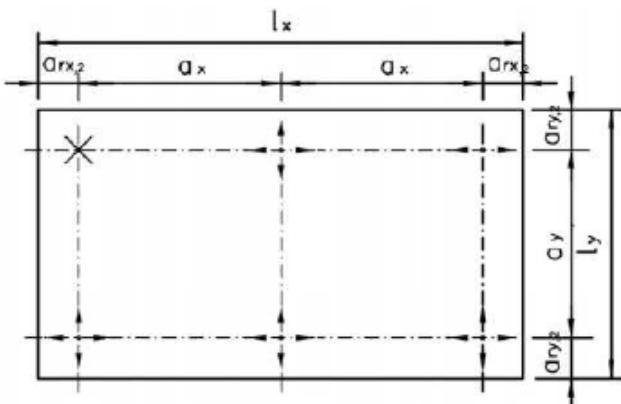


Figure 4: Façade panel with 6 agraffes – support condition 3

Rathscheck KEIL undercut anchor for Rathscheck slette

Intended use
Supports - definition of edge distance and spacing

Annex B 6

Definition of dimensions of the reveal angles

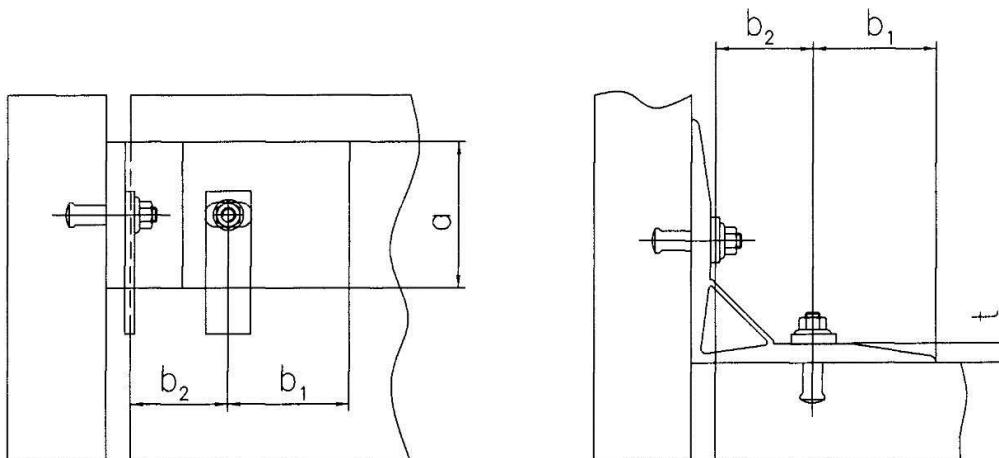
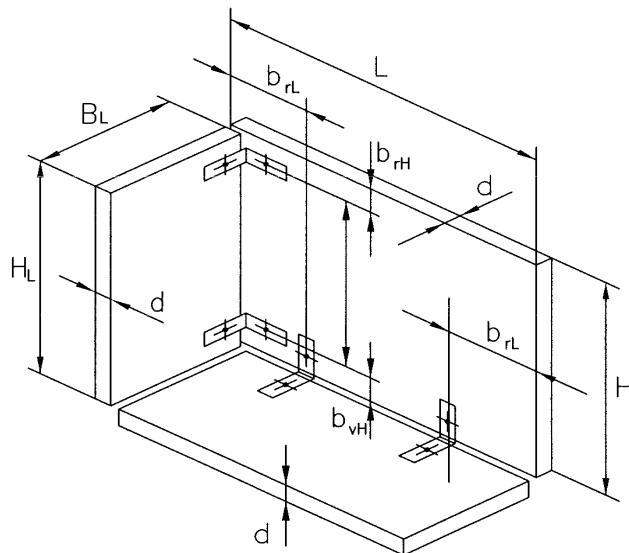


Table B4: Characteristic values of the reveal angles

		stainless steel 1.4401, 1.4404 bzw. 1.4571 EN 10088-3:2014	aluminium EN 755:2016
angle thickness	t [mm]	$t \geq 4$	$t \geq 5$
angle width	a [mm]	$40 \leq a \leq 100$	$40 \leq a \leq 100$
Distance between the centre of anchor to outer edge of reveal angle	b ₁ [mm]	$25 \leq b_1 \leq 10 t$	$25 \leq b_1 \leq 8 t$
Distance between the centre of anchor to inner edge of reveal angle	b ₂ [mm]	$40 \leq b_2 \leq 10 t$	$40 \leq b_2 \leq 8 t$
cross tension stiffness	c _q [MN/m]	$c_q \leq 2,5$	

Rathscheck KEIL undercut anchor for Rathscheck slette


Intended use
Reveal angle of the panel made of natural stone (except slate)

Annex B 7



Installation instructions

1. Drilling the undercut hole

a) cylindrical drilling

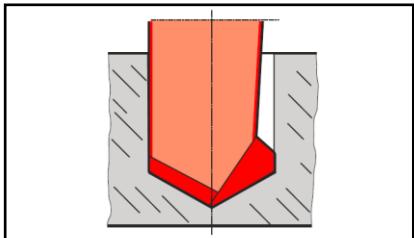


b) undercutting and cleaning

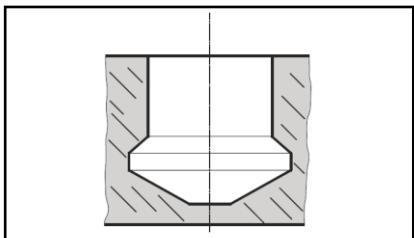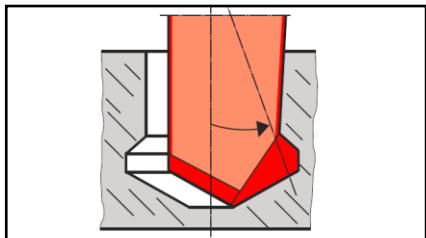

c) finished undercut hole

2. Checking the undercut hole

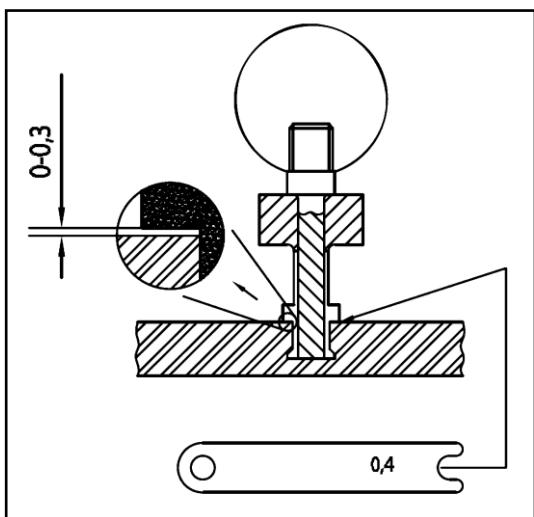


with KEIL depth control guide

Rathscheck KEIL undercut anchor for Rathscheck splete


Intended use
Installation instructions

Annex B 8

3. Installation of anchor (sleeve and screw)

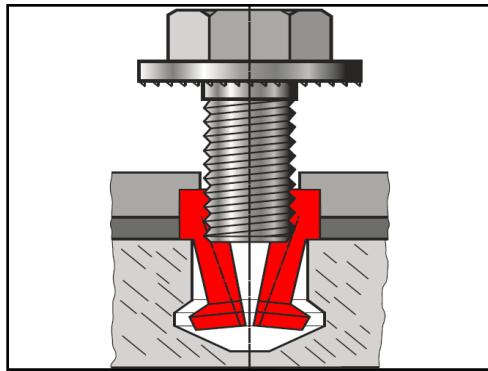


a) Insert the sleeve in the undercut hole
and drill the screw in the sleeve

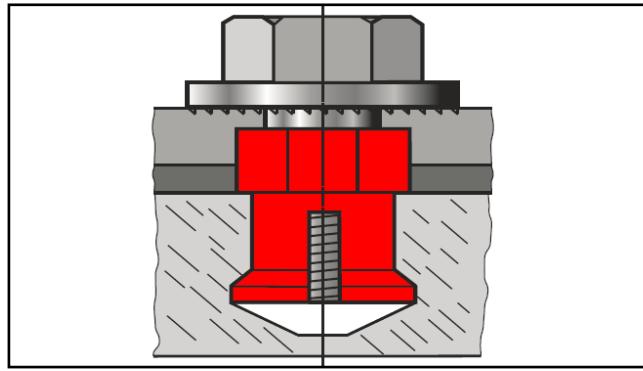

b) Installed anchor

4. Installation of anchor (sleeve and grub screw)

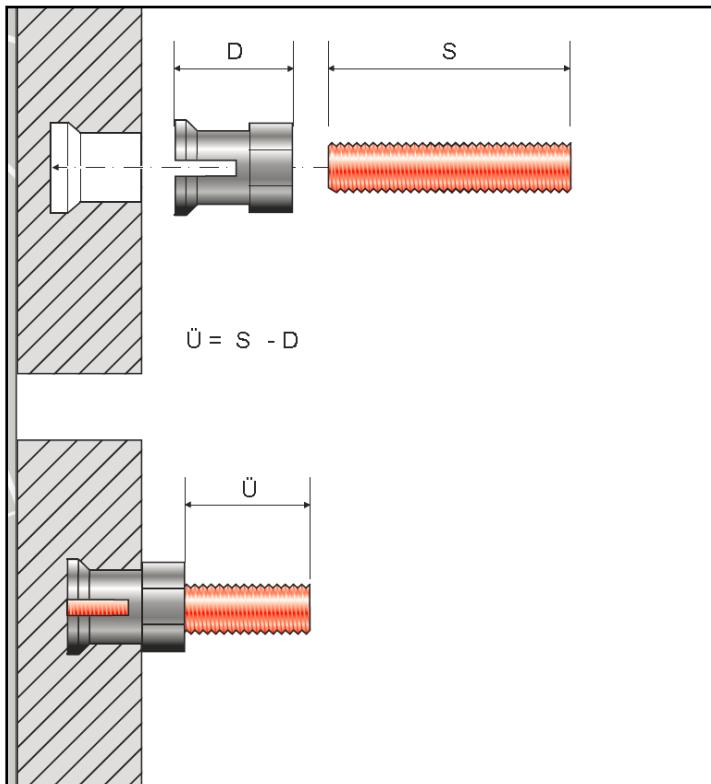

a) Insert the sleeve in the undercut hole

b) Drill the grub screw in the sleeve

c) Installed anchor

Characteristic load-bearing capacity of the anchor

Table C1: Characteristic values for facade panels and reveal panels

Natural stone	Epprechtstein yellow ¹⁾	Padang light ¹⁾	Sto-Kilzinger Sandstein ¹⁾
Setting depth $h_s = [mm]$	15	10	15
Edge distance $a_r \geq [mm]$	100	50	100
Spacing $a \geq [mm]$	120	80	120
Characteristic resistance to tension load $N_{Rk}^{1)} = [kN]$	4,6	3,6	2,9
Characteristic resistance to shear load $V_{Rk}^{1)} = [kN]$	5,1	4,2	3,0

¹⁾ According to Table B3, for other natural stones the characteristic resistances may be determined as follows:

$$N_{Rk} = N_{u,5\%} \cdot \alpha_{exp}$$

$$V_{Rk} = V_{u,5\%} \cdot \alpha_{exp}$$

with:

$$\alpha_{exp} = 1,0 \quad \text{Group of stone I and II}$$

$$\alpha_{exp} = 1,25 \cdot \frac{\sigma_{um,exp}}{\sigma_{um}} \leq 1,0 \quad \text{Group of stone III and IV}$$

$\sigma_{5\%}$, $N_{u,5\%}$ und $V_{u,5\%}$, $\sigma_{um,exp}$ and σ_{um} according to EAD 330030-00-0601, Annex A

Table C2: Characteristic values for facade panels made of sleete ColorSIN CS 50, InterSIN SIN 120 und InterSIN SIN 150

sleete	CS 50 ¹⁾	SIN 120 ¹⁾	SIN 150 ¹⁾
Setting depth $h_s = [mm]$		7	
Edge distance $a_r \geq [mm]$	50	100	50
Spacing $a \geq [mm]$	100	200	100
Characteristic resistance to tension load $N_{Rk} = [kN]$	1,1	1,5	1,3
Characteristic resistance to shear load $V_{Rk} = [kN]$	1,6	1,9	2,7

¹⁾ According to Table B2

Rathscheck KEIL undercut anchor for Rathscheck sleete

Performance
Characteristic resistance

Annex C 1

Dimensioning aid

The following bearing conditions are to use for the admissible wind loads in Annex D 2 to D 9.
By object-releated calculation other admissible wind load tables may be determined.

Maximum support spacing and location of the substructure fixings

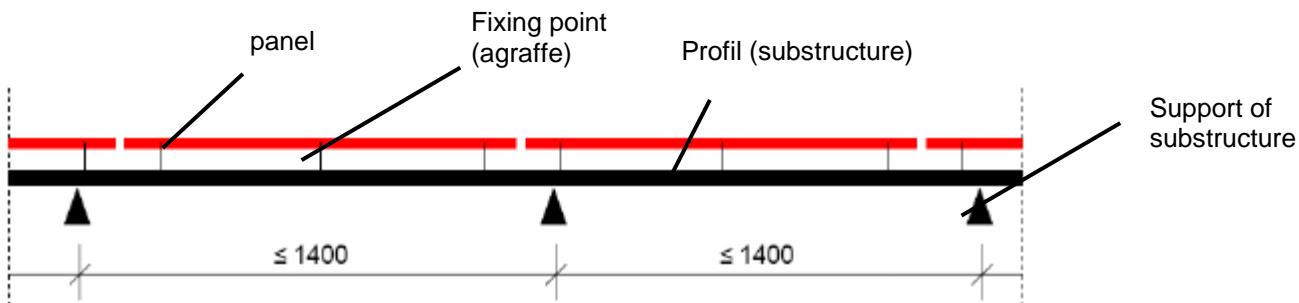


Figure 5: Profiles, supporting three fixing points of a panel, have a maximum spacing of the supports of 1.4 m.

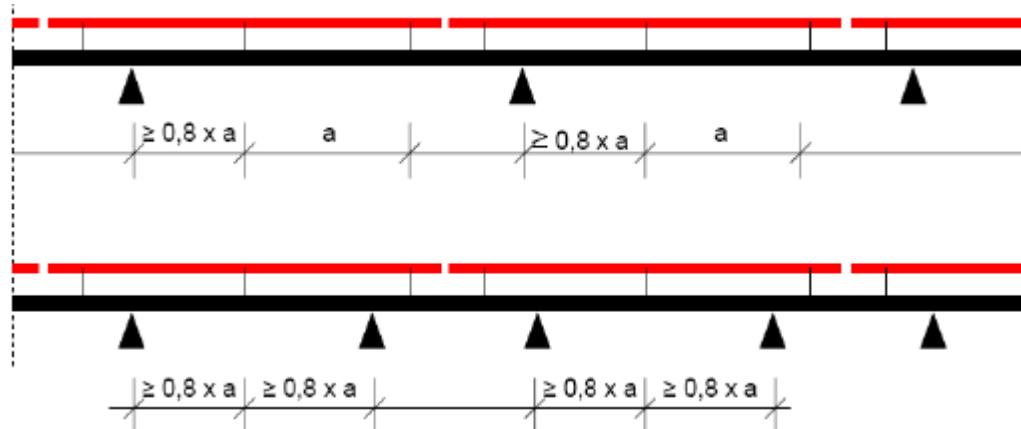


Figure 6: In profiles, supporting three fixing points of a panel, the central fixing points must have a minimum distance of $0,8 \times a$ (a = spacing of the fixing points of the panel) to the supports.

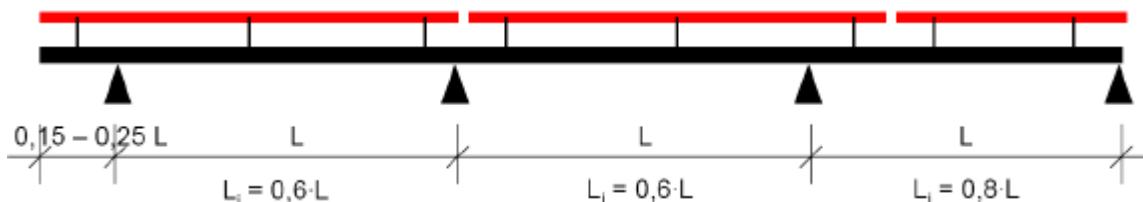


Figure 7: Equivalent support spacing

Rathscheck KEIL undercut anchor for Rathscheck splete

Informative

Maximum support spacing and location of the substructure fixings for splete
ColorSIN CS 50, InterSIN SIN 120 and InterSIN SIN 150

Annex D 1

Dimensioning aid for facade panels made of slate ColorSIN CS 50

Table D1: admissible wind loads – flush-fixed, $e/c_H = 0,75$; $a_r \geq 50 \text{ mm}$

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	50-150	50-150	600 x 600	4	1	3,6
	12,5							3,3
	15							3,0
2	10	7	50-150	50-200	600 x 900	4	1	2,0
	12,5							1,7
	15							1,5
3	10	7	50-150	100-250	600 x 1200	4	1	1,2
	12,5							1,0
	15							0,7
4	10	7	50-200	50-200	750 x 750	4	1	1,9
	12,5							1,6
	15							1,4
7	10	7	50-100	100-150	600 x 1200	6	2 3	1,3
	12,5							1,1
	15							0,8
8	10	7	50-100	150-225	1000 x 1000	6	2 3	0,6

Table D2: admissible wind loads – flush-fixed, $e/c_H = 0,75$; $a_r \geq 100 \text{ mm}$

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	100-150	100-150	600 x 600	4	1	4,0
	12,5							4,7
	15							4,4
2	10	7	100-150	100-200	600 x 900	4	1	2,2
	12,5							2,7
	15							2,4
3	10	7	100-150	100-250	600 x 1200	4	1	1,3
	12,5							1,6
	15							1,4
4	10	7	100-200	100-200	750 x 750	4	1	1,9
	12,5							2,5
	15							2,2
5	10	7	100-200	100-200	900 x 900	4	1	1,4
	12,5							1,3
	15							1,0
6	10	7	100-200	100-200	1000 x 1000	4	1	1,0
	12,5							0,8
	15							0,5
7	10	7	100	100-150	600 x 1200	6	2 3	2,0
	12,5							1,8
	15							1,5
8	10	7	100	150-225	1000 x 1000	6	2 3	0,8
	12,5							0,8
	15							0,5

Rathscheck KEIL undercut anchor for Rathscheck slatee

Informative

Dimensioning aid for façade panels made of slate ColorSIN CS 50

Annex D 2

Table D3: admissible wind loads – flush-fixed, $e/c_H = 0,54$; $a_r \geq 50$ mm

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	50-150	50-150	600 x 600	4	1	3,8
	12,5							3,5
	15							3,3
2	10	7	50-150	50-200	600 x 900	4	1	2,2
	12,5							2,0
	15							1,8
3	10	7	50-150	100-250	600 x 1200	4	1	1,5
	12,5							1,2
	15							1,0
4	10	7	50-200	50-200	750 x 750	4	1	2,1
	12,5							1,9
	15							1,7
7	10	7	50-100	100-150	600 x 1200	6	2 3	1,6
	12,5							1,3
	15							1,1
8	10	7	50-100	150-225	1000 x 1000	6	2 3	0,9

Table D4: admissible wind loads – flush-fixed, $e/c_H = 0,54$; $a_r \geq 100$ mm

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	100-150	100-150	600 x 600	4	1	4,2
	12,5							5,0
	15							4,8
2	10	7	100-150	100-200	600 x 900	4	1	2,4
	12,5							2,9
	15							2,7
3	10	7	100-150	100-250	600 x 1200	4	1	1,5
	12,5							1,9
	15							1,7
4	10	7	100-200	100-200	750 x 750	4	1	2,1
	12,5							2,8
	15							2,5
5	10	7	100-200	100-200	900 x 900	4	1	1,6
	12,5							1,6
	15							1,3
6	10	7	100-200	100-200	1000 x 1000	4	1	1,2
	12,5							1,0
	15							0,8
7	10	7	100	100-150	600 x 1200	6	2 3	2,0
	12,5							2,1
	15							1,8
8	10	7	100	150-225	1000 x 1000	6	2 3	1,0
	12,5							1,1
	15							0,9

Rathscheck KEIL undercut anchor for Rathscheck slatee

Annex D 3

Informative
Dimensioning aid for façade panels made of slate ColorSIN CS 50

Table D5: admissible wind loads – flush-fixed, $e/c_H = 0,33$; $a_r \geq 50$ mm

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	50-150	50-150	600 x 600	4	1	4,0
	12,5							3,8
	15							3,7
2	10	7	50-150	50-200	600 x 900	4	1	2,4
	12,5							2,3
	15							2,1
3	10	7	50-150	100-250	600 x 1200	4	1	1,7
	12,5							1,5
	15							1,3
4	10	7	50-200	50-200	750 x 750	4	1	2,3
	12,5							2,1
	15							2,0
7	10	7	50-100	100-150	600 x 1200	6	2	1,8
	12,5							1,6
	15							1,4
8	10	7	50-100	150-225	1000 x 1000	6	2	1,1
	12,5							0,9
	15							0,7

Table D6: admissible wind loads – flush-fixed, $e/c_H = 0,33$; $a_r \geq 100$ mm

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10	7	100-150	100-150	600 x 600	4	1	4,4
	12,5							5,2
	15							5,1
2	10	7	100-150	100-200	600 x 900	4	1	2,6
	12,5							3,2
	15							3,0
3	10	7	100-150	100-250	600 x 1200	4	1	1,7
	12,5							2,2
	15							2,0
4	10	7	100-200	100-200	750 x 750	4	1	2,3
	12,5							3,0
	15							2,9
5	10	7	100-200	100-200	900 x 900	4	1	1,8
	12,5							1,8
	15							1,6
6	10	7	100-200	100-200	1000 x 1000	4	1	1,4
	12,5							1,3
	15							1,1
7	10	7	100	100-150	600 x 1200	6	2	2,0
	12,5							2,3
	15							2,1
8	10	7	100	150-225	1000 x 1000	6	2	1,2
	12,5							1,4
	15							1,2

Rathscheck KEIL undercut anchor for Rathscheck sleete

Annex D 4

Informative

Dimensioning aid for façade panels made of slate ColorSIN CS 50

Dimensioning aid for facade panels made of slate InterSIN SIN 120

Table D7: admissible wind loads – flush-fixed, $e/c_H = 0,75$

System	d = [mm]	h_v = [mm]	a_rx,1 a_ry,2 [mm]	a_ry,1 a_rx,2 [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_Tab [kN/m²]
1	10,0	7	50-150	50-150	600 x 600	4	1	2,2
	12,5							3,3
	15,0							3,0
	17,5							2,8
	20,0							2,6
2	10,0	7	50-150	50-200	600 x 900	4	1	1,1
	12,5							1,8
	15,0							1,5
	17,5							1,3
	20,0							1,1
3	10,0	7	50-150	100-250	600 x 1200	4	1	0,5
	12,5							1,0
	15,0							0,8
	17,5							0,6
	20,0							0,3
4	10,0	7	50-200	50-200	750 x 750	4	1	0,9
	12,5							1,7
	15,0							1,4
	17,5							1,2
	20,0							0,9
5	10,0	7	100-200	100-200	900 x 900	4	1	0,6
	12,5							0,8
	15,0							0,5
	17,5							0,3
	20,0							0,1
6	10,0	7	100-200	100-200	1000 x 1000	4	1	0,3
	12,5							0,4
	15,0							0,2

Rathscheck KEIL undercut anchor for Rathscheck slate

Informative

Dimensioning aid for facade panels made of slate InterSIN SIN 120

Annex D 5

Table D8: admissible wind loads – flush-fixed, $e/c_H = 0,54$

System	d = [mm]	h_v = [mm]	a_rx,1 a_ry,2 [mm]	a_ry,1 a_rx,2 [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_Tab [kN/m ²]
1	10,0	7	50-150	50-150	600 x 600	4	1	2,4
	12,5							3,5
	15,0							3,3
	17,5							3,1
	20,0							2,9
2	10,0	7	50-150	50-200	600 x 900	4	1	1,3
	12,5							2,0
	15,0							1,8
	17,5							1,7
	20,0							1,5
3	10,0	7	50-150	100-250	600 x 1200	4	1	0,7
	12,5							1,3
	15,0							1,1
	17,5							0,9
	20,0							0,7
4	10,0	7	50-200	50-200	750 x 750	4	1	1,1
	12,5							1,9
	15,0							1,7
	17,5							1,5
	20,0							1,4
5	10,0	7	100-200	100-200	900 x 900	4	1	0,8
	12,5							1,1
	15,0							0,9
	17,5							0,7
	20,0							0,5
6	10,0	7	100-200	100-200	1000 x 1000	4	1	0,6
	12,5							0,7
	15,0							0,5
	17,5							0,3
	20,0							0,1

Rathscheck KEIL undercut anchor for Rathscheck slate

Informative

Dimensioning aid for façade panels made of slate InterSIN SIN 120

Annex D 6

Table D9: admissible wind loads – flush-fixed, $e/c_H = 0,33$

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10,0	7	50-150	50-150	600 x 600	4	1	2,6
	12,5							3,8
	15,0							3,7
	17,5							3,5
	20,0							3,4
2	10,0	7	50-150	50-200	600 x 900	4	1	1,5
	12,5							2,3
	15,0							2,2
	17,5							2,0
	20,0							1,9
3	10,0	7	50-150	100-250	600 x 1200	4	1	0,9
	12,5							1,6
	15,0							1,4
	17,5							1,3
	20,0							1,2
4	10,0	7	50-200	50-200	750 x 750	4	1	1,3
	12,5							2,2
	15,0							2,0
	17,5							1,9
	20,0							1,8
5	10,0	7	100-200	100-200	900 x 900	4	1	1,0
	12,5							1,3
	15,0							1,2
	17,5							1,0
	20,0							0,9
6	10,0	7	100-200	100-200	1000 x 1000	4	1	0,8
	12,5							0,9
	15,0							0,8
	17,5							0,7
	20,0							0,5

Rathscheck KEIL undercut anchor for Rathscheck sleete

Informative

Dimensioning aid for façade panels made of slate InterSIN SIN 120

Annex D 7

Dimensioning aid for facade panels made of slate InterSIN SIN 150

Table D10: admissible wind loads – flush-fixed, $e/c_H = 0,75$

System	d = [mm]	h_v = [mm]	a _{rx,1} a _{ry,2} [mm]	a _{ry,1} a _{rx,2} [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w _{Tab} [kN/m ²]
1	10,0	7	50-150	50-150	600 x 600	4	1	2,8
	12,5							3,4
	15,0							3,1
	17,5							2,9
	20,0							2,7
2	10,0	7	50-150	50-200	600 x 900	4	1	1,5
	12,5							1,9
	15,0							1,6
	17,5							1,4
	20,0							1,2
3	10,0	7	50-150	100-250	600 x 1200	4	1	0,8
	12,5							1,1
	15,0							0,9
	17,5							0,6
	20,0							0,4
4	10,0	7	50-200	50-200	750 x 750	4	1	1,3
	12,5							1,7
	15,0							1,5
	17,5							1,3
	20,0							1,0
5	10,0	7	100-200	100-200	900 x 900	4	1	0,9
	12,5							0,8
	15,0							0,6
	17,5							0,4
	20,0							0,1
6	10,0	7	100-200	100-200	1000 x 1000	4	1	0,6
	12,5							0,5
	15,0							0,2

Rathscheck KEIL undercut anchor for Rathscheck slate

Informative

Dimensioning aid for facade panels made of slate InterSIN SIN 150

Annex D 8

Table D11: admissible wind loads – flush-fixed, $e/c_H = 0,54$

System	d = [mm]	h_v = [mm]	a_rx,1 a_ry,2 [mm]	a_ry,1 a_rx,2 [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_Tab [kN/m²]
1	10,0	7	50-150	50-150	600 x 600	4	1	3,0
	12,5							3,6
	15,0							3,4
	17,5							3,2
	20,0							3,1
2	10,0	7	50-150	50-200	600 x 900	4	1	1,7
	12,5							2,1
	15,0							1,9
	17,5							1,7
	20,0							1,6
3	10,0	7	50-150	100-250	600 x 1200	4	1	1,0
	12,5							1,4
	15,0							1,2
	17,5							1,0
	20,0							0,8
4	10,0	7	50-200	50-200	750 x 750	4	1	1,5
	12,5							2,0
	15,0							1,8
	17,5							1,6
	20,0							1,4
5	10,0	7	100-200	100-200	900 x 900	4	1	1,1
	12,5							1,1
	15,0							0,9
	17,5							0,7
	20,0							0,6
6	10,0	7	100-200	100-200	1000 x 1000	4	1	0,8
	12,5							0,7
	15,0							0,5
	17,5							0,4
	20,0							0,2

Rathscheck KEIL undercut anchor for Rathscheck slate

Informative

Dimensioning aid for façade panels made of slate InterSIN SIN 150

Annex D 9

Table D12: admissible wind loads – flush-fixed, $e/c_H = 0,33$

System	d = [mm]	h_v = [mm]	$a_{rx,1}$ $a_{ry,2}$ [mm]	$a_{ry,1}$ $a_{rx,2}$ [mm]	Panel length x width [mm]	No. of agraffes	Support condition (Annex B 6)	Admissible windloads w_{Tab} [kN/m ²]
1	10,0	7	50-150	50-150	600 x 600	4	1	3,2
	12,5							3,9
	15,0							3,8
	17,5							3,6
	20,0							3,5
2	10,0	7	50-150	50-200	600 x 900	4	1	1,9
	12,5							2,4
	15,0							2,3
	17,5							2,1
	20,0							2,0
3	10,0	7	50-150	100-250	600 x 1200	4	1	1,2
	12,5							1,6
	15,0							1,5
	17,5							1,4
	20,0							1,2
4	10,0	7	50-200	50-200	750 x 750	4	1	1,7
	12,5							2,3
	15,0							2,1
	17,5							2,0
	20,0							1,9
5	10,0	7	100-200	100-200	900 x 900	4	1	1,3
	12,5							1,4
	15,0							1,2
	17,5							1,1
	20,0							1,0
6	10,0	7	100-200	100-200	1000 x 1000	4	1	1,0
	12,5							1,0
	15,0							0,9
	17,5							0,7
	20,0							0,6

Rathscheck KEIL undercut anchor for Rathscheck slatee

Informative

Dimensioning aid for facade panels made of slate InterSIN SIN 150

Annex D 10