



Approval body for construction products and types of construction

**Bautechnisches Prüfamt** 

An institution established by the Federal and Laender Governments



# **European Technical Assessment**

ETA-16/0601 of 20 July 2016

English translation prepared by DIBt - Original version in German language

#### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

CEMflex VB, CEMflex VB NG, CEMflex VB Abschalblech

Coated metal water stop sheet for construction and controlled crack joints in waterproof concrete

BPA-GmbH Behringstraße 12 71083 Herrenberg-Gültstein DEUTSCHLAND

BPA-GmbH
Behringstraße 12
71083 Herrenberg-Gültstein
DEUTSCHLAND

9 pages including 4 annexes which form an integral part of this assessment

European Assessment Document (EAD) 320002-02-0605



Page 2 of 9 | 20 July 2016

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 9 | 20 July 2016

English translation prepared by DIBt

#### **Specific Part**

#### 1 Discritption of the product

The water stop "CEMFlex VB" consists of the following components:

Galvanized metal sheet with the dimensions:

 $h = 90 \text{ mm}, t_0 = 0.75 \text{ mm},$ 

 $h = 100 \text{ mm}, t_0 = 0.75 \text{ mm or}$ 

 $h = 120 \text{ mm}, t_0 = 0.75 \text{ mm},$ 

 $h = 150 \text{ mm}, t_0 = 0.75 \text{ mm},$ 

· special coating mineral-based

For installation purposes the water stop could be delivered with "CEMflex"-clips for the fixing of overlapping. Furthermore, the water stop could be fixed with "CEMflex" Omega-holder. The contact of the "active" coating with the alkaline humidity/concrete provokes a crystallisation and fusion, which ensure the permanent watertightness of the jointing.

There are the following types of products:

"CEMflex VB" and "CEMflex VB NG" - for all Construction joints

"CEMflex VB" Abschalblech only for Construction joints between walls and between floors.

Annex A shows the principles and performances of the product and furthermore the different types of products.

### 2 Specification of the intended use in accordance with the applicable European assessment Document

The water stop is used to seal joints in constructions made of concrete with high resistance to water (watertight concrete) against the penetration of pressing and un-pressing water (e.g. ground water) and to soil moisture.

There are the following classes of intended use:

- a) Construction joints
- b) Controlled crack joints for the use in pre-cast elements made of concrete
- c) Controlled crack joints for the use in in-situ concrete

The performances given in Section 3 are only valid if the water stop is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the water stop of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works



Page 4 of 9 | 20 July 2016

English translation prepared by DIBt

#### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Not applicable

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	See Annex A1

#### 3.3 Safety and accessibility (BWR 4)

Not applicable

#### 3.4 Protection against noise (BWR 5)

Not applicable

#### 3.5 Energy economy and heat retention (BWR 6)

Not applicable

#### 3.6 Sustainable use of natural resources (BWR 7)

For the sustainable use of natural resources no performance was investigated for this product.

#### 3.7 General aspects

The verification of durability and serviceability is part of testing the essential characteristics and by additional tests on the product respectively on the components:

Essential characteristic	Performance
Bondstrength at state of delivery	See Annex A1
Bondstrength after heat aging	See Annex A1

The verification of durability and serviceability is only ensured if the specifications of intended use according to Annex B and the specifications of the technical file of the manufacturer are kept.

### Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision of the Commission of 25 January 1999 (99/90/EC) (OJ L 29/38 of 03.02.1999) amended on 8 January 2001 (2001/586/EC) (OJ L 209/33 of 02.08.2001) the system of assessment and verification of constancy of performance (see Annex V and Article 65 Paragraph 2 to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use(s)	Level or class	System
Coated Metal water stop	For building works	-	3
sheet	For uses subject to regulation on reaction to fire	E	3





Page 5 of 9 | 20 July 2016

English translation prepared by DIBt


5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 20 Juli 2016 by Deutsches Institut für Bautechnik

Uwe Benderbeglaubigt:Head of DepartmentGnamou



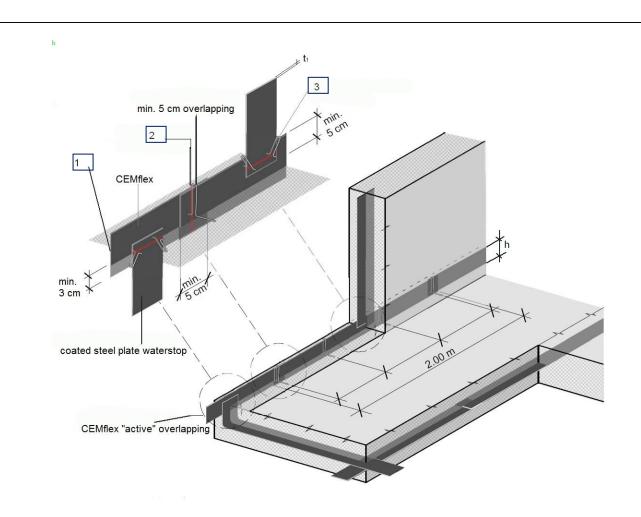

- Coated metal water stop "CEMFlex VB" for all construction joints CEMflex Omega-holder 1
- 2
- 3 CEMflex-clip


#### Performance of the product:

Reaction to fire acc. to EN 13501-1	Class E	
Watertightness in end use conditions		
$h = 150 \text{ mm}, t_1 = 1,25 \text{ mm}$	Class a)	Class b) and c)
$h= 120 \text{ mm}, t_1 = 1,25 \text{ mm}$		, ,
h= 100 mm, t <sub>1</sub> = 1,25 mm	Watertight	Watertight
$h = 90 \text{ mm}, t_1 = 1,25 \text{ mm}$	up to 20 m	up to 4 m
Bondstrength at the state of delivery	> 0.8 N/mm²	
Bondstrength after heat aging	pass (< 20 %)	


CEMflex VB, CEMflex VB NG, CEMflex VB Abschalblech BPA- GmbH		
System built-up, use categories and performances of the product	1 Annex A1	

Z24459.16 8.06.05-205/15



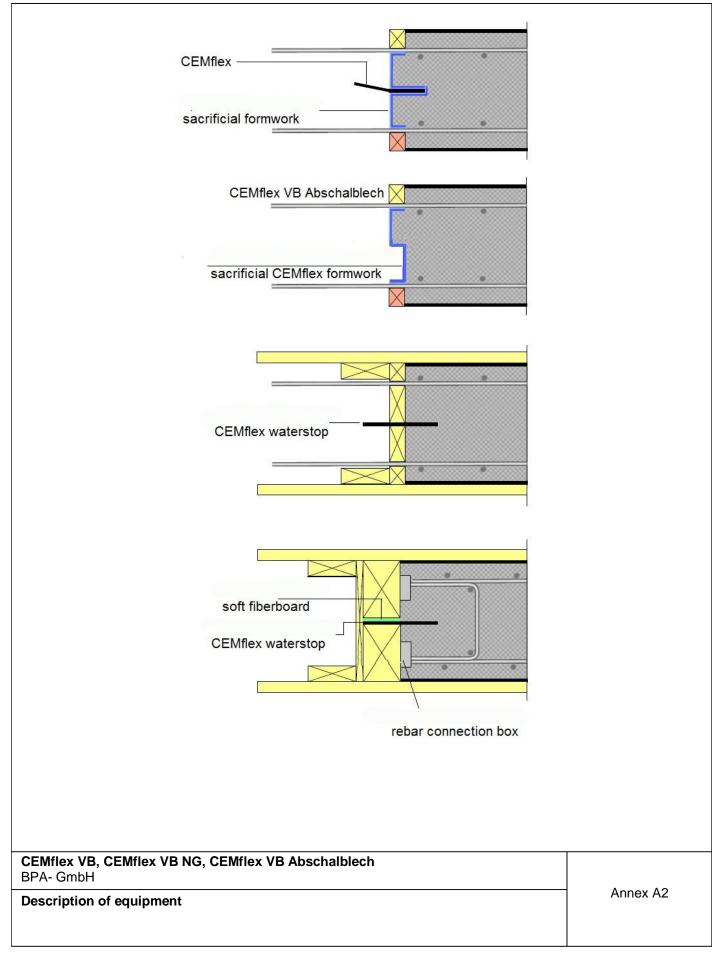



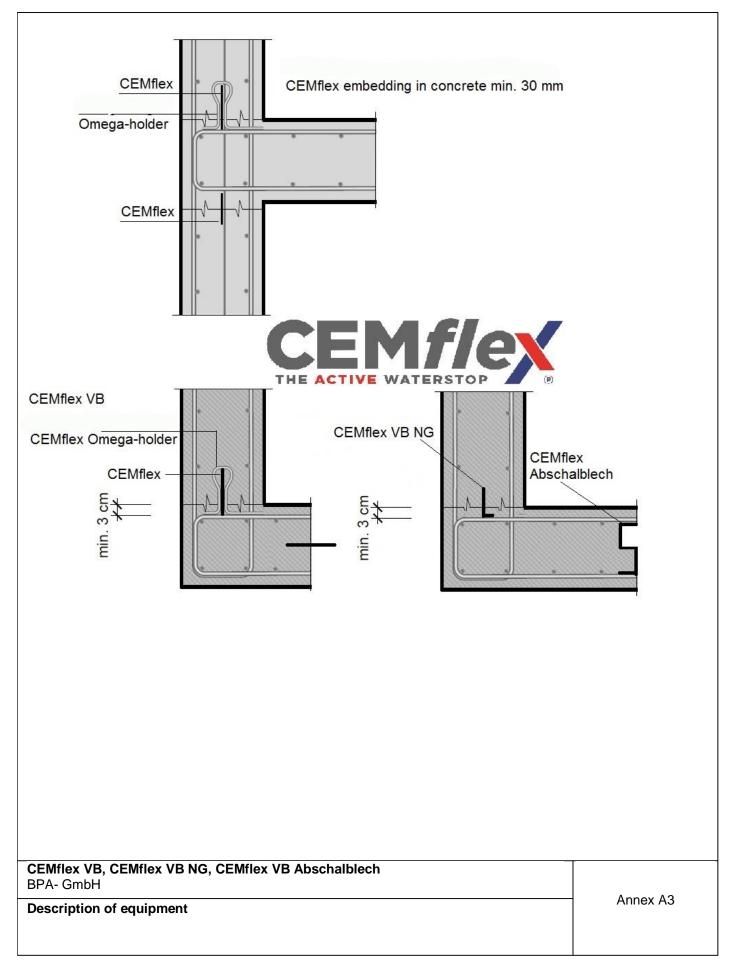

English translation prepared by DIBt



#### Installation

The levels of use categories and the performance of the waterproofing product can be assumed only, if the installation is carried out according to the installation instructions stated in the technical file of the manufacturer, in particular taking account of the following points:

- Installation by appropriately trained personnel
- Installation of only those components which are specified as components of the products
- Installation with the required tools
- Inspecting the substrate surface and the joint surface for cleanliness and correct treatment
- The water stop is generally located in the middle of the construction joints respectively crack control sections.
- The embedment in the first concreting step must be at least 30 mm.
- The distance between water stop and the edge of the construction element must be at least 50 mm respectively at least three times of maximum grain size.
- The water stop has to be attached with appropriate CEMfllex Omega-holder or with CEMflex-clip.
   During concreting the water stop should not move and should not float.
- According to the water pressure the overlapping between the water stops is at least 50 mm at 8 m and at least 200 mm at 20 m.
- Inspecting of position and fixing of the water stop during installation and of the finished installed water stop respectively after the 1. concrete step and documentation of the results.

CEMflex VB, CEMflex VB NG, CEMflex VB Abschalblech BPA- GmbH		
Intended use Specifications	Annex B	

Z24459.16 8.06.05-205/15

electronic copy of the eta by dibt: eta-16/0601