

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-12/0533
of 24 April 2017

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

StoTherm Classic 10 MW/MW-L

Product family
to which the construction product belongs

Product area code: 4
External Thermal Insulation Composite System with
rendering on mineral wool for the use as external
insulation of building walls

Manufacturer

Sto SE & Co. KGaA
Ehrenbachstraße 1
79780 Stühlingen
DEUTSCHLAND

Manufacturing plant

Sto SE & Co. KGaA
Ehrenbachstraße 1
79780 Stühlingen
DEUTSCHLAND

This European Technical Assessment
contains

19 pages including 4 annexes which form an integral part
of this assessment

Annex 5 Control Plan contains confidential information
and is not included in the European Technical
Assessment when that assessment is publicly available

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

Guideline for European technical approval of "External
Thermal Insulation Composite Systems with Rendering",
ETAG 004, edition 2000, amended 2013,
used as European Assessment Document (EAD)
according to Article 66 Paragraph 3 of Regulation (EU)
No 305/2011.

This version replaces

ETA-12/0533 issued on 7 December 2012

European Technical Assessment

ETA-12/0533

English translation prepared by DIBt

Page 2 of 19 | 24 April 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to Article 25 Paragraph 3 of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

1.1 Definition of the kit

This product is an ETICS (External Thermal Insulation Composite System) with rendering - a kit comprising components which are factory-produced by the manufacturer or component suppliers. It's made up on site from these. The ETICS manufacturer is ultimately responsible for the ETICS.

The ETICS kit comprises a prefabricated insulation product of mineral wool (MW) to be bonded and if necessary additionally mechanically fixed onto a wall. The methods of fixing and the relevant components are specified in the table below.

The insulation product is faced with a rendering system consisting of one base and finishing coat (site applied), the base coat contains reinforcement. The rendering system is applied directly to the insulating panels, without any air gap or disconnecting layer.

The ETICS may include special fittings (e.g. base profiles, corner profiles ...) for connection to adjacent building elements (apertures, corners, parapets...). Assessment and performance of these components is not addressed in this ETA, however the ETICS-manufacturer is responsible for adequate compatibility and performance within the ETICS when the components are delivered as a part of the kit.

1.2 Composition of the ETICS

	Components	Coverage [kg/m²]	Thickness [mm]
	National application documents shall be taken into account		
Insulation material with associated method of fixing	Bonded ETICS: <ul style="list-style-type: none"> • Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product <ul style="list-style-type: none"> - MW lamella • Adhesives <ul style="list-style-type: none"> - Sto-Baukleber (cement based powder requiring addition of 22 – 26 % of water) - StoLevell Uni (cement based powder requiring addition of 20 – 23 % of water) - StoLevell Duo Plus (cement based powder requiring addition of about 25 % of water) - StoLevell FT (cement based powder requiring addition of about 28 % of water) - StoLevell Duo (cement based powder requiring addition of 20 – 25 % of water) - StoLevell Duo plus QS (cement based powder requiring addition of 20 – 25 % of water) - StoLevell Alpha (cement based powder requiring addition of 25 – 28 % of water) - StoLevell Novo (cement based powder requiring addition of 37 % of water) 	–	≤ 200
		4.0 to 7.5 (powder)	–

	Components National application documents shall be taken into account	Coverage [kg/m²]	Thickness [mm]
Insulation material with associated method of fixing	Mechanically fixed ETICS with profiles and supplementary adhesive: <ul style="list-style-type: none"> • Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product <ul style="list-style-type: none"> - MW panel, $\sigma_{mt} \geq 14$ kPa • Supplementary adhesive (equal to bonded ETICS) • Profiles (see annex 3 for product characteristics) <ul style="list-style-type: none"> - Sto-Halteleiste Alu - Sto-Verbindungsleiste Alu Aluminium (AL) - Profile • Anchors for profiles <ul style="list-style-type: none"> - WS 8 L - WS 8 N - ejotherm SDK U - SDF-K plus - ejotherm NK U • Anchors for insulation product if necessary (equal to mechanically fixed ETICS with anchors and supplementary adhesive, see below) 	–	60 to 200
	Mechanically fixed ETICS with anchors and supplementary adhesive: <ul style="list-style-type: none"> • Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product <ul style="list-style-type: none"> - MW panel - MW lamella • Supplementary adhesive (equal to bonded ETICS) • Anchors for insulation product (see annex 2 for product characteristics) all anchors with ETA according to ETAG 014¹ with characteristics defined in annex 2 	–	60 to 340 60 to 200
Base coat	StoArmat Classic S1 ready to use paste (cement free) consisting of an terpolymer binder, silicat particles, fibres and specific additives.	5.5 to 10.0	3.0 to 5.0

¹ ETAG 014

Plastic anchors for fixing of external thermal insulation composite systems with rendering

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Glass fibre Mesh	Sto-Glasfasergewebe Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 6.0 mm x 6.0 mm. (see annex 4 for product characteristics)	–	–
	Sto-Glasfasergewebe F Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 4.0 mm x 4.0 mm. (see annex 4 for product characteristics)	–	–
	Sto-Abschirmgewebe AES (special mesh including a thin stainless yarn to reduce radiation of electric fields) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 4.0 mm x 4.0 mm. (see annex 4 for product characteristics)	–	–
	Sto-Panzergewebe (reinforced mesh implemented in addition to the meshes described above to improve the impact resistance) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 450 g/m ² and mesh size of about 7.5 mm x 7.5 mm. (see annex 4 for product characteristics)	–	–
Key coat	Sto-Putzgrund Ready to use pigmented acrylic-resin dispersion liquids For the compatibility with the finishing coats see below.	about 0.3 l/m ²	–
Finishing coat	To use with key coat "Sto-Putzgrund", if applicable:* <ul style="list-style-type: none"> Ready to use pastes – acrylic binder: <ul style="list-style-type: none"> Stolit K (particle size 1.0 to 6.0 mm) Stolit X-Black (particle size 1.0 to 6.0) Stolit R (particle size 1.5 to 6.0 mm) Stolit Effect (particle size 3.0 mm) Stolit MP (thin, middle or thick layered) Ready to use pastes – acrylic/siloxane binder: <ul style="list-style-type: none"> StoSilco K (particle size 1.0 to 3.0 mm) StoSilco R (particle size 1.5 to 3.0 mm) StoSilco MP (thin, middle or thick layered) StoSilco blue K (particle size 1.0 to 3.0 mm) StoSilco blue MP (particle size 1.0 to 3.0 mm) Ready to use pastes – acrylic binder: <ul style="list-style-type: none"> StoLotusan K (particle size 1.0 to 3.0 mm) StoLotusan MP (thin, middle or thick layered) 	2.2 to 6.5 2.2 to 6.5 2.2 to 6.1 4.5 to 5.5 2.2 to 4.7 2.0 to 4.8 2.2 to 4.5 2.2 to 4.7 1.8 to 5.0 1.5 to 4.0 2.0 to 4.8 2.2 to 4.7	} regulated by particle size 1.5 to 3.5 } regulated by particle size 1.5 to 3.5 } regulated by particle size 1.5 to 3.5

	Components National application documents shall be taken into account	Coverage [kg/m²]	Thickness [mm]
Finishing coat	<ul style="list-style-type: none">Ready to use pastes – acrylic/siloxane binder: (application between 0°C and 15°C): Stolit QS K (particle size 1.0 to 3.0 mm) Stolit QS R (particle size 1.5 to 3.0 mm) Stolit QS MP (thin, middle or thick layer)Ready to use pastes – acrylic/siloxane binder (application between 0°C and 15°C): StoSilco QS K (particle size 1.0 to 3.0 mm) StoSilco QS R (particle size 1.5 to 3.0 mm) StoSilco QS MP (thin, middle or thick layer)	2.0 to 4.8 2.2 to 4.5 2.2 to 4.7	} regulated by particle size 1.5 to 3.5 } regulated by particle size 1.5 to 3.5
	Decorative paint (optional)	StoColor Silco StoColor Silco G StoColor Lotusan StoColor Lotusan G StoColor Jumbosil StoColor Maxicryl StoColor Crylan StoColor X-black	
Ancillary material	Remains the responsibility of the manufacturer.		
* The instruction to the installer concerning the use of a key coat remains the responsibility of the manufacturer.			

2 Specification of the intended use in accordance with the applicable European assessment Document (hereinafter called EAD)

2.1 Intended use

This ETICS is intended to be used as external insulation to the walls of buildings made of masonry (bricks, blocks, stones ...) or concrete (cast on site or as prefabricated panels) with and without rendering. The characteristics of the walls shall be verified prior to use of the ETICS, especially regarding conditions for reaction to fire classification and for fixing of the ETICS either bonding or mechanically. It shall be designed to give the wall to which it is applied satisfactory thermal insulation.

The ETICS is non load-bearing construction element. It does not contribute directly to the stability of the wall on which it is installed, but it can contribute to durability by providing enhanced protection from the effects of weathering.

The ETICS can be used on new or existing (retrofit) vertical walls.

The ETICS is not intended to ensure the air tightness of the building structure.

The choice of the method of fixing depends on the characteristics of the substrate, which could need preparation (see clause 7.2.1 of ETAG 004) and on the national instructions

The verifications and assessment methods on which this European Technical Assessment (hereinafter called ETA) is based lead to the assumption of a working life of the ETICS "StoTherm Classic 10 MW/MW-L" of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right products in relation to the assumed economically reasonable working life of the works.

2.2 Manufacturing

The ETA is issued for the ETICS on the basis of agreed data/information, deposited with the DIBt, which identifies the ETICS that has been assessed and judged. Changes to the ETICS or the components or their production process, which could result in this deposited data/information being incorrect, should be notified to the DIBt before the changes are introduced. DIBt will decide whether or not such changes affect the approval and consequently the validity of the CE-marking on the basis of the approval and if so whether further assessment or alterations to the approval shall be necessary.

2.3 Design and installation

The installation instructions including special installation techniques and provisions for the qualification of the personnel are given in the manufacturer's technical documentation.

Design, installation and execution of ETICS are to be in conformity with national documents. Such documents and the level of their implementation in Member States' legislation are different. Therefore, the assessment and declaration of performance are done taking into account general assumptions introduced in the chapters 7.1 and 7.2 of ETAG 004 used as EAD, which summarize how information introduced in the ETA and related documents is intended to be used in the construction process and gives advice to all parties interested when normative documents are missing.

2.4 Packing, transport and storage

The information on packaging, transport and storage is given in the manufacturer's technical documentation. It is the responsibility of the manufacturer to ensure that this information is made known to the concerned people.

2.5 Use, maintenance, repair

The finishing coat shall normally be maintained in order to fully preserve the ETICS performance. Maintenance includes at least:

- visual inspection of the ETICS,
- the repairing of localised damaged areas due to accidents,
- the aspect maintenance with products adapted and compatible with the ETICS (possibly after washing or ad hoc preparation).

Necessary repairs should be performed as soon as the need has been identified.

The information on use, maintenance and repair is given in the manufacturer's technical documentation.

It is the responsibility of the manufacturer to ensure that this information is made known to the concerned people.

3 Performance of the product and references to the methods used for its assessment

3.0 General

The performances of the kit as described in this chapter are valid provided that the components of the kit comply with Annexes 1- 4.

3.1 Mechanical resistance and stability (BWR 1)

Not relevant

3.2 Safety in case of fire (BWR 2)

Reaction to fire (ETAG 004 - clause 5.1.2)

Configurations	Organic content	Flame retardant content	Euroclass according to EN 13501-1
Base coat	max. 8.4 %	min. 45.0 %	
Mineral wool	In quantity ensuring Euroclass A1 according to EN 13501-1	no flame retardant	
profiles	-	-	
anchors	-	-	
Rendering system Base coat with finishing coat and compatible key coat in clause 1.2:			
Stolit K/R (particle size 1.0 to 3.0 mm) Stolit X-Black (particle size 1.0 bis 3.0 mm)	max. 10 %	min. 8.0 %	A2 – s1,d0
Stolit Effect			
Stolit MP		min. 7.8 %	
StoSilco K/R/MP		min. 7.6 %	
StoSilco blue K/MP		min. 8.0 %	
StoLotusan K/MP		min. 10.7 %	A2 – s2,d0
Stolit QS K		min. 9.2 %	
Stolit QS R/MP		min. 9.4 %	
StoSilco QS K		min. 9.2 %	
StoSilco QS R/MP		min.9.4 %	
Stolit K/R (particle size 3.5 to 6.0 mm) Stolit X-Black (particle size 3.5 to 6.0 mm)		min. 8.0 %	B – s2,d0

3.3 Hygiene, health and environment (BWR 3)

3.3.1 Water absorption (capillarity test) (ETAG 004 – clause 5.1.3.1)

- **Base coat:**

- Water absorption after 1 hour < 1.0 kg/m²
- Water absorption after 24 hours < 0.5 kg/m²

• **Rendering system:**

		Water absorption after 24 hours	
		< 0.5 kg/m ²	≥ 0.5 kg/m ²
Rendering systems: Base coat with finishing coat indicated in clause 1.1:	Stolit K/R/Effect/MP	x	
	StoSilco K/R/MP	x	
	StoSilco blue K/MP	x	
	StoLotusan K/MP	x	
	Stolit QS K/R/MP	x	
	Stolit X-Black	x	
	StoSilco QS K/R/MP	x	

3.3.2 Hydrothermal behaviour (ETAG 004 - clause 5.1.3.2)

Pass (without defects)

3.3.3 Impact resistance (ETAG 004 - clause 5.1.3.3)

Standard mesh: "Sto-Glasfasergewebe" or "Sto-Glasfasergewebe F"

Rendering system: Base coat with finishing coat indicated hereafter:	Standard mesh/ Sto- Abschirmgewebe AES	two-part mesh: Sto- Glasfasergewebe	Standard mesh with Sto-Panzergerewebe
Stolit K/R/Effect/MP	Category I	Category II	Category I
StoSilco K/R/MP	Category I	Category II	Category I
StoSilco blue K/MP	npd		
StoLotusan K/MP	Category I	Category II	Category I
Stolit QS K/R/MP	npd		
Stolit X-Black	Category II	Category II	Category I
StoSilco QS K/R/MP	npd	Category I	npd

3.3.4 Water vapour permeability (ETAG 004 – clause 5.1.3.4)

Rendering system: Base coat with finishing coats indicated hereafter (evaluated without key coat and decorative paint)	Equivalent air thickness s_d
Stolit K/R/Effect/MP	≤ 1.0 m (Test result obtained with Stolit K2: 0.31 m)
StoSilco K/R/MP	≤ 1.0 m (Test result obtained with StoSilco K2: 0.21 m)
StoSilco blue K/MP	≤ 1,0 m (Test result obtained with StoSilco blue K2: 0.71 m)
StoLotusan K/MP	≤ 1.0 m (Test result obtained with StoLotusan K2: 0.06 m)
Stolit QS K/R/MP	≤ 1.0 m (Test result obtained with Stolit QS K2: 0.21 m)
Stolit X-Black	≤ 1,0 m (Test result obtained with Stolit X-Black K2: 0.81 m)
StoSilco QS K/R/MP	≤ 1,0 m (Test result obtained with StoSilco QS K2: 0.41 m)

3.3.5 Release of dangerous substances (ETAG 004 - clause 5.1.3.5, EOTA TR034)

Essential characteristic	Performance
Release of dangerous substances	no performance assessed

3.4 Safety and accessibility in use (BWR 4)

3.4.1 Bond strength between base coat and insulation product (MW lamella) (ETAG 004 - clause 5.1.4.1.1)

Conditioning		
Initial state	After hygrothermal cycles	After freeze/thaw test
≥ 0.08 MPa	< 0.08 MPa but failure in the insulation product	Test not required because freeze/thaw cycles not necessary

3.4.2 Bond strength between adhesive and substrate resp. insulation product (MW lamella) (ETAG 004 - clause 5.1.4.1.2 and 5.4.1.3)

		Initial state	48 hrs. immersion in water and 2 hrs. drying	48 hrs. immersion in water and 7 days drying
Sto-Baukleber StoLevell Duo Plus StoLevell Uni StoLevell Duo StoLevell Duo plus QS StoLevell Alpha StoLevell Novo	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW Lamella	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
StoLevell FT	MW Lamella	≥ 0.08 MPa	≥ 0.03 MPa	< 0.08 MPa But failure in the insulation product

Bonded surface:

With a bonded surface of 50 % the formula given in clause 6.1.4.1.3 of ETAG 004 is fulfilled and the use as bonded ETICS is possible.

3.4.3 Bond strength after ageing (ETAG 004 - clause 5.1.4.2)

Rendering system: Base coat with finishing coats indicated hereafter	Stolit K/R/Effect/MP	< 0.08 MPa but failure in the insulation product
	StoSilco K/R/MP	
	StoSilco blue K/MP	
	StoLotusan K/MP	
	Stolit QS K/R/MP	
	Stolit X-Black	
	StoSilco QS K/R/MP	

3.4.4 Fixing strength (displacement test) (ETAG 004 - clause 5.1.4.2)

Test not required therefore no limitation of ETICS length required

3.4.5 Wind load resistance (Insulation product MW) (ETAG 004 - clause 5.1.4.3)

The following failure loads only apply to the listed combination of the properties of components and the characteristics of the insulation product given in annex 1.

3.4.5.1 Safety in use of mechanically fixed ETICS using profiles

Failure loads – Table 1

MW panels	Dimensions	625 mm x 800 mm
	Thickness	≥ 60 mm
	Tensile strength perpendicular to the faces	≥ 14 kPa
Failure loads [N/panel] (Static Foam Block Test)	Horizontal profiles with a vertical distance of 625 mm, fixed every 30 cm and vertical connection profiles No additional anchors in MW panel	Mindestwert: 1200 Mittelwert: 1250

Failure loads – Table 2

MW panels	Dimensions	625 mm x 800 mm
	Thickness	≥ 60 mm
	Tensile strength perpendicular to the faces	≥ 14 kPa
Failure loads [N/panel] (Static Foam Block Test)	Horizontal profiles with a vertical distance of 625 mm, fixed every 30 cm and vertical connection profiles Two additional anchors per MW panel, plate diameter ≥ 60 mm, mounted on the MW panel surface	Mindestwert: 2200 Mittelwert: 2400

3.4.5.2 Safety in use of mechanically fixed ETICS using anchors

Failure loads – Table 3

Apply to all anchors listed in the clause 1.2 mounted on the insulation panels surface			
Characteristics of the MW panels	Thickness		≥ 60 mm
	Tensile strength perpendicular to the faces		≥ 14 kPa
Versagenslast [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R _{panel}	Mindestwert: 650 Mittelwert: 740
	Anchors placed at the panel joints (Static Foam Block Test)	R _{joint}	Mindestwert: 590 Mittelwert: 610
	Anchors not placed at the panel joints (Pull-through test, dry conditions)	R _{panel}	Mindestwert: 640 Mittelwert: 690
	Anchors not placed at the panel joints (Pull-through test, wet conditions) - series 2* - series 3*	R _{panel}	Mindestwert: 360 Mittelwert: 390 Mindestwert: 410 Mittelwert: 450
* according to ETAG 004 clause 5.2.4.1.2 test method (2)			

Failure loads – Table 4

Apply to all anchors listed in the clause 1.2 mounted on the insulation panels surface				
Characteristics of the MW panels		Thickness	≥ 80 mm	
		Tensile strength perpendicular to the faces	≥ 5.0 kPa	
Plate diameter of anchor			≥ Ø 90 mm	≥ Ø 140 mm
Failure loads [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R _{panel}	Minimal: 480 Average: 490	Minimal: 560 Average: 690
	Anchors placed at the panel joints (Static Foam Block Test)	R _{joint}	Minimal: 380 Average: 390	Minimal: 440 Average: 540
	Anchors not placed at the panel joints (Pull-through test, dry conditions)	R _{panel}	Minimal: 540 Average: 610	npd
	Anchors not placed at the panel joints (Pull-through test, wet conditions) - series 2*	R _{panel}	Minimal: 400 Average: 460	npd
* according to ETAG 004 clause 5.2.4.1.2 test method (2)				

Failure loads – Table 5

Apply to all anchors listed in clause 1.2 mounted on the insulation panels surface			
Plate diameter of anchor		≥ Ø 140 mm	
Characteristics of the MW lamella	Thickness		≥ 60 mm
	Tensile strength perpendicular to the faces		≥ 80 kPa
Failure loads [N]	Anchors placed at the panel joints (Pull-through test, dry condition)	R_{joint}	Minimal: 620 Average: 660
	Anchors placed at the panel joints (Pull-through test, wet condition)	R_{joint}	Minimal: 510 Average: 570
	Anchors placed at the panel joints (Static Foam Block Test)	R_{joint}	Minimal: 710

The failure loads of Table 2 and 3 specified above only apply to the following anchors with deep mounting under the given conditions of installation:

Anchor	Thickness of the MW panel [d]	Conditions of installation *
ejotherr STR U ejotherr STR U 2G (ETA-04/0023)	100 mm > d ≥ 80 mm	– Maximum installation depth of the anchor plate: 15 mm (≤ thickness of insulation cover) – Maximum depth of die: 5 mm
	≥ 100 mm	– Maximum installation depth of the anchor plate: 15 mm (≤ thickness of insulation cover) – Maximum depth of die: 20 mm
* according to the appropriate ETA of anchor		

3.4.6 Render Strip Tensile Test (ETAG 004 – clause 5.5.4.1)

No cracks occurred during the Render Strip Tensile Test of the base coat reinforced with the glass fibre mesh "Sto-Glasfasergewebe" and "Sto-Abschirmgewebe AES" at a render strain value of 1 %.

The average value of crack width of the base coat reinforced with the glass fibre mesh "Sto-Glasfasergewebe F" measured at a render strain value of 1 % is about 0.10 mm.

3.5 Protection against noise (BWR 5)

NPD (no performance determined)

3.6 Energy economy and heat retention (BWR 6)

3.6.1 Thermal resistance

The nominal value of the additional thermal resistance R provided by the ETICS to the substrate wall is calculated in accordance with EN ISO 6946:2007 from the nominal value of the insulation product's thermal resistance R_D given accompanied to the CE marking and from the thermal resistance of the rendering system R_{render} which is about $0.02 \text{ (m}^2 \cdot \text{K)/W}$.

$$R = R_D + R_{render}$$

The thermal bridges caused by anchors profiles increases the thermal transmittance U . This influence had to take into account according to EN ISO 6946:2007

The thermal bridges caused by mechanical fixing devices (anchors profiles) increase the thermal transmittance U . This influence had to take into account according to EN ISO 6946:2007.

$$U_c = U + \Delta U$$

corrected thermal transmittance $[W/(m^2 \cdot K)]$

$$\Delta U = \Delta U_{anchor} + \Delta U_{profile}$$

correction term for mechanical fixing devices (anchors, profiles)

$$\Delta U_{anchor} = \chi_p \cdot n$$

correction term for anchors

where: n

number of anchors per m^2

$$\chi_p$$

local influence of thermal bridge caused by an anchor. The values listed below can be taken into account, if not specified in the anchor's technical approval

$$\chi_p = 0.004 \text{ W/K}$$

for anchors with a galvanized steel screw with the head covered by a plastic material

$$\chi_p = 0.002 \text{ W/K}$$

for anchors with a stainless steel screw with the head covered by plastic material, and for anchors with an air gap at the head of the screw

$$\Delta U_{profile}$$

correction term for profiles; subject to the thickness of the insulation product and the thermal resistance of the substrate wall the following values apply

Thermal resistance of the substrate wall [$(m^2 \cdot K)/W$]	Thickness of the insulation product [mm]	$\Delta U_{profile}$ [$W/(m^2 \cdot K)$]
$R < 0.33$	$60 \leq d < 80$	0.03
	$80 \leq d < 120$	0.02
	$d \geq 120$	0
$0.33 \leq R \leq 1.10$	$60 \leq d < 80$	0.02
	$80 \leq d \leq 100$	0.01
	$d > 100$	0
$R > 1.10$	$d \geq 60$	0

3.7 Sustainable use of natural resources (BWR 7)

For the sustainable use of natural resources no performance was investigated for this product.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the European Commission decision 97/556/EC amended by the European Commission decision 2001/596/EC, the assessment and verification of constancy of performance system (AVCP) applies suitable following table (see Annex V to Regulation (EU) No 305/2011).

Product	Intended use	Levels or classes (Reaction to fire)	Systems
"StoTherm Classic 10 MW/MW-L"	in external wall subject to fire regulations	A1 ⁽¹⁾ , A2 ⁽¹⁾ , B ⁽¹⁾ , C ⁽¹⁾	1
		A1 ⁽²⁾ , A2 ⁽²⁾ , B ⁽²⁾ , C ⁽²⁾ , D, E, (A1 to E) ⁽³⁾ , F	2+
	in external wall not subject to fire regulations	any	2+
⁽¹⁾ Products/materials for which a clearly identifiable stage in the production process results in an improvement of the reaction to fire classification (e.g. an addition of fire retardants or a limiting of organic material) ⁽²⁾ Products/materials not covered by footnote (1) ⁽³⁾ Products/materials that do not require to be tested for reaction to fire (e.g. products/materials of Classes A1 according to Commission Decision 96/603/EC)			

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 24 April 2017 by Deutsches Institut für Bautechnik

Dirk Brandenburger
Head of Department

beglaubigt:
Windhorst

European Technical Assessment
ETA-12/0533

English translation prepared by DIBt

Page 15 of 19 | 24 April 2017

Annexes:

- Annex 1: Insulation product characteristics
- Annex 2: Anchors
- Annex 3: Profiles
- Annex 4: Reinforcement

Annex No. 1: Insulation product characteristics

Factory-prefabricated panels and lamella made of mineral wool (MW) to EN 13162:2015 with the following designation code and the other properties having the description in the Table below shall be used, provided that the manufacturer and the trade name of the MW are deposited with the DIBt.

MW – EN 13162 – T5 – DS(T+) – WS – WL(P) – MU1

Description and characteristics	MW panel***	MW panel	MW lamella
Reaction to fire; EN 13501-1:2007	Class A1		
Gross heat of combustion [MJ/kg]; EN ISO 1716:2002	PCS ≤ 1.4		
Thermal resistance [(m² · K)/W]	Defined in the CE marking in reference to EN 13162:2015		
Tensile strength perpendicular to the faces [kPa]; EN 1607:1997 - in dry conditions*	$\sigma_{mt} \geq 14$	$\sigma_{mt} \geq 5$	$\sigma_{mt} \geq 80$
- in wet conditions** Average value - series 2 - series 3	≥ 33 % of average value in dry conditions ≥ 50 % of average value in dry conditions		
Compressive strength* [kPa]; EN 826:1996	$\sigma_m \geq 40$	$\sigma_m \geq 4$	$\sigma_m \geq 40$
Apparent density [kg/m³]; EN 1602:1996	$120 \leq \rho_a \leq 150$	$100 \leq \rho_a \leq 150$	$80 \leq \rho_a \leq 150$
Shear strength* [kPa]; EN 12090:1997	$20 \leq f_{tk} \leq 100$	$6 \leq f_{tk} \leq 100$	$20 \leq f_{tk} \leq 100$
Shear modulus [MPa]; EN 12090:1997	$1.0 \leq G_m \leq 2.0$	$0.3 \leq G_m \leq 2.0$	$1.0 \leq G_m \leq 2.0$
* Minimal value of all single values ** According to ETAG 004 clause 5.2.4.1.2 test method (2) *** Thermal insulation materials for mechanically fixed ETICS with profiles must circumferentially at the edges, 24 mm from the inner surface, get an approx. 3 mm wide and 13 to 18 mm deep groove cut-in at the factory			

Annex No. 2: Anchors

All anchors with ETA according to ETAG 014⁷ with characteristics having the description below shall be used in the mechanically fixed ETICS:

- plate diameter of anchor ≥ 60 mm resp. ≥ 90 mm or ≥ 140 mm
- plate stiffness ≥ 0.3 kN/mm
- load resistance of the anchor plate ≥ 1.0 kN

These characteristics and the characteristic tension resistance of the anchors shall be taken from the corresponding ETA.

The anchors listed in the Table in clause 1.2 with reference to the respective ETA shall be used in the mechanically fixed ETICS with profiles for fixing the horizontal profiles.



Trade name	ETA-number
WS 8 L	ETA-02/0019
WS 8 N	ETA-03/0019
ejotherm SDK U	ETA-04/0023
SDF-K plus	ETA-04/0064
ejotherm NK U	ETA-05/0009

Annex No. 3: Profiles

Aluminium (Al) profiles, EN AW-6060 T66 to EN 755-2:2008 are to be used in the mechanically fixed ETICS with profiles.


The Pull-through resistance of fixings from profiles is ≥ 500 N.

Horizontal profile – "Sto-Halteleiste Alu"

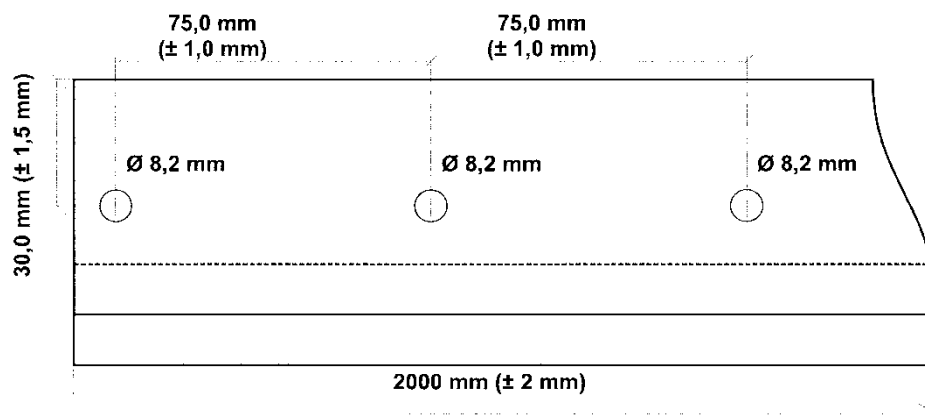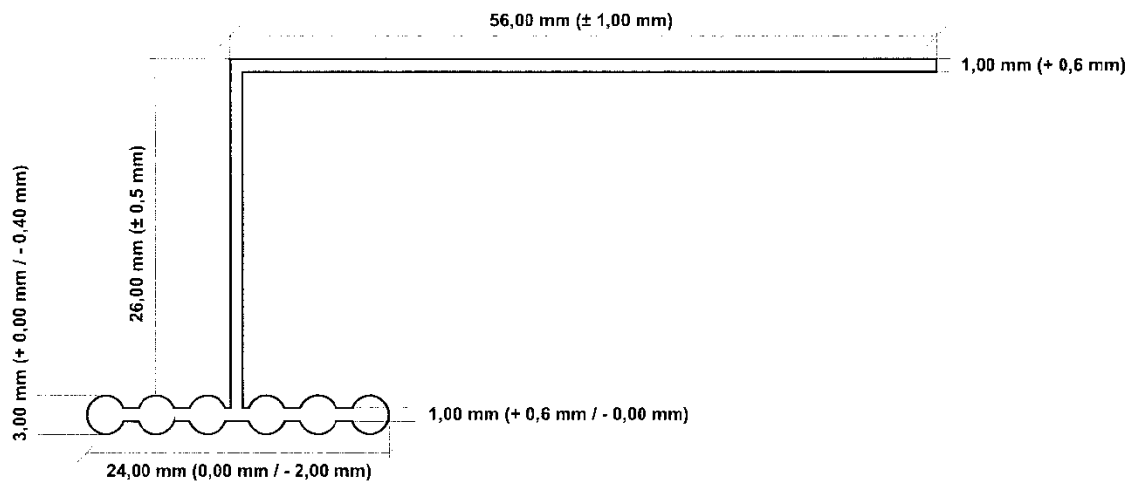

Vertical connection profile – "Sto-Verbindungsleiste Alu"

Length: 470 mm

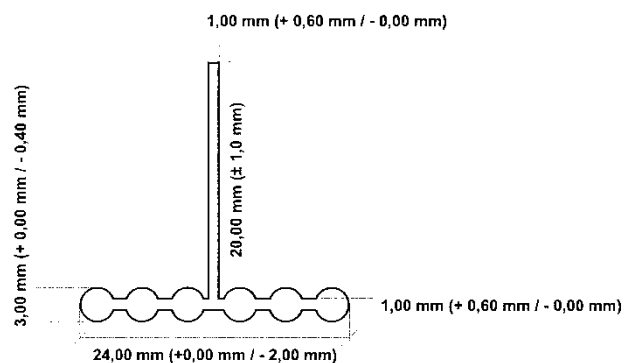

Annex No. 4: Reinforcement (glass fibre mesh)

Characteristics (alkali resistance): pass

	Description	Residual strength after ageing [N/mm]	Relative residual strength after ageing, of the strength in the as-delivered state [%]
"Sto-Glasfasergewebe"	Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 6.0 mm x 6.0 mm	≥ 20	≥ 50
"Sto-Glasfasergewebe F"	Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 4.0 mm x 4.0 mm	≥ 20	≥ 50
"Sto-Abschirmgewebe AES"	(special mesh including a thin stainless yarn to reduce radiation of electric fields) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 165 g/m ² and mesh size of about 4.0 mm x 4.0 mm.	≥ 20	≥ 50
"Sto-Panzergewebe"	(reinforced mesh implemented in addition to the meshes described above to improve the impact resistance) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 450 g/m ² and mesh size of about 7.5 mm x 7.5 mm	≥ 20	≥ 50