



Approval body for construction products and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and Laender Governments



European Technical Assessment

ETA-13/0259 of 27 November 2017

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Berner aircrete anchor BPX-I

Metal expansion fastener for use in autoclaved aerated concrete

Berner Trading Holding GmbH Bernerstraße 6 74653 Künzelsau DEUTSCHLAND

Berner Herstellwerk 6 Berner manufacturing plant 6

12 pages including 3 annexes which form an integral part of this assessment

EAD 330014-00-0601

Deutsches Institut für Bautechnik Kolonnenstraße 30 B | 10829 Berlin | GERMANY | Phone: +49 30 78730-0 | Fax: +49 30 78730-320 | Email: dibt@dibt.de | www.dibt.de



European Technical Assessment ETA-13/0259

Page 2 of 12 | 27 November 2017

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 12 | 27 November 2017

Specific Part

1 Technical description of the product

The Berner aircrete anchor BPX-I is a deformation controlled expansion anchor made of galvanised steel. The anchor consists of an internal threaded socket, a cone bolt and an expansion sleeve. The anchor transfers loads into autoclaved aerated concrete via mechanical interlock.

The anchor is set into a predrilled bore hole and anchored with a hexagon installation tool until the installation tool is pushed out of the internal hexagon socket. The fixture is installed with a screw-in part (threaded rods or screw).

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Resistance in any load direction without lever arm	See Annex C 1
Resistance in any load direction with lever arm	See Annex C 1
Spacing, edge distance, member thickness	See Annex B 3 and B 4
Displacements	See Annex C 2
Durability	Durability is ensured if the specifications of intended use according to Annex B are taken into account.

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	The anchor satisfy requirements for Class A1
Resistance to fire	No performance assessed



Page 4 of 12 | 27 November 2017

European Technical Assessment ETA-13/0259

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330014-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1


5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 27 November 2017 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow Head of Department *beglaubigt:* Baderschneider



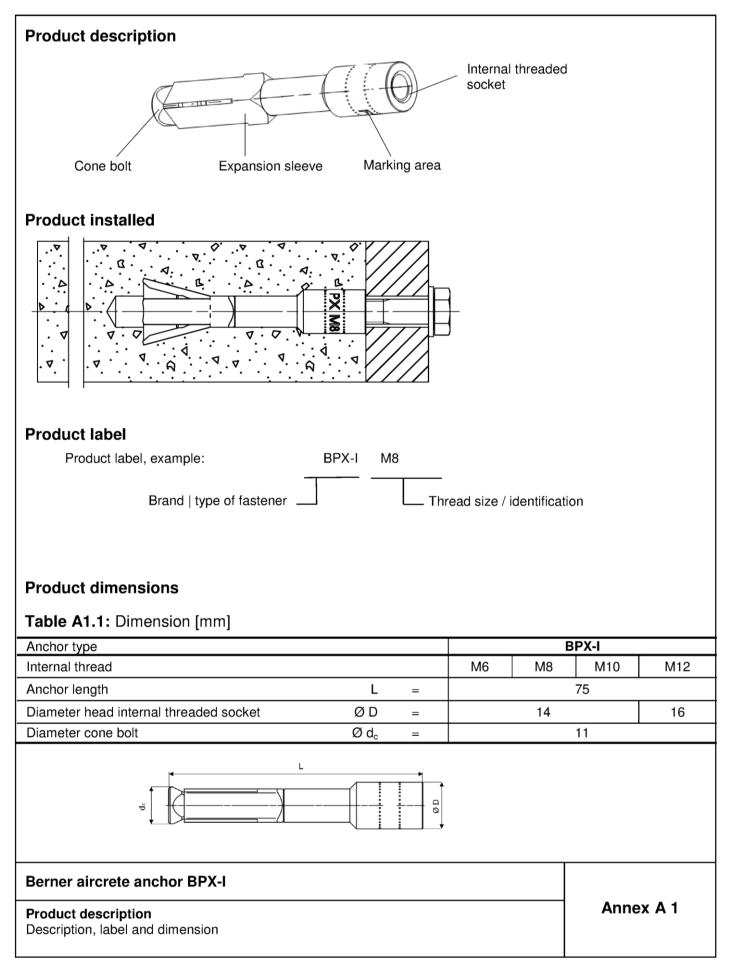

Page 6 of European Technical Assessment ETA-13/0259 of 27 November 2017

English translation prepared by DIBt




	Specifications of i	ntended us	se		
Berner aircrete anchor BF	PX-I	M6	M8	M10	M12
Galvanized steel					
Static and quasi-static loa	lds	1		/	
Cracked and uncracked A	utoclaved Aerated Concrete (AAC)	1			
Base material:					
	s (uncracked slabs are included) accord	ng to FN 126	02·2016 of		
strength class $f_{AAC} \ge 3,3$	S N/mm ² with dry density $\rho_m \ge 0,50$ kg/dm N/mm ² with dry density $\rho_m \ge 0,55$ kg/dm	³ and			
Uncracked reinforced sl	abs according to EN 12602:2016 of				
strength class $f_{AAC} \ge 1,6$	0 N/mm ² with dry density $ρ_m ≥ 0,25$ kg/dm 0 N/mm ² with dry density $ρ_m ≥ 0,65$ kg/dm				
Masonry units according	g to EN 771-4: 2003 of				
strength class $f_{AAC} \ge 1,6$	N/mm ² with dry density $\rho_m \ge 0,25$ kg/dm N/mm ² with dry density $\rho_m \ge 0,65$ kg/dm				
The mortar strength class	ss of the masonry has to be M 2,5 accord	ding to EN 99	8-2:2010 at r	ninimum	
Use conditions (Enviror	nmental conditions):	C			
	y internal conditions (BPX-I)				
	esigned under the responsibility of an en	gineer experie	enced in anc	horages and	concrete
 and masonry work Verifiable calculation no position of the anchor is Design of fastenings according to the second s	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B.			-	
 and masonry work Verifiable calculation no position of the anchor is Design of fastenings acc Table B1.1: Material 	tes and drawings are to be prepared tak to be indicated on the design drawings	ing account ir		-	
and masonry work Verifiable calculation no position of the anchor is Design of fastenings acc Table B1.1: Material Designation	otes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B.	ing account in		-	
and masonry work Verifiable calculation no position of the anchor is Design of fastenings acc Table B1.1: Material Designation	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; $f_{uk} \ge 800 \text{ N/mm}^2$, $f_{yk} \ge$	ing account in		-	
and masonry work • Verifiable calculation no position of the anchor is • Design of fastenings acc Table B1.1: Material Designation Cone bolt ¹⁾ Expansion sleeve ¹⁾	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; $f_{uk} \ge 800 \text{ N/mm}^2$, $f_{yk} \ge$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$	ing account in		-	
and masonry work • Verifiable calculation no position of the anchor is • Design of fastenings acc Table B1.1: Material Designation Cone bolt ¹⁾ Expansion sleeve ¹⁾ Internal threaded bolt ¹⁾	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; $f_{uk} \ge 800 \text{ N/mm}^2$, $f_{yk} \ge$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$	BPX-I 640 N/mm ²	the loads to	-	
and masonry work • Verifiable calculation no position of the anchor is • Design of fastenings acc Table B1.1: Material Designation Cone bolt ¹⁾ Expansion sleeve ¹⁾ Internal threaded bolt ¹⁾ Screw-in-parts ^{1, 2)}	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; $f_{uk} \ge 800 \text{ N/mm}^2$, $f_{yk} \ge$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$ Minimum steel strength class 4.8, D	BPX-I 640 N/mm ²	the loads to	-	
and masonry work • Verifiable calculation no position of the anchor is • Design of fastenings acc Table B1.1: Material Designation Cone bolt ¹⁾ Expansion sleeve ¹⁾ Internal threaded bolt ¹⁾ Screw-in-parts ^{1, 2)} ¹⁾ Galvanized according to	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; $f_{uk} \ge 800 \text{ N/mm}^2$, $f_{yk} \ge$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$ $f_{uk} \ge 450 \text{ N/mm}^2$, $f_{yk} \ge 360 \text{ N/mm}^2$ Minimum steel strength class 4.8, D	BPX-I 640 N/mm ²	the loads to	be anchored	d. The
and masonry work • Verifiable calculation no position of the anchor is • Design of fastenings acc Table B1.1: Material Designation Cone bolt ¹⁾ Expansion sleeve ¹⁾ Internal threaded bolt ¹⁾ Screw-in-parts ^{1, 2)} ¹⁾ Galvanized according to ²⁾ Screw-in parts (screws)	tes and drawings are to be prepared tak to be indicated on the design drawings cording to TR 054, Design Method B. Steel strength; f _{uk} ≥ 800 N/mm ² , f _{yk} ≥ f _{uk} ≥ 450 N/mm ² , f _{yk} ≥ 360 N/mm ² f _{uk} ≥ 450 N/mm ² , f _{yk} ≥ 360 N/mm ² Minimum steel strength class 4.8, D to EN ISO 4042, ≥ 5 μm and threaded rods including nuts and wa	BPX-I 640 N/mm ²	the loads to	be anchored	d. The



Table B2.1: Installation paramete	ers								
Size					BPX-I				
Size					M6	M8	M10	M12	
Nominal drill hole diameter		d ₀	=			1	0		
Maximum drill bit diameter		d _{cut}	\leq			10	,45		
Double of defilies to do up of a sint	with cleaning ¹⁾			[80				
Depth of drill hole to deepest point	without cleaning		\geq	[mm]	95				
Diameter of clearance hole in the fixture		d _f	\leq		7	9	12	14	
Effective embedment depth		h _{ef}	=		70				
Maximum fastening torque ²⁾		T _{max}		[Nm]		;	3		
Screw-in depth internal thread		l _{s,min}		[mm]	6	8	10	12	
Screw-in depth internal thread		I _{s,max}		[iiiii]		1	5		

¹⁾ For member thickness h < 120 mm the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall

²⁾ If the anchor cannot retain against the fixture no installation torque may be applied ($T_{max} = 0 \text{ Nm}$)

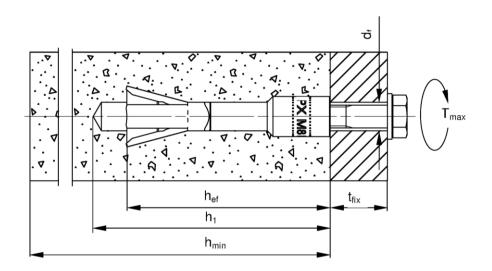

- h_{ef} = Effective embedment depth
- t_{fix} = Thickness of fixture
- h_1 = Depth of drill hole to deepest point
- h_{min} = Minimum thickness of AAC member
- T_{max} = Maximum setting torque
- d_f = Diameter of clearance hole in the fixture

Berner aircrete anchor BPX-I

Intended use

Installation parameters

Annex B 2



Table B3.1: Minimum member thickness, minimum spacing and edge distance in AAC - slabs										
Size					BPX-I M6 M8 M10					
Minimum thickness of AAC clab	with cleaning ¹⁾	h		100						
Minimum thickness of AAC - slab	without cleaning	- h _{min}		120						
Minimum spacing		S _{min}		100						
Minimum odgo distanco	single anchor ²⁾		[mm]	125 ⁵⁾						
Minimum edge distance	anchor groups ³⁾	- C ₁	[]		2	50				
Minimum edge distance, orthogonal	stance, orthogonal to c1			1,5 x c ₁						
Minimum analoing batwaan	single anchors	-			6	00				
Minimum spacing between	anchors groups ^{3) 4)}	- a		750						


¹⁾ For member thickness h < 120 mm the drill dust has to be cleaned out of the hole and the depth of the drill hole has to be reduced to 80 mm in order to avoid damage on the opposite side of the slab

²⁾ Maximum 2 single anchors in the same formation as anchor groups. For 2 single anchors with spacing smaller than 600 mm $(s_{min} \ge 100 \text{ mm})$ the same spacing in between and edge distances (a; c₁) like for the anchor group are valid

³⁾ For exclusive tension loads the spacing and edge distances for groups can be reduced to the spacing and edge distances of single anchors

⁴⁾ If there is no (free) edge, or the edge distance is ≥ a, the spacing between anchor groups can be reduced to the spacing between single anchors

⁵⁾ The edge distance of reinforced slabs with a width \leq 700 mm has to be \geq 150 mm

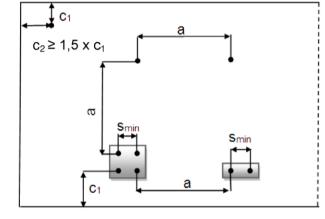

a ... a . hmin

Berner aircrete anchor BPX-I

Intended use

Minimum member thickness, minimum spacing and edge distance in AAC slabs

Annex B 3



Table B4.1: Minimum member thickness, minimum spacing and edge distance in AAC masonry

indeein y							
Size					BP	X-I	
Size				M6	M8	M10	M12
Minimum thickness of AAC -	with cleaning ¹⁾	– h					
masonry	without cleaning	– h _{min}		120		20	
Minimum spacing		S _{min}		100			
Minimum distance to non-filled jo	ints, single anchor	CF		0 ⁵⁾ / 75 ⁶⁾ / 125 ⁷⁾			
Minimum edge distance	single anchor ²⁾	- 0	[mm]	125			
Minimum edge distance	anchor groups ³⁾	- C ₁					
Minimum edge distance, orthogo	nal to c ₁	C ₂		1,5 x c ₁			
Minimum spacing between	single anchors ²⁾				37	75	
winning between	anchors groups ^{3) 4)}	- a			75	50	

¹⁾ For member thickness h < 120 mm, the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall

²⁾ Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than 375 mm (s_{min} \ge 100 mm) the same spacing in between and edge distances (a; c₁) like for the anchor group are valid


³⁾ For exclusive tension loads the spacing and edge distances of anchor groups can be reduced to the spacing and edge distances of single anchors

⁴⁾ If there is no edge, or the edge distance is \geq a, the spacing between anchor groups can be reduced to the spacing between single anchors

⁵⁾ For joints completely filled with mortar and a joint width ≤ 12 mm and a compressive strength according to EN 998-2 ≥ f_{AAC} AAC no distances to joints are required

⁶⁾ c_F for only tension and /or shear loads parallel to the joints which are not filled with mortar and a joint width $\leq 2 \text{ mm}$

⁷⁾ $c_F = c_1$ for shear load or with a part of the load orthogonal to the jont which are not filled with mortar and a joint width ≥ 0 mm

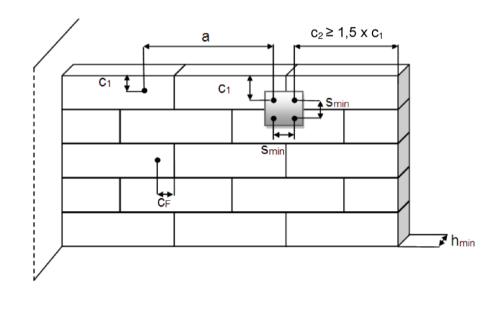

Berner aircrete anchor BPX-I

Intended use


Minimum member thickness, minimum spacing and edge distance in AAC masonry

Annex B 4



Installation instruction

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Use of the anchor only as supplied by the manufacturer without exchanging the components of the anchor
- Checking before placing the anchor to ensure that the strength class of the aircrete in which the anchor is to be placed is in the range given and is not lower than that of the aircrete to which the characteristic loads apply
- · Drill hole created perpendicular +/- 5° to AAC surface, positioning without damaging the reinforcement
- In case of aborted hole: New drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with non-shrinkage, high strength mortar (pressure strength ≥ 30 N/mm²) and if under shear or oblique tension load it is not the direction of the load application

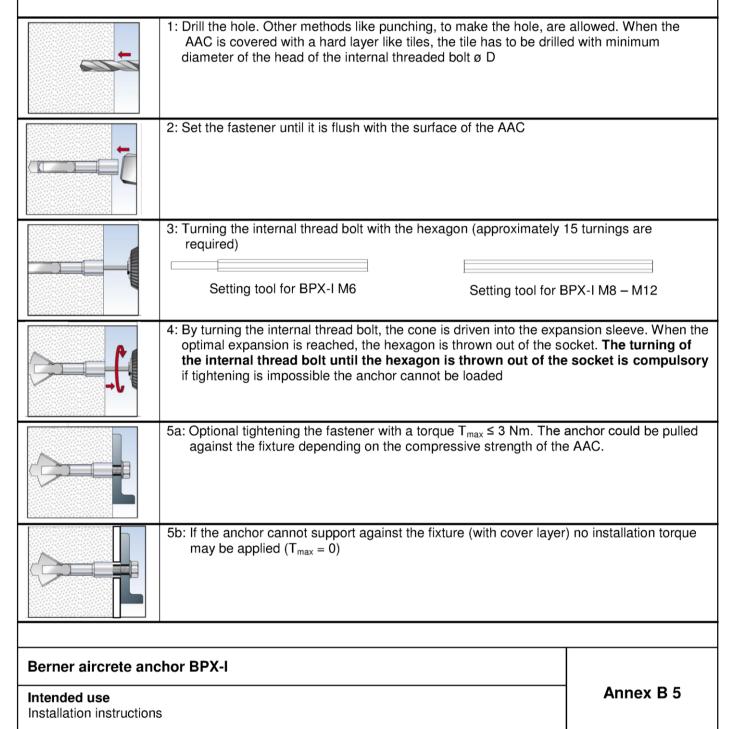

Deutsches Institut für Bautechnik

2			BPX-I			
Size			M6	M8	M10	M12
Single anchor in AAC - slabs ¹⁾						
Characteristic resistance in cracked AAC -	$f_{AAC} \ge 3,3, \rho_m$	≥ 0,50			,5	
Slabs F _{Rk} [kN] -	$f_{AAC} \ge 4,4, \rho_m$	≥ 0,55			,0	
Characteristic resistance in uncracked AAC -	$f_{AAC} \ge 3,3, \rho_m$,0	
slabs	$f_{AAC} \ge 4,4, \rho_m$	≥ 0,55 2)			,0	
Partial safety factor for AAC - slabs	<u>`</u>	MAAC ²		1,	73	
Single anchor in AAC - masonry ¹⁾					-	
Characteristic resistance in AAC - masonry ³⁾	$f_{AAC} \ge 1, 6, \rho_m$,9	
F_{Rk} [kN] =	$f_{AAC} \ge 2,0, \rho_m$,2	
ntermediate values by linear interpolation	$f_{AAC} \ge 4,0, \rho_m$,5	
· · ·	$f_{AAC} \ge 6,0, \rho_m$,0	
Partial safety factor for AAC - masonry	γμαα	с ²⁾		2	,0	
Single anchor in AAC - slabs and AAC - masonry ¹⁾						
Obevectovictic beveling variatorics with	_	4.8	6	15	30	52
Characteristic bending resistance with ever arm in combination with screw / ISO 898-1: 2013	M _{Rk,s} [Nm] -	5.8	8	19	37	65
hreaded rod complying with:		6.8	9	23	44	78
		8.8	12	30	60	105
Partial safety factor for AAC - masonry		γMs			25	
Anchor groups in cracked and uncracked AAC - slabs a	and AAC - mas	onry w	ith n = 2	to n = 4	anchor	s ³⁾
Characteristic resistance for $n = 2$, $n = 4^{4}$				2 x	F _{Rk}	
$s_{min} \ge 100 \text{ mm}, c_1 \ge 250 \text{ mm}^{-5}$	$F_{Rk,n}$.		Z A	ЧК	
Characteristic resistance for $n \ge 3$	T tix,	[kN]		n x	F _{Bk}	
s _{min} ≥ 140 mm, c _{min, anchor group} ≥ 700 mm ⁵⁾ Characteristic resistance redundancy						
when the joints are not visible $5^{(1)}$	$F_{Rk,n,Redundancy}$			0,5 x	F _{Rk,n}	
Partial safety factor for AAC - slabs	γ	MAAC ²⁾		1,	73	
Partial safety factor for AAC - masonry		MAAC ²⁾		2	,0	
¹⁾ Maximum 2 single anchors in the same formation as the anchor ($s_{min} \ge 100 \text{ mm}$) the characteristic resistance of the anchor group ²⁾ The installation safety factor $\gamma_2 = 1,0$ is included ³⁾ The evaluation of N _{Rk,pb} according to TR 054, Section 4.2.1.5 is ⁴⁾ Rectangular arrangement according to drawing Annex B3 and E ⁵⁾ Only for multiple use according to ETAG 001 Part 6 The characteristic strength class f _{AAC} [N/mm ²] and the chara EN 771-4:2011+A1:2015 for AAC - masonry and EN 12602	p is decisive necessary. The s 34 acteristic dry de	smaller ν ensity ρ _n	alue of N _f	Rk,pb and F	Rk is decis	sive

Berner aircrete anchor BPX-I

Performances

Characteristic resistance for all load directions

Annex C 1



Table C2.1: Displacement under tension loads, shear loads and oblique loads in AAC ¹⁾						
Size		E M6 M8	BPX-I M10 M12			
Displacement tension load in cracked AAC	δ _{N0} [mm]		1,0			
for all AAC strength classes	δ _№ [mm]		2,0			
Displacement tension load in uncracked AAC for all AAC	δ_{N0} [mm]] 1,0				
strength classes	δ _№ ∞ [mm]		1,0			
Displacement shear load in cracked and uncracked	δ_{V0} [mm]		2,5			
Displacement shear load in cracked and uncracked AAC $f_{AAC} = 1,6 - \rho_m \ge 0,25^{-2}$	$\delta_{V\infty}$ [mm]	3,7				
Displacement shear load in cracked and uncracked	δ_{V0} [mm]		5,0			
AAC $f_{AAC} \ge 6,0 - \rho_m \ge 0,65^{-2}$	$\delta_{V\infty}$ [mm]		7,3			

 $^{1)}$ Displacement at service load level $F_{Bk}/\left(\gamma_{MAAC}\,x\,\,1,4\right)$ $^{2)}$ Intermediate values by linear interpolation, taking in account the AAC strength

Berner aircrete anchor BPX-I

Annex C 2