



Approval body for construction products and types of construction

**Bautechnisches Prüfamt** 

An institution established by the Federal and Laender Governments



# **European Technical Assessment**

ETA-13/0260 of 27 November 2017

English translation prepared by DIBt - Original version in German language

#### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

BTI aircrete anchor BPX-I

Metal expansion fastener for use in autoclaved aerated concrete

BTI Befestigungstechnik GmbH & Co. KG Salzstraße 51 74653 Ingelfingen DEUTSCHLAND

BTI Herstellwerk 1 BTI manufacturing plant 1

12 pages including 3 annexes which form an integral part of this assessment

EAD 330014-00-0601



# European Technical Assessment ETA-13/0260

Page 2 of 12 | 27 November 2017

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



European Technical Assessment ETA-13/0260

Page 3 of 12 | 27 November 2017

English translation prepared by DIBt

## **Specific Part**

## 1 Technical description of the product

The BTI aircrete anchor BPX-I is a deformation controlled expansion anchor made of galvanised steel. The anchor consists of an internal threaded socket, a cone bolt and an expansion sleeve. The anchor transfers loads into autoclaved aerated concrete via mechanical interlock.

The anchor is set into a predrilled bore hole and anchored with a hexagon installation tool until the installation tool is pushed out of the internal hexagon socket. The fixture is installed with a screw-in part (threaded rods or screw).

The product description is given in Annex A.

# 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

## 3 Performance of the product and references to the methods used for its assessment

## 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Resistance in any load direction without lever arm	See Annex C 1
Resistance in any load direction with lever arm	See Annex C 1
Spacing, edge distance, member thickness	See Annex B 3 and B 4
Displacements	See Annex C 2
Durability	Durability is ensured if the specifications of intended use according to Annex B are taken into account.

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	The anchor satisfy requirements for Class A1
Resistance to fire	No performance assessed





# European Technical Assessment ETA-13/0260

Page 4 of 12 | 27 November 2017

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330014-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 27 November 2017 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow Head of Department


beglaubigt: Baderschneider






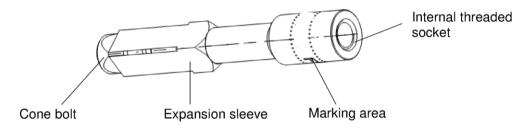

# **Product installed**

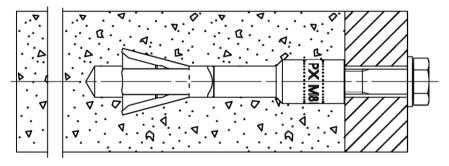


# **Product label**



# **Product dimensions**

# Table A1.1: Dimension [mm]

Anchor type			BPX-I				
Internal thread			M6	M8	M10	M12	
Anchor length	L	=	75				
Diameter head internal threaded socket	ØD	=	14 16				
Diameter cone bolt	Ø d <sub>c</sub>	=	11				



BTI aircrete anchor BPX-I	
Product description Description, label and dimension	Annex A 1

8.06.01-426/17

Z61947.17



Specifications of intended use						
BTI aircrete anchor BPX-I	M6	M8	M10	M12		
Galvanized steel						
Static and quasi-static loads	/					
Cracked and uncracked Autoclaved Aerated Concrete (AAC)						

#### Base material:

- Cracked reinforced slabs (uncracked slabs are included) according to EN 12602:2016 of strength class  $f_{AAC} \ge 3,3$  N/mm² with dry density  $\rho_m \ge 0,50$  kg/dm³ and strength class  $f_{AAC} \ge 4,4$  N/mm² with dry density  $\rho_m \ge 0,55$  kg/dm³
- Uncracked reinforced slabs according to EN 12602:2016 of strength class  $f_{AAC} \ge 1,6 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,25 \text{ kg/dm}^3$  to strength class  $f_{AAC} \ge 6,0 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,65 \text{ kg/dm}^3$
- Masonry units according to EN 771-4: 2003 of strength class  $f_{AAC} \ge 1,6 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,25 \text{ kg/dm}^3$  to strength class  $f_{AAC} \ge 6,0 \text{ N/mm}^2$  with dry density  $\rho_m \ge 0,65 \text{ kg/dm}^3$
- The mortar strength class of the masonry has to be M 2,5 according to EN 998-2:2010 at minimum

#### **Use conditions (Environmental conditions):**

· Structures subject to dry internal conditions (BPX-I)

#### Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete and masonry work
- Verifiable calculation notes and drawings are to be prepared taking account in the loads to be anchored. The
  position of the anchor is to be indicated on the design drawings
- · Design of fastenings according to TR 054, Design Method B.

# Table B1.1: Material

Designation	BPX-I
Cone bolt 1)	Steel strength; f <sub>uk</sub> ≥ 800 N/mm², f <sub>yk</sub> ≥ 640 N/mm²
Expansion sleeve 1)	$f_{uk} \ge 450 \text{ N/mm}^2, f_{yk} \ge 360 \text{ N/mm}^2$
Internal threaded bolt 1)	$f_{uk} \ge 450 \text{ N/mm}^2, f_{yk} \ge 360 \text{ N/mm}^2$
Screw-in-parts <sup>1, 2)</sup>	Minimum steel strength class 4.8, DIN EN ISO 898-1

<sup>1)</sup> Galvanized according to EN ISO 4042, ≥ 5 μm


BTI aircrete anchor BPX-I	
Intended use Specifications	Annex B 1

<sup>&</sup>lt;sup>2)</sup> Screw-in parts (screws and threaded rods including nuts and washer) must comply with the specification in Annex C1.



Table B2.1: Installation paramete	rs								
Size						BPX-I			
Size					М6	М8	M10	M12	
Nominal drill hole diameter		$d_0$	=		10				
Maximum drill bit diameter		$d_{\text{cut}}$	<b>S</b>	[	10,45				
Depth of drill hole to deepest point	with cleaning 1)	- b	≥	[mm]	80				
	without cleaning	— n₁ J				9	5		
Diameter of clearance hole in the fixture		d <sub>f</sub>	<u> </u>	[	7	9	12	14	
Effective embedment depth		h <sub>ef</sub>	=		70				
Maximum fastening torque 2)		$T_{max}$		[Nm]		(	3		
Screw-in depth internal thread		$I_{s,min}$		[mm]	6	8	10	12	
Screw-in depth internal thread		1		- [mm]	15				

<sup>1)</sup> For member thickness h < 120 mm the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall  $^{2)}$  If the anchor cannot retain against the fixture no installation torque may be applied ( $T_{max} = 0 \text{ Nm}$ )

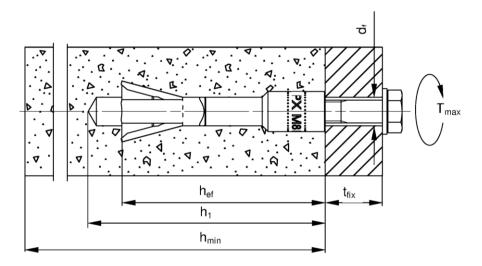

Effective embedment depth h<sub>ef</sub>

Thickness of fixture  $t_{fix}$ 

Depth of drill hole to deepest point h₁ Minimum thickness of AAC member  $h_{\mathsf{min}}$ 

Maximum setting torque  $T_{\text{max}}$ 

Diameter of clearance hole in the fixture

BTI aircrete anchor BPX-I	
Intended use Installation parameters	Annex B 2

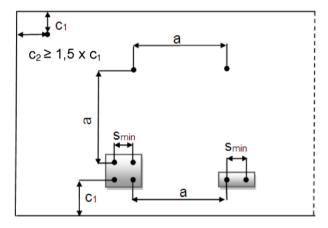



Table B3.1: Minimum member thickness, minimum spacing and edge distance in AAC - slabs

					BPX-I				
Size			М6	M8	M10	M12			
with cleaning 1)		h		100					
Minimum thickness of AAC - slab -	without cleaning	– h <sub>min</sub>		120					
Minimum spacing		S <sub>min</sub>	nin 100						
Minimum adaa distance	single anchor <sup>2)</sup>		[mm]	125 <sup>5)</sup>					
Minimum edge distance	anchor groups 3)	- C <sub>1</sub>		250					
Minimum edge distance, orthogonal to c₁		$C_2$		1,5 x c <sub>1</sub>					
Minimum spacing between	single anchors				60	00			
	anchors groups 3) 4)	- a		750					

<sup>1)</sup> For member thickness h < 120 mm the drill dust has to be cleaned out of the hole and the depth of the drill hole has to be reduced to 80 mm in order to avoid damage on the opposite side of the slab

<sup>&</sup>lt;sup>5)</sup> The edge distance of reinforced slabs with a width  $\leq$  700 mm has to be  $\geq$  150 mm





BTI aircrete anchor BPX-I	
Intended use Minimum member thickness, minimum spacing and edge distance in AAC slabs	Annex B 3

<sup>&</sup>lt;sup>2)</sup> Maximum 2 single anchors in the same formation as anchor groups. For 2 single anchors with spacing smaller than 600 mm (s<sub>min</sub> ≥ 100 mm) the same spacing in between and edge distances (a; c<sub>1</sub>) like for the anchor group are valid

For exclusive tension loads the spacing and edge distances for groups can be reduced to the spacing and edge distances of single anchors

<sup>&</sup>lt;sup>4)</sup> If there is no (free) edge, or the edge distance is ≥ a, the spacing between anchor groups can be reduced to the spacing between single anchors



**Table B4.1:** Minimum member thickness, minimum spacing and edge distance in AAC - **masonry** 

Size			BPX-I						
0120				М6	M8	M10	M12		
Minimum thickness of AAC - with cleaning 1)		h		100					
masonry	without cleaning	cleaning		120					
Minimum spacing		S <sub>min</sub>							
Minimum distance to non-filled joints, single anchor		CF		0 <sup>5)</sup> / 75 <sup>6)</sup> / 125 <sup>7)</sup>					
Minimum edge distance single anchor 2)			[mm]	125					
Williman eage distance	anchor groups 3)	- c <sub>1</sub>	_	250					
Minimum edge distance, orthogonal to c <sub>1</sub>		$c_2$		1,5 x c <sub>1</sub>					
Minimum spacing between	single anchors <sup>2)</sup>				37	75			
willimum spacing between	anchors groups 3) 4)	а		750					

<sup>1)</sup> For member thickness h < 120 mm, the drill hole shall be cleaned and the depth of the drill hole shall be reduced to 80 mm in order to avoid damage on the opposite side of the wall


For exclusive tension loads the spacing and edge distances of anchor groups can be reduced to the spacing and edge distances of single anchors

<sup>4)</sup> If there is no edge, or the edge distance is ≥ a, the spacing between anchor groups can be reduced to the spacing between single anchors

5) For joints completely filled with mortar and a joint width ≤ 12 mm and a compressive strength according to EN 998-2 ≥ f<sub>AAC</sub> AAC no distances to joints are required

 $^{6)}$  C<sub>F</sub> for only tension and /or shear loads parallel to the joints which are not filled with mortar and a joint width  $\leq 2$  mm

 $^{7)}$  c<sub>F</sub> = c<sub>1</sub> for shear load or with a part of the load orthogonal to the jont which are not filled with mortar and a joint width  $\geq$  0 mm

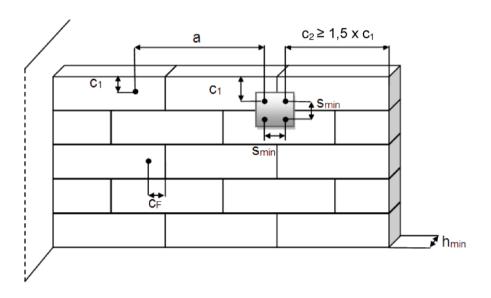


BTI aircrete anchor BPX-I	
Intended use Minimum member thickness, minimum spacing and edge distance in AAC masonry	Annex B 4

<sup>&</sup>lt;sup>2)</sup> Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than 375 mm (s<sub>min</sub> ≥ 100 mm) the same spacing in between and edge distances (a; c<sub>1</sub>) like for the anchor group are valid




## Installation instruction


- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Use of the anchor only as supplied by the manufacturer without exchanging the components of the anchor
- Checking before placing the anchor to ensure that the strength class of the aircrete in which the anchor is to be placed is in the range given and is not lower than that of the aircrete to which the characteristic loads apply
- Drill hole created perpendicular +/- 5° to AAC surface, positioning without damaging the reinforcement
- In case of aborted hole: New drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with non-shrinkage, high strength mortar (pressure strength ≥ 30 N/mm²) and if under shear or oblique tension load it is not the direction of the load application



1: Drill the hole. Other methods like punching, to make the hole, are allowed. When the AAC is covered with a hard layer like tiles, the tile has to be drilled with minimum diameter of the head of the internal threaded bolt ø D




2: Set the fastener until it is flush with the surface of the AAC




3: Turning the internal thread bolt with the hexagon (approximately 15 turnings are required)

Setting tool for BPX-I M6


Setting tool for BPX-I M8 - M12



4: By turning the internal thread bolt, the cone is driven into the expansion sleeve. When the optimal expansion is reached, the hexagon is thrown out of the socket. The turning of the internal thread bolt until the hexagon is thrown out of the socket is compulsory if tightening is impossible the anchor cannot be loaded



5a: Optional tightening the fastener with a torque  $T_{max} \le 3$  Nm. The anchor could be pulled against the fixture depending on the compressive strength of the AAC.



5b: If the anchor cannot support against the fixture (with cover layer) no installation torque may be applied  $(T_{\text{max}} = 0)$ 

# BTI aircrete anchor BPX-I Intended use Installation instructions Annex B 5

English translation prepared by DIBt



Table C1.1: Characteristic resistance for all load directions							
Size			BPX-I				
			М6	М8	M10	M12	
Single anchor in AAC - slabs 1)							
Characteristic resistance in cracked AAC -	$-F_{Rk} [kN] = \begin{cases} f_{AAC} \ge 3,3, \ \rho_m \ge 0,50 \\ \hline f_{AAC} \ge 4,4, \ \rho_m \ge 0,55 \\ \hline f_{AAC} \ge 3,3, \ \rho_m \ge 0,50 \\ \hline f_{AAC} \ge 4,4, \ \rho_m \ge 0,55 \end{cases}$		1,5				
slabs E (IAN)			2,0				
Characteristic resistance in uncracked AAC -			2,0				
slabs			3,0				
Partial safety factor for AAC - slabs	)	MAAC 2)		1,	73		
Single anchor in AAC - masonry 1)							
2)	$f_{AAC} \ge 1.6, \rho_{m} \ge 0.25$		0,9				
Characteristic resistance in AAC - masonry $\frac{1}{9}$ $\frac{1}{1000}$ $$	≥ 0,35		1	,2			
Intermediate values by linear interpolation —	$F_{Rk}[KN] = f_{res} > 4.0 \circ > 0.50$	2,5					
— intermediate values by linear interpolation	thermediate values by linear interpolation $\frac{-1000}{f_{AAC} \ge 6.0,  \rho_m \ge 0.65}$		4,0				
Partial safety factor for AAC - masonry	ΥΜΑΑ	2)		2	,0		
Single anchor in AAC - slabs and AAC - masonry 1)							
		4.8	6	15	30	52	
Characteristic bending resistance with lever arm in combination with screw / ISO 898-1: 2013	M <sub>Rk,s</sub> [Nm] –	5.8	8	19	37	65	
lever arm in combination with screw / ISO 898-1: 2013 threaded rod complying with:		6.	6.8	9	23	44	78
threaded fod complying with.			_	8.8	12	30	60
Partial safety factor for AAC - masonry		γ̃Ms		1,	25		
Anchor groups in cracked and uncracked AAC - slabs a	nd AAC - mas	onry w	ith n = 2	to n = 4	anchors	<sup>3)</sup>	
Characteristic resistance for $n = 2$ , $n = 4^{4}$ $s_{min} \ge 100$ mm, $c_1 \ge 250$ mm $s_0^{5}$	F <sub>Rk,n</sub> [kN]		2 x F <sub>Rk</sub>				
Characteristic resistance for $n \ge 3$ $s_{min} \ge 140$ mm, $c_{min, anchor group} \ge 700$ mm <sup>5)</sup>			n x F <sub>Rk</sub>				
Characteristic resistance redundancy when the joints are not visible 5)	F <sub>Rk,n,Redundancy</sub>			0,5 x			
Partial safety factor for AAC - slabs	γ	MAAC 2)			73		
Partial safety factor for AAC - masonry	γ	MAAC 2)		2,	,0		

<sup>1)</sup> Maximum 2 single anchors in the same formation as the anchor groups. For 2 single anchors with spacing smaller than a  $(s_{min} \ge 100 \text{ mm})$  the characteristic resistance of the anchor group is decisive <sup>2)</sup> The installation safety factor  $\gamma_2 = 1,0$  is included <sup>3)</sup> The evaluation of  $N_{Rk,pb}$  according to TR 054, Section 4.2.1.5 is necessary. The smaller value of  $N_{Rk,pb}$  and  $F_{Rk}$  is decisive

The characteristic strength class  $f_{AAC}$  [N/mm²] and the characteristic dry density  $\rho_m$  [kg/dm³] have to comply with EN 771-4:2011+A1:2015 for AAC - masonry and EN 12602:2016 for AAC - slabs

BTI aircrete anchor BPX-I	
Performances Characteristic resistance for all load directions	Annex C 1

<sup>4)</sup> Rectangular arrangement according to drawing Annex B3 and B4

<sup>&</sup>lt;sup>5)</sup> Only for multiple use according to ETAG 001 Part 6



Table C2.1: Displacement under tension loads, shear loads and oblique loads in AAC 1)

Size		BPX-I M6   M8   M10   M12
Displacement tension load in <b>cracked</b> AAC for all AAC strength classes	$\frac{\delta_{\text{N0}} [\text{mm}]}{\delta_{\text{N}\infty} [\text{mm}]}$	1,0 2,0
Displacement tension load in <b>uncracked</b> AAC for all AAC strength classes	$\frac{\delta_{\text{N0}} \text{ [mm]}}{\delta_{\text{N}\infty} \text{ [mm]}}$	1,0 1,0
Displacement shear load in <b>cracked and uncracked</b> AAC $f_{AAC} = 1,6 - \rho_m \ge 0,25$	$\frac{\delta_{\text{V0}}[\text{mm}]}{\delta_{\text{V}\infty}[\text{mm}]}$	2,5 3,7
Displacement shear load in <b>cracked and uncracked</b> AAC $f_{AAC} \ge 6,0-\rho_m \ge 0,65^{\ 2)}$	$\frac{\delta_{\text{V0}}[\text{mm}]}{\delta_{\text{V}\infty}[\text{mm}]}$	5,0 7,3

BTI aircrete anchor BPX-I			
Performances Displacements under tension, shear loads and oblique loads	Annex C 2		

 $<sup>^{1)}</sup>$  Displacement at service load level F<sub>Rk</sub>/  $(\gamma_{MAAC}\,x\,1,4)$   $^{2)}$  Intermediate values by linear interpolation, taking in account the AAC strength