

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-15/0435
of 21 December 2017

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Hilti metal expansion anchor HST2 and HST2-R

Product family
to which the construction product belongs

Mechanical fastener for use in concrete

Manufacturer

Hilti AG
Feldkircherstraße 100
9494 Schaan
FÜRSTENTUM LIECHTENSTEIN

Manufacturing plant

Hilti Aktiengesellschaft

This European Technical Assessment
contains

25 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330232-00-0601

This version replaces

ETA-15/0435 issued on 7 August 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The Hilti metal expansion anchor HST2 and HST2-R is an anchor made of galvanized steel (HST2) or stainless steel (HST2-R) which is placed into a drilled hole and anchored by torque controlled expansion.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance under static and quasi-static loading, displacements	See Annex C1 to C4
Characteristic resistance for seismic performance category C1, displacements	See Annex C5 to C6
Characteristic resistance for seismic performance category C2, displacements	See Annex C7 to C8

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorage satisfy requirements for Class A1
Resistance to fire	See Annex C9 to C10

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European assessment document EAD 330232-00-0601, the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 21 December 2017 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow
Head of Department

beglaubigt:
Lange

Installed condition for HST2 and HST2-R

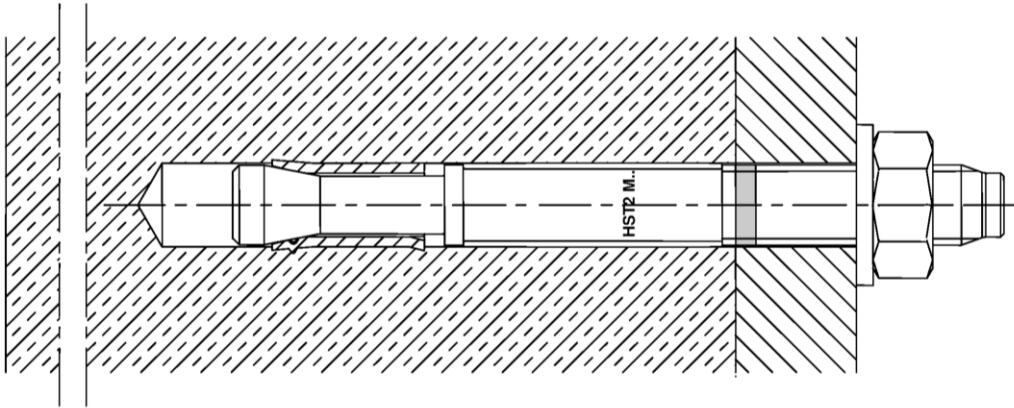

Product description and marking for HST2 and HST2-R

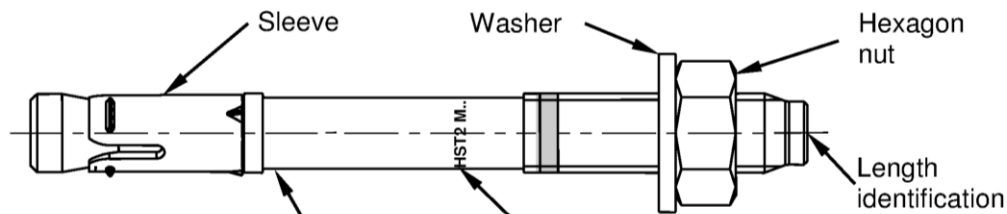

Marking:
HST2: HST2 M .../t_{fix}
HST2-R: HST2-R M .../t_{fix}

Hilti metal expansion anchor HST2 and HST2-R

Product description

Installation condition, anchor types, marking and identification

Annex A1

Table A1: Length identification HST2 and HST2-R

Letter		A	B	C	D	E	f	II
Anchor length	≥ [mm]	38,1	50,8	63,5	76,2	88,9	100,0	100,0
	< [mm]	50,8	63,5	76,2	88,9	101,6	100,0	100,0

Letter		F	G	Δ	H	I	J	K
Anchor length	≥ [mm]	101,6	114,3	125,0	127,0	139,7	152,4	165,1
	< [mm]	114,3	127,0	125,0	139,7	152,4	165,1	177,8

Letter		L	M	N	O	P	Q	R
Anchor length	≥ [mm]	177,8	190,5	203,2	215,9	228,6	241,3	254,0
	< [mm]	190,5	203,2	215,9	228,6	241,3	254,0	279,4

Letter		r	S	T	U	V	W	X
Anchor length	≥ [mm]	260,0	279,4	304,8	330,2	355,6	381,0	406,4
	< [mm]	260,0	304,8	330,2	355,6	381,0	406,4	431,8

Letter		Y	Z	AA	BB	CC	DD	EE
Anchor length	≥ [mm]	431,8	457,2	482,6	508,0	533,4	558,8	584,2
	< [mm]	457,2	482,6	508,0	533,4	558,8	584,2	609,6

Letter		FF	GG	HH	II	JJ	KK	LL
Anchor length	≥ [mm]	609,6	635,0	660,4	685,8	711,2	736,6	762,0
	< [mm]	635,0	660,4	685,8	711,2	736,6	762,0	787,4

Letter		MM	NN	OO	PP	QQ	RR	SS
Anchor length	≥ [mm]	787,4	812,8	838,2	863,6	889,0	914,4	939,8
	< [mm]	812,8	838,2	863,6	889,0	914,4	939,8	965,2

Letter		TT	UU	VV
Anchor length	≥ [mm]	965,2	990,6	1016,0
	< [mm]	990,6	1016,0	1041,4

Hilti metal expansion anchor HST2 and HST2-R

Product description

Installation condition, anchor types, marking and identification

Annex A2


Table A2: Materials

Designation	Material
HST2 (Carbon steel)	
Expansion sleeve	Stainless steel A2
Bolt	Carbon steel, galvanized, coated (transparent), rupture elongation ($l_0 = 5d$) > 8 %
Washer	Carbon steel, galvanized
Hexagon nut	Carbon steel, galvanized
HST2-R (Stainless steel A4)	
Expansion sleeve	Stainless steel A4
Bolt	Stainless steel A4 or Duplex A4, cone coated (transparent), rupture elongation ($l_0 = 5d$) > 8 %
Washer	Stainless steel A4
Hexagon nut	Stainless steel A4, coated

Table A3: Dimensions HST2 and HST2-R

HST2, HST2-R			M8	M10	M12	M16
Maximum length of anchor	l_{max}	[mm]	260	280	295	350
Shaft diameter at the cone	d_R	[mm]	5,5	7,2	8,5	11,6
Length of expansion sleeve	l_s	[mm]	14,8	18,2	22,7	24,3
Diameter of washer	$d_w \geq$	[mm]	15,57	19,48	23,48	29,48

HST2 and HST2-R

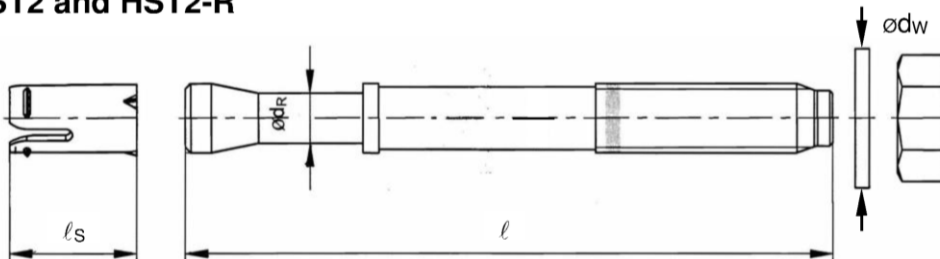

Hilti metal expansion anchor HST2 and HST2-R

Product description
Materials and dimensions

Annex A3

Specifications of intended use

Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000.
- Strength classes C20/25 to C50/60 according to EN 206-1:2000.
- Cracked and non-cracked concrete.

Use conditions (Environmental conditions):

- Hilti metal expansion anchor HST2 made of galvanized steel:
Structures subject to dry internal conditions.
- Hilti metal expansion anchor HST2-R made of stainless steel A4:
Structures subject to dry internal conditions and also in structures subject to external atmospheric exposure (including industrial and marine environment), or exposure in permanently damp internal conditions, if no particular aggressive conditions exist. Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed in accordance with:
FprEN 1992-4:2016 and EOTA Technical Report TR 055, 12/2016
- Anchorages under seismic actions (cracked concrete) are designed in accordance with:
FprEN 1992-4:2016 and EOTA Technical Report TR 045, 2/ 2013
Anchorages shall be positioned outside of critical regions (e.g. plastic hinges) of the concrete structure. Fastenings where shear loads act on anchors with a lever arm, such as e.g. in stand-off installation or with a grout layer, are not covered.
- Anchorages under fire exposure are designed in accordance with:
FprEN 1992-4:2016 and EOTA Technical Report TR 020, 4/2004
In case of requirements to resistance to fire local spalling of the concrete cover must be avoided.

Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- The anchor may only be set once.
- Overhead applications are permitted.

Hilti metal expansion anchor HST2 and HST2-R

Specifications of intended use

Annex B1

Table B1: Drilling technique




HST2, HST2-R		M8	M10	M12	M16
Hammer drilling (HD)		✓	✓	✓	✓
Diamond coring (DD) with <ul style="list-style-type: none"> DD EC-1 coring tool and DD-C ... TS/TL core bits or DD-C ... T2/T4 core bits DD 30-W coring tool and C+ ... SPX-T (abrasive) core bits 		✓	✓	✓	✓
Hammer drilling with Hilti hollow drill bit TE-CD/YD ... drilling system (HDB)		-	-	✓	✓

Table B2: Drill hole cleaning






Manual cleaning (MC): Hilti hand pump for blowing out drill holes	
Compressed air cleaning (CAC): Air nozzle with an orifice opening of 3,5 mm in diameter	
Automated cleaning (AC): Cleaning is performed during drilling with Hilti TE-CD and TE-YD drilling system including vacuum cleaner	

Table B3: Methods for application of torque moment

HST2, HST2-R		M8	M10	M12	M16
Torque wrench		✓	✓	✓	✓
Machine torqueing with Hilti SIW 6AT-A22 impact wrench and SI-AT-A22 adaptive torque module		✓	✓	✓	-

Hilti metal expansion anchor HST2 and HST2-R

Specifications of intended use

Annex B2

Table B4: Overview use and performance categories

Anchorage subject to:	HST2, HST2-R
Static and quasi static loading	M8 to M16 Table : C1 - C3
Seismic performance category C1/C2	M10 to M16 (HST2 only) Table : C4 - C9
Static and quasi static loading under fire exposure	M8 to M16 Table : C10 - C11

Hilti metal expansion anchor HST2 and HST2-R


Specifications of intended use

Annex B3

Table B5: Installation parameters for HST2 and HST2-R

HST2, HST2-R			M8	M10	M12	M16
Nominal diameter of drill bit	d_0	[mm]	8	10	12	16
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	8,45	10,45	12,50	16,50
drill hole depth ¹⁾	$h_1 \geq$	[mm]	60	74	88	103
Effective embedment depth	h_{ef}	[mm]	47	60	70	82
Thread engagement length	h_{nom}	[mm]	55	69	80	95
Maximum diameter of clearance hole in the fixture	d_f	[mm]	9	12	14	18
Installation torque moment	T_{inst}	[Nm]	20	45	60	110
Maximum thickness of fixture	$t_{fix,max}$	[mm]	195	200	200	235
Width across flats	SW	[mm]	13	17	19	24

¹⁾ In case of diamond drilling + 5 mm for M8 to M10 and + 2 mm for M12 to M16

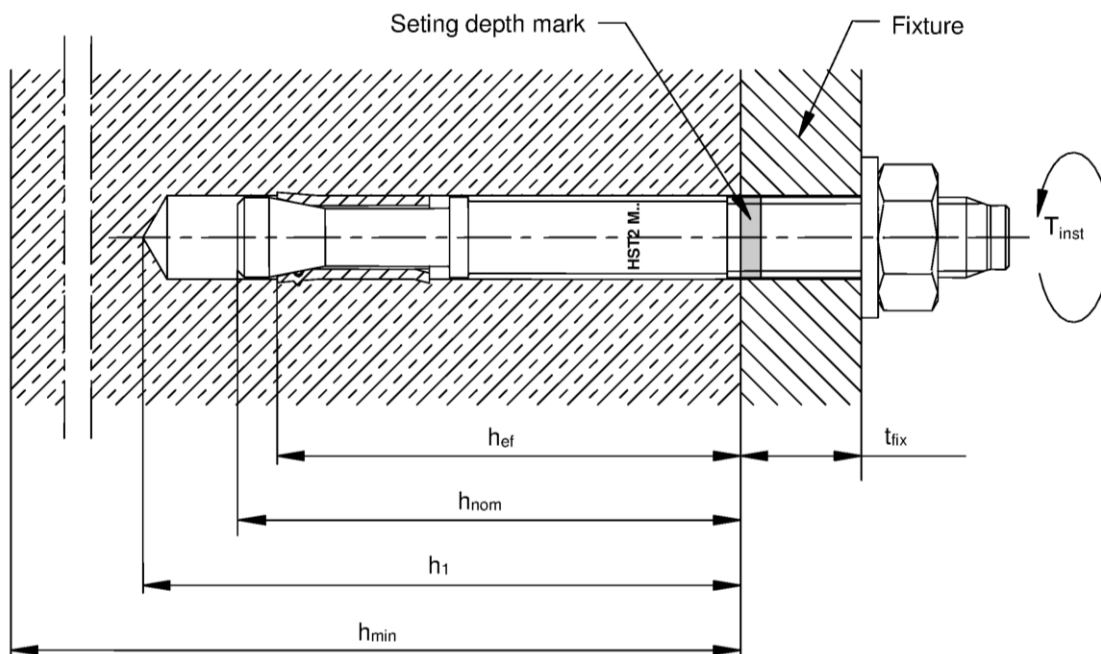

Hilti metal expansion anchor HST2 and HST2-R


Specifications of intended use
Installation parameters

Annex B4

Table B6: Minimum spacing and edge distance for HST2 and HST2-R

		M8	M10	M12	M16
Minimum thickness of concrete member	$h_{min,1}$ [mm]	100	120	140	160
Cracked concrete					
HST2					
Minimum spacing ¹⁾	s_{min} [mm]	40	55	60	70
	for $c \geq$ [mm]	50	70	75	100
Minimum edge distance ¹⁾	c_{min} [mm]	45	55	55	70
	for $s \geq$ [mm]	50	90	120	150
HST2-R					
Minimum spacing ¹⁾	s_{min} [mm]	40	55	60	70
	for $c \geq$ [mm]	50	65	75	100
Minimum edge distance ¹⁾	c_{min} [mm]	45	50	55	60
	for $s \geq$ [mm]	50	90	110	160

¹⁾ Linear interpolation for s_{min} and c_{min} allowed

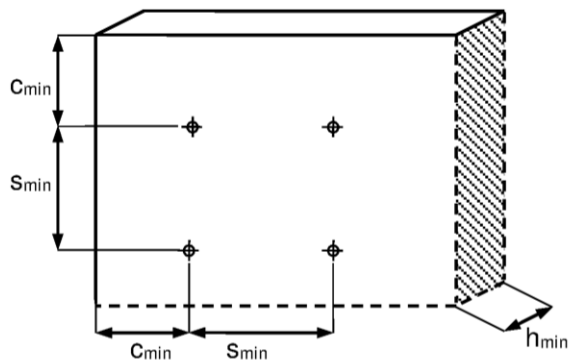

Hilti metal expansion anchor HST2 and HST2-R


Intended Use
Minimum spacing and minimum edge distance

Annex B5

Table B6 continued

		M8	M10	M12	M16
Minimum thickness of concrete member	$h_{min,1}$ [mm]	100	120	140	160
Non-cracked concrete					
HST2					
Minimum spacing ¹⁾	s_{min} [mm]	60	55	60	70
	for $c \geq$ [mm]	50	80	85	110
Minimum edge distance ¹⁾	c_{min} [mm]	50	55	55	85
	for $s \geq$ [mm]	60	115	145	150
HST2-R					
Minimum spacing ¹⁾	s_{min} [mm]	60	55	60	70
	for $c \geq$ [mm]	60	70	80	110
Minimum edge distance ¹⁾	c_{min} [mm]	60	50	55	70
	for $s \geq$ [mm]	60	115	145	160

¹⁾ Linear interpolation for s_{min} and c_{min} allowed

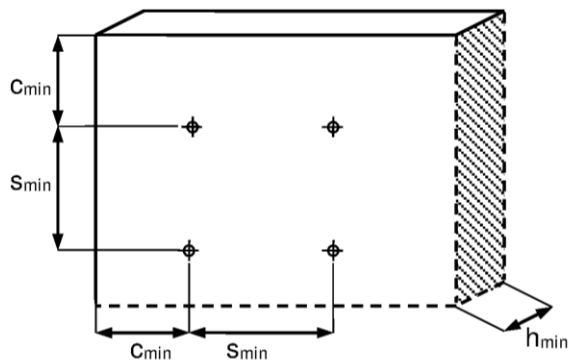

Hilti metal expansion anchor HST2 and HST2-R


Intended Use
Minimum spacing and minimum edge distance

Annex B6

Table B6 continued

		M8	M10	M12	M16
Minimum thickness of concrete member	$h_{min,2}$ [mm]	80	100	120	140
Cracked concrete					
HST2 and HST2-R					
Minimum spacing	s_{min} [mm]	50	55	60	80
	for $c \geq$ [mm]	60	110	100	140
Minimum edge distance	c_{min} [mm]	55	70	70	80
	for $s \geq$ [mm]	60	100	130	180
Non-cracked concrete					
HST2 and HST2-R					
Minimum spacing	s_{min} [mm]	60	55	60	80
	for $c \geq$ [mm]	75	115	100	140
Minimum edge distance	c_{min} [mm]	70	70	70	80
	for $s \geq$ [mm]	80	110	130	180

1) Linear interpolation for s_{min} and c_{min} allowed

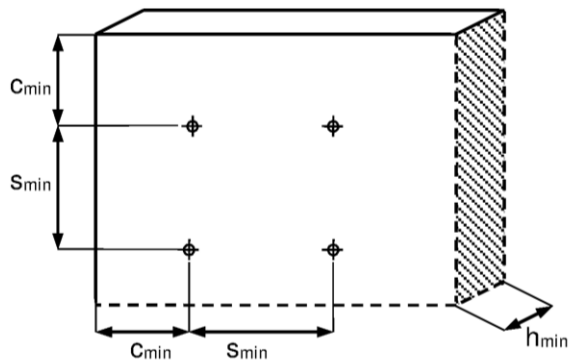

Hilti metal expansion anchor HST2 and HST2-R


Intended Use
Minimum spacing and minimum edge distance

Annex B7


Installation instruction

Hole drilling and cleaning


a) Hammer drilling (HD):
M8 to M16

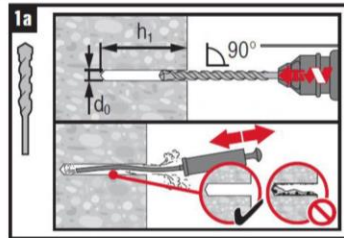

b) Diamond coring (DD):
M8 to M16

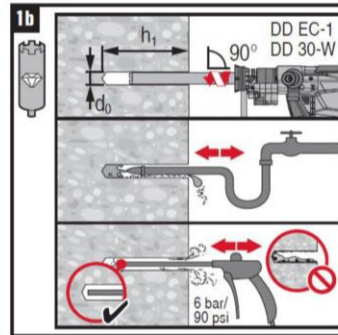


c) Hammer drilling with Hilti hollow drill bit (HDB):
M12 to M16

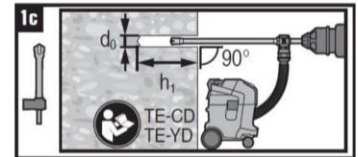


Anchor setting


a) Hammer setting:
M8 to M16



b) Machine setting (setting tool):
M8 to M16




Check setting

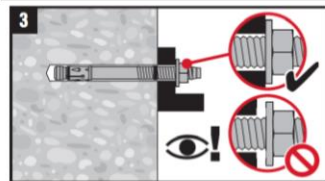


Anchor torquing

a) Torque wrench:
M8 to M16

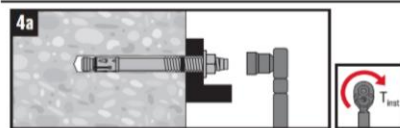

b) Machine torquing:
M8 to M12

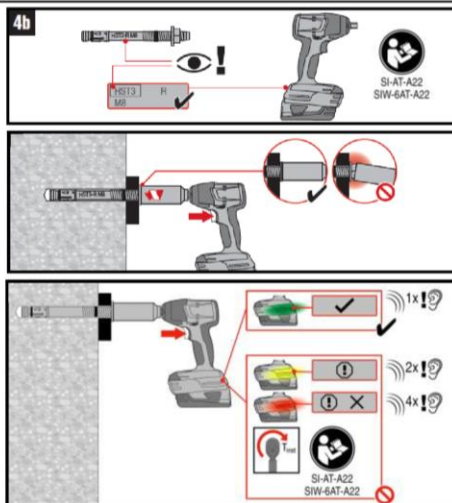

Hilti metal expansion anchor HST2 and HST2-R

Intended Use
Installation instructions

Annex B8

Table C1: Characteristic tension resistance for HST2 and HST2-R in cracked and non-cracked concrete

		M8	M10	M12	M16
Steel failure					
HST2					
Characteristic resistance	$N_{Rk,s}$ [kN]	17,8	31,4	44,8	78,2
Partial safety factor	$\gamma_{Ms}^{1)}$ [-]	1,40			
HST2-R					
Characteristic resistance	$N_{Rk,s}$ [kN]	17,6	30,5	43,1	78,2
Partial safety factor	$\gamma_{Ms}^{1)}$ [-]	1,40			
Pullout failure					
HST2					
Characteristic resistance in cracked concrete C20/25	$N_{Rk,p}$ [kN]	5,0	9,0	12,0	20,0
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,p}$ [kN]	9,0	16,0	20,0	35,0
Installation safety factor	γ_{inst} [-]	1,00			
HST2-R					
Characteristic resistance in cracked concrete C20/25	$N_{Rk,p}$ [kN]	5,0	9,0	12,0	25,0
Characteristic resistance in non-cracked concrete C20/25	$N_{Rk,p}$ [kN]	9,0	16,0	20,0	35,0
Installation safety factor	γ_{inst} [-]	1,00			
HST2 and HST2-R					
Increasing factor for cracked and non-cracked concrete	ψ_C C20/25	1,00			
	ψ_C C30/37	1,22			
	ψ_C C40/50	1,41			
	ψ_C C50/60	1,55			

¹⁾ In absence of other national regulations

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic values of resistance under tension loading in cracked and non-cracked concrete

Annex C1

Table C1 continued

			M8	M10	M12	M16
Concrete cone and splitting failure						
HST2 and HST2-R						
Effective embedment depth	h_{ef}	[mm]	47	60	70	82
Installation safety factor	γ_{inst}	[-]	1,00			
Factor for cracked concrete	$k_1 = k_{cr,N}$	[-]	7,7			
Factor for non-cracked concrete	$k_1 = k_{ucr,N}$	[-]	11,0			
Spacing	$s_{cr,N}$ $s_{cr,sp}$	[mm]	3 h_{ef}			
Edge distance	$c_{cr,N}$ $c_{cr,sp}$	[mm]	1,5 h_{ef}			

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic values of resistance under tension loading in cracked and non-cracked concrete

Annex C2

Table C2: Characteristic shear resistance for HST2 and HST2-R in cracked and non-cracked concrete

			M8	M10	M12	M16
Steel failure						
HST2						
Characteristic resistance	$V_{Rk,s}$	[kN]	11,4	21,6	31,4	55,3
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25			
Ductility factor	k_7	[-]	1,0			
HST2-R						
Characteristic resistance	$V_{Rk,s}$	[kN]	15,7	25,3	36,7	63,6
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25			
Ductility factor	k_7	[-]	1,0			
Steel failure with lever arm						
HST2						
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	25	55	93	240
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25			
HST2-R						
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	27	53	93	216
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25			
Concrete pryout failure						
HST2 and HST2-R						
Installation safety factor	γ_{inst}	[-]	1,00			
Pryout factor	k_8	[-]	2,0	2,0	2,2	2,5
Concrete edge failure						
HST2 and HST2-R						
Effective length of anchor in shear loading	l_f	[mm]	47	60	70	82
Diameter of anchor	d_{nom}	[mm]	8	10	12	16
Installation safety factor	γ_{inst}	[-]	1,00			

¹⁾ In absence of other national regulations

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic values of resistance under shear loading in cracked and non-cracked concrete

Annex C3

Table C3: Displacements under tension and shear loads for HST2 and HST2-R for static and quasi static loading

			M8	M10	M12	M16
Displacements under tension loading						
HST2						
Tension load in cracked concrete	N	[kN]	2,0	4,3	5,7	9,5
Corresponding displacement	δ_{N0}	[mm]	1,3	0,2	0,1	0,5
	$\delta_{N\infty}$	[mm]	1,2	1,0	1,2	1,2
Tension load in non-cracked concrete	N	[kN]	3,6	7,6	9,5	16,7
Corresponding displacement	δ_{N0}	[mm]	0,2	0,1	0,1	0,4
	$\delta_{N\infty}$	[mm]	1,1	1,1	1,1	1,1
HST2-R						
Tension load in cracked concrete	N	[kN]	2,4	4,3	5,7	11,9
Corresponding displacement	δ_{N0}	[mm]	0,6	0,2	0,8	1,0
	$\delta_{N\infty}$	[mm]	1,5	1,2	1,4	1,2
Tension load in non-cracked concrete	N	[kN]	4,3	7,6	9,5	16,7
Corresponding displacement	δ_{N0}	[mm]	0,1	0,1	0,1	0,1
	$\delta_{N\infty}$	[mm]	1,5	1,2	1,4	1,2
Displacements under shear loading						
HST2						
Shear load in cracked and non-cracked concrete	V	[kN]	6,5	12,3	17,9	31,6
Corresponding displacement	δ_{V0}	[mm]	2,0	2,3	3,3	4,0
	$\delta_{V\infty}$	[mm]	3,1	3,4	4,9	6,0
HST2-R						
Shear load in cracked and non-cracked concrete	V	[kN]	9,0	14,5	21,0	36,3
Corresponding displacement	δ_{V0}	[mm]	1,9	4,3	6,0	2,9
	$\delta_{V\infty}$	[mm]	2,9	6,4	9,1	4,4

Hilti metal expansion anchor HST2 and HST2-R

Performances
Displacements under tension and shear loading

Annex C4

Table C4: Characteristic tension resistance for seismic loading for HST2, performance category C1

		M8	M10	M12	M16
Steel failure					
HST2					
Characteristic resistance	$N_{Rk,s,seis}$ [kN]	-	31,4	44,8	78,2
Partial safety factor	$\gamma_{Ms,seis}$ ¹⁾ [-]	-	1,40		
Pullout failure					
HST2					
Characteristic resistance	$N_{Rk,p,seis}$ [kN]	-	8,0	10,7	18,0
Installation safety factor	γ_{inst} [-]	-	1,00		
Concrete cone failure ²⁾					
HST2					
Installation safety factor	γ_{inst} [-]	-	1,00		
Splitting failure ²⁾					
HST2					
Installation safety factor	γ_{inst} [-]	-	1,00		

¹⁾ In absence of other national regulations

²⁾ For concrete cone failure and splitting failure see TR 045

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic tension resistance for performance category C1

Annex C5

Table C5: Characteristic shear resistance for seismic loading for HST2, performance category C1

		M8	M10	M12	M16
Steel failure					
HST2					
Characteristic resistance	$V_{Rk,s,seis}$ [kN]	-	16,0	27,0	41,3
Partial safety factor	$\gamma_{Ms,seis}$ ¹⁾ [-]	-	1,25		
Concrete pryout failure ²⁾					
HST2					
Installation safety factor	γ_{inst} [-]	-	1,00		
Concrete edge failure ²⁾					
HST2					
Installation safety factor	γ_{inst} [-]	-	1,00		

¹⁾ In absence of other national regulations

²⁾ For concrete pryout failure and concrete edge failure see TR 045

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic shear resistance for performance category C1

Annex C6

Table C6: Characteristic tension resistance for seismic loading for HST2, performance category C2

			M8	M10	M12	M16
Steel failure						
HST2						
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	-	31,4	44,8	78,2
Partial safety factor	$\gamma_{Ms,seis}$	¹⁾ [-]	-	1,40		
Pullout failure						
HST2						
Characteristic resistance	$N_{Rk,p,seis}$	[kN]	-	3,3	10,0	12,8
Installation safety factor	γ_{inst}	[-]	-	1,00		
Concrete cone failure ²⁾						
HST2						
Installation safety factor	γ_{inst}	[-]	-	1,00		
Splitting failure ²⁾						
HST2						
Installation safety factor	γ_{inst}	[-]	-	1,00		

¹⁾ In absence of other national regulations

²⁾ For concrete cone failure and splitting failure see TR 045

Table C7: Displacements under tension loads for seismic loading for HST2, performance category C2

			M8	M10	M12	M16
Displacements under tension loading						
HST2						
Displacement DLS	$\delta_{N,seis}$	[mm]	-	1,4	6,7	4,0
Displacement ULS	$\delta_{N,seis}$	[mm]	-	8,6	15,9	13,3

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic tension resistance and displacements for performance category C2

Annex C7

Table C8: Characteristic shear resistance for seismic loading for HST2, performance category C2

			M8	M10	M12	M16
Steel failure						
HST2						
Characteristic resistance	$V_{Rk,s,seis}$	[kN]	-	16,0	24,2	41,3
Partial safety factor	$\gamma_{Ms,seis}$	¹⁾ [-]	-	1,25		
Concrete pryout failure ²⁾						
HST2						
Installation safety factor	γ_{inst}	[-]	-	1,00		
Concrete edge failure ²⁾						
HST2						
Installation safety factor	γ_{inst}	[-]	-	1,00		

¹⁾ In absence of other national regulations

²⁾ For concrete pryout failure and concrete edge failure see TR 045

Table C9: Displacements under shear loads for seismic loading for HST2, performance category C2

			M8	M10	M12	M16
Displacements under tension loading						
HST2						
Displacement DLS	$\delta_{V,seis}$	[mm]	-	4,7	4,8	5,7
Displacement ULS	$\delta_{V,seis}$	[mm]	-	7,7	7,9	8,9

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic shear resistance and displacements for performance category C2

Annex C8

Table C10: Characteristic tension resistance under fire exposure for HST2 and HST2-R in cracked and non-cracked concrete

				M8	M10	M12	M16
Steel failure							
HST2 and HST2-R							
Characteristic resistance	R30	$N_{Rk,s,fi}$	[kN]	0,9	2,5	5,0	9,0
	R60	$N_{Rk,s,fi}$	[kN]	0,7	1,5	3,5	6,0
	R90	$N_{Rk,s,fi}$	[kN]	0,6	1,0	2,0	3,5
	R120	$N_{Rk,s,fi}$	[kN]	0,5	0,7	1,0	2,0
Pullout failure							
HST2 and HST2-R							
Characteristic resistance in concrete \geq C20/25	R30	$N_{Rk,p,fi}$	[kN]	1,3	2,3	3,0	5,0
	R60	$N_{Rk,p,fi}$	[kN]				
	R90	$N_{Rk,p,fi}$	[kN]				
	R120	$N_{Rk,p,fi}$	[kN]	1,0	1,8	2,4	4,0
Concrete cone failure							
HST2 and HST2-R							
Characteristic resistance in concrete \geq C20/25	R30	$N^0_{Rk,c,fi}$	[kN]	2,7	5,0	7,4	11,0
	R60	$N^0_{Rk,c,fi}$	[kN]				
	R90	$N^0_{Rk,c,fi}$	[kN]				
	R120	$N^0_{Rk,c,fi}$	[kN]	2,2	4,0	5,9	8,8
Spacing	$s_{cr,N}$	[mm]	4 h_{ef}				
	s_{min}	[mm]	50	55	60	80	
Edge distance	$c_{cr,N}$	[mm]	2 h_{ef}				
	c_{min}	[mm]	Fire attack from one side: 2 h_{ef} Fire attack from more than one side: \geq 300				

In absence of other national regulations the partial safety factor for resistance under fire exposure $\gamma_{M,fi} = 1,0$ is recommended.

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic values of resistance under tension loading under fire exposure in cracked and non-cracked concrete

Annex C9

Table C11: Characteristic shear resistance under fire exposure for HST2 and HST2-R in cracked and non-cracked concrete

				M8	M10	M12	M16	
Steel failure without lever arm								
HST2 and HST2-R								
Characteristic resistance	R30	$V_{RK,s,fi}$	[kN]	0,9	2,5	5,0	9,0	
	R60	$V_{RK,s,fi}$	[kN]	0,7	1,5	3,5	6,0	
	R90	$V_{RK,s,fi}$	[kN]	0,6	1,0	2,0	3,5	
	R120	$V_{RK,s,fi}$	[kN]	0,5	0,7	1,0	2,0	
Steel failure with lever arm								
HST2 and HST2-R								
Characteristic resistance	R30	$M^0_{RK,s,fi}$	[Nm]	1,0	3,3	8,1	20,6	
	R60	$M^0_{RK,s,fi}$	[Nm]	0,8	2,4	5,7	14,4	
	R90	$M^0_{RK,s,fi}$	[Nm]	0,7	1,6	3,2	8,2	
	R120	$M^0_{RK,s,fi}$	[Nm]	0,6	1,2	2,0	5,1	
Concrete pryout failure								
HST2 and HST2-R								
Pryout factor	k_8			[-]	2,00	2,00	2,20	2,50
Characteristic resistance in concrete $\geq C20/25$	R30	$V^0_{RK,cp,fi}$	[kN]	5,4	10,0	16,0	27,2	
	R60	$V^0_{RK,cp,fi}$	[kN]					
	R90	$V^0_{RK,cp,fi}$	[kN]					
	R120	$V^0_{RK,cp,fi}$	[kN]					
Concrete edge failure								
HST2 and HST2-R								
The initial value $V^0_{RK,c,fi}$ of the characteristic resistance in concrete C20/25 to C50/60 under fire exposure may be determined by: $V^0_{RK,c,fi} = 0,25 \times V^0_{RK,c}$ ($\leq R90$) $V^0_{RK,c,fi} = 0,20 \times V^0_{RK,c}$ (R120) with $V^0_{RK,c}$ initial value of the characteristic resistance in cracked concrete C20/25 under normal temperature.								

In absence of other national regulations the partial safety factor for resistance under fire exposure $\gamma_{M,fi} = 1,0$ is recommended.

Hilti metal expansion anchor HST2 and HST2-R

Performances

Characteristic values of resistance under shear loading under fire exposure in cracked and non-cracked concrete

Annex C10