



Approval body for construction products and types of construction

#### **Bautechnisches Prüfamt**

An institution established by the Federal and Laender Governments



### European Technical Assessment

### ETA-17/0361 of 18 August 2017

English translation prepared by DIBt - Original version in German language

### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

FI-P-8, FI-M-8, FI-X-8, FI-P-10, FI-M-10, FI-X-10

Nailed-in plastic anchor for the fixing of external thermal insulation composite systems with rendering in concrete and masonry

TOP KRAFT SK a.s. Priemyselna 9050/1 SK-907 01 MYJAVA SLOWAKISCHE REPUBLIK

Plant 1

19 pages including 3 annexes which form an integral part of this assessment

European Assessment Document (EAD) 330196-01-0604

Deutsches Institut für Bautechnik Kolonnenstraße 30 B | 10829 Berlin | GERMANY | Phone: +49 30 78730-0 | Fax: +49 30 78730-320 | Email: dibt@dibt.de | www.dibt.de



### European Technical Assessment ETA-17/0361 English translation prepared by DIBt

Page 2 of 19 | 18 August 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 19 | 18 August 2017

### Specific Part

#### 1 Technical description of the product

The nailed-in anchor FI-P-8, FI-M-8, FI-X-8, FI-P-10, FI-M-10, FI-X-10 consists of an anchor sleeve with an enlarged shaft, spreading zone subsequently, an insulation plate made of polyethylene and an accompanying specific nail of galvanised steel for the type TMX and TGX and an accompanying specific nail of polyamide for the type TTX. The serrated expanding part of the anchor sleeve is slotted.

The anchor may in addition be combined with the anchor plates TDX-P-90 / TDX-90 and TDX-P-140 / TDX-140.

An illustration and the description of the product are given in Annex A.

## 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

### 3.1 Mechanical resistance and stability (BWR 1)

Requirements with respect to the mechanical resistance and stability of non- load bearing parts of the works are not included in this Essential requirement but are under the Essential Requirement safety in use.

### 3.2 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance	
Characteristic tension resistance	See Annex C 1, C 2	
Edge distances and spacing	See Annex B 2	
Plate stiffness	See Annex C 3	
Displacements	See Annex C 4	

#### 3.3 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance	
Point thermal transmittance	See Annex C 3	

## 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 330196-01-0604, the applicable European legal act is: [97/463/EC].

The system to be applied is: 2+



# European Technical Assessment ETA-17/0361

Page 4 of 19 | 18 August 2017

English translation prepared by DIBt

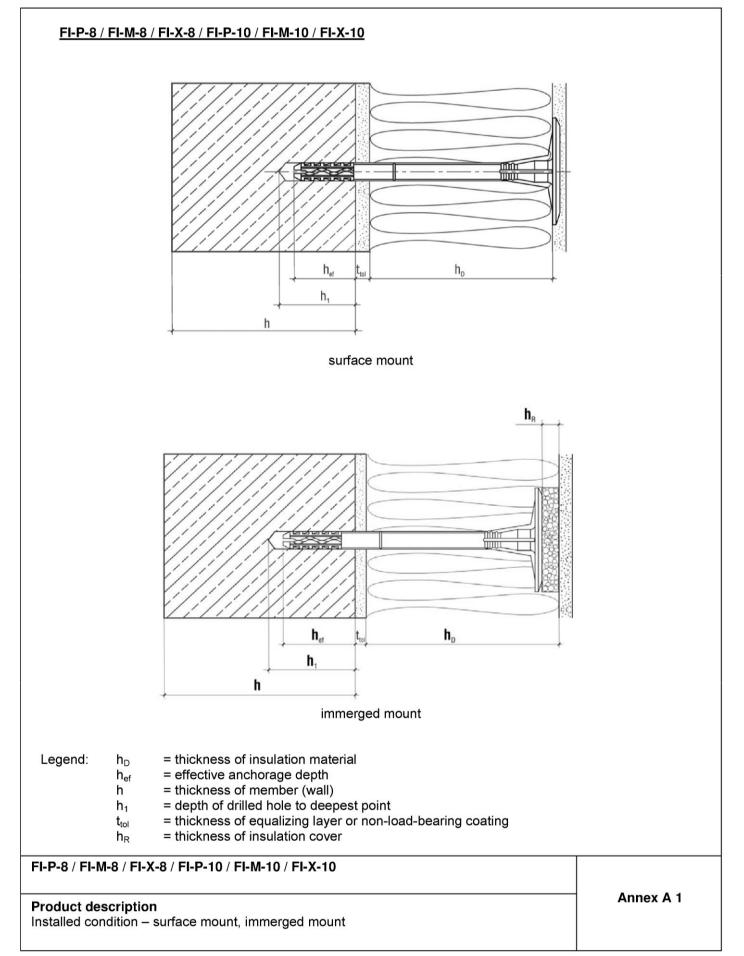
# 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 18 August 2017 by Deutsches Institut für Bautechnik

Dr. Ing. Lars Eckfeldt p. p. Head of Department *beglaubigt:* Ziegler






### Page 6 of European Technical Assessment ETA-17/0361 of 18 August 2017

	h h ef1 Marking of effect	$\bigvee$	L <sub>a</sub>		Mark Iden Anct		X
/ Table A1: Dim	Accompanying s	pecific nail	<b>L</b> <sub>s</sub> TTX-4,8				
Anchor Type	Colour	d <sub>nom</sub> [mm]	Anchor Sleeve h <sub>ef</sub> [mm]	min L <sub>a</sub> max L <sub>a</sub> [mm]	d <sub>s</sub> [mm]	Specific nail c [mm]	min L <sub>s</sub> max L <sub>s</sub> [mm]
FI-P-8	natural	8	h <sub>ef1</sub> = 25 h <sub>ef2</sub> = 65*	95 195	4,8	44	100 200
h <sub>D</sub> e.g. h <sub>D</sub>	f maximum thick = L <sub>a</sub> – t <sub>tol</sub> – h <sub>ef</sub> = 95 – 10 – 25 = 60		ulation h <sub>D</sub> [mm (L <sub>a</sub> = e.g. 95; t <sub>t</sub>	_			

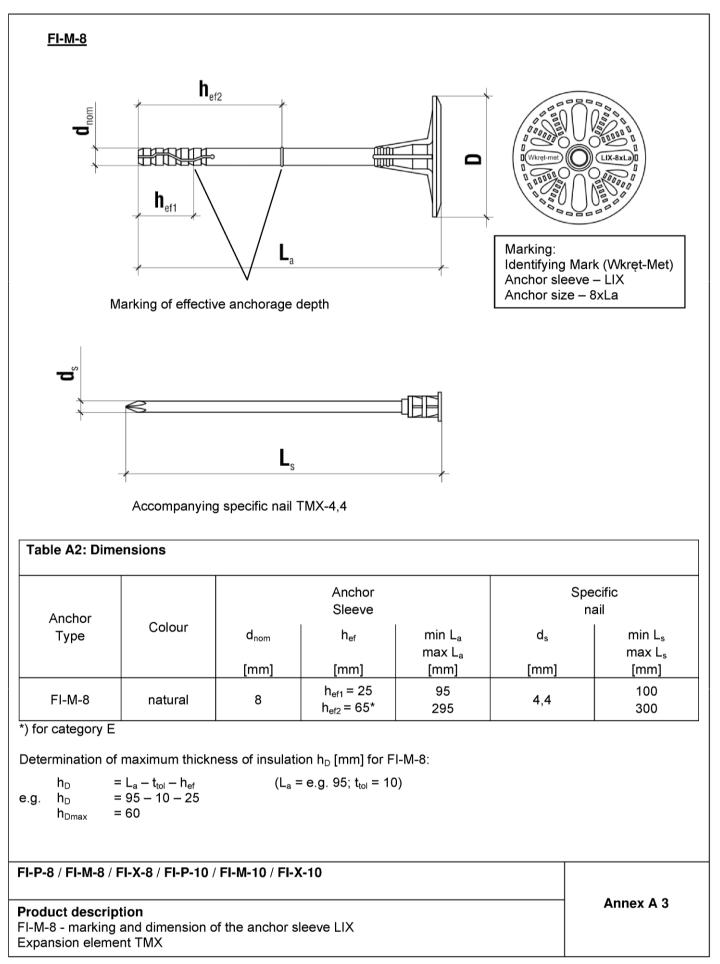
### Page 7 of European Technical Assessment ETA-17/0361 of 18 August 2017





### Page 8 of European Technical Assessment ETA-17/0361 of 18 August 2017




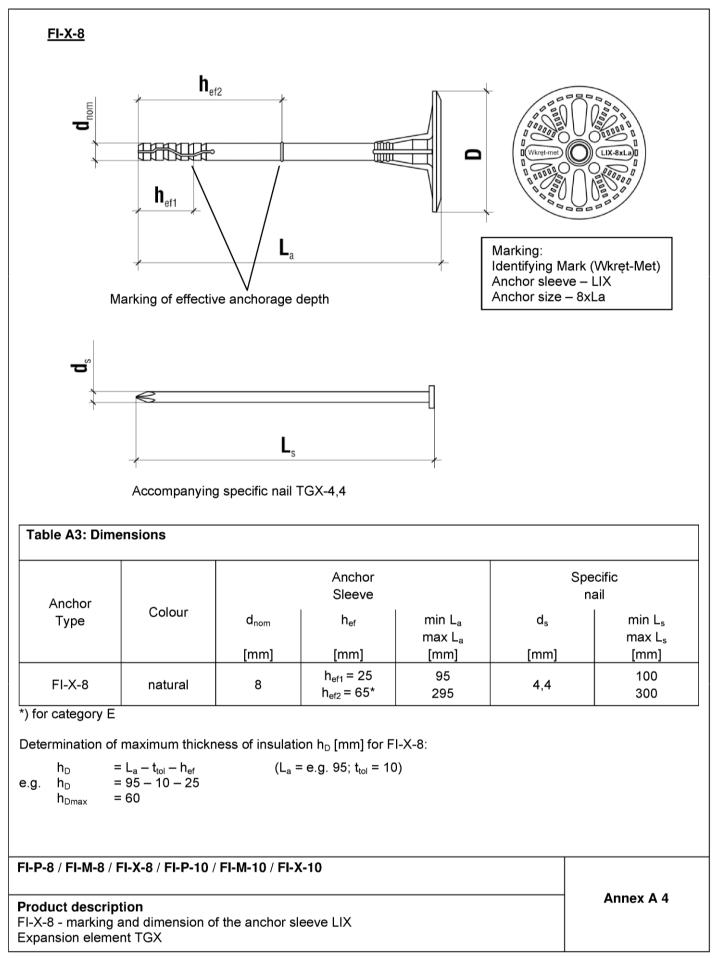

#### Page 9 of European Technical Assessment ETA-17/0361 of 18 August 2017

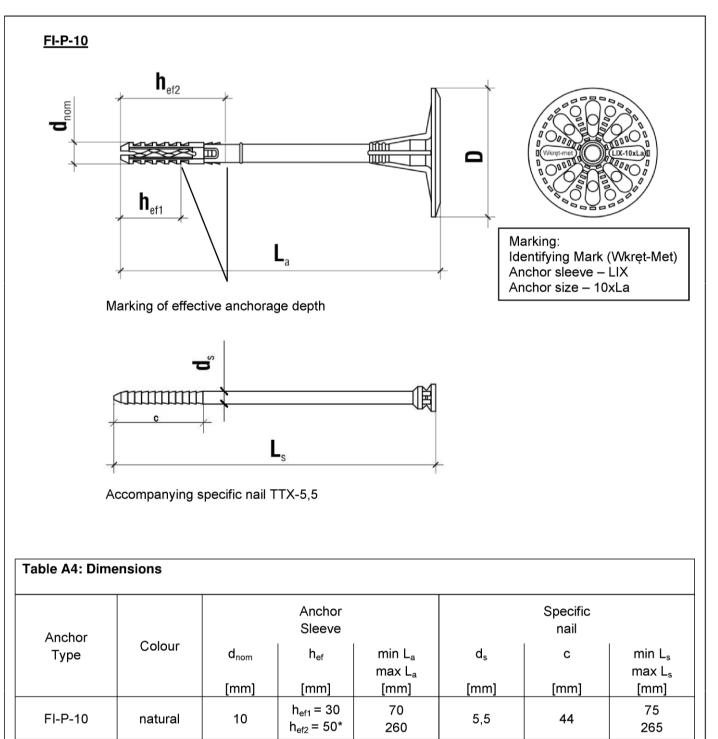English translation prepared by DIBt





### \*) for category E

Determination of maximum thickness of insulation  $h_D$  [mm] for FI-P-10:

$$\begin{array}{rl} h_{D} & = L_{a} - t_{tol} - h_{ef} \\ e.g. & h_{D} & = 70 - 10 - 30 \\ h_{Dmax} & = 30 \end{array}$$

$$(L_a = e.g. 70; t_{tol} = 10)$$

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10


### **Product description**

FI-P-10 - marking and dimension of the anchor sleeve LIX Expansion element TTX

30

Annex A 5



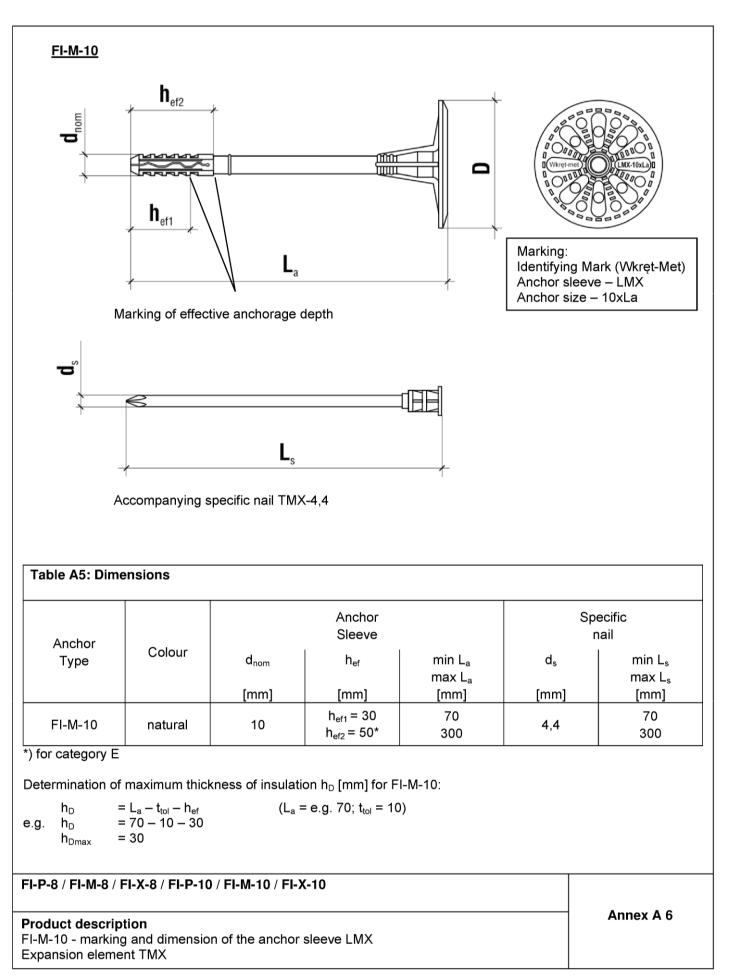



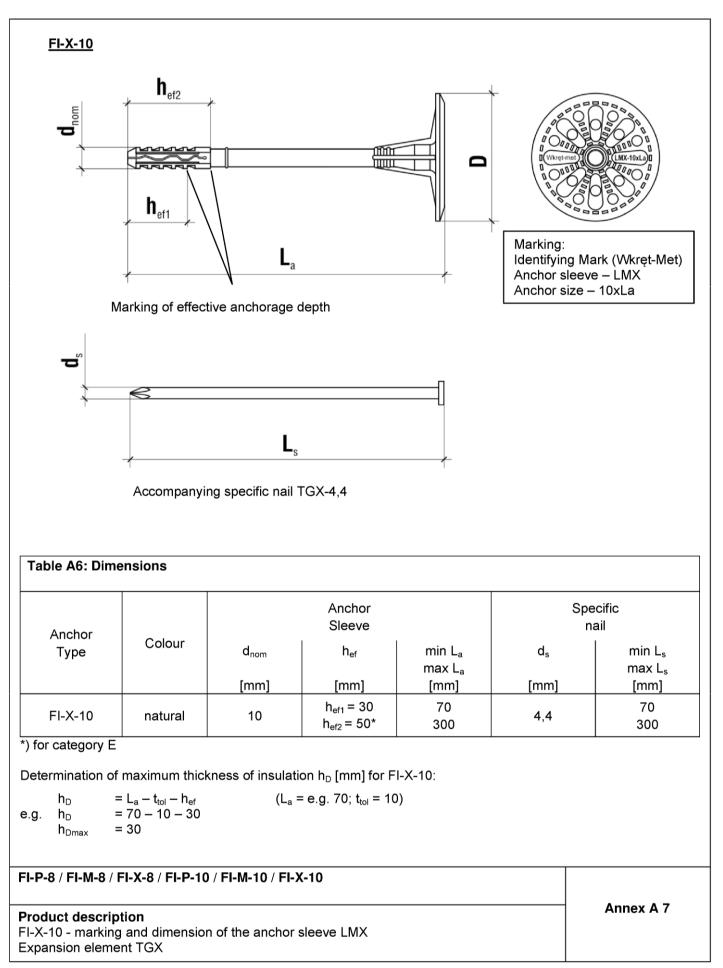



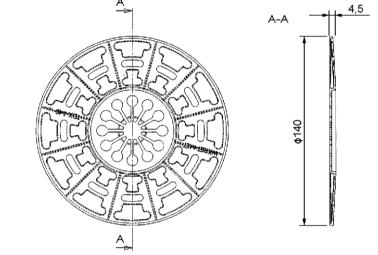


Table A7: Materials	
Name	Materials
Anchor sleeve	Polyethylene, colour: natural
Specific nail TTX	Polyamide GF, colour: black or natural
Specific nail TMX, TGX	Steel, electro galvanized $\geq$ 5 $\mu m$ according to EN ISO 4042:2001, white passivated, $f_{yk} \geq$ 420 N/mm²


### Table A8: Insulation discs, diameters and material

Plate type	Outer diameter [mm]	Material
TDX-P-90	90	Polyethylene, natural or grey
TDX-90	90	Polyamide +GF, natural or grey
TDX-P-140	140	Polyethylene, natural or grey
TDX-140	140	Polyamide + GF, natural or grey





TDX-P-90/TDX-90



TDX-P-140/TDX-140



Special drill tool WK-FT for immerged installation

Insulation cover KS and KSG

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

#### **Product description** Materials,

Slip on plates with FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

Annex A 8

### Page 13 of European Technical Assessment ETA-17/0361 of 18 August 2017

English translation prepared by DIBt



### Specifications of intended use

### Anchorages subject to:

• The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the thermal insulation composite system.

### **Base materials:**

- Normal weight concrete (use category A) according to Annex C 1
- Solid masonry (use category B), according to Annex C 1
- · Hollow or perforated masonry (use category C), according to Annex C 1
- · Lightweight aggregate concrete (use category D), according to Annex C 1
- · Autoclaved aerated concrete (use category E), according to Annex C 1
- For other base materials of the use categories A, B, C, D or E the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 051 Edition December 2016.

### **Temperature Range:**

• 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)

### Design:

- The anchorages are designed under the responsibility of an engineer experienced in anchorages and masonry work with the partial safety factors  $\gamma_{M} = 2,0$  and  $\gamma_{F} = 1,5$ , if there are no other national regulations.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings of thermal insulation composite systems.

### Installation:

- Hole drilling by the drill modes according to Annex C 1
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature from 0°C to +40°C
- Exposure to UV due to solar radiation of the anchor not protected by rendering  $\leq$  6 weeks

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

#### Intended use Specifications

Annex B 1




Table B1: Installation parameters for FI-P-8 / FI-M-8 / FI-X-8							
		ABCD	E				
Drill hole diameter	d <sub>0</sub> [mm] =	8	8				
Cutting diameter of drill bit	d <sub>cut</sub> [mm] ≤	8,45	8,45				
Depth of drilled hole to deepest point	h₁ [mm] ≥	35	75				
Effective anchorage depth	h <sub>ef</sub> [mm] ≥	25	65				

### Table B2: Installation parameters for FI-P-10 / FI-M-10 / FI-X-10

		ABCD	E
Drill hole diameter	d <sub>0</sub> [mm] =	10	10
Cutting diameter of drill bit	d <sub>cut</sub> [mm] ≤	10,45	10,45
Depth of drilled hole to deepest point	h₁ [mm] ≥	40	60
Effective anchorage depth	h <sub>ef</sub> [mm] ≥	30	50

Table B3: Anchor distances and dimensions of members							
Minimum allowable spacing	s <sub>min</sub> ≥ [mm]	100					
Minimum allowable edge distance	$c_{min} \geq [mm]$	100					
Minimum thickness of member	h ≥ [mm]	100					

### Scheme of distance and spacing



### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

### Intended use Installation parameters,

Edge distances and spacing

Annex B 2

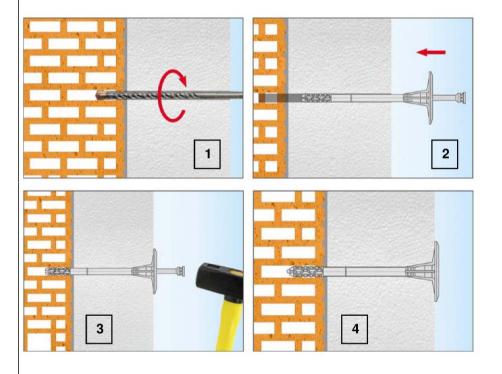
### Page 15 of European Technical Assessment ETA-17/0361 of 18 August 2017

English translation prepared by DIBt



### Installation instructions

surface mount




1) Drill the hole perpendicular to the substrate surface. Clean the drill hole.

2) Place the anchor into the drill hole. The bottom side of the plate must be flush with the ETICS.

3) Drive in the specific nail with the hammer.

4) Installed condition.

### immerged mount

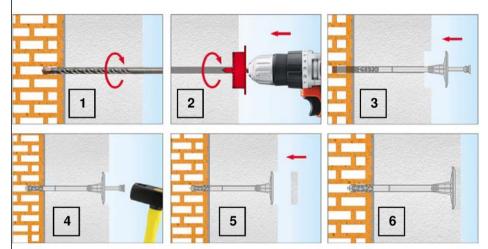

1) Drill the hole perpendicular to the substrate surface. Clean the drill hole.

2) Drill the recess for immerged installation with the special drilling tool WK-FT.

3) Place the anchor into the drill hole. The bottom side of the plate must be flush with the recess in the ETICS.

4) Drive in the specific nail with the hammer.

5) Insert the insulation cover.

6) Installed condition.

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

### Intended use

Installation instructions - surface mount, immerged mount

Annex B 3



kN						
Anchor type					FI-P-8	FI-M-8 FI-X-8
Base materials	Bulk density ρ [kg/dm³]	minimum compressive strength f <sub>b</sub> [N/mm²]	General remarks	Drill method	N <sub>Rk</sub> [kN]	N <sub>Rk</sub> [kN]
Concrete C12/15 (EN 206-1:2000)	≥ 2,25	≥ 30		hammer	0,5	0,5
Concrete C20/25 - C50/60 (EN 206-1:2000)	≥ 2,30	≥ 65		hammer	0,75	0,75
Clay bricks MZ e.g. according to EN 771-1:2011	≥ 2,0	≥ 20		hammer	0,75	0,75
Calcium silicate bricks KS e.g. according to EN 771-2:2011	≥ 2,0	≥ 20		hammer	0,75	0,75
Calcium silicate hollow block KSL e.g. according to EN 771-2:2011	≥ 1,6	≥ 12	Vertically perforation more than 15 % and less than 50 %	hammer	0,75	0,75
Vertically perforated clay bricks HLZ e.g. according to EN 771-1:2011	≥ 1,2	≥ 12	Vertically perforation more than 15 % and less than 50 %	rotary	0,6	0,6
Vertically perforated clay bricks porotherm 25 e.g. according to EN 771-1:2011	≥ 0,8	≥ 10	Vertically perforation more than 15 %	rotary	0,4	0,4
Autoclaved concrete blocks AAC2 e.g. according to EN 771-4:2011	≥ 0,35	≥ 2		rotary	0,75	0,75
Autoclaved concrete blocks AAC7 e.g. according to EN 771-4:2011	≥ 0,65	≥ 3,5		rotary	0,9	0,9
Lightweight concrete blocks LAC e.g. according to EN 1520:2011-06 / EN 771-3:2011	≥ 0,88	≥ 5		rotary	0,6	0,75

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

### Performances

Characteristic resistance FI-P-8, FI-M-8, FI-X-8

Annex C 1



Anchor type					FI-P-10	FI-M-10 FI-X-10
Base materials	Bulk density ρ [kg/dm³]	minimum compressive strength f <sub>b</sub>	General remarks	Drill method	N <sub>Rk</sub>	N <sub>Rk</sub>
		[N/mm²]			[kN]	[kN]
Concrete C12/15 (EN 206-1:2000)	≥ 2,25	≥ 30		hammer	0,5	0,75
Concrete C20/25 - C50/60 (EN 206-1:2000)	≥ 2,30	≥ 65		hammer	0,75	0,9
Clay bricks MZ e.g. according to EN 771-1:2011	≥ 2,0	≥ 20		hammer	0,75	0,9
Calcium silicate bricks KS e.g. according to EN 771-2:2011	≥ 2,0	≥ 20		hammer	0,6	0,9
Calcium silicate hollow block KSL e.g. according to EN 771-2:2011	≥ 1,6	≥ 12	Vertically perforation more than 15 % and less than 50 %	hammer	0,6	0,9
Vertically perforated clay bricks HLZ e.g. according to EN 771-1:2011	≥ 1,2	≥ 12	Vertically perforation more than 15 % and less than 50 %	rotary	0,6	0,9
Vertically perforated clay bricks porotherm 25 e.g. according to EN 771-1:2011	≥ 0,8	≥ 10	Vertically perforation more than 15 %	rotary	0,4	0,5
Autoclaved concrete blocks AAC2 e.g. according to EN 771-4:2011	≥ 0,35	≥2		rotary	0,5	0,75
Autoclaved concrete blocks AAC7 e.g. according to EN 771-4:2011	≥ 0,65	≥ 3,5		rotary	0,6	0,9
Lightweight concrete blocks LAC e.g. according to EN 1520:2011-06 / EN 771-3:2011	≥ 0,88	≥ 5		rotary	0,6	0,9

FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

### Performances

Characteristic resistance FI-P-10, FI-M-10, FI-X-10

Annex C 2

electronic copy of the eta by dibt: eta-17/0361



Table C3: Point thermal transmittance according EOTA Technical Report TR 025:2007-06						
anchor type	insulation thickness h <sub>D</sub> [mm]	point thermal transmittance χ [W/K]				
FI-P-8 surface mount	60 - 160	0				
FI-P-8 immerged mount	80 - 160	0				
FI-M-8 surface mount	60 - 260	0,004				
FI-M-8 immerged mount	80 - 260	0,002				
FI-X-8 surface mount	60 - 260	0,006				
FI-X-8 immerged mount	80 - 260	0,003				
FI-P-10 surface mount	30 - 220	0,001				
FI-P-10 immerged mount	50 - 220	0				
FI-M-10 surface mount	30 - 260	0,004				
FI-M-10 immerged mount	50 - 260	0,002				
FI-X-10 surface mount	30 - 260	0,007				
FI-X-10 immerged mount	50 - 260	0,003				

Table C4: Plate stiffness according EOTA Technical Report TR 026:2007-06							
anchor type	diameter of the anchor plate [mm]	load resistance of the anchor plate [kN]	plate stiffness [kN/mm]				
FI-P-8/FI-M-8/FI-X-8	60	1,09	0,5				
FI-P-10/FI-M-10/FI-X-10	60	1,02	0,5				

FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

**Performances** Point thermal transmittance, plate stiffness Annex C 3



Table C5: Displacements FI-P-8 and FI-P-10										
Base materials (refer Table C1, C2)	Bulk density ρ [kg/dm³]	Minimum Compressive strength f <sub>b</sub> [N/mm²]	Tension load N [kN] <b>FI-P-8 FI-P-10</b>		Displacements <sup> </sup>					
Concrete C20/25	≥ 2,25	≥ 30	0,17	0,17	1,5	1,4				
Concrete C50/60	≥ 2,30	≥ 65	0,25	0,25	1,5	1,8				
Clay bricks MZ	≥ 2,0	≥ 20	0,25	0,25	0,5	0,6				
Calcium silicate bricks KS	≥ 2,0	≥ 20	0,25	0,2	0,8	1,1				
Calcium silicate hollow block KSL	≥ 1,6	≥ 12	0,25	0,2	1,0	1,5				
Vertically perforated clay bricks HLZ	≥ 1,2	≥ 12	0,2	0,2	1,2	1,4				
Perforated clay bricks porotherm 25	≥ 0,8	≥ 10	0,13	0,13	0,6	0,5				
Autoclaved concrete blocks AAC2	≥ 0,35	≥ 2	0,25	0,17	0,8	1,3				
Autoclaved concrete blocks AAC7	≥ 0,65	≥ 3,5	0,3	0,2	1,3	1,8				
Lightweight concrete blocks LAC	≥ 0,88	≥ 5	0,2	0,2	0,9	1,5				

Table C6: Displacements FI-M-8 / FI-X-8 and FI-M-10 / FI-X-10									
Base materials (refer Table C1, C2)	Bulk density p [kg/dm³]	Minimum Compressive strength f <sub>b</sub> [N/mm²]	Tension load N [kN]		Displacements <sup>ō</sup> (N) [mm]				
			FI-M-8/ FI-X-8	FI-M-10/ FI-X-10	FI-M-8/ FI-X-8	FI-M-10/ FI-X-10			
Concrete C20/25	≥ 2,25	≥ 30	0,17	0,25	2,1	1,3			
Concrete C50/60	≥ 2,30	≥ 65	0,25	0,3	2,4	1,5			
Clay bricks MZ	≥ 2,0	≥ 20	0,25	0,3	2,0	0,8			
Calcium silicate bricks KS	≥ 2,0	≥ 20	0,25	0,3	0,7	1,0			
Calcium silicate hollow block KSL	≥ 1,6	≥ 12	0,25	0,3	1,0	1,3			
Vertically perforated clay bricks HLZ	≥ 1,2	≥ 12	0,2	0,3	1,6	1,7			
Perforated clay bricks porotherm 25	≥ 0,8	≥ 10	0,13	0,17	0,9	0,8			
Autoclaved concrete blocks AAC2	≥ 0,35	≥ 2	0,25	0,25	2,7	2,4			
Autoclaved concrete blocks AAC7	≥ 0,65	≥ 3,5	0,3	0,3	2,0	1,4			
Lightweight concrete blocks LAC	≥ 0,88	≥ 5	0,25	0,3	1,0	1,0			

### FI-P-8 / FI-M-8 / FI-X-8 / FI-P-10 / FI-M-10 / FI-X-10

Performances Displacements Annex C 4