



Approval body for construction products and types of construction

**Bautechnisches Prüfamt** 

An institution established by the Federal and Laender Governments



# **European Technical Assessment**

# ETA-17/0421 of 14 December 2017

English translation prepared by DIBt - Original version in German language

#### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

fischer Injection system Anchorstar Plus for masonry

Injection system for use in masonry

fischerwerke GmbH & Co. KG Klaus-Fischer-Straße 1 72178 Waldachtal DEUTSCHLAND

fischerwerke

26 pages including 3 annexes which form an integral part of this assessment

ETAG 029, April 2013, used as EAD according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011.



# **European Technical Assessment ETA-17/0421**

Page 2 of 26 | 14 December 2017

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Z3986.18 8.06.04-134/17



**European Technical Assessment ETA-17/0421** 

Page 3 of 26 | 14 December 2017

English translation prepared by DIBt

#### **Specific Part**

#### 1 Technical description of the product

The fischer Injection system Anchorstar Plus for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar Anchorstar Plus, Anchorstar Plus Low Speed and Anchorstar Plus High Speed, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

#### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

#### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See Annex C 1 – C 4
Characteristic resistance for bending moments	See Annex C 5
Displacements under shear and tension loads	See Annex C 5
Reduction Factor for job site tests (β-Factor)	See Annex C 6
Edge distances and spacing	See Annex C 7 – C8

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorages satisfy requirements for Class A1
Resistance to fire	No performance assessed

#### 3.3 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances there may be requirements (e.g. transposed European legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this European Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

Z3986.18 8.06.04-134/17





# **European Technical Assessment ETA-17/0421**

Page 4 of 26 | 14 December 2017

English translation prepared by DIBt

#### 3.4 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with guideline for European technical approval ETAG 029, April 2013 used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 14 December 2017 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow Head of Department


beglaubigt: Baderschneider

Z3986.18 8.06.04-134/17



#### Installation conditions part 1


Threaded rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

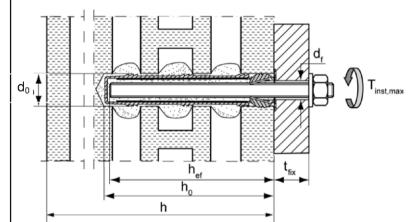

#### Pre-positioned installation

FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K

# Internal threaded anchors FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

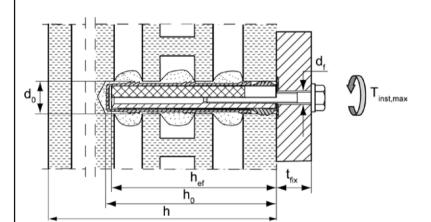

#### Pre-positioned installation

FIS H 16x85 K - FIS E 11x85 M6 and M8 FIS H 20x85 K - FIS E 15x85 M10 and M12

h<sub>ef</sub> = effective anchorage depth

 $h_0 =$  depth of drill hole  $t_{fix} =$  thickness of fixture

h = thickness of masonry

d<sub>0</sub>= nominal drill bit diameter

f= diameter of clearance hole in the fixture

 $T_{inst,max} = maximum torque moment$ 

### fischer Injectionsystem Anchorstar Plus for masonry

#### **Product description**

Installation condition, part 1: in perforated and solid brick masonry


Annex A 1




#### Installation conditions part 2

Threaded rods without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete


#### Pre-positioned installation

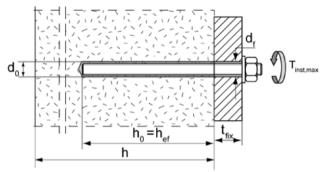





Internal threaded anchors FIS E without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete

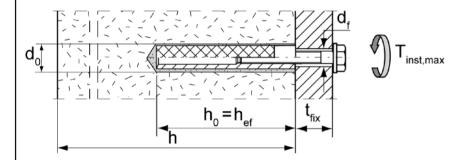

#### Pre-positioned installation

FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12

h<sub>ef</sub> = effective anchorage depth

 $h_0 =$  depth of drill hole  $t_{fix} =$  thickness of fixture

h = thickness of masonry

d<sub>0</sub>= nominal drill bit diameter

d<sub>f</sub>= diameter of clearance hole in the fixture


 $T_{inst,max} = maximum torque moment$ 

## fischer Injectionsystem Anchorstar Plus for masonry

#### **Product description**

Installation condition, part 2: in solid brick masonry and autoclaved aerated concrete

Annex A 2

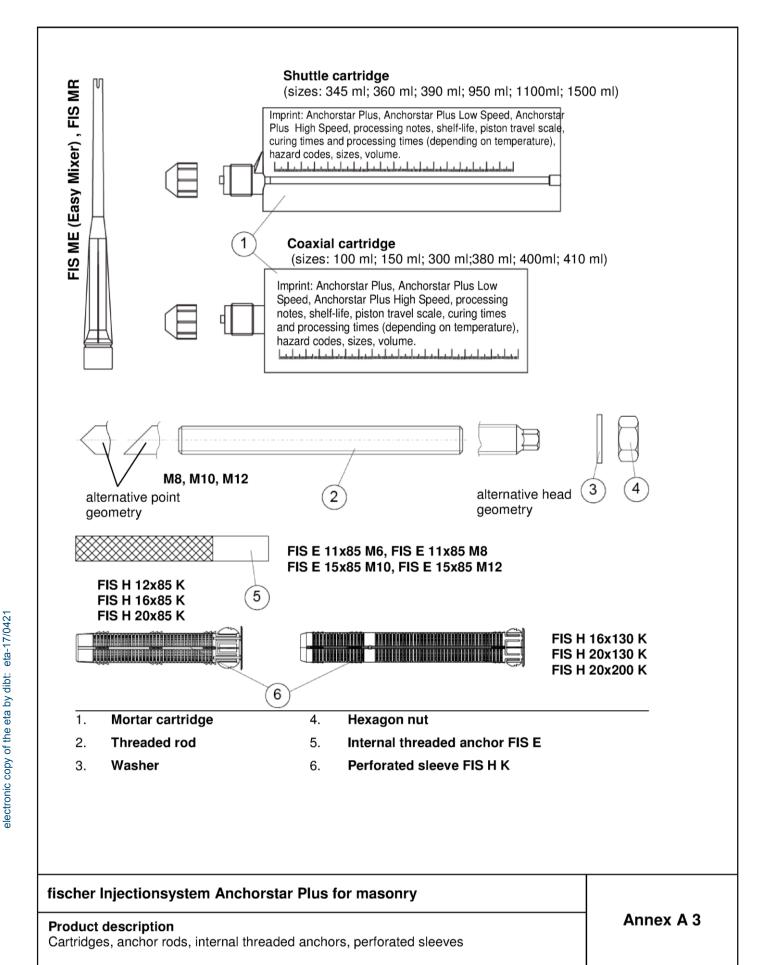



## Table A1: Materials

Part	Designation		Material		
1	Mortar cartridge	r	mortar, hardener; filler		
		Steel, zinc plated	Stainless steel A4	High corrosion- resistant steel C	
2	Threaded rod	Property class 5.8 or 8.8; ISO 898-1:2013 zinc plated ≥ 5µm, EN ISO 4042:1999 A2K or hot-dip galvanised EN ISO 10684:2004 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup>	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062	Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with $f_{yk}$ = 560 N/mm <sup>2</sup> 1.4565; 1.4529 EN 10088-1:2014 $f_{uk} \le 1000$ N/mm <sup>2</sup>	
		A <sub>5</sub> > 8%	EN 10088-1:2014 $f_{uk} \le 1000 \text{ N/mm}^2$ $A_5 > 8\%$	A <sub>5</sub> > 8%	
3	Washer ISO 7089:2000	zinc plated ≥ 5µm, EN ISO 4042:1999 A2K or hot-dip galvanised ISO 10684:2004	1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362 EN 10088-1:2014	1.4565;1.4529 EN 10088-1:2014	
4	Hexagon nut	Property class 5 or 8; EN ISO 898-2:2012 zinc plated ≥ 5µm, ISO 4042:1999 A2K or hot-dip galvanised ISO 10684:2004	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014	
5	Internal threaded anchor FIS E	Property class 5.8; EN 10277-1:2008-06 zinc plated ≥ 5µm, EN ISO 4042:1999 A2K	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014	
	Screw or threaded rod for internal threaded anchor FIS E	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5µm, ISO 4042:1999 A2K	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014	
6	Perforated sleeve FIS H K		PP / PE		

fischer Injectionsystem Anchorstar Plus for masonry	
Product description Materials	Annex A 4



#### Specifications of intended use

#### Anchorages subject to:

Static and quasi-static loads

#### Base materials:

- Solid brick masonry (Use category b) and autoclaved aerated concrete (Use category d), acc. to Annex B8.
   Note: The characteristic resistance is also valid for larger brick sizes and higher compressive strength of the masonry unit.
- Hollow brick masonry (use category c), according to Annex B8
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry and autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to ETAG 029, Annex B under consideration of the β-factor according to Annex C6, Table C4

#### **Temperature Range:**

I: From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)

#### Use conditions (Environmental conditions):

- Dry and wet structure (regarding injection mortar)
- Structures subject to dry internal conditions exist
   (zinc coated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)
  - Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Specifications	Annex B 1



#### Specifications of intended use

#### Design:

- The anchorages have to be designed in accordance with the ETAG 029, Annex C, Design method A under the responsibility of an engineer experienced in anchorages and masonry work
  - Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,s} = N_{Rk,p} = N_{Rk,b} = N_{Rk,pb}$$

$$V_{\mathsf{Rk}} = V_{\mathsf{Rk},s} = V_{\mathsf{Rk},b} \, = \, V_{\mathsf{Rk},c} \, = \, V_{\mathsf{Rk},pb}$$

Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the
region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The
position of the anchor is indicated on the design drawings

#### Installation:

- Category d/d: -Installation and use in dry structures
- · Category w/w: -Installation and use in dry and wet structures
- Hole drilling by hammer drill mode
- In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) see Annex B 4 (Table B1.3)
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or threaded rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E
- minimum curing time see Annex B5. Table B3
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:


Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A4, Table A1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored

Marking of the threaded rod with the envisage embedment depth. This may be done by the manufacturer of the rod or by a person on job site

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Specifications	Annex B 2



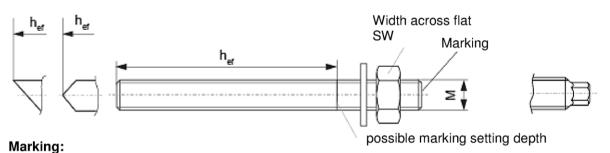

Property class (p.c.) 8.8, Stainless steel A4, p.c. 80 or high corrosion-resistant steel C, p.c. 80: • Stainless steel A4, property class 50 and high corrosion-resistant steel C, property class 50: ••

Table B1.1: Installation parameters for threaded rod without perforated sleeve

DIO DITTI IIIOGAIIAGI	on parameters for thread	<u> </u>		. <u>po o</u>	. <del> </del>		
Size			·	М8	M10	M12	
Nominal drill hole diame	eter	$d_{nom}=d_0$	[mm]	10	12	14	
Width across flat		SW	[mm]	13	17	19	
Effective anchorage dep	oth <sup>1)</sup>	$h_{\rm ef,min}$	[mm]		50		
Depth of drill hole $h_0 = h$	ef	h <sub>ef,max</sub>	[mm]	h-30	) and ≤ 20	0 mm	
Effective anchorage der	oth AAC	h <sub>ef,min</sub>	mm]	100			
Effective afficilities dep	DITAAC	h <sub>ef,max</sub>	[mm]	120			
Maximum torque mome	nt	$T_{inst,max}$	[Nm]	m] 10			
Max. torque moment for	autoclaved aerated concrete	$T_{inst,max}$	[Nm]	1 2			
Diameter of clearance	Pre-position anchorage	d <sub>f</sub> ≤	[mm]	9	12	14	
hole in the fixture	Push through anchorage	d <sub>f</sub> ≤	[mm]	11	14	16	

<sup>1)</sup>  $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.

#### fischer internal threaded anchor FIS E

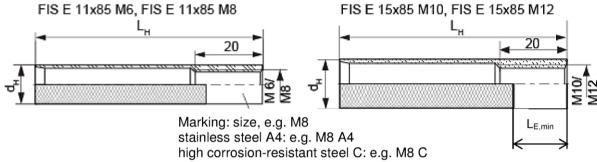


Table B1.2: Installation parameters for internal threaded anchor FIS E without perforated sleeve

Size FIS E			11x85 M6	11x85 M8	15x85 M10	15x85 M12
diameter of internal threaded anchor	$d_H$	[mm]	1	1	1	5
Nominal drill hole diameter	$d_{nom}=d_0$	[mm]	1	4	1	8
Depth of drill hole	$h_0$	[mm]			85	
Effective anchorage depth	$L_{H}=h_{ef}$	[mm]	85			
Maximum torque moment	$T_{inst,\;max}$	[Nm]	4		10	
Max. torque moment for		[Nm]		ı	,	,
autoclaved aerated concrete	T <sub>inst, max</sub>	[14111]	<b>'</b>			
Diameter of clearance hole in the	d <sub>f</sub> ≤	[mm]	7	9	12	14
fixture	u <sub>f</sub> =	[mm]	_ ′	9	12	14
Screw-in depth	$L_{E,min}$	[mm]	6	8	10	12

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Installation parameters, part 1	Annex B 3

# Perforated sleeves FIS H 12x85; 16x85; 16x130; 20x85; 20x130; 20x200 K

Marking:size D<sub>Sleeve</sub> x L<sub>Sleeve</sub> e.g. 16x85






Table B1.3: Installation parameters (threaded rod and internal threaded anchor with perforated sleeve; only pre-positioned anchorage)

Size FIS HK			12x85	16x85	16x130 <sup>2)</sup>	20x85	20x130 <sup>2)</sup>	20x200 <sup>2)</sup>
Nominal drill hole diameter $(d_0 = D_{Sleeve})$	$d_{nom}\!\!=\!\!d_0$	[mm]	12		16		20	
Depth of drill hole	h <sub>0</sub>	[mm]	90	90	135	90	135	205
Effective anchorage	$h_{\rm ef,min}$	[mm]	85	85	110	85	110	180
depth <sup>1)</sup>	h <sub>ef,max</sub>	[mm]	85	85	130	85	130	200
Size of threaded rod		[-]	M8	M8	, M10		M12	
Size of internal threaded anchor		[-]		11x85		15x85		
Maximum torque moment threaded rod and internal threaded anchor	$T_{inst,max}$	[mm]				2		

electronic copy of the eta by dibt: eta-17/0421

fischer Injectionsystem Anchorstar Plus for masonry Annex B 4 Intended Use Installation parameters, part 2

 $<sup>^{1)}</sup>$   $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.  $^{2)}$  Bridging of unbearing layer (e.g. plaster) possible



# Cleaning brush BS (Steel brush)



Only for solid bricks and autoclaved aerated concrete

#### Table B2: Parameters of steel brush

Drill hole diameter	do	[mm]	10	12	14	16	18	20
Brush diameter	d <sub>b,nom</sub>	[mm]	11	14	16	20	20	25

#### Table B3: Maximum processing time of the mortar and minimum curing time (During the curing time of the mortar the masonry temperature may not fall below the listed minimum

temperature).

Tamananah maa			Minimum curing time '' t <sub>cure</sub> [minutes]					
Temperature at anchoring base [ °C ]			Anchorstar Plus High Speed <sup>3)</sup>	Anchorstar Plus <sup>2)</sup>	Anchorstar Plus Low Speed <sup>2)</sup>			
-10	to	-5	12 hours					
>-5	to	±Ο	3 hours	24 hours				
>±0	to	+5	90	3 hours	6 hours			
>+5	to	+10	45	90	3 hours			
>+10	to	+20	30	60	2 hours			
>+20	to	+30		45	60			
>+30	to	+40		35	30			

	System- temperature (mortar) [ °C ]	Maximum processing time t <sub>work</sub> [minutes]					
		Anchorstar Plus High Speed	Anchorstar Plus <sup>2)</sup>	Anchorstar Plus Low Speed <sup>2)</sup>			
	±0	5					
	+5	5	13	20			
	+10	3	9	20			
	+20	1	5	10			
	+30		4	6			
	+40		2	4			

<sup>&</sup>lt;sup>1)</sup> For wet bricks the curing time must be doubled <sup>2)</sup> Minimum cartridge temperature +5°C

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use	Annex B 5
Steel brush	
Processing times and curing times	

<sup>3)</sup> Minimum cartridge temperature ±0°C


#### Installation instructions Part 1


Installation and Preparing the cartridge in solid brick and autoclaved aerated concrete (without perforated sleeve)


1 h<sub>0</sub> d<sub>0</sub>

Drill the hole. Depth of drill hole h<sub>0</sub> and drill hole diameter d<sub>0</sub> see Table **B1.1** or **B1.2** 

2









Blow out the drill hole two times. Brush the drill hole two times (see Table B2) and blow out two times again

3




Remove the sealing cap



Screw on the static mixer (the spiral in the static mixer must be clearly visible)

4




Place the cartridge into a suitable dispenser.



Press out approximately 10 cm of material until the mortar is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed off.

5




Fill approximately 2/3 of the drill hole with mortar Always begin from the bottom of the hole to eliminate voids<sup>1)</sup>.



For push through installation (not FIS E) fill the annular gap also with mortar.

6




Only use clean and oil-free anchor elements. Mark the threaded rod for setting depth. Press the threaded rod or internal threaded anchor FIS E down to the bottom of the hole, turning it slightly by hand while doing. After inserting the anchor element, excess mortar must emerge around the anchor element.

7

electronic copy of the eta by dibt: eta-17/0421



Do not touch. Minimum curing time t<sub>cure</sub> see Table **B3** 



Mounting the fixture
T<sub>inst,max</sub> see Table **B1.1** or **B1.2** 

# fischer Injectionsystem Anchorstar Plus for masonry

#### Intended Use

Installation instructions part 1 in solid brick and autoclaved aerated concrete

Annex B 6

<sup>1)</sup> For the exact quantity of mortar see manufacturer's specification.



#### Installation instructions Part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage)

1

Drill the hole (hammer drill). Depth of drill hole h<sub>0</sub> and drill hole diameter d<sub>0</sub> see Table **B1.3**  When install perforated sleeves in solid bricks or solid areas of hollow bricks, also clean the hole by blowing out and brushing




Remove the sealing cap



Screw on the static mixer (the spiral in the static mixer must be clearly visible)

3




Place the cartridge into a suitable dispenser



Press out approximately 10 cm of material until the mortar is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed

off




Insert the perforated sleeve flush with the surface of the masonry or plaster



Fill the perforated sleeve completely with mortar beginning from the bottom of the hole<sup>1)</sup>.

5






Only use clean and oil-free anchor elements. Mark the threaded rod for setting depth. Insert the threaded rod or the internal threaded anchor FIS E by hand using light turning motions until reaching the setting depth marking (threaded rod) or flush with the surface (internal threaded anchor).

6



Do not touch. Minimum curing time t<sub>cure</sub> see Table **B3** 



Mounting the fixture. T<sub>inst.max</sub> see Table B1.3

# fischer Injectionsystem Anchorstar Plus for masonry Intended Use Installation instructions part 2 in hollow brick masonry Annex B 7

<sup>1)</sup> For the exact quantity of mortar see manufacturer's specification.

English translation prepared by DIBt



# Table B 4: Summary of bricks and blocks

Brick No. 1 Solid brick Mz according to EN 771-2 $\rho \ge 1.8$ [kg/dm <sup>3</sup> ] fb $\ge 10$ or 20 [N/mm <sup>2</sup> ]	1,10		Brick No. 6 Perforated brick HLz according to EN 771-1 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 20 \text{ [N/mm}^2\text{]}$		14 + 8 + 28 + 28 + 28 + 28 + 28 + 28 + 28
Brick No. 2 Solid sand-lime brick according to EN 771-2 $\rho \ge 1,8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20 \text{ [N/mm}^2\text{]}$	150		Brick No. 7 Perforated brick HLz according to EN 771-1 $\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ [N/mm}^2\text{]}$	Training to the state of the st	
Brick No. 3 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20 \text{ [N/mm}^2\text{]}$	340		Brick No. 8 Perforated brick HLz filled with mineral wool according to EN 771-1 ρ≥ 0,6 [kg/dm³] fb≥ 8 [N/mm²]		29 10 132 55
Brick No. 4 Sand-lime hollow brick according to EN 771-2 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 12 \text{ or } 20$ [N/mm <sup>2</sup> ]	\$15 P	21 42 71 42	Brick-No. 9 Light-weight concrete hollow block HbI according to EN 771-1 $\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 4 \text{ [N/mm}^2\text{]}$	OR PARTY OF THE PA	8 8 76 76 76 76 76 76 76 76 76 76 76 76 76
Brick No. 5 Perforated brick HLz according to EN 771-1 $\rho \ge 0.9 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ [N/mm}^2\text{]}$	The state of the s	2. 12. 2. 10 -1210	Brick No. 10 Autoclaved aerated concrete block $\rho \ge 0.35, 0.5 \text{ or}$ $0.65 \text{ [kg/dm}^3\text{]}$ fb $\ge 2, 4 \text{ or } 6$ [N/mm <sup>2</sup> ]		

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Types and dimensions of blocks and bricks	Annex B 8



Table B5.1: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)2)</sup> and perforated or solid bricks

Kind of masonry	Brick	Valid anchor rods, internal threaded rods and perforated sleeves					
Brick No. 1 Solid brick Mz according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ [N/mm²]	THE THE PARTY OF T		M8; M10; M12 FIS E 11x85				
Brick No. 2 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8$ [kg/dm <sup>3</sup> ] fb $\ge 10$ or 20 [N/mm <sup>2</sup> ]	116		M8; M10; M12 FIS E 11x85				
Brick No. 3 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ [N/mm <sup>2</sup> ]	36		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K				
Brick No. 4 Sand-lime hollow brick according to EN 771-2 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 12 \text{ or } 20$ [N/mm <sup>2</sup> ]	25 TE		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K				
Brick No. 5 Perforated brick HLz according to EN 771-1 ρ≥ 0,9 [kg/dm³] fb≥ 10 [N/mm²]	113		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K				
Brick No. 6 Perforated brick HLz according to EN 771-1 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 20 \text{ [N/mm}^2\text{]}$			FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K				

 $<sup>^{1)}</sup>$  Other combinations can be used after job site tests acc. to ETAG 029, Annex B.  $^{2)}$  Sleeve/anchor rod combination see table B1.3

The  $\beta$ - factor for this job site tests are given in Table C4 Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 1	Annex B 9



Table B5.2: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)2)</sup> and perforated or solid bricks

Kind of masonry	Brick	Valid anchor rods internal threaded rods and perforated sleeves				
Brick No. 7 Perforated brick HLz according to EN 771-1 $\rho \ge 1.0 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ [N/mm}^2\text{]}$	TH QUO		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 20x130 K			
Brick No. 8 Perforated brick HLz filled with mineral wool according to EN 771-1 ρ≥ 0,6 [kg/dm³] fb≥ 8 [N/mm²]	SAS		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K FIS H 20x200 K			
Brick-No. 9 Light-weight concrete hollow block Hbl according to EN 771-1 $\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 4 \text{ [N/mm}^2\text{]}$	200		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K			
Brick No. 10 Autoclaved aerated concrete block			M8; M10; M12			
$\rho \ge 0,35, 0,5 \text{ or } 0,65 \text{ [kg/dm}^3\text{]}$ fb $\ge 2, 4 \text{ or } 6$ [N/mm <sup>2</sup> ]			FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12			

<sup>&</sup>lt;sup>1)</sup> Other combinations can be used after job site tests acc. to ETAG 029, Annex B. <sup>2)</sup> Sleeve/anchor rod combination see table B1.3

The  $\beta$ - factor for this job site tests are given in Table C4

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 2	Annex B 10



Table C1.1: Characteristic values of resistance under tension loads and under shear loads

	Density ρ			Effect ancho		Characteristic resistance [kN]		
Brick	[kg/dm <sup>3</sup> ]	Perforated	Anchor size or screw	depth		$N_{Rk}$		$V_{Rk}$
	Compressive strength f <sub>b</sub>	sleeve FIS HK	size in internal threaded anchor	h <sub>ef,min</sub>	h <sub>ef,max</sub>	Temp. 50/80°C		All categories
	[N/mm²]			[mm]	[mm]	d/d	w/w	categories
			M8	50	200	4,0	2,5	2,5
			M10	50	79	3,5	2,0	4,0
			M10	80	199	5,0	3,0	
	ρ≥ 1,8		M10	200	200	8,5	7,5	8,5
	f <sub>b</sub> ≥ 10		M12	50	79	3,0	2,0	4,0
116			M12	80	199	5,5	3,5	4,0
E			M12	200	200	8,0	5,0	8,5
			FIS E11x85 M6/ M8,	85	85	5,5	3,5	2,5
340		without	M8	50	200	5,5	3,5	4,0
No.1			M10	50	79	5,0	3,0	6.0
Solid brick Mz	ρ ≥ 1,8 f <sub>b</sub> ≥ 20		M10	80	199	7,0	4,5	6,0
			M10	200	200	8,5	8,5	8,5
			M12	50	79	4,5	3,0	5,5
			M12	80	199	8,0	5,0	
			M12	200	200	8,5	7,0	8,5
			FIS E11x85 M6/ M8,	85	85	8,0	5,0	4,0
			M8	50	200	2,5 1,5	1,5	4.0
			M10	50	79			
			M10	80	199			4,0
	ρ≥ 1,8		M10	200	200	8,5	6,0	
*	f <sub>b</sub> ≥ 10		M12	50	79	2,5 1,5	1,5	5,0
115			M12	80	199	2,5	1,5	
E Z			M12	200	200	8,5	6,5	
		without	FIS E11x85 M6/ M8,	85	85	2,5	1,5	3,0
No.2 Solid sand-lime brick			M8	50	200			
			M10	50	79	3,5	2,0	5,5
			M10	80	199			, 5,5
	ρ ≥ 1,8 f <sub>b</sub> ≥ 20		M10	200	200	8,5	8,5	
	10 - 20		M12	50	79	3,5 2,0		
			M12	80	199			7,0
			M12	200	200	8,5	8,5	
			FIS E11x85 M6/ M8,	85	85	3,5	2,0	4,0

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Performances Characteristic values of resistance under tension loads and under shear loads, part 1	Annex C 1

electronic copy of the eta by dibt: eta-17/0421



Table C1.2: Characteristic values of resistance under tension loads and under shear loads

	Density ρ		Effect Anchor size or anchor			Characteristic resistance [kN]		
Brick	[kg/dm <sup>3</sup> ]	sleeve Sive FIS HK	d screw size in	depth		$N_{Rk}$		$V_{Rk}$
	Compressive strength f <sub>b</sub>			h <sub>ef.min</sub>	h <sub>ef.max</sub>	Temp. 50/80°C		All
	[N/mm <sup>2</sup> ]			[mm]	[mm]	d/d	w/w	categories
		12x85	M8	85	85	6,0	3,5	3,0
		16x85	FIS E 11x85 M6	85	85	3,5	2,0	3,0
118.4	ρ ≥ 1,8 f <sub>b</sub> ≥ 10	16x85	M8/M10, FIS E 11x85 M8	85	85	3,5	2,0	
413		20x85	M12, FIS E 15x85	85	85	8,5	6,5	3,5
.32.		16x130	M8/M10	110	130	3,5	2,0	
340		20x130	M12	110	130	7,0	4,5	
	ρ≥1,8	12x85	M8	85	85	8,5	5,0	4,5
No.3	f <sub>b</sub> ≥ 20	16x85	FIS E 11x85 M6	85	85	5,5	3,0	4,5
Solid sand-lime brick		16x85	M8/M10, FIS E 11x85 M8	85	85	5,5	3,0	
		20x85	M12, FIS E 15x85	85	85	8,5	8,5	5,5
		16x130	M8/M10	110	130	5,0	3,0	
		20x130	M12	110	130	8,5	6,0	
		12x85	M8	85	85	2,5	2,5	2,5
	ρ≥ 1,4 f <sub>b</sub> ≥ 12	16x85	FIS E 11x85 M6	85	85	3,0	2,5	2,5
		16x85	M8/M10, FIS E 11x85 M8	85	85	3,0	2,5	4,5
175		20x85	M12, FIS E 15x85	85	85			
FF 68.89		16x130	M8/M10	110	130	3,5	3,0	4,5
		20x130	M12	110	130			
340		12x85	M8	85	85	4,5	4,0	4,5
No.4 Sand-lime hollow		16x85	FIS E 11x85 M6	85	85	5,0	4,0	4,0
brick	ρ≥1,4 f <sub>b</sub> ≥20	16x85	M8/M10, FIS E 11x85 M8	85	85	5,0	4,5	7,5
	.5 – 20	20x85	M12, FIS E 15x85	85	85			
		16x130	M8/M10	110	130	6,0	5,5	7,5
		20x130	M12	110	130			

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Performances Characteristic values of resistance under tension loads and under shear loads, part 2	Annex C 2



Table C1.3: Characteristic values of resistance under tension loads and under shear loads

	snear ioad	5							
	Density p		Anchor size or	Effect anchorage	Characteristic resistanc [kN]				
	[kg/dm <sup>3</sup> ]	Perforated	screw size in			N <sub>Rk</sub>		$V_{Rk}$	
Brick	Compressive strength f <sub>b</sub>	sleeve FIS HK	internal threaded anchor	_		Temp. 50/80°C		All	
	[N/mm <sup>2</sup> ]			h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d	w/w	categories	
175		12x85	M8	85	85	4,0	3,5	4,0	
2		16x85	FIS E 11x85 M6	85	85	3,5	3,5	4,0	
	ρ≥ 0,9 f <sub>b</sub> ≥ 10	16x85	M8/M10, FIS E 11x85 M8	85	85	3,5	3,5	5,5	
***	1 <sub>b</sub> ≥ 10	20x85	M12, FIS E 15x85	85	85	5,0	4,5	6,0	
No.5 Perforated brick		16x130	M8/M10	110	130	5,0	4,5	5,5	
		20x130	M12	110	130	5,0	4,5	6,0	
***		12x85	M8	85	85	4,0	3,5	7,5 (5,5) <sup>1)</sup>	
2000		16x85	FIS E 11x85 M6	85	85	2	,5	4,0	
	$\rho \ge 1.4$ $f_b \ge 20$	16x85	M8/M10, FIS E 11x85 M8	85	85	2,5		4,5	
No.6 Perforated brick		20x85	M12, FIS E 15x85	85	85	3,0		8,5 (5,5) <sup>1)</sup>	
Te canol	ρ≥ 1,0 f <sub>b</sub> ≥ 10	12x85	M8	85	85	0	,9		
000		16x85	M8/M10, FIS E 11x85	85	85			1,2	
		20x85	M12, FIS E 15x85	85	85	2,5			
275 (620)		16x130	M8/M10	110	130			1,5	
No.7 Perforated brick		20x130	M12	110	130	3,5	3,0	1,5	
20		12x85	M8	85	85	2,0	2,0	2,5	
S. Carlo		16x85	FIS E 11x85 M6	85	85	2,0	1,5	2,5	
25	ρ≥ 0,6	16x85	M8/M10, FIS E 11x85 M8	85	85	2,0	1,5	3,0	
***************************************	f <sub>b</sub> ≥ 8	20x85	M12, FIS E 15x85	85	85	2,0	2,0	1,5	
		16x130	M8/M10	130	130	3,0	2,5	3,0	
No.8 Perforated brick		20x130	M12	110	130	2,0	2,0	1,5	
		20x200	M12	180	200	3,0	3,0	1,5	
249		12x85	M8	85	85				
3		16x85	M8/M10, FIS E 11x85	85	85				
	ρ≥ 1,0	20x85	M12, FIS E 15x85	85 85 3,0		,0	2,0		
*	f <sub>b</sub> ≥ 4	16x130	M8/M10	110	130				
No.9 Light-weight concrete hollow block		20x130	M12	110	130				

Characteristic value of pushing out of one brick  $V_{Rk,pb} = 5.5 \text{ kN}$ 

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Performances Characteristic values of resistance under tension loads and under shear loads, part 3	Annex C 3



2,5

3,5

Table C1.4:	Characte shear loa		ues of resistan	ce un	der ter	sion	loads	s and und	
				anch	ctive orage pth	Characteristic resistance [kN]			
Brick	Density p	Perforated	Anchor size or screw size in			N	Rk	$V_{Rk}$	
BIICK	[kg/dm³] -	sleeve FIS HK	internal threaded anchor			Temp. 50/80°C		All	
	Compressive strength f <sub>b</sub> [N/mm <sup>2</sup> ]			h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d	w/w	categories	
200	ρ≥ 0,35 f <sub>b</sub> ≥ 2		M8	100	120	1,5		1,2	
		without	M10	100	120			1,2	
280			M12	100	120			1,5	
			FIS E 11x85 FIS E 15x85	85				1,2	
			M8	100	120	2	,0	2,5	
No.10 Autoclaved	0 > 0 5		M10	100	120	2,5		2,0	
Aerated concrete block	ρ≥ 0,5 f <sub>b</sub> ≥ 4	without	M12	100	120			2,5	
			FIS E 11x85 FIS E 15x85	85		2,0		2,0	
			M8	100	120	3,5	3,0	3,0	
	ρ≥ 0,65		M10	100	120	5,0	15	3,0	
	$f_b \ge 0.65$	without	M12	100	120	5,0	4,5	3,5	
	.0		EIO E 11:05						

FIS E 11x85

FIS E 15x85

85

Imaging of the bricks are not scaled

fischer Injectionsystem Anchorstar Plus for masonry	
Performances Characteristic values of resistance under tension loads and under shear loads, part 4	Annex C 4

English translation prepared by DIBt



Table C2: Characteristic bending moments for threaded rods

Size	•				M8	M10	M12
		Zina platad stool	Proporty class	5.8 [Nm]	19	37	65
g	Zinc-plated steel	Property class	8.8 [Nm]	30	60	105	
bending Ik,s	Stainless stool A4	Droporty along	50 [Nm]	19	37	65	
þe	pe staini	Stainless steel A4	Property class	70 [Nm]	26	52	92
stic be			80[Nm]	30	60	105	
teri	terii It			50 [Nm]	19	37	65
Characteristic moment M <sub>R</sub>	High corrosion-resistant steel C	Property class	70 <sup>1)</sup> [Nm]	26	52	92	
S E				80 [Nm]	30	60	105

 $<sup>^{1)}</sup> f_{uk} = 700 \text{ N/mm}^2; f_{vk} = 560 \text{ N/mm}^2$ 

Table C2.1: Characteristic bending moments for internal threaded anchors FIS E

Size FIS E				11x85 M6	11x85 M8	15x85 M10	15x85 M12
Characteristic bending moments M <sub>RK,S</sub>	zinc	Property	5.8 [Nm]	8	19	37	65
	plated steel,	class of screw	8.8 [Nm]	12	30	60	105
	stainless steel A4	Property class of screw	70 [Nm]	11	26	52	92
	high corrosion resistant steel C	Property class of screw	70 [Nm]	11	26	52	92

# Tabelle C3: Displacements under tension loads and shear loads

Material	N [kN]	$\delta N_0$ [mm]	δN∞ [mm]	V [kN]	δV <sub>0</sub> [mm]	δV∞ [mm]
solid units and autoclaved aerated concrete	N <sub>Rk</sub> 1,4 * γ <sub>M</sub>	0,03	0,06	$\frac{V_{Rk}}{1,4*\gamma_M}$	0,59	0,88
hollow units	N <sub>Rk</sub> 1,4 * γ <sub>M</sub>	0,03	0,06	V <sub>Rk</sub>	1,71	2,56

fischer Injectionsystem Anchorstar Plus for masonry	
Performances Characteristic bending moments; displacements	Annex C 5

electronic copy of the eta by dibt: eta-17/0421



#### $\beta\text{-}$ factor for job site tests according to ETAG 029, Annex B Table C4:

Using categories	w/w	d/d		
Temperature range	50/80	50/80		
Brick	Size			
	M8	0,57		
Solid brick	M10	0,59	0,96	
	M12 FIS E 11x85 FIS E 15x85	0,60		
Hollow brick	All sizes	0,86	0,96	
Autoclaved aerated concrete	All size	0,73	0,81	

fischer Injectionsystem Anchorstar Plus for masonry	
Performances	Annex C 6
β- factors for job site tests	




#### Edge distance and spacing Table C5:

Direction t	o bed joint		_	L			Group factor		Min. thickness		
Brick No.	$h_{ef}$	C <sub>cr</sub> =C <sub>min</sub>	S <sub>min</sub>	S <sub>cr</sub>	S <sub>min</sub>	S <sub>cr</sub>	Т				of the masonry members
Briok 140.	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	$\alpha_{\text{g},\text{N}}$	$\alpha_{g,V}$	$\alpha_{\text{g,N}}$	$\alpha_{g,V}$	[mm]
	50	100	7	5	60 <sup>1)</sup>	150	2	2	1,5	1,4	
1	80	100	7	5	60 <sup>1)</sup>	240	2	2	1,5	1,4	
	200	150	7	5	2	40			2		
	50	100	7	5	2	40			2		
2	80	100	7	75		40	2				
	200	150	7	5	2	40	2				
3	85	100	1	15	2	40	2				
3	130	100	1	15	2	40		2			h <sub>ef</sub> + 30
4	all sizes	100	1	15	100	240	2	2	1,5	1,5	(≥ 80)
5	all sizes	100	1.	15	2	40			2		
6	all sizes	100	1	15	2	40		_	2		
7	all sizes	100	100	240	100	375 (500) <sup>2)</sup>	1	1	1	1	
8	all sizes	120	24	15 250		2					
9	all sizes	80	24	40	3	365		2			]
10	all sizes	100	25	50	3	00	2				

fischer Injectionsystem Anchorstar Plus for masonry Annex C 7 **Performances** Edge distance and spacing

 $<sup>^{1)}</sup>$  only valid for tension loads, for shear loads  $s_{min} \big\| = s_{cr} \big\|$  spacing depending on brick dimension, brick dimension see table B4, brick 7

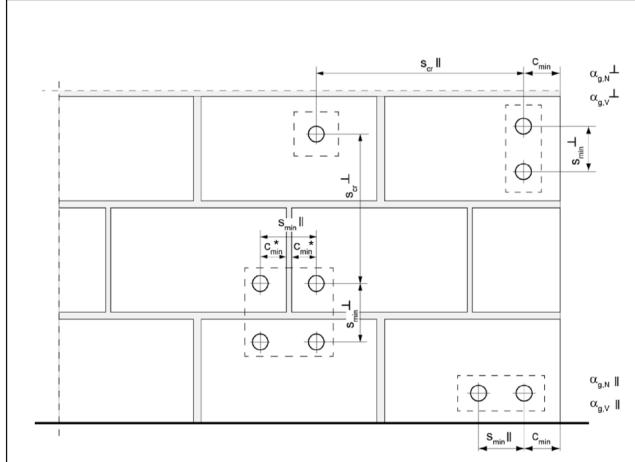

\* Only, if joints are visible and vertical joints are not filled with mortar

 $s_{min} II = Minimum spacing parallel to bed joint$ 

 $s_{min}^{\perp}$  = Minimum spacing vertical to bed joint

s<sub>cr</sub> II = Characteristic spacing parallel to bed joint

 $s_{cr}^{\perp}$  = Characteristic spacing vertical to bed joint

 $c_{cr} = c_{min}$  = Edge distance

 $\alpha_{o,N}$  II = Group factor for tension load parallel to bed joint

 $\alpha_{o,V}$  II = Group factor for shear load parallel to bed joint

 $\alpha_{a,N} \perp$  = Group factor for tension load vertical to bed joint

 $\alpha_{\text{GV}} \perp$  = Group factor for shear load vertical to bed joint

For  $s > s_{cr}$   $\alpha_q = 2$ 

For  $s_{min} \le s \le s_{cr}$   $\alpha_g$  according to table C5  $N^g_{Rk} = \alpha_{g,N} \cdot N_{Rk}$ ;  $V^g_{Rk} = \alpha_{g,V} \cdot V_{Rk}$  (Group of 2 anchors)  $N^g_{Rk} = \alpha_{g,N} \coprod \bullet \alpha_{g,N} \coprod \bullet N_{Rk}$ ;  $V^g_{Rk} = \alpha_{g,V} \coprod \bullet \alpha_{g,V} \coprod \bullet V_{Rk}$  (Group of 4 anchors)

#### fischer Injectionsystem Anchorstar Plus for masonry

#### **Performances**

electronic copy of the eta by dibt: eta-17/0421

Definition of minimum edge distance, minimum spacing and group factors

Annex C 8