

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-11/0273**  
**of 27 June 2018**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Trade name of the construction product

Product family  
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment  
contains

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Rebar connection with BTI  
injection mortar UVT Top-Z

Systems for post-installed rebar  
connections with mortar

BTI Befestigungstechnik GmbH & Co. KG  
Salzstraße 51  
74653 Ingelfingen  
DEUTSCHLAND

BTI Herstellwerk 1  
BTI manufacturing plant 1

20 pages including 3 annexes which form an integral part  
of this assessment

EAD 330087-00-0601

**European Technical Assessment**

**ETA-11/0273**

English translation prepared by DIBt

**Page 2 of 20 | 27 June 2018**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The subject of this European Technical Assessment is the post-installed connection, by anchoring or overlap connection joint, of reinforcing bars (rebars) in existing structures made of normal weight concrete, using the "Rebar connection with BTI Injection mortar UVT Top-Z" in accordance with the regulations for reinforced concrete construction.

Reinforcing bars made of steel with a diameter  $\phi$  from 8 to 40 mm or the rebar anchor FRA from sizes 12, 16 and 20 according to Annex A and injection mortar UVT Top-Z are used for rebar connections. The rebar is placed into a drilled hole filled with injection mortar and is anchored via the bond between rebar, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the rebar connection of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance under static and quasi-static loading	See Annex C 1

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	No performance assessed

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330087-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 27 June 2018 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department


*beglaubigt:*  
Baderschneider

Installation anchor


**Figure A1:**  
Overlap joint with existing reinforcement for rebar connections of slabs and beams

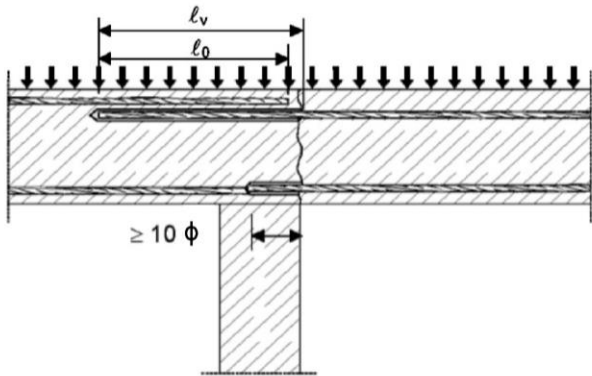


**Figure A3:**  
End anchoring of slabs or beams (e.g. designed as simply supported)

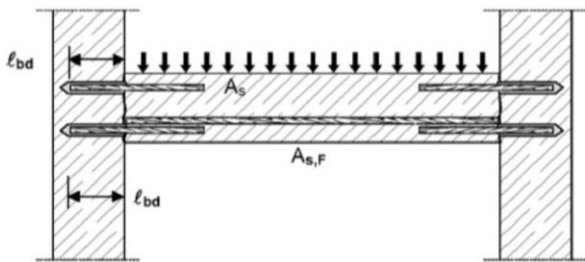


**Figure A5:**  
Anchoring of reinforcement to cover the enveloped line of acting tensile force in the bending member

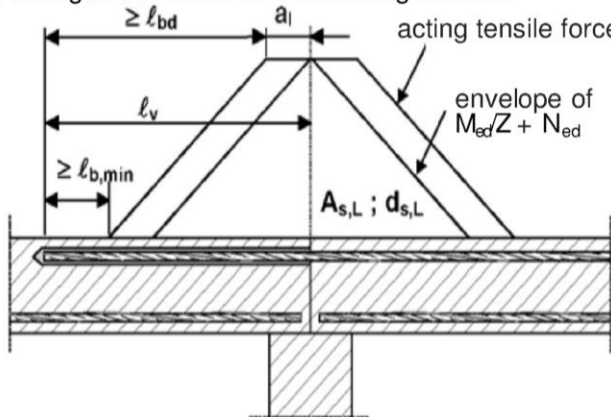

**Figure A2:**  
Overlap joint with existing reinforcement at a foundation of a column or wall where the rebars are stressed

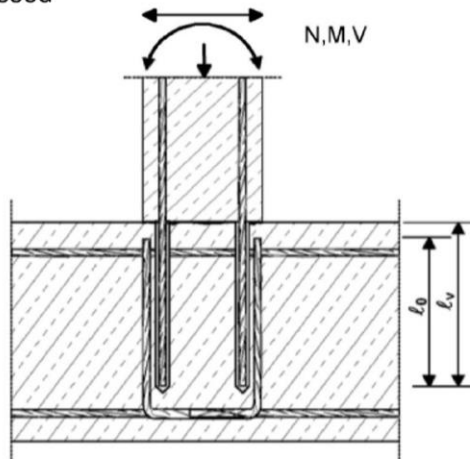

**Figure A4:**  
Rebar connection for stressed primarily in compression

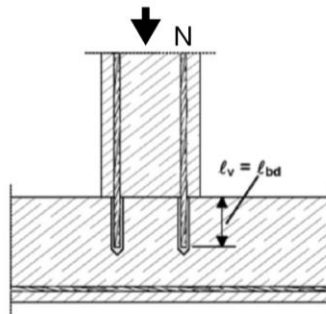

Note to **Figure A1** to **A5**:

In the Figures no traverse reinforcement is plotted, the traverse reinforcement shall comply with EN 1992-1-1: 2004+AC:2010.


Preparing of joints according to **Annex B 2**

Rebar connection with BTI injection mortar UVT Top-Z


**Product description**  
Installed condition and examples of use for rebars

**Annex A 1**

## Installation anchor

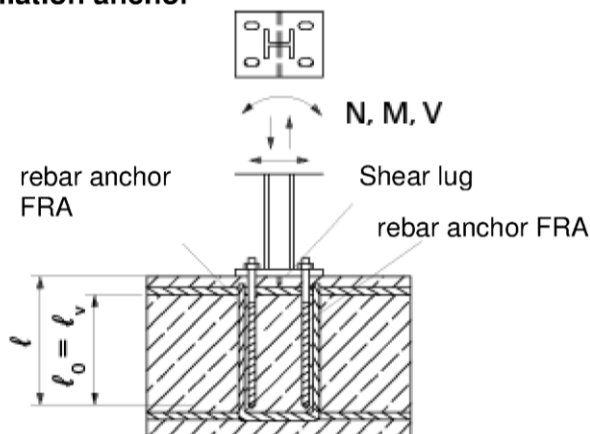


**Figure A6:** Lap to a foundation of a column under bending.

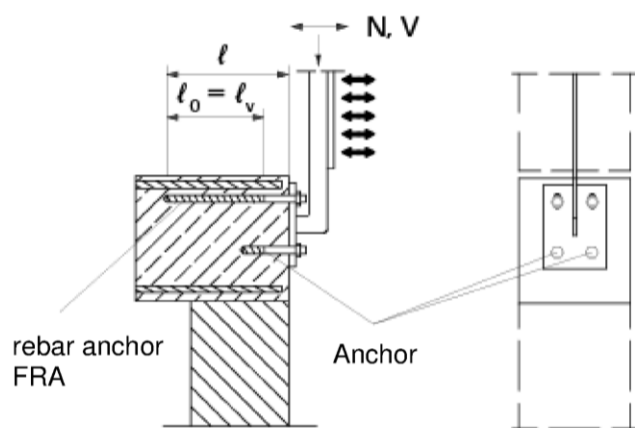

**Figure A7:** Lap of the anchoring of guardrail posts.

In the anchor plate, the drill holes for the rebar anchors FRA have to be designed as elongated holes with axial direction to the shear force.

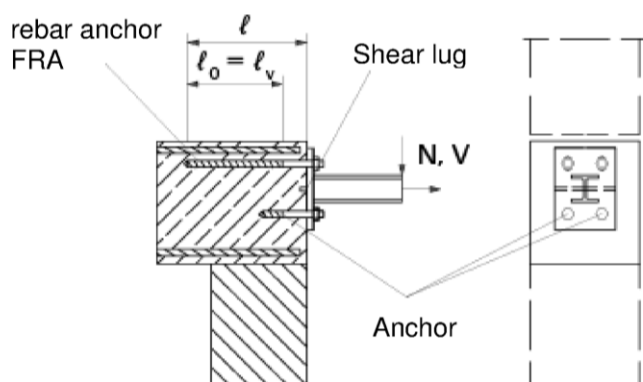

**Figure A8:** Lap of the anchoring of cantilevered building components.

In the anchor plate, the drill holes for the rebar anchors FRA have to be designed as elongated holes with axial direction to the shear load.

The required transverse reinforcement acc. to EN 1992-1-1:2004+AC:2010 is not shown in the figures. **The rebar anchor FRA may be only used for axial tensile force.** The tensile force must be transferred by lap to the existing reinforcement of the building. The transfer of the shear force has to be ensured by suitable measure, e.g. by means of shear force or anchors with European Technical Approval/Assessment (ETA)

## Rebar connection with BTI injection mortar UVT Top-Z

### Product description

Installed condition and examples of use for rebar anchor FRA



## Annex A 2

### Injection cartridge

Sizes: 390 ml, 585 ml, 1500 ml




Sealing cap

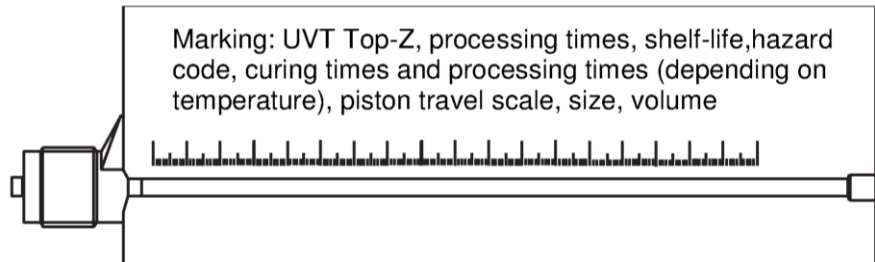

Static mixer

### rebar anchor FRA 12, 16, 20

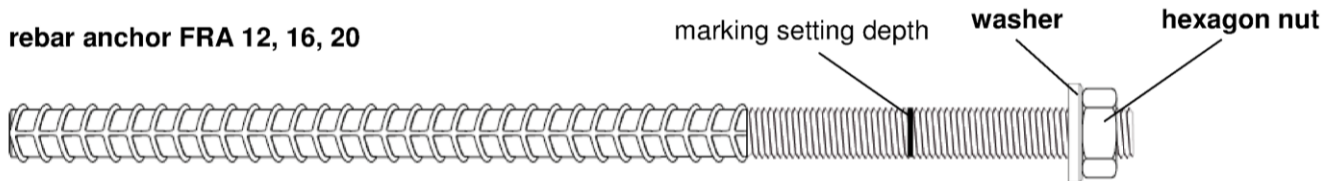

### Reinforcing bar (rebar)

φ8, φ10, φ12, φ14, φ16, φ20, φ22, φ24, φ25, φ26, φ28, φ30, φ32, φ34, φ36, φ40



marking setting depth

### Rebar connection with BTI injection mortar UVT Top-Z

#### Product description

Injection mortar; reinforcing bar, rebar anchor FRA

### Annex A 3



Figure A9: Properties of reinforcing bars (rebar)



- The minimum value of related rip area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- The maximum outer rebar diameter over the rips shall be:
  - The nominal diameter of the rip  $\phi + 2 \cdot h$  ( $h \leq 0,07 \cdot \phi$ )
  - ( $\phi$ : Nominal diameter of the bar;  $h$ : rip height of the bar)

Table A1: Materials of rebars

Designation	Reinforcing bar (rebar)
Reinforcing bar EN 1992-1-1:2004+AC:2010, Annex C	Bars and de-coiled rods class B or C with $f_{yk}$ and $k$ according to NDP or NCL of EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$


Rebar connection with BTI injection mortar UVT Top-Z

Product description  
Properties and materials of rebars

Annex A 4



**Figure A10: Properties of rebar anchors FRA**

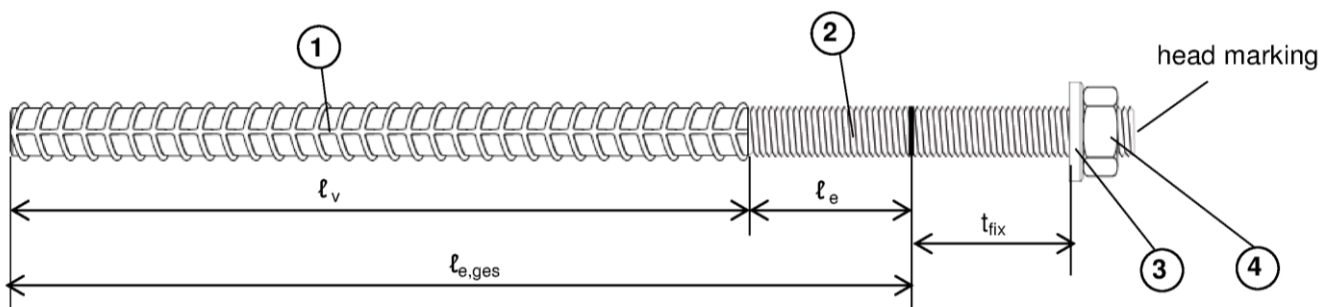

Head marking e.g.: FRA (for stainless steel)

FRA C (for high corrosion-resistant steel)

**Table A2: Installation parameters for rebar anchors FRA**

Threaded diameter		M12		M16	M20
Nominal bar size	$\phi$ [mm]	12		16	20
Width across flat	SW [mm]	19		24	30
Nominal drill bit diameter	$d_0$ [mm]	14 <sup>1)</sup>	16	20	25
Depth of drill hole ( $h_0 = l_{ges}$ )	$l_{e,ges}$ [mm]	$l_v + l_e$			
Effective anchorage depth	$l_v$ [mm]	acc. to static calculation			
Distance concrete surface to welded joint	$l_e$ [mm]	100			
Diameter of clearance hole in the fixture	Pre-positioned $\leq d$	[mm]	14	18	22
	Push through $\leq d_f$	[mm]	18	22	26
Minimum thickness of concrete member	$h_{min}$ [mm]	$h_0 + 30 \geq 100$		$h_0 + 2d_0$	
Maximum torque moment	$T_{inst,max}$ [Nm]	50		100	150

<sup>1)</sup> Both drill bit diameters can be used

**Table A3: Materials of rebar anchors FRA**

Part	Description	Materials	
		FRA	FRA C
1	Reinforcing bar	Class B according to NDP or NCL acc. to EN 1992-1-1/NA; $f_{uk} = f_{tk} = k \cdot f_{yk}$	
2	Round bar with partial or full thread	Stainless steel acc. to EN 10088-1:2014	High corrosion-resistant steel acc. to EN 10088-1:2014
3	Washer	Stainless steel acc. to EN 10088-1:2014	High corrosion-resistant steel acc. to EN 10088-1:2014
4	Hexagon nut	Stainless steel acc. to EN 10088-1:2014 Strength class 80; acc. to EN ISO 3506:2009	High corrosion-resistant steel acc. to EN 10088-1:2014 Strength class 80; acc. to EN ISO 3506:2009

**Rebar connection with BTI injection mortar UVT Top-Z**

**Product description**  
Properties and materials of rebar anchors FRA

**Annex A 5**

## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loads

### Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000
- Strength classes C12/15 to C50/60 according to EN 206-1:2000
- Maximum chloride concrete of 0,40% (CL 0.40) related to the cement content according to EN 206-1:2000
- Non-carbonated concrete

Note: In case of a carbonated surface of the existing concrete structure the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of  $\phi + 60$  mm prior to the installation of the new rebar. The depth of concrete to be removed shall correspond to at least the minimum concrete cover in accordance with EN 1992-1-1:2004+AC:2010. The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions

### Temperature Range:

- - 40°C to +80°C (max. short term temperature +80°C and max long term temperature +50°C)

### Use conditions (Environmental conditions) for rebar anchors FRA:

- Structures subject to dry internal conditions (rebar anchors FRA and FRA C)
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (rebar anchors FRA and FRA C)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (rebar anchors FRA C)

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work
- Verifiable calculation notes and drawings are prepared taking account of the forces to be transmitted
- Design according to EN 1992-1-1:2004+AC:2010 and Annex B 2 and B 3
- The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing

### Installation:

- Dry or wet concrete
- It must not be installed in flooded holes
- Overhead installation allowed
- Hole drilling by hammer drill, compressed air drill or diamond drill mode
- The installation of post-installed rebar respectively rebar anchor FRA shall be done only by suitable trained installer and under Supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for Supervision on site are up to the Member States in which the installation is done
- Check the position of the existing rebars (if the position of existing rebars is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint)


Rebar connection with BTI injection mortar UVT Top-Z

Intended use  
Specifications

Annex B 1

**Figure B1: General construction rules for post-installed rebars**

- Only tension forces in the axis of the rebar may be transmitted
- The transfer of shear forces between new concrete and existing structure shall be designed additionally according to EN 1992-1-1:2004+AC:2010
- The joints for concreting must be roughened to at least such an extent that aggregate protrude

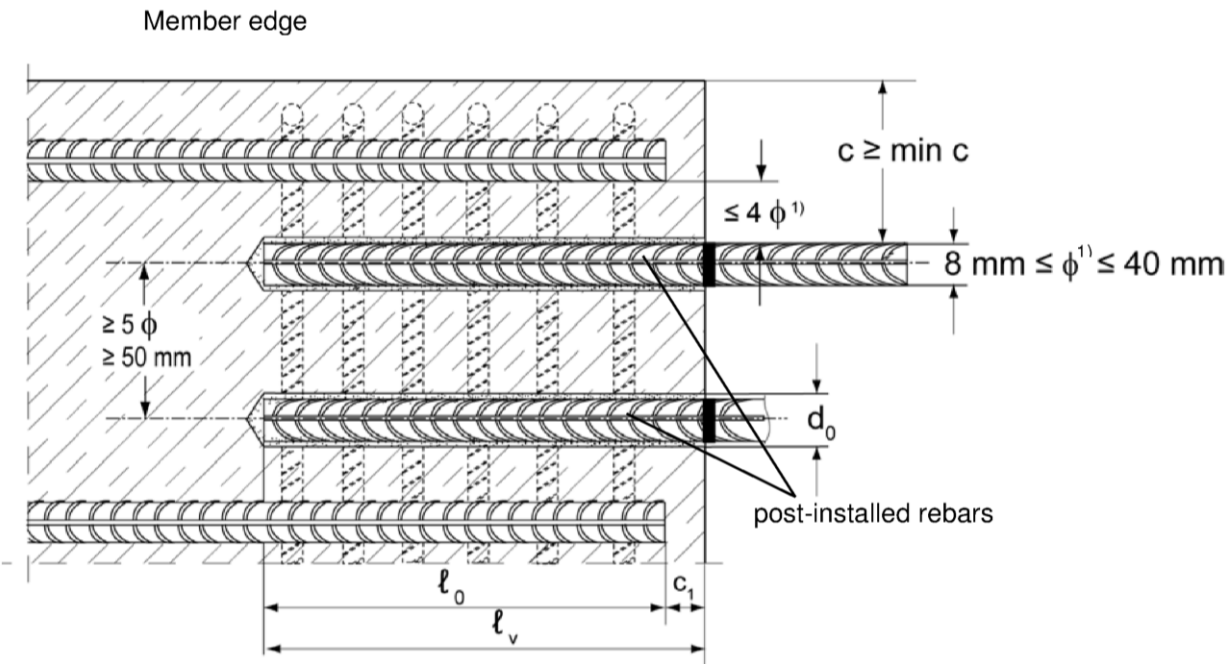

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4 \phi$  then the lap length shall be increased by the difference between the clear bar distance and  $4 \phi$

- $c$  concrete cover of post-installed rebar  
 $c_1$  concrete cover at end-face of existing rebar  
 $\min c$  minimum concrete cover according to Table B1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2  
 $\phi$  diameter of post-installed rebar  
 $\ell_0$  lap length, according to EN 1992-1-1:2004+AC:2010, Section 8.7.3  
 $\ell_v$  effective embedment depth,  $\geq \ell_0 + c_1$   
 $d_0$  nominal drill bit diameter, see Annex B 5


**Rebar connection with BTI injection mortar UVT Top-Z**

**Intended use**  
General construction rules for post-installed rebars

**Annex B 2**

**Figure B2: General construction rules for post-installed rebar anchors FRA**

- Only tension forces in the axis of the FRA may be transmitted
- The tension force must be transferred via an overlap joint to the reinforcement in the building part.
- The transmission of the shear load shall be ensured by appropriate additional measures, e.g. by shear lugs or by anchors with an European Technical Assessment (ETA).
- In the anchor plate, the holes for the tension anchor shall be executed as elongated holes with the axis in the direction of the shear force.

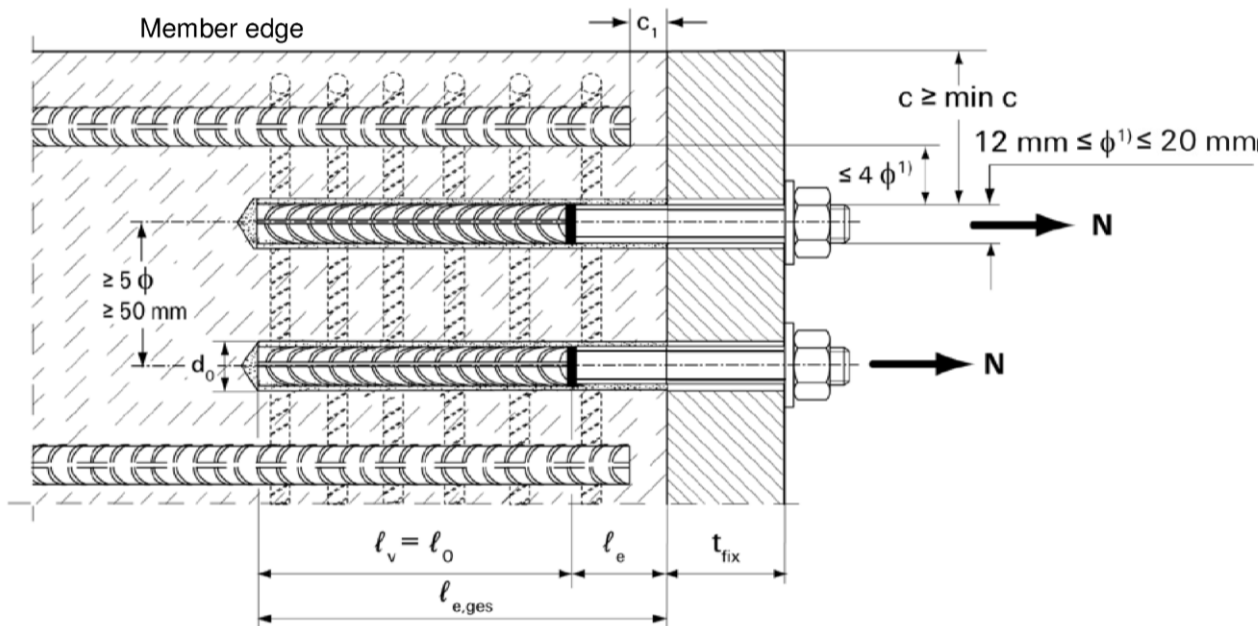

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4 \phi$  then the lap length shall be increased by the difference between the clear bar distance and  $4 \phi$

$c$	concrete cover of post-installed FRA
$c_1$	concrete cover at end-face of existing rebar
$\min c$	minimum concrete cover according to Table B1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2
$\phi$	nominal diameter of the bar
$\ell_0$	lap length, according to EN 1992-1-1:2004+AC:2010, Section 8.7.3
$\ell_{e,ges}$	overall embedment depth, $\geq \ell_v + \ell_e$
$d_0$	nominal drill bit diameter, see Annex B 5
$\ell_e$	length of the bonded in threaded part
$t_{fix}$	thickness of the fixture
$\ell_v$	effective embedment depth

**Rebar connection with BTI injection mortar UVT Top-Z**


**Intended use**

General construction rules for post-installed rebar anchors FRA

**Annex B 3**



**Table B1:**  
**Minimum concrete cover  $c^{1)}$  depending of the drilling method and the drilling tolerance**

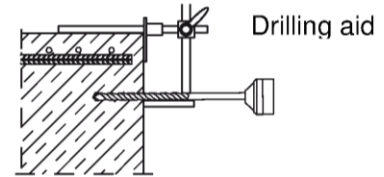

Drilling method	Nominal diameter of the bar $\phi$ [mm]	Minimum concrete cover min c	
		Without drilling aid [mm]	With drilling aid [mm]
Hammer drilling	$\leq 20$	$30 \text{ mm} + 0,06 l_v$	$30 \text{ mm} + 0,02 l_v \geq 2 \phi$
	$\geq 22$	$40 \text{ mm} + 0,06 l_v$	$40 \text{ mm} + 0,02 l_v \geq 2 \phi$
Pneumatic drilling	$\leq 20$	$50 \text{ mm} + 0,08 l_v$	$50 \text{ mm} + 0,02 l_v$
	$\geq 22$	$60 \text{ mm} + 0,08 l_v$	$60 \text{ mm} + 0,02 l_v$
Diamond drilling	$\leq 20$	$30 \text{ mm} + 0,06 l_v$	$30 \text{ mm} + 0,02 l_v \geq 2 \phi$
	$\geq 22$	$40 \text{ mm} + 0,06 l_v$	$40 \text{ mm} + 0,02 l_v \geq 2 \phi$

<sup>1)</sup> See Annex B2, Figure B1 and Annex B3, Figure B2

Note: The minimum concrete cover as specified in EN 1992-1-1:2004+AC:2010 must be observed

**Table B2:**  
**Dispensers and cartridge sizes corresponding to maximum embedment depth  $l_{v,max}$**

Rebar /FRA	Manual dispenser	Accu and pneumatic dispenser (small)	Pneumatic dispenser (large)	
	Cartridge size 390 ml, 585 ml	Cartridge size 390 ml, 585 ml	Cartridge size 1500 ml	
$\phi$ [mm]	$\ell_{v,max} / \ell_{e,ges,max}$ [mm]	$\ell_{v,max} / \ell_{e,ges,max}$ [mm]	$\ell_{v,max} / \ell_{e,ges,max}$ [mm]	
8	1000	1000	1800	
10				
12 / FRA 12		1200		
14		1500		
16 / FRA 16	700	1300	2000	
20 / FRA 20		1000		
22 / 24 / 25	500	700		
26 / 28				
30 / 32 / 34	-----	500		
36				
40				

**Table B3: Working times  $t_{work}$  and curing times  $t_{cure}$**

Temperature in the anchorage base [°C]	Max. working time <sup>2)</sup> $t_{work}$ [minutes]	Minimum curing time <sup>3)</sup> $t_{cure}$ [hours]
	UVT Top-Z	UVT Top-Z
+5 to +9 <sup>1)</sup>	120	40
>+10 to +19	30	18
>+20 to +29	14	10
>+30 to +40	7	5

<sup>1)</sup> For installation temperature lower than 10°C the mortar UVT Top-Z must be tempered to 20°C

<sup>2)</sup> Maximum time from the beginning of injection to rebar setting and positioning

<sup>3)</sup> For wet concrete the curing time must be doubled

**Rebar connection with BTI injection mortar UVT Top-Z**

**Intended use**

Minimum concrete cover/ Maximum embedment depth per dispenser and cartridge size/ Working times and curing times

**Annex B 4**

**Table B4:**  
**Installation tools for drilling and cleaning the bore hole and injection of the mortar**

Rebar / FRA ϕ [mm]	Drilling and cleaning						Injection				
	Nominal drill bit diameter d <sub>0</sub> [mm]		Diameter of cutting edge d <sub>cut</sub> [mm]		Steel brush diameter d <sub>b</sub> [mm]		Cleaning nozzle [mm]	Extension tube [mm]	Injection adapter		
									[colour]		
8	10 <sup>1)</sup>	12 <sup>1)</sup>	≤ 10,50	≤ 12,50	11,0	12,5	11	9	-	nature	
10	12 <sup>1)</sup>	14 <sup>1)</sup>	≤ 12,50	≤ 14,50	12,5	15			nature	blue	
12/ FRA 12	14 <sup>1)</sup>	16 <sup>1)</sup>	≤ 14,50	≤ 16,50	15	17			blue	red	
14	18		≤ 18,50		19		15	9 or 15	yellow		
16/ FRA 16	20		≤ 20,55		21,5				19	green	
20/ FRA 20	25		≤ 25,55		26,5					black	
22, 24	30		≤ 30,55		32		28			grey	
25	30		≤ 30,55		32				grey		
26 / 28	35		≤ 35,70		37				brown		
30 / 32 / 34	40		≤ 40,70		42		38		red		
36	45		≤ 45,70		47				yellow		
40	55		≤ 55,70		58				nature		

<sup>1)</sup> Both drill bit diameters can be used

**Rebar connection with BTI injection mortar UVT Top-Z**

**Intended use**

Installation tools for drilling and cleaning the bore hole and injection installation of the mortar

**Annex B 5**

### Safety regulations



Review the Material Safety Data Sheet (SDS) before use for proper and safe handling!


Wear well-fitting protective goggles and protective gloves when working with mortar UVT Top-Z

important: Observe the instructions for use provided with each cartridge.


### 1. Drill hole

Note: Before drilling, remove carbonized concrete; clean contact areas (see Annex B 1)

In case of aborted drill hole the drill hole shall be filled with mortar.

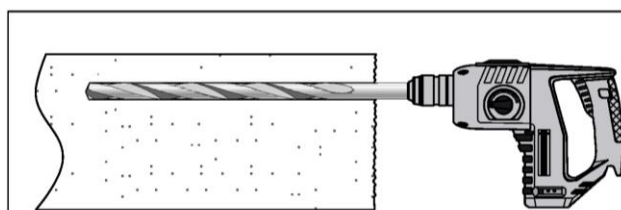

Drill hole to the required embedment depth using a hammer-drill with carbide drill bit set in rotation hammer mode, a pneumatic drill or a diamond drill in drilling mode.  
Drill bit sizes see Table B4.


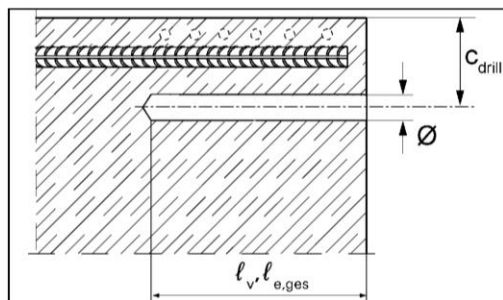


Measure and control concrete cover  $c$

$$c_{\text{drill}} = c + \phi / 2$$

Drill parallel to surface edge and to existing rebar

Where applicable use drilling aid.



For holes  $l_v > 20$  cm use drilling aid.

Three different options can be considered:

- A) drilling aid
- B) Slat or spirit level
- C) Visual check

### Rebar connection with BTI injection mortar UVT Top-Z

#### Intended use


Installation instruction part 1

### Annex B 6



## 2. Cleaning the bore hole

### Hammer- and pneumatic drilling

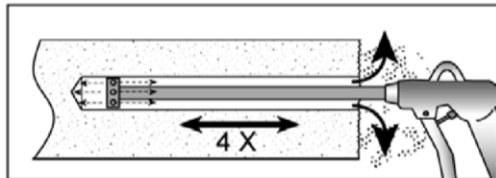


Blowing  
four times from the back of the hole with oil-free  
compressed air (min. 6 bar) until return air  
stream is free of noticeable dust.


### Diamond drilling




Break away the drill core and remove it

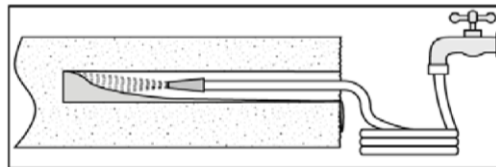


Flush the bore hole until the water comes clear

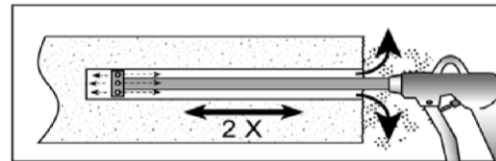

Blowing  
two times from the back of the hole with oil-free  
compressed air (min. 6 bar) until return air  
stream is free of noticeable dust.

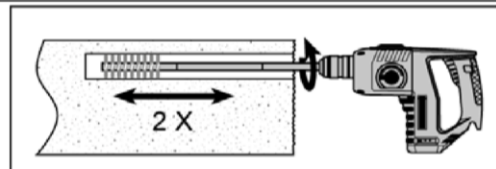

Fix an adequate steel brush with an extension  
into a drilling machine and brush the bore hole  
two times

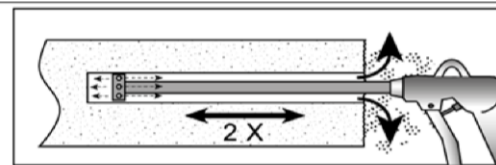






Blowing  
two times from the back of the hole with oil-free  
compressed air (min. 6 bar) until return air  
stream is free of noticeable dust.

### Rebar connection with BTI injection mortar UVT Top-Z

**Intended use**  
Installation instruction part 2



**Annex B 7**

### 3. Rebar preparation and cartridge preparation

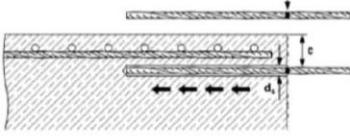	<p>Before use, make sure the rebar or the rebar anchor FRA is dry and free of oil or other residue. Mark the embedment depth <math>\ell_v</math> on the rebar (e.g. with tape) Insert rebar in borehole, to verify hole and setting depth <math>\ell_v</math> resp. <math>\ell_{e,ges}</math></p>
<b>Injection system preparation</b>	
	<p>No. 1: Twist off the sealing cap</p>
	<p>No. 2: Twist on the static mixer (the spiral in the static mixer must be clearly visible).</p>
	<p>No. 3: Place the cartridge into a suitable dispenser.</p>
	<p>No. 4: Press approximate 10 cm of material out until the resin is evenly grey in colour. Don't use mortar that is not uniformly grey.</p>

### 4. Inject mortar into borehole

#### 4.1 borehole depth $\leq 250$ mm:

	<p>Inject the mortar from the back of the hole towards the front and slowly withdraw the mixing nozzle step by step after each trigger pull. Fill holes approximately 2/3 full, or as required to ensure that the annular gap between the rebar and the concrete is completely filled with adhesive over the embedment length.</p>
	<p>After injecting, depressurize the dispenser by pressing the release trigger. This will prevent further mortar discharge from the mixing nozzle.</p>



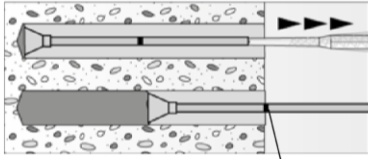

### Rebar connection with BTI injection mortar UVT Top-Z

#### Intended use

Installation instruction part 3

### Annex B 8

#### 4.2 borehole depth > 250 mm:





	<p>Assemble mixing nozzle, extension tube and injection adapter (see Table B 4)</p>
 <p>Mortar level mark</p>	<p>Mark the required mortar level <math>\ell_m</math> and embedment depth <math>\ell_v</math> resp. <math>\ell_{e,ges}</math> with tape or marker on the injection extension tube.</p> <p>a) Estimation:</p> $\ell_m = \frac{1}{3} * \ell_v \text{ resp. } \ell_m = \frac{1}{3} * \ell_{e,ges}$ <p>b) Precise formula for optimum mortar volume:</p> $\ell_m = \ell_v \text{ resp. } \ell_{e,ges} \left( \left( 1,2 * \frac{d_s^2}{d_0^2} - 0,2 \right) \right) [\text{mm}]$
 <p>Mortar level mark</p>	<p>Insert injection adapter to back of the hole. Begin injection allowing the pressure of the injected adhesive mortar to push the injection adapter towards the front of the hole. Fill holes approximately 2/3 full, or as required to ensure that the annular gap between the rebar and the concrete is completely filled with adhesive over the embedment length. When using an injection adapter continue injection until the mortar level mark <math>\ell_m</math> becomes visible. Maximum embedment depth see Table B 2</p>
	<p>After injecting, depressurize the dispenser by pressing the release trigger. This will prevent further mortar discharge from the mixing nozzle.</p>

Rebar connection with BTI injection mortar UVT Top-Z

Intended use  
Installation instruction part 4

Annex B 9

### 4.3 Insert rebar rebar anchor FRA

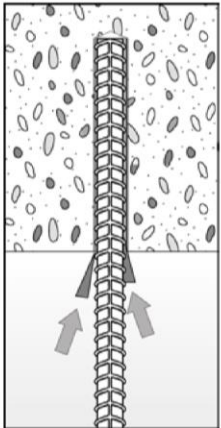	<p>For each installation insert the rebar / rebar anchor FRA slowly twisted into the borehole until the embedment mark is at the concrete surface level.</p>
	<p>For overhead installation support the rebar / rebar anchor FRA and secure it from falling till mortar started to harden, e.g. using wedges.</p>
	<p>After installing the rebar or FRA the annular gap must be completely filled with mortar.</p> <p>Proper installation</p> <ul style="list-style-type: none"> <li>• Desired anchoring embedment is reached <math>\ell_v</math>: embedment mark at concrete surface.</li> <li>• Excess mortar flows out of the borehole after the rebar has been fully inserted until the embedment mark.</li> </ul>
	<p>Observe the working time "<math>t_{work}</math>" (see Table B3), which varies according to temperature of base material. Minor adjustments to the rebar / rebar anchor FRA position may be performed during the working time</p> <p>Full load may be applied only after the curing time "<math>t_{cure}</math>" has elapsed (see Table B 3)</p>

### Rebar connection with BTI injection mortar UVT Top-Z

**Intended use**  
Installation instruction part 5

**Annex B 10**

### Minimum anchorage length and minimum lap length

The minimum anchorage length  $\ell_{b,min}$  and the minimum lap length  $\ell_{o,min}$  according to EN 1992-1-1:2004+AC:2010 ( $\ell_{b,min}$  acc. to Eq. 8.6 and Eq. 8.7 and  $\ell_{o,min}$  acc. to Eq. 8.11) shall be multiply by a amplification factor  $\alpha_{lb}$  according to Table C1.

**Table C1: Amplification factor  $\alpha_{lb}$  related to concrete class and drilling method**

Concrete class	Drilling method	Amplification factor $\alpha_{lb}$
C12/15 to C50/60	Hammer drilling and pneumatic drilling	1,0
C12/15 to C50/60	Diamond drilling	1,3

**Table C2: Reduction factor  $k_b$  for all drilling methods**

Hammer drill or pneumatic drill									
Rebar / FRA $\phi$ [mm]	Reduction factor $k_b$								
	Concrete classe								
	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 bis 25	1,00	1,00	1,00	1,00	1,00	1,00	1,00	1,00	1,00
26 bis 40	1,00	1,00	1,00	1,00	1,00	1,00	1,00	1,00	0,93
Diamond drill									
Rebar / FRA $\phi$ [mm]	Reduction factor $k_b$								
	Concrete class								
	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 bis 12	1,00	1,00	1,00	1,00	1,00	1,00	1,00	0,93	1,00
14 bis 25	1,00	1,00	1,00	1,00	1,00	1,00	1,00	0,86	0,86
26 bis 40	1,00	1,00	1,00	1,00	1,00	0,71	0,71	0,71	0,71

**Table C3: Design values of the ultimate bond resistance  $f_{bd,PIR}$  in N/mm<sup>2</sup> for all drilling methods and for good bond conditions**

$$f_{bd,PIR} = k_b \cdot f_{bd}$$

$f_{bd}$ : Design value of the ultimate bond stress in N/mm<sup>2</sup> considering the concrete classes and the rebar diameter according to EN 1992-1-1:2004+AC:2010

(for all other bond conditions multiply the values by 0,7)

$k_b$ : Reduction factor according to Table C2

Hammer drill or pneumatic drill									
Rebar / FRA  ϕ [mm]	Bond resistance f <sub>bd,PIR</sub> [N/mm²]								
	Concrete class								
	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 25	1,6	2,0	2,3	2,7	3,0	3,4	3,7	4,0	4,3
26 to 40									4,0
Diamond drill									
Rebar / FRA  ϕ [mm]	Bond resistance f <sub>bd,PIR</sub> [N/mm²]								
	Concrete class								
	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 12	1,6	2,0	2,3	2,7	3,0	3,4	3,7	4,0	4,3
14 to 25								3,7	
26 to 40						3,0			

### Rebar connection with BTI injection mortar UVT Top-Z

#### Performances

Amplification factor  $\alpha_{lb}$ , Reduction factor  $k_b$

Design values of ultimate bond resistance  $f_{bd,PIR}$

### Annex C 1