

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-13/0407**  
**of 9 February 2018**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

C5 TRAK-IT® XH Nails and DCN890 XH Nails

Product family  
to which the construction product belongs

Power-actuated fastener for multiple use in concrete  
for non-structural applications

Manufacturer

Stanley Black & Decker Deutschland GmbH  
Richard-Klinger-Straße 11  
65510 Idstein  
DEUTSCHLAND

Manufacturing plant

Manufacturing Plant 4 and Plant 9

This European Technical Assessment  
contains

11 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330083-02-0601

This version replaces

ETA-13/0407 issued on 20 October 2016

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The C5 TRAK-IT® XH Nails and DCN890 XH Nails are power-actuated fasteners which are placed into the concrete without previous drill by use of a gas actuated tool TRAK-IT® C5 or an cordless concrete nailer DCN 890. They are anchored in the concrete by sintering and mechanical interlock.

The fastener (nail) is made of galvanised steel. The nails are arranged and connected with each other by special plastic strips that guides the nails in the gas actuated tool magazine.

The product description is given in Annex A.

The characteristic material values, dimensions and tolerances of the fastener not given in Annex A correspond to the respective values laid down in the technical documentation<sup>1</sup> of this European Technical Assessment.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic                              | Performance  |
|---|--|
| Characteristic values of resistance and displacements | See Annex C1   |
| Durability  | Durability is ensured if the specifications of intended use according to Annex B are taken into account. |

#### 3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance  |
|--------------------------|--------------|
| Reaction to fire         | Class A1     |
| Resistance to fire       | See Annex C1 |

<sup>1</sup> The technical documentation of this ETA is deposited at the Deutsches Institut für Bautechnik and, as far as relevant for the tasks of the notified bodies involved in the attestation of conformity procedure, is handed over to the notified bodies.

English translation prepared by DIBt

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with EAD No. 330083-02-0601, the applicable European legal act is: 1997/463/EC (EU).

The system to be applied is: 2+

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 9 February 2018 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department

*beglaubigt:*  
Baderschneider

**Nail Types**

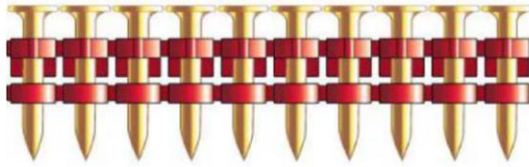


TRAK-IT® XH Extra Hard Nails



DCN890 XH Extra Hard Nails

**Installed condition**

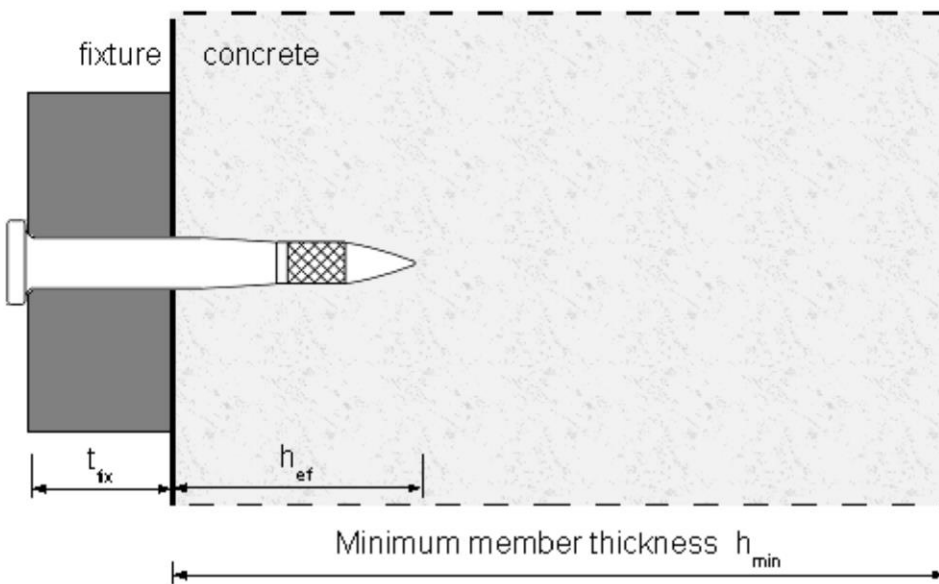


**C5 TRAK-IT® XH Nails and DCN890 XH Nails**

Product

**Annex A1**

TRAK-IT® XH Extra Hard Nails and DCN890 XH Extra Hard Nails

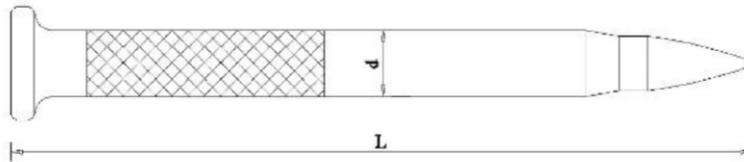

**Table 1: Dimensions and materials**

|                            |      | XH nails                             | XH nails                             |
|----------------------------|------|--------------------------------------|--------------------------------------|
| For use with tool          | [-]  | TRAK-IT® C5                          | DCN890                               |
| Length of nails L          | [mm] | 22-38                                | 19-57                                |
| Shaft diameter d           | [mm] | 3,0                                  | 3,0                                  |
| Head diameter D            | [mm] | 6,3                                  | 6,3                                  |
| Material nail              | [-]  | Hardened C-steel                     |                                      |
| Material plastic collation | [-]  | Polyethylene (red)                   |                                      |
| Zinc plating               | [-]  | Mech. or El. galvanized<br>min. 5 µm | Mech. or El. galvanized<br>min. 5 µm |

**C5 TRAK-IT® XH Nails and DCN890 XH Nails**

Material and Dimensions

**Annex A2**

## Specification of intended use

### Anchorage subject to:

- Static and quasi-static loads.

### Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000.
- For cracked and non-cracked concrete.
- Anchorages in two-dimensional load-bearing structures (slabs and walls).
- C5 TRAK-IT® Gas Concrete Nailer  
Strength classes C20/25 to C40/50 according to EN 206-1:2000 for use of setting tool C5.
- DCN890 Cordless Concrete Nailer  
Strength classes C20/25 to C50/60 according to EN 206-1:2000 for use of setting tool DCN890.

### Use conditions (Environmental conditions):

- Structures subject to dry conditions.

### Design:

- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the drawings (e.g. position of the fastener relative to reinforcement or to supports etc.).
- The anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- The anchorages are designed in accordance with ETAG 001, Annex C, Design Method C, August 2010 or in accordance with CEN/TS 1992-4-4:2009, Design Method C.
- The anchorages under fire exposure are designed in accordance with EOTA TR 020, May 2004 or in accordance with CEN/TS 1992-4:2009, Annex D. It must be ensured that local spalling of the concrete cover does not occur.
- The fastener with setting tool C5 is to be used only for multiple use for non-structural applications with following definition:
  - Number of fixing points  $n_1 \geq 4$ ,
  - Number of fasteners per fixing point  $n_2 = 1$ ,
  - Design value of actions  $F_{sd}$  per fixing point  $n_3 \leq 0,6$  kN.
- The fastener with setting tool DCN890 is to be used only for multiple use for non-structural applications with following definition:
  - Number of fixing points  $n_1 \geq 6$ ,
  - Number of fasteners per fixing point  $n_2 = 1$ ,
  - Design value of actions  $F_{sd}$  per fixing point  $n_3 \leq 0,3$  kN.
- The design of the fixture is such that in the case of excessive slip or failure of one fastener the load can be transmitted to neighboring fasteners without significantly violating the requirements on the fixture in the serviceability and ultimate limit state.

### Installation:

- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

**C5 TRAK-IT® XH Nails and DCN890 XH Nails**

Intended use

**Annex B1**

**Table 2: Installation parameters (no previous drilling needed)**

|  |            |      | XH nails    | XH nails  |
|--|------------|------|-------------|-----------|
| For use with tool  |            | [-]  | TRAK-IT® C5 | DCN890    |
| Maximum concrete strength class                                      |            | [-]  | C40/50      | C50/60    |
| Effective anchorage depth  | $h_{ef}$   | [mm] | ≥ 18        | ≥ 15      |
| Average anchorage depth when used in maximum concrete strength class | $h_{ef,m}$ | [mm] | 22          | 19        |
| Diameter of clearance hole in the fixture                            | $d_f$      | [mm] | 3,5         | 3,5       |
| Max. Thickness of fixture  | $t_{fix}$  | [mm] | L - 21 mm   | L - 23 mm |
| <b>Member thickness, edge distances and spacing</b>                  |            |      |             |           |
| Minimum member thickness   | $h_{min}$  | [mm] | 80          | 80        |
| Minimum spacing  | $s_{min}$  | [mm] | 200         | 200       |
| Minimum edge distance  | $c_{min}$  | [mm] | 100         | 100       |

### Installation instructions

- Fastener installation in accordance with the manufacturer's specifications and drawings and using the specified installation device.
- Fasteners to be installed perpendicular to the surface of the base material.
- When setting, pay attention to setting defects. A setting defect is present if the nail can be pull out of the concrete by hand.
- Fasteners to be installed ensuring not less than the minimum effective anchorage depth according to Table 2. If the embedment depth is smaller than the minimum effective anchorage depth the nail must be assumed as a setting defect and it must not be loaded.
- Damages on the concrete surface, caused by setting defects, have to be repaired according to EN 1504. A new fastener is set at a minimum distance away of 100 mm of the edge of the damaged surface.
- Use of setting tools according to Annex B3 and B4. The setting tool shall be complied with EN 792-13:2009.

### C5 TRAK-IT® XH Nails and DCN890 XH Nails

Installation parameters, installation instructions

**Annex B2**



**Gas actuated tool and gas can**

TRAK-IT<sup>®</sup> C5 Gas Concrete Nailer (long track version) and TRAK-IT<sup>®</sup> C5-ST Gas Concrete Nailer (short track version) 105 Joule gas actuated tool



**C5 TRAK-IT<sup>®</sup> XH Nails and DCN890 XH Nails**

**Annex B3**

Gas tools C5 TRAK-IT<sup>®</sup> and corresponding gas can

**DCN 890 Cordless Concrete Nailer 18V XR**



**C5 TRAK-IT® XH Nails and DCN890 XH Nails**

DEWALT DCN 890 Cordless Concrete Nailer

**Annex B4**

**Table 3: Characteristic values, Design method C**

|   |                           |      | XH nails   |         |
|---|---------------------------|------|------------|---------|
| For use with tool                                 |                           |      | C5         | DCN 890 |
| Characteristic resistance for all load directions | $F_{Rk}$                  | [N]  | 44         | 40      |
| Partial safety factor                             | $\gamma_M^{1)}$           | [-]  | 1,5        |         |
| Characteristic spacing                            | $s_{cr}$                  | [mm] | 200        |         |
| Characteristic edge distance                      | $c_{cr}$                  | [mm] | 150        |         |
| Displacements for all load directions             | $\delta_0, \delta_\infty$ | [mm] | $\leq 0,1$ |         |

1) In absence of other national regulations

**Table 4: Characteristic values under fire exposure**

| Fire resistance class |   |                      |      | XH nails          |         |
|-----------------------|---|----------------------|------|-------------------|---------|
| R 30                  | For use with tool                                 |                      |      | C5                | DCN 890 |
|                       | Characteristic resistance for all load directions | $F_{Rk,fi}$          | [N]  | 11                | 10      |
|                       | Partial safety factor                             | $\gamma_{M,fi}^{1)}$ | [-]  | 1,0               |         |
|                       | Characteristic spacing                            | $s_{cr}$             | [mm] | 200               |         |
|                       | Characteristic edge distance                      | $c_{cr}$             | [mm] | 150 <sup>2)</sup> |         |

1) In absence of other national regulations

2) If the fire attack is from more than one side, the edge distance shall be  $c \geq 300$  mm.

**C5 TRAK-IT® XH Nails and DCN890 XH Nails**

Characteristic values

**Annex C1**