

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-15/0259
of 11 January 2018

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Hilti ETICS anchors D8-FV H and HTH

Product family
to which the construction product belongs

Screwed-in plastic anchor for fixing of external thermal
insulation composite systems with rendering in concrete
and masonry

Manufacturer

HILTI Corporation
Feldkircherstraße 100
9494 SCHAAN
FÜRSTENTUM LIECHTENSTEIN

Manufacturing plant

Hilti Werke
Hilti manufacturing plant

This European Technical Assessment
contains

17 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330196-01-0604

This version replaces

ETA-15/0259 issued on 08 June 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The Hilti ETICS screwed-in anchors D8-FV H and HTH with a helix consist of a plastic part made of virgin polypropylene and an accompanying specific screw of galvanised steel.
The description of the product is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.
The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance	See Annex C 1
Edge distances and spacing	See Annex B 3
Displacements	See Annex C 2

3.2 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance
Point thermal transmittance	See Annex C 2

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 330196-01-00-0604, the applicable European legal act is: [97/463/EC].
The system to be applied is: 2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 11 January 2018 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow
Head of Department

beglaubigt:
Ziegler

Hilti ETICS anchor D8-FV H

Intended use: Fixing of external thermal insulation composite systems in concrete, masonry, lightweight aggregate concrete and autoclaved aerated concrete

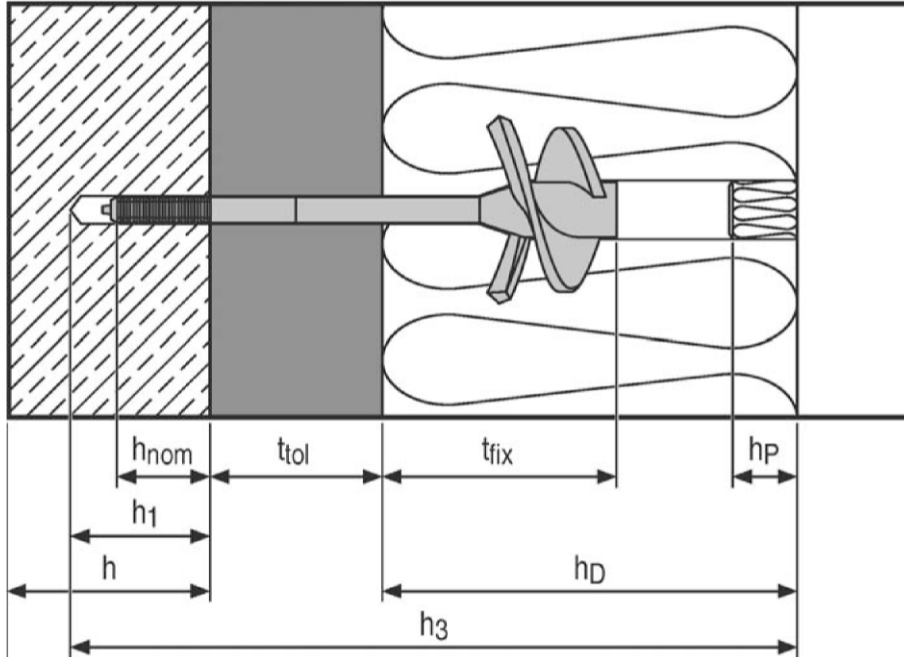

Legend:

- h = thickness of member (wall)
- h_1 = depth of drilled hole in base material to deepest point
- h_3 = total length of borehole from insulation material surface to deepest point
- h_{nom} = overall plastic anchor embedment depth in the base material
- h_D = thickness of insulation material
- h_P = thickness of plug
- t_{fix} = thickness of fixture
- t_{tol} = thickness of equalizing layer for compensation of tolerances or non-loadbearing layer


Hilti ETICS anchors D8-FV H and HTH

Product description
Installed condition D8-FV H

Annex A 1

Hilti ETICS anchor HTH

Intended use: Fixing of external thermal insulation composite systems in concrete, masonry, lightweight aggregate concrete and autoclaved aerated concrete

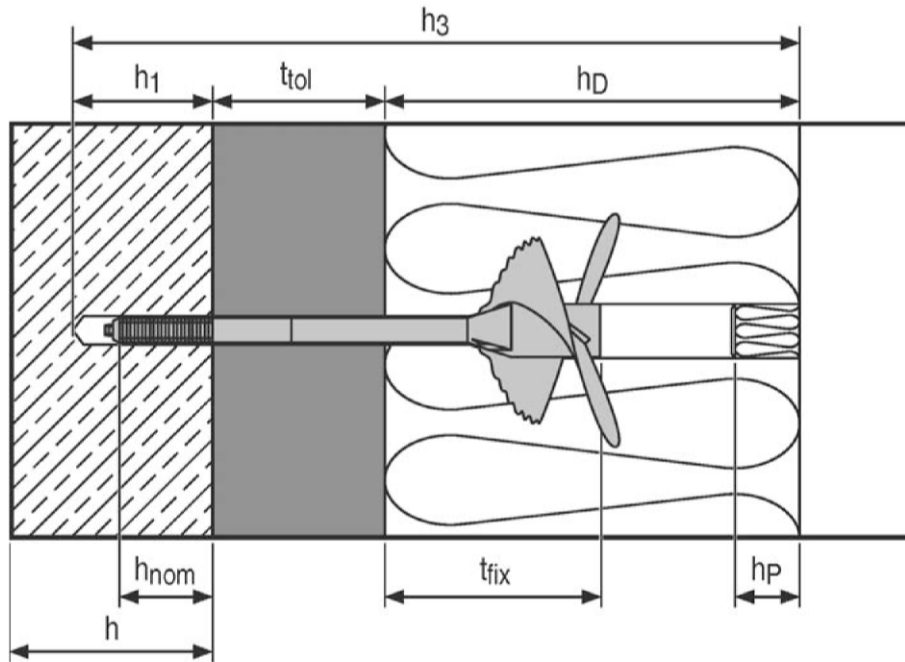

Legend:

- h = thickness of member (wall)
- h_1 = depth of drilled hole to deepest point
- h_3 = total length of borehole from insulation material surface to deepest point
- h_{nom} = overall plastic anchor embedment depth in the base material
- h_D = thickness of insulation material
- h_P = thickness of plug
- t_{fix} = thickness of fixture
- t_{tol} = thickness of equalizing layer for compensation of tolerances or non-loadbearing layer


Hilti ETICS anchors D8-FV H and HTH

Product description
Installed condition HTH


Annex A 2

Use in different insulation material thickness



Minimum thickness

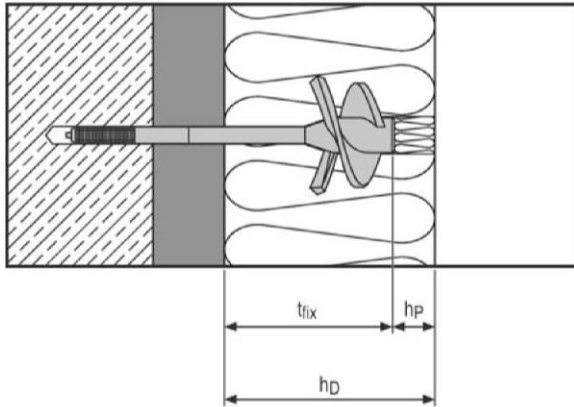

Maximum thickness

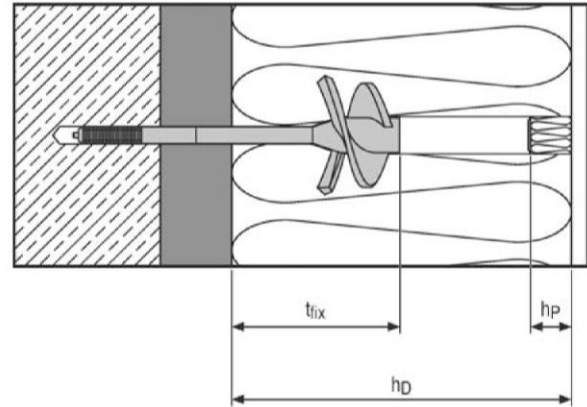

Use in different thickness of equalizing or non-loadbearing layer

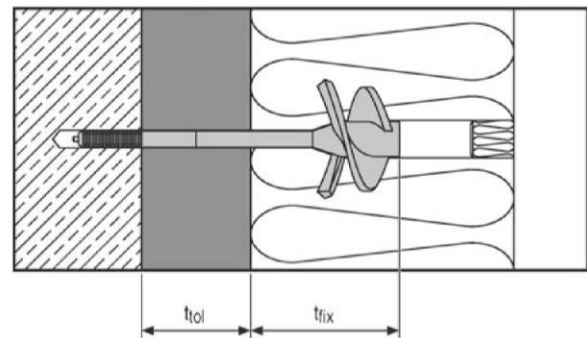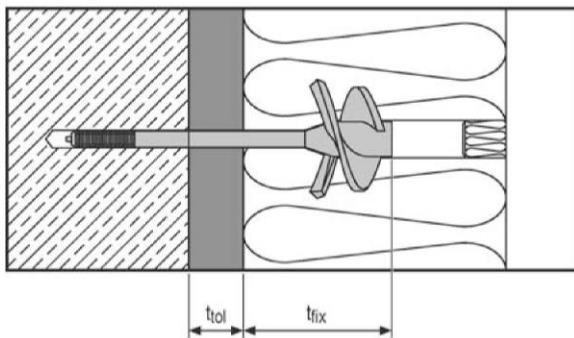

Legend:


- h_D = thickness of insulation material
- h_P = thickness of plug
- t_{fix} = thickness of fixture
- t_{tol} = thickness of equalizing layer for compensation of tolerances or non-loadbearing layer

Hilti ETICS anchors D8-FV H and HTH


Product description
Different installed conditions

Annex A 3


Anchor sleeve D8-FV H

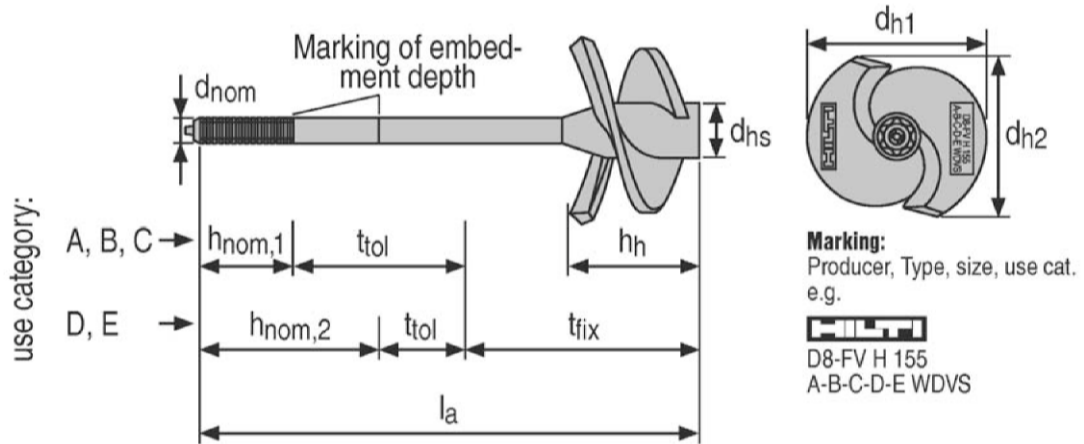


Anchor sleeve HTH

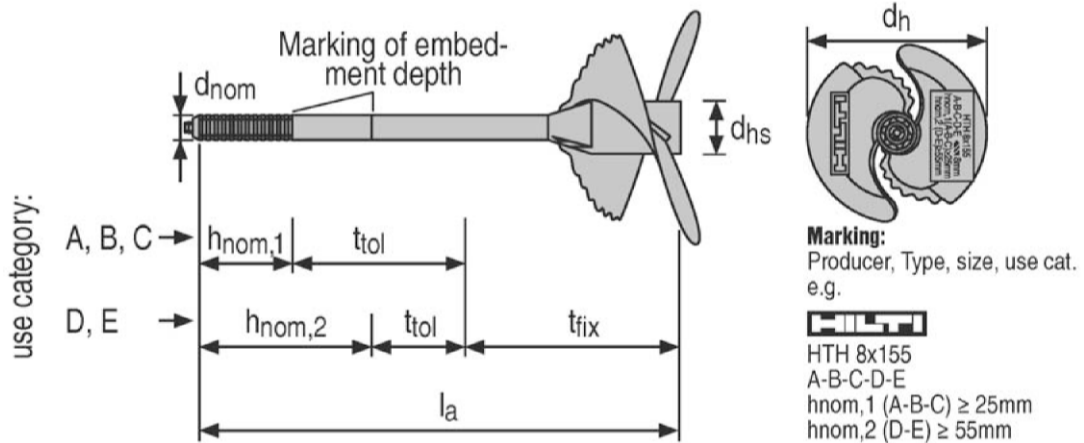

Screw for D8-FV H, HTH

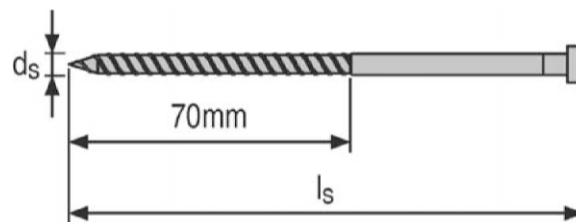

Plug for D8-FV H, HTH



Note: PU-Foam with specifications according to Table A5 can be used alternatively

Hilti ETICS anchors D8-FV H and HTH


Product description

Dimensions and marking of the anchor sleeve D8-FV H and HTH expansion element, plug

Annex A 4

Setting tools

Setting tool D8-SW 1 or setting tool D8-SW 2 suitable for D8-FV H and HTH

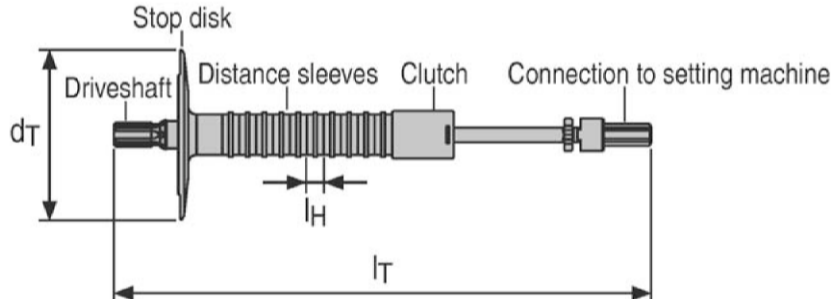

Setting tool HTH-SW 1 or setting tool HTH-SW 2 suitable for D8-FV H and HTH

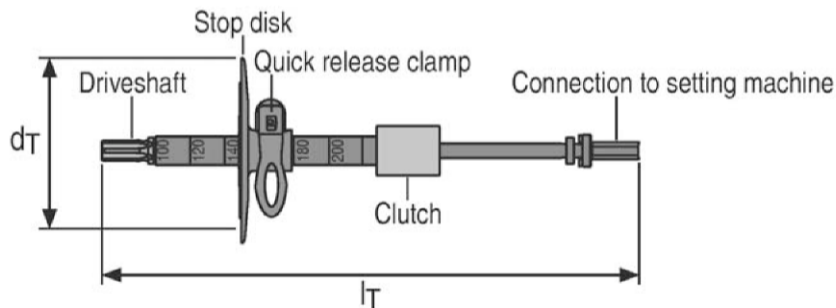


Table A1 Dimensions for setting tool types D8-SW 1 and D8-SW 2

Setting tool type		D8-SW 1	D8-SW 2
Diameter of disk	d_T [mm]	100	
Length of the tool	l_T [mm]	310	477
Length of distance sleeve (insulation thickness increment)	l_H [mm]	10	
Applicable insulation thickness	$h_{D,min}$ [mm]	100 ¹⁾	200
	$h_{D,max}$ [mm]	200	360

¹⁾ This value applies for $t_{fix} = 80$ mm (for $t_{fix} = 110$ mm: $h_{D,min} = 130$ mm).

Table A2 Dimensions for setting tool types HTH-SW 1 and HTH-SW 2

Setting tool type		HTH-SW 1	HTH-SW 2
Diameter of disk	d_T [mm]	100	
Length of the tool	l_T [mm]	310	477
Applicable insulation thickness	$h_{D,min}$ [mm]	100 ¹⁾	200
	increment [mm]	10	
	$h_{D,max}$ [mm]	200	360

¹⁾ This value applies for $t_{fix} = 80$ mm (for $t_{fix} = 110$ mm: $h_{D,min} = 130$ mm).

Hilti ETICS anchors D8-FV H and HTH

Product description Setting tools

Annex A 5

Table A3 Anchor types and dimensions of D8-FV H

Anchor type			D8-FV H 125	D8-FV H 155	D8-FV H 215
Plastic sleeve	Sleeve diameter	d_{nom} [mm]	8		
	Length of sleeve	l_a [mm]	125	155	215
	Height of helix	h_h [mm]	40		
	Diameter of helix centre	d_{hs} [mm]	17		
	Diameter 1 of helix	d_{h1} [mm]	65		
	Diameter 2 of helix	d_{h2} [mm]	58		
Special screw	Screw diameter	d_s [mm]	5,35		
	Length of screw	l_s [mm]	94	124	184

Table A4 Anchor types and dimensions of HTH

Anchor type			HTH 8x125	HTH 8x155	HTH 8x215
Plastic sleeve	Sleeve diameter	d_{nom} [mm]	8		
	Length of sleeve	l_a [mm]	125	155	215
	Diameter of helix centre	d_{hs} [mm]	17		
	Diameter of helix	d_h [mm]	75		
Special screw	Screw diameter	d_s [mm]	5,35		
	Length of screw	l_s [mm]	94	124	184

Table A5 Materials of D8-FV H and HTH

Element	Material
Anchor sleeve	virgin Polypropylene, colour: black
Screw	Steel, galvanised $\geq 5 \mu\text{m}$, $f_{yk} = 480 \text{ N/mm}^2$, $f_{uk} = 600 \text{ N/mm}^2$
Plug	EPS or mineral wool
PU-Foam	Polyurethane, thermal conductivity $\leq 0,045 \text{ W/(mK)}$ Remark: use of foam only in accordance with ETICS system suppliers

Hilti ETICS anchors D8-FV H and HTH

Product description
Dimensions and Materials

Annex A 6

Specifications of intended use

Anchorage subject to:

- The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the thermal insulation composite system.

Base materials:

- Normal weight concrete (use category A) according to Annex C 1
- Solid masonry (use category B), according to Annex C 1
- Hollow or perforated masonry (use category C), according to Annex C 1
- Lightweight aggregate concrete (use category D), according to Annex C 1
- Autoclaved aerated concrete (use category E), according to Annex C 1
- For other base materials of the use categories A, B, C, D or E the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 051 edition December 2016.

Temperature Range:

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)

Design:

- The anchorages are designed under the responsibility of an engineer experienced in anchorages and masonry work with the partial safety factors $\gamma_M = 2,0$ and $\gamma_F = 1,5$, if there are no other national regulations.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings of thermal insulation composite systems.

Installation:

- Hole drilling by the drill modes according to Annex C 1
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Installation temperature from 0°C to +40°C
- Exposure to UV due to solar radiation of the anchor not protected by rendering ≤ 6 weeks

Hilti ETICS anchors D8-FV H and HTH

Intended use
Specifications

Annex B 1

Table B1 Installation parameters for use in concrete and solid masonry (use category A, B)

Anchor type		D8-FV H 125	D8-FV H 155	D8-FV H 215	
		HTH 8x125	HTH 8x155	HTH 8x215	
Drill hole diameter	$d_0 = [\text{mm}]$	8			
Cutting diameter of drill bit	$d_{\text{cut}} \leq [\text{mm}]$	8,45			
Minimum depth of drilled hole to deepest point	$h_1 \geq [\text{mm}]$	45			
Overall plastic anchor embedment depth in the base material	$h_{\text{nom},1} \geq [\text{mm}]$	25			
Thickness of fixture	$t_{\text{fix}} = [\text{mm}]$	80	80	80	110
Thickness of equalizing layer for compensation of tolerances or non-loadbearing layer	$t_{\text{tol},\text{min}} = [\text{mm}]$	0	0	50	20
	$t_{\text{tol},\text{max}} = [\text{mm}]$	20	50	110 ¹⁾	80 ¹⁾
Total length of borehole	$h_3 \geq [\text{mm}]$	h_D+65	h_D+95	h_D+155	h_D+125

¹⁾ If $t_{\text{tol},\text{max}}$ exceeds 50 mm it has to be ensured that the material t_{tol} has enough capability to carry the dead load of the ETICS. This can be considered as given if t_{tol} consists of plaster, old insulation or shells of jacket blocks.

Table B2 Installation parameters for use in thin concrete members (e.g. weather resistant skin of external wall panels) and hollow masonry (use category C)

Anchor type		D8-FV H 125	D8-FV H 155	D8-FV H 215	
		HTH 8x125	HTH 8x155	HTH 8x215	
Drill hole diameter	$d_0 = [\text{mm}]$	8			
Cutting diameter of drill bit	$d_{\text{cut}} \leq [\text{mm}]$	8,45			
Minimum depth of drilled hole to deepest point	$h_1 \geq [\text{mm}]$	45			
Overall plastic anchor embedment depth in the base material	$h_{\text{nom},1} \geq [\text{mm}]$	25			
Thickness of fixture	$t_{\text{fix}} = [\text{mm}]$	80	80	80	110
Thickness of equalizing layer for compensation of tolerances or non-loadbearing layer	$t_{\text{tol},\text{min}} = [\text{mm}]$	0	20 ¹⁾	80 ¹⁾	50 ¹⁾
	$t_{\text{tol},\text{max}} = [\text{mm}]$	20	50	110 ²⁾	80 ²⁾
Total length of borehole	$h_3 \geq [\text{mm}]$	h_D+65	h_D+95	h_D+155	h_D+125

¹⁾ $t_{\text{tol},\text{min}}$ may be lower if the anchor performance is tested on site.

²⁾ If $t_{\text{tol},\text{max}}$ exceeds 50 mm it has to be ensured that the material t_{tol} has enough capability to carry the dead load of the ETICS. This can be considered as given if t_{tol} consists of plaster, old insulation or shells of jacket blocks.

Hilti ETICS anchors D8-FV H and HTH

Intended use
Installation parameters – use categories A, B, C

Annex B 2

Table B3 Installation parameters for use in lightweight aggregate concrete and autoclaved aerated concrete (use category D, E)


Anchor type		D8-FV H 125 HTH 8x125	D8-FV H 155 HTH 8x155	D8-FV H 215 HTH 8x215
Drill hole diameter	$d_0 =$ [mm]	8		
Cutting diameter of drill bit	$d_{cut} \leq$ [mm]	8,45		
Minimum depth of drilled hole to deepest point	$h_1 \geq$ [mm]	75		
Overall plastic anchor embedment depth in the base material	$h_{nom,2} \geq$ [mm]	55		
Thickness of fixture	$t_{fix} =$ [mm]	80	80	110
Thickness of equalizing layer for compensation of tolerances or non-loadbearing layer	$t_{tol,min} =$ [mm]	0	0	0
	$t_{tol,max} =$ [mm]	20	80 ¹⁾	50
Total length of borehole	$h_3 \geq$ [mm]	h_D+95	h_D+155	h_D+125

¹⁾ If $t_{tol,max}$ exceeds 50 mm it has to be ensured that the material t_{tol} has enough capability to carry the dead load of the ETICS. This can be considered as given if t_{tol} consists of plaster, old insulation or shells of jacket blocks.

Table B4 Minimum thickness of base material, edge distance and anchor spacing

		D8-FV H HTH
Minimum thickness of the base material	concrete, masonry, lightweight aggregate concrete and autoclaved aerated concrete	h_{min} [mm] 100
	thin concrete members (e.g. weather resistant skin of external wall panels)	h_{min} [mm] 40
Minimum allowable spacing	s_{min} [mm]	100
Minimum allowable edge distance	c_{min} [mm]	100

Scheme of minimum thickness of base material, edge distances and anchor spacings

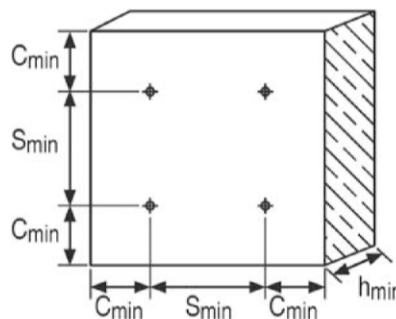

Hilti ETICS anchors D8-FV H and HTH

Intended use
Installation parameters – use categories D, E
Minimum thickness of base material, distances and spacings

Annex B 3

Installation instructions of D8-FV H

Example given for anchor size D8-FV H 155

HILTI
D8-FV 155

1 $h_3 = h_D + 95\text{mm}$ $h_D = 100\text{-}360\text{mm}$

EPS
 mineral wool

2

min. 12mm
 18 V
 n = 370-600 U/min

3 $h_3 = h_D + 95\text{mm}$

$d_0 = 8\text{mm}$
 $t_{D1} = 0\text{-}50\text{mm}$ $t_{D2} = 20\text{-}50\text{mm}$ $t_{D3} = 0\text{-}20\text{mm}$

4

SW1
 $h_D = 100\text{-}200\text{mm}$
 SW2
 $h_D = 200\text{-}360\text{mm}$

5

h_D
 200mm, 190mm, 180mm, 170mm, 160mm, 150mm, 140mm, 130mm, 110mm, 100mm, 360mm, 350mm, 340mm, 330mm, 320mm, 310mm, 300mm, 290mm, 280mm, 270mm, 260mm, 250mm, 240mm, 230mm, 220mm, 210mm, 200mm

6

click!

7

n = 370-600 U/min

8

9

90° + 5 kg

10

11a

11b

Hilti ETICS anchors D8-FV H and HTH

Intended use
Installation instructions for D8-FV H

Annex B 4

Installation instructions of HTH

1 $h_D = 100-360\text{mm}$

2

3

HTH 8 x 125 $h_3 = h_D + 55\text{mm}$					
	$t_{tol} = 0-20\text{mm}$				
HTH 8 x 155 $h_3 = h_D + 95\text{mm}$					
	$t_{tol} = 0-50\text{mm}$		$t_{tol} = 20-50\text{mm}$		$t_{tol} = 0-20\text{mm}$
HTH 8 x 215 $h_3 = h_D + 155\text{mm}$					
	$t_{tol} = 50-110\text{mm}$		$t_{tol} = 80-110\text{mm}$		$t_{tol} = 0-80\text{mm}$

4

$h_D = 100 - 200\text{ mm} \rightarrow$ HTH-SW 1
 $h_D = 200 - 360\text{ mm} \rightarrow$ HTH SW 2

5

6

$n = 370-600\text{ U/min}$

7

8

$+5\text{ kg}$

9

10a

10b

Hilti ETICS anchors D8-FV H and HTH

Intended use
Installation instructions for HTH

Annex B 5

Table C1 Characteristic resistance to tension loads N_{Rk} in concrete, masonry, lightweight aggregate concrete and autoclaved aerated concrete for single anchor

Base material	Use cat. 4)	Bulk density class ρ [kg/dm ³]	Compressive strength class f_b [N/mm ²]	Remarks	Drill method	N_{Rk} [kN]
Concrete C12/15 – C50/60 EN 206-1:2000	A	-	-	-	hammer	1,2
Thin concrete members (e.g. weather resistant skins of external wall panels) C16/20 – C50/60, EN 206-1:2000	A	-	-	Thickness of the thin skin $h \geq 40\text{mm}$	hammer	1,2
Clay brick, Mz e.g. according to DIN 105-100:2012-01 / EN 771-1:2011	B	2,0	20	Cross section reduced up to 15% by perforation vertically to the resting area	hammer	1,2
Sand-lime solid brick, KS e.g. according to DIN V 106:2005-10 / EN 771-2:2011	B	2,0	20	Cross section reduced up to 15% by perforation vertically to the resting area	hammer	1,2
Vertically perforated clay brick, Hz, e.g. according to DIN 105-100:2012-01 / EN 771-1:2011	C	1,2	12	Cross section reduced > 15% and $\leq 50\%$ by perforation vertically to the resting area ¹⁾	rotary	1,2
Vertically perforated clay brick, Hz, e.g. according to DIN 105-100:2012-01 / EN 771-1:2011	C	0,8	12	Cross section reduced > 15% and $\leq 50\%$ by perforation vertically to the resting area ²⁾ , net density $\geq 1,5 \text{ kg/dm}^3$	rotary	0,6
Vertically perforated sand-lime brick, KSL e.g. according to DIN V 106:2005-10 / EN 771-2:2011	C	1,4	12	Cross section reduced > 15% and $\leq 50\%$ by perforation vertically to the resting area ³⁾	rotary	1,2
Lightweight aggregate concrete, LAC, e.g. according to EN 1520:2011 / EN 771-3:2011	D	0,9	2 4	-	hammer	0,6 1,2
Autoclaved aerated concrete, AAC, e.g. according to EN 771-4:2011	E	0,5	4	-	rotary	0,9

¹⁾ The value applies only for outer web thickness $\geq 12 \text{ mm}$

²⁾ The value applies only for outer web thickness $\geq 9 \text{ mm}$

³⁾ The value applies only for outer web thickness $\geq 23 \text{ mm}$

⁴⁾ Different installation parameters for use categories A, B, C and use categories D, E and thin concrete members to be considered (see Annex B 2 and B 3)

Otherwise the characteristic resistance shall be determined by job-site pull-out tests

Hilti ETICS anchors D8-FV H and HTH

Performance
Characteristic resistance

Annex C 1

Table C2 Point thermal transmittance acc. EOTA Technical Report TR 025:2016-05

Anchor type	Insulation thickness h_D [mm]	Point thermal transmittance χ [W/K]		
		Hole filled with EPS plug	Hole filled with PUR spray foam	
D8-FV H 125 D8-FV H 155 D8-FV H 215	$t_{fix}=80\text{mm}$	$100 \leq h_D \leq 150$	0,001	0,001
		$150 < h_D \leq 360$	0,001	0,000
		$130 \leq h_D \leq 150$	0,002	0,002
D8-FV H 155 D8-FV H 215	$t_{fix}=110\text{mm}$	$150 < h_D \leq 360$	0,001	0,001
		$100 \leq h_D \leq 150$	0,001	0,001
HTH 125 HTH 155 HTH 215	$t_{fix}=80\text{mm}$	$150 < h_D \leq 360$	0,000	0,000
		$130 \leq h_D \leq 150$	0,001	0,001
HTH 155 HTH 215	$t_{fix}=110\text{mm}$	$150 < h_D \leq 360$	0,001	0,001
		$160 \leq h_D \leq 360$	0,002	0,002

Table C3 Displacements

Base material	Bulk density class ρ [kg/dm ³]	Compressive strength class f_b [N/mm ²]	Tension load N [kN]	$\delta_m(N)$ [mm]
Concrete, C12/15 – C50/60 (EN 206-1:2000)	-	-	0,40	< 0,6
Thin concrete members, C16/20 – C50/60 (EN 206-1:2000)	-	-	0,40	< 0,5
Clay brick, Mz (DIN 105-100:2012-01 / EN 771-1:2011)	2,0	20	0,40	< 0,5
Sand-lime solid brick, KS (DIN V 106:2005-10 / EN 771-2:2011)	2,0	20	0,40	< 0,5
Vertically perforated clay brick, HLz (DIN 105-100:2012-01 / EN 771-1:2011)	1,2	12	0,40	< 0,5
Vertically perforated clay brick, HLz net density $\geq 1,5 \text{ kg/dm}^3$ (DIN 105-100:2012-01 / EN 771-1:2011)	0,8	12	0,20	< 0,2
Vertically perforated sand-lime brick, KSL (DIN V 106:2005-10 / EN 771-2:2011)	1,4	12	0,40	< 0,5
Lightweight aggregate concrete, LAC (EN 1520:2011 / EN 771-3:2011)	0,9	2	0,20	< 0,5
		4	0,40	< 0,5
Autoclaved aerated concrete, AAC (EN 771-4:2011)	0,5	4	0,30	< 0,7

Hilti ETICS anchors D8-FV H and HTH

Performance
Point thermal transmittance and displacements

Annex C 2