

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-18/0588**  
**of 29 November 2018**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Fosroc Lokfix E75  
for rebar connection

Product family  
to which the construction product belongs

Systems for post-installed rebar  
connections with mortar

Manufacturer

Fosroc International Limited  
Drayton Manor Business Park Coleshill Road  
TAMWORTH STAFFORDSHIRE; B78 3XN  
GROSSBRITANNIEN

Manufacturing plant

Fosroc Plant RC1

This European Technical Assessment  
contains

23 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330087-00-0601

This version replaces

ETA-18/0588 issued on 12 July 2018

**European Technical Assessment**

**ETA-18/0588**

English translation prepared by DIBt

**Page 2 of 23 | 29 November 2018**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The subject of this European Technical Assessment is the post-installed connection, by anchoring or overlap connection joint, of reinforcing bars (rebars) in existing structures made of normal weight concrete, using the "Fosroc Lokfix E75 for rebar connection" in accordance with the regulations for reinforced concrete construction.

Reinforcing bars made of steel with a diameter  $\phi$  from 8 to 40 mm or the tension anchor ZA from sizes M12 to M24 according to Annex A and injection mortar Lokfix E75 are used for rebar connections. The rebar is placed into a drilled hole filled with injection mortar and is anchored via the bond between rebar, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the rebar connection of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance under static and quasi-static loading	See Annex C 1 and C 2

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 3 and C 4

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330087-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 29 November 2018 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department


*beglaubigt:*  
Baderschneider

Installation post installed rebar


**Figure A1:** Overlapping joint for rebar connections of slabs and beams

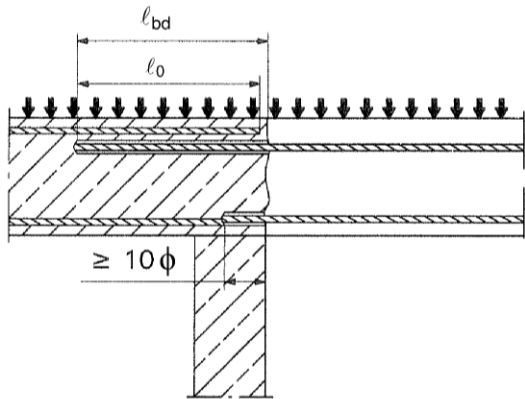


**Figure A3:** End anchoring of slabs or beams (e.g. designed as simply supported)

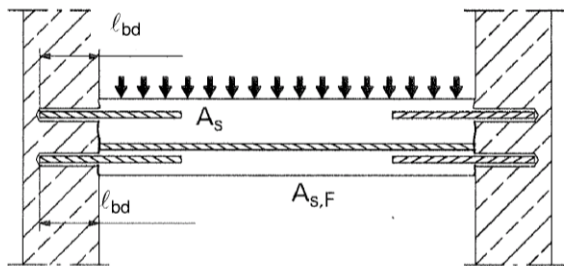


**Figure A5:** Anchoring of reinforcement to cover the line of acting tensile force

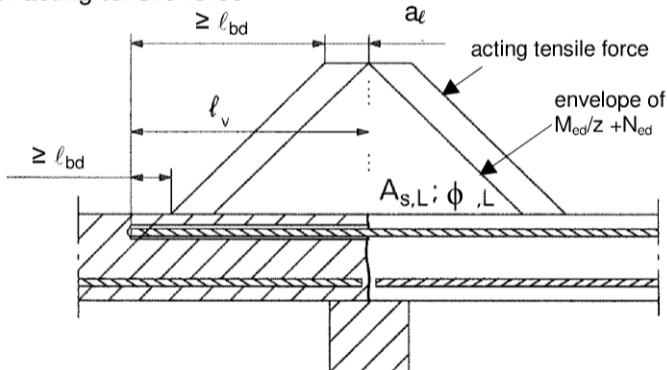

**Figure A2:** Overlapping joint at a foundation of a wall or column where the rebars are stressed in tension

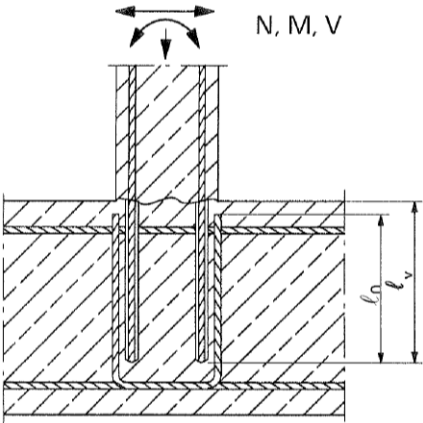

**Figure A4:** Rebar connection for components stressed primarily in compression. The rebars are stressed in compression

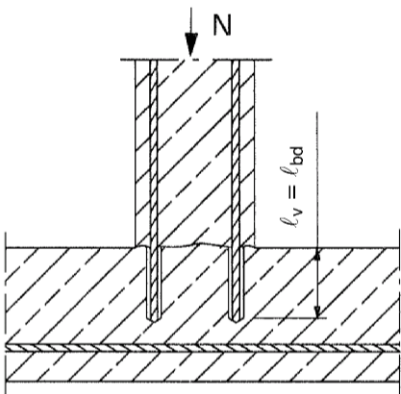

**Note to Figure A1 to A5:**

In the Figures no transverse reinforcement is plotted, the transverse reinforcement shall comply with EN 1992-1-1:2004+AC:2010.

Preparing of joints according to Annex B 2

Fosroc Lokfix E75 for rebar connection


Product description

Installed condition and examples of use for rebars


Annex A 1

Installation tension anchor ZA


**Figure A6:** Overlapping joint of a column stressed in bending to a foundation

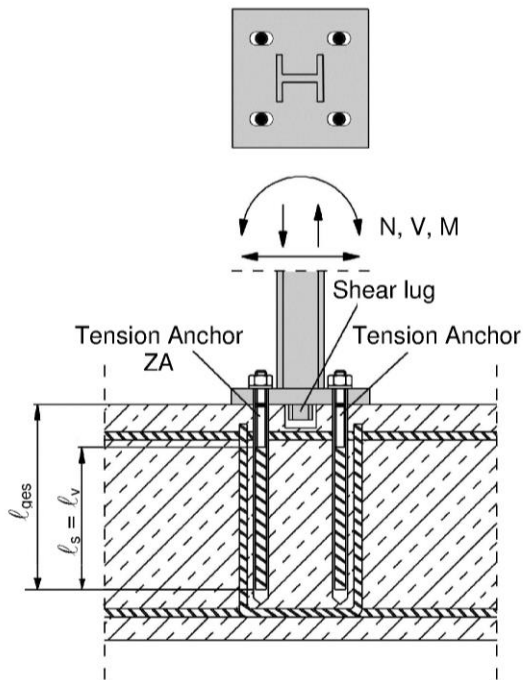

**Figure A7:** Overlap joint for the anchorage of barrier posts

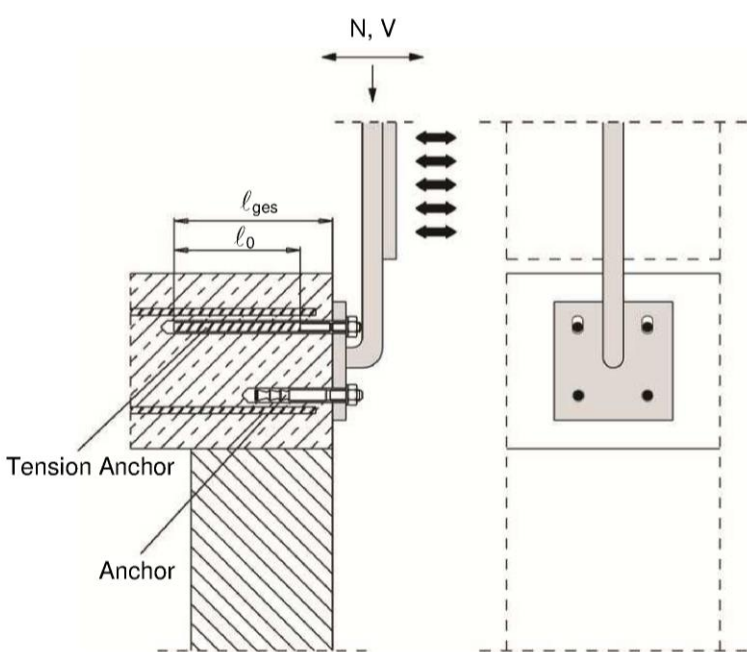

**Figure A8:** Overlap joint for the anchorage to cantilever members

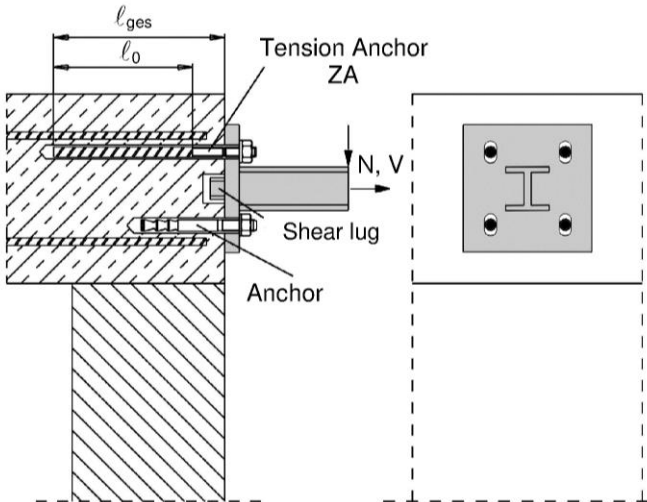

**Note to Figure A6 to A8:**

In the Figures no transverse reinforcement is plotted, the transverse reinforcement shall comply with EN 1992-1-1:2002+AC:2010

Fosroc Lokfix E75 for rebar connection

**Product description**  
Installed condition and examples of use for tension anchors ZA


**Annex A 2**

## Fosroc Lokfix E75:

### Injection mortar: Lokfix E75

#### Type "side-by-side":


385 ml, 444ml, 585 ml, 999 ml  
and 1400 ml

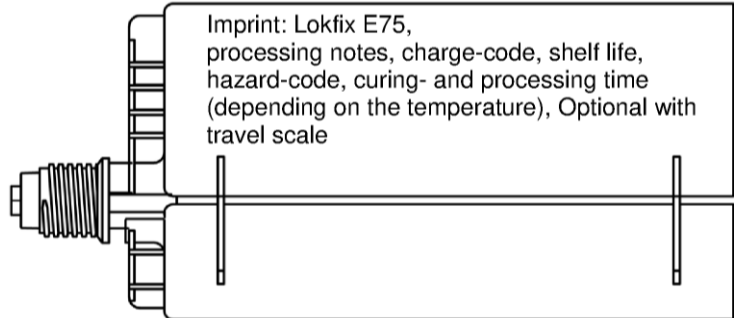

### Static Mixer




### Piston plug and mixer extension

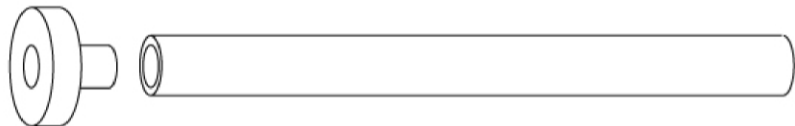

### Reinforcing bar (rebar): ø8, ø10, ø12, ø14, ø16, ø20, ø22, ø24, ø25, ø28, ø32, ø34, ø36, ø40



### Tension Anchor ZA: M12 to M24

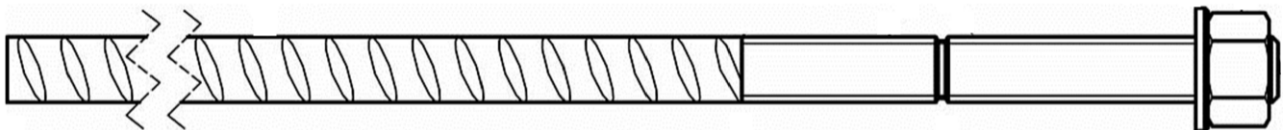

## Fosroc Lokfix E75 for rebar connection

### Product description

Injection mortar / Static mixer / Rebar / Tension Anchor ZA

## Annex A 3



**Reinforcing bar (rebar):  $\varnothing 8$ ,  $\varnothing 10$ ,  $\varnothing 12$ ,  $\varnothing 14$ ,  $\varnothing 16$ ,  $\varnothing 20$ ,  $\varnothing 22$ ,  $\varnothing 24$ ,  $\varnothing 25$ ,  $\varnothing 28$ ,  $\varnothing 32$ ,  $\varnothing 34$ ,  $\varnothing 36$ ,  $\varnothing 40$**



- Minimum value of related rib area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- Rib height of the bar shall be in the range  $0,05\phi \leq h \leq 0,07\phi$   
( $\phi$ : Nominal diameter of the bar; h: Rib height of the bar)


**Table A1: Materials**


Designation	Material
Rebar EN 1992-1-1:2004+AC:2010, Annex C	Bars and de-coiled rods class B or C $f_{yk}$ and $k$ according to NDP or NCL of EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$
<p><b>Fosroc Lokfix E75 for rebar connection</b></p> <p><b>Product description</b> Materials Rebar</p>	


**Annex A 4**



## Tension Anchor ZA: M12, M16, M20, M24

Marking: e.g.  12 A4

-  Mark of the producer  
ZA Trade name  
12 Rod diameter/thread  
A4 for stainless steel A4  
HCR for high corrosion resistance steel

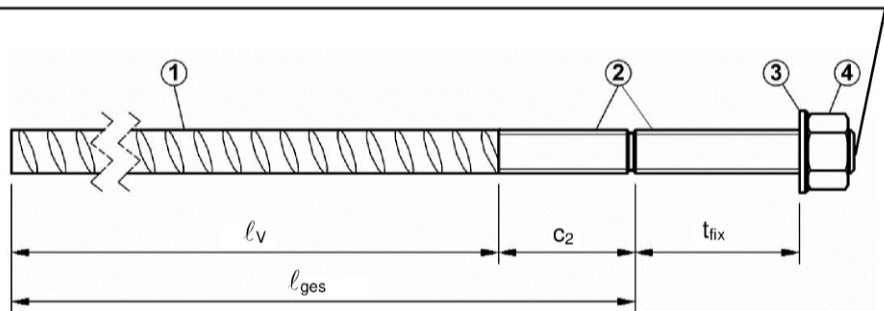

**Table A2: Materials**

Part	Designation	Material											
		ZA vz				ZA A4				ZA HCR			
		M12	M16	M20	M24	M12	M16	M20	M24	M12	M16	M20	M24
1	Reinforcement bar	Class B according to NDP or NCL of EN 1992-1-1/NA $f_{yk} = f_{tk} = k \cdot f_{yk}$											
2	Threaded rod	Steel, zinc plated according to EN 10087:1998 or EN 10263:2001				Stainless steel, 1.4362, 1.4401, 1.4404, 1.4571, EN 10088-1:2014				High corrosion resistant steel, 1.4529, 1.4565, EN 10088-1:2014			
		$f_{yk}$ [N/mm <sup>2</sup> ] 640				640 560				640 560			
3	Washer	Steel, zinc plated according to EN 10087:1998 or EN 10263:2001				Stainless steel, 1.4362, 1.4401, 1.4404, 1.4571, EN 10088-1:2014				High corrosion resistant steel, 1.4529, 1.4565, EN 10088-1:2014			
4	Nut												

**Table A3: Dimensions and installation parameter**

Size			ZA-M12	ZA-M16	ZA-M20	ZA-M24
Diameter of threaded rod		[mm]	12	16	20	24
Diameter of reinforcement bar		[mm]	12	16	20	25
Drill hole diameter		[mm]	16	20	25	32
Diameter of clearance hole in fixture		[mm]	14	18	22	26
With across nut flats	SW	[mm]	19	24	30	36
Stress area	A <sub>s</sub>	[mm <sup>2</sup> ]	84	157	245	353
Effective embedment depth	l <sub>v</sub>	[mm]	according to static calculation			
Length of bonded thread	plated	c <sub>2</sub>	[mm]	≥ 20	≥ 20	≥ 20
	A4/HCR			≥ 100	≥ 100	≥ 100
Minimum thickness of fixture	t <sub>fix</sub>	[mm]	5	5	5	5
Maximum thickness of fixture	t <sub>fix</sub>	[mm]	3000	3000	3000	3000
Maximum installation torque	T <sub>max</sub>	[Nm]	50	100	150	150

### Fosroc Lokfix E75 for rebar connection

**Product description**  
Specifications Tension Anchor ZA

### Annex A 5

## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loads.
- Fire exposure

### Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000.
- Strength classes C12/15 to C50/60 according to EN 206-1:2000.
- Maximum chloride concrete of 0,40% (CL 0.40) related to the cement content according to EN 206-1:2000.
- Non-carbonated concrete.

Note: In case of a carbonated surface of the existing concrete structure the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of  $\phi + 60$  mm prior to the installation of the new rebar.

The depth of concrete to be removed shall correspond to at least the minimum concrete cover in accordance with EN 1992-1-1:2004+AC:2010.

The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions.

### Temperature Range:

- - 40°C to +80°C (max. short term temperature +80°C and max long term temperature +50°C).

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions or subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the forces to be transmitted.
- Design according to EN 1992-1-1:2004+AC:2010, EN 1992-1-2:2004+AC:2008 and Annex B 2 and B 3.
- The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing.

### Installation:

- Dry or wet concrete.
- It must not be installed in flooded holes.
- Hole drilling by hammer drill (HD), hollow drill (HDB), compressed air drill (CD) or diamond drill mode (DD).
- The installation of post-installed rebar resp. tension anchors shall be done only by suitable trained installer and under supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for supervision on site are up to the Member States in which the installation is done.
- Check the position of the existing rebars (if the position of existing rebars is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint).


### Fosroc Lokfix E75 for rebar connection

Intended use  
Specifications

Annex B 1

Figure B1: General construction rules for post-installed rebars

- Only tension forces in the axis of the rebar may be transmitted
- The transfer of shear forces between new concrete and existing structure shall be designed additionally according to EN 1992-1-1:2004+AC:2010.
- The joints for concreting must be roughened to at least such an extent that aggregate protrude.

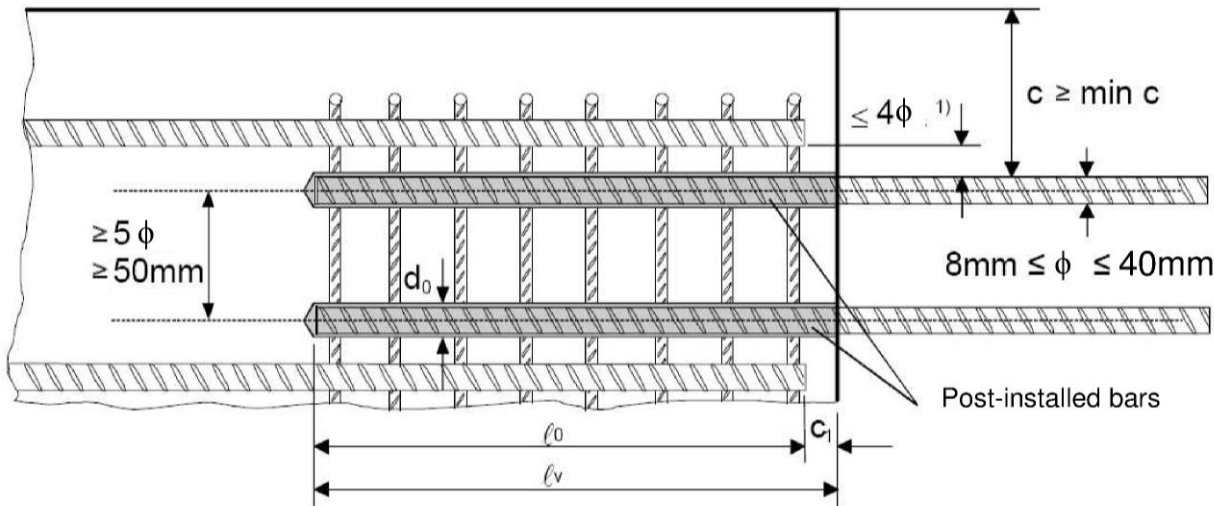

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4\phi$ , then the lap length shall be increased by the difference between the clear bar distance and  $4\phi$ .

The following applies to Figure B1:

- $c$  concrete cover of post-installed rebar
- $c_1$  concrete cover at end-face of existing rebar
- $\min c$  minimum concrete cover according to Table B1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2
- $\phi$  diameter of post-installed rebar
- $\ell_0$  lap length, according to EN 1992-1-1:2004+AC:2010, Section 8.7.3
- $\ell_v$  effective embedment depth,  $\geq \ell_0 + c_1$
- $d_0$  nominal drill bit diameter, see Annex B 4

Fosroc Lokfix E75 for rebar connection


Intended use

General construction rules for post-installed rebars

Annex B 2

Figure B2: General construction rules for tension anchors ZA

- The length of the bonded-in thread may not be accounted as anchorage
- Only tension forces in the direction of the bar axis may be transmitted by the tension anchor ZA
- The tension force must be transferred via an overlap joint to the reinforcement in the building part.
- The transfer of shear forces shall be ensured by appropriate additional measures, e.g. shear lugs or by anchors with an European technical assessment.
- In the anchor plate, the holes for the tension anchors shall be executed as elongated holes with axis in the direction of the shear force.

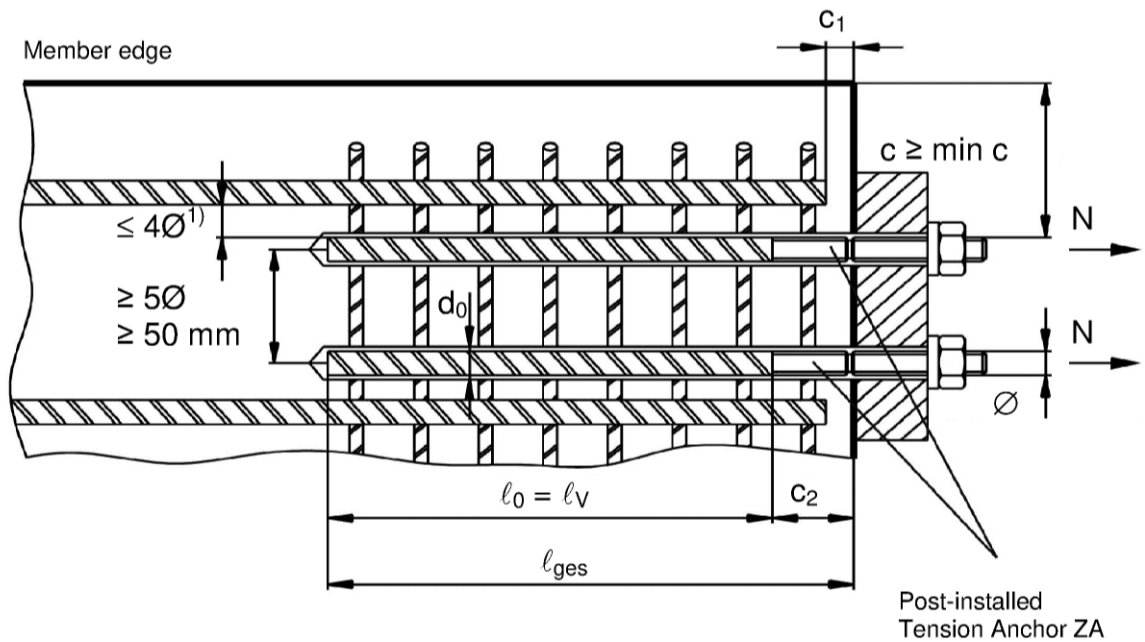

<sup>1)</sup> If the clear distance between lapped bars exceeds  $4\phi$ , then the lap length shall be increased by the difference between the clear bar distance and  $4\phi$ .

The following applies to Figure B2:

c	concrete cover of tension anchor ZA
$c_1$	concrete cover at end-face of existing rebar
$c_2$	Length of bonded thread
min c	minimum concrete cover according to Table B1 and to EN 1992-1-1:2004+AC:2010, Section 4.4.1.2
$\phi$	diameter of tension anchor
$l_0$	lap length, according to EN 1992-1-1:2004+AC:2010, Section 8.7.3
$l_v$	effective embedment depth, $\geq l_0 + c_1$
$l_{ges}$	overall embedment depth, $\geq l_0 + c_2$
$d_0$	nominal drill bit diameter, see Annex B 4


Fosroc Lokfix E75 for rebar connection

Intended use  
General construction rules for tension anchors

Annex B 3



**Table B1: Minimum concrete cover min  $c^1$  of post-installed rebar and tension anchor ZA depending of drilling method**

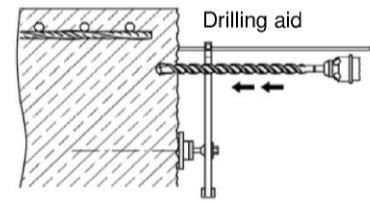

Drilling method	Rebar diameter	Without drilling aid	With drilling aid
Hammer drilling (HD) Hollow drilling (HDB)	< 25 mm	$30 \text{ mm} + 0,06 \cdot l_v \geq 2 \phi$	$30 \text{ mm} + 0,02 \cdot l_v \geq 2 \phi$
	$\geq 25 \text{ mm}$	$40 \text{ mm} + 0,06 \cdot l_v \geq 2 \phi$	$40 \text{ mm} + 0,02 \cdot l_v \geq 2 \phi$
Compressed air drilling (CD)	< 25 mm	$50 \text{ mm} + 0,08 \cdot l_v$	$50 \text{ mm} + 0,02 \cdot l_v$
	$\geq 25 \text{ mm}$	$60 \text{ mm} + 0,08 \cdot l_v$	$60 \text{ mm} + 0,02 \cdot l_v$
Diamond coring (DD)	< 25 mm	Drill stand used as drilling aid	$30 \text{ mm} + 0,02 \cdot l_v \geq 2 \phi$
	$\geq 25 \text{ mm}$		$40 \text{ mm} + 0,02 \cdot l_v \geq 2 \phi$

<sup>1)</sup> see Annex B 2, Figure B1 and Annex B 3, Figure B2  
Comments: The minimum concrete cover acc. EN 1992-1-1:2004+AC:2010 must be observed

**Table B2: Bore hole diameter and maximum embedment depth  $l_{v,max}$**

Bar size Φ rebar	Bar size Φ tension anchor ZA	Drill bit - Ø			Cartridge: side-by-side (385, 444, 585, 999, 1400 ml)				Cartridge: side-by-side (999, 1400 ml)					
					Hand or battery tool		Pneumatic tool		Pneumatic tool					
		HD + HDB	CD	DD	l <sub>v,max</sub>	Mixer extension	l <sub>v,max</sub>	Mixer extension	l <sub>v,max</sub>	Mixer extension				
(mm)	(mm)	(mm)			(mm)		(mm)		(mm)					
8		12	-	12	700	VL 10/0,75	800	VL 10/0,75	800	VL 10/0,75				
10		14	-	14			1000		1000					
12	M12	16							1400	1200	VL 16/1,8			
14		18								1600				
16	M16	20								2000				
20	M20	25	26	25	500		700		2000	VL 16/1,8				
22		28					500							
24		32												
25	M24	32												
28		35												
32		40			-		500					VL 10/0,75	2000	VL 16/1,8
34		40												
36		45												
40		55	55	52										

**Fosroc Lokfix E75 for rebar connection**

**Intended use**  
Minimum concrete cover  
Maximum embedment depth






**Annex B 4**

**Table B3: Base material temperature, gelling time and curing time**

Concrete temperature	Gelling- / working time <sup>1)</sup>	Minimum curing time in dry concrete	Minimum curing time in wet concrete
	$t_{gel}$	$t_{cure,dry}$	$t_{cure,wet}$
$\geq + 5\text{ °C}$	120 min	50 h	100 h
$\geq + 10\text{ °C}$	90 min	30 h	60 h
$\geq + 20\text{ °C}$	30 min	10 h	20 h
$\geq + 30\text{ °C}$	20 min	6 h	12 h
$\geq + 40\text{ °C}$	12 min	4 h	8 h

<sup>1)</sup>  $t_{gel}$ : maximum time from starting of mortar injection to completing of rebar setting.

**Table B4: Dispensing tools**

Cartridge type/size	Hand tool		Pneumatic tool
Side-by-side cartridges 385, 444, 585 ml	 e.g. SA 296C585	 e.g. Type H 244 C	 e.g. Type TS 444 KX
Side-by-side cartridge 999 ml	-	-	 e.g. Type TS 4104
Side-by-side cartridge 1400 ml	-	-	 e.g. Type TS 471

All cartridges could also be extruded by a battery tool.

**Fosroc Lokfix E75 for rebar connection**


**Intended use**  
Working time and curing times  
Dispensing tools

**Annex B 5**

**Table B5: Installation tools**

Bar size Φ rebar	Bar size Φ tension anchor ZA	Drill and clean						Installation			
		Drill bit - Ø			Brush		min Brush - Ø	Air Nozzle	Piston plug	Mixer extension	Max embedment depth
		HD + HDB	CD	DD		d <sub>b</sub>	d <sub>b,min</sub>				l <sub>v</sub> or l <sub>e,ges</sub>
[mm]	[mm]	[mm]			[-]	[mm]	[mm]	[-]	[-]	[-]	[mm]
8		12	-	12	RBT12	14	12,5	AN10	-	VL 10/0,75 or VL 16/1,8	800
10		14	-	14	RBT14	16	14,5		VS14		1000
12	M12	16			RBT16	18	16,5	AN14	VS16		1200
14		18			RBT18	20	18,5		VS18		1400
16	M16	20			RBT20	22	20,5	AN17	VS20		1600
20	M20	25	-	25	RBT25	27	25,5		VS25		2000
		-	26	-	RBT25	27	26,5		VS25		2000
22		28			RBT28	30	28,5	AN27	VS28		2000
24		32			RBT32	34	32,5		VS32		2000
25	M24	32			RBT32	34	32,5		VS32		2000
28		35			RBT35	37	35,5		VS35		2000
32		40			RBT40	42	40,5		VS40		2000
34		40			RBT40	42	40,5		VS40		2000
36		45			RBT45	47	45,5		AN40		VS45
40		-	-	52	RBT52	54	52,5	VS52			2000
		55	55	-	RBT55	58	55,5	VS55			2000

**Brush RBT:**

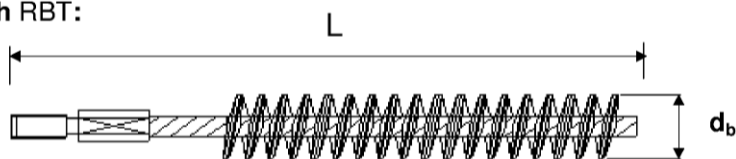

**SDS Plus Adapter:**




**Rec. compressed air tool  
hand slide valve (min 6 bar)**



**Hand pump (volume 750 ml)**



**Air nozzle:**



**Brush extension:**




**Fosroc Lokfix E75 for rebar connection**

**Intended use**  
Installation tools

**Annex B 6**



## 1) Bore hole drilling

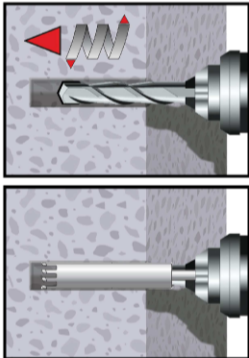


1. Drill a hole into the base material to the size and embedment depth required by the selected reinforcing bar with carbide hammer drill (HD) hollow drill (HDB), a compressed air drill (CD) or diamond core (DD). In case of aborted drill hole: the drill hole shall be filled with mortar. Drill bit sizes see Table B5.



Hammer drilling (HD)  
Hollow drilling (HDB)




Compressed air drilling (CD)






Diamond coring (DD)

## 2a) Bore hole cleaning (HD, HDB and CD)


**Attention! Standing water in the bore hole must be removed before cleaning.**



or



or



- 2a. Starting from the bottom or back of the bore hole, blow the hole clean with compressed air (min. 6 bar) or a hand pump a minimum of two times. If the bore hole ground is not reached an extension shall be used.

For bore holes deeper than 240 mm, compressed air (min. 6 bar **must** be used. For bore holes larger than 32 mm, compressed air (min. 6 bar) and the appropriate air nozzle (see Table B5) **must** be used.

- 2b. Check brush diameter (Table B5) and attach the brush to a drilling machine or a battery screwdriver. Brush the hole with an appropriate sized wire brush  $> d_{b,min}$  (Table B5) a minimum of two times. If the bore hole ground is not reached with the brush, a brush extension shall be used.

- 2c. Finally blow the hole clean again with compressed air (min. 6 bar) or a hand pump a minimum of two times. If the bore hole ground is not reached an extension shall be used.

For bore holes deeper than 240 mm, compressed air (min. 6 bar **must** be used. For bore holes larger than 32 mm, compressed air (min. 6 bar) and the appropriate air nozzle (see Table B5) **must** be used.

**After cleaning, the bore hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the bore hole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**


Fosroc Lokfix E75 for rebar connection

Intended use


Installation instruction: Bore hole drilling and cleaning (HD, HDB and CD)

Annex B 7


## 2b) Bore hole cleaning (DD)



2a. Rinsing with water until clear water comes out.




2b. Check brush diameter acc. Table B5 and attach the brush to a drilling machine or a battery screwdriver. Brush the hole with an appropriate sized wire brush  $> d_{b,min}$  (Table B5) a minimum of two times. If the bore hole ground is not reached with the brush, a brush extension shall be used (Table B5).




2c. Rinsing again with water until clear water comes out.

**Attention! Standing water in the bore hole must be removed before cleaning.**



2d. Starting from the bottom or back of the bore hole, blow the hole clean with compressed air (min. 6 bar) with the appropriate air nozzle (see Table B5) a minimum of two times. If the bore hole ground is not reached an extension shall be used.



2e. Check brush diameter (Table B5) and attach the brush to a drilling machine or a battery screwdriver. Brush the hole with an appropriate sized wire brush  $> d_{b,min}$  (Table B5) a minimum of two times. If the bore hole ground is not reached with the brush, a brush extension shall be used.



2f. Finally blow the hole clean again with compressed air (min. 6 bar) with the appropriate air nozzle (see Table B5) a minimum of two times. If the bore hole ground is not reached an extension shall be used.

**After cleaning, the bore hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the bore hole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**


**Fosroc Lokfix E75 for rebar connection**

**Intended Use**

Installation instruction: Bore hole cleaning (DD)


**Annex B 8**

### 3) Preparation of bar and cartridge




3a. Attach the supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool.

For every working interruption longer than the recommended working time (Table B3) as well as for every new cartridges, a new static-mixer shall be used.




3b. Prior to inserting the reinforcing bar into the filled bore hole, the position of the embedment depth shall be marked (e.g. with tape) on the reinforcing bar and insert bar in empty hole to verify hole and depth  $\ell_v$ .

The anchor should be free of dirt, grease, oil or other foreign material.




3c. Prior to dispensing into the anchor hole, squeeze out separately the mortar until it shows a consistent grey or red colour, but a minimum of three full strokes, and discard non-uniformly mixed adhesive components.

### 4) Filling the bore hole




4. Starting from the bottom or back of the cleaned anchor hole fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid creating air pockets. For embedment larger than 190 mm an extension nozzle shall be used.



For overhead and horizontal installation and bore holes deeper than 240 mm a piston plug and the appropriate mixer extension must be used.

Observe the gel-/ working times given in Table B3.

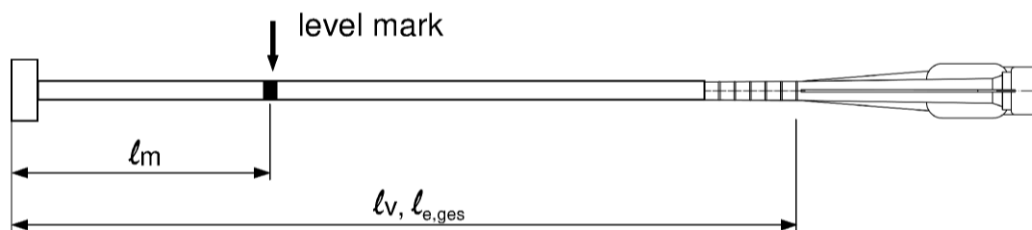

Injection tool must be marked by mortar level mark  $\ell_m$  and anchorage depth  $\ell_v$  resp.  $\ell_{e,ges}$  with tape or marker.

Quick estimation:  $\ell_m = 1/3 \cdot \ell_v$

Continue injection until the mortar level mark  $\ell_m$  becomes visible.

Optimum mortar volume:  $\ell_m = \ell_v$  resp.  $\ell_{e,ges} \cdot \left( 1,2 \cdot \frac{\phi^2}{d_0^2} - 0,2 \right)$  [mm]


#### Fosroc Lokfix E75 for rebar connection

##### Intended Use

Installation instruction: Preparation of bar and cartridge  
Filling the bore hole


#### Annex B 9

## 5) Setting the rebar




- 5a. Push the reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached.

The bar should be free of dirt, grease, oil or other foreign material.



- 5b. Be sure that the bar is inserted in the bore hole until the embedment mark is at the concrete surface and that excess mortar is visible at the top of the hole. If these requirements are not maintained, the application has to be renewed. For horizontal and overhead installation fix embedded part (e.g. with wedges).



- 5c. Observe gelling time  $t_{gel}$ . Attend that the gelling time can vary according to the base material temperature (see Table B3). It is not allowed to move the bar after gelling time  $t_{gel}$  has elapsed. Allow the adhesive to cure to the specified time prior to applying any load. Do not move or load the bar until it is fully cured (attend Table B3). After full curing time  $t_{cure}$  has elapsed, the add-on part can be installed.

Fosroc Lokfix E75 for rebar connection

Intended Use

Installation instruction: Inserting rebar

Annex B 10



## Minimum anchorage length and minimum lap length

The minimum anchorage length  $\ell_{b,min}$  and the minimum lap length  $\ell_{0,min}$  according to EN 1992-1-1:2004+AC:2010 ( $\ell_{b,min}$  acc. to Eq. 8.6 and Eq. 8.7 and  $\ell_{0,min}$  acc. to Eq. 8.11) shall be multiply by the amplification factor  $\alpha_{lb}$  according to Table C1.

**Table C1: Amplification factor  $\alpha_{lb}$  related to concrete class and drilling method**

Concrete class	Drilling method	Bar size	Amplification factor $\alpha_{lb}$
C12/15 to C50/60	Hammer drilling (HD), Hollow drilling (HDB) and compressed air drilling (CD)	8 mm to 32 mm ZA-M12 to ZA-M24	1,0
C12/15 to C50/60	Hammer drilling (HD), Hollow drilling (HDB) and compressed air drilling (CD)	> 32 mm	1,5
C12/15 to C50/60	Diamond coring (DD)	8 mm to 40 mm ZA-M12 to ZA-M24	1,5

**Table C2: Reduction factor  $k_b$  for hammer drilling (HD), hollow drilling (HDB) and compressed air drilling (CD) methods**

Rebar - Ø	Concrete class								
φ	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 40 mm ZA-M12 to ZA-M24	1,0								

**Table C3: Design values of the ultimate bond stress  $f_{bd,PIR}$  in N/mm<sup>2</sup> for hammer drilling (HD), hollow drilling (HDB) and compressed air drilling (CD) methods and for good conditions**

$$f_{bd,PIR} = k_b \cdot f_{bd}$$

with

$f_{bd}$ : Design value of the ultimate bond stress in N/mm<sup>2</sup> considering the concrete classes, the rebar diameter, the drilling method according to EN 1992-1-1:2004+AC:2010.

(for all other bond conditions multiply the values by 0.7)

$k_b$ : Reduction factor according to Table C2

Rebar - Ø	Concrete class								
φ	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 32 mm ZA-M12 to ZA-M24	1,6	2,0	2,3	2,7	3,0	3,4	3,7	4,0	4,3
34 mm	1,6	2,0	2,3	2,6	2,9	3,3	3,6	3,9	4,2
36 mm	1,5	1,9	2,2	2,6	2,9	3,3	3,6	3,8	4,1
40 mm	1,5	1,8	2,1	2,5	2,8	3,1	3,4	3,7	4,0

## Fosroc Lokfix E75 for rebar connection

### Performances

Amplification factor, Reduction factor

Design values of ultimate bond resistance  $f_{bd,PIR}$

## Annex C 1

**Table C4: Reduction factor  $k_b$  for Diamond coring (DD) method**

Rebar - Ø	Concrete class								
$\phi$	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 28 mm ZA-M12 to ZA-M24	1,0								
32 to 40 mm	1,0	1,0	1,0	0,89	0,80	0,73	0,67	0,63	0,89

**Table C5: Design values of the ultimate bond stress  $f_{bd,PIR}$  in N/mm<sup>2</sup> for Diamond coring (DD) method and for good conditions**

$$f_{bd,PIR} = k_b \cdot f_{bd}$$

with

$f_{bd}$ : Design value of the ultimate bond stress in N/mm<sup>2</sup> considering the concrete classes, the rebar diameter, the drilling method according to EN 1992-1-1:2004+AC:2010.

(for all other bond conditions multiply the values by 0.7)

$k_b$ : Reduction factor according to Table C4

Rebar - Ø	Concrete class								
$\phi$	C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
8 to 28 mm ZA-M12 to ZA-M24	1,6	2,0	2,3	2,7	3,0	3,4	3,7	4,0	4,3
32 mm	1,6	2,0	2,3	2,7					
34 mm	1,6	2,0	2,3	2,6					
36 mm	1,5	1,9	2,2	2,6					
40 mm	1,5	1,8	2,1	2,5					

**Fosroc Lokfix E75 for rebar connection**

**Performances**

Reduction factor

Design values of ultimate bond resistance  $f_{bd,PIR}$

**Annex C 2**

**Design value of the ultimate bond stress  $f_{bd,fi}$  under fire exposure for concrete classes C12/15 to C50/60, (all drilling methods):**

The design value of the bond strength  $f_{bd,fi}$  under fire exposure has to be calculated by the following equation:


$$f_{bd,fi} = k_{fi}(\theta) \cdot f_{bd,PIR} \cdot \gamma_c / \gamma_{M,fi}$$

with:  $\theta \leq 270^\circ\text{C}$ :  $k_{fi}(\theta) = 9221,2 \cdot \theta^{-1,747} / (f_{bd,PIR} \cdot 4,3) \leq 1,0$   
 $\theta > 270^\circ\text{C}$ :  $k_{fi}(\theta) = 0$

- $f_{bd,fi}$  Design value of the ultimate bond stress in case of fire in N/mm<sup>2</sup>
- $\theta$  Temperature in °C in the mortar layer.
- $k_{fi}(\theta)$  Reduction factor under fire exposure.
- $f_{bd,PIR}$  Design value of the ultimate bond stress in N/mm<sup>2</sup> in cold condition according to Table C3 or C5 considering the concrete classes, the rebar diameter, the drilling method and the bond conditions according to EN 1992-1-1:2004+AC:2010.
- $\gamma_c$  partially safety factor according to EN 1992-1-1:2004+AC:2010
- $\gamma_{M,fi}$  partially safety factor according to EN 1992-1-2:2004+AC:2008

For evidence under fire exposure the anchorage length shall be calculated according to EN 1992-1-1:2004+AC:2010 Equation 8.3 using the temperature-dependent ultimate bond stress  $f_{bd,fi}$ .

**Example graph of Reduction factor  $k_{fi}(\theta)$  for concrete classes C20/25 for good bond conditions:**

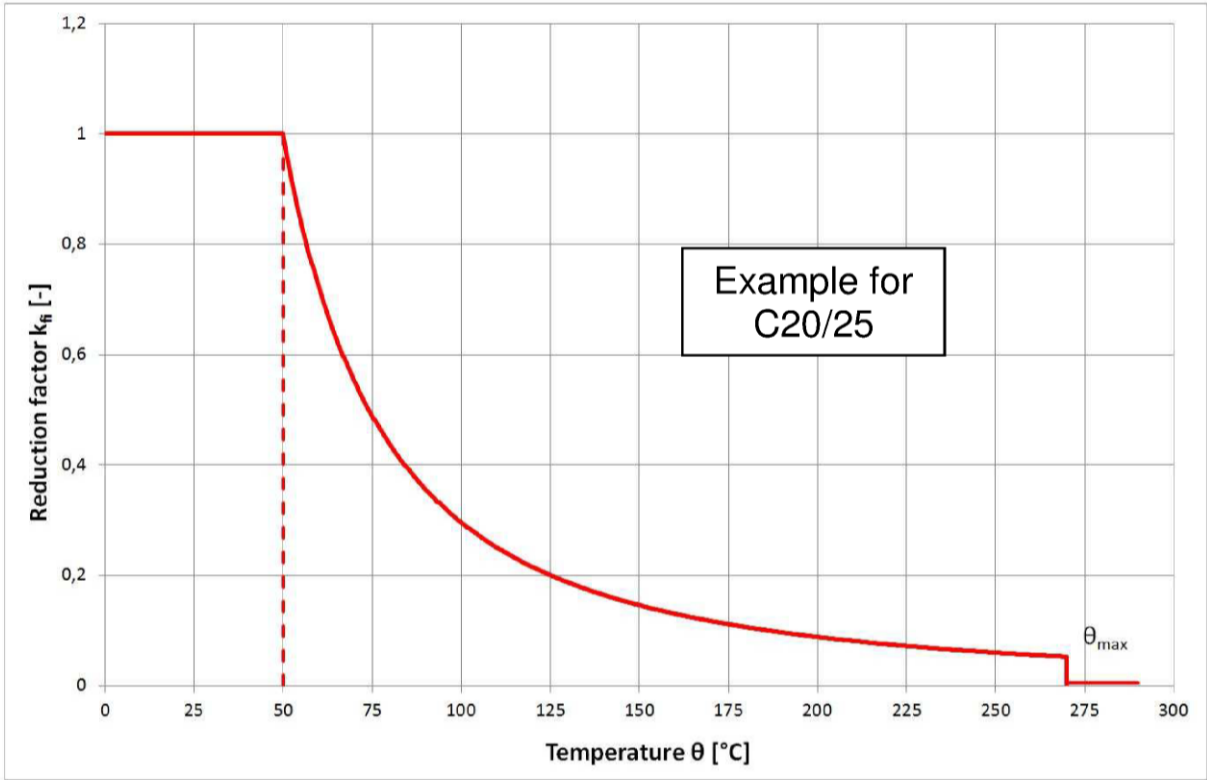

**Fosroc Lokfix E75 for rebar connection**

**Performances**  
Design value of bond strength  $f_{bd,fi}$  under fire exposure

**Annex C 3**



**Table C6: Characteristic tension strength for tension anchor ZA under fire exposure,**  
concrete classes C12/15 to C50/60, according to Technical Report TR 020

Tension Anchor				M12	M16	M20	M24
Steel, zinc plated (ZA vz)							
Characteristic steel strength	R30	$\sigma_{Rk,s,fi}$	[N/mm²]	20			
	R60			15			
	R90			13			
	R120			10			
Stainless Steel (ZA A4 or ZA HCR)							
Characteristic steel strength	R30	$\sigma_{Rk,s,fi}$	[N/mm²]	30			
	R60			25			
	R90			20			
	R120			16			

**Design value of the steel strength  $\sigma_{Rd,s,fi}$  under fire exposure**

The design value of the steel strength  $\sigma_{Rd,s,fi}$  under fire exposure has to be calculated by the following equation:

$$\sigma_{Rd,s,fi} = \sigma_{Rk,s,fi} / \gamma_{M,fi}$$

with:

$\sigma_{Rk,s,fi}$  characteristic steel strength according to Table C6  
 $\gamma_{M,fi}$  partially safety factor according to EN 1992-1-2:2004+AC:2008

**Fosroc Lokfix E75 for rebar connection**

**Performances**

Design value of the steel strength  $\sigma_{Rd,s,fi}$  for tension anchor ZA under fire exposure

**Annex C 4**