

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-10/0436
of 5 September 2019

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Capatect WDVS "A" mit
Unterputz Capatect ArmaReno 700,
Unterputz Capatect Klebe- und Armierungsmasse 133
Leicht und
Unterputz Capatect Klebe- und Armierungsmasse 186 M

Product family
to which the construction product belongs

Product area code: 4
External Thermal Insulation Composite System with
rendering on mineral wool for use on building walls

Manufacturer

CAPAROL
Farben Lacke Bautenschutz GmbH
Roßdörfer Straße 50
64372 Ober-Ramstadt
DEUTSCHLAND

Manufacturing plant

CAPAROL
Farben Lacke Bautenschutz GmbH
Roßdörfer Straße 50
64372 Ober-Ramstadt
DEUTSCHLAND

This European Technical Assessment
contains

24 pages including 4 annexes which form an integral part
of this assessment

Annex 5 Control Plan contains confidential information
and is not included in the European Technical
Assessment when that assessment is publicly available

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

ETAG 004, edition 2000, amended 2013,
used as EAD according to Article 66 Paragraph 3 of
Regulation (EU) No 305/2011.

This version replaces

ETA-10/0436 issued on 26 February 2016

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

1.1 Definition of the kit

This product is an External Thermal Insulation Composite System (ETICS) with rendering - a kit comprising components which are factory-produced by the manufacturer or component suppliers. It's made up on site from these. The ETICS manufacturer is ultimately responsible for all components of the ETICS specified in this ETA.

The ETICS kit comprises a prefabricated insulation product of mineral wool (MW) to be bonded and if it necessary additional mechanically fixed onto a wall. The methods of fixing and the relevant components are specified in the table below.

The insulation product is faced with a rendering system consisting of one base coat and finishing coat (site applied), in which the base coat contains reinforcement. The rendering is applied directly to the insulating panels, without any air gap or disconnecting layer.

The ETICS may include special fittings (e.g. base profiles, corner profiles ...) for connection to adjacent building elements (apertures, corners, parapets ...). Assessment and performance of these components is not addressed in this ETA, however the ETICS manufacturer is responsible for adequate compatibility and performance within the ETICS when the components are delivered as a part of the kit.

1.2 Composition of the ETICS

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Insulation material with associated method of fixing	Bonded ETICS:		
	• Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product	–	≤ 400
	– MW lamella		
	• Adhesives		
	– Capatect Klebe- und Armierungsmasse 186 M (cement based powder requiring addition of about 20 – 24 % of water)	3.5 to 4.5 (powder)	–
	– Capatect Klebe- und Armierungsmasse 133 Leicht (cement based powder requiring addition of about 36 – 40 % of water)	3.5 to 4.5 (powder)	–
	– Capatect Klebe- und Spachtelmasse 190 (cement based powder requiring addition of about 20 – 24 % of water)	about 4.0 (powder)	–
	– Capatect Dämmkleber 185 (cement based powder requiring addition of about 20 % of water)	4.0 to 5.0 (powder)	–
– Capatect ArmaReno 700 (cement based powder requiring addition of about 20 – 25 % of water)	4.0 to 5.0 (powder)	–	
– Capatect Klebe- und Armierungsmasse 131 SL (cement based powder requiring addition of about 40 – 43 % of water)	3.0 to 4.5 (powder)	–	

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Insulation material with associated method of fixing	<ul style="list-style-type: none"> – Capatect Klebe- und Armierungsmasse 186 M Sprinter (cement based powder requiring addition of about 22 % of water) 	3.0 to 5.0	–
	<p>Mechanically fixed ETICS with profiles and supplementary adhesive:</p> <ul style="list-style-type: none"> • Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product <ul style="list-style-type: none"> – MW panel, $\sigma_{mt} \geq 14$ kPa • Supplementary adhesive (equal to bonded ETICS) • Profiles (see annex 3 for product characteristics) <ul style="list-style-type: none"> – Capatect-Halteleiste ALU – Capatect-Verbindungsstück ALU Aluminium (Al) – profiles • Anchors for profiles (see annex 2 for product characteristics) <ul style="list-style-type: none"> – WS 8 L – ejothem SDK U – SDF-K plus – ejothem NK U • Anchors for insulation product if necessary (equal to mechanically fixed ETICS with anchors and supplementary adhesive, see below) 	–	60 to 200
	<p>Mechanically fixed ETICS with anchors and supplementary adhesive:</p> <ul style="list-style-type: none"> • Insulation product (see annex 1 for product characteristics) factory-prefabricated mineral wool (MW) product <ul style="list-style-type: none"> – MW panel – MW lamella • Supplementary adhesive (equal to bonded ETICS) • Anchors for insulation product (see annex 2 for product characteristics) all anchors with ETA according to EAD330196-01-0604¹ 	– –	60 to 340 60 to 200
Base coat	<p>Capatect ArmaReno 700</p> <p>Capatect Klebe- und Armierungsmasse 133 Leicht</p>	6.0 to 10.5 (powder) 5.5 to 11.0 (powder)	4.0 to 7.0 5.0 to 10.0

¹

EAD330196-01-0604

Plastic anchors for fixing of external thermal insulation composite systems with rendering

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Base coat	Capatect Klebe- und Armierungsmasse 186 M Identical with the equally named adhesives given above.	4.0 to 5.0	3.0 to 4.0
Glass fibre mesh	Capatect Gewebe 650 Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 160 g/m ² and mesh size of about 4.0 mm x 4.0 mm. (see annex 4 for product characteristics)	–	–
	Capatect Gewebe 666 Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 160 g/m ² and mesh size of about 6.0 mm x 6.0 mm. (see annex 4 for product characteristics)	–	–
	Capatect Panzergewebe 652 (implemented in addition to the standard mesh to improve the impact resistance) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 330 g/m ² and mesh size of about 6.0 mm x 6.0 mm. (see annex 4 for product characteristics)	–	–
Key coat	Ready to use pigmented liquid - styrol acrylate binder Putzgrund 610 For the compatibility with the finishing coats see below.	about 0.20 l/m ²	–
Finishing coat	All finishing coats to use with key coat "Putzgrund 610" if applicable**: <u>Applicable with all base coats</u> <ul style="list-style-type: none"> Cement based powder requiring addition of about 28 – 44 % of water: Capatect Mineral-Leichtputz R* (particle size 2.0 to 3.0 mm) Capatect Mineral-Leichtputz K* (particle size 2.0 to 3.0 mm) Cement based powder requiring addition of about 20 – 24 % of water: Capatect Mineralputz R* (particle size 2.0 to 3.0 mm) Capatect Mineralputz K* (particle size 2.0 to 3.0 mm) Capatect Feinspachtel 195 	2.3 to 4.5 2.3 to 4.5 about 3.0 about 3.0 4.0 to 6.0	regulated by particle size 2.0 to 3.0
	<u>Only applicable with base coats "Capatect Klebe- und Armierungsmasse 133 Leicht" and "Capatect Klebe- und Armierungsmasse 186 M"</u> <ul style="list-style-type: none"> Cement based powder requiring addition of about 40 % of water: Capatect Modellier- und Spachtelputz 134 	about 4.0	

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Finishing coat	<p>Only applicable with base coats "Capatect Klebe- und Armierungsmasse 133 Leicht"</p> <ul style="list-style-type: none"> Cement based powder requiring addition of about 40 % of water <p>Capatect-Edelkratzputz</p>	13.0 to 16.0	6.0 to 12.0
	<p>Only applicable with base coat "Capatect Klebe- und Armierungsmasse 186 M"</p> <ul style="list-style-type: none"> Ready to use pastes – acrylate binder: <ul style="list-style-type: none"> Capatect Fassadenputz R* (particle size 1.5 to 3 mm) Capatect Fassadenputz K* (particle size 1.5 to 3 mm) Ready to use pastes – acrylate/silicone resin emulsion: <ul style="list-style-type: none"> Capatect AmphiSilan Fassadenputz NQG R* (particle size 2.0 to 3.0 mm) Capatect AmphiSilan Fassadenputz NQG K* (particle size 1.5 to 3.0 mm) Ready to use paste – vinyl acetate ethylene binder: <ul style="list-style-type: none"> Capatect Fassadenputz Fein Ready to use pastes – silicate/styrol acrylate binder: <ul style="list-style-type: none"> Capatect Sylitol-Fassadenputz R* (particle size 2.0 to 3.0 mm) Capatect Sylitol-Fassadenputz K* (particle size 1.5 to 3.0 mm) Ready to use pastes – silicate/ organic hybrid dispersion: <ul style="list-style-type: none"> Capatect ThermoSan Fassadenputz NQG R* (particle size 1.5 to 3.0 mm) Capatect ThermoSan Fassadenputz NQG K* (particle size 1.0 to 4.0 mm) Ready to use pastes – polymer dispersion binder: <ul style="list-style-type: none"> Capatect Putz 622 W SilaCryl (particle size 1.5 mm) Ready to use pastes – styrol acrylate/ vinylic binder: <ul style="list-style-type: none"> Capatect AmphiSilan-Fassadenputz NQG Fein (particle size 1.0 mm) Ready to use pastes – styrol acrylate/ vinylic binder: <ul style="list-style-type: none"> Capatect AmphiSilan-Fassadenputz K10 (particle size 1.0 mm) 	2.8 to 3.6 2.7 to 4.3 2.5 to 3.5 2.5 to 4.1 3.0 to 6.0 2.5 to 4.0 2.5 to 4.0 1.8 to 2.6 1.3 to 3.2 2.5 to 3.5 1.4 to 2.0 1.4 to 2.0	regulated by particle size regulated by particle size 2.0 bis 4.0 regulated by particle size 1.5 to 3.0 1.0 to 4.0 1.3 to 1.7 1.0 to 1.5 1.0 to 1.5

	Components National application documents shall be taken into account	Coverage [kg/m ²]	Thickness [mm]
Finishing coat	<ul style="list-style-type: none"> Ready to use pastes – styrol acrylate binder – associated with synthetic briquettes: Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080 	4.0 to 5.0 3.0 to 4.0	6.0 1.0 to 4.0
Ancillary material	Remains the manufacturer's responsibility.		
* K / R indicates different structures of the finishing coats.			
** The instruction to the installer concerning the use of a key coat remains the responsibility of the ETA-holder.			

2 Specification of the intended use in accordance with the applicable European assessment Document (hereinafter EAD)

2.1 Intended use

This ETICS is intended to be used as external insulation to the walls of buildings made of masonry (bricks, blocks, stones ...) or concrete (cast on site or as prefabricated panels) with and without rendering. The characteristics of the walls shall be verified prior to use of the ETICS, especially regarding conditions for reaction to fire classification and for fixing of the ETICS either by bonding or mechanically. It shall be designed to give the wall to which it is applied satisfactory thermal insulation.

The ETICS is non load-bearing construction element. It does not contribute directly to the stability of the wall on which it is installed, but it can contribute to durability by providing enhanced protection from the effects of weathering.

The ETICS can be used on new or existing (retrofit) vertical walls.

The ETICS is not intended to ensure the air tightness of the building structure.

The choice of the method of fixing depends on the characteristics of the substrate, which could need preparation (see clause 7.2.1 of ETAG 004) and on the national instructions.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the ETICS "Capatect WDVS "A" mit Unterputz Capatect ArmaReno 700, Unterputz Capatect Klebe- und Armierungsmasse 133 Leicht und Unterputz Capatect Klebe- und Armierungsmasse 186 M" of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right products in relation to the assumed economically reasonable working life of the works.

2.2 Manufacturing

The ETA is issued for the ETICS on the basis of agreed data/information, deposited with the DIBt, which identifies the ETICS that has been assessed and judged. Changes to the ETICS or the components or their production process, which could result in this deposited data/information being incorrect, should be notified to the DIBt before the changes are introduced. DIBt will decide whether or not such changes affect the approval and consequently the validity of the CE-marking on the basis of the approval and if so whether further assessment or alterations to the approval shall be necessary.

2.3 Design and installation

The installation instructions including special installation techniques and provisions for the qualification of the personnel are given in the manufacturer's technical documentation.

Design, installation and execution of ETICS are to be in conformity with national documents. Such documents and the level of their implementation in Member States' legislation are different. Therefore, the assessment and declaration of performance are done taking into account general assumptions introduced in the chapters 7.1 and 7.2 of ETAG 004 used as EAD, which summarize how information introduced in the ETA and related documents is intended to be used in the construction process and gives advice to all parties interested when normative documents are missing.

2.4 Packing, transport and storage

The information on packaging, transport and storage is given in the manufacturer's technical documentation. It is the responsibility of the manufacturer to ensure that this information is made known to the concerned people.

2.5 Use, maintenance, repair

The finishing coat shall normally be maintained in order to fully preserve the ETICS performance. Maintenance includes at least:

- visual inspection of the ETICS,
- the repairing of localised damaged areas due to accidents,
- the aspect maintenance with products adapted and compatible with the ETICS (possibly after washing or ad hoc preparation).

Only products which are compatible with the ETICS shall be used.

Necessary repairs should be performed as soon as the need has been identified.

The information on use, maintenance and repair is given in the manufacturer's technical documentation.

It is the responsibility of the manufacturer to ensure that this information is made know to the concerned people.

3 Performance of the product and references to the methods used for its assessment

3.0 General

The performances of the kit as described in this chapter are valid provided that the components of the kit comply with annexes 1 to 4.

3.1 Mechanical resistance and stability (BWR 1)

Not relevant

3.2 Safety in case of fire (BWR 2)

Reaction to fire (ETAG 004 - clause 5.1.2)

Configurations	Organic content	Flame retardant content	Euroclass according to EN 13501-1
Base coats "Capatect ArmaReno 700" and "Capatect Klebe- und Armierungsmasse 133 Leicht"	max. 3.9 %	no flame retardant	A2 - s1,d0
Mineral wool- insulation product	In quantity ensuring Euroclass A1 according to EN 13501-1	no flame retardant	
profiles	-	-	

Configurations	Organic content	Flame retardant content	Euroclass according to EN 13501-1
anchors	-	-	A2 - s1,d0
rendering system: Base coat with finishing coat indicated in clause 1.2:			
Capatect Mineral-Leichtputz R Capatect Mineral-Leichtputz K Capatect Mineralputz R Capatect Mineralputz K Capatect Feinspachtel 195 Capatect Modellier- und Spachtelputz 134 Capatect Edelkratzputz	max 3.7 %	no flame retardant	

Configuraions	Organic content	Flame retardant content	Euroclass according to EN 13501-1
Base coat "Capatect Klebe- und Armierungsmasse 186 M"	max. 2.3 %	no flame retardant	A2 – s1,d0
Mineral wool- insulation product	In quantity ensuring Euroclass A1 according to EN 13501-1	no flame retardant	
profiles	-	-	
anchors	-	-	
Rendering system Base coat with finishing coat and compatible key coat in clause 1.2:			
Capatect Fassadenputz R/K Capatect AmphiSilan Fassadenputz NQG R Capatect Fassadenputz Fein	max. 8.9 %	no flame retardant	
Capatect AmphiSilan Fassadenputz NQG K	max. 8,4 %	min. 3,0 %	
Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080	max. 9.2 % max. 9.9 %	min. 9.0 % no flame retardant	
Capatect Putz 622 W SilaCryl Capatect AmphiSilan Fassadenputz NQG Fein Capatect AmphiSilan Fassadenputz K10	max. 8.7 %	no flame retardant	
Capatect Sylitol Fassadenputz K/R	max. 6.2 %		
Capatect ThermoSan Fassadenputz NQG R/K	max. 8.9 %		

Configuraions	Organic content	Flame retardant content	Euroclass according to EN 13501-1
Capatect Mineral-Leichtputz R/K Capatect Mineralputz R/K Capatect Feinspachtel 195 Capatect Modellier- und Spachtelputz 134	max. 3.7 %	no flame retardant	A2 – s1,d0

3.3 Hygiene, health and environment (BWR 3)

3.3.1 Water absorption (capillarity test) (ETAG 004 – clause 5.1.3.1)

Base coat	Water absorption after 1 h < 1,0 kg/m ²	Water absorption after 24 h < 0,5 kg/m ²
Capatect ArmaReno 700	x	x
Capatect Klebe- und Armierungsmasse 133 Leicht	x	x
Capatect Klebe- und Armierungsmasse 186 M	x	x

Rendering system:

		Water absorption after 24 hours	
		< 0.5 kg/m ²	≥ 0.5 kg/m ²
Rendering system: Base coats "Capatect ArmaReno 700" and "Capatect Klebe- und Armierungsmasse 133 Leicht" with finishing coats indicated in clause 1.2:	Capatect Mineral-Leichtputz R	x	
	Capatect Mineral-Leichtputz K	x	
	Capatect Mineralputz R	x	
	Capatect Mineralputz K	x	
	Capatect Feinspachtel 195	x	
	Capatect Modellier- und Spachtelputz 134	x	
	Capatect Edelkratzputz	x	
Rendering system: Base coat "Capatect Klebe- und Armierungsmasse 186 M" with finishing coat indicated in clause 1.2:	Capatect Fassadenputz R/K	x	
	Capatect AmphiSilan Fassadenputz NQG R/K	x	
	Capatect Fassadenputz Fein		x
	Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080	x	
	Capatect Putz 622 W SilaCryl	x	
	Capatect AmphiSilan Fassadenputz NQG Fein	x	
	Capatect AmphiSilan Fassadenputz K10	x	
	Capatect Syllitol-Fassadenputz K/R		x
	Capatect ThermoSan Fassadenputz NQG R/K	x	
	Capatect Mineral-Leichtputz R/K	x	
	Capatect Mineralputz R/K	x	
	Capatect Feinspachtel 195	x	
	Capatect Modellier- und Spachtelputz 134	x	

English translation prepared by DIBt

3.3.2 Hygrothermal behaviour (ETAG 004 - clause 5.1.3.2)

Pass (without defects)

Freeze/thaw behaviour

The ETICS with base coat "Capatect Klebe- und Armierungsmasse 186 M" and finishing coats "Capatect Fassadenputz Fein" and "Capatect Sylitol-Fassadenputz K/R" has been assessed as freeze/thaw resistant according to the simulated method.

3.3.3 Impact resistance (ETAG 004 - clause 5.1.3.3)

Rendering system: Base coat with finishing coat indicated hereafter:	Single standard mesh "Capatect Gewebe 650"		
	Capatect ArmaReno 700 (t = 3 mm)	Capatect Klebe- und Armierungs- masse 133 Leicht (t < 10 mm)	Capatect Klebe- und Armierungsmasse 133 Leicht (t = 10 mm)
Capatect Mineral-Leichtputz R	Category II	Category III	Category II
Capatect Mineral-Leichtputz K			
Capatect Mineralputz R			
Capatect Mineralputz K			
Capatect Feinspachtel 195			
Capatect Modellier- und Spachtelputz 134	not applicable in compliance with clause 1.2		
Capatect-Edelkratzputz		Category I	Category I

Rendering system: Base coat "Capatect-Klebe- und Armierungsmasse 186 M" with finishing coat indicated hereafter:	Single mesh "Capatect Gewebe 650"	Single mesh "Capatect Gewebe 650" with "Capatect Panzergewebe 652"
Capatect Fassadenputz R/K	Category III	Category I
Capatect AmphiSilan Fassadenputz NQG R/K	Category II	Category II
Capatect Fassadenputz Fein	Category III	Category III
Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080	Category I	Category I
Capatect Putz 622 W SilaCryl	Category III	Category II
Capatect AmphiSilan Fassadenputz NQG Fein		Category III
Capatect AmphiSilan Fassadenputz K10		Category III
Capatect Sylitol Fassadenputz K/R	Category II	Category II
Capatect ThermoSan Fassadenputz NQG R/K	Category II	Category I
Capatect Mineral-Leichtputz R/K	Category II	no performance assessed

Rendering system: Base coat "Capatect-Klebe- und Armierungsmasse 186 M" with finishing coat indicated hereafter:	Single mesh "Capatect Gewebe 650"	Single mesh "Capatect Gewebe 650" with "Capatect Panzergewebe 652"
Capatect Mineralputz R/K	Category II	no performance assessed
Capatect Feinspachtel 195		
Capatect Modellier- und Spachtelputz 134		

The impact resistance for all combination of base coat and finishing coat with the meshes "Capatect Gewebe 650" and "Capatect Panzergewebe 652" were not assessed.

The impact resistance for ETICS with mesh "Capatect Gewebe 666" were not assessed.

3.3.4 Water vapour permeability (ETAG 004 - clause 5.1.3.4)

Rendering system: Base coat with finishing coat indicated hereafter:	Equivalent air thickness s_d	
	Capatect ArmaReno 700	Capatect Klebe- und Armierungsmasse 133 Leicht
Capatect Mineral-Leichtputz R	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)
Capatect Mineral-Leichtputz K	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)
Capatect Mineralputz R	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.2 m)
Capatect Mineralputz K	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.1 m)	≤ 1.0 m (Test result obtained with a layer thickness 3 mm: 0.2 m)
Capatect Feinspachtel 195	≤ 1.0 m (Test result obtained with a layer thickness 4 mm: 0.1 m)	≤ 1.0 m (Test result obtained with a layer thickness 4 mm: 0.2 m)
Capatect Modellier- und Spachtelputz 134	not applicable in compliance with clause 1.2	≤ 1.0 m (Test result obtained with a layer thickness 4 mm: 0.1 m)
Capatect Edelkratzputz	not applicable in compliance with clause 1.2	≤ 1.0 m (Test result obtained with a layer thickness 10 mm: 0.2 m)

Rendering system: Base coat "Capatect Klebe- und Armierungsmasse 186 M" with finishing coat indicated hereafter:	Equivalent air thickness s_d
Capatect Fassadenputz R/K	≤ 1.0 m (Test result obtained with layer thickness of 3 mm: 0.82 m)
Capatect AmphiSilan Fassadenputz NQG R/K	≤ 1.0 m (Test result obtained with layer thickness of 3 mm: 0.93 m)
Capatect Fassadenputz Fein	≤ 1.0 m (Test result obtained with a layer thickness of 4 mm: 0.95 m)
Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080	≤ 1.0 m (Test result obtained with a layer thickness of 6-8 mm: 0.93m)
Capatect Putz 622 W SilaCryl	≤ 1.0 m (Test result obtained with layer thickness of 1.5 mm: 0.95 m)
Capatect AmphiSilan Fassadenputz NQG Fein	≤ 1.0 m (Test result obtained with layer thickness of 1 mm: 0.95 m)
Capatect AmphiSilan Fassadenputz K10	≤ 1.0 m (Test result obtained with layer thickness of 1 mm: 0.95 m)
Capatect Sylitol Fassadenputz K/R	≤ 1.0 m (Test result obtained with layer thickness of 3 mm: 0.64 m)
Capatect ThermoSan Fassadenputz NQG R/K	≤ 1.0 m (Test result obtained with layer thickness of 4 mm: 0.62 m)
Capatect Mineral-Leichtputz R/K	≤ 1.0 m (Test result obtained with layer thickness of 3 mm: 0.10 m)
Capatect Mineralputz R/K	≤ 1.0 m (Test result obtained with layer thickness of 3 mm: 0.06 m)
Capatect Feinspachtel 195	≤ 1.0 m (Test result obtained with a layer thickness of 4 mm: 0.10 m)
Capatect Modellier- und Spachtelputz 134	≤ 1.0 m (Test result obtained with a layer thickness of 4 mm: 0.10 m)

3.3.5 Release of dangerous substances (ETAG 004 - clause 5.1.3.5, EOTA TR 034)

Essential characteristic	Performance
Release of dangerous substances	no performance assessed

3.4 Safety and accessibility in use (BWR 4)

3.4.1 Bond strength between base coat and insulation product (MW lamella) (ETAG 004 - clause 5.1.4.1.1)

Base coat	Conditioning		
	Initial state	After hygrothermal cycles	After freeze/thaw test
Capatect ArmaReno 700	≥ 0.08 MPa	≥ 0.08 MPa	Test not required because freeze/thaw cycles not necessary
Capatect Klebe- und Armierungsmasse 133 Leicht	≥ 0.08 MPa	≥ 0.08 MPa	

Base coat	Conditioning		
	Initial state	After hygrothermal cycles	After freeze/thaw test
Capatect Klebe- und Armierungsmasse 186 M	≥ 0.08 MPa	< 0.08 MPa but failure in the insulation product	Test not required because freeze/thaw cycles not necessary

3.4.2 Bond strength between adhesive and substrate/insulation product (MW lamella) (ETAG 004 - clause 5.1.4.1.2 and 5.4.1.3)

Adhesive	Substrate resp. insulation product	Conditioning		
		Initial state	2 d immersion in water + 2 h drying	2 d immersion in water + 7 d drying
Capatect Klebe- und Armierungsmasse 186 M	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW lamella	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
Capatect Klebe- und Armierungsmasse 133 Leicht	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW lamella	≥ 0.08 MPa	≥ 0.03 MPa	< 0.08 MPa but failure in the insulation product
Capatect Klebe- und Spachtelmasse 190	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW lamella	≥ 0.08 MPa	≥ 0.03 MPa	< 0.08 MPa but failure in the insulation product
Capatect Dämmkleber 185	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW lamella	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa
Capatect ArmaReno 700	Concrete	≥ 0.25 MPa	≥ 0.08 MPa	≥ 0.25 MPa
	MW lamella	≥ 0.08 MPa	≥ 0.03 MPa	≥ 0.08 MPa

Bonded surface:

With a bonded surface of 50 % the formula given in clause 6.1.4.1.3 of ETAG 004 is fulfilled and the use as bonded ETICS is possible.

English translation prepared by DIBt

3.4.3 Bond strength after ageing (ETAG 004 – clause 5.1.7.1)

Rendering system: Base coat with finishing coat indicated in clause 1.2	Capatect Mineral-Leichtputz R	≥ 0.08 MPa
	Capatect Mineral- Leichtputz K	
	Capatect Mineralputz R	
	Capatect Mineralputz K	
	Capatect Feinspachtel 195	
	Capatect Modellier- und Spachtelputz 134	
	Capatect Edelkratzputz	
	Capatect Fassadenputz R/K	
	Capatect AmphiSilan Fassadenputz NQG R/K	
	Capatect Fassadenputz M Fein	
	Meldorfer Flachverblender mit Meldorfer Ansatzmörtel 080	
	Capatect Putz 622 W SilaCryl	
	Capatect AmphiSilan-Fassadenputz NQG Fein	
	Capatect AmphiSilan-Fassadenputz K10	
Capatect Sylitol-Fassadenputz K/R		
Capatect ThermoSan Fassadenputz NQG R/K		

3.4.4 Fixing strength (displacement test) (ETAG 004 - clause 5.1.4.2)

Test not required therefore no limitation of ETICS length required.

3.4.5 Wind load resistance (ETAG 004 - clause 5.1.4.3)

The following failure loads only apply to the listed combination of the properties of components and the characteristics of the insulation product given in annex 1.

3.4.5.1 Safety in use of mechanically fixed ETICS using profiles

Failure loads – Table 1

Characteristics of the MW panels	Dimensions	625 mm x 800 mm	
	Thickness	≥ 60 mm	
	Tensile strength perpendicular to the faces	≥ 14 kPa	
Failure loads [N/panel] (Static Foam Block Test)	Horizontal profiles with a vertical distance of 625 mm, fixed every 30 cm and vertical connection profiles No additional anchors in MW panel	Minimal	1200
		Average:	1250

Failure loads – Table 2

Characteristics of the MW panels	Dimensions	625 mm x 800 mm
	Thickness	≥ 60 mm
	Tensile strength perpendicular to the faces	≥ 14 kPa
Failure loads [N/panel] (Static Foam Block Test)	Horizontal profiles with a vertical distance of 625 mm, fixed every 30 cm and vertical connection profiles Two additional anchors per MW panel, plate diameter ≥ 60 mm, mounted on the MW panel surface	Minimal: 2200 Average: 2400

3.4.5.2 Safety in use of mechanically fixed ETICS using anchors

Failure loads – Table 3

Apply to all anchors listed in the clause 1.2 mounted on the insulation panels surface				
Characteristics of the MW panels	Thickness		≥ 60 mm	
	Tensile strength perpendicular to the faces		≥ 14 kPa	
Plate diameter of anchor			≥ Ø 60 mm	
Failure loads [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R_{panel}	Minimal: 650 Average: 740	
	Anchors placed at the panel joints (Static Foam Block Test)	R_{joint}	Minimal: 590 Average: 610	
	Anchors not placed at the panel joints (Pull-through test, dry conditions)	R_{panel}	Minimal: 640 Average: 690	
	Anchors not placed at the panel joints (Pull-through test, wet conditions) - series 2* - series 3*	R_{panel}	Minimal: 360 Average: 390 Minimal: 410 Average: 450	
* according to ETAG 004 (edition 2000) clause 5.2.4.1.2 test method (2)				

Failure loads – Table 4

apply to all anchors listed in the clause 1.2 mounted on the insulation panels surface				
Characteristics of the MW panels	Thickness		≥ 80 mm	
	Tensile strength perpendicular to the faces		≥ 5 kPa	
Plate diameter of anchor			≥ Ø 90 mm	≥ Ø 140 mm
Failure loads [N]	Anchors not placed at the panel joints (Static Foam Block Test)	R_{panel}	Minimal: 480 Average: 490	Minimal: 560 Average: 690
	Anchors placed at the panel joints (Static Foam Block Test)	R_{joint}	Minimal: 380 Average: 390	Minimal: 440 Average: 540
	Anchors not placed at the panel joints (Pull-through test, dry conditions)	R_{panel}	Minimal: 540 Average: 610	npd
	Anchors not placed at the panel joints (Pull-through test, wet conditions) - series 2*	R_{panel}	Minimal: 400 Average: 460	npd
* according to ETAG 004 (edition 2000) clause 5.2.4.1.2 test method (2)				

Failure loads – Table 5

apply to all anchors listed in clause 1.2 mounted on the insulation panels surface			
Characteristics of the MW lamella	Thickness		≥ 60 mm
	Tensile strength perpendicular to the faces		≥ 80 kPa
Plate diameter of anchor			≥ Ø 140 mm
Failure loads [N]	Anchors placed at the panel joints (Pull-through test, dry condition)	R_{joint}	Minimal: 620 Average: 660
	Anchors placed at the panel joints (Pull-through test, wet condition)	R_{joint}	Minimal: 510 Average: 570
	Anchors placed at the panel joints (Static Foam Block Test)	R_{joint}	Minimal: 710

The failure loads of Table 2 and 3 specified above only apply to the following anchors with deep mounting under the given conditions of installation:

Anchor	Thickness of the MW panel [d]	Conditions of installation*
ejothem STR U ejothem STR U 2G (ETA-04/0023) STR Carbon (ETA-13/0009)	100 mm > d ≥ 80 mm	<ul style="list-style-type: none"> – Maximum installation depth of the anchor plate: 15 mm (≙ thickness of insulation cover) – Maximum depth of die: 5 mm
	≥ 100 mm	<ul style="list-style-type: none"> – Maximum installation depth of the anchor plate: 15 mm (≙ thickness of insulation cover) – Maximum depth of die: 20 mm
TERMOZ 8 SV (ETA-06/0180)	≥ 80 mm	<ul style="list-style-type: none"> – Maximum installation depth of the anchor plate: 15 mm (≙ thickness of insulation cover)

* according to the appropriate ETA of anchor

3.4.6 Render strip tensile test (ETAG 004 - clause 5.5.4.1)

The average value of crack width of the base coats reinforced with the different glass fibre meshes measured at a render strain value of 1 % is:

Base coat	Glass fibre mesh	Average value of crack width $w_{m(1\%)}$
Capatect Klebe- und Armierungsmasse 186 M	Capatect Gewebe 650	0,06 mm
Capatect ArmaReno 700	Capatect Gewebe 650	0,06 mm
Capatect Klebe- und Armierungsmasse 133 Leicht	Capatect Gewebe 650	0,08 mm
Capatect Klebe- und Armierungsmasse 133 Leicht	Capatect Gewebe 666	0,09 mm

For all other base coat- mesh combinations no performance was assessed for the render trip tensile test.

English translation prepared by DIBt

3.5 Protection against noise (BWR 5)

For the protection against noise no performance was assessed for this product.

3.6 Energy economy and heat retention (BWR 6)

3.6.1 Thermal resistance

The nominal value of the additional thermal resistance R provided by the ETICS to the substrate wall is calculated in accordance with EN ISO 6946:2007 from the nominal value of the insulation product's thermal resistance R_D given accompanied to the CE marking and from the thermal resistance of the rendering system R_{render} which is about $0.02 \text{ (m}^2 \cdot \text{K)/W}$.

$$R = R_D + R_{render}$$

The thermal bridges caused by mechanical fixing devices (anchors profiles) increase the thermal transmittance U . This influence had to take into account according to EN ISO 6946:2007.

$$U_c = U + \Delta U$$

corrected thermal transmittance [$\text{W}/(\text{m}^2 \cdot \text{K})$]

$$\Delta U = \Delta U_{anchor} + \Delta U_{profile}$$

correction term for mechanical fixing devices (anchors, profiles)

$$\Delta U_{anchor} = \chi_p \cdot n$$

correction term for anchors

where: n

number of anchors per m^2

$$\chi_p$$

local influence of thermal bridge caused by an anchor. The values listed below can be taken into account, if not specified in the anchor's technical approval

$$\chi_p = 0.004 \text{ W/K}$$

for anchors with a galvanized steel screw with the head covered by a plastic material

$$\chi_p = 0.002 \text{ W/K}$$

for anchors with a stainless steel screw with the head covered by plastic material, and for anchors with an air gap at the head of the screw

$$\Delta U_{profile}$$

correction term for profiles; subject to the thickness of the insulation product and the thermal resistance of the substrate wall the following values apply :

Thermal resistance of the substrate wall [$\text{m}^2 \cdot \text{K}/\text{W}$]	Thickness of the insulation product [mm]	$\Delta U_{profile}$ [$\text{W}/(\text{m}^2 \cdot \text{K})$]
$R < 0.33$	$60 \leq d < 80$	0.03
	$80 \leq d < 120$	0.02
	$d \geq 120$	0
$0.33 \leq R \leq 1.10$	$60 \leq d < 80$	0.02
	$80 \leq d \leq 100$	0.01
	$d > 100$	0
$R > 1.10$	$d \geq 60$	0

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to the European Commission decision 97/556/EC amended by the European Commission decision 2001/596/EC, the assessment and verification of constancy of performance system (AVCP) applies suitable following table (see Annex V to Regulation (EU) No 305/2011).

Product	Intended use	Levels or classes (Reaction to fire)	Systems
Capatect WDVS "A" mit Unterputz Capatect ArmaReno 700, Unterputz	ETICS in external wall subject to fire regulations	A1 ⁽¹⁾ , A2 ⁽¹⁾ , B ⁽¹⁾ , C ⁽¹⁾	1
		A1 ⁽²⁾ , A2 ⁽²⁾ , B ⁽²⁾ , C ⁽²⁾ , D, E, (A1 to E) ⁽³⁾ , F	2+
Capatect-Klebe- und Armierungsmasse 133 Leicht" und Capatect Klebe- und Armierungsmasse 186M	ETICS in external wall not subject to fire regulations	any	2+
⁽¹⁾ Products/materials for which a clearly identifiable stage in the production process results in an improvement of the reaction to fire classification (e. g. an addition of fire retardants or a limiting of organic material) ⁽²⁾ Products/materials not covered by footnote (1) ⁽³⁾ Products/materials that do not require to be tested for reaction to fire (e.g. products/materials of Classes A1 according to Commission Decision 96/603/EC)			

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 5 September by Deutsches Institut für Bautechnik

Dirk Brandenburger
Head of Department

beglaubigt:
Windhorst

Annexes:

- Annex 1: Insulation product characteristics
- Annex 2: Anchors
- Annex 3: Profiles
- Annex 4: Reinforcement

Annex 1: Thermal insulation product characteristic

Factory-prefabricated panels and lamella made of mineral wool (MW) to EN 13162:2015 with the following designation code and the other properties having the description in the Table below shall be used, provided that the manufacturer and the trade name of the MW are deposited with the DIBt.

MW – EN 13162 – T5 – DS(T+) – WS – WL(P) – MU1

Description and characteristics	MW panel ^{***}	MW panel	MW lamella
Reaction to fire; EN 13501-1:2007	Class A1		
Gross heat of combustion [MJ/kg]; EN ISO 1716:2010	PCS ≤ 1.4		
Thermal resistance [(m ² · K)/W]	Defined in the CE marking in reference to EN 13162:2015		
Tensile strength perpendicular to the faces [kPa]; EN 1607:2013 - in dry conditions [*]	$\sigma_{mt} \geq 14$	$\sigma_{mt} \geq 5$	$\sigma_{mt} \geq 80$
- in wet conditions ^{**} Average value - series 2 - series 3	≥ 33 % of average value in dry conditions ≥ 50 % of average value in dry conditions		
Compressive strength [*] [kPa]; EN 826:2013	$\sigma_m \geq 40$	$\sigma_m \geq 4$	$\sigma_m \geq 40$
Apparent density [kg/m ³]; EN 1602:2013	$120 \leq \rho_a \leq 150$	$100 \leq \rho_a \leq 150$	$80 \leq \rho_a \leq 150$
Shear strength [*] [kPa]; EN 12090:2013	$20 \leq f_{tk} \leq 100$	$6 \leq f_{tk} \leq 100$	$20 \leq f_{tk} \leq 100$
Shear modulus [MPa]; EN 12090:2013	$1.0 \leq G_m \leq 2.0$	$0.3 \leq G_m \leq 2.0$	$1.0 \leq G_m \leq 2.0$
[*] Minimal value of all single values ^{**} according to ETAG 004 (edition 2000), clause 5.2.4.1.2 test method (2) ^{***} Thermal insulation materials for mechanically fixed ETICS with profiles must circumferentially at the edges, 24 mm from the inner surface, get an approx. 3 mm wide and 13 to 18 mm deep groove cut-in at the factory.			

Annex 2: Anchors

All anchors with ETA according to EAD330196-01-0604¹ with characteristics having the description below shall be used in the mechanically fixed ETICS:

- plate diameter of anchor ≥ 60 mm resp. ≥ 90 mm or ≥ 140 mm
- plate stiffness ≥ 0.3 kN/mm
- load resistance of the anchor plate ≥ 1.0 kN

These characteristics and the characteristic tension resistance of the anchors shall be taken from the corresponding ETA.

The anchors listed in the Table in clause 1.2 with reference to the respective ETA shall be used in the mechanically fixed ETICS with profiles for fixing the horizontal profiles.


Trade name	ETA-number
WS 8 L	ETA-02/0019
ejothem SDK U	ETA-04/0023
SDF-K plus	ETA-04/0064
ejothem NK U	ETA-05/0009

Annex 3: Profile

Aluminium (Al) profiles, EN AW-6060 T66 to EN 755-2: are to be used in the mechanically fixed ETICS with profiles.


The Pull-through resistance of fixings from profiles is ≥ 500 N.

Horizontal profile – "Capatect - Halteleiste ALU"

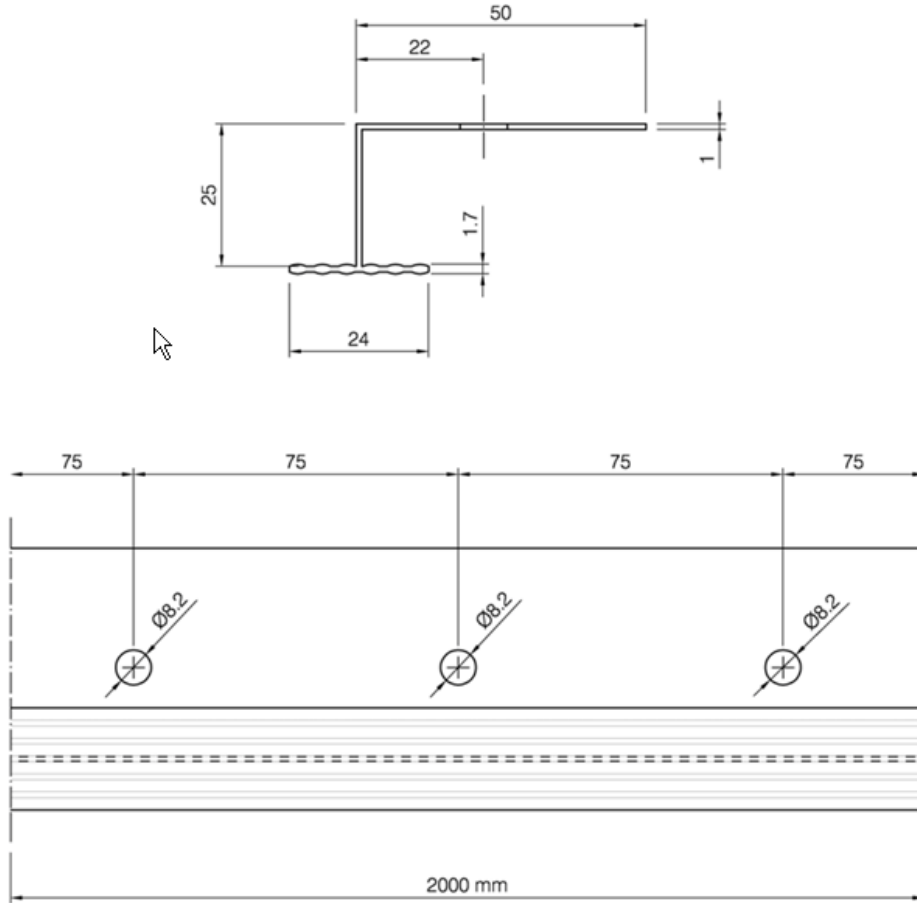

Vertical connection profile – "Capatect – Verbindungsleiste ALU"

Length: 470 mm

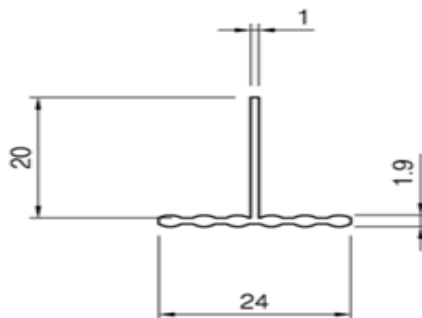

Annex 4: Reinforcement (glass fibre mesh)

Characteristics (alkali resistance): pass

	Description	Residual strength after ageing [N/mm]	Relative residual strength after ageing, of the strength in the as delivered state [%]
"Capatect Gewebe 650"	alkali- and slide-resistant glass fibre mesh with mass per unit area of about 160 g/m ² and mesh size of about 4.0 mm x 4.0 mm.	≥ 20	≥ 50
"Capatect Gewebe 666"	alkali- and slide-resistant glass fibre mesh with mass per unit area of about 160 g/m ² and mesh size of about 6.0 mm x 6.0 mm.	≥ 20	≥ 50
"Capatect Panzergewebe 652"	(implemented in addition to the standard mesh to improve the impact resistance) Alkali- and slide-resistant glass fibre mesh with mass per unit area of about 330 g/m ² and mesh size of about 6.0 mm x 6.0 mm.	no performance assessed	no performance assessed