

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-12/0554
of 18 October 2019

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer Injection system FIS HT II for masonry

Product family
to which the construction product belongs

Metal Injection anchors for use in masonry

Manufacturer

fischerwerke GmbH & Co. KG
Klaus-Fischer-Straße 1
72178 Waldachtal
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment
contains

58 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330076-00-0604

This version replaces

ETA-12/0554 issued on 11 September 2018

European Technical Assessment

ETA-12/0554

English translation prepared by DIBt

Page 2 of 58 | 18 October 2019

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part**1 Technical description of the product**

The fischer Injection system FIS HT II for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar FIS HT II, FIS HT II High Speed or FIS HT II Low Speed, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment**3.1 Mechanical resistance and stability (BWR 1)**

| Essential characteristic | Performance |
|--------------------------------------|-------------------------|
| Characteristic values for resistance | See Annexes C 1 to C 35 |
| Displacements | See Annex C 36 |
| Durability | See Annex B2 |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|--------------------------|-------------|
| Reaction to fire | Class A1 |

3.3 Hygiene, health and the environment (BWR 3)

| Essential characteristic | Performance |
|--|-------------------------|
| Content, emission and/or release of dangerous substances | No performance assessed |

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330076-00-0604 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 18 October 2019 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow
Head of Department

beglaubigt:
Lange


Installation conditions part 1

Anchor rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned anchorage:

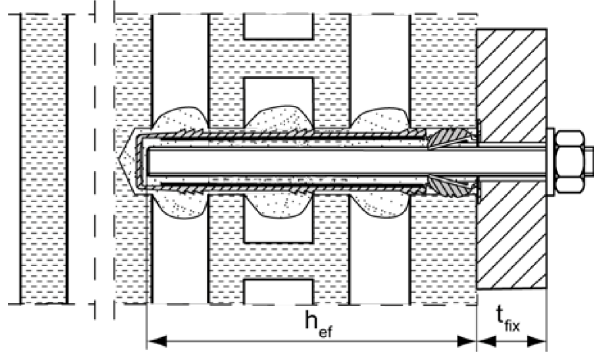


Installation with render bridge

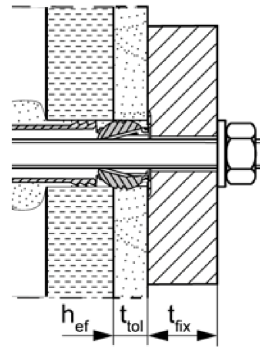


Size of the perforated sleeve:

| | | | |
|---------------|----------------|----------------|----------------|
| FIS H 12x50 K | FIS H 16x85 K | FIS H 20x85 K | FIS H 20x200 K |
| FIS H 12x85 K | FIS H 16x130 K | FIS H 20x130 K | |

Push through anchorage:

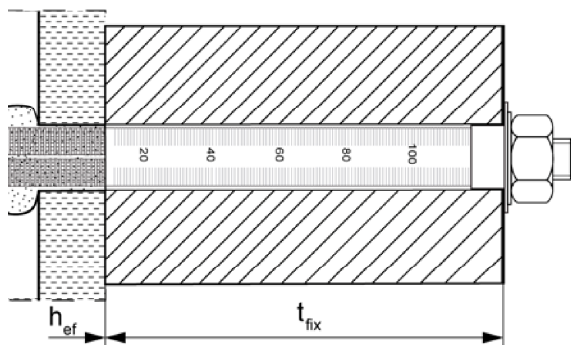

Installation with render bridge

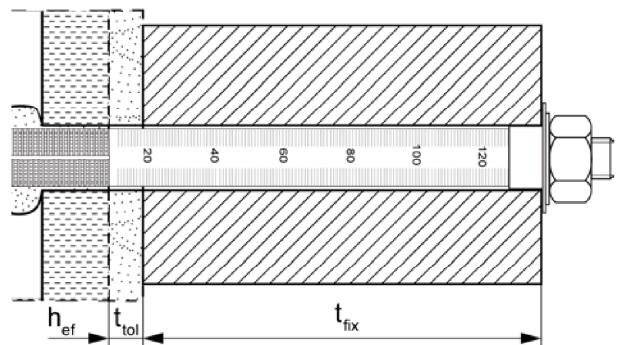


Size of the perforated sleeve:


| | |
|--------------------|--------------------|
| FIS H 18x130/200 K | FIS H 22x130/200 K |
|--------------------|--------------------|

Internal threaded anchor FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned anchorage:

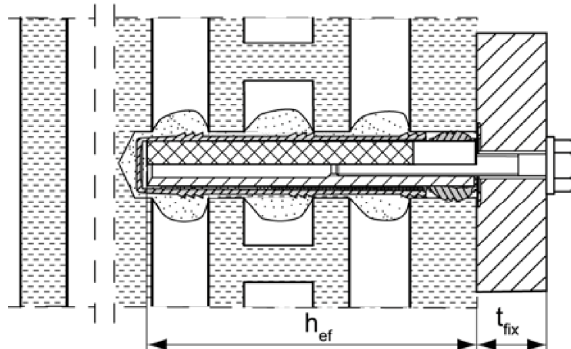

Installation with render bridge

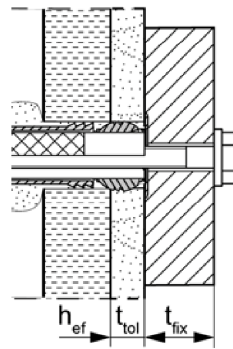

Pictures not to scale

h_{ef} = effective anchorage depth

t_{tol} = thickness of unbearing layer (e.g. plaster)

t_{fix} = thickness of fixture

fischer injektion system FIS HT II masonry

Product description


Installation conditions part 1,
Anchor rods and internal threaded anchor with perforated sleeve

Annex A 1


Installation conditions part 2

Anchor rods without perforated sleeve FIS H K; installation in solid brick masonry

Pre-positioned anchorage:

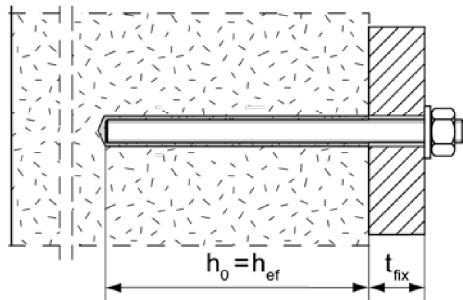


Push through anchorage: Annular gap filled with mortar

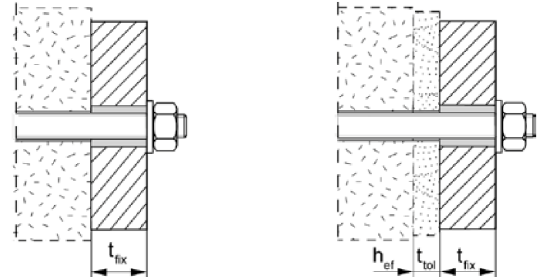


Installation with
render bridge

Internal threaded anchors FIS E without perforated sleeve FIS H K; installation in solid brick masonry

Pre-positioned anchorage:

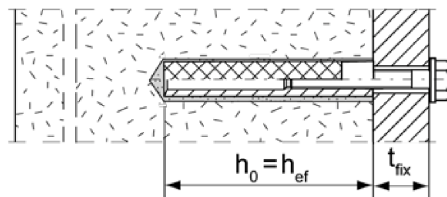

Installation with render bridge

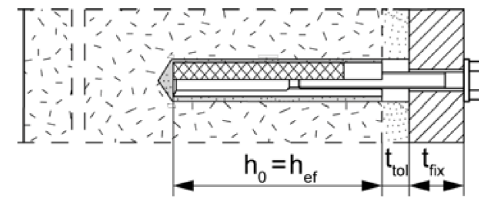

Pictures not to scale

h_0 = depth of drill hole

t_{tol} = thickness of unbearing layer (e.g. plaster)

h_{ef} = effective anchorage depth

t_{fix} = thickness of fixture

fischer injektion system FIS HT II masonry

Product description

Installation conditions part 2,
Anchor rods and internal threaded anchor without perforated sleeve

Annex A 2




Overview system components part 1

Mortar cartridge (shuttle cartridge) with sealing cap

①

Size: 350 ml, 360 ml, 585 ml, 950 ml

Imprint: fischer FIS HT II, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume

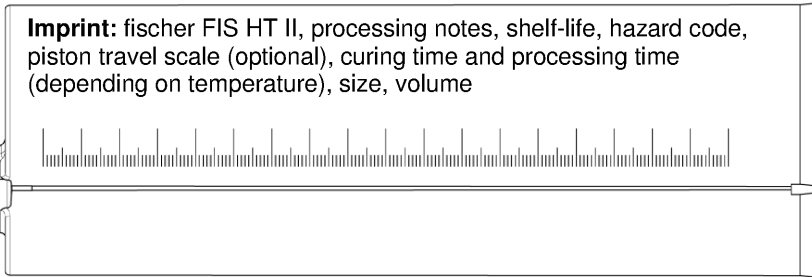




Mortar cartridge (coaxial cartridge) with sealing cap

①


Size: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml

Imprint: fischer FIS HT II, processing notes, shelf-life, hazard code, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume

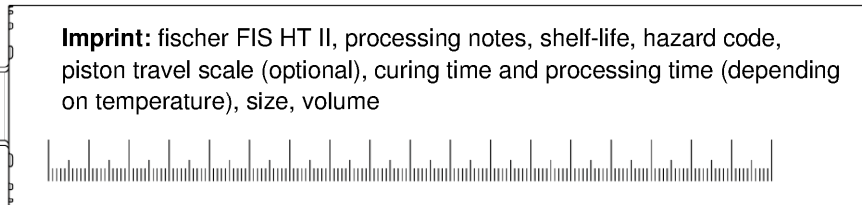


Static mixer MR Plus with injection adapter

Injection adapter



Static mixer



Cleaning brush BS / BSB



Blow-out pump ABG or ABP



Pictures not to scale

fischer injektion system FIS HT II masonry


System description

Overview system components part 1: cartridge / static mixer / cleaning brush

Annex A 3

Overview system components part 2


fischer anchor rod



Internal threaded anchor FIS E




Perforated sleeve FIS H K



Perforated sleeve FIS H K (push through anchorage)



Washer



Hexagon nut



Pictures not to scale

fischer injektion system FIS HT II masonry

System description

Overview system components part 2: steel parts / perforated sleeve



Annex A 4

Table A5.1: Materials

| Part | Designation | Material | | |
|--|---|--|--|--|
| 1 | Mortar cartridge | Mortar, hardener; filler | | |
| | | Steel, zinc plated | Stainless steel A4 | High corrosion-resistant steel C |
| 2 | Anchor rod | Property class 4.6, 4.8, 5.8 oder 8.8; EN ISO 898-1: 2013 zinc plated ≥ 5µm, EN ISO 4042:1999 A2K or hot-dip galvanised EN ISO 10684:2004 f _{uk} ≤ 1000 N/mm ² A ₅ > 8% fracture elongation | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062 EN 10088-1:2014 f _{uk} ≤ 1000 N/mm ² A ₅ > 8% fracture elongation | Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with f _{yk} = 560 N/mm ² 1.4565; 1.4529 EN 10088-1:2014 f _{uk} ≤ 1000 N/mm ² A ₅ > 8% fracture elongation |
| 3 | Washer ISO 7089:2000 | zinc plated ≥ 5µm, EN ISO 4042:1999 A2K or hot-dip galvanised EN ISO 10684:2004 | 1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362 EN 10088-1:2014 | 1.4565;1.4529 EN 10088-1:2014 |
| 4 | Hexagon nut | Property class 5 or 8; EN ISO 898-2:2012 zinc plated ≥ 5µm, ISO 4042:1999 A2K or hot-dip galvanised ISO 10684:2004 | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 |
| 5 | Internal threaded anchor FIS E | Property class 5.8; EN 10277-1:2008-06 zinc plated ≥ 5µm, ISO 4042:1999 A2K | Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 |
| 6 | Commercial standard screw or threaded / anchor rod for internal threaded anchor FIS E | Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5µm, ISO 4042:1999 A2K | Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014 |
| 7 | Perforated sleeve | PP / PE | | |
| | | | | |
| fischer injektion system FIS HT II masonry | | | | Annex A 5 |
| Product description Materials | | | | |

Specifications of intended use (part 1)

Table B1.1: Overview use and performance conditions

| Anchorages subject to | | fischer injection system FIS HT II masonry | |
|---|--------------------------|--|---|
| Hole drilling with hammer drill mode  | all bricks | | |
| Hole drilling with rotary drill mode  | all bricks | | |
| Static and quasi static load, in masonry | all bricks | | |
| Condition | dry or wet masonry | all bricks | |
| Installation | Pre-positioned anchorage | Anchor rod or internal threaded anchor (in solid brick masonry) | Perforated sleeve with anchor rod or internal threaded anchor (in perforated and solid brick masonry) Size: FIS H 12x50 K FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K |
| | Push through anchorage | Anchor rod (in solid brick masonry) | Perforated sleeve with anchor rod (in perforated and solid brick masonry) Size: FIS H 18x130/200 K FIS H 22x130/200 K |
| Installation conditions | condition d/d | all bricks | |
| | condition w/d | | |
| | condition w/w | | |
| Installation temperature | | 0°C to +40°C | |
| In-service temperature | -40°C to +80°C | max. short term temperature +80 °C and max. long term temperature +50 °C | |
| | -40°C to +120°C | max. short term temperature +120 °C and max. long term temperature +72 °C | |
| | | | |
| fischer injektion system FIS HT II masonry | | | Annex B 1 |
| Intended Use Specifications (part 1) | | | |

Specifications of intended use (part 2)

Anchorage subject to:

- Static and quasi-static loads

Base materials:

- Solid brick masonry (masonry group b), acc. to Annex B 13
- Hollow brick masonry (masonry group c), according to Annex B 13
- For minimum thickness of masonry member is $h_{ef} + 30\text{mm}$
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry, the characteristic resistance of the anchor may be determined by job site tests according to Technical Report TR 053, April 2016, Annex C under consideration of the β -factor according to Annex C 36, Table C36.1

Note (only applies to solid bricks):

The characteristic resistance is also valid for larger brick sizes, higher compressive strength and higher raw density of the masonry unit.

Temperature Range:

- I: From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)
- II: From -40°C to +120°C (max. short term temperature +120°C and max. long term temperature +72°C)

Use conditions (Environmental conditions):

- Dry and wet structure (regarding injection mortar)
- Structures subject to dry internal conditions exist
(zinc coated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particular aggressive conditions exist exist
(stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

fischer injektion system FIS HT II masonry

Intended Use
Specifications (part 2)

Annex B 2

Specifications of intended use (part 3)

Design:

- The anchorages have to be designed in accordance with the Technical Report TR054, April 2016, Design method A under the responsibility of an engineer experienced in anchorages and masonry work.

Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,b} = N_{Rk,p}$$

$$V_{Rk} = V_{Rk,b} = V_{Rk,c}$$

For the Calculation of pulling out a brick under tensile load $N_{Rk,pb}$ or pushing out a brick under shear load $V_{Rk,pb}$ see Technical Report TR 054, April 2016.

$N_{Rk,s}$, $V_{Rk,s}$ and $M_{Rk,s}$ see annex C1-C3

Factors for job site tests and displacements see Annex C36

- Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.

Installation:

- Condition d/d: - Installation and use in dry structures
- Condition w/w: - Installation and use in dry and wet structures
- Condition w/d: - Installation in wet structures and use in dry structures
- Hole drilling see Annex C (drilling method)
- In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) see Annex B 6, Table B6.1
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or anchor rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E.
- minimum curing time see Annex B 8, Table B8.2
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A 5, Table 5.1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored

Marking of the anchor rod with the envisage embedment depth. This may be done by the manufacturer of the rod or by a person on job site

fischer injektion system FIS HT II masonry

Intended Use
Specifications (part 3)

Annex B 3

Table B4.1: Installation parameters for anchor rods in solid bricks without perforated sleeves

| Anchor rod | Thread | M6 | M8 | M10 | M12 | M16 |
|---|------------------------------|-------------------------|----|-----|-----|-----|
| Nominal drill hole diameter | d_0 [mm] | 8 | 10 | 12 | 14 | 18 |
| Effective anchorage depth h_{ef} ¹⁾ | $h_{ef,min}$ [mm] | 50 | | | | |
| in solid brick (depth of drill hole $h_0 = h_{ef}$) | $h_{ef,max}$ [mm] | $h-30, \leq 200$ | | | | |
| Diameter of clearance hole in the fixture | pre-position $d_r \leq$ [mm] | 7 | 9 | 12 | 14 | 18 |
| | push through $d_r \leq$ [mm] | 9 | 11 | 14 | 16 | 20 |
| Diameter of cleaning brush | $d_b \geq$ [mm] | see Table B8.1 | | | | |
| Maximum installation torque | $T_{inst,max}$ [Nm] | see parameters of brick | | | | |

¹⁾ $h_{ef,min} \leq h_{ef} \leq h_{ef,max}$ is possible.

fischer anchor rods M6, M8, M10, M12, M16



Marking:


Property class 8.8, stainless steel A4 property class 80 and high corrosion resistant steel C property class 80: •

Stainless steel A4 property class 50 and high corrosion resistant steel C property class 50: ••

Or colour coding according to DIN 976-1:2016-09, property class 4.6 marking according to EN ISO 898-1:2013

Installation conditions:

Anchor rod in cylindrical drill hole
Setting depth mark

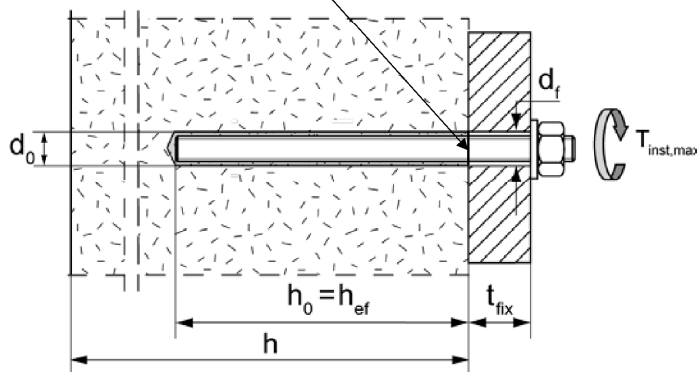

Pictures not to scale

fischer injektion system FIS HT II masonry

Intended Use


Installation parameters for anchor rods without perforated sleeve

Annex B 4

Table B5.1: Installation parameters for internal threaded anchors FIS E in solid bricks without perforated sleeves

| Internal threaded anchor FIS E | | 11x85 M6 | 11x85 M8 | 15x85 M10 | 15x85 M12 |
|--|---------------------------------------|-------------------------|----------|-----------|-----------|
| Diameter of anchor | d _H [mm] | 11 | | 15 | |
| Nominal drill hole diameter | d ₀ [mm] | 14 | | 18 | |
| Length of anchor | L _H [mm] | 85 | | | |
| Effective anchorage depth | h ₀ = h _{ef} [mm] | 85 | | | |
| Effective anchorage depth h _{ef} in AAC (conical drill hole) | h ₀ [mm] | 100 | | - | |
| | h _{ef} [mm] | 85 | | | |
| Diameter of cleaning brush | d _b ≥ [mm] | see Table B8.1 | | | |
| Maximum installation torque | T _{inst,max} [Nm] | see parameters of brick | | | |
| Diameter of clearance hole in the fixture | d _f [mm] | 7 | 9 | 12 | 14 |
| Screw-in depth | l _{E,min} [mm] | 6 | 8 | 10 | 12 |
| | l _{E,max} [mm] | 60 | | | |

fischer Internal threaded anchor FIS E

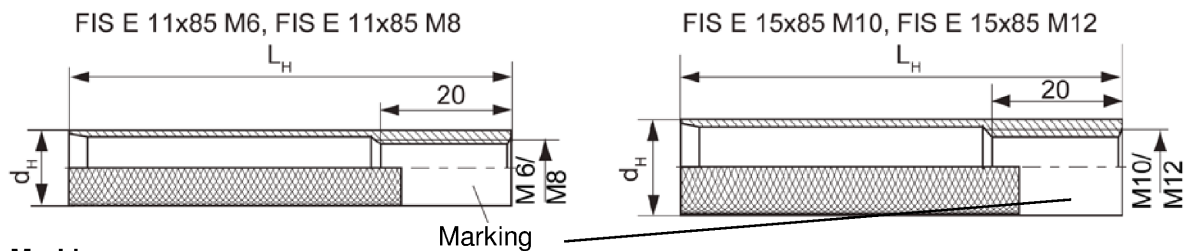


Marking:

Size, e.g. **M8**, Stainless steel: A4, e.g. **M8 A4**, High corrosion-resistant steel: C, e.g. **M8 C**

Installation conditions:

Internal threaded anchor in cylindrical drill hole

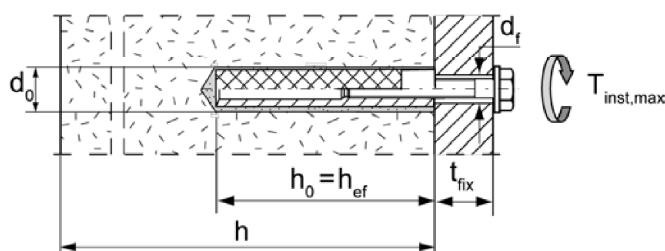

Pictures not to scale

fischer injektion system FIS HT II masonry

Intended Use

Installation parameters for anchor rods without perforated sleeve

Annex B 5

Table B6.1: Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeves (pre-positioned anchorage)

| perforated sleeve FIS H K | 12x50 | 12x85 ²⁾ | 16x85 | 16x130 ²⁾ | 20x85 | 20x130 ²⁾ | 20x200 ²⁾ |
|---|---------------------------|---------------------|-----------|----------------------|------------|----------------------|----------------------|
| Nominal drill hole diameter $d_0 = D_{\text{sleeve, nom}}$ | 12 | | 16 | | 20 | | |
| Depth of drill hole h_0 [mm] | 55 | 90 | 90 | 140 | 90 | 140 | 210 |
| Effective anchorage depth | $h_{\text{ef, min}}$ [mm] | 50 | 65 | 85 | 110 | 85 | 110 |
| | $h_{\text{ef, max}}$ [mm] | 50 | 85 | 85 | 130 | 85 | 130 |
| Size of threaded rod [-] | M6 or M8 | | M8 or M10 | | M12 or M16 | | |
| Size of internal threaded anchor FIS E | - | - | 11x85 | - | 15x85 | - | - |
| Diameter of cleaning brush ¹⁾ $d_b \geq$ [mm] | see Table B8.1 | | | | | | |
| Maximum installation torque $T_{\text{inst, max}}$ [Nm] | see parameters of brick | | | | | | |

¹⁾ Only for solid areas in hollow bricks and solid bricks.


²⁾ Bridging of unbearing layer (e.g. plaster) is possible. When reducing the effective anchorage depth $h_{\text{ef, min}}$, the values of the next shorter perforated sleeve of the same diameter must be used. The smaller value of characteristic resistance must be taken.

Perforated sleeve


FIS H 12x50 K; FIS H 12x85 K; FIS H 16x85 K; FIS H 16x130 K;
FIS H 20x85 K; FIS H 20x130 K; FIS H 20x200 K

Marking:

Size $D_{\text{sleeve, nom}} \times L_{\text{sleeve}}$
(e.g.: 16x85)




$D_{\text{sleeve, nom}}$

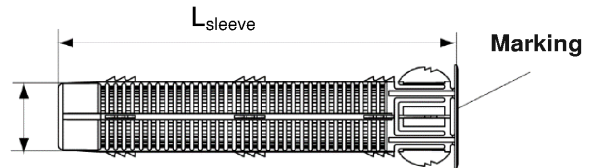


fischer Internal threaded anchor FIS E

FIS E 11x85 M6, FIS E 11x85 M8

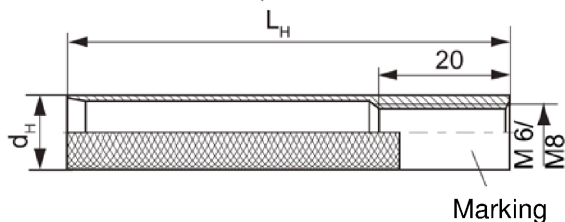


FIS E 15x85 M10, FIS E 15x85 M12

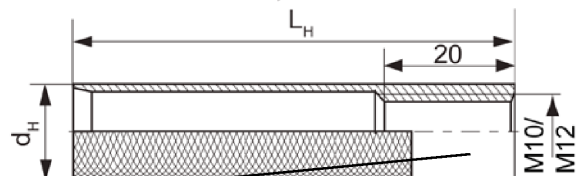


Installation conditions:

Anchor rod with perforated sleeve

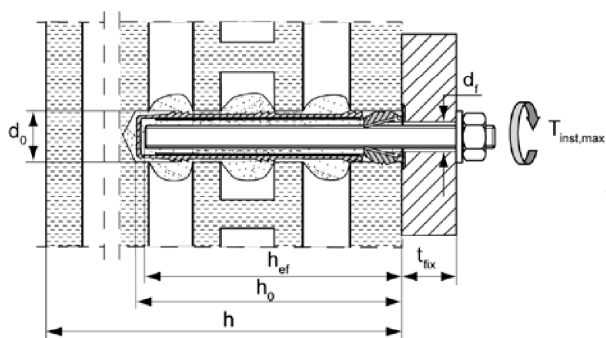

Internal threaded anchor with perforated sleeve

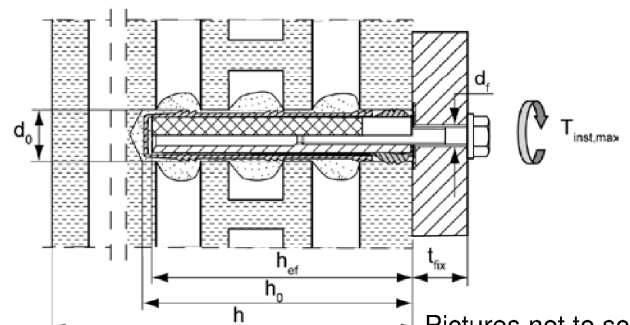

Pictures not to scale

fischer injektion system FIS HT II masonry

Intended Use

Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeve (pre-positioned anchorage)

Annex B 6


Table B7.1: Installation parameters for anchor rods with perforated sleeves
(push through anchorage)

| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
|--|------------------------------|-------------------------|-----|------------|
| Nominal sleeve diameter | D _{sleeve,nom} [mm] | 16 | | 20 |
| Nominal drill hole diameter | d ₀ [mm] | 18 | | 22 |
| Depth of drill hole | h ₀ [mm] | 135 + t _{fix} | | |
| Effective anchorage depth | h _{ef} [mm] | ≥130 | | |
| Diameter of cleaning brush ¹⁾ | d _b ≥ [mm] | Siehe Tabelle B8.1 | | |
| Size of threaded rod | [-] | M10 | M12 | M16 |
| Maximum installation torque | T _{inst,max} [Nm] | see parameters of brick | | |
| Thickness of fixture | t _{fix,max} [mm] | 200 | | |

¹⁾ Only for solid areas in hollow bricks and solid bricks.


Perforated sleeve

FIS H 18x130/200 K; FIS H 22x130/200 K

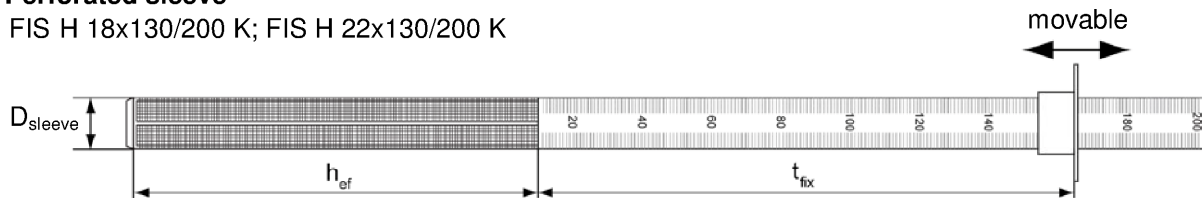

Installation conditions:

Anchor rod with perforated sleeve

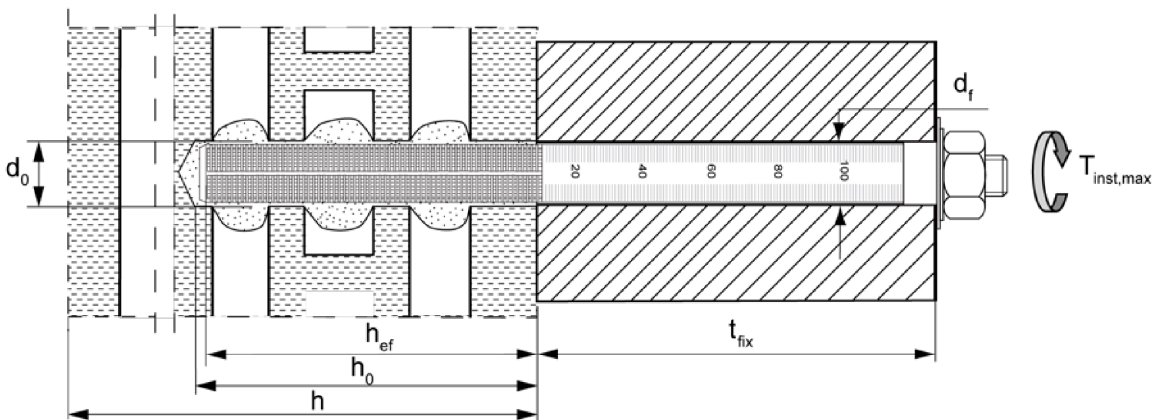

Pictures not to scale

fischer injektion system FIS HT II masonry

Intended Use

Installation parameters for anchor rods with perforated sleeves
(push through anchorage)

Annex B 7

Tabelle B8.1: Parameters of the cleaning brush BS (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

| | | | | | | | | | |
|---------------------|------------|---|----|----|----|----|----|----|----|
| Drill hole diameter | d_0 [mm] | 8 | 10 | 12 | 14 | 16 | 18 | 20 | 22 |
| Brush diameter | d_b [mm] | 9 | 11 | 14 | 16 | 20 | 20 | 25 | 25 |



Only for solid bricks and solid areas in perforated bricks

Table B8.2: Maximum processing times and minimum curing times
(During the curing time of the mortar the masonry temperature may not fall below the listed minimum temperature)

| Temperature at anchoring base [°C] | Minimum curing time ¹⁾ t_{cure} | | | System-temperature (mortar) [°C] | Maximum processing time t_{work} | | |
|--------------------------------------|--|-------------------------|-----------------------------------|------------------------------------|------------------------------------|-------------------------|-----------------------------------|
| | FIS HT II High Speed | FIS HT II ²⁾ | FIS HT II Low Speed ²⁾ | | FIS HT II High Speed | FIS HT II ²⁾ | FIS HT II Low Speed ²⁾ |
| ±0 to +5 | 3 h | 3 h | 6 h | +5 | 5 min | 13 min | 20 min |
| >+5 to +10 | 50 min | 90 min | 3 h | +10 | 3 min | 9 min | 20 min |
| >+10 to +20 | 30 min | 60 min | 2 h | +20 | 1 min | 5 min | 10 min |
| >+20 to +30 | - | 45 min | 60 min | +30 | - | 4 min | 6 min |
| >+30 to +40 | - | 35 min | 30 min | +40 | - | 2 min | 4 min |

¹⁾ For wet bricks the curing time must be doubled

²⁾ Minimum cartridge temperature +5°C

Pictures not to scale

fischer injektion system FIS HT II masonry












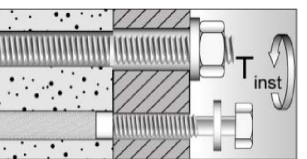
Intended use

Cleaning brush (steel brush)
Maximum processing times and minimum curing times

Annex B 8

Installation instruction part 1

Installation in solid brick (without perforated sleeve)
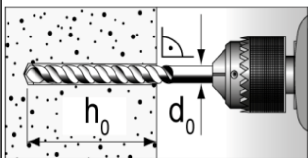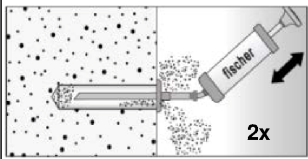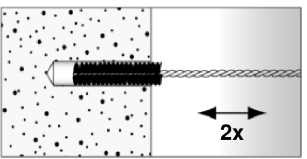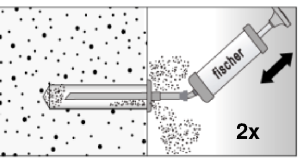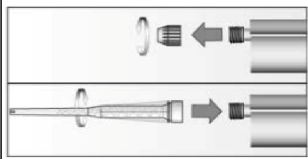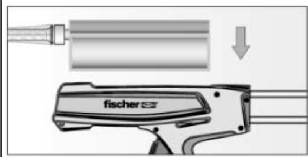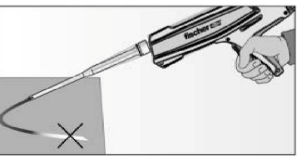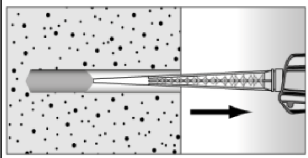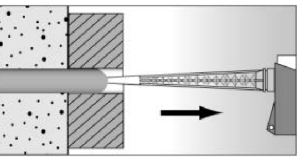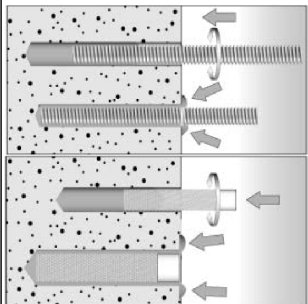
| | | | | |
|---|---|--|--|--|
| 1 |  | Drill the hole (drilling method see Annex C of the respective brick) depth of drill hole h_0 and drill hole diameter d_0 see Tables B4.1; B5.1 | | |
| 2 |  |  |  | Blow out the drill hole twice. Brush twice and blow out twice again. |
| 3 |  | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | | |
| 4 |  | Place the cartridge into a suitable dispenser |  | Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of. |
| 5 |  | Fill approximetly 2/3 of the drill hole with mortar beginning from the bottom of the hole ¹⁾ . Avoid bubbles! |  | For push through anchorage fill the annular clearance with mortar. |
| 6 |  | Only use clean and oil-free anchor elements. Mark the anchor rod for setting depth. Insert the anchor rod or internal threaded anchor FIS E by hand using light turning motions. When reaching the setting depth marking, excess mortar must emerge from the mouth of the drill hole. | | |
| 7 |  | Do not touch. Minimum curing time see Table B8.2 |  | Mounting the fixture. $T_{inst,max}$ see parameter of brick. |

¹⁾ Exact volume of mortar see manufacturer's specification.

fischer injektion system FIS HT II masonry









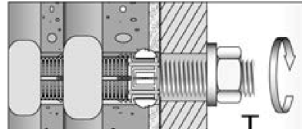
Intended use

Installation instruction (without perforated sleeve) part 1

Annex B 9

Installation instruction part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage)
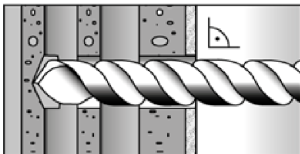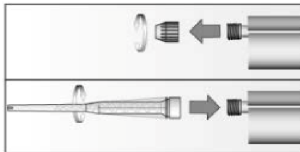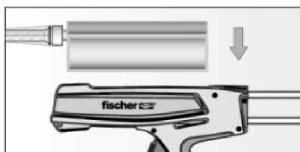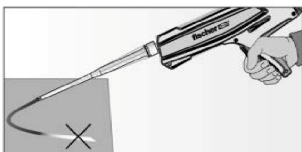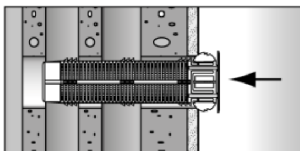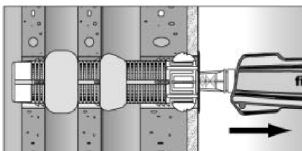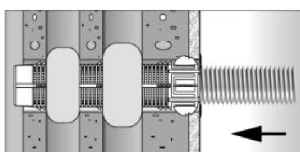
| | | | | |
|---|---|---|---|--|
| 1 |  | Drill the hole (drilling method see Annexes C). depth of drill hole h_0 and drill hole diameter d_0 see Table B6.1 | When install perforated sleeves in solid bricks or solid areas of hollow bricks, also clean the hole by blowing out and brushing. | |
| 2 |  | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | | |
| 3 |  | Place the cartridge into a suitable dispenser. |  | Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of. |
| 4 |  | Insert the perforated sleeve flush with the surface of the masonry or plaster. |  | Fill the perforated sleeve completely with mortar beginning from the bottom of the hole ¹⁾ . |
| 5 |  | Only use clean and oil-free anchor elements. Mark the anchor rod for setting depth. Insert the anchor rod or the internal threaded anchor FIS E by hand using light turning motions until reaching the setting depth marking (anchor rod) or flush with the surface (internal threaded anchor). | | |
| 6 |  | Do not touch. Minimum curing time see Table B8.2 |  | Mounting the fixture. $T_{inst,max}$ see parameter of brick. T_{inst} |

¹⁾ Exact volume of mortar see manufacturer's specification.

fischer injektion system FIS HT II masonry











Intended use

Installation instruction (with perforated sleeve) part 2

Annex B 10

Installation instruction part 3

Installation in perforated or solid brick with perforated sleeve (push through anchorage)
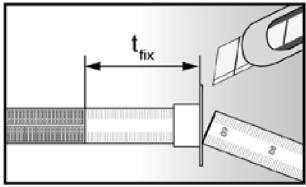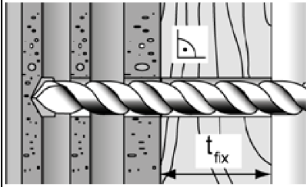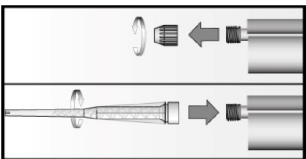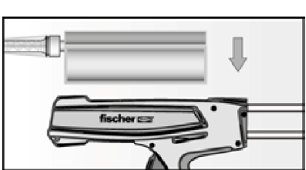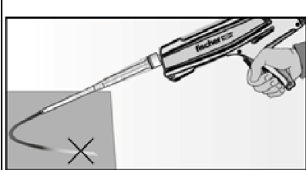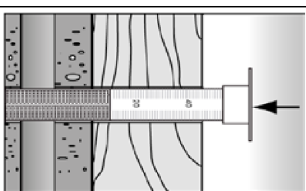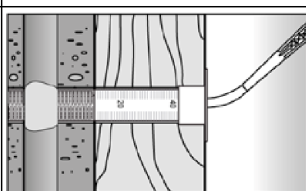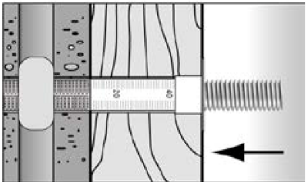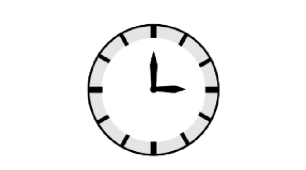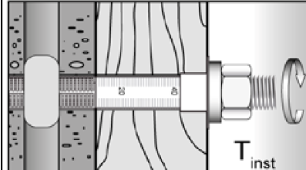
| | | | | |
|---|---|---|--|--|
| 1 |  | Push the movable stop up to the correct thickness of fixture and cut the overlap. |  | Drill the hole through the fixture. Depth of drill hole ($h_0 + t_{fix}$) and drill hole diameter see Table B7.1 |
| 2 |  | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | | |
| 3 |  | Place the cartridge into a suitable dispenser. |  | Press out approximately 10 cm of mortar until the resin is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed of. |
| 4 |  | Insert the perforated sleeve flush with the surface of the fixture into the drill hole. |  | Fill the sleeve with mortar beginning from the bottom of the hole. ¹⁾ For deep drill holes use an extension tube. |
| 5 |  | Only use clean and oil-free anchor elements. Mark the anchor rod for setting depth. Insert the anchor rod or the internal threaded anchor FIS E by hand using light turning motions until reaching the setting depth marking (anchor rod) or flush with the surface (internal threaded anchor). | | |
| 6 |  | Do not touch. Minimum curing time see Table B8.2 |  | Mounting the fixture. $T_{inst,max}$ see parameter of brick. |

¹⁾ Exact volume of mortar see manufacturer's specification.

fischer injektion system FIS HT II masonry

Intended use


Installation instruction (with perforated sleeve) part 3

Annex B 11

Table B12.1: Overview of controlled bricks

| Kind of masonry | Brick format [mm] | Compressive strength f_b N/mm ² | Producing country | Density ρ [kg/dm ³] | Annex |
|---|----------------------|---|----------------------|---|------------|
| Solid brick Mz | | | | | |
| Solid brick Mz | 2DF ≥240x115x113 | 10 - 16 | Germany | ≥1,8 | C4/C5 |
| Solid sand- lime brick KS / perforated Sand- lime brick KSL | | | | | |
| Solid sand- lime brick KS | NF ≥240x115x71 | 12 - 28 | Germany | ≥2,0 | C6/C7 |
| Solid sand- lime brick KS | 8DF ≥ 250x240x240 | 10 - 28 | Germany | ≥2,0 | C8/C9 |
| Perforated Sand- lime brick KSL | 3DF 240x175x113 | 8 - 20 | Germany | ≥1,4 | C10 – C13 |
| Vertical perforated brick HLz | | | | | |
| Vertical perforated brick HLz | 375x240x237 | 4 - 12 | Germany | ≥1,0 | C14/C15 |
| | 2DF 240x115x113 | 6 - 28 | Germany | ≥1,4 | C16/C17 |
| | 500x200x315 | 4 - 8 | France | ≥0,6 | C18 – C21 |
| | 500x200x300 | 4 - 10 | France | ≥0,7 | C22 – C25 |
| | 500x200x315 | 2 - 8 | France | ≥0,7 | C26 – C29 |
| | 560x200x275 | 4 - 8 | France | ≥0,7 | C30/C31 |
| Light-weight concrete hollow block Hbl | | | | | |
| Light-weight concrete hollow block Hbl | 500x200x200 | 2 - 6 | France | ≥1,0 | C32/C33 |
| Light-weight concrete solid block Vbl | | | | | |
| Light-weight concrete solid block Vbl | ≥ 372x300x254 | 2 | Germany | ≥0,6 | C34/C35 |
| fischer injektion system FIS HT II masonry | | | | | Annex B 12 |
| Intended use Overview of controlled bricks | | | | | |

Spacing and edge distance

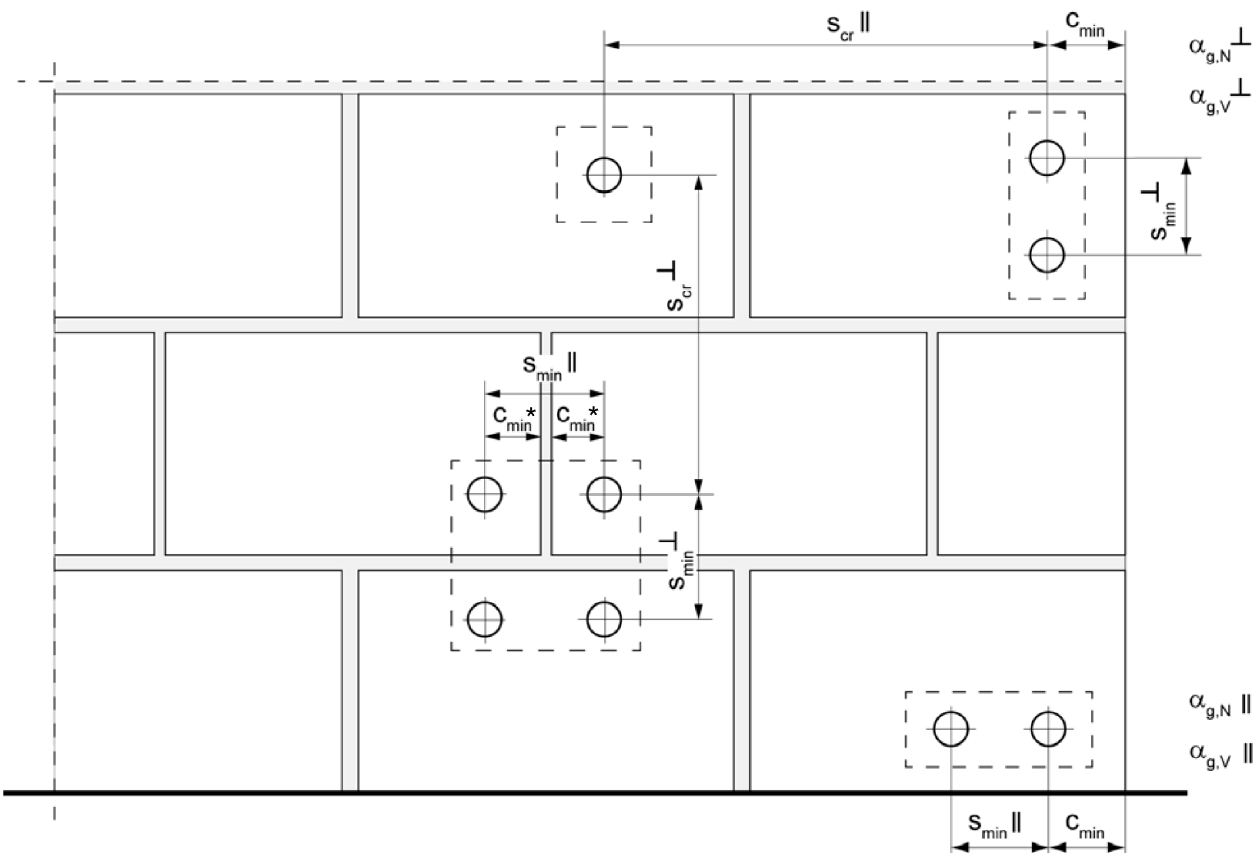

* Only, if vertical joints are not completely filled with mortar

- $s_{min} ||$ = Minimum spacing parallel to bed joint
 $s_{min} \perp$ = Minimum spacing vertical to bed joint
 $s_{cr} ||$ = Characteristic spacing parallel to bed joint
 $s_{cr} \perp$ = Characteristic spacing vertical to bed joint
 $c_{cr} = c_{min}$ = Edge distance
 $\alpha_{g,N} ||$ = Group factor for tensile load, anchor group parallel to bed joint
 $\alpha_{g,V} ||$ = Group factor for shear load, anchor group parallel to bed joint
 $\alpha_{g,N} \perp$ = Group factor for tensile load, anchor group vertical to bed joint
 $\alpha_{g,V} \perp$ = Group factor for shear load, anchor group vertical to bed joint

For $s \geq s_{cr}$ $\alpha_g = 2$

For $s_{min} \leq s < s_{cr}$ α_g according to installation parameters of brick

$N_{Rk}^g = \alpha_{g,N} \cdot N_{Rk}$; $V_{Rk}^g = \alpha_{g,V} \cdot V_{Rk}$ (Group of 2 anchors)

$N_{Rk}^g = \alpha_{g,N} || \cdot \alpha_{g,N} \perp \cdot N_{Rk}$; $V_{Rk}^g = \alpha_{g,V} || \cdot \alpha_{g,V} \perp \cdot V_{Rk}$ (Group of 4 anchors)

fischer injektion system FIS HT II masonry

Intended use
Spacing and edge distance

Annex B 13

Table C1.1: Characteristic values for the **steel bearing capacity** of **anchor rods** under tensile load

| Anchor rod | | | | M6 | M8 | M10 | M12 | M16 | | |
|--|---|----------------|-----|------|--------------------------------------|---------------------------|--------|--------|----|-----|
| Bearing capacity under tensile load, steel failure | | | | | | | | | | |
| Characteristic resistance $N_{Rk,s}$ | Steel zinc plated | Property class | 4.6 | [kN] | 8 | 15(13) | 23(21) | 34 | 63 | |
| | | | | | 4.8 | 8 | 15(13) | 23(21) | 34 | 63 |
| | | | | | 5.8 | 10 | 18(17) | 29(27) | 42 | 78 |
| | | | | | 8.8 | 16 | 29(27) | 46(43) | 67 | 125 |
| | Stainless steel A4 and High corrosion resistant steel C | Property class | 50 | | 10 | 18 | 29 | 42 | 78 | |
| | | | | | 70 | 14 | 26 | 41 | 59 | 110 |
| | | | | | 80 | 16 | 29 | 46 | 67 | 125 |
| | | | | | Partial safety factors ¹⁾ | | | | | |
| Partial safety factor $\gamma_{Ms,N}$ | Steel zinc plated | Property class | 4.6 | [-] | 2 | | | | | |
| | | | | | 4.8 | 1,50 | | | | |
| | | | | | 5.8 | 1,50 | | | | |
| | | | | | 8.8 | 1,50 | | | | |
| | Stainless steel A4 and High corrosion resistant steel C | Property class | 50 | | 2,86 | | | | | |
| | | | | | 70 | 1,50 ²⁾ / 1,87 | | | | |
| | | | | | 80 | 1,60 | | | | |
| | | | | | | | | | | |

¹⁾ In absence of other national regulations

²⁾ Only for fischer FIS A made of high corrosion-resistant steel C

³⁾ Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hotdip galvanized standard threaded rods according to EN ISO 10684:2004+AC:2009

fischer injektion system FIS HT II masonry

Performance

Characteristic steel bearing capacity of anchor rods

Annex C 1


Table C2.1: Characteristic values for the **steel bearing capacity** of **anchor rods** under shear load

| Anchor rod | | | M6 | M8 | M10 | M12 | M16 | | |
|--|---|----------------|------|------|---------------------------|--------|-----------|-----|-----|
| Bearing capacity under shear load, steel failure | | | | | | | | | |
| without lever arm | | | | | | | | | |
| Characteristic resistance $V_{Rk,s}$ | Steel zinc plated | Property class | [kN] | 4 | 7(6) | 12(10) | 17 | 31 | |
| | | | | 4 | 7(6) | 12(10) | 17 | 31 | |
| | | | | 5 | 9(8) | 15(13) | 21 | 39 | |
| | | | | 8 | 15(13) | 23(21) | 34 | 63 | |
| | Stainless steel A4 and High corrosion resistant steel C | | | 50 | 5 | 9 | 15 | 21 | 39 |
| | | | | 70 | 7 | 13 | 20 | 30 | 55 |
| | | | | 80 | 8 | 15 | 23 | 34 | 63 |
| | | | | | | | | | |
| with lever arm | | | | | | | | | |
| Characteristic bending moment $M_{Rk,s}$ | Steel zinc plated | Property class | [Nm] | 6 | 15(13) | 30(27) | 52 | 133 | |
| | | | | 6 | 15(13) | 30(27) | 52 | 133 | |
| | | | | 8 | 19(16) | 37(33) | 65 | 166 | |
| | | | | 12 | 30(26) | 60(53) | 105 | 266 | |
| | Stainless steel A4 and High corrosion resistant steel C | | | 50 | 7 | 19 | 37 | 65 | 166 |
| | | | | 70 | 10 | 26 | 52 | 92 | 232 |
| | | | | 80 | 12 | 30 | 60 | 105 | 266 |
| | | | | | | | | | |
| Partial safety factors ¹⁾ | | | | | | | | | |
| Partial safety factor $\gamma_{Ms,V}$ | Steel zinc plated | Property class | [-] | 1,67 | | | | | |
| | | | | 1,25 | | | | | |
| | | | | 1,25 | | | | | |
| | | | | 1,25 | | | | | |
| | Stainless steel A4 and High corrosion resistant steel C | | | 50 | 2,38 | | | | |
| | | | | 70 | 1,25 ²⁾ / 1,56 | | | | |
| | | | | 80 | 1,33 | | | | |
| | | | | | | | | | |
| ¹⁾ In absence of other national regulations | | | | | | | | | |
| ²⁾ Only for fischer FIS A made of high corrosion-resistant steel C | | | | | | | | | |
| ³⁾ Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hotdip galvanized standard threaded rods according to EN ISO 10684:2004+AC:2009 | | | | | | | | | |
| fischer injektion system FIS HT II masonry | | | | | | | Annex C 2 | | |
| Performance Characteristic steel bearing capacity of anchor rods | | | | | | | | | |

Table C3.1: Characteristic values for the **steel bearing capacity** of **internal threaded anchors FIS E** under tensile / shear load

| fischer internal threaded anchor FIS E | | | | M6 | M8 | M10 | M12 | |
|--|-----------------|-------------------|-----|------|------|-----|-----------|----|
| Bearing capacity under tensile load, steel failure | | | | | | | | |
| Characteristic resistance with screw | $N_{Rk,s}$ | Property class | 5.8 | [kN] | 10 | 18 | 29 | 42 |
| | | Property class | A4 | | 14 | 26 | 41 | 59 |
| | | Property class 70 | C | | 14 | 26 | 41 | 59 |
| Partial safety factors ¹⁾ | | | | | | | | |
| Partial safety factor | $\gamma_{Ms,N}$ | Property class | 5.8 | [-] | 1,50 | | | |
| | | Property class | A4 | | 1,87 | | | |
| | | Property class 70 | C | | 1,87 | | | |
| Bearing capacity under shear load, steel failure | | | | | | | | |
| without lever arm | | | | | | | | |
| Characteristic resistance with screw | $V_{Rk,s}$ | Property class | 5.8 | [kN] | 5 | 9 | 15 | 21 |
| | | Property class | A4 | | 7 | 13 | 20 | 30 |
| | | Property class 70 | C | | 7 | 13 | 20 | 30 |
| with lever arm | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s}$ | Property class | 5.8 | [Nm] | 8 | 19 | 37 | 65 |
| | | Property class | A4 | | 11 | 26 | 52 | 92 |
| | | Property class 70 | C | | 11 | 26 | 52 | 92 |
| Partial safety factors ¹⁾ | | | | | | | | |
| Partial safety factor | $\gamma_{Ms,V}$ | Property class | 5.8 | [-] | 1,25 | | | |
| | | Property class | A4 | | 1,56 | | | |
| | | Property class 70 | C | | 1,56 | | | |
| ¹⁾ In absence of other national regulations | | | | | | | | |
| fischer injektion system FIS HT II masonry | | | | | | | Annex C 3 | |
| Performance Characteristic steel bearing capacity of fischer internal threaded anchor FIS E | | | | | | | | |

Solid brick Mz, 2DF, EN 771-1

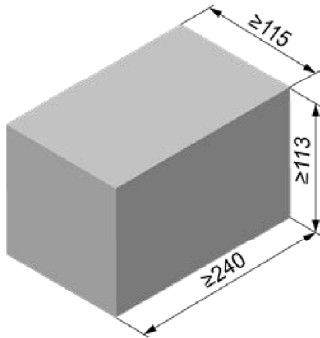

Solid brick Mz, 2DF, EN 771-1

| | | | |
|---|-------------------|---------|----------|
| Producer | e.g. Wienerberger | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | ≥ 240 | ≥ 115 | ≥ 113 |
| Density ρ [kg/dm ³] | ≥ 1,8 | | |
| Compressive strength f_b [N/mm ²] | 10 / 16 | | |
| Standard or annex | EN 771-1 | | |

Table C4.1: Installation parameters

| | | | | | | | | | | | | | | | | | | | | |
|--|--|--------------------------------|------|-----|-----|----|-----|----|-----|----|-----|----|-------|----|-------|----|-----|--|-----|--|
| Anchor rod | | | M6 | | M8 | | M10 | | M12 | | M16 | | - | | - | | | | | |
| Internal threaded anchor FIS E | | | - | | - | | - | | - | | - | | M6 | | M8 | | M10 | | M12 | |
| | | | | | | | | | | | | | 11x85 | | 15x85 | | | | | |
| Anchor rod and internal threaded anchor FIS E without perforated sleeve | | | | | | | | | | | | | | | | | | | | |
| Effective anchorage depth | | h_{ef} | [mm] | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 85 | | | | | | |
| Max. installation torque | | $T_{inst,max}$ | [Nm] | 4 | | 10 | | | | | | | | 4 | | 10 | | | | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H 16x85 K | | | | | | | | | | | | | | | | | | | | |
| Effective anchorage depth | | h_{ef} | [mm] | - | | 85 | | | | - | | | | 85 | | | - | | | |
| Max. installation torque | | $T_{inst,max}$ | [Nm] | | | 10 | | | | | | | | 4 | | 10 | | | | |
| General installation parameters | | | | | | | | | | | | | | | | | | | | |
| Edge distance | | c_{min} | [mm] | 60 | | | | | | | | | | | | | | | | |
| Spacing | | $s_{min} \parallel$ | | 120 | | | | | | | | | | | | | | | | |
| | | $s_{cr} \parallel$ | | 240 | | | | | | | | | | | | | | | | |
| | | $s_{cr} \perp = s_{min} \perp$ | | 115 | | | | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | | | | | |

Table C4.2: Group factors

| Anchor rods | | | M6 | M8 | M10 | M12 | M16 | - | | - | |
|-----------------------------------|--------------------------|-----|-----|----|-----|-----|-----|-------|----|-------|-----|
| Internal threaded anchor FIS E | | | - | - | - | - | - | M6 | M8 | M10 | M12 |
| | | | | | | | | 11x85 | | 15x85 | |
| Group factor | $\alpha_{q,N} \parallel$ | [-] | 1,5 | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | 1,4 | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | 2 | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Solid brick Mz, 2DF, dimensions, installation parameters

Annex C 4

Solid brick Mz, 2DF, EN 771-1

Table C5.1: Characteristic resistance under tensile load

| Anchor rod | | | M6 | | M8 | | M10 | | M12 | | M16 | | - | | - | | M8 | | M10 | | - | | | | | | | |
|--|--|-----------|-----|--|-----|-----|-----|-----|-----|-----|-----|-----|-------|-----|-------|----|-------|-----|-----|--|-------|--|---|--|----|--|----|--|
| Internal threaded anchor FIS E | | | - | | - | | - | | - | | - | | M6 | | M8 | | M10 | | M12 | | - | | - | | M6 | | M8 | |
| | | | | | | | | | | | | | 11x85 | | 15x85 | | 11x85 | | | | | | | | | | | |
| Perforated sleeve FIS H K | | | - | | - | | - | | - | | - | | - | | - | | | | | | 16x85 | | | | | | | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| compressive strength f _b | | condition | | Effective anchorage depth h _{ef} [mm] | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 85 | | | | | | | | | | | | |
| 10N/mm ² | | w/w | w/d | 1,5 | 2,5 | 1,5 | 2,5 | 1,5 | 3 | 2 | 3,5 | 2 | 3,5 | 2 | | | | 1,5 | | | | | | | | | | |
| | | d/d | 3 | 4,0 | 3,0 | 4,0 | 3,0 | 4,5 | 3 | 5,5 | 3 | 5,5 | 3 | | | | 3 | | | | | | | | | | | |
| 16N/mm ² | | w/w | w/d | 2,5 | 4 | 2,5 | 4 | 2,5 | 4,5 | 3,5 | 5,5 | 3,5 | 5,5 | 3,5 | | | | 2,5 | | | | | | | | | | |
| | | d/d | 4,5 | 7,0 | 4,5 | 7,0 | 4,5 | 7,5 | 5,5 | 8 | 5,5 | 8 | 5,5 | | | | 4,5 | | | | | | | | | | | |

Factor for temperature range 72/120°C: 0,83

Table C5.2: Characteristic resistance under shear load

| | | | | | | | | | | | | | | | |
|---|-----------|-----|---|-----|-----|-------|-----|-------|-----|-------|-----|-------|-----|-----|-----|
| Anchor rod | M6 | M8 | M10 | M12 | M16 | - | | - | | M8 | M10 | - | | | |
| Internal threaded anchor FIS E | - | - | - | - | - | M6 | M8 | M10 | M12 | - | - | M6 | M8 | | |
| | | | | | | 11x85 | | 15x85 | | | | 11x85 | | | |
| Perforated sleeve FIS H K | - | - | - | - | - | - | | - | | 16x85 | | | | | |
| Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | |
| compressive strength f_b | condition | | Effective anchorage depth h_{ef} [mm] | | | | | | | | | | | | |
| | | | ≥ 50 | | | | | 85 | | | | | | | |
| 10N/mm ² | w/w | w/d | 2,5 | 3,0 | 3,0 | 3,5 | 3,0 | 2,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,5 | 2,5 | 3,0 |
| | d/d | | | | | | | | | | | | | | |
| 16N/mm ² | w/w | w/d | 4,0 | 5,0 | 5,5 | 5,5 | 5,0 | 4,0 | 5,0 | 5,0 | 5,0 | 5,0 | 6,0 | 4,0 | 5,0 |
| | d/d | | | | | | | | | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Solid brick Mz, 2DF, Characteristic resistance under tensile and shear load

Annex C 5

Solid sand-lime brick KS, NF, EN 771-2

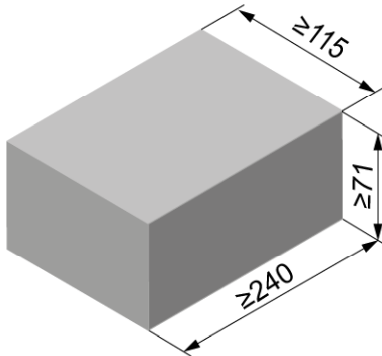

Solid sand-lime brick KS, NF, EN 771-2

| | | | |
|---|--------------|---------|----------|
| Producer | | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | ≥ 240 | ≥ 115 | ≥ 71 |
| Density ρ [kg/dm ³] | | | |
| Compressive strength f_b [N/mm ²] | 12 / 20 / 28 | | |
| Standard or annex | EN 771-2 | | |

Table C6.1: Installation parameters

| | | | | | | | | | | | | | | | | | | | | |
|---|--|-----------------------|------|--------------------|-----|----|-----|-----|-----|-----|-----|-----|-------|----|-------|----|-----|--|-----|--|
| Anchor rod | | | M6 | | M8 | | M10 | | M12 | | M16 | | - | | - | | | | | |
| Internal threaded anchor FIS E | | | - | | - | | - | | - | | - | | M6 | | M8 | | M10 | | M12 | |
| | | | | | | | | | | | | | 11x85 | | 15x85 | | | | | |
| Anchor rod and internal threaded anchor FIS E without perforated sleeve | | | | | | | | | | | | | | | | | | | | |
| Effective anchorage depth | | h _{ef} | [mm] | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 85 | | | 85 | | | |
| | | | | | | | | 200 | | 200 | | 200 | | | | | | | | |
| Max. installation torque | | T _{inst,max} | [Nm] | 3 | | 5 | | 15 | | 15 | | 25 | | 3 | 5 | 15 | | | | |
| General installation parameters | | | | | | | | | | | | | | | | | | | | |
| Edge distance | | c _{min} | [mm] | 60 | | | | | | | | | | | | | | | | |
| Spacing | | s _{min} | | 80 | | | | | | | | | | | | | | | | |
| | | s _{cr} | | 3x h _{ef} | | | | | | | | | | | | | | | | |
| | | s _{min} ⊥ | | 3x h _{ef} | | | | | | | | | | | | | | | | |
| | | s _{cr} ⊥ | | 3xh _{ef} | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | | | | | |

Table C6.2: Group factors

| Anchor rod | | | M6 | M8 | M10 | M12 | M16 | - | | - | |
|--------------------------------|--------------------------|-----|-----|----|-----|-----|-----|-------|----|-------|-----|
| Internal threaded anchor FIS E | | | - | - | - | - | - | M6 | M8 | M10 | M12 |
| | | | | | | | | 11x85 | | 15x85 | |
| Group factor | $\alpha_{q,N} \parallel$ | [-] | 0,7 | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | 1,3 | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | 2,0 | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | 2,0 | | | | | | | | |

fischer injektion system FIS HT II masonry

Performances

Solid sand-lime brick KS, NF, dimensions, installation parameters

Annex C 6

Solid sand-lime brick KS, NF, EN 771-2

Table C7.1: Characteristic resistance under tensile load

| Anchor rod | | | M6 | | M8 | | M10 | | | M12 | | | M16 | | | - | | - | |
|--|-----------|-----|--|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-------|-----|-------|-----|
| Internal threaded anchor FIS E | | | - | | - | | - | | | - | | | - | | | M6 | M8 | M10 | M12 |
| | | | | | | | | | | | | | | | | 11x85 | | 15x85 | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | Effective anchorage depth h _{ef} [mm] | | | | | | | | | | | | | | | | |
| | | | 50 | 100 | 50 | 100 | 50 | 100 | 200 | 50 | 100 | 200 | 50 | 100 | 200 | 85 | 85 | | |
| 12N/mm ² | w/w | w/d | 2,0 | 3,0 | 2,5 | 4,5 | 2,5 | 3,5 | 7,0 | 2,5 | 3,0 | 6,5 | 2,5 | 3,5 | 8,0 | 2,5 | 2,5 | | |
| | d/d | | 4,0 | 5,5 | 4,0 | 8,0 | 4,0 | 5,5 | 12 | 4,0 | 4,5 | 12 | 4,5 | 5,5 | 12 | 4,0 | 4,0 | | |
| 20N/mm ² | w/w | w/d | 3,0 | 4,5 | 3,5 | 6,5 | 3,5 | 4,5 | 10 | 3,5 | 4,0 | 9,5 | 4,0 | 5,0 | 11 | 3,5 | 3,5 | | |
| | d/d | | 5,5 | 7,5 | 6,0 | 11 | 6,0 | 8,0 | 12 | 6,0 | 6,5 | 12 | 6,5 | 8,0 | 12 | 6,0 | 6,0 | | |
| 28N/mm ² | w/w | w/d | 3,5 | 5,0 | 4,0 | 8,0 | 4,5 | 5,5 | 12 | 4,5 | 5,0 | 11 | 4,5 | 5,5 | 12 | 4,5 | 4,5 | | |
| | d/d | | 6,5 | 9,0 | 7,0 | 12 | 7,0 | 9,0 | 12 | 7,0 | 7,5 | 12 | 7,5 | 9,5 | 12 | 7,0 | 7,0 | | |

Factor for temperature range 72/120°C: 0,83

Table C7.2: Characteristic resistance under shear load

| Anchor rod | | M6 | | M8 | | M10 | | M12 | | M16 | | - | | - | |
|---|-----------|-----|--|-----|-----|-----|-----|------|-----|------|-----|-------|-----|-------|-----|
| Internal threaded anchor FIS E | | - | | - | | - | | - | | - | | M6 | M8 | M10 | M12 |
| | | | | | | | | | | | | 11x85 | | 15x85 | |
| Shear load V _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | Effective anchorage depth h _{ef} [mm] | | | | | | | | | | | | |
| | | | 50 | 100 | 50 | 100 | 50 | ≥100 | 50 | ≥100 | 50 | ≥100 | 85 | 85 | |
| 12N/mm ² | w/w | w/d | 1,5 | 3,0 | 1,5 | 3,0 | 1,2 | 2,0 | 1,2 | 2,0 | 1,2 | 2,0 | 1,2 | 1,2 | |
| | d/d | | | | | | | | | | | | | | |
| 20N/mm ² | w/w | w/d | 2,5 | 4,0 | 2,5 | 4,0 | 1,5 | 3,0 | 1,5 | 3,0 | 1,5 | 3,0 | 1,5 | 1,5 | |
| | d/d | | | | | | | | | | | | | | |
| 28N/mm ² | w/w | w/d | 3,0 | 4,5 | 3,0 | 4,5 | 1,5 | 3,5 | 1,5 | 3,5 | 1,5 | 3,5 | 1,5 | 1,5 | |
| | d/d | | | | | | | | | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performances

Solid sand-lime brick KS, NF, Characteristic resistance under tensile and shear load

Annex C 7

Solid sand-lime brick KS, 8DF, EN 771-2

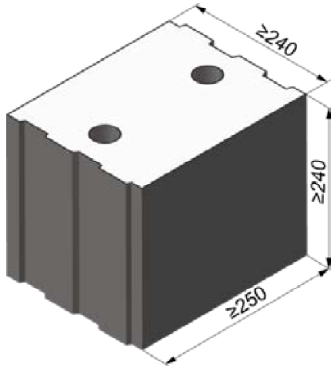

Solid sand-lime brick KS, 8DF, EN 771-2

| | | | |
|---|--------------|---------|----------|
| Producer | - | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | ≥ 250 | ≥ 240 | ≥ 240 |
| Density ρ [kg/dm ³] | ≥ 2,0 | | |
| Compressive strength f_b [N/mm ²] | 10 / 20 / 28 | | |
| Standard or annex | EN 771-2 | | |




Table C8.1: Installation parameters

| | | | | | | | | | | | | | | | | | | | | |
|--|--|---------------------|------|-----|-----|----|-----|----|-----|----|-----|----|-------|----|-------|----|-----|---|-----|--|
| Anchor rod | | | M6 | | M8 | | M10 | | M12 | | M16 | | - | | - | | | | | |
| Internal threaded anchor FIS E | | | - | | - | | - | | - | | - | | M6 | | M8 | | M10 | | M12 | |
| | | | | | | | | | | | | | 11x85 | | 15x85 | | | | | |
| Anchor rod and internal threaded anchor FIS E without perforated sleeve | | | | | | | | | | | | | | | | | | | | |
| Effective anchorage depth | | h_{ef} | [mm] | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 50 | 100 | 85 | | | | | | |
| Max. installation torque | | $T_{inst,max}$ | [Nm] | 4 | | 10 | | | | | | | | 4 | | 10 | | | | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H 16x85 K | | | | | | | | | | | | | | | | | | | | |
| Effective anchorage depth | | h_{ef} | [mm] | - | | 85 | | | | - | | | | 85 | | | | - | | |
| Max. installation torque | | $T_{inst,max}$ | [Nm] | | | 10 | | | | | | | | 4 | | 10 | | | | |
| General installation parameters | | | | | | | | | | | | | | | | | | | | |
| Edge distance | | c_{min} | [mm] | 60 | | | | | | | | | | | | | | | | |
| Spacing | | $s_{min} \parallel$ | | 80 | | | | | | | | | | | | | | | | |
| | | $s_{cr} \parallel$ | | 250 | | | | | | | | | | | | | | | | |
| | | $s_{min} \perp$ | | 80 | | | | | | | | | | | | | | | | |
| | | $s_{cr} \perp$ | | 240 | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | | | | | |

Table C8.2: Group factors

| Anchor rods | | | M6 | M8 | M10 | M12 | M16 | - | | - | |
|--------------------------------|--------------------------|-----|-----|----|-----|-----|-----|-------|----|-------|-----|
| Internal threaded anchor FIS E | | | - | - | - | - | - | M6 | M8 | M10 | M12 |
| | | | | | | | | 11x85 | | 15x85 | |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 1,5 | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | 1,2 | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | 1,5 | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | 1,2 | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Solid sand-lime brick KS, 8DF, dimensions, installation parameters

Annex C 8

Solid sand-lime brick KS, 8DF, EN 771-2

Table C9.1: Characteristic resistance under tensile load

| | | | | | | | | | | | | | | |
|--|-----------|-----|--|------|------|-------|------|-------|------|-------|------|-------|-----|-----|
| Anchor rod | M6 | M8 | M10 | M12 | M16 | - | | - | | M8 | M10 | - | | |
| Internal threaded anchor FIS E | - | - | - | - | - | M6 | M8 | M10 | M12 | - | - | M6 | M8 | |
| | | | | | | 11x85 | | 15x85 | | | | 11x85 | | |
| Perforated sleeve FIS H K | - | - | - | - | - | - | | - | | 16x85 | | | | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | Effective anchorage depth h _{ef} [mm] | | | | | | | | | | | |
| | | | ≥ 50 | | | | | 85 | | | | | | |
| 10N/mm ² | w/w | w/d | 3,0 | 4,0 | 4,5 | 4,5 | 3,5 | 3,0 | 3,5 | | 4,5 | | 3,0 | 4,5 |
| | d/d | | 5,0 | 7,0 | 7,0 | 7,0 | 5,5 | 5,0 | 5,5 | | 8,0 | | 5,0 | 8,0 |
| 20N/mm ² | w/w | w/d | 4,5 | 6,0 | 6,0 | 6,0 | 5,0 | 4,5 | 5,0 | | 6,5 | | 4,5 | 6,5 |
| | d/d | | 7,5 | 10,0 | 10,0 | 10,0 | 7,5 | 7,5 | 7,5 | | 11,0 | | 7,5 | 11 |
| 28N/mm ² | w/w | w/d | 5,0 | 8,0 | 8,5 | 8,5 | 7,0 | 5,0 | 7,0 | | 8,5 | | 5,0 | 8,5 |
| | d/d | | 8,5 | 12,0 | 12,0 | 12,0 | 11,0 | 8,5 | 11,0 | | 12,0 | | 8,5 | 12 |

Factor for temperature range 72/120°C: 0,83

Table C9.2: Characteristic resistance under shear load

| | | | | | | | | | | | | | |
|---|-----------|-----|---|-----|-----|-------|-----|-------|-----|-----|---|-------|-----|
| Anchor rod | M6 | M8 | M10 | M12 | M16 | - | - | M8 | M10 | - | | | |
| Internal threaded anchor FIS E | - | - | - | - | - | M6 | M8 | M10 | M12 | - | - | M6 | M8 |
| | | | | | | 11x85 | | 15x85 | | | | 11x85 | |
| Perforated sleeve FIS H K | - | - | - | - | - | - | - | 16x85 | | | | | |
| Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | |
| compressive strength f_b | condition | | Effective anchorage depth h_{ef} [mm] | | | | | | | | | | |
| | | | ≥ 50 | | | | | 85 | | | | | |
| 10N/mm ² | w/w | w/d | 2,5 | 4,5 | | | 2,5 | 4,5 | | 4,5 | | 2,5 | 4,5 |
| | d/d | | | | | | | | | | | | |
| 20N/mm ² | w/w | w/d | 4,0 | 6,5 | | | 4,0 | 6,5 | | 6,5 | | 4,0 | 6,5 |
| | d/d | | | | | | | | | | | | |
| 28N/mm ² | w/w | w/d | 5,0 | 9,0 | | | 5,0 | 9,0 | | 9,0 | | 5,0 | 9,0 |
| | d/d | | | | | | | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Solid sand-lime brick KS, 8DF, Characteristic resistance under tensile and shear load

Annex C 9

Perforated sand-lime brick KSL, 3DF, EN 771-2

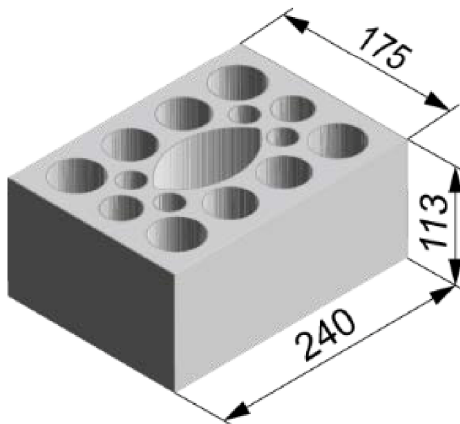

Perforated sand-lime brick KSL, 3DF, EN 771-2

| | | | |
|---|-----------------------|---------|----------|
| Producer | e.g. KS Wemding | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 240 | 175 | 113 |
| Density ρ [kg/dm ³] | $\geq 1,4$ | | |
| Compressive strength f_b [N/mm ²] | 8 / 10 / 12 / 16 / 20 | | |
| Standard or annex | EN 771-2 | | |




Tabelle C10.1: Installation parameters (Pre-positioned anchorage with perforated sleeve FIS HK)

| | | | | | | | | | | | | | | |
|---|-----------------------|-------|-------|-------|---|----|--------|-------|-----|---|--------|-----|-----|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | - | M6 | M8 | - | - | M10 | M12 | - | - | | | | |
| | | | 11x85 | 15x85 | | | | | | | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 16x85 | | | | 16x130 | 20x85 | | | 20x130 | | | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS HK | | | | | | | | | | | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 2 | | | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | |
| Edge distance | c _{min} | [mm] | 60 | | | | 80 | | | | | | | |
| Spacing | s _{min} | | 100 | | | | | | | | | | | |
| | s _{cr} | | 240 | | | | | | | | | | | |
| | s _{min} ⊥ | | 115 | | | | | | | | | | | |
| | s _{cr} ⊥ | | 115 | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | |

Table C10.2: Group factors

| | | | | | | | | | | | | | | | | | |
|--------------------------------|---|-------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Group factors | $\alpha_{q,N} \parallel = \alpha_{q,V} \parallel$ | [-] | 1,5 | | | | | | | | | | | | | | |
| | $\alpha_{q,N} \perp = \alpha_{q,V} \perp$ | | 2,0 | | | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Perforated sand-lime brick KSL, 3DF, dimensions, installation parameters

Annex C 10

Perforated sand-lime brick KSL, 3DF, EN 771-2

Table C11.1: Installation parameters
(Push through anchorage with perforated sleeve FIS HK)

| Anchor rod | | M10 | M12 | M16 |
|--|-----------------------|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Anchor rod with perforated sleeve FIS H K | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 2 | |
| General installation parameters | | | | |
| Edge distance | c _{min} | [mm] | 80 | |
| Spacing | s _{min} | | 100 | |
| | s _{cr} | | 240 | |
| | s _{min} ⊥ | | 115 | |
| | s _{cr} ⊥ | | 115 | |
| Drilling method | | | | |
| Hammer drilling with hard metal hammer drill | | | | |

Table C11.2: Group factors

| Anchor rod | | M10 | M12 | M16 |
|---------------------------|--------------------------|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 1,5 | |
| | $\alpha_{q,V} \parallel$ | | | |
| | $\alpha_{q,N} \perp$ | | 2,0 | |
| | $\alpha_{q,V} \perp$ | | | |

fischer injektion system FIS HT II masonry

Performance

Perforated sand-lime brick KSL, 3DF, dimensions, installation parameters

Annex C 11

Perforated sand-lime brick KSL, 3DF, EN 771-2

Table C12.1: Characteristic resistance under tensile load (Pre-positioned anchorage)

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|---|--------------|-------|-------|-------|-------|-------|--------|--------|--------|-------|-------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | - | - | M6 | M8 | - | - | - | M10 | M12 | - | - | - |
| | | | | | 11x85 | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x85 | 16x130 | 16x130 | 16x130 | 20x85 | 20x85 | 20x130 | 20x130 | 20x130 |
| Tensile load N_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | | | | | | | | | | | | |
| compressive strength f_b | use category | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 1,5 | | 2,0 | | 2,0 | | 2,0 | | 2,0 | | 2,0 | |
| | d/d | d/d | 1,5 | | 2,0 | | 2,5 | | 2,5 | | 2,5 | | 2,5 | |
| 10 N/mm ² | w/w | w/d | 2,0 | | 2,0 | | 2,5 | | 2,5 | | 2,5 | | 2,5 | |
| | d/d | d/d | 2,0 | | 2,5 | | 3,0 | | 3,0 | | 3,0 | | 3,0 | |
| 12 N/mm ² | w/w | w/d | 2,5 | | 2,5 | | 3,0 | | 3,0 | | 3,0 | | 3,0 | |
| | d/d | d/d | 2,5 | | 3,0 | | 3,5 | | 3,5 | | 3,5 | | 3,5 | |
| 16 N/mm ² | w/w | w/d | 3,0 | | 3,5 | | 4,5 | | 4,5 | | 4,5 | | 4,5 | |
| | d/d | d/d | 3,5 | | 4,0 | | 4,5 | | 4,5 | | 4,5 | | 4,5 | |
| 20 N/mm ² | w/w | w/d | 4,0 | | 4,5 | | 5,5 | | 5,5 | | 5,5 | | 5,5 | |
| | d/d | d/d | 4,5 | | 5,0 | | 6,0 | | 6,0 | | 6,0 | | 6,0 | |

Table C12.2: Characteristic resistance under tensile load (Push through anchorage)

| Anchor rod | | M10 | | M12 | | M16 | |
|--|--------------|------------|-----|-----|--|------------|--|
| Perforated sleeve FIS H K | | 18x130/200 | | | | 22x130/200 | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | |
| compressive strength f _b | use category | | | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | |
| | d/d | | 2,5 | | | | |
| 10 N/mm ² | w/w | w/d | 2,5 | | | | |
| | d/d | | 3,0 | | | | |
| 12 N/mm ² | w/w | w/d | 3,0 | | | | |
| | d/d | | 3,5 | | | | |
| 16 N/mm ² | w/w | w/d | 4,5 | | | | |
| | d/d | | 4,5 | | | | |
| 20 N/mm ² | w/w | w/d | 5,5 | | | | |
| | d/d | | 6,0 | | | | |

Factor for job site tests and displacements see annex C36

Factor for temperature range 72/120°C: 0,83

fischer injektion system FIS HT II masonry

Performance

Perforated sand-lime brick KSL, 3DF, Characteristic resistance under tensile load

Annex C 12

Perforated sand-lime brick KSL, 3DF, EN 771-2

Table C13.1: Characteristic resistance under shear load (Pre-positioned anchorage)

| | | | | | | | | | | | | | | | | |
|---|--------------|-----|-------|-----|-------|-----|-----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | |
| compressive strength f _b | use category | | | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 1,5 | | | | | 3,0 | | | | | 2,5 | 3,0 | 2,5 | |
| | d/d | | | | | | | | | | | | | | | |
| 10 N/mm ² | w/w | w/d | 2,0 | | | | | 3,5 | | | | | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 12 N/mm ² | w/w | w/d | 2,5 | | | | | 4,5 | | | | | 4,0 | 4,5 | 4,0 | |
| | d/d | | | | | | | | | | | | | | | |
| 16 N/mm ² | w/w | w/d | 3,0 | 3,5 | 3,0 | 3,5 | 3,0 | 6,0 | | | | | 5,5 | 6,0 | 5,5 | |
| | d/d | | | | | | | | | | | | | | | |
| 20 N/mm ² | w/w | w/d | 4,0 | 4,5 | 4,0 | 4,5 | 4,0 | 7,5 | | | | | 6,5 | 7,5 | 6,5 | |
| | d/d | | | | | | | | | | | | | | | |

Table C13.2: Characteristic resistance under shear load (Push through anchorage)

| Anchor rod | M10 | M12 | M16 |
|--|--------------|------------|------------|
| Perforated sleeve FIS H K | 18x130/200 | 18x130/200 | 22x130/200 |
| Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | |
| compressive strength f_b | use category | | |
| 8 N/mm ² | w/w | w/d | 3,0 |
| | d/d | d/d | |
| 10 N/mm ² | w/w | w/d | 3,5 |
| | d/d | d/d | |
| 12 N/mm ² | w/w | w/d | 4,5 |
| | d/d | d/d | |
| 16 N/mm ² | w/w | w/d | 6,0 |
| | d/d | d/d | |
| 20 N/mm ² | w/w | w/d | 7,5 |
| | d/d | d/d | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performances

Perforated sand-lime brick KSL, 3DF, Characteristic resistance under shear load

Annex C 13

Vertical perforated brick HLz, form B, EN 771-1

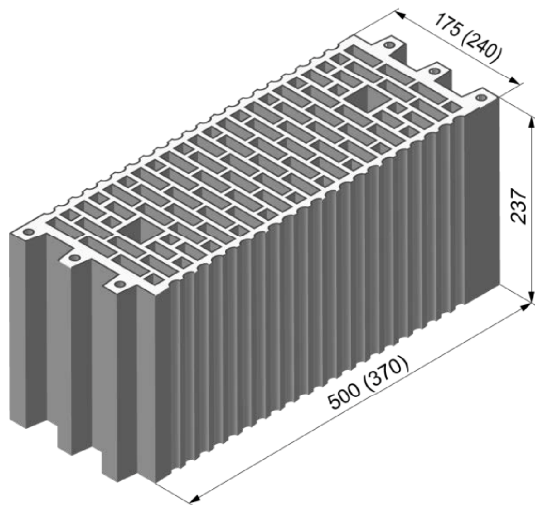

Vertical perforated brick HLz, form B, EN 771-1

| | | | |
|---|----------------------------|---------|----------|
| Producer | e.g. Wienerberger, Poroton | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 500 | 175 | 237 |
| | 370 | 240 | 237 |
| Density ρ [kg/dm ³] | $\geq 1,0$ | | |
| Compressive strength f_b [N/mm ²] | 4 / 6 / 8 / 10 / 12 | | |
| Standard or annex | EN 771-1 | | |

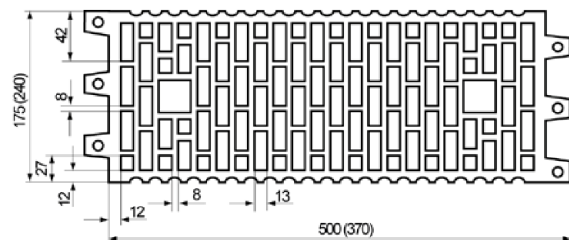


Table C14.1: Installation parameters

| | | | | | | | | | | | | | | | | | |
|--|--|----------------------------|----|---------|----|-----------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | | | | | | |
| Max. installation torque | | T _{inst,max} [Nm] | | 2 | | | | | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | | | | |
| Edge distance | | c _{min} | | II [mm] | | 100 | | | | | | | | | | | |
| Spacing | | s _{min} | | | | 100 | | | | | | | | | | | |
| | | s _{cr} | | | | 500 (370) | | | | | | | | | | | |
| | | s _{min} ⊥ | | | | 100 | | | | | | | | | | | |
| | | s _{cr} ⊥ | | | | 240 | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | | |

Table C14.2: Group factors

| | | | | | | | | | | | | | | |
|---|-------|-------|-------|-------|-------|--------|-------|--------|-----|-------|-----|-----|-----|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | - | - | - | M6 | M8 | - | - | - | M10 | M12 | - | - | - |
| | | | | | 11x85 | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x130 | 20x85 | 20x130 | | | | | | |
| Group factors $\alpha_{q,N} \parallel = \alpha_{q,V} \parallel$ | 1 | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 14

Vertical perforated brick HLz, form B, EN 771-1

Table C15.1: Characteristic resistance under tensile load

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|---|-----------|-------|-------|-------|----------------|--------|--------|--------|--------|------------------|-------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | - | - | M6 M8 11x85 | - | - | - | - | M10 M12 15x85 | - | - | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x130 | 16x130 | 16x130 | 16x130 | 20x85 | 20x85 | 20x130 | 20x130 | 20x130 |
| Tensile load N_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | | | | | | | | | | | | |
| compressive strength f_b | condition | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,3 | | 0,9 | | | | | | 1,2 | | | |
| | d/d | d/d | 0,4 | | 0,9 | | | | | | 1,2 | | | |
| 6 N/mm ² | w/w | w/d | 0,5 | | 1,5 | | | | | | 2,0 | | | |
| | d/d | d/d | 0,6 | | 1,5 | | | | | | 2,0 | | | |
| 8 N/mm ² | w/w | w/d | 0,75 | | 2,0 | | | | | | 2,5 | | | |
| | d/d | d/d | 0,75 | | 2,0 | | | | | | 2,5 | | | |
| 10 N/mm ² | w/w | w/d | 0,9 | | 2,5 | | | | | | 3,0 | | | |
| | d/d | d/d | 0,9 | | 2,5 | | | | | | 3,5 | | | |
| 12 N/mm ² | w/w | w/d | 0,9 | | 3,0 | | | | | | 3,5 | | | |
| | d/d | d/d | 1,2 | | 3,0 | | | | | | 4,0 | | | |

Factor for temperature range 72/120°C: 0,83

Table C15.2: Characteristic resistance under shear load

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|--|-----------|-------|-------|-------|----------------|--------|--------|--------|--------|------------------|-------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | - | - | M6 M8 11x85 | - | - | - | - | M10 M12 15x85 | - | - | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x130 | 16x130 | 16x130 | 16x130 | 20x85 | 20x85 | 20x130 | 20x130 | 20x130 |
| Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | |
| compressive strength f_b | condition | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,5 | | 0,6 | | | | 0,5 | | | 0,6 | | |
| | d/d | d/d | 0,5 | | 0,6 | | | | 0,5 | | | 0,6 | | |
| 6 N/mm ² | w/w | w/d | 0,75 | | 0,9 | | | | 0,75 | | | 0,9 | | |
| | d/d | d/d | 0,75 | | 0,9 | | | | 0,75 | | | 0,9 | | |
| 8 N/mm ² | w/w | w/d | 0,9 | | 1,2 | | | | 0,9 | | | 1,2 | | |
| | d/d | d/d | 0,9 | | 1,2 | | | | 0,9 | | | 1,2 | | |
| 10 N/mm ² | w/w | w/d | 1,2 | | 1,5 | | | | 1,2 | | | 1,5 | | |
| | d/d | d/d | 1,2 | | 1,5 | | | | 1,2 | | | 1,5 | | |
| 12 N/mm ² | w/w | w/d | 1,5 | | 2,0 | | | | 1,5 | | | 2,0 | | |
| | d/d | d/d | 1,5 | | 2,0 | | | | 1,5 | | | 2,0 | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B,
Characteristic resistance under tensile and shear load

Annex C 15

Vertical perforated brick HLz, 2DF, EN 771-1

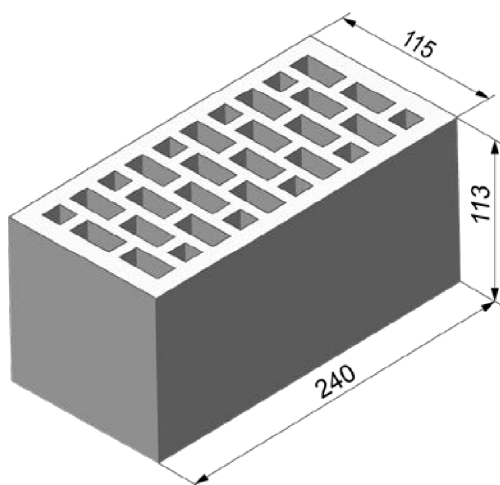

Vertical perforated brick HLz, 2DF, EN 771-1

| | | | |
|---|-----------------------|---------|----------|
| Producer | e.g. Wienerberger | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 240 | 115 | 113 |
| Density ρ [kg/dm ³] | $\geq 1,4$ | | |
| Compressive strength f_b [N/mm ²] | 6 / 10 / 16 / 20 / 28 | | |
| Standard or annex | EN 771-1 | | |

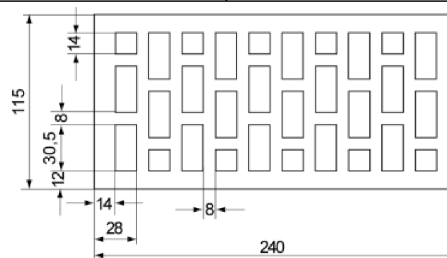


Table C16.1: Installation parameters

| | | | | | | | | | | | | |
|--|--|------|-------|----|-------|----|----|-----|-------|-----|-----|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | - | | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | M10 | M12 | - | |
| | | | | | 11x85 | | | | 15x85 | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 20x85 | | | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 2 | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | |
| Edge distance | c _{min} | [mm] | 80 | | | | | | | | | |
| Spacing | s _{cr} = s _{min} | | 240 | | | | | | | | | |
| | s _{cr} ⊥ = s _{min} ⊥ | | 115 | | | | | | | | | |
| Drilling method | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | |

Table C16.2: Group factors

| | | | | | | | | | | | | | |
|--------------------------------|--------------------------|-------|----|-------|----|-------|----|----|-----|-------|-----|-----|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | - | | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | M10 | M12 | - | |
| | | | | | | 11x85 | | | | 15x85 | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 20x85 | | | |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 2 | | | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | | | | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | | | | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performances

Vertical perforated brick HLz, 2DF, dimensions, installation parameters

Annex C 16

Vertical perforated brick HLz, 2DF, EN 771-1

Table C17.1: Characteristic resistance under tensile load

| Anchor rod | | | M6 | M8 | M6 | M8 | - | | M8 | M10 | - | | M12 | M16 | |
|--|--|-----------|-------|------|-------|-----|-------|------|----|-----|-------|-----|-----|-----|--|
| Internal threaded anchor FIS E | | | - | | - | | M6 | M8 | - | | M10 | M12 | - | | |
| | | | | | | | 11x85 | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | | | 12x50 | | 12x85 | | 16x85 | | | | 20x85 | | | | |
| Tensile load N _{rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | | | | | |
| compressive strength f _b | | condition | | | | | | | | | | | | | |
| 6 N/mm ² | | w/w | w/d | 0,75 | | 0,9 | | 0,75 | | | | 0,9 | | | |
| | | d/d | | 0,75 | | 1,2 | | 0,75 | | | | 0,9 | | | |
| 10 N/mm ² | | w/w | w/d | 1,2 | | 1,5 | | 1,2 | | | | 1,5 | | | |
| | | d/d | | 1,2 | | 2,0 | | 1,2 | | | | 1,5 | | | |
| 16 N/mm ² | | w/w | w/d | 2,0 | | 2,5 | | 2,0 | | | | 2,0 | | | |
| | | d/d | | 2,0 | | 3,0 | | 2,0 | | | | 2,5 | | | |
| 20 N/mm ² | | w/w | w/d | 2,5 | | 3,5 | | 2,5 | | | | 3,0 | | | |
| | | d/d | | 2,5 | | 4,0 | | 2,5 | | | | 3,0 | | | |
| 28 N/mm ² | | w/w | w/d | 3,0 | | 5,0 | | 3,5 | | | | 4,0 | | | |
| | | d/d | | 3,5 | | 5,5 | | 3,5 | | | | 4,5 | | | |

Factor for temperature range 72/120°C: 0,83

Table C17.2: Characteristic resistance under shear load

| | | | | | | | | | | | | |
|---|-----------|-----|-------|-----|-------|-----|-----|-----|-------|-----|-----|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | - | | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | M10 | M12 | - | |
| | | | | | 11x85 | | | | 15x85 | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 20x85 | | | |
| Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | |
| compressive strength f_b | condition | | | | | | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,2 | 1,5 | 1,2 | 2,0 | 1,2 | 1,5 | 2,5 | | | |
| | d/d | | | | | | | | | | | |
| 10 N/mm ² | w/w | w/d | 2,0 | 2,5 | 2,0 | 4,0 | 2,0 | 2,5 | 4,5 | | | |
| | d/d | | | | | | | | | | | |
| 16 N/mm ² | w/w | w/d | 3,0 | 3,5 | 3,0 | 6,0 | 3,0 | 3,5 | 7,0 | | | |
| | d/d | | | | | | | | | | | |
| 20 N/mm ² | w/w | w/d | 4,0 | 4,5 | 4,0 | 7,5 | 4,0 | 4,5 | 8,5 | | | |
| | d/d | | | | | | | | | | | |
| 28 N/mm ² | w/w | w/d | 5,0 | 6,5 | 5,0 | 9,5 | 5,0 | 6,5 | 12,0 | | | |
| | d/d | | | | | | | | | | | |


Factor for job site tests and displacements see annex C36

fischer injektion system FIS HT II masonry


Performance

Vertical perforated brick HLz, 2DF,
Characteristic resistance under tensile and shear load

Annex C 17

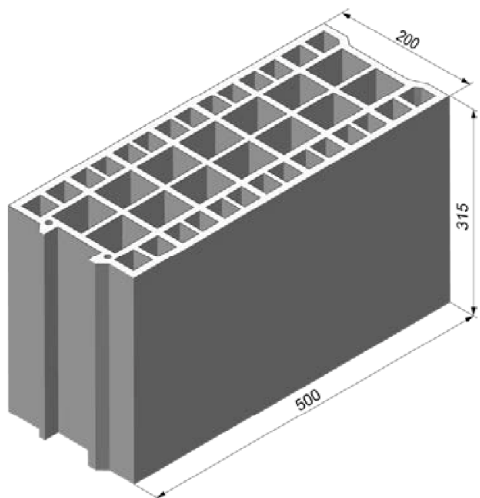

| Vertical perforated brick HLz, form B, EN 771-1 | | | |
|---|--------------------|---------|----------|
| Producer | e.g. Bouyer Leroux | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 500 | 200 | 315 |
| Density ρ [kg/dm ³] | ≥ 0,6 | | |
| Compressive strength f_b [N/mm ²] | 4 / 6 / 8 | | |
| Standard or annex | EN 771-1 | | |

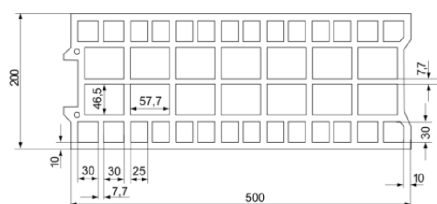

| | | | | | | | | | | | | | | | | | |
|--|--|-------|----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | | | | | | |
| Max. installation torque $T_{\text{inst,max}}$ | | [Nm] | | 2 | | | | | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | | | | |
| Edge distance c_{min} | | [mm] | | 120 | | | | | | | | | | | | | |
| $s_{\text{min}} \parallel$ | | | | 120 | | | | | | | | | | | | | |
| Spacing $s_{\text{cr}} \parallel$ | | | | 500 | | | | | | | | | | | | | |
| $s_{\text{min}} \perp = s_{\text{cr}} \perp$ | | | | 315 | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | |
|-----------------------------------|---|-------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|--------|-----|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | 20x130 | | |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 1,3 | | | | | | | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | 1,7 | | | | | | | | | | | | | | |
| | $\alpha_{q,N} \perp = \alpha_{q,V} \perp$ | | 2 | | | | | | | | | | | | | | |

Annex C 18

Vertical perforated brick HLz, form B, EN 771-1

Table C19.1: Installation parameters
(Push through anchorage with perforated sleeve FIS HK)

| Anchor rod | | M10 | M12 | M16 |
|--|--|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Anchor rod with perforated sleeve FIS H K | | | | |
| Max. installation torque | $T_{\text{inst,max}}$ | [Nm] | 2 | |
| General installation parameters | | | | |
| Edge distance | c_{min} | [mm] | 120 | |
| Spacing | $s_{\text{min}} \parallel$ | | 120 | |
| | $s_{\text{cr}} \parallel$ | | 500 | |
| | $s_{\text{min}} \perp = s_{\text{cr}} \perp$ | | 315 | |
| Drilling method | | | | |
| Hammer drilling with hard metal hammer drill | | | | |

Table C19.2: Group factors

| Anchor rod | | M10 | M12 | M16 |
|---------------------------|---|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Group factors | $\alpha_{g,N}$ II | [-] | 1,3 | |
| | $\alpha_{g,V}$ II | | 1,7 | |
| | $\alpha_{g,N} \perp = \alpha_{g,V} \perp$ | | 2 | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 19

Vertical perforated brick HLz, form B, EN 771-1

Table C20.1: Characteristic resistance under tensile load (Pre-positioned anchorage)

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|---|-----------|-------|-------|-------|-------|--------|--------|--------|--------|-------|-------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | - | - | M6 | M8 | - | - | - | M10 | M12 | - | - | - |
| | | | | | 11x85 | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x130 | 16x130 | 16x130 | 16x130 | 20x85 | 20x85 | 20x130 | 20x130 | 20x130 |
| Tensile load N_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | | | | | | | | | | | | |
| compressive strength f_b | condition | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,5 | 1,5 | 0,75 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 |
| | d/d | d/d | 0,6 | 1,5 | 0,9 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 | 1,5 |
| 6 N/mm ² | w/w | w/d | 0,75 | 2,0 | 1,2 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 |
| | d/d | d/d | 0,9 | 2,5 | 1,2 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 |
| 8 N/mm ² | w/w | w/d | 0,9 | 3,0 | 1,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 |
| | d/d | d/d | 1,2 | 3,0 | 2,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 |

Table C20.2: Characteristic resistance under tensile load (Push through anchorage)

| Anchor rod | M10 | M12 | M16 |
|---|------------|------------|------------|
| Perforated sleeve FIS H K | 18x130/200 | 18x130/200 | 22x130/200 |
| Tensile load N_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | |
| compressive strength f_b | condition | | |
| 4 N/mm ² | w/w | w/d | 0,75 |
| | d/d | d/d | 0,9 |
| 6 N/mm ² | w/w | w/d | 1,2 |
| | d/d | d/d | 1,2 |
| 8 N/mm ² | w/w | w/d | 1,5 |
| | d/d | d/d | 2,0 |

Factor for job site tests and displacements see annex C36

Factor for temperature range 72/120°C: 0,83

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, Characteristic resistance under tensile load

Annex C 20

Vertical perforated brick HLz, form B, EN 771-1

Table C21.1: Characteristic resistance under shear load (Pre-positioned anchorage)

| | | | | | | | | | | | | | | | | |
|---|-----------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 1,5 | | | | | | 0,9 | | 1,5 | | 2,5 | | 0,9 | |
| | d/d | | | | | | | | | | | | | | | |
| 6 N/mm ² | w/w | w/d | 2,5 | | | | | | 1,5 | | 2,5 | | 3,5 | | 1,5 | |
| | d/d | | | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 3,5 | | | | | | 2,0 | | 3,5 | | 4,5 | | 2,0 | |
| | d/d | | | | | | | | | | | | | | | |

Table C21.2: Characteristic resistance under shear load (Push through anchorage)

| | | | | | | | |
|---|-----------|------------|-----|-----|--|------------|--|
| Anchor rod | | M10 | | M12 | | M16 | |
| Perforated sleeve FIS H K | | 18x130/200 | | | | 22x130/200 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | |
| compressive strength f _b | condition | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,9 | | | | |
| | d/d | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | | |
| | d/d | | | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | |
| | d/d | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, Characteristic resistance under shear load

Annex C 21

Vertical perforated brick HLz, form B, EN 771-1

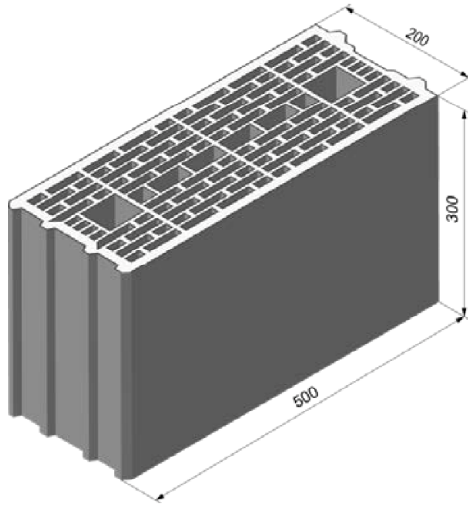

| Vertical perforated brick HLz, form B, EN 771-1 | | | |
|---|-------------------|---------|----------|
| Producer | e.g. Wienerberger | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 500 | 200 | 300 |
| Density ρ [kg/dm ³] | $\geq 0,7$ | | |
| Compressive strength f_b [N/mm ²] | 4 / 6 / 8 / 10 | | |
| Standard or annex | EN 771-1 | | |

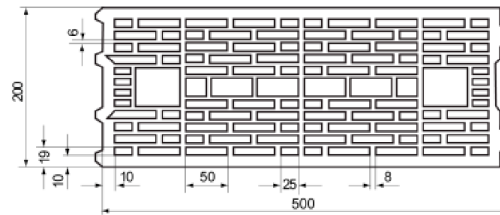


Table C22.1: Installation parameters
(Pre-positioned anchorage with perforated sleeve FIS HK)

| | | | | | | | | | | | | | | | | |
|--|--|------|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | -- | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 2 | | | | | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | | | |
| Edge distance | c _{min} | [mm] | 50 | | | | | | 80 | | | | 50 | 80 | | |
| Spacing | s _{min} | | 100 | | | | | | | | | | | | | |
| | s _{cr} | | 500 | | | | | | | | | | | | | |
| | s _{min} ⊥ = s _{cr} ⊥ | | 300 | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | |

Table C22.2: Group factors

| | | | | | | | | | | | | | | | | | |
|--------------------------------|---|-------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Group factors | $\alpha_{q,N}$ II | [-] | 1,4 | | | | | | | | | | | | | | |
| | $\alpha_{q,V}$ II | | 2 | | | | | | | | | | | | | | |
| | $\alpha_{q,N} \perp = \alpha_{q,V} \perp$ | | | | | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 22

Vertical perforated brick HLz, form B, EN 771-1

Table C23.1: Installation parameters
(Push through anchorage with perforated sleeve FIS HK)

| Anchor rod | | M10 | M12 | M16 |
|--|--|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Anchor rod with perforated sleeve FIS H K | | | | |
| Max. installation torque | $T_{\text{inst,max}}$ | [Nm] | 2 | |
| General installation parameters | | | | |
| Edge distance | c_{min} | [mm] | 80 | |
| Spacing | $s_{\text{min}} \parallel$ | | 100 | |
| | $s_{\text{cr}} \parallel$ | | 500 | |
| | $s_{\text{min}} \perp = s_{\text{cr}} \perp$ | | 300 | |
| Drilling method | | | | |
| Hammer drilling with hard metal hammer drill | | | | |

Table C23.2: Group factors

| Anchor rod | | M10 | M12 | M16 |
|---------------------------|---|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 1,4 | |
| | $\alpha_{q,V} \parallel$ | | 2 | |
| | $\alpha_{q,N} \perp = \alpha_{q,V} \perp$ | | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 23

Vertical perforated brick HLz, form B, EN 771-1

Table C24.1: Characteristic resistance under tensile load (Pre-positioned anchorage)

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|---|-----------|-------|-------|-------|----------------|--------|--------|--------|--------|------------------|-------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | - | - | M6 M8 11x85 | - | - | - | - | M10 M12 15x85 | - | - | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 12x85 | 16x85 | 16x130 | 16x130 | 16x130 | 16x130 | 20x85 | 20x85 | 20x130 | 20x130 | 20x130 |
| Tensile load N_{RK} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | | | | | | | | | | | | |
| compressive strength f_b | condition | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,5 | | 0,6 | | 1,2 | | 0,75 | | 1,5 | | | |
| | d/d | | 0,6 | | 0,75 | | 1,2 | | 0,9 | | 1,5 | | | |
| 6 N/mm ² | w/w | w/d | 0,75 | | 0,9 | | 1,5 | | 1,2 | | 2,0 | | | |
| | d/d | | 0,9 | | 1,2 | | 2,0 | | 1,2 | | 2,5 | | | |
| 8 N/mm ² | w/w | w/d | 0,9 | | 1,2 | | 2,0 | | 1,5 | | 2,5 | | | |
| | d/d | | 1,2 | | 1,5 | | 2,5 | | 1,5 | | 3,0 | | | |
| 10 N/mm ² | w/w | w/d | 1,2 | | 1,5 | | 2,5 | | 2,0 | | 3,5 | | | |
| | d/d | | 1,5 | | 2,0 | | 3,0 | | 2,0 | | 4,0 | | | |

Table C24.2: Characteristic resistance under tensile load (Push through anchorage)

| Anchor rod | M10 | M12 | M16 |
|---|------------|------------|------------|
| Perforated sleeve FIS H K | 18x130/200 | 18x130/200 | 22x130/200 |
| Tensile load N_{RK} [kN] depending on the compressive strength f_b (temperature range 50/80°C) | | | |
| compressive strength f_b | condition | | |
| 4 N/mm ² | w/w | w/d | 1,2 |
| | d/d | | 1,2 |
| 6 N/mm ² | w/w | w/d | 1,5 |
| | d/d | | 2,0 |
| 8 N/mm ² | w/w | w/d | 2,0 |
| | d/d | | 2,5 |
| 10 N/mm ² | w/w | w/d | 2,5 |
| | d/d | | 3,0 |

Factor for job site tests and displacements see annex C36

Factor for temperature range 72/120°C: 0,83

fischer injektion system FIS HT II masonry

Performances

Vertical perforated brick HLz, form B, Characteristic resistance under tensile load

Annex C 24

Vertical perforated brick HLz, form B, EN 771-1

Table C25.1: Characteristic resistance under shear load (Pre-positioned anchorage)

| | | | | | | | | | | | | | | | | |
|---|-----------|-----|-------|-----|-------|-----|-----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,9 | 1,2 | 0,9 | 1,2 | 0,6 | 2,0 | 0,6 | | | | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,2 | 1,5 | 1,2 | 1,5 | 0,9 | 3,0 | 0,9 | | | | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 1,5 | 2,0 | 1,5 | 2,0 | 1,2 | 4,0 | 1,2 | | | | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 10 N/mm ² | w/w | w/d | 2,0 | 3,0 | 2,0 | 3,0 | 1,5 | 5,0 | 1,5 | | | | | | | |
| | d/d | | | | | | | | | | | | | | | |

Table C25.2: Characteristic resistance under shear load (Push through anchorage)

| Anchor rod | | M10 | | M12 | | M16 | |
|---|-----------|------------|-----|-----|--|------------|--|
| Perforated sleeve FIS H K | | 18x130/200 | | | | 22x130/200 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | |
| compressive strength f _b | condition | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,6 | | | | |
| | d/d | | | | | | |
| 6 N/mm ² | w/w | w/d | 0,9 | | | | |
| | d/d | | | | | | |
| 8 N/mm ² | w/w | w/d | 1,2 | | | | |
| | d/d | | | | | | |
| 10 N/mm ² | w/w | w/d | 1,5 | | | | |
| | d/d | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, Characteristic resistance under shear load

Annex C 25

Vertical perforated brick HLz, form B, EN 771-1

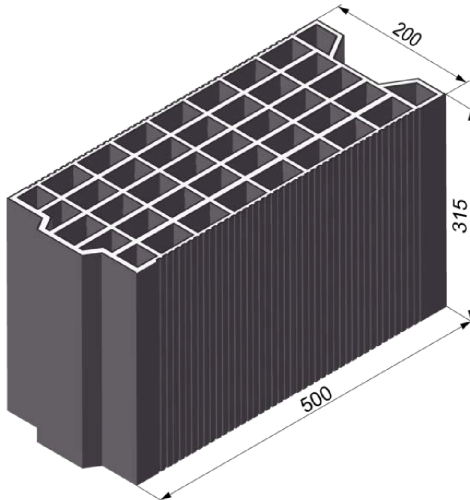

| Vertical perforated brick HLz, form B, EN 771-1 | | | |
|---|---------------|---------|----------|
| Producer | e.g. Terreal | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 500 | 200 | 315 |
| Density ρ [kg/dm ³] | $\geq 0,7$ | | |
| Compressive strength f_b [N/mm ²] | 2 / 4 / 6 / 8 | | |
| Standard or annex | EN 771-1 | | |

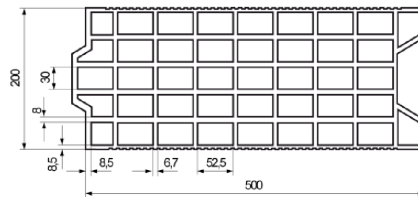


Table C26.1: Installation parameters
(Pre-positioned anchorage with perforated sleeve FIS HK)

| | | | | | | | | | | | | | | | | |
|--|-----------------------|------|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 2 | | | | | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | | | |
| Edge distance | c _{min} | [mm] | 50 | | | | | | 80 | | 50 | | | | 80 | |
| Spacing | s _{min} II | | 100 | | | | | | | | | | | | | |
| | s _{cr} II | | 500 | | | | | | | | | | | | | |
| | s _{min} ⊥ | | 100 | | | | | | | | | | | | | |
| | s _{cr} ⊥ | | 315 | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | |

Table C26.2: Group factors

| | | | | | | | | | | | | | | | | | |
|--------------------------------|--------------------------|-------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 1,1 | | | | | | | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | 1,2 | | | | | | | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | 1,1 | | | | | | | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | 1,2 | | | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 26

Vertical perforated brick HLz, form B, EN 771-1

Table C27.1: Installation parameters
(Push through anchorage with perforated sleeve FIS HK)

| Anchor rod | | M10 | M12 | M16 |
|--|----------------------------|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Anchor rod with perforated sleeve FIS H K | | | | |
| Max. installation torque | $T_{\text{inst,max}}$ | [Nm] | 2 | |
| General installation parameters | | | | |
| Edge distance | c_{min} | [mm] | 80 | |
| Spacing | $s_{\text{min}} \parallel$ | | 100 | |
| | $s_{\text{cr}} \parallel$ | | 500 | |
| | $s_{\text{min}} \perp$ | | 100 | |
| | $s_{\text{cr}} \perp$ | | 315 | |
| Drilling method | | | | |
| Hammer drilling with hard metal hammer drill | | | | |

Table C27.2: Group factors

| Anchor rod | | M10 | M12 | M16 |
|---------------------------|--------------------------|------------|-----|------------|
| Perforated sleeve FIS H K | | 18x130/200 | | 22x130/200 |
| Group factors | $\alpha_{q,N} \parallel$ | 1,1 | | |
| | $\alpha_{q,V} \parallel$ | 1,2 | | |
| | $\alpha_{q,N} \perp$ | 1,1 | | |
| | $\alpha_{q,V} \perp$ | 1,2 | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 27

Vertical perforated brick HLz, form B, EN 771-1

Table C28.1: Characteristic resistance under tensile load (Pre-positioned anchorage)

| | | | | | | | | | | | | | | | | |
|--|-----------|-----|-------|----|-------|----|----|-----|--------|-----|-------|-----|-----|-----|--------|-----|
| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | | | | | | | | |
| 2 N/mm ² | w/w | w/d | 0,5 | | | | | | | | | | | | | |
| | d/d | | 0,5 | | | | | | 0,6 | | 0,5 | | | | 0,6 | |
| 4 N/mm ² | w/w | w/d | 0,9 | | | | | | | | | | | | | |
| | d/d | | 0,9 | | 1,2 | | | | | | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | | | | | | | | | | | |
| | d/d | | 1,5 | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | | | | | | | | | | |
| | d/d | | 2,0 | | | | | | | | | | | | | |

Table C28.2: Characteristic resistance under tensile load (Push through anchorage)

| | | | | | | | |
|--|-----------|------------|-----|-----|--|------------|--|
| Anchor rod | | M10 | | M12 | | M16 | |
| Perforated sleeve FIS H K | | 18x130/200 | | | | 22x130/200 | |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | |
| compressive strength f _b | condition | | | | | | |
| 2 N/mm ² | w/w | w/d | 0,5 | | | | |
| | d/d | | 0,6 | | | | |
| 4 N/mm ² | w/w | w/d | 0,9 | | | | |
| | d/d | | 1,2 | | | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | | |
| | d/d | | 1,5 | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | |
| | d/d | | 2,0 | | | | |

Factor for job site tests and displacements see annex C36

Factor for temperature range 72/120°C: 0,83

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, Characteristic resistance under tensile load

Annex C 28

Vertical perforated brick HLz, form B, EN 771-1

Table C29.1: Characteristic resistance under shear load (Pre-positioned anchorage)

| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | - | | M12 | M16 | M12 | M16 |
|---|-----------|-----|-------|-----|-------|-----|----|-----|--------|-----|-------|------|-----|-----|--------|-----|
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | M10 | M12 | - | | - | |
| | | | | | 11x85 | | | | | | 15x85 | | | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 20x85 | | | | 20x130 | |
| Shear load V _{RK} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | | | | | | | | |
| 2 N/mm ² | w/w | w/d | 0,3 | 0,6 | 0,3 | 0,6 | | 0,6 | | 0,9 | | 0,75 | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,75 | 1,2 | 0,75 | 1,2 | | 1,2 | | 2,0 | | 1,5 | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 6 N/mm ² | w/w | w/d | 0,9 | 2,0 | 0,9 | 2,0 | | 1,5 | | 3,0 | | 2,0 | | | | |
| | d/d | | | | | | | | | | | | | | | |
| 8 N/mm ² | w/w | w/d | 1,5 | 2,5 | 1,5 | 2,5 | | 2,0 | | 4,0 | | 3,0 | | | | |
| | d/d | | | | | | | | | | | | | | | |

Table C29.2: Characteristic resistance under shear load (Push through anchorage)

| | | | | | | | |
|---|-----------|------------|-----|-----|--|------------|--|
| Anchor rod | | M10 | | M12 | | M16 | |
| Perforated sleeve FIS H K | | 18x130/200 | | | | 22x130/200 | |
| Shear load V_{RK} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C) | | | | | | | |
| compressive strength f_b | condition | | | | | | |
| 2 N/mm ² | w/w | w/d | 0,6 | | | 0,75 | |
| | d/d | | | | | | |
| 4 N/mm ² | w/w | w/d | 1,2 | | | 1,5 | |
| | d/d | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | 2,0 | |
| | d/d | | | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | 3,0 | |
| | d/d | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, Characteristic resistance under shear load

Annex C 29

Vertical perforated brick HLz, form B, EN 771-1

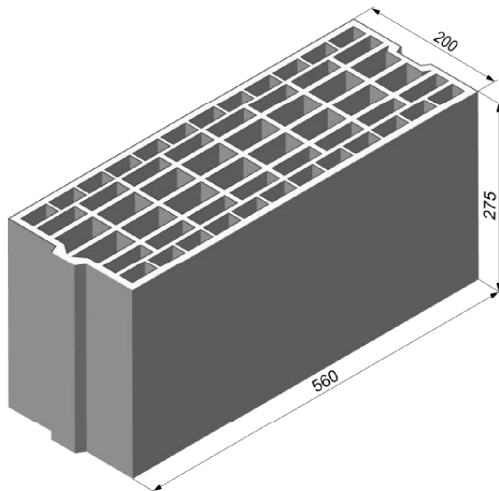

| Vertical perforated brick HLz, form B, EN 771-1 | | | |
|---|------------|---------|----------|
| Producer | e.g. Imery | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 560 | 200 | 275 |
| Density ρ [kg/dm ³] | $\geq 0,7$ | | |
| Compressive strength f_b [N/mm ²] | 4 / 6 / 8 | | |
| Standard or annex | EN 771-1 | | |

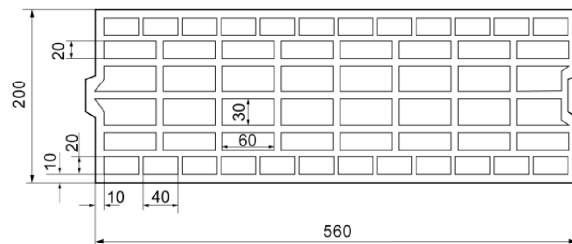


Table C30.1: Installation parameters

| Anchor rod | | M8 | M10 | M10 | M12 | M12 | M16 | M16 |
|--|--|--------|-----|------------|-----|--------|-----|------------|
| Perforated sleeve FIS H K | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 |
| Anchor rod with perforated sleeve FIS H K | | | | | | | | |
| Max. installation torque | $T_{inst,max}$ | [Nm] | 2 | | | | | |
| General installation parameters | | | | | | | | |
| Edge distance | c_{min} | [mm] | 80 | | | | | |
| Spacing | $s_{min} \parallel = s_{cr} \parallel$ | | 560 | | | | | |
| | $s_{min} \perp = s_{cr} \perp$ | | 275 | | | | | |
| Drilling method | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | |

Table C30.2: Group factors

| Anchor rod | | M8 | M10 | M10 | M12 | M12 | M16 | M16 |
|---------------------------|--------------------------|--------|-----|------------|-----|--------|-----|------------|
| Perforated sleeve FIS H K | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 2 | | | | | |
| | $\alpha_{q,V} \parallel$ | | | | | | | |
| | $\alpha_{q,N} \perp$ | | | | | | | |
| | $\alpha_{q,V} \perp$ | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B, dimensions, installation parameters

Annex C 30

Vertical perforated brick HLz, form B, EN 771-1

Table C31.1: Characteristic resistance under tensile load

| Anchor rod | | | M8 | M10 | M10 | M12 | M12 | M16 | M16 |
|--|-----------|-----|--------|-----|------------|-----|--------|-----|------------|
| Perforated sleeve FIS H K | | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,9 | | | | 1,2 | | |
| | d/d | | 1,2 | | | | 1,5 | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | | 2,0 | | |
| | d/d | | 1,5 | | | | 2,0 | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | 2,5 | | |
| | d/d | | 2,5 | | | | 3,0 | | |

Factor for temperature range 72/120°C: 0,83

Table C31.2: Characteristic resistance under shear load

| Anchor rod | | M8 | M10 | M10 | M12 | M12 | M16 | M16 |
|---|-----------|--------|-----|------------|-----|--------|-----|------------|
| Perforated sleeve FIS H K | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 |
| Shear load V _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | |
| compressive strength f _b | condition | | | | | | | |
| 4 N/mm ² | w/w | w/d | 0,9 | | | | | |
| | d/d | | | | | | | |
| 6 N/mm ² | w/w | w/d | 1,5 | | | | | |
| | d/d | | | | | | | |
| 8 N/mm ² | w/w | w/d | 2,0 | | | | | |
| | d/d | | | | | | | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Vertical perforated brick HLz, form B,
Characteristic resistance under tensile and shear load

Annex C 31

Light-weight concrete hollow block Hbl, EN 771-3

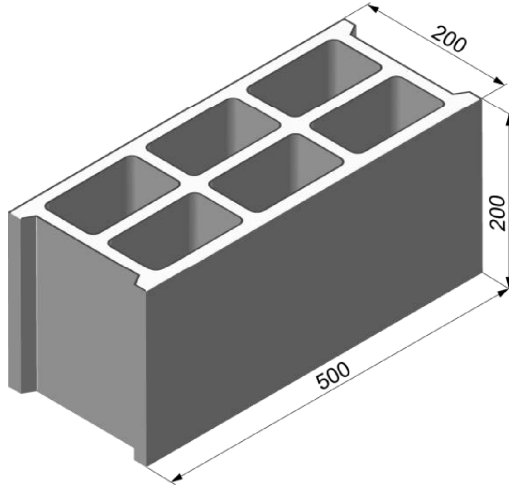

| Light-weight concrete hollow block Hbl, EN 771-3 | | | |
|--|-------------------|---------|----------|
| Producer | e.g. Sepa Papaing | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | 500 | 200 | 200 |
| Density ρ [kg/dm ³] | $\geq 1,0$ | | |
| Compressive strength f_b [N/mm ²] | 2 / 4 / 6 | | |
| Standard or annex | EN 771-1 | | |

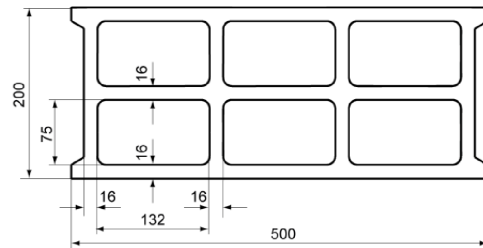


Table C32.1: Installation parameters

| Anchor rod | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | M10 | M12 | - | | M12 | M16 |
|--|--|------|-------|----|-------|----|----|-----|--------|-----|------------|-----|-------|-----|-----|-----|
| Internal threaded anchor FIS E | - | | - | | M6 | M8 | - | | - | | - | | M10 | M12 | - | |
| | | | | | 11x85 | | | | | | | | 15x85 | | | |
| Perforated sleeve FIS H K | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 18x130/200 | | 20x85 | | | |
| Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K | | | | | | | | | | | | | | | | |
| Max. installation torque | T _{inst,max} | [Nm] | 1 | | | | 2 | | | | | | | | | |
| General installation parameters | | | | | | | | | | | | | | | | |
| Edge distance | c _{min} | [mm] | 100 | | | | | | | | | | | | | |
| Spacing | s _{min} = s _{cr} | | 500 | | | | | | | | | | | | | |
| | s _{min} ⊥ = s _{cr} ⊥ | | 200 | | | | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | | | | | | |

Table C32.2: Group factors

| Anchor rod | | | M6 | M8 | M6 | M8 | - | | M8 | M10 | M8 | M10 | M10 | M12 | - | | M12 | M16 |
|--------------------------------|--|--------------------------|-------|----|-------|----|-------|----|----|-----|--------|-----|------------|-----|-------|-----|-----|-----|
| Internal threaded anchor FIS E | | | - | | - | | M6 | M8 | - | | - | | - | | M10 | M12 | - | |
| | | | | | | | 11x85 | | | | | | | | 15x85 | | | |
| Perforated sleeve FIS H K | | | 12x50 | | 12x85 | | 16x85 | | | | 16x130 | | 18x130/200 | | 20x85 | | | |
| Group factors | | $\alpha_{q,N} \parallel$ | [-] | 2 | | | | | | | | | | | | | | |
| | | $\alpha_{q,V} \parallel$ | | | | | | | | | | | | | | | | |
| | | $\alpha_{q,N} \perp$ | | | | | | | | | | | | | | | | |
| | | $\alpha_{q,V} \perp$ | | | | | | | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Light-weight concrete hollow block Hbl, dimensions, installation parameters

Annex C 32

Light-weight concrete hollow block Hbl, EN 771-3

Table C33.1: Characteristic resistance under tensile load

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 |
|--------------------------------|-------|-------|-------|-------|----------------|------------|-------|----|-----|-----|-----|------------------|-----|-----|
| Internal threaded anchor FIS E | - | - | - | - | M6 M8 11x85 | - | - | - | - | - | - | M10 M12 15x85 | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 16x85 | 16x130 | 18x130/200 | 20x85 | | | | | | | |

Tensile load N_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C)

| compressive strength f_b | condition | |
|----------------------------|-----------|-----|
| 2 N/mm ² | w/w | w/d |
| | d/d | |
| 4 N/mm ² | w/w | w/d |
| | d/d | |
| 6 N/mm ² | w/w | w/d |
| | d/d | |

Factor for temperature range 72/120°C: 0,83

Table C33.2: Characteristic resistance under shear load

| Anchor rod | M6 | M8 | M6 | M8 | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 |
|--------------------------------|-------|-------|-------|-------|----------------|------------|-------|----|-----|-----|-----|------------------|-----|-----|
| Internal threaded anchor FIS E | - | - | - | - | M6 M8 11x85 | - | - | - | - | - | - | M10 M12 15x85 | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 12x85 | 16x85 | 16x130 | 18x130/200 | 20x85 | | | | | | | |

Shear load V_{Rk} [kN] depending on the compressive strength f_b (temperature range 50/80°C and 72/120°C)

| compressive strength f_b | condition | |
|----------------------------|-----------|-----|
| 2 N/mm ² | w/w | w/d |
| | d/d | |
| 4 N/mm ² | w/w | w/d |
| | d/d | |
| 6 N/mm ² | w/w | w/d |
| | d/d | |

Factor for job site tests and displacements see annex C36


fischer injektion system FIS HT II masonry

Performance

Light-weight concrete hollow block Hbl,
Characteristic resistance under tensile and shear load

Annex C 33

Light-weight concrete solid block Vbl, EN 771-3

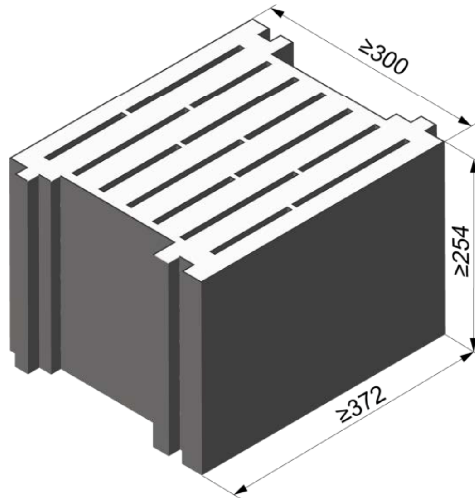

| Light-weight concrete solid block Vbl, EN 771-3 | | | |
|---|-----------|---------|----------|
| Producer | e.g. Sepa | | |
| Nominal dimensions [mm] | length L | width W | height H |
| | ≥ 372 | ≥ 300 | ≥ 254 |
| Density ρ [kg/dm ³] | ≥ 0,6 | | |
| Compressive strength f_b [N/mm ²] | 2 | | |
| Standard or annex | EN 771-3 | | |




Table C34.1: Installation parameters

| Anchor rod | | M8 | M10 | M10 | M12 | M12 | M16 | M16 | M12 | M16 | |
|--|--|----------------|------|------------|-----|--------|-----|------------|-----|--------|--|
| Perforated sleeve FIS H K | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 | | 20x200 | |
| Anchor rod with perforated sleeve FIS H K | | | | | | | | | | | |
| Max. installation torque | | $T_{inst,max}$ | [Nm] | 4 | | | | | | | |
| General installation parameters | | | | | | | | | | | |
| Edge distance | | c_{min} | [mm] | 130 | | | | | | | |
| Spacing | $s_{min} \parallel = s_{cr} \parallel$ | | | 370 | | | | | | | |
| | $s_{min} \perp = s_{cr} \perp$ | | | 250 | | | | | | | |
| Drilling method | | | | | | | | | | | |
| Hammer drilling with hard metal hammer drill | | | | | | | | | | | |

Table C34.2: Group factors

| Anchor rod | | M8 | M10 | M10 | M12 | M12 | M16 | M16 | M12 | M16 | |
|---------------------------|--------------------------|--------|-----|------------|-----|--------|-----|------------|-----|--------|--|
| Perforated sleeve FIS H K | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 | | 20x200 | |
| Group factors | $\alpha_{q,N} \parallel$ | [-] | 2 | | | | | | | | |
| | $\alpha_{q,V} \parallel$ | | | | | | | | | | |
| | $\alpha_{q,N} \perp$ | | | | | | | | | | |
| | $\alpha_{q,V} \perp$ | | | | | | | | | | |

fischer injektion system FIS HT II masonry

Performance

Light-weight concrete solid block Vbl, dimensions, installation parameters

Annex C 34

Light-weight concrete solid block Vbl, EN 771-3

Table C35.1: Characteristic resistance under tensile load

| Anchor rod | | | M8 | M10 | M10 | M12 | M12 | M16 | M16 | M12 | M16 |
|--|-----------|-----|--------|-----|------------|-----|--------|-----|------------|-----|--------|
| Perforated sleeve FIS H K | | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 | | 20x200 |
| Tensile load N _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C) | | | | | | | | | | | |
| compressive strength f _b | condition | | | | | | | | | | |
| 2 N/mm ² | w/w | w/d | 2,0 | | | | 2,5 | | | 3,0 | |
| | d/d | | 2,0 | | | | 3,0 | | | 4,0 | |

Factor for temperature range 72/120°C: 0,83

Table C35.2: Characteristic resistance under shear load

| Anchor rod | | | M8 | M10 | M10 | M12 | M12 | M16 | M16 | M12 | M16 | |
|---|-----|-----------|--------|-----|------------|-----|--------|-----|------------|-----|--------|--|
| Perforated sleeve FIS H K | | | 16x130 | | 18x130/200 | | 20x130 | | 22x130/200 | | 20x200 | |
| Shear load V _{Rk} [kN] depending on the compressive strength f _b (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | |
| compressive strength f _b | | condition | | | | | | | | | | |
| 2 N/mm² | w/w | w/d | 4,5 | | | | | | 6,5 | | | |
| | d/d | | | | | | | | | | | |

Factor for job site tests and displacements see annex C36

fischer injektion system FIS HT II masonry

Performance

Light-weight concrete solid block Vbl,
Characteristic resistance under tensile and shear load

Annex C 35

β-factors for job site tests; displacements

Table C36.1: β-factors for job site tests

| condition | | w/w and w/d | | d/d | |
|-------------------|--------------------|-------------|--------|-------|--------|
| temperature range | | 50/80 | 72/120 | 50/80 | 72/120 |
| Material | Size | | | | |
| solid units | M6 | 0,55 | 0,46 | 0,96 | 0,80 |
| | M8 | 0,57 | 0,51 | | |
| | M10 | 0,59 | 0,52 | | |
| | M12 FIS E 11x85 | 0,6 | 0,54 | | |
| | M16 FIS E 15x85 | 0,62 | 0,52 | | |
| | 16x85 | 0,55 | 0,46 | | |
| hollow units | all sizes | 0,86 | 0,72 | 0,96 | 0,8 |

Table C36.2: Displacements

| Material | N [kN] | δN ₀ [mm] | δN _∞ [mm] | V [kN] | δV ₀ [mm] | δV _∞ [mm] |
|--------------------------------------|--|-------------------------|-------------------------|--|-------------------------|-------------------------|
| solid units h _{ef} =100m | $\frac{N_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,03 | 0,06 | $\frac{V_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,82 | 0,88 |
| hollow units | $\frac{N_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,48 | 0,06 | $\frac{V_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 1,71 | 2,56 |
| solid brick Mz DF annex C 4 - C 5 | $\frac{N_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,74 | 1,48 | $\frac{V_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 1,23 | 1,85 |
| solid brick Ks NF annex C 6 / C 7 | $\frac{N_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,2 | 0,4 | $\frac{V_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,91 | 1,37 |
| brick Annex C 32 / C 33 | $\frac{N_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 0,03 | 0,06 | $\frac{V_{Rk}}{1,4 \cdot \gamma_{Mm}}$ | 6,44 | 9,66 |

fischer injektion system FIS HT II masonry

Performance
β-factors for job site tests; displacements

Annex C 36