

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-16/0515  
of 17 June 2019

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

HVU2

Product family  
to which the construction product belongs

Bonded Fastener for use in concrete

Manufacturer

Hilti AG Liechtenstein  
Feldkircherstraße 100  
9494 Schaan  
FÜRSTENTUM LIECHTENSTEIN

Manufacturing plant

Hilti Corporation

This European Technical Assessment  
contains

27 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601

This version replaces

ETA-16/0515 issued on 14 December 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The HVU2 is a bonded anchor consisting of a mortar capsule Hilti HVU2 and a steel element. The steel element consist of

- an anchor rod Hilti HAS-U or Hilti HAS-(E) with washer and hexagon nut of sizes M8 to M30 or
- an internally threaded sleeve HIS-(R)N of sizes M8 to M20.

The mortar capsule is placed in the hole and the steel element is driven by machine as specified in Annex B7.

The anchor rod is anchored via the bond between steel element, chemical mortar and concrete. The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for static and quasi-static tension load	See Annex C1 to C5
Characteristic resistance for static and quasi-static shear load	See Annex C6 to C8
Displacements for static and quasi-static loads	See Annex C9
Characteristic resistance for seismic performance categories C1	See Annex C10
Characteristic resistance and displacements for seismic performance categories C2	See Annex C11
Characteristic resistance for 100 years working life	No performance assessed

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

English translation prepared by DIBt

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 17 June 2019 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department


*beglaubigt:*  
Lange

## Installed condition

**Figure A1:**  
HAS-U... and HAS-(E)...

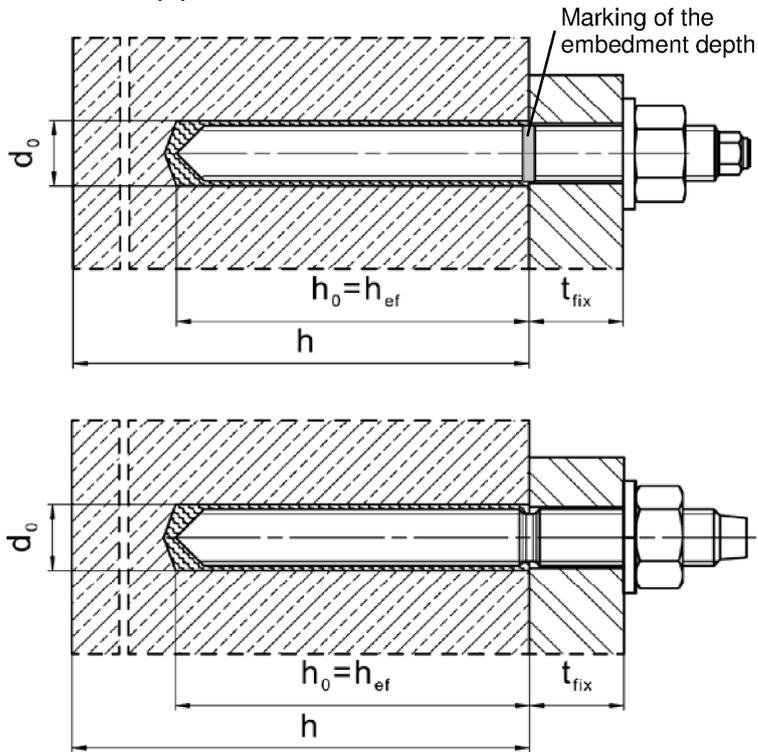

**Figure A2:**  
Internally threaded sleeve HIS-(R)N

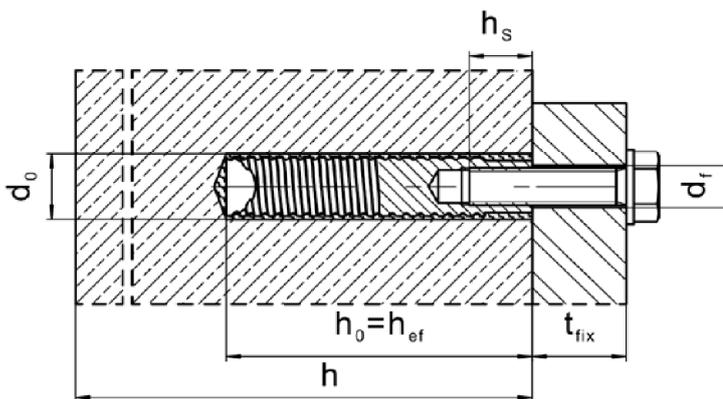

HVU2

Product description  
Installed condition

Annex A1



## Product description: Mortar capsule and steel elements

Adhesive anchor capsule HVU2 M8 to M30: resin and hardener with aggregate

Marking:  
HVU2 M ...  
Expiry date mm/yyyy




### Steel elements




HAS-U... : M8 to M30

washer nut



HAS-(E)... : M8 to M30

washer nut



Internally threaded sleeve HIS-(R)N: M8 to M20

Dimensions according to Annex B6.

HVU2

**Product description**  
Adhesive anchor capsule / Steel elements

**Annex A2**

**Table A1: Materials**

Designation	Material
<b>Metal parts made of zinc coated steel</b>	
HAS-(E)	M8 to M16: Strength class 5.8, $f_{uk} = 570 \text{ N/mm}^2$ , $f_{yk} = 456 \text{ N/mm}^2$ . M20 and M24: Strength class 5.8, $f_{uk} = 500 \text{ N/mm}^2$ , $f_{yk} = 400 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 8% ductile. M8 to M30: Strength class 8.8, $f_{uk} = 800 \text{ N/mm}^2$ , $f_{yk} = 640 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 12% ductile. Electroplated zinc coated $\geq 5 \mu\text{m}$ , (F) hot dip galvanized $\geq 45 \mu\text{m}$ .
HAS-U-...	M8 to M24: Strength class 5.8, $f_{uk} = 500 \text{ N/mm}^2$ , $f_{yk} = 400 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 8% ductile. M8 to M30: Strength class 8.8, $f_{uk} = 800 \text{ N/mm}^2$ , $f_{yk} = 640 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 12% ductile. Electroplated zinc coated $\geq 5 \mu\text{m}$ , (F) hot dip galvanized $\geq 45 \mu\text{m}$ .
Internally threaded sleeve HIS-N	Electroplated zinc coated $\geq 5 \mu\text{m}$ .
Washer	Electroplated zinc coated $\geq 5 \mu\text{m}$ , hot dip galvanized $\geq 45 \mu\text{m}$ .
Nut	Strength class of nut adapted to strength class of threaded rod. Electroplated zinc coated $\geq 5 \mu\text{m}$ , hot dip galvanized $\geq 45 \mu\text{m}$ .
<b>Metal parts made of stainless steel</b>	
HAS-(E)R	M8 to M16: Strength class 70, $f_{uk} = 700 \text{ N/mm}^2$ , $f_{yk} = 500 \text{ N/mm}^2$ . M20 and M24: Strength class 70, $f_{uk} = 700 \text{ N/mm}^2$ , $f_{yk} = 450 \text{ N/mm}^2$ . M27 and M30: Strength class 70, $f_{uk} = 500 \text{ N/mm}^2$ , $f_{yk} = 210 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 8% ductile. Stainless steel A4 according to EN 10088-1:2014.
HAS-U-R	M8 to M24: Strength class 70, $f_{uk} = 700 \text{ N/mm}^2$ , $f_{yk} = 450 \text{ N/mm}^2$ . M27 and M30: Strength class 70, $f_{uk} = 500 \text{ N/mm}^2$ , $f_{yk} = 210 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 8% ductile. Stainless steel A4 according to EN 10088-1:2014.
Internally threaded sleeve HIS-RN	Stainless steel A4 according to EN 10088-1:2014.
Washer	Stainless steel A4 according to EN 10088-1:2014.
Nut	Strength class of nut adapted to strength class of threaded rod. Stainless steel A4 according to EN 10088-1:2014.
<b>Metal parts made of high corrosion resistant steel</b>	
HAS-(E)HCR HAS-U-HCR	M8 to M20: $f_{uk} = 800 \text{ N/mm}^2$ , $f_{yk} = 640 \text{ N/mm}^2$ . M24: $f_{uk} = 700 \text{ N/mm}^2$ , $f_{yk} = 400 \text{ N/mm}^2$ . Rupture elongation ( $l_0 = 5d$ ) > 8% ductile. High corrosion resistant steel according to EN 10088-1:2014.
Washer	High corrosion resistant steel according to EN 10088-1:2014.
Nut	Strength class of nut adapted to strength class of threaded rod. High corrosion resistant steel according to EN 10088-1:2014.

HVU2

Product description  
Materials

Annex A3

## Specifications of intended use

### Anchorage subject to:

- Static and quasi static loading.
- Seismic performance category C1. HAS-U-... and HAS-(E)... size M10 to M30.
- Seismic performance category C2. HAS-U-... and HAS-(E)... size M16 and M20.

### Base material:

- Compacted reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Cracked and uncracked concrete.

### Temperature in the base material:

- **At installation**  
-10 °C to +40 °C  
For the standard variation of temperature and rapid variation of temperature after installation.
- **In-service**  
Temperature range I: -40 °C to +40 °C  
(max. long term temperature +24 °C and max. short term temperature +40 °C)  
Temperature range II: -40 °C to +80 °C  
(max. long term temperature +50 °C and max. short term temperature +80 °C)  
Temperature range III: -40 °C to +120 °C  
(max. long term temperature +72 °C and max. short term temperature +120 °C)

**Table B1: Specifications of intended use**

Elements	Foil capsule HVU2 with ...	
	HAS-U-..., HAS-(E)... 	HIS-(R)N 
Hammer drilling with hollow drill bit TE-CD or TE-YD 	M12 to M30	M8 to M20
Hammer drilling 	M8 to M30	M8 to M20
Diamond coring 	M10 to M30	M8 to M20

HVU2

Intended Use  
Specifications

Annex B1

**Use conditions (Environmental conditions):**

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal conditions, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal conditions, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing products are used).

**Design:**

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- The anchorages are designed in accordance with:  
EN 1992-4:2018 and EOTA Technical Report TR 055.  
Anchorages under seismic actions shall be positioned outside of critical regions (e.g. plastic hinges) of the concrete structure. Fastening in stand-off installation or with a grout layer under seismic action are not covered in this European technical assessment (ETA).

**Installation:**

- Concrete condition I1:  
Installation in dry or wet (water saturated) concrete and use in service in dry or wet concrete.
- Drilling technique: hammer drilling, diamond coring (e.g. Hilti DD 30-W or other Hilti DD machines), hammer drilling with hollow drill bit TE-CD, TE-YD.
- Installation direction:  
D2: downward and horizontal installation for HVU2 M8 to M30.  
D3: downward and horizontal and upward (e.g. overhead) installation for HVU2 M8 to M24.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

electronic copy of the eta by dibt: eta-16/0515

<b>HVU2</b>	<b>Annex B2</b>
<b>Intended Use Specifications</b>	

**Table B2: Installation parameters of HAS-U-... and HAS-(E)...**

HAS-U-... and HAS-(E)...		M8	M10	M12	M16	M20	M24	M27	M30
Foil capsule HVU2 M...		8x80	10x90	12x110	16x125	20x170	24x210	27x240	30x270
Diameter of fastener	$d = d_{nom}$ [mm]	8	10	12	16	20	24	27	30
Nominal diameter of drill bit	$d_0$ [mm]	10	12	14	18	22	28	30	35
Effective embedment depth and drill hole depth	$h_{ef} = h_0$ [mm]	80	90	110	125	170	210	240	270
Maximum diameter of clearance hole in the fixture	$d_f$ [mm]	9	12	14	18	22	26	30	33
Minimum thickness of concrete member	$h_{min}$ [mm]	110	120	140	160	220	270	300	340
Maximum torque moment	$\max T_{fix}$ [Nm]	10	20	40	80	150	200	270	300
Minimum spacing	$s_{min}$ [mm]	40	50	60	75	90	115	120	140
Minimum edge distance	$c_{min}$ [mm]	40	45	45	50	55	60	75	80


**HAS-U-...**



**Marking:**

Steel grade number and length identification letter: e.g. 8L

**HAS-(E)...**

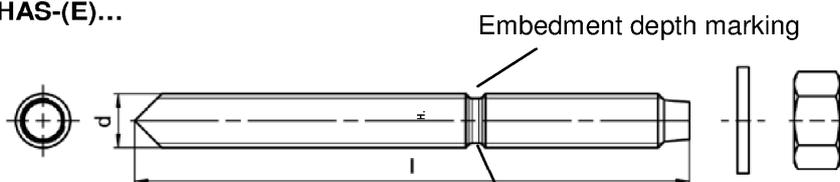

**Marking:**

- identifying mark - H, embossing "1" HAS-(E)
- identifying mark - H, embossing "=" HAS-(E)R
- identifying mark - H, embossing "CR" HAS-(E)HCR

**HVU2**


**Intended Use**  
Installation parameters

**Annex B3**

**Table B3: Installation parameters of internally threaded sleeve HIS-(R)N**

Internally threaded sleeve HIS-(R)N			M8	M10	M12	M16	M20
Foil capsule HVU2 M...			10x90	12x110	16x125	20x170	24x210
Outer diameter of sleeve	$d = d_{nom}$	[mm]	12,5	16,5	20,5	25,4	27,8
Nominal diameter of drill bit	$d_0$	[mm]	14	18	22	28	32
Effective embedment depth and drill hole depth	$h_{ef} = h_0$	[mm]	90	110	125	170	205
Maximum diameter of clearance hole in the fixture	$d_f$	[mm]	9	12	14	18	22
Minimum thickness of concrete member	$h_{min}$	[mm]	120	150	170	230	270
Maximum torque moment	$T_{max}$	[Nm]	10	20	40	80	150
Thread engagement length min-max	$h_s$	[mm]	8-20	10-25	12-30	16-40	20-50
Minimum spacing	$s_{min}$	[mm]	60	75	90	115	130
Minimum edge distance	$c_{min}$	[mm]	40	45	55	65	90

**Internally threaded sleeve HIS-(R)N...**

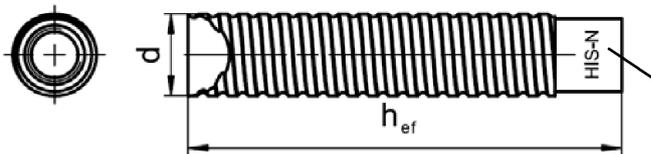

**Marking:**  
Identifying mark - HILTI and  
embossing "HIS-N" (for zinc coated steel)  
embossing "HIS-RN" (for stainless steel)

**Table B4: Minimum curing time**

Temperature in the base material T	Minimum curing time $t_{cure}$
-10 °C to -6 °C	5 hours
-5 °C to -1 °C	3 hours
0 °C to 4 °C	40 min
5 °C to 9 °C	20 min
10 °C to 19 °C	10 min
20 °C to 40 °C	5 min

HVU2

**Intended Use**  
Installation parameters and minimum curing time

**Annex B4**

**Table B5: Parameters of drilling and cleaning tools**

Elements		Drill and clean			
HAS-U-... HAS-(E)...	HIS-(R)N	Hammer drilling		Diamond coring	Brush
			Hollow drill bit TE-CD, TE-YD		
					
Size	Name	$d_0$ [mm]	$d_0$ [mm]	$d_0$ [mm]	HIT-RB
M8	-	10	-	-	-
M10	-	12	-	12	12
M12	M8	14	14	14	14
M16	M10	18	18	18	18
M20	M12	22	22	22	22
M24	M16	28	28	28	28
M27	-	30	-	30	30
-	M20	32	32	32	32
M30	-	35	35	35	35

**Cleaning alternatives**

**Manual Cleaning (MC):**

Hilti hand pump for blowing out drill holes with diameters  $d_0 \leq 18$  mm and drill hole depths  $h_0 \leq 10$  d.



**Compressed Air Cleaning (CAC):**

Air nozzle with an orifice opening of minimum 3,5 mm in diameter.



**Automatic Cleaning (AC):**

Cleaning is performed during drilling with Hilti TE-CD and TE-YD drilling system including vacuum cleaner.




HVU2

**Intended Use**  
Cleaning tools

**Annex B5**

**Table B6: Parameters of setting tools HAS-U-..., HAS-(E)... and HIS-(R)N**

HAS 	HIS-N 	TE(A) 	SID 4-A22 	SIW 22T-A 	SF(H) 	RPM
M8		1...7	+	+	2, 6, 8, 10, 14, 22	450...1300
M10	M8	1...7	+	+	6, 8, 10, 14, 22	450...1300
M12	M10	1...40	+	+	6, 8, 10, 14, 22	450...1300
M16	M12	1...40	+	-	6, 8, 10, 14, 22	450...1300
M20	-	50...60	-	-	-	-
-	M16	40...80	-	-	-	-
M24	-	50...80	-	-	-	-
-	M20	40...80	-	-	-	-
M27	-	60...80	-	-	-	-
M30	-	60...80	-	-	-	-

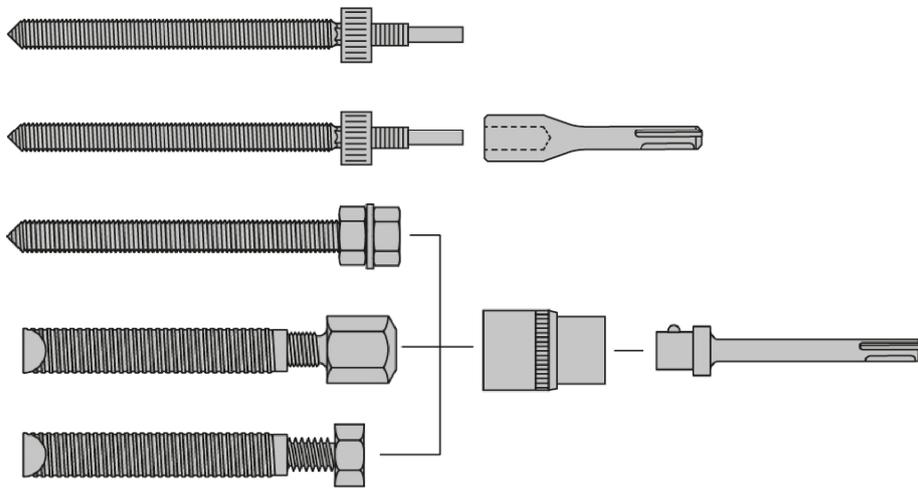

Settingtool	Article number	TE (A) 1...40	TE 50...80	SF (H)	SID 4-A22	HIS-S 
-	-	-	-	+	-	-
TE-C HVU2	# 2181356	+	-	-	-	-
TE-Y HVU2	# 2230162...5	-	+	-	-	-
TE-C 1/2"	# 32220	+	-	-	-	+
TE-Y 3/4"	# 32221	-	+	-	-	+
SI-SA 1/4"- 1/2"	# 2077174	-	-	+	+	+
SI-SA 7/16"	# 2134075	-	-	+	-	+


HVU2

Intended Use  
Setting tools

Annex B6


## Installation instruction

### Hole drilling




Mark required drilling depth  $h_0$  on drill bit or core bit

**a) Hammer drilling:** For dry or wet concrete.




Drill hole to the required embedment depth with a hammer drill set in rotation-hammer mode using an appropriately sized carbide drill bit.

**b) Hammer drilling with Hilti hollow drill bit:** For dry or wet concrete.




Drill hole to the required embedment depth with an appropriately sized Hilti TE-CD or TE-YD hollow drill bit attached to Hilti vacuum cleaner. This drilling system removes the dust and cleans the drill hole during drilling when used in accordance with the user's manual. After drilling is completed, proceed to the "setting the element" step in the installation instruction.

**c) Diamond coring:** For dry or wet concrete.




Diamond coring is permissible when suitable diamond core drilling machines and the corresponding core bits are used.

### Check setting depth



Mark required setting depth on fastener (see table B3).











Check the setting depth with the marked element.  
The element has to fit in the hole until the required embedment depth, not deeper.  
If it is not possible to insert the element to the required embedment depth, drill deeper.

HVU2

**Intended Use**  
Installation instructions


**Annex B7**

<p><b>Drill hole cleaning:</b> Just before setting an anchor, the drill hole must be free of dust and debris. Inadequate hole cleaning = poor load values.</p>	
<p><b>Manual Cleaning (MC):</b> For drill hole diameters <math>d_0 \leq 18</math> mm and drill hole depths <math>h_0 \leq 10</math> d.</p>	
	<p>The Hilti hand pump may be used for blowing out drill holes. Blow out at least 4 times from the back of the drill hole until return air stream is free of noticeable dust.</p>
<p><b>Compressed Air Cleaning (CAC):</b> For all drill hole diameters <math>d_0</math> and all drill hole depths <math>h_0</math>.</p>	
	<p>Blow 2 times from the back of the hole (if needed with nozzle extension) over the whole length with oil-free compressed air (min. 6 bar at 6 m³/h) until return air stream is free of noticeable dust.</p>
<p><b>Cleaning of hammer drilled flooded holes and diamond cored holes:</b> For all drill hole diameters <math>d_0</math> and all drill hole depths <math>h_0</math>.</p>	
	<p>Flush 2 times by inserting a water hose (water-line pressure) to the back of the hole until water runs clear.</p>
	<p>Brush 2 times with the specified brush (see table B5) by inserting the steel brush Hilti HIT-RB to the back of the hole (if needed with extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the drill hole (brush <math>\varnothing \geq</math> drill hole <math>\varnothing</math>) - if not, the brush is too small and must be replaced with the proper brush diameter.</p>
	<p>Flush 2 times by inserting a water hose (water-line pressure) to the back of the hole until water runs clear.</p>
	<p>Blow 2 times from the back of the hole (if needed with nozzle extension) over the whole length with oil-free compressed air (min. 6 bar at 6 m³/h) until return air stream is free of noticeable dust and water.</p>
	<p>Brush 2 times with the specified brush (see Table B5) by inserting the steel brush Hilti HIT-RB to the back of the hole (if needed with extension) in a twisting motion and removing it. The brush must produce natural resistance as it enters the drill hole (brush <math>\varnothing \geq</math> drill hole <math>\varnothing</math>) - if not, the brush is too small and must be replaced with the proper brush diameter.</p>
<p><b>HVU2</b></p>	<p><b>Annex B8</b></p>
<p><b>Intended Use</b> Installation instructions</p>	




Blow again with compressed air 2 times until return air stream is free of noticeable dust and water.


**Setting the element**




Insert the foil capsule with the peak ahead to the back of the hole.



Drive the anchor rod with the plugged tool into the hole, applying moderate pressure. Rotary hammer tool in rotation hammer mode (450 RPM to maximum 1300 RPM). Setting tool see Annexes B6. After reaching the embedment depth switch off setting machine immediately.



Overhead installation for HVU2 M8 to M24.  
For overhead installation use the overhead dripping cup HIT-OHC.



Loading the anchor: After required curing time  $t_{cure}$  (see Table B4) the anchor can be loaded. The applied installation torque shall not exceed the values  $T_{max}$  given in Table B2 and Table B3.

<b>HVU2</b>	<b>Annex B9</b>
<b>Intended Use</b> Installation instructions	

**Table C1: Essential characteristics for HAS-U-... and HAS-(E) under tension load in concrete**

HAS-U-... and HAS-(E)...	M8	M10	M12	M16	M20	M24	M27	M30	
<b>Installation safety factor</b>									
Hammer drilling and drilling with hollow drill bit TE-CD or TE-YD $\gamma_{inst}$ [-]	1,0								
Diamond coring $\gamma_{inst}$ [-]	1,0								
<b>Steel failure HAS-(E)...</b>									
HAS-(E) 5.8 $N_{Rk,s}$ [kN]	18,9	30,1	43,4	82,2	112,2	160,2	-		
Partial factor $\gamma_{Ms,N}^{1)}$ [-]	1,50							-	
HAS-(E) 8.8 $N_{Rk,s}$ [kN]	26,5	42,2	61,0	115,4	179,5	256,4	347	421,5	
Partial factor $\gamma_{Ms,N}^{1)}$ [-]	1,50								
HAS-R $N_{Rk,s}$ [kN]	23,2	37,0	53,3	100,9	157,0	224,3	216,9	263,4	
Partial factor $\gamma_{Ms,N}^{1)}$ [-]	1,68				1,87		2,86		
HAS-HCR $N_{Rk,s}$ [kN]	26,5	42,2	61,0	115,4	179,5	224,3	-		
Partial factor $\gamma_{Ms,N}^{1)}$ [-]	1,5					2,1		-	
<b>Steel failure HAS-U-...</b>									
HAS-U-... $N_{Rk,s}$ [kN]	$A_s \cdot f_{uk}$								
Partial factor grade 5.8 $\gamma_{Ms,N}^{1)}$ [-]	1,5							-	
Partial factor grade 8.8 $\gamma_{Ms,N}^{1)}$ [-]	1,5								
Partial factor HAS-U-R $\gamma_{Ms,N}^{1)}$ [-]	1,87							2,86	
Partial factor HAS-U-HCR $\gamma_{Ms,N}^{1)}$ [-]	1,5					2,1		-	
<b>Combined pullout and concrete cone failure</b>									
Effective embedment depth $h_{ef}$ [mm]	80	90	110	125	170	210	240	270	
<b>Uncracked concrete C20/25 in hammer drilled holes</b>									
Temperature range I: 24 °C / 40 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	12,0	16,0							
Temperature range II: 50 °C / 80 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	9,5	13,0							
Temperature range III: 72 °C / 120 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	6,0	7,5							
<b>Uncracked concrete C20/25 in hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>									
Temperature range I: 24 °C / 40 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	-	16,0							
Temperature range II: 50 °C / 80 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	-	13,0							
Temperature range III: 72 °C / 120 °C $\tau_{Rk,ucr}$ [N/mm <sup>2</sup> ]	-	7,5							

HVU2

**Performances**  
Essential characteristics under tension loads in concrete

**Annex C1**

**Table C1: continued**

HAS-U... and HAS-(E)...	M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked concrete C20/25 in diamond cored holes</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	-		14,0			
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	-		12,0			
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	-		6,5			
<b>Combined pullout and concrete cone failure</b>								
<b>Cracked concrete C20/25 in hammer drilled holes</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	5,0		8,5			
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	4,0		6,5			
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	2,5		4,0			
<b>Cracked concrete C20/25 in hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		8,5			
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		6,5			
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		4,0			
<b>Cracked concrete C20/25 in diamond cored holes</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		7,0			
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		6,0			
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	-		3,5			


**HVU2**

**Performances**  
Essential characteristics under tension loads in concrete

**Annex C2**

**Table C1: continued**

HAS-U... and HAS-(E)...		M8	M10	M12	M16	M20	M24	M27	M30
<b>Influence factors <math>\psi</math> on bond resistance <math>\tau_{Rk}</math></b>									
<b>Hammer drilled holes and hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>									
Uncracked concrete: Factor for concrete strength	$\psi_c$	C30/37	1,08						
		C40/50	1,15						
		C50/60	1,20						
Cracked concrete: Factor for concrete strength	$\psi_c$	C30/37	1,04						
		C40/50	1,07						
		C50/60	1,10						
Cracked and uncracked concrete: Sustained load factor	$\psi_{sus}^0$	24 °C / 40 °C	1,00						
		50 °C / 80 °C	0,73						
		72 °C / 120 °C	0,73						
<b>Diamond cored holes</b>									
Uncracked concrete: Factor for concrete strength	$\psi_c$	C30/37	1,08						
		C40/50	1,15						
		C50/60	1,20						
Cracked concrete: Factor for concrete strength	$\psi_c$	C50/60	1,00						
Cracked and uncracked concrete: Sustained load factor	$\psi_{sus}^0$	24 °C / 40 °C	0,78						
		50 °C / 80 °C	0,71						
		72 °C / 120 °C	0,78						
<b>Concrete cone failure</b>									
Factor for uncracked concrete	$k_{ucr,N}$	[-]	11,0						
Factor for cracked concrete	$k_{cr,N}$	[-]	7,7						
Edge distance	$C_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$						
Spacing	$S_{cr,N}$	[mm]	$3,0 \cdot h_{ef}$						
<b>Splitting failure</b>									
Edge distance $C_{cr,sp}$ [mm] for	$h / h_{ef} \geq 2,0$		$1,0 \cdot h_{ef}$						
	$2,0 > h / h_{ef} > 1,3$		$4,6 h_{ef} - 1,8 h$						
	$h / h_{ef} \leq 1,3$		$2,26 h_{ef}$						
Spacing	$S_{cr,sp}$	[mm]	$2 \cdot C_{cr,sp}$						

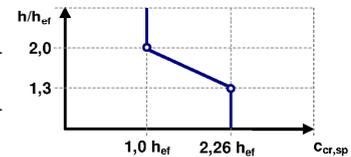

<sup>1)</sup> In absence of national regulations.

HVU2

**Performances**  
Essential characteristics under tension loads in concrete

**Annex C3**

**Table C2: Essential characteristics for internally threaded sleeve HIS-(R)N under tension load in concrete**

HIS-(R)N			M8	M10	M12	M16	M20
<b>Installation safety factor</b>							
Hammer drilling and drilling with hollow drill bit TE-CD or TE-YD	$\gamma_{inst}$	[-]	1,0				
Diamond coring	$\gamma_{inst}$	[-]	1,0				
<b>Steel failure</b>							
HIS-N with screw or threaded rod grade 8.8	$N_{Rk,s}$	[kN]	25	46	67	125	116
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5				
HIS-RN with with screw or threaded rod grade 70	$N_{Rk,s}$	[kN]	26	41	59	110	166
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,87				2,4
<b>Combined pullout and concrete cone failure</b>							
Effective embedment depth	$h_{ef}$	[mm]	90	110	125	170	205
Effective diameter of fastener	d	[mm]	12,5	16,5	20,5	25,4	27,6
Uncracked concrete C20/25 in <b>hammer drilled holes and hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>							
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	11,0				
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9,0				
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	5,5				
Uncracked concrete C20/25 in <b>diamond cored holes</b>							
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	11,0				
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	9,0				
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	5,5				
Cracked concrete C20/25 in <b>hammer drilled holes and hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>							
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	6,5				
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	5,0				
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	3,0				
Cracked concrete C20/25 in <b>diamond cored holes</b>							
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	4,5				
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	3,5				
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	2,5				

HVU2

**Performances**  
Essential characteristics under tension loads in concrete

**Annex C4**

**Table C2: Continued**

HIS-(R)N			M8	M10	M12	M16	M20	
<b>Influence factors <math>\psi</math> on bond resistance <math>\tau_{Rk}</math></b>								
<b>Hammer drilled holes and hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>								
Factor for concrete compressive strength								
Uncracked concrete: Factor for concrete strength	$\psi_c$	C50/60						1,00
		C30/37						1,08
Cracked concrete: Factor for concrete strength	$\psi_c$	C40/50						1,15
		C50/60						1,20
Cracked and uncracked concrete: Sustained load factor	$\psi_{sus}^0$	24 °C / 40 °C						1,00
		50 °C / 80 °C						0,73
		72 °C / 120 °C						0,73
<b>Diamond cored holes</b>								
Uncracked concrete: Factor for concrete strength	$\psi_c$	C50/60						1,00
Cracked concrete: Factor for concrete strength	$\psi_c$	C50/60						1,0
Cracked and uncracked concrete: Sustained load factor	$\psi_{sus}^0$	24 °C / 40 °C						0,78
		50 °C / 80 °C						0,71
		72 °C / 120 °C						0,78
<b>Concrete cone failure</b>								
Factor for uncracked concrete	$k_{ucr,N}$	[-]						11
Factor for cracked concrete	$k_{cr,N}$	[-]						7,7
Edge distance	$c_{cr,N}$	[mm]						$1,5 \cdot h_{ef}$
Spacing	$s_{cr,N}$	[mm]						$3,0 \cdot h_{ef}$
<b>Splitting failure</b>								
Edge distance $c_{cr,sp}$ [mm] for	$h / h_{ef} \geq 2,0$		$1,0 \cdot h_{ef}$					
	$2,0 > h / h_{ef} > 1,3$		$4,6 h_{ef} - 1,8 h$					
	$h / h_{ef} \leq 1,3$		$2,26 h_{ef}$					
Spacing	$s_{cr,sp}$	[mm]						$2 \cdot c_{cr,sp}$

<sup>1)</sup> In absence of national regulations.

**HVU2**

**Performances**  
Essential characteristics under tension loads in concrete

**Annex C5**

**Table C3: Essential characteristics for HAS-U-... and HAS-(E) under shear load in concrete**

HAS-U-... and HAS-(E)...			M8	M10	M12	M16	M20	M24	M27	M30
<b>Steel failure without lever arm</b>										
<b>HAS-(E)...</b>										
HAS-(E) 5.8	$V_{Rk,s}$	[kN]	9,5	15,1	21,7	41,1	56,1	80,1	-	-
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
HAS-(E) 8.8	$V_{Rk,s}$	[kN]	13,3	21,1	30,5	57,7	89,7	128,2	173,5	210,7
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
HAS-R	$V_{Rk,s}$	[kN]	11,6	18,5	26,7	50,5	78,5	112,2	108,4	131,7
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,4				1,56		2,38	
HAS-HCR	$V_{Rk,s}$	[kN]	13,3	21,1	30,5	57,7	89,7	112,2	-	-
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25					1,75	-	-
Ductility factor	$k_7$	[-]	1,0							
HAS-U-...	$V_{Rk,s}$	[kN]	$0,5 \cdot A_s \cdot f_{uk}$							
Partial factor grade 5.8	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
Partial factor grade 8.8	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
Partial factor HIT-V-R	$\gamma_{Ms,V}^{1)}$	[-]	1,56						2,38	
Partial factor HIT-V-HCR	$\gamma_{Ms,V}^{1)}$	[-]	1,5					2,1	-	-
Ductility factor	$k_7$	[-]	1,0							
<b>Steel failure with lever arm</b>										
<b>HAS-(E)...</b>										
HAS-(E) 5.8	$M_{Rk,s}^0$	[kN]	18	37	64	167	284	486	-	-
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
HAS-(E) 8.8	$M_{Rk,s}^0$	[kN]	26	53	90	234	455	777	1223	1638
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25						-	-
HAS-R	$M_{Rk,s}^0$	[kN]	23	45	79	205	398	680	765	1023
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,4				1,56		2,38	
HAS-HCR	$M_{Rk,s}^0$	[kN]	26	52	90	234	455	680	-	-
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25					1,75	-	-
Ductility factor	$k_7$	[-]	1,0							

HVU2

**Performances**  
Essential characteristics under shear loads in concrete

**Annex C6**

**Table C3: Continued**

HAS-U-... and HAS-(E)...			M8	M10	M12	M16	M20	M24	M27	M30
<b>HAS-U-...</b>										
Bending moment	$M_{Rk,s}^0$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}$							
Ductility factor	$k_7$	[-]	1,0							
<b>Concrete pry-out failure</b>										
Pry-out factor	$k_8$	[-]	2,0							
<b>Concrete edge failure</b>										
Effective length of fastener	$l_f$	[mm]	80	90	110	125	170	210	240	270
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	16	20	24	27	30

<sup>1)</sup> In absence of national regulations.

**HVU2**

**Performances**

Essential characteristics under shear loads in concrete

**Annex C7**

**Table C4: Essential characteristics for internally threaded sleeve HIS-(R)N under shear loads in concrete**

HIS-(R)N			M8	M10	M12	M16	M20
<b>Steel failure without lever arm</b>							
HIS-N with screw or threaded rod grade 8.8	$V_{Rk,s}$	[kN]	13	23	34	63	58
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25				
HIS-RN with screw or threaded rod grade 70	$V_{Rk,s}$	[kN]	13	20	30	55	83
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,56				
Ductility factor	$k_7$	[-]	1,0				
<b>Steel failure with lever arm</b>							
HIS-N with screw or threaded rod grade 8.8	$M^0_{Rk,s}$	[Nm]	30	60	105	266	519
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25				
HIS-RN with screw or threaded rod grade 70	$M^0_{Rk,s}$	[Nm]	26	52	92	233	454
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,56				
Ductility factor	$k_7$	[-]	1,0				
<b>Concrete pry-out failure</b>							
Pry-out factor	$k_8$	[-]	2,0				
<b>Concrete edge failure</b>							
Effective length of fastener	$l_f$	[mm]	90	110	125	170	205
Diameter of fastener	$d_{nom}$	[mm]	12,5	16,5	20,5	25,4	27,6

<sup>1)</sup> In absence of national regulations.

HVU2

**Performances**  
Essential characteristics under shear loads in concrete

**Annex C8**

**Table C5: Displacements for HAS-U-... and HAS-(E) under tension load<sup>1)</sup>**

HAS-U-... and HAS-(E)...			M8	M10	M12	M16	M20	M24	M27	M30
Uncracked concrete temperature range I to III										
Displacement	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,06						0,15	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,10						0,30	
Cracked concrete temperature range I to III										
Displacement	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,10						0,15	
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,14						0,30	

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau \quad (\tau: \text{bond stress due to applied tension force}).$$

**Table C6: Displacements for HAS-U-... and HAS-(E) under shear load<sup>1)</sup>**

HAS-U-... and HAS-(E)...			M8	M10	M12	M16	M20	M24	M27	M30
Displacement	$\delta_{V0}$ -factor	[mm/kN]	0,06	0,06	0,05	0,04	0,04	0,03		
	$\delta_{V\infty}$ -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05		

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V; \quad \delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V \quad (V: \text{applied shear force}).$$

**Table C7: Displacements for internally threaded sleeves HIS-(R)N under tension load<sup>1)</sup>**

HIS-(R)N			M8	M10	M12	M16	M20
Uncracked concrete temperature range I to III							
Displacement	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,05				0,15
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,10				0,15
Cracked concrete temperature range I to III							
Displacement	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,13				0,20
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,15				0,20

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau \quad (\tau: \text{bond stress due to applied tension force}).$$

**Table C8: Displacements for internally threaded sleeves HIS-(R)N under shear load<sup>1)</sup>**

HIS-(R)N			M8	M10	M12	M16	M20
Displacement	$\delta_{V0}$ -factor	[mm/kN]	0,06	0,06	0,05	0,04	0,04
	$\delta_{V\infty}$ -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V; \quad \delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V \quad (V: \text{applied shear force}).$$

HVU2

Performances  
Displacements

Annex C9

**Table C9: Essential characteristics for HAS-U-... and HAS-(E) under tension loads for seismic performance category C1**

HAS-U-... and HAS-(E)...		M10	M12	M16	M20	M24	M27	M30
<b>Steel failure</b>								
HAS-U-5.8(F), HAS-(E) 5.8	$N_{Rk,s,seis}$ [kN]	29	42	79	123	177	-	
HAS-U-8.8(F), HAS-(E) 8.8	$N_{Rk,s,seis}$ [kN]	46	67	126	196	282	367	449
HAS-U-R, HAS-R	$N_{Rk,s,seis}$ [kN]	41	59	110	172	247	230	281
HAS-U-HCR, HAS-HCR	$N_{Rk,s,seis}$ [kN]	46	67	126	196	247	-	
<b>Combined pullout and concrete cone failure in cracked concrete C20/25</b>								
<b>Hammer drilled holes</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	8,5	8,5	8,3	6,9	8,1	6,5	7,6
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	6,5	6,5	6,4	5,3	6,2	5,0	5,8
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	4,0	4,0	3,9	3,3	3,8	3,1	3,6
<b>Hammer drilled holes with hollow drill bit TE-CD or TE-YD</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	-	8,5	8,3	6,9	8,1	6,5	7,6
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	-	6,5	6,4	5,3	6,2	5,0	5,8
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	-	4,0	3,9	3,3	3,8	3,1	3,6
<b>Diamond cored holes</b>								
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	7,0	7,0	7,0	7,0	7,0	7,0	7,0
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	6,5	6,5	6,5	6,5	6,5	6,5	6,5
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	4,0	4,0	4,0	4,0	4,0	4,0	4,0

**Table C10: Essential characteristics for HAS-U-... and HAS-(E) under shear loads for seismic performance category C1**

HAS-U-... and HAS-(E)...		M10	M12	M16	M20	M24	M27	M30
<b>Steel failure without lever arm</b>								
HAS-U-5.8(F), HAS-(E) 5.8	$V_{Rk,s,seis}$ [kN]	11	15	27	43	62	-	-
HAS-U-8.8(F), HAS-(E) 8.8	$V_{Rk,s,seis}$ [kN]	16	24	44	69	99	129	157
HAS-U-R, HAS-R	$V_{Rk,s,seis}$ [kN]	14	21	39	60	87	81	98
HAS-U-HCR, HAS-HCR	$V_{Rk,s,seis}$ [kN]	16	24	44	69	87	-	-

HVU2

**Performances**

Essential characteristics for seismic performance category C1.

**Annex C10**

**Table C11: Essential characteristics for HAS-U-... and HAS-(E) under tension loads for seismic performance category C2**

HAS-U-... and HAS-(E)...		M16	M20
<b>Steel failure</b>			
HAS-U (-F) 8.8, HAS-(E)-(F) 8.8	$N_{Rk,s,seis}$ [kN]	126	196
<b>Combined pullout and concrete cone failure in cracked concrete C20/25 in hammer drilled holes and with hollow drill bit TE-CD or TE-YD</b>			
Temperature range I: 24 °C / 40 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	2,9	2,6
Temperature range II: 50 °C / 80 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	2,3	2,1
Temperature range III: 72 °C / 120 °C	$\tau_{Rk,seis}$ [N/mm <sup>2</sup> ]	1,4	1,3

**Table C12: Essential characteristics for HAS-U-... and HAS-(E) under shear loads for seismic performance category C2**

HAS-U-... and HAS-(E)...		M16	M20
<b>Steel failure without lever arm</b>			
HAS-U 8.8, HAS-(E) 8.8	$V_{Rk,s,seis}$ [kN]	40	71
HAS-U-F 8.8, HAS-F 8.8	$V_{Rk,s,seis}$ [kN]	30	46

**Table C13: Displacements under tension load for seismic performance category C2**

HAS-U-... and HAS-(E)...		M16	M20
Displacement DLS	$\delta_{N,seis(DLS)}$ [mm]	0,2	0,2
Displacement ULS	$\delta_{N,seis(ULS)}$ [mm]	0,4	0,5

**Table C14: Displacements under shear load for seismic performance category C2**

HAS-U-... and HAS-(E)...		M16	M20
Displacement DLS HAS-U 8.8, HAS-(E) 8.8	$\delta_{V,seis(DLS)}$ [mm]	3,2	2,5
Displacement DLS HAS-U-F 8.8, HAS-F 8.8	$\delta_{V,seis(DLS)}$ [mm]	2,3	3,8
Displacement ULS HAS-U 8.8, HAS-(E) 8.8	$\delta_{V,seis(ULS)}$ [mm]	9,2	7,1
Displacement ULS HAS-U-F 8.8, HAS-F 8.8	$\delta_{V,seis(ULS)}$ [mm]	4,3	9,1

HVU2

**Performances**

Essential characteristics for seismic performance category C2 and displacements.

**Annex C11**