

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-19/0201
of 17 December 2019

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Chemofast Injection System EP 1000 for concrete

Product family
to which the construction product belongs

Bonded fastener for use in concrete

Manufacturer

CHEMOFAST Anchoring GmbH
Hanns-Martin-Schleyer-Straße 23
47877 Willich
DEUTSCHLAND

Manufacturing plant

CHEMOFAST Anchoring GmbH
Hanns-Martin-Schleyer-Straße 23
47877 Willich
DEUTSCHLAND

This European Technical Assessment
contains

41 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330499-01-0601

This version replaces

ETA-19/0201 issued on 15 July 2019

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The "Chemofast Injection system EP 1000 for concrete" is a bonded anchor consisting of a cartridge with injection mortar Chemofast Injection mortar EP 1000 and a steel element according to Annex A3.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 and/or 100 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|---|
| Characteristic resistance for static and quasi-static tension load | See Annex C 1, C 2, C 3, C 4, C 5, C 7, C 8, C 10 to C 13 |
| Characteristic resistance for static and quasi-static shear load | See Annex C 1, C 2, C 4, C 6, C 14 |
| Displacements for static and quasi-static loading | See Annex C 15 to C 17 |
| Characteristic resistance for seismic performance category C1 and C2 and displacements | See Annex C 19 to C 25 |
| Durability | See Annex B 1 |

3.2 Hygiene, health and the environment (BWR 3)

| Essential characteristic | Performance |
|--|-------------------------|
| Content, emission and/or release of dangerous substances | No performance assessed |

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 17 December 2019 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow
Head of Department


beglaubigt:
Lange

Installation threaded rod M8 up to M30


prepositioned installation or
push through installation (annular gap filled with mortar)

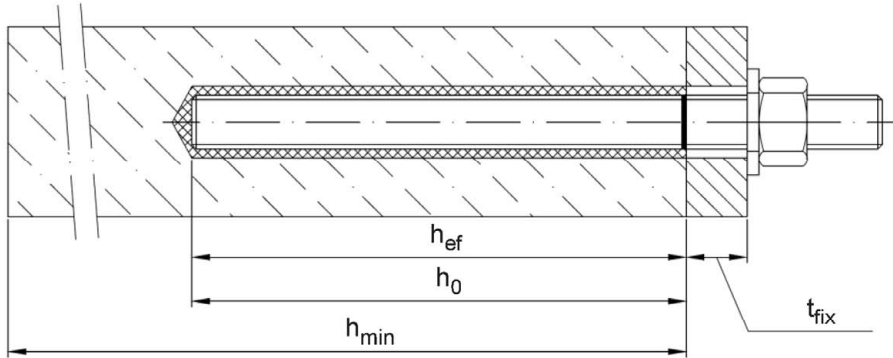

Installation reinforcing bar $\varnothing 8$ up to $\varnothing 32$

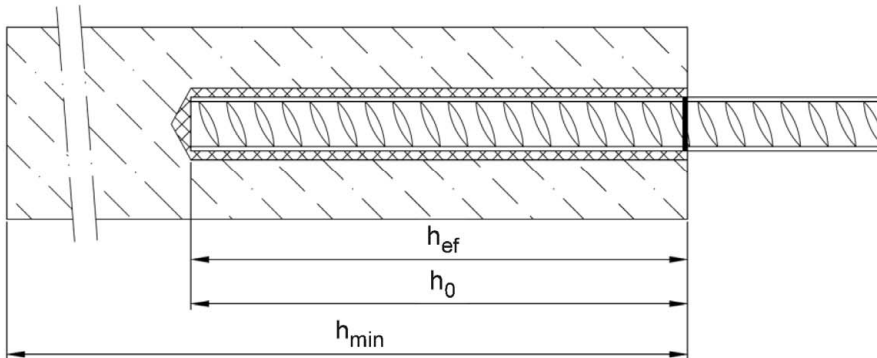

Installation internal threaded anchor rod IG-M6 up to IG-M20

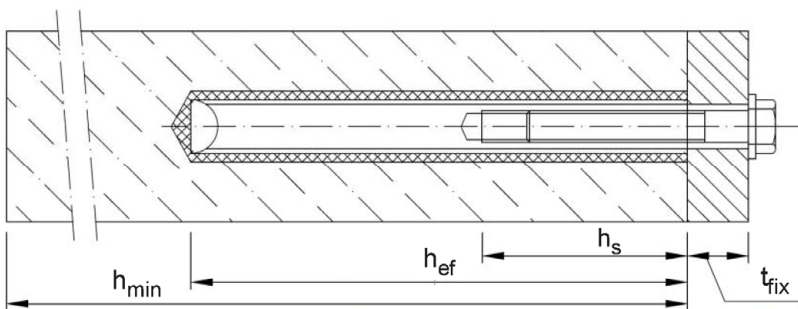

- t_{fix} = thickness of fixture
- h_{ef} = effective anchorage depth
- h_0 = depth of drill hole
- h_{min} = minimum thickness of member


Chemofast Injection System EP 1000 for concrete

Product description
Installed condition


Annex A 1

Cartridge: Chemofast EP 1000


440ml, 585ml and 1400ml cartridge (Type: "side-by-side")

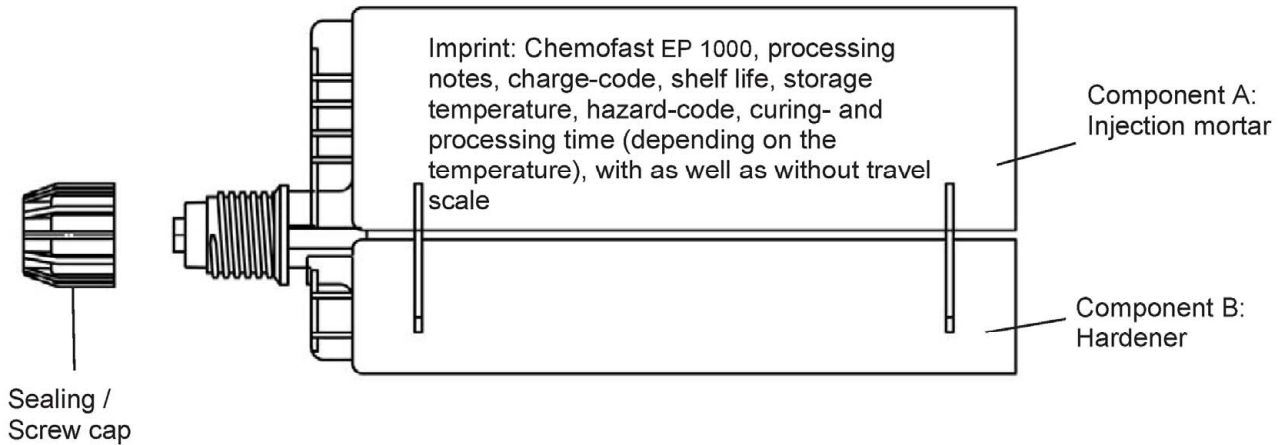

Static Mixer

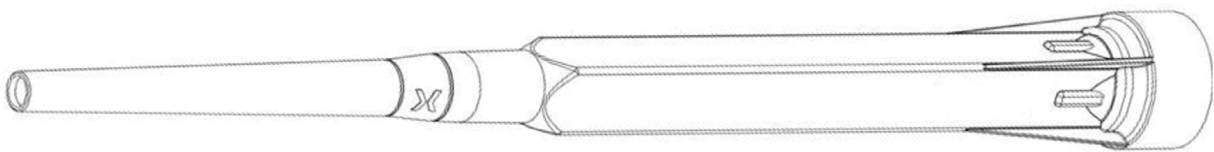

Piston Plug and Mixer Extension

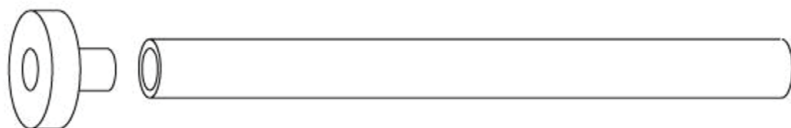


Electronic copy of the ETA by DIBt: ETA-19/0201

Chemofast Injection System EP 1000 for concrete

Product description
Injection system

Annex A 2



Threaded rod M8, M10, M12, M16, M20, M24, M27, M30 with washer and hexagon nut

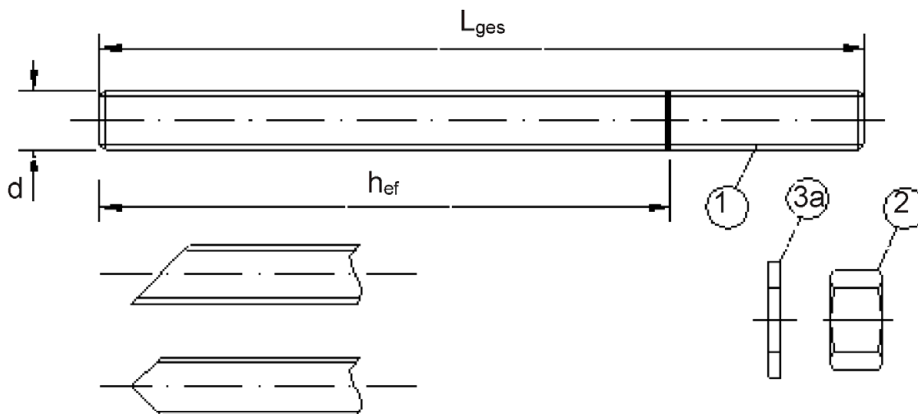



- Commercial standard threaded rod with:
- Materials, dimensions and mechanical properties acc. Table A1
 - Inspection certificate 3.1 acc. to EN 10204:2004
 - Marking of embedment depth

Internal threaded anchor rod IG-M6, IG-M8, IG-M10, IG-M12, IG-M16, IG-M20

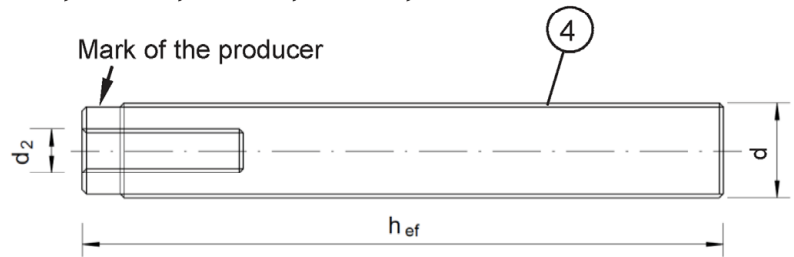Threaded rod or screw





Marking: e.g.  M8

 Marking Internal thread
 Mark

M8 Thread size (Internal thread)
A4 additional mark for stainless steel
HCR additional mark for high-corrosion resistance steel

Filling washer and mixer reduction nozzle for filling the annular gap between anchor rod and fixture




Chemofast Injection System EP 1000 for concrete

Product description
Threaded rod, internal threaded rod and filling washer

Annex A 3

| Table A1: Materials | | | | | | |
|--|--|---|--|-------------------------------------|-------------------------------|--------------------|
| Part | Designation | Material | | | | |
| Steel, zinc plated (Steel acc. to EN 10087:1998 or EN 10263:2001) | | | | | | |
| - zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:1999 or | | | | | | |
| - hot-dip galvanised $\geq 40 \mu\text{m}$ acc. to EN ISO 1461:2009 and EN ISO 10684:2004+AC:2009 or | | | | | | |
| - sherardized $\geq 45 \mu\text{m}$ acc. to EN ISO 17668:2016 | | | | | | |
| 1 | Threaded rod | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 898-1:2013 | 4.6 | $f_{uk} = 400 \text{ N/mm}^2$ | $f_{yk} = 240 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 4.8 | $f_{uk} = 400 \text{ N/mm}^2$ | $f_{yk} = 320 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 5.6 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 300 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 5.8 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 400 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| 8.8 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 640 \text{ N/mm}^2$ | $A_5 \geq 12\% ^3$ | | | |
| 2 | Hexagon nut | acc. to EN ISO 898-2:2012 | 4 | for anchor rod class 4.6 or 4.8 | | |
| | | | 5 | for anchor rod class 5.6 or 5.8 | | |
| | | | 8 | for anchor rod class 8.8 | | |
| 3a | Washer | Steel, zinc plated, hot-dip galvanised or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000) | | | | |
| 3b | Filling washer | Steel, zinc plated, hot-dip galvanised or sherardized | | | | |
| 4 | Internal threaded anchor rod | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 898-1:2013 | 5.8 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 400 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 8.8 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 640 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| Stainless steel A2 (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014) | | | | | | |
| Stainless steel A4 (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014) | | | | | | |
| High corrosion resistance steel (Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014) | | | | | | |
| 1 | Threaded rod ¹⁾⁴⁾ | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 3506-1:2009 | 50 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 210 \text{ N/mm}^2$ | $A_5 \geq 8\%$ |
| | | | 70 | $f_{uk} = 700 \text{ N/mm}^2$ | $f_{yk} = 450 \text{ N/mm}^2$ | $A_5 \geq 12\% ^3$ |
| 80 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 600 \text{ N/mm}^2$ | $A_5 \geq 12\% ^3$ | | | |
| 2 | Hexagon nut ¹⁾⁴⁾ | acc. to EN ISO 3506-1:2009 | 50 | for anchor rod class 50 | | |
| | | | 70 | for anchor rod class 70 | | |
| | | | 80 | for anchor rod class 80 | | |
| 3a | Washer | A2: Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000) | | | | |
| 3b | Filling washer | Stainless steel A4, High corrosion resistance steel | | | | |
| 4 | Internal threaded anchor rod ¹⁾²⁾ | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 3506-1:2009 | 50 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 210 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 70 | $f_{uk} = 700 \text{ N/mm}^2$ | $f_{yk} = 450 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| ¹⁾ Property class 70 or 80 for anchor rods up to M24 and Internal threaded anchor rods up to IG-M16, ²⁾ for IG-M20 only property class 50 ³⁾ $A_5 > 8\%$ fracture elongation if <u>no</u> requirement for performance category C2 exists ⁴⁾ Property class 80 only for stainless steel A4 and HCR | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | |
| Product description Materials threaded rod and internal threaded rod | | | | Annex A 4 | | |

Reinforcing bar $\varnothing 8, \varnothing 10, \varnothing 12, \varnothing 14, \varnothing 16, \varnothing 20, \varnothing 24, \varnothing 25, \varnothing 28, \varnothing 32$



- Minimum value of related rip area $f_{R,min}$ according to EN 1992-1-1:2004+AC:2010
- Rib height of the bar shall be in the range $0,05d \leq h \leq 0,07d$
(d: Nominal diameter of the bar; h: Rip height of the bar)

Table A2: Materials

| Part | Designation | Material |
|-------------------------|--|--|
| Reinforcing bars | | |
| 1 | Rebar EN 1992-1-1:2004+AC:2010, Annex C | Bars and de-coiled rods class B or C f_{yk} and k according to NDP or NCL of EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$ |

Chemofast Injection System EP 1000 for concrete

Product description
Materials reinforcing bar

Annex A 5

Specifications of intended use

Anchorage subject to:

- Static and quasi-static loads: M8 to M30, Rebar Ø8 to Ø32, IG-M6 to IG-M20.
- Seismic action for Performance Category C1: M8 to M30, Rebar Ø8 to Ø32.
- Seismic action for Performance Category C2: M12 to M24.

Base materials:

- Compacted, reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A1:2016.
- Strength classes C20/25 to C50/60 according to EN 206:2013 + A1:2016.
- Non-cracked concrete: M8 to M30, Rebar Ø8 to Ø32, IG-M6 to IG-M20.
- Cracked concrete: M8 to M30, Rebar Ø8 to Ø32, IG-M6 to IG-M20.

Temperature Range:

- I: - 40 °C to +40 °C (max long term temperature +24 °C and max short term temperature +40 °C)
- II: - 40 °C to +72 °C (max long term temperature +50 °C and max short term temperature +72 °C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (all materials).
- For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance class:
 - Stainless steel Stahl A2 according to Annex A 4, Table A1: CRC II
 - Stainless steel Stahl A4 according to Annex A 4, Table A1: CRC III
 - High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V

Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- The anchorages are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018

Installation:

- Dry, wet concrete or flooded bore holes (not sea-water).
- Hole drilling by hammer (HD), hollow (HDB), compressed air (CD) or diamond drill mode (DD).
- Overhead installation allowed.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

Chemofast Injection System EP 1000 for concrete

Intended Use
Specifications

Annex B 1

Table B1: Installation parameters for threaded rod

| Anchor size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|----------------------------------|------|--|-----|------------------|-----------------|-----|-----|-----|-----|
| Diameter of element | $d = d_{nom}$ | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 |
| Nominal drill hole diameter | d_0 | [mm] | 10 | 12 | 14 | 18 | 22 | 28 | 30 | 35 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 60 | 70 | 80 | 90 | 96 | 108 | 120 |
| | $h_{ef,max}$ | [mm] | 160 | 200 | 240 | 320 | 400 | 480 | 540 | 600 |
| Diameter of clearance hole in the fixture | Prepositioned installation d_f | [mm] | 9 | 12 | 14 | 18 | 22 | 26 | 30 | 33 |
| | Push through installation d_f | [mm] | 12 | 14 | 16 | 20 | 24 | 30 | 33 | 40 |
| Maximum torque moment | $T_{inst} \leq$ | [Nm] | 10 | 20 | 40 ¹⁾ | 60 | 100 | 170 | 250 | 300 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | | |
| Minimum spacing | s_{min} | [mm] | 40 | 50 | 60 | 75 | 95 | 115 | 125 | 140 |
| Minimum edge distance | c_{min} | [mm] | 35 | 40 | 45 | 50 | 60 | 65 | 75 | 80 |

¹⁾ Maximum Torque moment for M12 with steel Grade 4.6 is 35 Nm

Table B2: Installation parameters for rebar

| Anchor size | | | $\emptyset 8^1)$ | $\emptyset 10^1)$ | $\emptyset 12^1)$ | $\emptyset 14$ | $\emptyset 16$ | $\emptyset 20$ | $\emptyset 24$ | $\emptyset 25$ | $\emptyset 28$ | $\emptyset 32$ |
|-----------------------------|---------------|------|--|-------------------|-------------------|-----------------|----------------|----------------|----------------|----------------|----------------|----------------|
| Diameter of element | $d = d_{nom}$ | [mm] | 8 | 10 | 12 | 14 | 16 | 20 | 24 | 25 | 28 | 32 |
| Nominal drill hole diameter | d_0 | [mm] | 10 12 | 12 14 | 14 16 | 18 | 20 | 25 | 32 | 32 | 35 | 40 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 60 | 70 | 75 | 80 | 90 | 96 | 100 | 112 | 128 |
| | $h_{ef,max}$ | [mm] | 160 | 200 | 240 | 280 | 320 | 400 | 480 | 500 | 560 | 640 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | | | | |
| Minimum spacing | s_{min} | [mm] | 40 | 50 | 60 | 70 | 75 | 95 | 120 | 120 | 130 | 150 |
| Minimum edge distance | c_{min} | [mm] | 35 | 40 | 45 | 50 | 50 | 60 | 70 | 70 | 75 | 85 |

¹⁾ both nominal drill hole diameter can be used

Table B3: Installation parameters for Internal threaded anchor rod

| Anchor size | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 |
|--|-----------------|------|--|-------|--------|-----------------|--------|--------|
| Internal diameter of anchor rod | d_2 | [mm] | 6 | 8 | 10 | 12 | 16 | 20 |
| Outer diameter of anchor rod ¹⁾ | $d = d_{nom}$ | [mm] | 10 | 12 | 16 | 20 | 24 | 30 |
| Nominal drill hole diameter | d_0 | [mm] | 12 | 14 | 18 | 22 | 28 | 35 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 70 | 80 | 90 | 96 | 120 |
| | $h_{ef,max}$ | [mm] | 200 | 240 | 320 | 400 | 480 | 600 |
| Diameter of clearance hole in the fixture | d_f | [mm] | 7 | 9 | 12 | 14 | 18 | 22 |
| Maximum torque moment | $T_{inst} \leq$ | [Nm] | 10 | 10 | 20 | 40 | 60 | 100 |
| Thread engagement length min/max | l_{IG} | [mm] | 8/20 | 8/20 | 10/25 | 12/30 | 16/32 | 20/40 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | |
| Minimum spacing | s_{min} | [mm] | 50 | 60 | 75 | 95 | 115 | 140 |
| Minimum edge distance | c_{min} | [mm] | 40 | 45 | 50 | 60 | 65 | 80 |










¹⁾ With metric threads according to EN 1993-1-8:2005+AC:2009

Chemofast Injection System EP 1000 for concrete

Intended Use
Installation parameters

Annex B 2

Table B4: Parameter cleaning and setting tools

|  |  |  |  |  | | |  | | | |
|---|---|---|---|--|------|--|---|---|---|---|
| Threaded Rod | Rebar | Internal threaded anchor rod | d_0 Drill bit - \varnothing HD, HDB, CD, DD | d_b Brush - \varnothing | | $d_{b,min}$ min. Brush - \varnothing | Piston plug | Installation direction and use of piston plug | | |
| [mm] | [mm] | [mm] | [mm] | | [mm] | [mm] | |  |  |  |
| M8 | 8 | | 10 | RB10 | 11,5 | 10,5 | No plug required | | | |
| M10 | 8 / 10 | IG-M6 | 12 | RB12 | 13,5 | 12,5 | | | | |
| M12 | 10 / 12 | IG-M8 | 14 | RB14 | 15,5 | 14,5 | | | | |
| | 12 | | 16 | RB16 | 17,5 | 16,5 | | | | |
| M16 | 14 | IG-M10 | 18 | RB18 | 20,0 | 18,5 | VS18 | $h_{ef} > 250$ mm | $h_{ef} > 250$ mm | all |
| | 16 | | 20 | RB20 | 22,0 | 20,5 | VS20 | | | |
| M20 | | IG-M12 | 22 | RB22 | 24,0 | 22,5 | VS22 | | | |
| | 20 | | 25 | RB25 | 27,0 | 25,5 | VS25 | | | |
| M24 | | IG-M16 | 28 | RB28 | 30,0 | 28,5 | VS28 | | | |
| M27 | | | 30 | RB30 | 31,8 | 30,5 | VS30 | | | |
| | 24 / 25 | | 32 | RB32 | 34,0 | 32,5 | VS32 | | | |
| M30 | 28 | IG-M20 | 35 | RB35 | 37,0 | 35,5 | VS35 | | | |
| | 32 | | 40 | RB40 | 43,5 | 40,5 | VS40 | | | |

CAC - Rec. compressed air tool (min 6 bar)

Drill bit diameter (d_0): all diameters



HDB – Hollow drill bit system

Drill bit diameter (d_0): all diameters






The hollow drill bit system contains the Heller Duster Expert hollow drill bit and a class M vacuum with minimum negative pressure of 253 hPa and flow rate of minimum 150 m³/h (42 l/s).










Chemofast Injection System EP 1000 for concrete

Intended Use
Cleaning and setting tools

Annex B 3

| Installation instructions | |
|---|---|
| Drilling of the bore hole (HD, HDB, CD) | |
|  | <p>1a. Hammer (HD) or compressed air drilling (CD) Drill a hole into the base material to the size and embedment depth required by the selected anchor (Table B1, B2, or B3). Proceed with Step 2. In case of aborted drill hole, the drill hole shall be filled with mortar.</p> |
|  | <p>1b. Hollow drill bit system (HDB) (see Annex B 3) Drill a hole into the base material to the size and embedment depth required by the selected anchor (Table B1, B2, or B3). This drilling system removes the dust and cleans the bore hole during drilling (all conditions). Proceed with Step 3. In case of aborted drill hole, the drill hole shall be filled with mortar.</p> |
| <p>Attention! Standing water in the bore hole must be removed before cleaning.</p> | |
| CAC: Cleaning for dry, wet and water-filled bore holes with all diameter in uncracked and cracked concrete | |
|  | <p>2a. Starting from the bottom or back of the bore hole, blow the hole clean with compressed air (min. 6 bar) (Annex B 3) a minimum of two times until return air stream is free of noticeable dust. If the bore hole ground is not reached an extension must be used.</p> |
|  | <p>2b. Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush $> d_{b,min}$ (Table B4) a minimum of two times in a twisting motion. If the bore hole ground is not reached with the brush, a brush extension must be used.</p> |
|  | <p>2c. Finally blow the hole clean again with compressed air (min. 6 bar) (Annex B 3) a minimum of two times until return air stream is free of noticeable dust. If the bore hole ground is not reached an extension must be used.</p> |
| <p>After cleaning, the bore hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the bore hole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.</p> | |
| <p>Chemofast Injection System EP 1000 for concrete</p> | |
| <p>Intended Use Installation instructions</p> | <p>Annex B 4</p> |

| Installation instructions | |
|---|---|
| Drilling of the bore hole (DD) | |
|  | <p>1a. Diamond drilling (DD) Drill with diamond drill a hole into the base material to the size and embedment depth required by the selected anchor (Table B1, B2, or B3). Proceed with Step 2. In case of aborted drill hole, the drill hole shall be filled with mortar.</p> |
| SPCAC: Cleaning for dry, wet and water-filled bore holes with all diameter in uncracked concrete | |
|  | <p>Attention! Standing water in the bore hole must be removed before cleaning.</p> |
|  | <p>2a. Rinsing with water until clear water comes out.</p> <p>2b. Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush $> d_{b,min}$ (Table B4) a minimum of two times in a twisting motion. If the bore hole ground is not reached with the brush, a brush extension must be used.</p> |
|  | <p>2c. Rinsing again with water until clear water comes out.</p> |
|  | <p>2d. Starting from the bottom or back of the bore hole, blow the hole clean with compressed air (min. 6 bar) (Annex B 3) a minimum of two times until return air stream is free of noticeable dust. If the bore hole ground is not reached an extension must be used.</p> |
|  | <p>2e. Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush $> d_{b,min}$ (Table B4) a minimum of two times in a twisting motion. If the bore hole ground is not reached with the brush, a brush extension must be used.</p> |
|  | <p>2f. Finally blow the hole clean again with compressed air (min. 6 bar) (Annex B 3) a minimum of two times until return air stream is free of noticeable dust. If the bore hole ground is not reached an extension must be used.</p> |
| <p>After cleaning, the bore hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the bore hole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.</p> | |
| <p>Chemofast Injection System EP 1000 for concrete</p> | <p>Annex B 5</p> |
| <p>Intended Use Installation instructions</p> | |










| Installation instructions (continuation) | |
|--|---|
|    | <p>3. Attach the supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool. For every working interruption longer than the recommended working time (Table B5) as well as for new cartridges, a new static-mixer shall be used.</p> <p>4. Prior to inserting the anchor rod into the filled bore hole, the position of the embedment depth shall be marked on the anchor rods.</p> <p>5. Prior to dispensing into the anchor hole, squeeze out separately a minimum of three full strokes and discard non-uniformly mixed adhesive components until the mortar shows a consistent grey or red colour.</p> |
|     | <p>6. Starting from the bottom or back of the cleaned anchor hole, fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid creating air pockets. If the bottom or back of the anchor hole is not reached, an appropriate extension nozzle must be used. Observe the gel-/ working times given in Table B5.</p> <p>7. Piston plugs and mixer nozzle extensions shall be used according to Table B4 for the following applications:</p> <ul style="list-style-type: none"> • Horizontal assembly (horizontal direction) and ground erection (vertical downwards direction): Drill bit-$\varnothing d_0 \geq 18$ mm and embedment depth $h_{ef} > 250$mm • Overhead assembly (vertical upwards direction): Drill bit-$\varnothing d_0 \geq 18$ mm <p>8. Push the threaded rod or reinforcing bar into the anchor hole while turning slightly to ensure positive distribution of the adhesive until the embedment depth is reached.</p> <p>The anchor shall be free of dirt, grease, oil or other foreign material.</p> <p>9. After inserting the anchor, the annular gap between anchor rod and concrete, in case of a push through installation additionally also the fixture, must be complete filled with mortar. If excess mortar is not visible at the top of the hole, the requirement is not fulfilled and the application has to be renewed. For overhead application the anchor rod shall be fixed (e.g. wedges).</p> |
|   | <p>10. Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (attend Table B5).</p> <p>11. After full curing, the add-on part can be installed with up to the max. torque (Table B1 or B3) by using a calibrated torque wrench. In case of prepositioned installation the annular gap between anchor and fixture can be optional filled with mortar. Therefor substitute the washer by the filling washer and connect the mixer reduction nozzle to the tip of the mixer. The annular gap is filled with mortar, when mortar oozes out of the washer.</p> |
| <p>Chemofast Injection System EP 1000 for concrete</p> | |
| <p>Intended Use Installation instructions (continuation)</p> | <p>Annex B 6</p> |

Table B5: Maximum working time and minimum curing time

| Concrete temperature | Gelling working time | Minimum curing time in dry concrete | Minimum curing time in wet concrete |
|-----------------------|----------------------|-------------------------------------|-------------------------------------|
| + 5 °C to + 9 °C | 80 min | 48 h | 96 h |
| + 10 °C to + 14 °C | 60 min | 28 h | 56 h |
| + 15 °C to + 19 °C | 40 min | 18 h | 36 h |
| + 20 °C to + 24 °C | 30 min | 12 h | 24 h |
| + 25 °C to + 34 °C | 12 min | 9 h | 18 h |
| + 35 °C to + 39 °C | 8 min | 6 h | 12 h |
| +40 °C | 8 min | 4 h | 8 h |
| Cartridge temperature | +5°C to +40°C | | |

Chemofast Injection System EP 1000 for concrete

Intended Use
Curing time

Annex B 7

Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods

| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
|--|--|--------------------|---------|---------|---------|-----|-----|-----|-----|------------------|------|
| Cross section area | A_s | [mm ²] | 36,6 | 58 | 84,3 | 157 | 245 | 353 | 459 | 561 | |
| Characteristic tension resistance, Steel failure ¹⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 4.8 | $N_{Rk,s}$ | [kN] | 15 (13) | 23 (21) | 34 | 63 | 98 | 141 | 184 | 224 | |
| Steel, Property class 5.6 and 5.8 | $N_{Rk,s}$ | [kN] | 18 (17) | 29 (27) | 42 | 78 | 122 | 176 | 230 | 280 | |
| Steel, Property class 8.8 | $N_{Rk,s}$ | [kN] | 29 (27) | 46 (43) | 67 | 125 | 196 | 282 | 368 | 449 | |
| Stainless steel A2, A4 and HCR, class 50 | $N_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 | |
| Stainless steel A2, A4 and HCR, class 70 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 171 | 247 | - | - | |
| Stainless steel A4 and HCR, class 80 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | - | - | |
| Characteristic tension resistance, Partial factor ²⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 5.6 | $\gamma_{Ms,N}$ | [-] | 2,0 | | | | | | | | |
| Steel, Property class 4.8, 5.8 and 8.8 | $\gamma_{Ms,N}$ | [-] | 1,5 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 50 | $\gamma_{Ms,N}$ | [-] | 2,86 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 70 | $\gamma_{Ms,N}$ | [-] | 1,87 | | | | | | | | |
| Stainless steel A4 and HCR, class 80 | $\gamma_{Ms,N}$ | [-] | 1,6 | | | | | | | | |
| Characteristic shear resistance, Steel failure ¹⁾ | | | | | | | | | | | |
| Without lever arm | Steel, Property class 4.6 and 4.8 | $V^0_{Rk,s}$ | [kN] | 9 (8) | 14 (13) | 20 | 38 | 59 | 85 | 110 | 135 |
| | Steel, Property class 5.6 and 5.8 | $V^0_{Rk,s}$ | [kN] | 11 (10) | 17 (16) | 25 | 47 | 74 | 106 | 138 | 168 |
| | Steel, Property class 8.8 | $V^0_{Rk,s}$ | [kN] | 15 (13) | 23 (21) | 34 | 63 | 98 | 141 | 184 | 224 |
| | Stainless steel A2, A4 and HCR, class 50 | $V^0_{Rk,s}$ | [kN] | 9 | 15 | 21 | 39 | 61 | 88 | 115 | 140 |
| | Stainless steel A2, A4 and HCR, class 70 | $V^0_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 | - | - |
| | Stainless steel A4 and HCR, class 80 | $V^0_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | - | - |
| With lever arm | Steel, Property class 4.6 and 4.8 | $M^0_{Rk,s}$ | [Nm] | 15 (13) | 30 (27) | 52 | 133 | 260 | 449 | 666 | 900 |
| | Steel, Property class 5.6 and 5.8 | $M^0_{Rk,s}$ | [Nm] | 19 (16) | 37 (33) | 65 | 166 | 324 | 560 | 833 | 1123 |
| | Steel, Property class 8.8 | $M^0_{Rk,s}$ | [Nm] | 30 (26) | 60 (53) | 105 | 266 | 519 | 896 | 1333 | 1797 |
| | Stainless steel A2, A4 and HCR, class 50 | $M^0_{Rk,s}$ | [Nm] | 19 | 37 | 66 | 167 | 325 | 561 | 832 | 1125 |
| | Stainless steel A2, A4 and HCR, class 70 | $M^0_{Rk,s}$ | [Nm] | 26 | 52 | 92 | 232 | 454 | 784 | - | - |
| | Stainless steel A4 and HCR, class 80 | $M^0_{Rk,s}$ | [Nm] | 30 | 59 | 105 | 266 | 519 | 896 | - | - |
| Characteristic shear resistance, Partial factor ²⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 5.6 | $\gamma_{Ms,V}$ | [-] | 1,67 | | | | | | | | |
| Steel, Property class 4.8, 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 50 | $\gamma_{Ms,V}$ | [-] | 2,38 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 70 | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | | | | |
| Stainless steel A4 and HCR, class 80 | $\gamma_{Ms,V}$ | [-] | 1,33 | | | | | | | | |
| ¹⁾ Values are only valid for the given stress area A_s . Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hot-dip galvanised threaded rods according to EN ISO 10684:2004+AC:2009. ²⁾ in absence of national regulation | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 1 | |
| Performances Characteristic values for steel tension resistance and steel shear resistance of threaded rods | | | | | | | | | | | |

| Table C2: Characteristic values for Concrete cone failure and Splitting with all kind of action | | | | |
|--|------------------------|----------------------------------|------------------|--|
| Anchor | | All Anchor type and sizes | | |
| Concrete cone failure | | | | |
| Non-cracked concrete | $k_{ucr,N}$ | [-] | 11,0 | |
| Cracked concrete | $k_{cr,N}$ | [-] | 7,7 | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | |
| Axial distance | $s_{cr,N}$ | [mm] | 2 $c_{cr,N}$ | |
| Splitting | | | | |
| Edge distance | $h/h_{ef} \geq 2,0$ | $c_{cr,sp}$ | [mm] | 1,0 h_{ef} |
| | $2,0 > h/h_{ef} > 1,3$ | | | $2 \cdot h_{ef} \left(2,5 - \frac{h}{h_{ef}} \right)$ |
| | $h/h_{ef} \leq 1,3$ | | | 2,4 h_{ef} |
| Axial distance | $s_{cr,sp}$ | [mm] | 2 $c_{cr,sp}$ | |
| | | | | |
| Chemofast Injection System EP 1000 for concrete | | | Annex C 2 | |
| Performances Characteristic values for Concrete cone failure and Splitting with all kind of action | | | | |

| Table C3: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | |
|--|---------------|---|-----------------|--------------------------------------|------------|------------|------------|------------|------------|------------------|------------|-----|
| Anchor size threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}$ (or see Table C1) | | | | | | | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 20 | 20 | 19 | 19 | 18 | 17 | 16 | 16 |
| | II: 72°C/50°C | | | | 15 | 15 | 15 | 14 | 13 | 13 | 12 | 12 |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 17 | 16 | 16 | 16 | 15 | 14 | 14 | 13 |
| | II: 72°C/50°C | | | | 14 | 14 | 14 | 13 | 13 | 12 | 12 | 11 |
| | I: 40°C/24°C | flooded bore hole | | | 16 | 16 | 16 | 15 | 15 | 14 | 14 | 13 |
| | II: 72°C/50°C | | | | 14 | 14 | 14 | 13 | 13 | 12 | 12 | 11 |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD) , compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 7,0 | 7,0 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 |
| | II: 72°C/50°C | | | | 6,0 | 6,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | |
| | II: 72°C/50°C | | | | 0,68 | | | | | | | |
| Increasing factors for concrete ψ_c | | | C25/30 | 1,02 | | | | | | | | |
| | | | C30/37 | 1,04 | | | | | | | | |
| | | | C35/45 | 1,07 | | | | | | | | |
| | | | C40/50 | 1,08 | | | | | | | | |
| | | | C45/55 | 1,09 | | | | | | | | |
| | | | C50/60 | 1,10 | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Splitting | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Installation factor | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | γ_{inst} | [-] | 1,0 | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | 1,2 | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 3 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | |

| Table C4: Characteristic values of tension loads under static and quasi-static action for a service life of 100 years | | | | | | | | | | | | |
|--|---|-----------------|----------------------|--------------------------------------|------------|------------|------------|------------|------------|------------------|------------|--|
| Anchor size threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}$ (or see Table C1) | | | | | | | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 20 | 20 | 19 | 19 | 18 | 17 | 16 | 16 | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 17 | 16 | 16 | 16 | 15 | 14 | 14 | 13 | |
| Temperature range I: 40°C/24°C | flooded bore hole | | | 16 | 16 | 16 | 15 | 15 | 14 | 14 | 13 | |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD) , compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 6,5 | 6,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | |
| Increasing factors for concrete ψ_c | | C25/30 | | 1,02 | | | | | | | | |
| | | C30/37 | | 1,04 | | | | | | | | |
| | | C35/45 | | 1,07 | | | | | | | | |
| | | C40/50 | | 1,08 | | | | | | | | |
| | | C45/55 | | 1,09 | | | | | | | | |
| | | C50/60 | | 1,10 | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Splitting | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Installation factor | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | γ_{inst} | [-] | 1,0 | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | 1,2 | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 4 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | |

| Table C5: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | |
|---|---------------|---|-----------------|--------------------------------------|------------|------------|------------|------------|------------|------------------|------------|-----|
| Anchor size threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}$ (or see Table C1) | | | | | | | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 15 | 14 | 14 | 13 | 12 | 12 | 11 | 11 |
| | II: 72°C/50°C | | | | 12 | 12 | 11 | 10 | 9,5 | 9,5 | 9,0 | 9,0 |
| Reduction factor ψ_{sus}^0 in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,77 | | | | | | | |
| | II: 72°C/50°C | | | | 0,72 | | | | | | | |
| Increasing factors for concrete ψ_c | C25/30 | | | 1,04 | | | | | | | | |
| | C30/37 | | | 1,08 | | | | | | | | |
| | C35/45 | | | 1,12 | | | | | | | | |
| | C40/50 | | | 1,15 | | | | | | | | |
| | C45/55 | | | 1,17 | | | | | | | | |
| | C50/60 | | | 1,19 | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Splitting | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | |
| Installation factor | | | | | | | | | | | | |
| for dry and wet concrete (DD) | | γ_{inst} | [-] | 1,0 | | | | | | | | |
| for flooded bore hole (DD) | | | | 1,2 | | | 1,4 | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 5 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | |

| Table C6: Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | | |
|---|------------------|--------------------|---|------------|------------|------------|------------|------------|------------------------------|------------|--|
| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure without lever arm | | | | | | | | | | | |
| Characteristic shear resistance Steel, strength class 4.6, 4.8 and 5.6, 5.8 | $V_{Rk,s}^0$ | [kN] | 0,6 · A _s · f _{uk} (or see Table C1) | | | | | | | | |
| Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all strength classes | $V_{Rk,s}^0$ | [kN] | 0,5 · A _s · f _{uk} (or see Table C1) | | | | | | | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s}^0$ | [Nm] | 1,2 · W _{el} · f _{uk} (or see Table C1) | | | | | | | | |
| Elastic section modulus | W _{el} | [mm ³] | 31 | 62 | 109 | 277 | 541 | 935 | 1387 | 1874 | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | min(h _{ef} ; 12 · d _{nom}) | | | | | | min(h _{ef} ; 300mm) | | |
| Outside diameter of fastener | d _{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | Annex C 6 | | |
| Performances Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | | |

Table C7: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years

| Anchor size internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
|---|-----------------|---|-----------------|----------------------|-------|--------|--------|------------------|--------|-----|
| Steel failure¹⁾ | | | | | | | | | | |
| Characteristic tension resistance, | 5.8 | $N_{Rk,s}$ | [kN] | 10 | 17 | 29 | 42 | 76 | 123 | |
| Steel, strength class | 8.8 | $N_{Rk,s}$ | [kN] | 16 | 27 | 46 | 67 | 121 | 196 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,N}$ | | [-] | 1,5 | | | | | | |
| Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $N_{Rk,s}$ | [kN] | 14 | 26 | 41 | 59 | 110 | 124 | |
| Partial factor | $\gamma_{Ms,N}$ | | [-] | 1,87 | | | | | | |
| Combined pull-out and concrete cone failure | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 20 | 19 | 19 | 18 | 17 | 16 |
| | II: 72°C/50°C | | | | 15 | 15 | 14 | 13 | 13 | 12 |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 16 | 16 | 16 | 15 | 14 | 13 |
| | II: 72°C/50°C | | | | 14 | 14 | 13 | 13 | 12 | 11 |
| | I: 40°C/24°C | flooded bore hole | | | 16 | 16 | 15 | 15 | 14 | 13 |
| | II: 72°C/50°C | | | | 14 | 14 | 13 | 13 | 12 | 11 |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 7,0 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 |
| | II: 72°C/50°C | | | | 6,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | |
| | II: 72°C/50°C | | | | 0,68 | | | | | |
| Increasing factors for concrete ψ_c | | | | C25/30 | 1,02 | | | | | |
| | | | | C30/37 | 1,04 | | | | | |
| | | | | C35/45 | 1,07 | | | | | |
| | | | | C40/50 | 1,08 | | | | | |
| | | | | C45/55 | 1,09 | | | | | |
| | | | | C50/60 | 1,10 | | | | | |
| Concrete cone failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Splitting failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Installation factor | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | | | γ_{inst} | [-] | 1,0 | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | | | 1,2 | | | | |
| ¹⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ²⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | Annex C 7 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | |

| Table C8: Characteristic values of tension loads under static and quasi-static action for a service life of 100 years | | | | | | | | | | |
|---|-----------------|---|-----------------|----------------------|--------------|---------------|---------------|------------------|---------------|-----|
| Anchor size internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
| Steel failure¹⁾ | | | | | | | | | | |
| Characteristic tension resistance, | 5.8 | $N_{Rk,s}$ | [kN] | 10 | 17 | 29 | 42 | 76 | 123 | |
| Steel, strength class | 8.8 | $N_{Rk,s}$ | [kN] | 16 | 27 | 46 | 67 | 121 | 196 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,N}$ | | [-] | 1,5 | | | | | | |
| Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $N_{Rk,s}$ | [kN] | 14 | 26 | 41 | 59 | 110 | 124 | |
| Partial factor | $\gamma_{Ms,N}$ | | [-] | 1,87 | | | | | 2,86 | |
| Combined pull-out and concrete cone failure | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 20 | 19 | 19 | 18 | 17 | 16 |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 16 | 16 | 16 | 15 | 14 | 13 |
| | I: 40°C/24°C | flooded bore hole | | | 16 | 16 | 15 | 15 | 14 | 13 |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 6,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | All conditions | ψ_{sus}^0 | [-] | 0,80 | | | | | |
| Increasing factors for concrete ψ_c | | | C25/30 | | 1,02 | | | | | |
| | | | C30/37 | | 1,04 | | | | | |
| | | | C35/45 | | 1,07 | | | | | |
| | | | C40/50 | | 1,08 | | | | | |
| | | | C45/55 | | 1,09 | | | | | |
| | | | C50/60 | | 1,10 | | | | | |
| Concrete cone failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Splitting failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Installation factor | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | | γ_{inst} | [-] | 1,0 | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | | 1,2 | | | | | |
| ³⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ⁴⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | Annex C 8 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | |

| Table C9: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years | | | | | | | | | | |
|---|-----------------|---|-----------------|----------------------|--------------|---------------|---------------|------------------|---------------|-----|
| Anchor size internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
| Steel failure¹⁾ | | | | | | | | | | |
| Characteristic tension resistance, | 5.8 | $N_{Rk,s}$ | [kN] | 10 | 17 | 29 | 42 | 76 | 123 | |
| Steel, strength class | 8.8 | $N_{Rk,s}$ | [kN] | 16 | 27 | 46 | 67 | 121 | 196 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,N}$ | | [-] | 1,5 | | | | | | |
| Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $N_{Rk,s}$ | [kN] | 14 | 26 | 41 | 59 | 110 | 124 | |
| Partial factor | $\gamma_{Ms,N}$ | | [-] | 1,87 | | | | | 2,86 | |
| Combined pull-out and concrete cone failure | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 14 | 14 | 13 | 12 | 12 | 11 |
| | II: 72°C/50°C | | | | 12 | 11 | 10 | 9,5 | 9,5 | 9,0 |
| Reduction factor ψ_{sus}^0 in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,77 | | | | | |
| | II: 72°C/50°C | | | | 0,72 | | | | | |
| Increasing factors for concrete ψ_c | C25/30 | | | 1,04 | | | | | | |
| | C30/37 | | | 1,08 | | | | | | |
| | C35/45 | | | 1,12 | | | | | | |
| | C40/50 | | | 1,15 | | | | | | |
| | C45/55 | | | 1,17 | | | | | | |
| | C50/60 | | | 1,19 | | | | | | |
| Concrete cone failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Splitting failure | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | |
| Installation factor | | | | | | | | | | |
| for dry and wet concrete (DD) | | | γ_{inst} | [-] | 1,0 | | | | | |
| for flooded bore hole (DD) | | | | | 1,2 | 1,4 | | | | |
| ⁵⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ⁶⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | Annex C 9 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | |

| Table C10: Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | |
|--|-----------------|-----------------|----------------------------------|--------------|--------------|---------------|---------------|-------------------|------------------------------|--|
| Anchor size for internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
| Steel failure without lever arm¹⁾ | | | | | | | | | | |
| Characteristic shear resistance, Steel, strength class | 5.8 | $V_{Rk,s}^0$ | [kN] | 5 | 9 | 15 | 21 | 38 | 61 | |
| | 8.8 | $V_{Rk,s}^0$ | [kN] | 8 | 14 | 23 | 34 | 60 | 98 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | |
| Characteristic shear resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $V_{Rk,s}^0$ | [kN] | 7 | 13 | 20 | 30 | 55 | 40 | |
| | Partial factor | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | 2,38 | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | |
| Steel failure with lever arm¹⁾ | | | | | | | | | | |
| Characteristic bending moment, Steel, strength class | 5.8 | $M_{Rk,s}^0$ | [Nm] | 8 | 19 | 37 | 66 | 167 | 325 | |
| | 8.8 | $M_{Rk,s}^0$ | [Nm] | 12 | 30 | 60 | 105 | 267 | 519 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | |
| Characteristic bending moment, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $M_{Rk,s}^0$ | [Nm] | 11 | 26 | 52 | 92 | 233 | 456 | |
| | Partial factor | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | 2,38 | |
| Concrete pry-out failure | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Concrete edge failure | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | | $\min(h_{ef}; 300\text{mm})$ | |
| Outside diameter of fastener | d_{nom} | [mm] | 10 | 12 | 16 | 20 | 24 | 30 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| ¹⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ²⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | Annex C 10 | | |
| Performances Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | |

| Table C11: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | | | | |
|--|-----------------|---|-------------------------|----------------------|------|------|------|------|------|------|-------------------|------|-----|-----|-----|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | | | |
| Steel failure | | | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | | | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 16 | 16 | 16 | 16 | 16 | 16 | 15 | 15 | 15 | 15 | |
| | II: 72°C/50°C | | | | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 11 | 11 | 11 |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 14 | 14 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | |
| | II: 72°C/50°C | | | | 12 | 12 | 12 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 |
| | I: 40°C/24°C | flooded bore hole | | | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 |
| | II: 72°C/50°C | | | | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 7,0 | 7,0 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | |
| | II: 72°C/50°C | | | | 6,0 | 6,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | | | |
| | II: 72°C/50°C | | | | 0,68 | | | | | | | | | | |
| Increasing factors for concrete ψ_c | C25/30 | | | 1,02 | | | | | | | | | | | |
| | C30/37 | | | 1,04 | | | | | | | | | | | |
| | C35/45 | | | 1,07 | | | | | | | | | | | |
| | C40/50 | | | 1,08 | | | | | | | | | | | |
| | C45/55 | | | 1,09 | | | | | | | | | | | |
| | C50/60 | | | 1,10 | | | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | | γ_{inst} | [-] | 1,0 | | | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | | 1,2 | | | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 11 | | | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | | | | |

| Table C12: Characteristic values of tension loads under static and quasi-static action for a service life of 100 years | | | | | | | | | | | | | |
|--|---|--------------------|-------------------------|------|------|------|------|------|------|------|-------------------|------|-----|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | |
| Steel failure | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 16 | 16 | 16 | 16 | 16 | 16 | 15 | 15 | 15 | 15 |
| Characteristic bond resistance in non-cracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 14 | 14 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 |
| | flooded bore hole | | | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 | 13 |
| Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,cr}$ | [N/mm ²] | 6,5 | 6,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | | |
| Increasing factors for concrete ψ_c | C25/30 | | 1,02 | | | | | | | | | | |
| | C30/37 | | 1,04 | | | | | | | | | | |
| | C35/45 | | 1,07 | | | | | | | | | | |
| | C40/50 | | 1,08 | | | | | | | | | | |
| | C45/55 | | 1,09 | | | | | | | | | | |
| | C50/60 | | 1,10 | | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | γ_{inst} | [-] | 1,0 | | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | 1,2 | | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 12 | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | | |

| Table C13: Characteristic values of tension loads under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | | | |
|--|-----------------|---|-------------------------|----------------------|------|------|------|------|------|------|-------------------|------|-----|-----|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | | |
| Steel failure | | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | | |
| Characteristic bond resistance in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,ucr}$ | [N/mm ²] | 14 | 13 | 13 | 13 | 12 | 12 | 11 | 11 | 11 | 11 |
| | II: 72°C/50°C | | | | 11 | 11 | 10 | 10 | 10 | 9,5 | 9,5 | 9,5 | 9,0 | 9,0 |
| Reduction factor ψ_{sus}^0 in non-cracked concrete C20/25 in diamond drilled holes (DD) | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,77 | | | | | | | | | |
| | II: 72°C/50°C | | | | 0,72 | | | | | | | | | |
| Increasing factors for concrete ψ_c | C25/30 | | | 1,04 | | | | | | | | | | |
| | C30/37 | | | 1,08 | | | | | | | | | | |
| | C35/45 | | | 1,12 | | | | | | | | | | |
| | C40/50 | | | 1,15 | | | | | | | | | | |
| | C45/55 | | | 1,17 | | | | | | | | | | |
| | C50/60 | | | 1,19 | | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | | |
| for dry and wet concrete (DD) | | γ_{inst} | [-] | 1,0 | | | | | | | | | | |
| for flooded bore hole (DD) | | | | 1,2 | | | | | 1,4 | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 13 | | | |
| Performances Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | | | |

| Table C14: Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | | | | | |
|--|-----------------|--------------------|---|------|------|------|------|------|------|------------------------------|------|------|--|--|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | | |
| Steel failure without lever arm | | | | | | | | | | | | | | |
| Characteristic shear resistance | $V_{RK,s}^0$ | [kN] | $0,5 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,5 ²⁾ | | | | | | | | | | | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | | | | |
| Characteristic bending moment | $M_{RK,s}^0$ | [Nm] | $1,2 \cdot W_{el} \cdot f_{uk}^{1)}$ | | | | | | | | | | | |
| Elastic section modulus | W_{el} | [mm ³] | 50 | 98 | 170 | 269 | 402 | 785 | 1357 | 1534 | 2155 | 3217 | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,5 ²⁾ | | | | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | | | $\min(h_{ef}; 300\text{mm})$ | | | | |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 14 | 16 | 20 | 24 | 25 | 28 | 32 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 14 | | | | |
| Performances | | | Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | | |

Table C15: Displacements under tension load¹⁾ in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB)

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|----------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,039 | 0,041 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,039 | 0,041 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,038 | 0,039 | 0,040 | 0,044 | 0,047 | 0,051 | 0,052 | 0,055 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,047 | 0,049 | 0,051 | 0,055 | 0,059 | 0,064 | 0,067 | 0,070 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,081 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,193 | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,092 | 0,095 | 0,096 | 0,099 | 0,102 | 0,106 | 0,109 | 0,110 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,259 | 0,154 | 0,163 | 0,172 | 0,181 | 0,189 | 0,207 | 0,229 |
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,039 | 0,041 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,028 | 0,030 | 0,031 | 0,033 | 0,036 | 0,038 | 0,040 | 0,042 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,081 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,193 | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

Table C16: Displacements under tension load¹⁾ in diamond drilled holes (DD)

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--|----------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,011 | 0,012 | 0,012 | 0,013 | 0,014 | 0,014 | 0,015 | 0,015 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,018 | 0,019 | 0,019 | 0,020 | 0,022 | 0,023 | 0,024 | 0,025 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,013 | 0,014 | 0,014 | 0,015 | 0,016 | 0,016 | 0,018 | 0,018 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,052 | 0,053 | 0,055 | 0,058 | 0,062 | 0,065 | 0,068 | 0,070 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

Table C17: Displacements under shear load²⁾ for all drilling methods

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|----------------------------|---------|------|------|------|------|------|------|------|------|
| Non-cracked and cracked concrete C20/25 under static and quasi-static action | | | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,06 | 0,06 | 0,05 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,05 |

²⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

Chemofast Injection System EP 1000 for concrete

Performances

Displacements under static and quasi-static action (threaded rods)

Annex C 15

Table C18: Displacements under tension load¹⁾ in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB)

| Anchor size Internal threaded anchor rod | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
|---|----------------------------|---------------------------|-------|--------|--------|--------|--------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,041 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,041 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,039 | 0,040 | 0,044 | 0,047 | 0,051 | 0,055 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,049 | 0,051 | 0,055 | 0,059 | 0,064 | 0,070 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,171 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,095 | 0,096 | 0,099 | 0,102 | 0,106 | 0,110 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,154 | 0,163 | 0,172 | 0,181 | 0,189 | 0,229 |
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,029 | 0,030 | 0,033 | 0,035 | 0,038 | 0,041 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,030 | 0,031 | 0,033 | 0,036 | 0,038 | 0,042 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,171 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

τ : action bond stress for tension

Table C19: Displacements under tension load¹⁾ in diamond drilled holes (DD)

| Anchor size Internal threaded anchor rod | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
|--|----------------------------|---------------------------|-------|--------|--------|--------|--------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,012 | 0,012 | 0,013 | 0,014 | 0,014 | 0,015 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,019 | 0,019 | 0,020 | 0,022 | 0,023 | 0,025 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,014 | 0,014 | 0,015 | 0,016 | 0,016 | 0,018 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,053 | 0,055 | 0,058 | 0,062 | 0,065 | 0,070 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

τ : action bond stress for tension

Table C20: Displacements under shear load²⁾ for all drilling methods

| Anchor size Internal threaded anchor rod | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
|---|----------------------------|---------|-------|--------|--------|--------|--------|------|
| Non-cracked and cracked concrete C20/25 under static and quasi-static action | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,07 | 0,06 | 0,06 | 0,05 | 0,04 | 0,04 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,10 | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 |

²⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

V : action shear load

Chemofast Injection System EP 1000 for concrete

Performances

Displacements under static and quasi-static action (Internal threaded anchor rod)

Annex C 16

Table C21: Displacements under tension load¹⁾ in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB)

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 |
|---|-------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | |
| Temp.- range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,031 | 0,033 | 0,035 | 0,038 | 0,038 | 0,040 | 0,043 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,031 | 0,033 | 0,035 | 0,038 | 0,038 | 0,040 | 0,043 |
| Temp.- range II: 72°C/50°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,038 | 0,039 | 0,040 | 0,042 | 0,044 | 0,047 | 0,051 | 0,051 | 0,054 | 0,058 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,047 | 0,049 | 0,051 | 0,053 | 0,055 | 0,059 | 0,065 | 0,065 | 0,068 | 0,072 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | |
| Temp.- range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,073 | 0,074 | 0,076 | 0,079 | 0,079 | 0,081 | 0,084 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 | 0,171 | 0,181 | 0,194 |
| Temp.- range II: 72°C/50°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,092 | 0,095 | 0,096 | 0,098 | 0,099 | 0,102 | 0,106 | 0,106 | 0,109 | 0,113 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,154 | 0,163 | 0,172 | 0,181 | 0,189 | 0,207 | 0,229 | 0,229 | 0,242 | 0,260 |
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | | | | | |
| Temp.- range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,028 | 0,029 | 0,030 | 0,031 | 0,033 | 0,035 | 0,038 | 0,038 | 0,040 | 0,043 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,028 | 0,030 | 0,031 | 0,032 | 0,033 | 0,036 | 0,039 | 0,039 | 0,041 | 0,043 |
| Cracked concrete C20/25 under static and quasi-static action for a service life of 100 years | | | | | | | | | | | | |
| Temp.- range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,073 | 0,074 | 0,076 | 0,079 | 0,079 | 0,081 | 0,084 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 | 0,171 | 0,181 | 0,194 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0\text{-factor}} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot \tau;$$

Table C22: Displacements under tension load¹⁾ in diamond drilled holes (DD)

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 |
|--|-------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Non-cracked concrete C20/25 under static and quasi-static action for a service life of 50 years | | | | | | | | | | | | |
| Temp.- range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,008 | 0,009 | 0,009 | 0,01 | 0,011 | 0,012 | 0,013 | 0,013 | 0,014 | 0,015 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,018 | 0,018 | 0,019 | 0,020 | 0,021 | 0,024 | 0,027 | 0,027 | 0,028 | 0,031 |
| Temp.- range II: 72°C/50°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,009 | 0,011 | 0,011 | 0,012 | 0,013 | 0,014 | 0,015 | 0,015 | 0,016 | 0,018 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,048 | 0,051 | 0,054 | 0,058 | 0,061 | 0,068 | 0,076 | 0,076 | 0,081 | 0,088 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0\text{-factor}} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot \tau;$$

Table C23: Displacements under shear load²⁾ for all drilling methods

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 |
|---|-------------------------|---------|------|------|------|------|------|------|------|------|------|------|
| For concrete C20/25 under static and quasi-static action | | | | | | | | | | | | |
| All temperature ranges | δ _{V0} -factor | [mm/kN] | 0,06 | 0,05 | 0,05 | 0,04 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 | 0,03 |
| | δ _{V∞} -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,05 | 0,04 | 0,04 |

²⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0\text{-factor}} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-factor}} \cdot V;$$

Chemofast Injection System EP 1000 for concrete

Performances
Displacements under static and quasi-static action (rebar)

Annex C 17

| Table C24: Characteristic values of tension loads under seismic action (performance category C1+C2) for a service life of 50 years | | | | | | | | | | | | |
|--|--|-------------------|----------------------|------------|----------------------|----------------------|------------|------------|------------|-------------------|-----|-----|
| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | | |
| Steel failure | | | | | | | | | | | | |
| Characteristic tension resistance (Seismic C1) | | | $N_{Rk,s,eq,C1}$ | [kN] | $1,0 \cdot N_{Rk,s}$ | | | | | | | |
| Characteristic tension resistance, (Seismic C2) Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class ≥ 70 | | | $N_{Rk,s,eq,C2}$ | [kN] | NPA | $1,0 \cdot N_{Rk,s}$ | | | | | NPA | |
| Partial factor | | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | |
| Characteristic bond resistance in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C II: 72°C/50°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,eq,C1}$ | [N/mm ²] | 7,0 | 7,0 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 |
| | | $\tau_{Rk,eq,C2}$ | [N/mm ²] | NPA | | 5,8 | 4,8 | 5,0 | 5,1 | NPA | | |
| | | $\tau_{Rk,eq,C1}$ | [N/mm ²] | 6,0 | 6,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 |
| | | $\tau_{Rk,eq,C2}$ | [N/mm ²] | NPA | | 5,0 | 4,1 | 4,3 | 4,4 | NPA | | |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C II: 72°C/50°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | |
| | | | | 0,68 | | | | | | | | |
| Increasing factors for concrete ψ_c | | | C25/30 to C50/60 | | | 1,0 | | | | | | |
| Concrete cone failure | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | |
| Splitting | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | |
| Installation factor | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | | γ_{inst} | [-] | 1,0 | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | | 1,2 | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 18 | | |
| Performances Characteristic values of tension loads under seismic action (performance category C1+C2) | | | | | | | | | | | | |

| Table C25: Characteristic values of tension loads under seismic action (performance category C1+C2) for a service life of 100 years | | | | | | | | | | | |
|--|--|-------------------|----------------------|----------------------|------------|----------------------|------------|------------|------------|-------------------|------------|
| Anchor size threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel failure | | | | | | | | | | | |
| Characteristic tension resistance (Seismic C1) | | $N_{Rk,s,eq,C1}$ | [kN] | $1,0 \cdot N_{Rk,s}$ | | | | | | | |
| Characteristic tension resistance, (Seismic C2) Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class ≥ 70 | | $N_{Rk,s,eq,C2}$ | [kN] | NPA | | $1,0 \cdot N_{Rk,s}$ | | | | NPA | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | |
| Characteristic bond resistance in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,eq,C1}$ | [N/mm ²] | 6,5 | 6,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 |
| | | $\tau_{Rk,eq,C2}$ | [N/mm ²] | NPA | | 5,8 | 4,8 | 5,0 | 5,1 | NPA | |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | |
| Increasing factors for concrete ψ_C | | C25/30 to C50/60 | | 1,0 | | | | | | | |
| Concrete cone failure | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | |
| Splitting | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | |
| Installation factor | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | γ_{inst} | [-] | 1,0 | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | 1,2 | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | Annex C 19 | |
| Performances Characteristic values of tension loads under seismic action (performance category C1+C2) | | | | | | | | | | | |

| Table C26: Characteristic values of shear loads under seismic action (performance category C1+C2) | | | | | | | | | | | |
|--|--------------------|------|----------------------------------|------------|------------|-------------------------|------------|------------|------------------------------|------------|--|
| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure without lever arm | | | | | | | | | | | |
| Characteristic shear resistance (Seismic C1) | $V_{Rk,s,eq,C1}$ | [kN] | $0,70 \cdot V_{Rk,s}^0$ | | | | | | | | |
| Characteristic shear resistance (Seismic C2), Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class ≥ 70 | $V_{Rk,s,eq,C2}$ | [kN] | NPA | | | $0,70 \cdot V_{Rk,s}^0$ | | | NPA | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s,eq,C1}^0$ | [Nm] | No Performance Assessed (NPA) | | | | | | | | |
| | $M_{Rk,s,eq,C2}^0$ | [Nm] | No Performance Assessed (NPA) | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | | $\min(h_{ef}; 300\text{mm})$ | | |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Factor for annular gap | α_{gap} | [-] | $0,5 (1,0)^{1)}$ | | | | | | | | |
| ¹⁾ Value in brackets valid for filled annular gab between anchor and clearance hole in the fixture. Use of special filling washer Annex A 3 is required | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | Annex C 20 | | |
| Performances Characteristic values of shear loads under seismic action (performance category C1+C2) | | | | | | | | | | | |

| Table C27: Characteristic values of tension loads under seismic action (performance category C1) for a service life of 50 years | | | | | | | | | | | | | |
|--|-----------------|---|-----------------------------------|----------------------|------|------|------|------|------|------|-------------------|------|-----|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | |
| Steel failure | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s,eq}$ | [kN] | $1,0 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | |
| Characteristic bond resistance in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,eq}$ | [N/mm ²] | 7,0 | 7,0 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 | 8,5 |
| | II: 72°C/50°C | | $\tau_{Rk,eq}$ | [N/mm ²] | 6,0 | 6,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 | 7,0 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | |
| | II: 72°C/50°C | | | | 0,68 | | | | | | | | |
| Increasing factors for concrete ψ_c | | | C25/30 to C50/60 | | 1,0 | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | | γ_{inst} | [-] | 1,0 | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | | 1,2 | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 21 | | |
| Performances Characteristic values of tension loads under seismic action (performance category C1) | | | | | | | | | | | | | |

| Table C28: Characteristic values of tension loads under seismic action (performance category C1) for a service life of 100 years | | | | | | | | | | | | | |
|--|---|--------------------|-----------------------------------|------|------|------|------|------|------|------|-------------------|------|-----|
| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | |
| Steel failure | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s,eq}$ | [kN] | $1,0 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | |
| Characteristic bond resistance in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | $\tau_{Rk,eq}$ | [N/mm ²] | 6,5 | 6,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 | 7,5 |
| Reduction factor ψ_{sus}^0 in cracked and non-cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and with hollow drill bit (HDB) | | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{sus}^0 | [-] | 0,80 | | | | | | | | | |
| Increasing factors for concrete ψ_C | | C25/30 to C50/60 | | 1,0 | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | |
| for dry and wet concrete (HD; HDB, CD) | | γ_{inst} | [-] | 1,0 | | | | | | | | | |
| for flooded bore hole (HD; HDB, CD) | | | | 1,2 | | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 22 | | |
| Performances Characteristic values of tension loads under seismic action (performance category C1) | | | | | | | | | | | | | |

**Table C29: Characteristic values of shear loads under seismic action
(performance category C1)**

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | | |
|--|-----------------|--------------------|------------------------------------|------|------|------|------|------|------|------------------------------|-------------------|------|--|--|
| Steel failure without lever arm | | | | | | | | | | | | | | |
| Characteristic shear resistance | $V_{Rk,s,eq}$ | [kN] | $0,35 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 452 | 491 | 616 | 804 | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,5 ²⁾ | | | | | | | | | | | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s,eq}^0$ | [Nm] | No Performance Assessed (NPA) | | | | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | | | $\min(h_{ef}; 300\text{mm})$ | | | | |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 14 | 16 | 20 | 24 | 25 | 28 | 32 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | | | |
| Factor for annular gap | α_{gap} | [-] | 0,5 (1,0) ³⁾ | | | | | | | | | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation ³⁾ Value in brackets valid for filled annular gap between anchor and clearance hole in the fixture. Use of special filling washer Annex A 3 is required | | | | | | | | | | | | | | |
| Chemofast Injection System EP 1000 for concrete | | | | | | | | | | | Annex C 23 | | | |
| Performances Characteristic values of shear loads under seismic action (performance category C1) | | | | | | | | | | | | | | |

| Table C30: Displacements under tension load¹⁾ (threaded rod) | | | | | | | | | | |
|--|----------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Non-cracked and cracked concrete C20/25 under seismic C1 action for a service life of 50 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,081 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,193 | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,092 | 0,095 | 0,096 | 0,099 | 0,102 | 0,106 | 0,109 | 0,110 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,259 | 0,154 | 0,163 | 0,172 | 0,181 | 0,189 | 0,207 | 0,229 |
| Non-cracked and cracked concrete C20/25 under seismic C1 action for a service life of 100 years | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,074 | 0,076 | 0,079 | 0,081 | 0,082 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,193 | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 |

Table C31: Displacements under tension load¹⁾ (rebar)

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 |
|--|----------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Non-cracked and cracked concrete C20/25 under seismic C1 action for a service life of 50 years | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,073 | 0,074 | 0,076 | 0,079 | 0,079 | 0,081 | 0,084 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 | 0,171 | 0,181 | 0,194 |
| Temperature range II: 72°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,092 | 0,095 | 0,096 | 0,098 | 0,099 | 0,102 | 0,106 | 0,106 | 0,109 | 0,113 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,154 | 0,163 | 0,172 | 0,181 | 0,189 | 0,207 | 0,229 | 0,229 | 0,242 | 0,260 |
| Non-cracked and cracked concrete C20/25 under seismic C1 action for a service life of 100 years | | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,069 | 0,071 | 0,072 | 0,073 | 0,074 | 0,076 | 0,079 | 0,079 | 0,081 | 0,084 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,115 | 0,122 | 0,128 | 0,135 | 0,142 | 0,155 | 0,171 | 0,171 | 0,181 | 0,194 |

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau; (\tau: \text{action bond stress for tension})$$

Table C32: Displacements under shear load²⁾ (threaded rod)

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--|----------------------------|---------|------|------|------|------|------|------|------|------|
| Non-cracked and cracked concrete C20/25 under seismic C1 action | | | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,06 | 0,06 | 0,05 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,05 |

Table C33: Displacement under shear load¹⁾ (rebar)

| Anchor size reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 |
|--|----------------------------|---------|------|------|------|------|------|------|------|------|------|------|
| For concrete C20/25 under seismic C1 action | | | | | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,06 | 0,05 | 0,05 | 0,04 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 | 0,03 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,05 | 0,04 | 0,04 |

²⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V; (V: \text{action shear load})$$

| | |
|--|-------------------|
| Chemofast Injection System EP 1000 for concrete | Annex C 24 |
| Performances Displacements under seismic C1 action (threaded rods and rebar) | |

Table C34: Displacements under tension load¹⁾ (threaded rod)

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--|----------------------|------|-----|------|------|------|------|-----|-----|-----|
| Non-cracked and cracked concrete C20/25 under seismic C2 action | | | | | | | | | | |
| All temperature ranges | $\delta_{N,eq}(DLS)$ | [mm] | NPA | 0,21 | 0,24 | 0,27 | 0,36 | NPA | | |
| | $\delta_{N,eq}(ULS)$ | [mm] | | 0,54 | 0,51 | 0,54 | 0,63 | | | |

Table C35: Displacements under shear load (threaded rod)

| Anchor size threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--|----------------------|------|-----|-----|-----|-----|------|-----|-----|-----|
| Non-cracked and cracked concrete C20/25 under seismic C2 action | | | | | | | | | | |
| All temperature ranges | $\delta_{V,eq}(DLS)$ | [mm] | NPA | 3,1 | 3,4 | 3,5 | 4,2 | NPA | | |
| | $\delta_{V,ep}(ULS)$ | [mm] | | 6,0 | 7,6 | 7,3 | 10,9 | | | |

Chemofast Injection System EP 1000 for concrete

Performances
Displacements under seismic C2 action (threaded rods)

Annex C 25