

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-08/0188**  
**of 5 October 2020**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

KTS Facade Anchor KT 10 and KT 14

Product family  
to which the construction product belongs

Plastic anchor for multiple use in concrete and masonry  
for non-structural applications

Manufacturer

KtS Kunststofftechnik GmbH  
Osterkamp 18  
59368 Werne  
DEUTSCHLAND

Manufacturing plant

KtS Kunststofftechnik GmbH  
Osterkamp 18  
59368 Werne  
DEUTSCHLAND

This European Technical Assessment  
contains

19 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

ETAG 020, March 2012,  
used as EAD according to Article 66 Paragraph 3 of  
Regulation (EU) No 305/2011.

This version replaces

ETA-08/0188 issued on 19 October 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

**Specific part****1 Technical description of the product**

The KTS Facade Anchor in the range of KT 10 and KT 14 is a plastic anchor consisting of a plastic sleeve made of polyamide and an accompanying specific screw of galvanised steel or stainless steel.

The plastic sleeve is expanded by screwing in the specific screw which presses the sleeve against the wall of the drilled hole.

The product description is given in Annex A.

**2 Specification of the intended use in accordance with the applicable European Assessment Document**

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchors of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

**3 Performance of the product and references to the methods used for its assessment****3.1 Safety in case of fire (BWR 2)**

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 1

**3.2 Safety and accessibility (BWR 4)**

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See Annex C 1 - C 3, C 5
Edge distances and spacing	See Annex B 2 - B 4
Displacements	See Annex C 4 – C 5
Durability	See Annex B 1

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with guideline for European technical approval ETAG 020, March 2012 used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 the applicable European legal act is: 97/463/EC.

The system to be applied is: 2+

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 5 October 2020 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department


*beglaubigt:*  
Ziegler

KTS Facade Anchor KT 10 and KT 14

Fixing in concrete and solid masonry

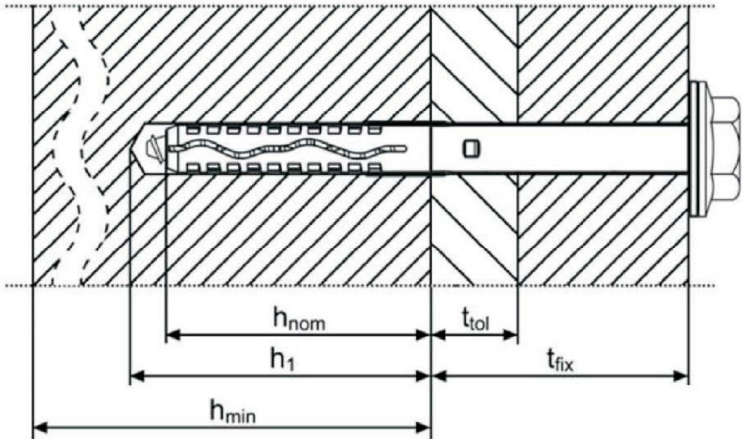

Fixing in hollow or perforated masonry

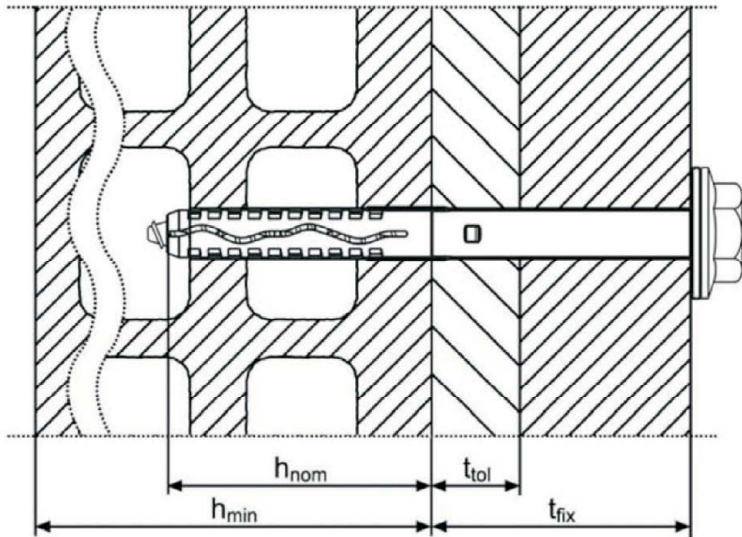

Legend

- $h_{nom}$  = overall plastic anchor embedment depth in the base material
- $h_1$  = depth of drilled hole to deepest point
- $h$  = thickness of member (wall)
- $t_{fix}$  = thickness of fixture
- $t_{tol}$  = thickness of layer or non-load bearing coating


KTS Facade Anchor KT 10 and KT 14

Product description  
Installed condition


Annex A 1

## Anchor types / specific screw


Anchor sleeve KT 10

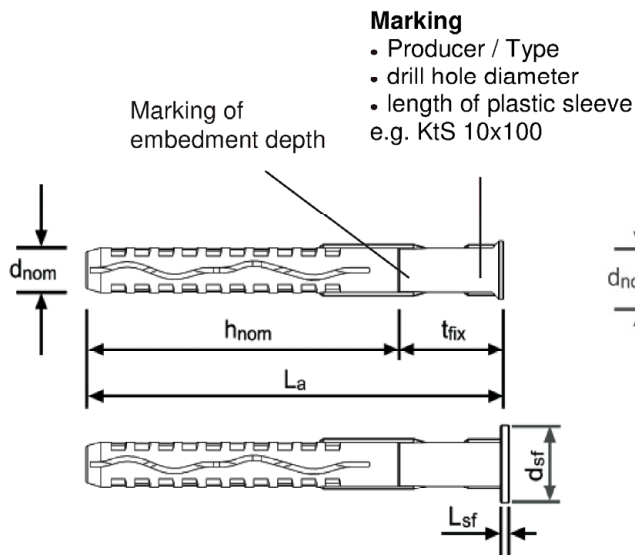


Anchor sleeve KT 14

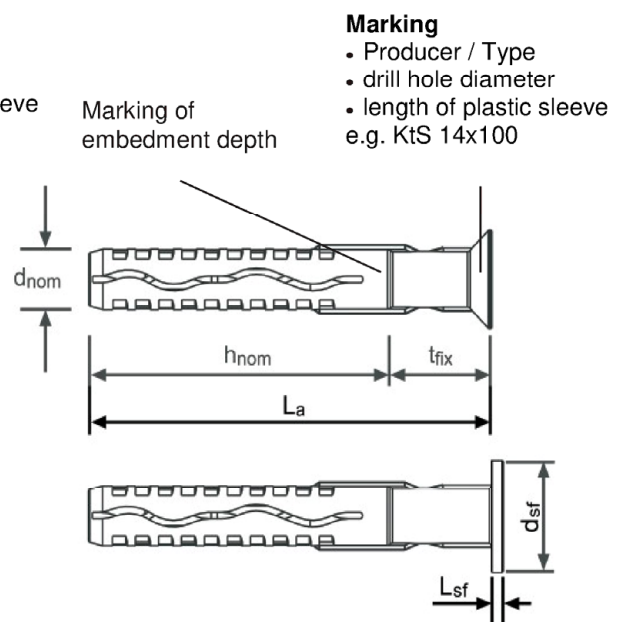

Special screw KT 10

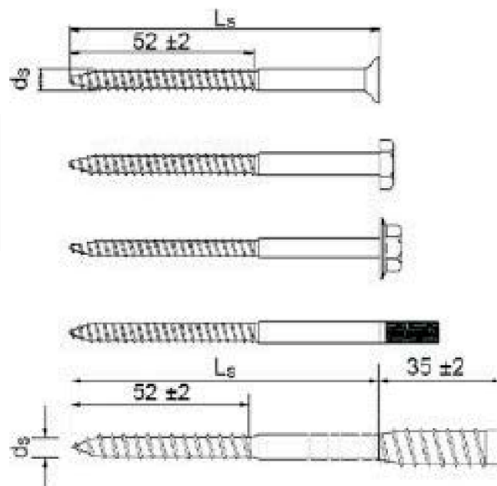

Special screw KT 14

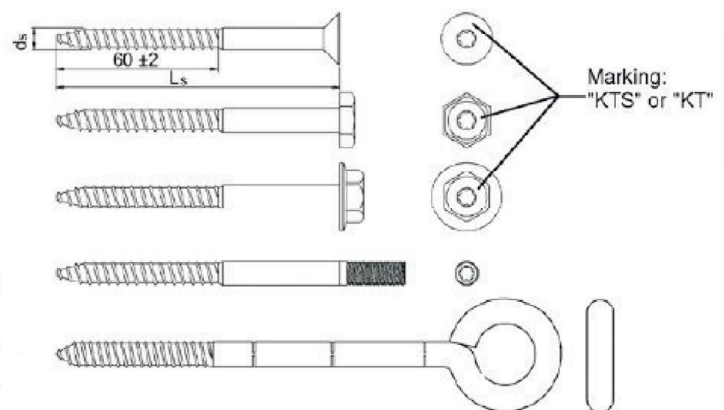

### KTS Facade Anchor KT 10 and KT 14

#### Product description

Anchor types / specific screw  
marking

#### Annex A 2

**Table A1: Dimensions [mm]**

Type	Anchor sleeve								Special screw <sup>1)</sup>			
	d <sub>nom</sub> [mm]	h <sub>nom</sub> [mm]	t <sub>fix,min</sub> [mm]	t <sub>fix,max</sub> [mm]	L <sub>a,min</sub> [mm]	L <sub>a,max</sub> [mm]	L <sub>sf</sub> <sup>2)</sup> [mm]	d <sub>s,f</sub> [mm]	d <sub>s</sub> [mm]	d <sub>k</sub> <sup>3)</sup> [mm]	L <sub>s,min</sub> [mm]	L <sub>s,max</sub> [mm]
10	10	70	10	230	80	300	2	18	7	5,8	90	310
14	14	70	10	290	80	360	3	26	10	8,4	90	370

1) To insure that the screw penetrates the anchor sleeve L<sub>s</sub> must be L<sub>a</sub> + L<sub>sf</sub> + 8.

2) only valid for flat collar version

3) core diameter of the thread

**Table A2: Materials**

Name	Material
Anchor sleeve	Polyamide PA6, colour: red, grey
Special screw	Carbon steel, strength class 6.8, electrogalvanic coating Zn ≥ 5µm according to EN ISO 4042:2018
	Stainless steel according to EN 10088-3:2014, material 1.4401, 1.4404 or 1.4571

**KTS Facade Anchor KT 10 and KT 14**

**Product description**  
Dimensions and materials

**Annex A 3**



## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loads
- Multiple fixing of non-structural applications

### Base materials:

- Reinforced or unreinforced normal weight concrete with strength classes  $\geq C12/15$  (use category a), according to EN 206-1:2000, Annex C 1
- Solid brick masonry (use category b), according to Annex C 2  
Note: The characteristic resistance is also valid for larger brick sizes and larger compressive strength of the masonry unit.
- Hollow brick masonry (use category c), according to Annex C 3
- Autoclaved aerated concrete (use category d), according to Annex C 5
- Mortar strength class of the masonry  $\geq M2,5$  at minimum according to EN 998-2:2010.
- For other base materials of the use categories a, b, c and d the characteristic resistance of the anchor may be determined by job size tests according to ETAG 020, Annex B Edition March 2012.

### Temperature Range:

- Temperature range a):  $-40^{\circ}\text{C}$  to  $+40^{\circ}\text{C}$  (max. long term temperature  $+24^{\circ}\text{C}$  and max. short term temperature  $+40^{\circ}\text{C}$ )
- Temperature range b):  $-40^{\circ}\text{C}$  bis  $+80^{\circ}\text{C}$  (max. long term temperature  $+50^{\circ}\text{C}$  and max. short term temperature  $+80^{\circ}\text{C}$ )

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel).
- The specific screw made of galvanized steel may also be used in structures subject to external atmospheric exposure, if the area of the head of the screw is protected against moisture and driving rain after mounting of the fixing unit in this way, that intrusion of moisture into the anchor shaft is prevented. Therefore there shall be an external cladding or a ventilated rainscreen mounted in front of the head of the screw and the head of the screw itself shall be coated with a soft plastic, permanently elastic bitumen-oil-combination coating (e. g. undercoating or body cavity protection for cars).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel).
- Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

### Design:

- The anchorages are designed in accordance with the ETAG 020, Annex C Edition March 2012 under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials and the dimensions of the anchorage members as well as of the relevant tolerances. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple use for non-structural application, according to ETAG 020 Edition March 2012.

### Installation:

- Hole drilling by the drill modes according to Annex C 1, C 2, C 3, C 5
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Installation temperature from  $\geq -20^{\circ}\text{C}$
- Exposure to UV due to solar radiation of the anchor not protected  $\leq 6$  weeks

## KTS Facade Anchor KT 10 and KT 14

Intended use  
Specifications

Annex B 1



**Table B1: Installation parameters**

Anchor type		10	14
Drill hole diameter	$d_0 = [\text{mm}]$	10	14
Cutting diameter of drill bit	$d_{\text{cut}} \leq [\text{mm}]$	10,45	14,45
Depth of drilled hole to deepest point <sup>1)</sup>	$h_1 \geq [\text{mm}]$	85	85
Overall plastic anchor embedment depth in the base material <sup>1), 2)</sup>	$h_{\text{nom}} \geq [\text{mm}]$	70	70
Diameter of clearance hole in the fixture	$d_f \leq [\text{mm}]$	10,5	14,5

<sup>1)</sup> See Annex A 1


<sup>2)</sup> For hollow and perforated masonry the influence of  $h_{\text{nom}} > 70 \text{ mm}$  has to be detected by job site tests according ETAG 020 Annex B

**Table B2: Minimum thickness of member, edge distance and spacing in concrete**

Fixing points with a spacing  $a \leq s_{\text{cr},N}$  are considered as a group with a max. characteristic resistance  $N_{Rk,p}$  acc. to Table C 3. For  $a > s_{\text{cr},N}$  the anchors are considered as single anchors, each with a characteristic resistance  $N_{Rk,p}$  acc. to Table C 3.

Type		Minimum thickness of member $h_{\text{min}}$ [mm]	Characteristic edge distance $c_{\text{cr},N}$ [mm]	Minimum edge distance $c_{\text{min}}$ [mm]	Minimum spacing $s_{\text{min}}$ [mm]	Characteristic spacing $s_{\text{cr},N}$ [mm]
<b>10</b>	Concrete C12/15	100	100	85	70	85
	Concrete $\geq$ C16/20		70	60	50	85
<b>14</b>	Concrete C12/15	100	140	120	105	115
	Concrete $\geq$ C16/20		100	85	75	115

**Scheme of distance and spacing in concrete**

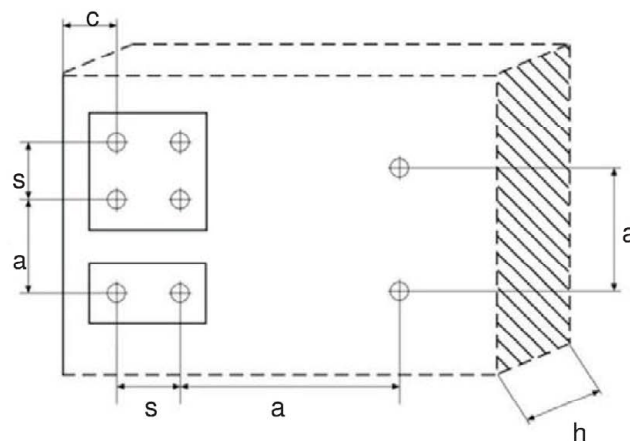

**KTS Facade Anchor KT 10 and KT 14**

**Intended use**

Installation parameters, edge distance and spacings for use in concrete

**Annex B 2**

**Table B3: Minimum distance and dimensions in solid masonry**

		10		14	
Minimum thickness of member	$h_{\min}$ [mm]	115	240 <sup>2)</sup>	115	240 <sup>1)</sup>
Single anchor					
Minimum spacing	$a_{\min}$ [mm]	max (250 mm / $s_{1,\min}$ / $s_{2,\min}$ )			
Minimum edge distance	$c_{\min}$ [mm]	100	120 <sup>2)</sup>	100	200 <sup>1)</sup>
Anchor Group					
Minimum spacing perpendicular to free edge	$s_{1,\min}$ [mm]	200	85 <sup>2)</sup>	200	
Minimum spacing parallel to free edge	$s_{2,\min}$ [mm]	400	85 <sup>2)</sup>	400	
Minimum edge distance	$c_{\min}$ [mm]	100	120 <sup>2)</sup>	100	

<sup>1)</sup> Only for KS-NF and member thickness  $h \geq 240$  mm [see Table C4, with footnote 5]


<sup>2)</sup> Only for Mz-NF and KS-NF [see Table C4, with footnote 6]

**Table B4: Minimum distance and dimensions in hollow or perforated masonry (only for 10)**

		10 in HLz-2DF <sup>1)</sup>	10 in KSL-8DF <sup>1)</sup>
Minimum thickness of member	$h_{\min}$ [mm]	115	115
Single anchor			
Minimum spacing	$a_{\min}$ [mm]	max (250 mm / $s_{1,\min}$ / $s_{2,\min}$ )	
Minimum edge distance	$c_{\min}$ [mm]	100	60
Anchor Group			
Minimum spacing perpendicular to free edge	$s_{1,\min}$ [mm]	100	100
Minimum spacing parallel to free edge	$s_{2,\min}$ [mm]	100	100
Minimum edge distance	$c_{\min}$ [mm]	100	60

<sup>1)</sup> Information for base material, see Table C5

**Scheme of distance and spacing in solid masonry**

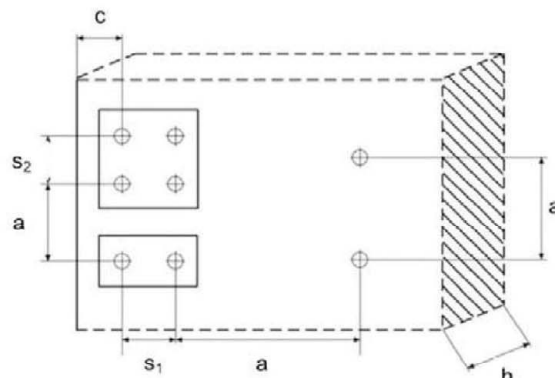

**KTS Facade Anchor KT 10 and KT 14**

**Intended use**


Edge distance and spacings for use in masonry and hollow or perforated masonry

**Annex B 3**

**Table B5: Minimum distances and dimensions in autoclaved aerated concrete**

		<b>10</b>
Minimum thickness of member	$h_{\min}$ [mm]	200
<b>Single anchor</b>		
Minimum spacing	$a_{\min}$ [mm]	$\max (250 \text{ mm} / s_{1,\min} / s_{2,\min})$
Minimum edge distance	$c_{\min}$ [mm]	100
<b>Anchor Group</b>		
Minimum spacing <b>perpendicular</b> to free edge	$s_{1,\min}$ [mm]	200
Minimum spacing <b>parallel</b> to free edge	$s_{2,\min}$ [mm]	400
Minimum edge distance	$c_{\min}$ [mm]	100

**Scheme of distance and spacing in autoclaved aerated concrete**

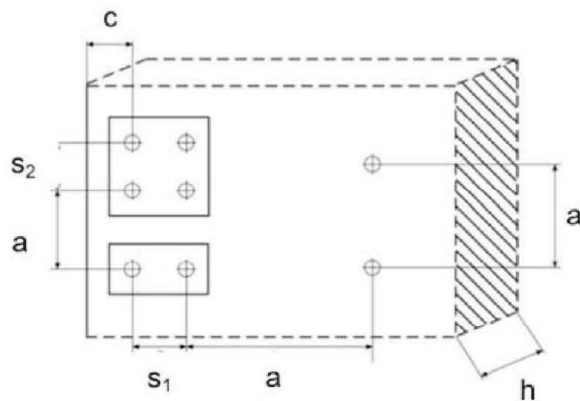

**KTS Facade Anchor KT 10 and KT 14**

**Intended use**

Edge distance and spacings for use in autoclaved aerated concrete

**Annex B 4**

Brick No.	Base material	Size	Geometry
No.1	Clay brick HLz acc. to EN 771-1:2011	2DF (240x115x115)	
No.2	Hochlochziegel Hlz acc. to EN 771-1:2011 e.g.. Schlagmann Poroton S8	12DF (248x365x249)	
No.3	Hochlochziegel Hlz acc. to EN 771-1:2011 e.g. Schlagmann S9	12DF (248x365x249)	
No.4	Clay brick Hlz acc. to EN 771-1:2011 e.g. Schlagmann FZ9	12DF (248x365x249)	

**Intended use**  
Geometry of stones

## Annex B 5

**Table B7: Geometry of hollow bricks (see Table C5, Annex C3)**


Brick No.	Base material	Size	Geometry
No.5	Ceiling clay brick HLz acc. to DIN EN 15037-3:2011-07 e.g. Wienerberger	(250x530x210)	
No.6	Hollow calcium silicate brick KSL acc. to EN 771-2:2011	8DF (250x240x237)	
No.7	Ceiling hollow brick lightweight concrete acc. to DIN EN 15037-2: 2011-07 e.g. Schnuch SB-Baustoffe GmbH	(250x550x180)	
No.8	Hollow brick lightweight concrete Hbl acc. to EN 771-3:2011 e.g. Jakob Stockschläder GmbH & Co. Kg	16 DF (497x240x249)	

**KTS Facade Anchor KT 10 and KT 14**

**Intended use**  
Geometry of stones

**Annex B 6**


### Installation instructions

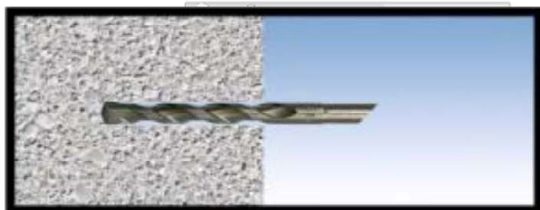


1. Drill a hole



2. Blow out drill-hole and clean it

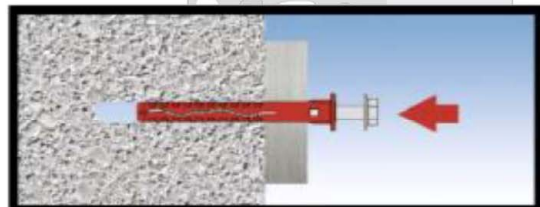

3. Put the plug into the drill-hole

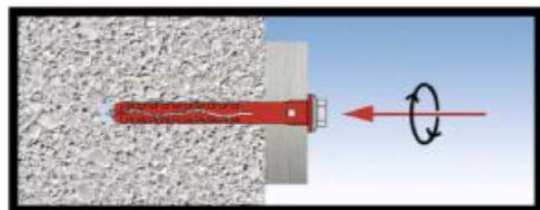

4. Screw in tight the anchor plate

**KTS Facade Anchor KT 10 and KT 14**

**Intended use**  
Installation instructions

**Annex B 7**

**Table C1: Characteristic resistance of the screw**

Failure of expansion element (special screw)			10		14	
			gvz	stainless steel	gvz	stainless steel
Characteristic tension resistance	$N_{Rk,s}$	[kN]	15,0	13,5	30,2	27,1
Partial safety factor	$\gamma_{Ms}^{1)}$		1,5	1,6	1,5	1,6
Characteristic shear resistance	$V_{Rk,s}$	[kN]	7,5	6,8	15,1	13,6
Partial safety factor	$\gamma_{Ms}^{1)}$		1,25	1,33	1,25	1,33
Characteristic bending resistance	$M_{Rk,s}$	[Nm]	12,8	11,5	36,2	32,6
Partial safety factor	$\gamma_{Ms}^{1)}$		1,25	1,33	1,25	1,33

<sup>1)</sup> In absence of other national regulations

**Table C2: Values under fire exposure in concrete C20/25 to C50/60 in any load direction, no permanent centric tension load and without lever arm, fastening of facade systems**

Anchor type	Fire resistance class	$F_{Rk,fi,90}$	$\gamma_{M,fi}^{1)}$
KT 10	R 90	0,8 kN	1,0

<sup>1)</sup> In absence of other national regulations

**Table C3: Characteristic resistance by pull-out failure for use in concrete (drill method: hammer)**

Pull-out failure (plastic sleeve)			10		14	
			24/40 °C	50/80 °C	24/40 °C	50/80 °C
Concrete ≥ C16/20 according EN 206-1:2000						
Characteristic resistance	N <sub>Rk,p</sub>	[kN]	5,0	3,5	7,5	5,0
Partial safety factor	γ <sub>Mc</sub> <sup>1)</sup>		1,8			
Concrete C12/15 according EN 206-1:2000						
Characteristic resistance	N <sub>Rk,p</sub>	[kN]	3,5	2,5	5,0	3,5
Partial safety factor	γ <sub>Mc</sub> <sup>1)</sup>		1,8			

<sup>1)</sup> In absence of other national regulations

**KTS Facade Anchor KT 10 and KT 14**

**Performances**

Characteristic resistance of the screw,  
Characteristic bending resistance, Characteristic resistance for use in concrete

**Annex C 1**



**Table C4: Characteristic resistance  $F_{Rk}$  in [kN] in solid bricks (use category „b“)**

Base material	Min. DF or min. Size (L x W x H)  [mm]	Bulk density  $\rho$ [kg/dm³]	Min. compr- essive strength  $f_b$ [N/mm²]	Drill me- thod	Thick- ness of wall  h [mm]	Comment	Characteristic resistance $F_{Rk}$ [kN]			
							10		14	
							24/40 °C	50/80 °C	24/40 °C	50/80 °C
Clay brick Mz EN 771-1:2011	NF (240x115x71)	1,8	20	H <sup>1)</sup>	115		4,0 6,0 <sup>4)</sup>	3,5	4,5 7,5 <sup>5)</sup>	4,5 5,0 <sup>5)</sup>
			10				3,0 4,5 <sup>4)</sup>	2,5	3,0 5,0 <sup>5)</sup>	3,0 3,5 <sup>5)</sup>
			20		240		6,0 <sup>6)</sup>	3,5 <sup>6)</sup>	8)	
			10				5,0 <sup>6)</sup>	2,5 <sup>6)</sup>		
Solid sand lime brick KS EN 771-2:2011	NF (240x115x71)	1,8	20	H <sup>1)</sup>	115	Vertical perforation up to 15%	1,5	1,5	1,5	1,5
			10				1,2	1,2	1,2	1,2
			20		240		6,0 <sup>6)</sup>	4,0 <sup>6)</sup>	9,0 <sup>5)</sup>	6,0 <sup>5)</sup>
			10				5,0 <sup>6)</sup>	3,0 <sup>6)</sup>	6,0 <sup>5)</sup>	4,0 <sup>5)</sup>
Solid sand- lime brick KS EN 771-2:2011	2DF (240x115x112)	2,0	20	H <sup>1)</sup>	115	Vertical perforation up to 15%	4,0 6,0 <sup>4)</sup>	4,0	4,5 9,0 <sup>5)</sup>	4,5 9,0 <sup>5)</sup>
			10				3,0 4,5 <sup>4)</sup>	3,0	3,0 6,0 <sup>5)</sup>	3,0 6,0 <sup>5)</sup>
Lightweight solid brick acc. to EN 771-3:2011	8DF (497x115x249)	2,0	20	H <sup>1)</sup>	115		3,0	1,5	8)	
Partial safety factor <sup>3)</sup>					$\gamma_{Mm}$		2,5			

- 1) Hammer drilling
- 2) Rotary drilling
- 3) In absence of other national regulations
- 4) Only valid for an edge distance  $c \geq 150$  mm
- 5) Only valid for an edge distance  $c \geq 200$  mm
- 6) Only valid for an edge distance  $c \geq 120$  mm
- 7) Cut brick for reveal
- 8) No performance assessed

**KTS Facade Anchor KT 10 and KT 14**

**Performances**

Characteristic resistance for use in solid masonry

**Annex C 2**

**Table C5: Characteristic resistance  $F_{Rk}$  in [kN] in hollow or perforated masonry (use category „c“)**

Base material	Min. DF or min. Size (L x W x H)  [mm]	Bulk density  $\rho$ [kg/dm³]	Min. compressive strength  $f_b$ [N/mm²]	Drill method	Thickness of wall  h [mm]	Comment	Characteristic resistance $F_{Rk}$ [kN]			
							10		14	
							24/40 °C	50/80 °C	24/40 °C	50/80 °C
Hollow clay brick HLz EN 771-1:2011	2DF (240x115x115)	1,0	12	R <sup>2)</sup>	115	Brick no. 1	1,5	0,75	8)	
Hollow clay brick HLz EN 771-1:2011	12DF (248x365x249)	0,75	10	R <sup>2)</sup>	365	Brick no. 2 e.g. Schlagmann Poroton S8	0,3	0,1	8)	
Hollow clay brick HLz EN 771-1:2011	12DF (248x365x249)	0,85	12	R <sup>2)</sup>	365	Brick no. 3 e.g. Schlagmann Poroton S9	0,5	0,2	8)	
Hollow clay brick HLz EN 771-1:2011	12DF (248x365x249)	0,75	10	R <sup>2)</sup>	365	Brick no. 4 e.g. Schlagmann Poroton FZ9	1,2	0,6	8)	
Ceiling clay brick HLz DIN EN 15037-3:2011-07	(250x530x210)	0,8	10	R <sup>2)</sup>	210	Brick no. 5	0,9	0,4	8)	
Hollow sand-lime brick KSL EN 771-2:2011	8DF (250x240x237)	1,4	12	R <sup>2)</sup>	115 <sup>2)</sup>	Brick no. 6	1,2	0,6	8)	
Ceiling acc. to DIN EN 15037-2:2011-07	(250x550x180)	1,4	2	R <sup>2)</sup>	180	Brick no. 7 e.g Schnuch SB-Baustoffe GmbH	0,4	0,2	8)	
Lightweight hollow brick Hbl EN 771-3:2011	16 DF (497x240x249)	0,8	5	R <sup>2)</sup>	240	Brick no. 8 e.g. Jakob Stockschlädler GmbH & Co. Kg	0,6	0,3	8)	
Partial safety factor <sup>3)</sup>					$\gamma_{Mm}$		2,5			

- 1) Hammer drilling
- 2) Rotary drilling
- 3) In absence of other national regulations
- 4) Only valid for an edge distance  $c \geq 150$  mm
- 5) Only valid for an edge distance  $c \geq 200$  mm
- 6) Only valid for an edge distance  $c \geq 120$  mm
- 7) Cut brick for reveal
- 8) No performance assessed

**KTS Facade Anchor KT 10 and KT 14**

**Performances**

Characteristic resistance for use in hollow or perforated masonry

**Annex C 3**

**Table C6: Displacements under tension and shear loading in concrete**

Type	Tension load			Shear load		
	F <sup>1)</sup> [kN]	$\delta_{NO}$ [mm]	$\delta_{N\infty}$ [mm]	F <sup>1)</sup> [kN]	$\delta_{VO}$ [mm]	$\delta_{V\infty}$ [mm]
<b>10</b>	1,98	0,2	0,4	2,98	1,0	1,5
<b>14</b>	2,98	0,4	0,6	6,11	3,0	4,5

<sup>1)</sup> Intermediate values by linear interpolation

**Table C7: Displacements under tension and shear loading in solid and hollow/perforated masonry**

Type	Base material <sup>1)</sup>	F [kN]	Displacements [mm]			
			Tension load		Shear load	
			$\delta_{NO}$	$\delta_{N\infty}$	$\delta_{VO}$	$\delta_{V\infty}$
<b>10</b>	Clay brick Mz EN 771-1:2011	1,71	0,2	0,4	1,4	2,1
	Solid sand-lime brick KS-NF EN 771-2:2011	0,43	0,2	0,4	0,4	0,5
	Solid sand-lime brick KS-2DF EN 771-2:2011	1,71	0,2	0,4	1,4	2,1
	Solid lightweight concrete Vbl EN 771-3:2011	0,86	0,2	0,4	0,7	1,1
	Hollow clay brick HLz EN 771-1:2011	0,43	0,1	0,2	0,9	1,3
	Hollow clay brick HLz S8 EN 771-1:2011	0,09	0,03	0,1	0,1	0,1
	Hollow clay brick HLz S9 EN 771-1:2011	0,14	0,1	0,1	0,1	0,2
	Hollow clay brick HLz FZ9 EN 771-1:2011	0,34	0,1	0,1	0,3	0,4
	Ceiling clay brick HLz DIN EN 15037-3:2011-07	0,26	0,1	0,2	0,2	0,3
	Hollow sand-lime brick KSL EN 771-2:2011	0,34	0,2	0,4	0,7	1,0
	Ceiling lightweight brick VBL DIN EN 15037-2:2011-07	0,11	0,1	0,1	0,1	0,1
	Lightweight hollow brick Hbl 2 EN 771-3:2011	0,17	0,1	0,2	0,1	0,2
<b>14</b>	Clay brick Mz EN 771-1:2011	2,14	0,2	0,4	1,8	2,7
	Solid sand-lime brick KS-NF EN 771-2:2011	0,43	0,1	0,2	0,4	0,5
	Solid sand-lime brick KS-2DF EN 771-2:2011	2,57	0,1	0,2	2,1	3,2
	Solid sand-lime brick KS EN 771-2:2011	2,57	1,1	2,2	2,1	3,2

<sup>1)</sup> Information for base material masonry: see Annex C 2, Table C4

**KTS Facade Anchor KT 10 and KT 14**

**Performances**

Displacements under tension and shear loading in concrete, solid and hollow or perforated masonry

**Annex C 4**

**Table C8: Characteristic resistance  $F_{Rk}$  in [kN] in autoclaved aerated concrete (use category „d“)**

Type	Base material	Bulk density $\rho$ [kg/m <sup>3</sup> ]	Minimum compressive strength $f_b$ [N/mm <sup>2</sup> ]	Drill method	Characteristic resistance $F_{Rk}$ [kN]	
					24/40 °C	50/80 °C
<b>10</b>	uncracked autoclaved aerated concrete (blocks) EN 771-4:2011	≥ 350	1,8	R <sup>2)</sup>	0,9	0,75
		≥ 650	5,4	R <sup>2)</sup>	2,5	2,5
	Partial safety factor <sup>1)</sup>		$\gamma_{M,AAC}$		2,0	

<sup>1)</sup> In absence of other national regulations

<sup>2)</sup> Rotary drilling

**Table C9: Displacements under tension and shear loading autoclaved aerated concrete**

Type	Base material	Tension load			Shear load		
		$F^{1)}$ [kN]	$\delta_{NO}$ [mm]	$\delta_{N\infty}$ [mm]	$F^{1)}$ [kN]	$\delta_{VO}$ [mm]	$\delta_{V\infty}$ [mm]
<b>10</b>	autoclaved aerated concrete $f_b \geq 1,8 \text{ N/mm}^2$	0,3	0,2	0,4	0,3	0,6	1,0
	autoclaved aerated concrete $f_b \geq 5,4 \text{ N/mm}^2$	0,9	0,2	0,4	0,9	1,8	2,7

<sup>1)</sup> Intermediate values by linear interpolation

**KTS Facade Anchor KT 10 and KT 14**

**Performances**

Characteristic resistance and displacements for use in autoclaved aerated concrete

**Annex C 5**