

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-09/0159
of 23 September 2020

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

BTI High-Performance Anchor BHA, BHA-I

Product family
to which the construction product belongs

Mechanical fastener for use in concrete

Manufacturer

BTI Befestigungstechnik GmbH & Co. KG
Salzstraße 51
74653 Ingelfingen
DEUTSCHLAND

Manufacturing plant

BTI Herstellwerk 1

This European Technical Assessment
contains

25 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330232-00-0601, Edition 10/2016

This version replaces

ETA-09/0159 issued on 4 September 2018

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The BTI High-Performance Anchor BHA, BHA-I is an anchor made of galvanised steel (sizes with external diameter 10, 12, 15, 18, 24, 28 and 32, sizes with internal thread 12/M6 I, 12/M8 I, 15/M10 I and 15/M12 I) or stainless steel (sizes with external diameter 10, 12, 15, 18 and 24, sizes with internal thread 12/M6 I, 12/M8 I, 15/M10 I and 15/M12 I) which is placed into a drilled hole and anchored by torque-controlled expansion.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex C 1, C 2, C 7
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 3 and C 4
Displacements (static and quasi-static loading)	See Annex C 10, C 11
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C 8, C 9, C 11
Durability	See Annex B 1

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 5, C 6

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330232-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

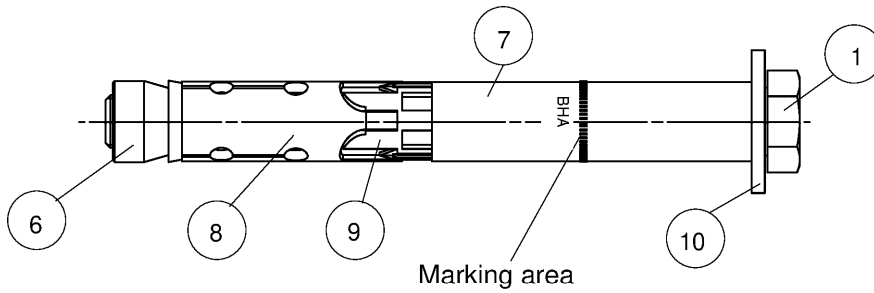
5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 23 September 2020 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow
Head of Department

beglaubigt:
Baderschneider



Type hexagon screw **S**
BHA 10 - 32 S
BHA 10 - 24 S R

Product label, example:

BHA 15/25 R

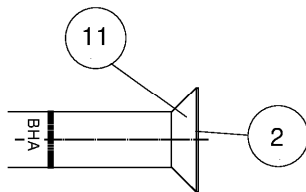
Type of fastener

BHA

15/25 R

Identification R


Nominal drill hole diameter/max. thickness of fixture (t_{fix})



Type countersunk screw **SK**

BHA 10 - 18 SK

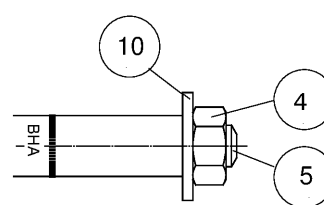
BHA 10 - 18 SK R



Type hexagon nut **B**

BHA 10 - 32 B

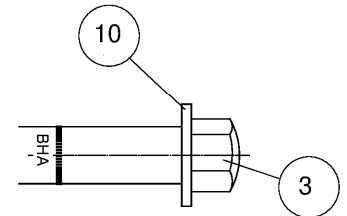BHA 10 - 24 B R



Type cap nut **H**


BHA 10 - 24 H

BHA 10 - 24 H R

- 1 Hexagon screw
- 2 Countersunk screw
- 3 Cap nut
- 4 Hexagon nut

- 5 Threaded rod
- 6 Cone nut
- 7 Distance sleeve
- 8 Expansion sleeve

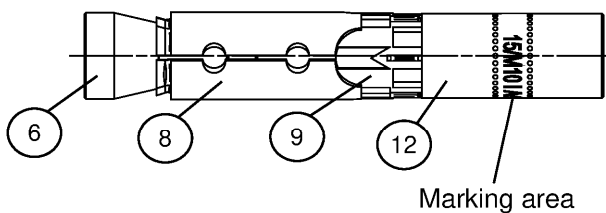- 9 Plastic sleeve
- 10 Washer
- 11 Conical washer
- 12 Internal thread socket



Type internal threaded anchor **I**
BHA 12 M6-I or M8-I
BHA 15 M10-I or M12-I

Product label, example:

BHA 12/M8-I R

Type of fastener

BHA

12/M8-I R

Identification R

Nominal drill hole diameter / size of internal thread
(Fig. not to scale)

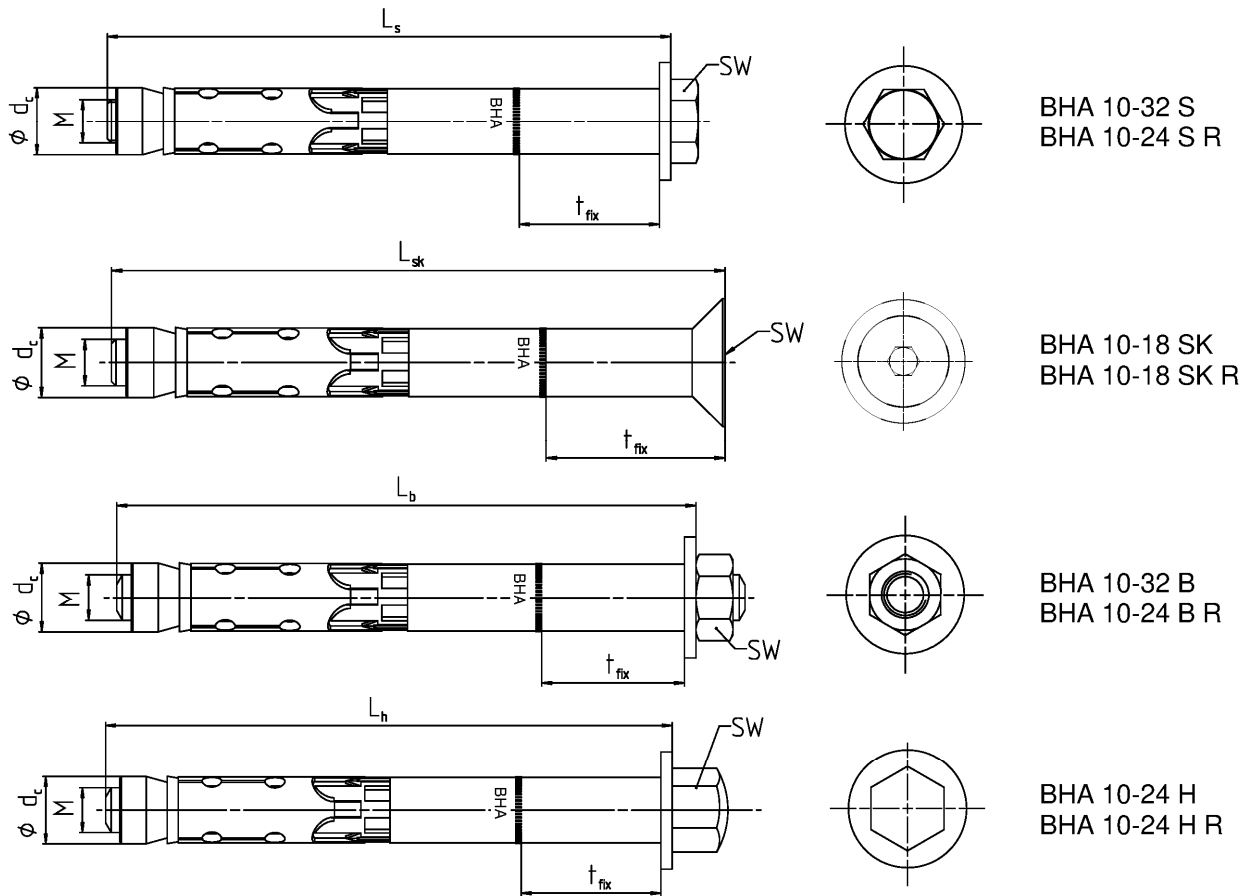


Table A2.1: Dimensions [mm] BHA and BHA R

Anchor type		BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Thread	M	6	8	10	12	16	20	24
Diameter cone nut	d _c	10	12	14,8	17,8	23,7	27,5	31,5
Wrench size SW	BHA-S, -B	10	13	17	19	24	30	36
	BHA-SK ¹⁾	4	5	6	8	3)		
	BHA-H	13	17	17	19	24	3)	
	BHA-S R, -B R, -H R	10	13	17	19	24	3)	
	BHA-SK R ¹⁾	4	5	6	8	3)		
t _{fix} BHA-S, -B, -H + BHA-S R, -B R, -H R	min	0	0	0	0	0	0	0
t _{fix} BHA-SK + BHA-SK R ²⁾	min	5	6	6	8	3)		
Length of screw / bolt	L _s , L _h , L _b (- t _{fix})	≥ 49	≥ 74	≥ 89	≥ 99	≥ 124	≥ 149	≥ 174
Length of countersunk screw	L _{sk} (- t _{fix})	≥ 54	≥ 79	≥ 95	≥ 107	3)		

¹⁾ Internal hexagon

²⁾ The influence of the thickness of fixture to the characteristic resistance for shear loads, steel failure without lever arm is taken into account, see tables C3.1, C8.1 and C9.1

³⁾ Anchor type not part of assessment

(Fig. not to scale)

BTI High-Performance Anchor BHA, BHA-I

Product description
Anchor types and dimensions BHA, BHA R

Annex A 2

Table A3.1: Material BHA and BHA R			
No.	Designation	Material	
		BHA	BHA R
	Steel grade	Steel	Stainless steel R
		Zinc plated $\geq 5 \mu\text{m}$, ISO 4042:2018	Acc. to EN 10088:2014
1	Hexagon screw	Steel class 8.8; EN ISO 898-1:2013	Class 80 EN ISO 3506:2020
2	Countersunk screw		
3	Cap nut		
4	Hexagon nut		
		Steel class 8	
5	Threaded rod	Steel $f_{uk} \geq 800 \text{ N/mm}^2$; $f_{yk} \geq 640 \text{ N/mm}^2$	Stainless steel EN 10088:2014 $f_{uk} \geq 800 \text{ N/mm}^2$; $f_{yk} \geq 640 \text{ N/mm}^2$
6	Cone nut	Steel EN 10277:2018	Stainless steel EN 10088:2014
7	Distance sleeve	Steel EN 10305:2016	
8	Expansion sleeve	Steel EN 10139:2020/ EN 10277:2018	
9	Plastic sleeve	ABS (plastic)	
10	Washer	Steel EN 10139:2020	Stainless steel EN 10088:2014
11	Conical washer	Steel EN 10277:2018	
BTI High-Performance Anchor BHA, BHA-I			Annex A 3
Product description Materials BHA and BHA R			

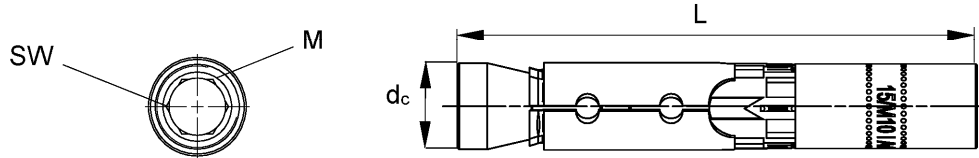


Table A4.1: Anchor Dimensions [mm] BHA-I and BHA-I R

Anchor type BHA-I, BHA-I R		BHA 12/M6 I	BHA 12/M8 I	BHA 15/M10 I	BHA 15/M12 I
Thread	M	6	8	10	12
Diameter cone nut	d _c	12	12	14,8	14,8
Wrench size internal hexagon	SW	6	8	6	8
Anchor length	L	77,5	77,5	90	90

Table A4.2: Material BHA-I and BHA-I R

No.	Designation	Material	
		BHA-I	BHA-I R
	Steel grade	Steel	Stainless steel R
		Zinc plated $\geq 5 \mu\text{m}$, ISO 4042:2018	Acc. to EN 10088:2014
6	Cone nut	Steel EN 10277:2018	Stainless steel EN 10088:2014
8	Expansion sleeve	Steel EN 10139:2020 / EN 10277:2018	
9	Plastic sleeve	ABS (plastic)	
12	Internal thread bolt	Steel EN 10277:2018 $f_{uk} \geq 750 \text{ N/mm}^2$, $f_{yk} \geq 600 \text{ N/mm}^2$	Stainless steel EN 10088:2014 $f_{uk} \geq 750 \text{ N/mm}^2$, $f_{yk} \geq 600 \text{ N/mm}^2$
Requirements for fixing elements		Steel strength class 5.8, 6.8 or 8.8 EN ISO 898-1:2013	Steel strength class A50, A70 or A80 EN ISO 3506:2010 1.4362, 1.4401, 1.4404, 1.4571, 1.4529

(Fig. not to scale)

BTI High-Performance Anchor BHA, BHA-I



Product description

Anchor types, dimensions and materials BHA-I, BHA I-R

Annex A 4

Specifications of intended use

Anchorage subject to:

Size		10	12	15	18	24	28	32
High Performance Anchor	BHA-S, -B				✓			
	BHA-H, -S R, -B R, -H R			✓				1)
	BHA-SK, BHA-SK R		✓					1)
High Performance Anchor	BHA-I, BHA-I R	1)	✓				1)	
Hammer drilling with standard drill bit								
Hammer drilling with hollow drill bit with automatic cleaning					✓			
Static and quasi-static loads					✓			
Cracked and uncracked concrete					✓			
Fire exposure								
Seismic performance category	C1 BHA					✓		
	C1 BHA R	2)		✓				1)
	C2 BHA					✓		
	C2 BHA R			✓				1)
	C1 BHA-I, BHA-I R	1)		2)				1)
	C2 BHA-I, BHA-I R							

1) Anchor type not part of the assessment

2) No performance assessed

Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres (cracked and uncracked) of strength classes C20/25 to C50/60 according to EN 206:2013+A1:2016

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (BHA, BHA R, BHA-I, BHA-I R)
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal conditions, if no particular aggressive conditions exist (BHA R, BHA-I R)

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where deicing materials are used)

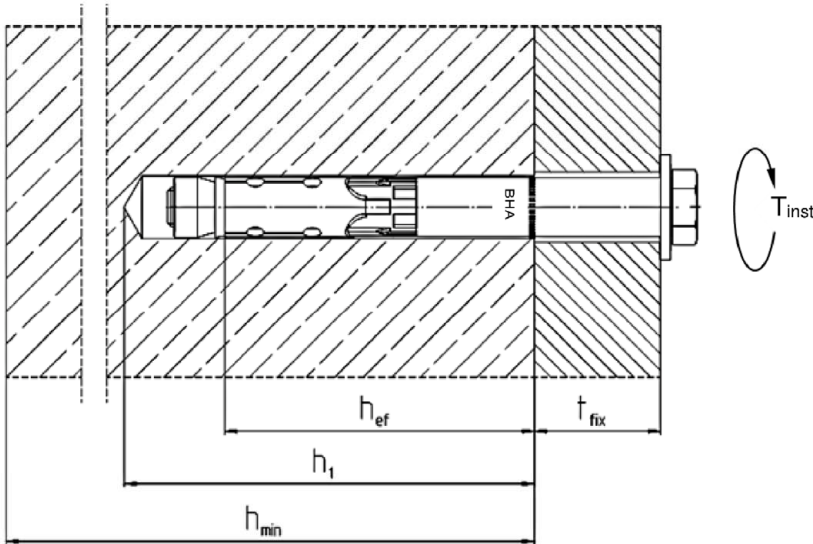
Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete work
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)
- Design of fastenings according to EN 1992-4:2018 and EOTA Technical Report TR 055, Edition February 2018

BTI High-Performance Anchor BHA, BHA-I

Intended use
Specifications

Annex B 1



- h_{ef} = Effective embedment depth
- t_{fix} = Thickness of the fixture
- h_1 = Depth of drill hole to deepest point
- h_{min} = Minimum thickness of concrete member
- T_{inst} = Required setting torque

Table B2.1: Installation parameters BHA and BHA R

Anchor type BHA S, -SK, -B, -H and BHA S R, -SK R, -B R, -H R	BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32	
Nominal drill hole diameter d_0	10	12	15	18	24	28	32	
Maximum diameter of drill bit $d_{cut} \leq$	10,45	12,50	15,50	18,50	24,55	28,55	32,70	
Depth of drill hole to deepest $h_1 \geq$	55	80	90	105	125	155	180	
Diameter of clearance hole $d_f \leq$	12	14	17	20	26	31	35	
Diameter of counter sunk BHA SK	18	22	25	32	1)			
Depth of counter sunk, 90° BHA SK R	5,0	5,8	5,8	8,0				
Required setting torque T_{inst} [Nm]	BHA S	10	22,5	40	80	160	180	200
	BHA B	17,5	38	120		180	200	
	BHA H	22,5	40	90		1)		
	BHA SK	1)						
	BHA S R, BHA B R	15	25	40	100	160	1)	
	BHA H R	10				1)		
BHA SK R	1)							

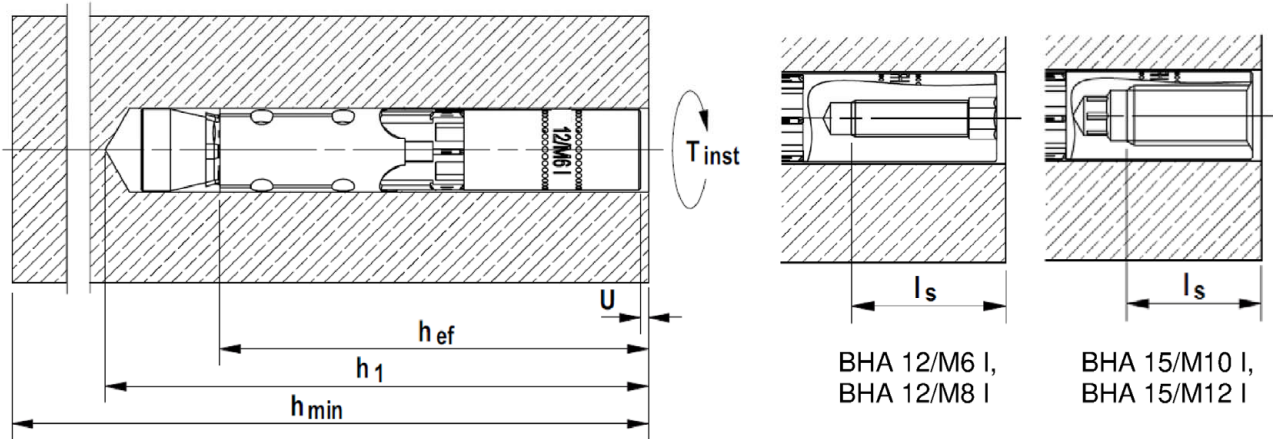
1) Anchor type not part of assessment

(Fig. not to scale)

BTI High-Performance Anchor BHA, BHA-I

Intended use
Installation parameters BHA, BHA R

Annex B 2



- h_{ef} = Effective embedment depth
- h_1 = Depth of drill hole to deepest point
- h_{min} = Minimum thickness of concrete member
- T_{inst} = Required setting torque
- U = Required gap after torquing
- l_s = Screw-in depth

Table B3.1: Installation parameters BHA-I and BHA-I R

Anchor type BHA-I and BHA-I R		BHA 12/M6 I	BHA 12/M8 I	BHA 15/M10 I	BHA 15/M12 I
Nominal drill hole diameter	d_0	12		15	
Maximum bit diameter	$d_{cut} \leq$	12,50		15,50	
Depth of drill hole	$h_1 \geq$ [mm]	85		95	
Diameter of clearance hole	$d_f \leq$	7	9	12	14
Required gap after torquing ¹⁾	U	3 - 5			
Required setting torque ¹⁾	T_{inst} [Nm]	15		25	
Minimum screw-in depth	$l_s \geq$	11 + U	13 + U	10 + U	12 + U
Maximum screw-in depth	$l_s \leq$	20 + U			
Maximum torque on fixture in combination with screws and threaded rods strength class ≥ 5.8 resp. $\geq A50$	$\max T_{fix}$ [Nm]	3	8	15	20

¹⁾ At least one of the requirements concerning the gap U or the required setting torque T_{inst} have to be fulfilled

(Fig. not to scale)

BTI High-Performance Anchor BHA, BHA-I

Intended use
Installation parameters BHA-I, BHA-I R

Annex B 3

Installation instructions:






















- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Use of the fastener only as supplied by the manufacturer without exchanging the components of the fastener
- Checking before placing the fastener to ensure that the strength class of the concrete in which the fastener is to be placed is in the range given and is not lower than that of the concrete to which the characteristic loads apply
- Check of concrete being well compacted, e.g. without significant voids
- Hammer or hollow drilling according to Annex B5 and B6
- Drill hole created perpendicular $\pm 5^\circ$ to concrete surface, positioning without damaging the reinforcement
- In case of aborted hole: new drilling at a minimum distance twice the depth of the aborted drill hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application

BTI High-Performance Anchor BHA, BHA-I

Intended Use
Installation instructions



Annex B 4

Installation instruction for the BTI High-Performance anchor
BHA 10 - BHA 32 and BHA 10 R - BHA 24 R

Hollow drilling		Continue with step 3, 4 and 5			
					
Hammer drilling	Installation instruction BHA 10 - 32 S and BHA 10 - 24 S R				
					
	Installation instruction BHA 10 - 18 SK and BHA 10 - 18 SK R				
					
	Installation instruction BHA 10 - 32 B and BHA 10 - 24 B R				
					
Installation instruction BHA 10 - 24 H and BHA 10 - 24 H R					






Step	1	2	3	4	5
------	----------	----------	----------	----------	----------

Step	Description	
1	Create drill hole with hammer drill	Create drill hole with hollow drill and vacuum cleaner
2	Clean the hole	-
3	Set the fastener	
4	Apply T_{inst}	
5	Installed fastener	

Types of drill bits	
Hammer drill	
Hollow drill	

BTI High-Performance Anchor BHA, BHA-I		Annex B 5
Intended use Installation instructions BHA, BHA R		

Installation instruction for the BTI High-Performance anchor internal thread
BHA-I and BHA-I R

Hollow drilling		Continue with step 2, 3, and 4		
Hammer drilling				
Step	1	2	3	4

Step	Description	
1	Create drill hole with hammer drill, clean drill hole	Create drill hole with hollow drill and vacuum cleaner
2	Hammering in the anchor flushed with the surface of the concrete	
3	Tighten the anchor. The included hexagon bit in the package should be used. Other tightening methods are allowed. Tighten the anchor in the concrete until the gap U is 3 - 5 mm or the required setting torque T_{inst} is reached. Only one of the above requirements has to be fulfilled.	
4	Attach the fixture and use a suitable screw or anchor rod. The length of the screw or anchor rod should be determined depending on the thickness of fixture t_{fix} , admissible tolerances, and available thread length $l_{s,max}$ and $l_{s,min}$ including the gap U. Tighten the screw with the torque $\leq \max T_{fix}$ ($\max T_{fix}$ see table B3.1)	

Types of drill bits

Hammer drill



Hollow drill



BTI High-Performance Anchor BHA, BHA-I

Intended use

Installation instructions BHA-I, BHA-I R

Annex B 6

Table C1.1: Performance characteristics of tension resistance under static and quasi-static loads for BHA and BHA R

Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R		BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32		
Steel failure										
BHA-S, -B,		16,1	29,3	46,4	67,4	125,3	195,8	282,0		
BHA-H, BHA-H R, -B R		$N_{Rk,s}$	[kN]	16,1	29,3	46,4	67,4	125,3 ²⁾		
BHA-SK		16,1	29,3	46,4	67,4	2)				
Partial factor		γ_{Ms} ¹⁾	[-]	1,5						
BHA-S R		$N_{Rk,s}$	[kN]	16,1	29,3	46,4	67,4	125,3 ²⁾		
BHA-SK R		16,1	29,3	46,4	67,4	2)				
Partial factor		γ_{Ms} ¹⁾	[-]	1,6						
Pullout failure										
Characteristic resistance in cracked concrete C20/25 BHA and BHA R		$N_{Rk,p}$	[kN]	7,5	12,0	16,0	25,0	34,4	48,1	63,3
Characteristic resistance in uncracked concrete C20/25 BHA		$N_{Rk,p}$	[kN]	12,5	22,9	28,8	35,2	49,2	68,8	90,4
Characteristic resistance in uncracked concrete C20/25 BHA R				12,5	20,0	28,8	35,2	49,2	2)	
Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete		ψ_c	C25/30	1,12						
			C30/37	1,22						
			C35/45	1,32						
			C40/50	1,41						
			C45/55	1,50						
			C50/60	1,58						
Installation factor		γ_{Inst}	[-]	1,0						
Concrete cone failure and splitting failure										
Effective embedment depth		h_{ef}	[mm]	40	60	70	80	100	125	150
Factor for cracked concrete		$k_{cr,N}$	[-]	7,7 ³⁾						
Factor for uncracked concrete		$k_{ucr,N}$		11,0 ³⁾						
Spacing		$s_{cr,N}$		120	180	210	240	300	375	450
Edge distance		$c_{cr,N}$	[mm]	60	90	105	120	150	187,5	225
Spacing (splitting)		$s_{cr,sp}$		190	300	320	340	380	480	570
Edge distance (splitting)		$c_{cr,sp}$		95	150	160	170	190	240	285
Characteristic resistance (splitting)		$N_{Rk,sp}^0$	[kN]	$\min \{N_{Rk,c}^0, N_{Rk,p}^0\}$ ⁴⁾						
¹⁾ In absence of other national regulations ²⁾ Anchor type no performance assessed ³⁾ Based on concrete strength as cylinder strength ⁴⁾ $N_{Rk,c}^0$ acc. EN 1992-4:2018										
BTI High-Performance Anchor BHA, BHA-I								Annex C 1		
Performances Performance characteristics of tension resistance for BHA and BHA R										

Table C2.1: Performance characteristics of tension resistance under static and quasi-static loads for BHA-I and BHA-I R					
Anchor type BHA-I and BHA-I R		BHA 12/M6 I	BHA 12/M8 I	BHA 15/M10 I	BHA 15/M12 I
Steel failure					
Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898					
Strength class 5.8		10	19	29	43
Strength class 6.8	$N_{Rk,s}$ [kN]	12	23	35	44
Strength class 8.8		16	27	44	44
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,5			
Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506					
Screw/thread strength class A50	$N_{Rk,s}$ [kN]	10	19	29	43
Partial factor	$\gamma_{Ms}^{1)}$ [-]	2,86			
Screw/thread strength class A70	$N_{Rk,s}$ [kN]	14	26	41	54
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,87			
Screw/thread strength class A80	$N_{Rk,s}$ [kN]	16	29	46	46
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,60			
Pullout failure					
Characteristic resistance in cracked concrete C20/25	$N_{Rk,p}$ [kN]	9,0		12,0	
Characteristic resistance in uncracked concrete C20/25		20,0		28,8	
Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete	ψ_c	C25/30	1,12		
		C30/37	1,22		
		C35/45	1,32		
		C40/50	1,41		
		C45/55	1,50		
		C50/60	1,58		
Installation factor	γ_{inst} [-]	1,0			
Concrete cone failure and splitting failure					
Effective embedment depth	h_{ef} [mm]	60		70	
Factor for cracked concrete	$k_{cr,N}$ [-]	7,7 ²⁾			
Factor for uncracked concrete	$k_{ucr,N}$ [-]	11,0 ²⁾			
Spacing	$s_{cr,N}$	180		210	
Edge distance	$c_{cr,N}$ [mm]	90		105	
Spacing (splitting)	$s_{cr,sp}$	300		320	
Edge distance (splitting)	$c_{cr,sp}$	150		160	
Characteristic resistance (splitting)	$N_{Rk,sp}^0$ [kN]	$\min \{N_{Rk,c}^0, N_{Rk,p}\}^3)$			
¹⁾ In absence of other national regulations ²⁾ Based on concrete strength as cylinder strength ³⁾ $N_{Rk,c}^0$ acc. EN 1992-4:2018					
BTI High-Performance Anchor BHA, BHA-I					Annex C 2
Performances Performance characteristics of tension resistance for BHA-I and BHA-I R					

Table C3.1: Performance characteristics of shear resistance for BHA and BHA R under static and quasi-static loads										
Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R			BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32	
Installation factor γ_{inst} [-]			1,0							
Steel failure without lever arm										
BHA-S			18,0	33,0	59,0	76,0	146,0	176,4	217,0	
BHA-B $V^0_{Rk,s}$ [kN]			16,0	27,2	42,8	61,9	119,0	148,8	169,0	
BHA-H			16,0	27,2	42,8	61,9	119,0	3)		
BHA-SK			$t_{fix}^{2)}$ [mm]	≥ 10		≥ 15		3)		
			$V^0_{Rk,s}$ [kN]	18,0	33,0	59,0	76,0			
			$t_{fix}^{2)}$ [mm]	< 10		< 15				
			$V^0_{Rk,s}$ [kN]	8,0	14,0	23,0	34,0			
Partial factor $\gamma_{Ms}^{1)}$ [-]			1,25							
Factor for ductility k_7			1,0							
BHA-S R $V^0_{Rk,s}$ [kN]			18,0	33,0	59,0	76,0	146,0	3)		
Partial factor $\gamma_{Ms}^{1)}$ [-]			1,33							
BHA-B R, -H R $V^0_{Rk,s}$ [kN]			16,0	27,2	42,8	61,9	119,0	3)		
Partial factor $\gamma_{Ms}^{1)}$ [-]			1,25							
BHA-SK R			$t_{fix}^{2)}$ [mm]	≥ 10		≥ 15		3)		
			$V^0_{Rk,s}$ [kN]	18,0	33,0	59,0	76,0			
			$t_{fix}^{2)}$ [mm]	< 10		< 15				
			$V^0_{Rk,s}$ [kN]	8,0	14,0	23,0	34,0			
Partial factor $\gamma_{Ms}^{1)}$ [-]			1,33							
Factor for ductility k_7			1,0							
Steel failure with lever arm and concrete pryout failure										
Characteristic bending resistance BHA-S, -SK, -B, -H $M^0_{Rk,s}$ [Nm]			12	30	60	105	266	518	896	
Partial factor $\gamma_{Ms}^{1)}$ [-]			1,25							
Characteristic bending resistance BHA R $M^0_{Rk,s}$ [Nm]			12	30	60	105	266	3)		
Partial factor $\frac{BHA-B R, -H R}{BHA-S R, -SK R}$ $\gamma_{Ms}^{1)}$ [-]			1,25							
			1,33							
Factor for pryout failure k_8 [-]			1,0	2,0						
Concrete edge failure										
Effective embedment depth for calculation $l_f =$ [mm]			h_{ef}							
Outside diameter of a fastener d_{nom}			10	12	15	18	24	28	32	
¹⁾ In absence of other national regulations ²⁾ The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm ³⁾ No performance assessed										
BTI High-Performance Anchor BHA, BHA-I							Annex C 3			
Performances		Performance characteristics of shear resistance for BHA and BHA R								

Table C4.1: Performance characteristics of shear resistance for BHA-I and BHA-I R under static and quasi-static loads					
Anchor type BHA-I and BHA-I R		BHA 12/M6 I	BHA 12/M8 I	BHA 15/M10 I	BHA 15/M12 I
Installation factor	γ_{inst} [-]	1,0			
Steel failure without lever arm					
Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898:2013					
Strength class 5.8		5	9	15	21
Strength class 6.8	$V_{RK,s}^0$ [kN]	6	11	18	24
Strength class 8.8		8	14	23	24
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,25			
Factor for ductility	k_7	1,0			
Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506:2010					
Strength class A50	$V_{RK,s}^0$ [kN]	5	9	15	21
Partial factor	$\gamma_{Ms}^{1)}$ [-]	2,38			
Strength class A70	$V_{RK,s}^0$ [kN]	7	13	20	30
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,56			
Strength class A80	$V_{RK,s}^0$ [kN]	8	15	23	32
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,33			
Factor for ductility	k_7	1,0			
Steel failure with lever arm and concrete pryout failure					
Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898:2013					
Strength class 5.8		8	19	37	65
Strength class 6.8	$M_{RK,s}^0$ [Nm]	9	23	44	78
Strength class 8.8		12	30	60	105
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,25			
Factor for ductility	k_7	1,0			
Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506:2010					
Strength class A50	$M_{RK,s}^0$ [Nm]	8	19	37	65
Partial factor	$\gamma_{Ms}^{1)}$ [-]	2,38			
Strength class A70	$M_{RK,s}^0$ [Nm]	11	26	52	92
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,56			
Strength class A80	$M_{RK,s}^0$ [Nm]	12	30	60	105
Partial factor	$\gamma_{Ms}^{1)}$ [-]	1,33			
Factor for ductility	k_7 [-]	1,0			
Factor for pryout failure	k_8	2,0			
Concrete edge failure					
Effective embedment depth for calculation	$l_f =$ [mm]	h_{ef}			
Outside diameter of fastener	d_{nom}	12		15	
1) In absence of other national regulations					
BTI High-Performance Anchor BHA, BHA-I				Annex C 4	
Performances Performance characteristics of shear resistance for BHA-I and BHA-I R					

Table C5.1: Performance characteristics of tension resistance under fire exposure

Anchor type	R30			R60		
	$N_{Rk,s,fi,30}$ [kN]	$N_{Rk,p,fi,30}$ [kN]	$N^0_{Rk,c,fi,30}$ [kN]	$N_{Rk,s,fi,60}$ [kN]	$N_{Rk,p,fi,60}$ [kN]	$N^0_{Rk,c,fi,60}$ [kN]
BHA 10, BHA 10 R	0,2	1,8	1,8	0,2	1,8	1,8
BHA 12, BHA 12 R	2,0	3,0	5,0	1,3	3,0	5,0
BHA 15, BHA 15 R	3,2	4,0	7,4	2,3	4,0	7,4
BHA 18, BHA 18 R	4,8	6,3	10,3	3,9	6,3	10,3
BHA 24, BHA 24 R	8,9	9,0	18,0	7,3	9,0	18,0
BHA 28	13,9	12,6	31,4	11,3	12,6	31,4
BHA 32	20,0	16,5	49,6	16,3	16,5	49,6
BHA 12/M6-I, 5.8, A50 ¹⁾	0,1	2,3	5,0	0,1	2,3	5,0
BHA 12/M6-I R 8.8, A70, A80 ^{1) 2)}	0,2			0,2		
BHA 12/M8-I, 5.8, A50 ¹⁾	1,3			0,8		
BHA 12/M8-I R 8.8, A70, A80 ^{1) 2)}	2,0			1,3		
BHA 15/M10-I, 5.8, A50 ¹⁾	2,0	3,0	7,4	1,4	3,0	7,4
BHA 15/M10-I R 8.8, A70, A80 ^{1) 2)}	3,2			2,3		
BHA 15/M12-I, 5.8/A50 ¹⁾	3,0			2,4		
BHA 15/M12-I R 8.8, A70, A80 ^{1) 2)}	4,8			3,9		
Anchor type	R90			R120		
	$N_{Rk,s,fi,90}$ [kN]	$N_{Rk,p,fi,90}$ [kN]	$N^0_{Rk,c,fi,90}$ [kN]	$N_{Rk,s,fi,120}$ [kN]	$N_{Rk,p,fi,120}$ [kN]	$N^0_{Rk,c,fi,120}$ [kN]
BHA 10, BHA 10 R	0,1	1,8	1,8	0,1	1,5	1,5
BHA 12, BHA 12 R	0,6	3,0	5,0	0,2	2,4	4,0
BHA 15, BHA 15 R	1,4	4,0	7,4	1,0	3,2	5,9
BHA 18, BHA 18 R	3,0	6,3	10,3	2,6	5,0	8,2
BHA 24, BHA 24 R	5,6	9,0	18,0	4,8	7,2	14,4
BHA 28	8,8	12,6	31,4	7,5	10,1	25,2
BHA 32	12,6	16,5	49,6	10,8	13,2	39,7
BHA 12/M6-I, 5.8, A50 ¹⁾	0,1	2,3	5,0	0,1	1,8	4,0
BHA 12/M6-I R 8.8, A70, A80 ^{1) 2)}	0,1			0,1		
BHA 12/M8-I, 5.8, A50 ¹⁾	0,4			0,1		
BHA 12/M8-I R 8.8, A70, A80 ^{1) 2)}	0,6			0,2		
BHA 15/M10-I, 5.8, A50 ¹⁾	0,9	3,0	7,4	0,6	2,4	5,9
BHA 15/M10-I R 8.8, A70, A80 ^{1) 2)}	1,4			1,0		
BHA 15/M12-I, 5.8/A50 ¹⁾	1,9			1,6		
BHA 15/M12-I R 8.8, A70, A80 ^{1) 2)}	3,0			2,6		

¹⁾ Intermediate values by linear interpolation

²⁾ In combination with screw / threaded rod strength class 8.8, A70, A80

BTI High-Performance Anchor BHA, BHA-I

Performances

Performance characteristics of tension resistance under fire exposure

Annex C 5

Table C6.1: Performance characteristics of shear resistance under fire exposure

Anchor type	R30		R60	
	$V_{Rk,s,fi,30}$ [kN]	$M^0_{Rk,s,fi,30}$ [Nm]	$V_{Rk,s,fi,60}$ [kN]	$M^0_{Rk,s,fi,60}$ [Nm]
BHA 10, BHA 10 R	0,3	0	0,3	0
BHA 12, BHA 12 R	2,0	2	1,3	1
BHA 15, BHA 15 R	3,2	4	2,3	3
BHA 18, BHA 18 R	4,8	7	3,9	6
BHA 24, BHA 24 R	8,9	19	7,3	15
BHA 28	13,9	37	11,3	30
BHA 32	20,0	64	16,3	52
BHA 12/M6 I, 5.8, A50 ¹⁾	0,2	0	0,2	0
BHA 12/M6 I R 8.8, A70, A80 ^{1) 2)}	0,3	0	0,3	0
BHA 12/M8 I, 5.8, A50 ¹⁾	1,3	1	0,8	1
BHA 12/M8-I R 8.8, A70, A80 ^{1) 2)}	2,0	2	1,3	1
BHA 15/M10 I, 5.8, A50 ¹⁾	2,0	3	1,4	2
BHA 15/M10-I R 8.8, A70, A80 ^{1) 2)}	3,2	4	2,3	3
BHA 15/M12-I, 5.8/A50 ¹⁾	3,0	4	2,4	4
BHA 15/M12-I R 8.8, A70, A80 ^{1) 2)}	4,8	7	3,9	6
Anchor type	R90		R120	
	$V_{Rk,s,fi,90}$ [kN]	$M^0_{Rk,s,fi,90}$ [Nm]	$V_{Rk,s,fi,120}$ [kN]	$M^0_{Rk,s,fi,120}$ [Nm]
BHA 10, BHA 10 R	0,2	0	0,1	0
BHA 12, BHA 12 R	0,6	1	0,2	0
BHA 15, BHA 15 R	1,4	2	1,0	1
BHA 18, BHA 18 R	3,0	5	2,6	4
BHA 24, BHA 24 R	5,6	12	4,8	10
BHA 28	8,8	23	7,5	20
BHA 32	12,6	40	10,8	34
BHA 12/M6-I, 5.8, A50 ¹⁾	0,1	0	0,1	0
BHA 12/M6-I R 8.8, A70, A80 ^{1) 2)}	0,2	0	0,1	0
BHA 12/M8-I, 5.8, A50 ¹⁾	0,4	1	0,1	0
BHA 12/M8-I R 8.8, A70, A80 ^{1) 2)}	0,6	1	0,2	0
BHA 15/M10 I, 5.8, A50 ¹⁾	0,9	2	0,6	1
BHA 15/M10-I R 8.8, A70, A80 ^{1) 2)}	1,4	3	1,0	1
BHA 15/M12 I, 5.8/A50 ¹⁾	1,9	4	1,6	3
BHA 15/M12-I R 8.8, A70, A80 ^{1) 2)}	3,0	6	2,6	4

¹⁾ Intermediate values by linear interpolation

²⁾ In combination with screw / threaded rod strength class 8.8, A70, A80

Table C6.2: Minimum spacings and minimum edge distances of anchors under fire exposure for tension and shear loads

Anchor type	BHA 10	BHA 12 BHA 12-I	BHA 15 BHA 15-I	BHA 18	BHA 24	BHA 28	BHA 32
Spacing $\frac{S_{cr,N,fi}}{S_{min,fi}}$	4x h _{ef}						
	40	50	60	70	80	100	120
Edge distance $\frac{C_{cr,N,fi}}{C_{min,fi}}$ [mm]	2 x h _{ef}						
	C _{min,fi} = 2 x h _{ef} , for fire exposure from more than one side C _{min,fi} ≥ 300 mm						

BTI High-Performance Anchor BHA, BHA-I

Performances

Performance characteristics of shear resistance under fire exposure

Minimum spacings and minimum edge distances of anchors under fire exposure

Annex C 6

Table C7.1: Minimum thickness of concrete member, minimum spacing and minimum edge distances
BHA, BHA R

Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R		BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Minimum thickness of concrete member	h_{min} [mm]	80	120	140	160	200	250	300
Minimum spacing, cracked concrete	s_{min}	40	50	60	70	80	100	120
	for $c \geq$	40	80	120	140	180	200	260
Minimum edge distance, cracked concrete	c_{min}	40	50	60	70	80	100	120
	for $s \geq$	40	80	120	160	200	220	280
Minimum spacing, uncracked concrete	s_{min}	40	60	70	80	100	120	160
	for $c \geq$	70	100	100	160	200	220	360
Minimum edge distance, uncracked concrete	c_{min}	40	60	70	80	100	120	180
	for $s \geq$	70	100	140	200	220	240	380

Intermediate values may be calculated by linear interpolation

Table C7.2: Minimum thickness of concrete member, minimum spacing and minimum edge distances
BHA-I, BHA-I R

Anchor type BHA-I and BHA-I R		BHA 12/M6 I BHA 12/M8 I	BHA 15/M10 I BHA 15/M12 I
Minimum thickness of concrete member	h_{min} [mm]	125	150
Minimum spacing, cracked concrete	s_{min}	50	60
	for $c \geq$	80	120
Minimum edge distance, cracked concrete	c_{min}	50	60
	for $s \geq$	80	120
Minimum spacing, uncracked concrete	s_{min}	60	70
	for $c \geq$	100	100
Minimum edge distance, uncracked concrete	c_{min}	60	70
	for $s \geq$	100	140

Intermediate values may be calculated by linear interpolation.

BTI High-Performance Anchor BHA, BHA-I

Performances
Minimum thickness of concrete member, minimum spacing and minimum edge distances

Annex C 7

Table C8.1: Performance characteristics of **tension and shear resistance** for **seismic performance category C1** for BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R

Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R		BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32		
Steel failure									
Characteristic resistance of tension load C1	BHA-S, -B	29,3	46,4	67,4	125,3	195,8	282,0		
	BHA-H, -H R, -B R	29,3	46,4	67,4	125,3	3)			
	BHA-SK	29,3	46,4	67,4	3)				
	Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,5						
	BHA-S R	29,3	46,4	67,4	125,3	3)			
	BHA-SK R	29,3	46,4	67,4	3)				
	Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,6						
Pullout failure									
Characteristic resistance of tension load in cracked concrete C1		$N_{Rk,p,C1}$ [kN]	12,0	16,0	25,0	36,0	50,3	66,1	
		$\gamma_{Mp,C1}^{1)}$ [-]	1,5						
Steel failure without lever arm									
Characteristic resistance of shear load C1									
BHA-S	$V_{Rk,s,C1}$ [kN]	25,0	41,0	60,0	123,0	141,0	200,0		
BHA-B		17,0	30,0	46,0	103,0	117,0	169,0		
BHA-H		17,0	30,0	46,0	103,0				
BHA-SK	$t_{fix}^{2)}$ [mm]	≥ 10	≥ 15		3)				
	$V_{Rk,s,C}$ [kN]	25,0	41,0	60,0					
	$t_{fix}^{2)}$ [mm]	< 10	< 15						
	$V_{Rk,s,C}$ [kN]	11,0	16,0	27,0					
Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,25							
BHA-S R	$V_{Rk,s,C1}$ [kN]	25,0	41,0	60,0	123,0	-			
Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,33							
BHA-B R, -H R	$V_{Rk,s,C1}$ [kN]	17,0	30,0	46,0	103,0	-			
Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,25							
BHA-SK R	$t_{fix}^{2)}$ [mm]	≥ 10	≥ 15		3)				
	$V_{Rk,s,C1}$ [kN]	25,0	41,0	60,0					
	$t_{fix}^{2)}$ [mm]	< 10	< 15						
	$V_{Rk,s,C1}$ [kN]	11,0	16,0	27,0					
Partial factor	$\gamma_{Ms,C1}^{1)}$ [-]	1,33							
Factor for annular gap	α_{gap}	0,50							

¹⁾ In absence of other national regulations

²⁾ The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm

³⁾ No performance assessed

BTI High-Performance Anchor BHA, BHA-I

Performances
Performance characteristics of tension and shear resistance for seismic performance category C1

Annex C 8

Table C9.1: Performance characteristics of **tension and shear resistance** for **seismic performance category C2** for BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R

Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R				BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Steel failure									
Characteristic resistance of tension load C2	BHA-S, -B	$N_{Rk,s,C2}$ [kN]	[kN]	29,3	46,4	67,4	125,3	195,8	
	BHA-H, -H R, -B R			29,3	46,4	67,4	125,3	3)	
	BHA-SK	29,3	46,4	67,4	3)				
	Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,5					
	BHA-S R	$N_{Rk,s,C2}$ [kN]	[kN]	29,3	46,4	67,4	125,3	3)	
	BHA-SK R			29,3	46,4	67,4	3)		
	Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,6					
Pullout failure									
Characteristic resistance of tension load in cracked concrete C2	$N_{Rk,p,C2}$ [kN]			6,2	11,3	21,8	43,0	65,9	
	$\gamma_{Mp,C2}^{1)}$	[-]		1,5					
Steel failure without lever arm									
Characteristic resistance of shear load C2									
BHA-S	$V_{Rk,s,C2}$ [kN]	[kN]	14,7	28,9	41,0	100,7			
BHA-B			9,8	20,9	34,1	61,9	67,2		
BHA-H			9,8	20,9	34,1	61,9	3)		
BHA-SK	$t_{fix}^{2)}$ [mm]		≥ 10	≥ 15		3)			
	$V_{Rk,s,C2}$ [kN]		14,8	23,3	33,8				
	$t_{fix}^{2)}$ [mm]		< 10	< 15					
	$V_{Rk,s,C2}$ [kN]		6,3	9,1	15,1				
Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,25						
BHA-S R	$V_{Rk,s,C2}$ [kN]		14,7	28,9	41,0	100,7	3)		
Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,33						
BHA-B R, -H R	$V_{Rk,s,C2}$ [kN]		9,8	20,9	34,1	61,9	3)		
Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,25						
BHA-SK R	$t_{fix}^{2)}$ [mm]		≥ 10	≥ 15		3)			
	$V_{Rk,s,C2}$ [kN]		14,8	23,3	33,8				
	$t_{fix}^{2)}$ [mm]		< 10	< 15					
	$V_{Rk,s,C2}$ [kN]		6,3	9,1	15,1				
Partial factor	$\gamma_{Ms,C2}^{1)}$	[-]	1,33						
Factor for annular gap	α_{gap}		0,50						
BTI High-Performance Anchor BHA, BHA-I									Annex C 9
Performances Performance characteristics of tension and shear resistance for seismic performance category C2									

1) In absence of other national regulations

2) The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm

3) No performance assessed

Table C10.1: Displacements under static and quasi static tension loads for BHA and BHA R									
Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R			BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Tension load cracked concrete	N	[kN]	3,6	5,7	7,6	11,9	17,1	24,0	31,5
Corresponding displacements	$\frac{\delta_{N0}}{\delta_{N\infty}}$	[mm]	1,0	1,0	1,0	1,0	1,0	0,7	0,7
			1,7	1,6	1,6	1,6	1,8	1,3	1,1
Tension load uncracked concrete	N	[kN]	6,0	11,2	14,1	17,2	24,0	33,6	44,2
Corresponding displacements	$\frac{\delta_{N0}}{\delta_{N\infty}}$	[mm]	0,6	1,0	1,0	1,0	1,0	0,3	0,3
			1,7	1,6	1,6	1,6	1,8	1,3	1,1

Table C10.2: Displacements under static and quasi static tension loads for BHA-I and BHA-I R				
Anchor type BHA-I and BHA-I R			BHA 12/M6 I BHA 12/M8 I	BHA 15/M10 I BHA 15/M12 I
Tension load cracked concrete	N	[kN]	4,3	5,7
Tension load uncracked concrete			9,5	14,1
Corresponding displacements	$\frac{\delta_{N0}}{\delta_{N\infty}}$	[mm]	1,7	1,9
			2,2	2,9

Table C10.3: Displacements under static and quasi static shear loads for BHA-S and BHA-SK									
Anchor type BHA-S and BHA-SK			BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Shear load in cracked and uncracked concrete	V	[kN]	10,3	18,9	33,7	43,4	83,4	99,4	124,0
Corresponding displacements	$\frac{\delta_{V0}}{\delta_{V\infty}}$	[mm]	2,4	2,7	4,4	5,0	7,0	6,0	8,0
			3,6	4,1	6,6	7,5	10,5	9,0	12,0

Table C10.4: Displacements under static and quasi static shear loads for BHA-B and BHA-H									
Anchor type BHA-B and BHA-H			BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Shear load in cracked and uncracked concrete	V	[kN]	8,9	15,4	23,4	35,4	68,0	83,4	96,6
Corresponding displacements	$\frac{\delta_{V0}}{\delta_{V\infty}}$	[mm]	2,2	2,3	3,0	5,0	7,0	5,0	5,0
			3,3	3,5	4,5	7,5	10,5	7,5	7,5

BTI High-Performance Anchor BHA, BHA-I							Annex C 10	
Performances Displacements under tension and shear loads								

Table C11.1: Displacements under static and quasi static shear loads for BHA-S R, BHA-SK R, BHA-B R and BHA-H R								
Anchor type BHA-S R, -SK R, -B R, -H R			BHA 10	BHA 12	BHA 15	BHA 18	BHA 24	
Shear load in cracked and uncracked concrete	V	[kN]	10,3	16,0	24,6	37,7	68,0	
Corresponding displacements	$\frac{\delta_{v0}}{\delta_{v\infty}}$	[mm]	3,5	3,5	3,7	5,7	9,0	
			5,3	5,3	5,6	8,6	13,5	
Table C11.2: Displacements under static and quasi static shear loads for BHA-I and BHA-I R								
Anchor type: BHA-I and BHA-I R			BHA 12/M6 I	BHA 12/M8 I	BHA 15/M10 I	BHA 15/M12 I		
Shear load in cracked and uncracked concrete	V	[kN]	4,6	8,3	13,3	13,7		
Corresponding displacements	$\frac{\delta_{v0}}{\delta_{v\infty}}$	[mm]	2,6	2,6	2,2	2,2		
			3,9	3,9	3,3	3,3		
Table C11.3: Displacements under tension loads for seismic performance category C2 for BHA and BHA R								
Anchor type BHA-S, -SK, -B, -H and BHA-S R, -SK R, -B R, -H R			BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Displacement DLS	$\delta_{N,C2}$ (DLS)	[mm]	1,55	2,63	2,04	4,26	3,06	
Displacement ULS	$\delta_{N,C2}$ (ULS)		8,71	11,07	7,30	11,70	11,44	
Table C11.4: Displacements under shear loads for seismic performance category C2 for BHA and BHA R								
Anchor type BHA-S, -SK and BHA-S R, -SK R			BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Displacement DLS	$\delta_{V,C2}$ (DLS)	[mm]	3,53	4,18	4,67	5,59	4,79	
Displacement ULS	$\delta_{V,C2}$ (ULS)		6,62	7,38	9,03	14,09	9,95	
Anchor type BHA-B, -H and BHA-B R, -H R			BHA 12	BHA 15	BHA 18	BHA 24	BHA 28	BHA 32
Displacement DLS	$\delta_{V,C2}$ (DLS)	[mm]	3,42	4,26	4,29	4,79		
Displacement ULS	$\delta_{V,C2}$ (ULS)		5,26	6,66	7,95	7,69	9,95	
BTI High-Performance Anchor BHA, BHA-I							Annex C 11	
Performances Displacements under tension and shear loads								