

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-12/0258**  
**of 17 June 2020**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer Superbond

Product family  
to which the construction product belongs

Bonded anchor for use in concrete

Manufacturer

fischerwerke GmbH & Co. KG  
Otto-Hahn-Straße 15  
79211 Denzlingen  
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment  
contains

42 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601

This version replaces

ETA-12/0258 issued on 22 July 2019

**European Technical Assessment**

**ETA-12/0258**

English translation prepared by DIBt

**Page 2 of 42 | 17 June 2020**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The injection system fischer Superbond is a bonded anchor for use in concrete consisting of a cartridge with injection mortar fischer FIS SB or a resin capsule fischer RSB and a steel element according to Annex A 5.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The resin capsule is placed into the hole and the steel element is driven by machine with simultaneous hammering and turning. The anchor rod is anchored via the bond between steel element, chemical mortar and concrete

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B 4 to B 8, C 1 to C 10
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1 to C 4
Displacements under short-term and long-term loading	See Annex C 11 and C 12
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C 13 to C 16

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 17 June 2020 by Deutsches Institut für Bautechnik


BD Dipl.-Ing. Andreas Kummerow  
Head of Department

*beglaubigt:*  
Baderschneider


## Installation conditions part 1

anchor rod or fischer anchor rod RG M with fischer injection system FIS SB


**Pre-positioned installation**

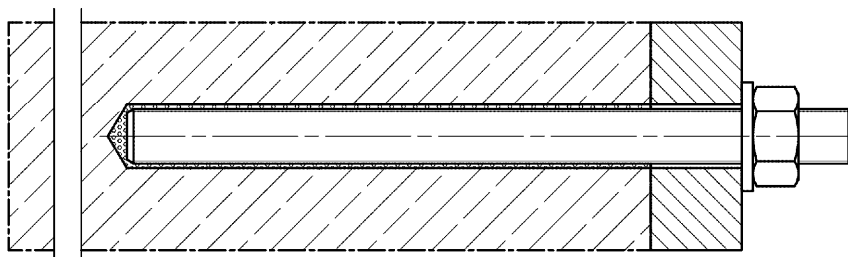

**Push through installation** (annular gap filled with mortar)

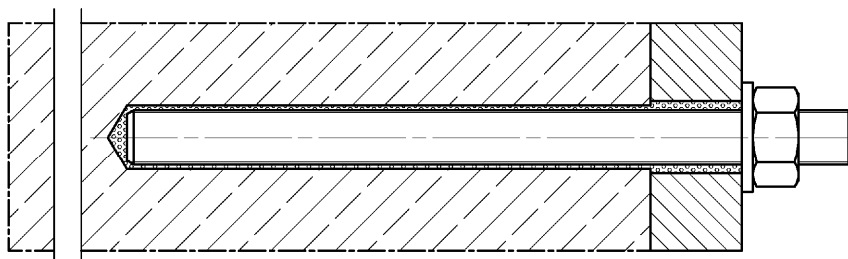

**Pre-positioned or push through installation with subsequently injected fischer filling disc**  
(annular gap filled with mortar)

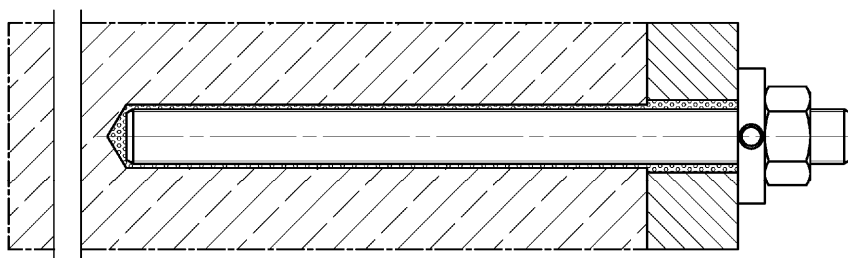

Figures not to scale


fischer Superbond

**Product description**  
Installation conditions part 1

**Annex A 1**


Installation conditions part 2

Reinforcing bar with fischer injection system FIS SB

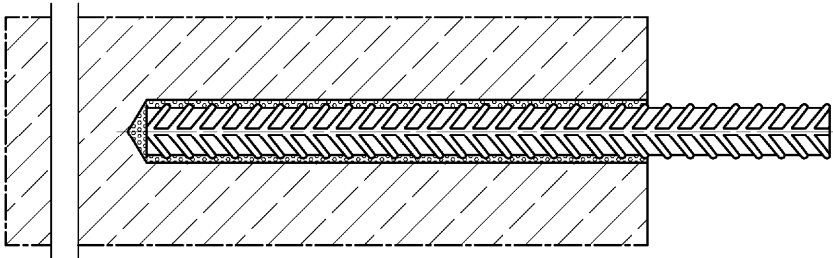


fischer rebar anchor FRA with fischer injection system FIS SB

Pre-positioned installation

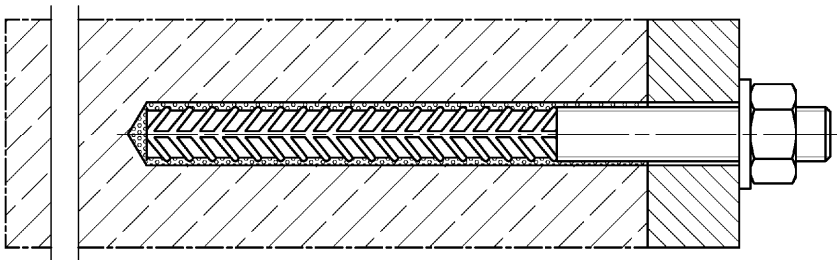

Push through installation (annular gap filled with mortar)

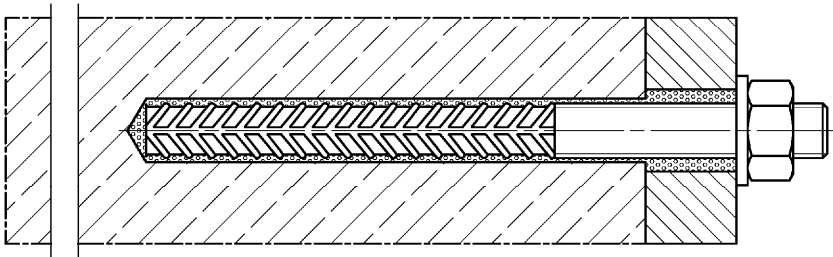

Figures not to scale

fischer Superbond


Product description  
Installation conditions part 2

Annex A 2


### Installation conditions part 3

fischer internal threaded anchor RG MI with fischer resin capsule system RSB or fischer injection system FIS SB

**Pre-positioned installation**

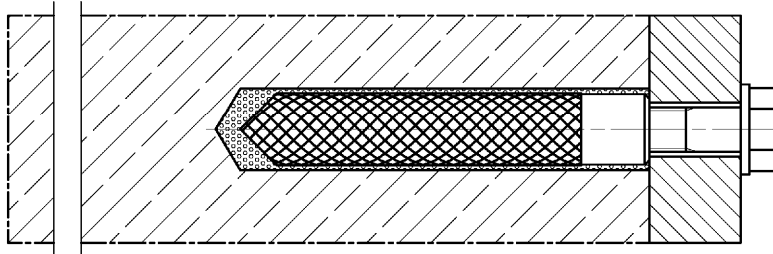


**Pre-positioned installation with subsequently injected fischer filling disc** (annular gap filled with mortar)

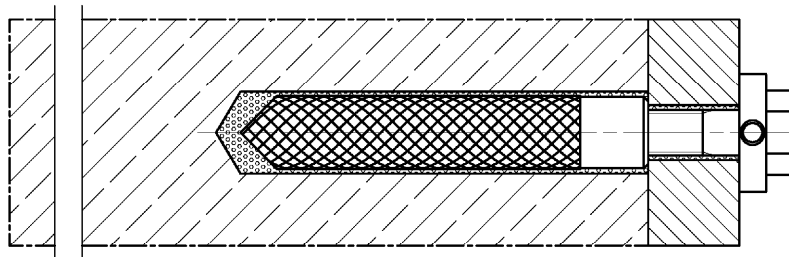


fischer anchor rod RG M with fischer resin capsule system RSB

**Pre-positioned installation**

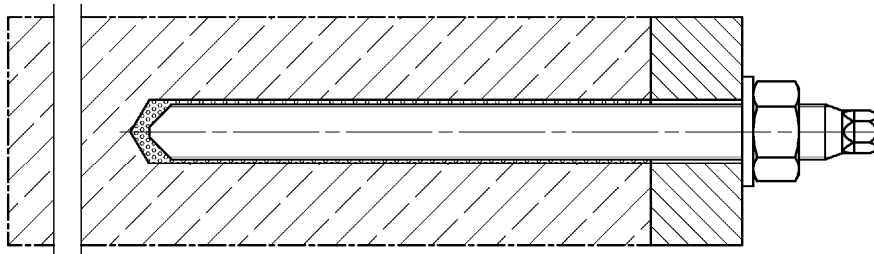

**Pre-positioned installation with subsequently injected fischer filling disc** (annular gap filled with mortar)

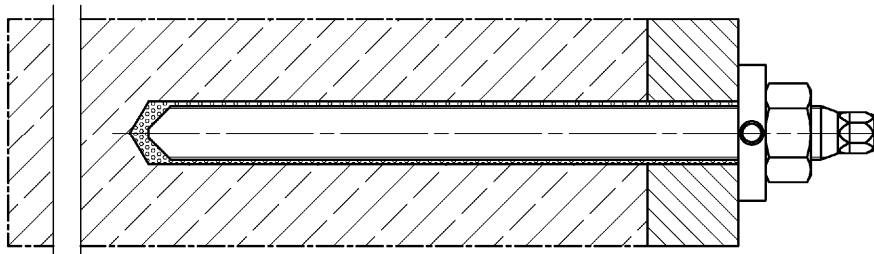

Figures not to scale

fischer Superbond


**Product description**

Installation conditions part 3

**Annex A 3**

## Overview system components Part 1

**Mortar cartridge (shuttle cartridge) with sealing cap; Sizes: 390 ml, 585 ml, 1100 ml, 1500 ml**

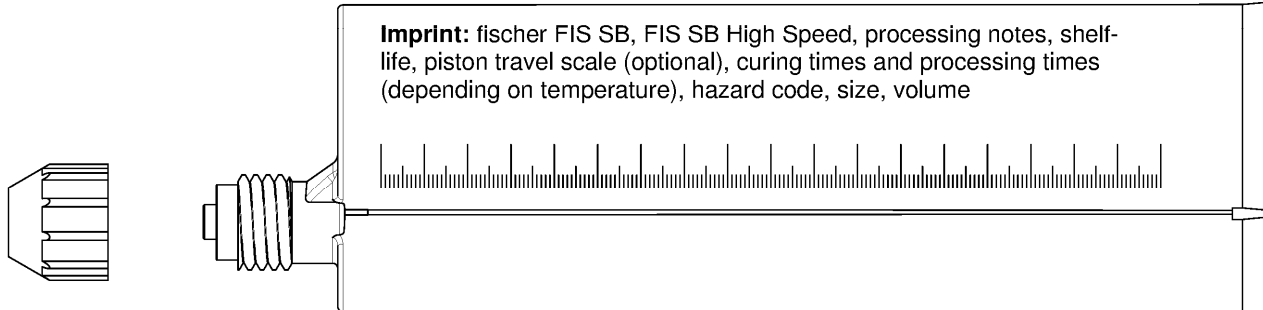


**Resin capsule**


Sizes: 8, 10 mini, 10, 12 mini, 12, 16 mini, 16, 16 E, 20, 20 E / 24, 30



**Static mixer FIS MR Plus or UMR**

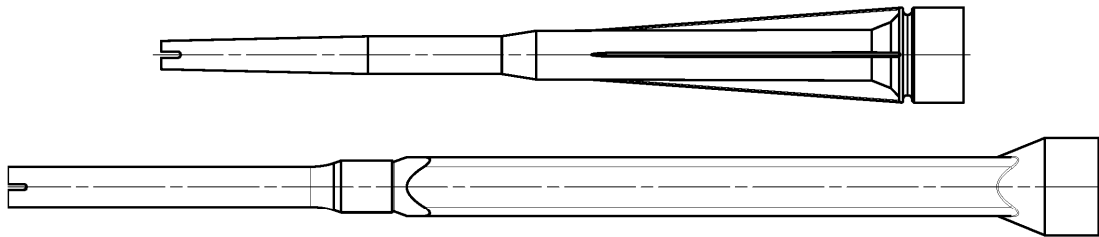

**Injection adapter / extension tube for static mixer**



Figures not to scale

fischer Superbond

**Product description**

Overview system components part 1;  
cartridges / capsule / static mixer / injection adapter


**Annex A 4**



## Overview system components Part 2


### anchor rod

Sizes: M8, M10, M12, M16, M20, M24, M27, M30



### fischer anchor rod RG M

Sizes: M8, M10, M12, M16, M20, M24, M30




### fischer internal threaded anchor RG MI


Size: M8, M10, M12, M16, M20



### Screw / threaded rod / washer / hexagon nut

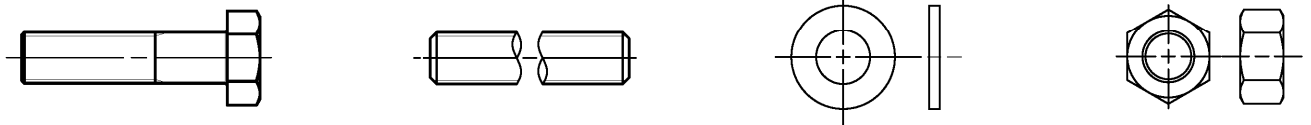

### fischer filling disc with injection adapter

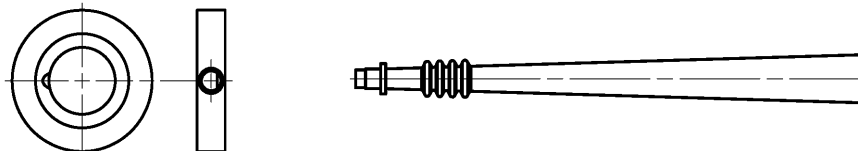

### Reinforcing bar

Nominal diameters:  $\phi 8$ ,  $\phi 10$ ,  $\phi 12$ ,  $\phi 14$ ,  $\phi 16$ ,  $\phi 20$ ,  $\phi 25$ ,  $\phi 28$ ,  $\phi 32$



### fischer rebar anchor FRA

Sizes: M12, M16, M20, M24



Figures not to scale

fischer Superbond

### Product description

Overview system components part 2;  
steel components

**Annex A 5**

## Overview system components Part 3

### Cleaning brush BS / BSB



### Blow-out pump ABG or ABP with cleaning nozzle



Figures not to scale

fischer Superbond

#### Product description

Overview system components part 3;  
cleaning brush / blow-out pump / injection adapter








**Annex A 6**

**Table A7.1: Materials**

Part	Designation	Material		
1	Injection cartridge	Mortar, hardener, filler		
	Steel grade	Steel	Stainless steel R	High corrosion resistant steel HCR <sup>2)</sup>
		zinc plated	acc. to EN 10088-1:2014 Corrosion resistance class CRC III acc. to EN 1993-1-4:2015	acc. to EN 10088-1:2014 Corrosion resistance class CRC V acc. to EN 1993-1-4:2015
2	Anchor rod	Property class 4.8, 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 12% fracture elongation	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062, 1.4662, 1.4462; EN 10088-1:2014 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 12% fracture elongation	Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with f <sub>yk</sub> = 560 N/mm <sup>2</sup> 1.4565; 1.4529; EN 10088-1:2014 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 12% fracture elongation
		Fracture elongation A <sub>5</sub> > 8 %, for applications without requirements for seismic performance category C2		
3	Washer ISO 7089:2000	zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004	1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565; 1.4529; EN 10088-1:2014
4	Hexagon nut	Property class 5 or 8; EN ISO 898-2:2012 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
5	fischer internal threaded anchor RG MI	Property class 5.8 ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K)	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014
6	Commercial standard screw or threaded rod for fischer internal threaded anchor RG MI	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K), A <sub>5</sub> > 8 % fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 A <sub>5</sub> > 8 % fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014 A <sub>5</sub> > 8 % fracture elongation
7	fischer filling disc similar to DIN 6319-G	zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565;1.4529; EN 10088-1:2014
8	Reinforcing bar EN 1992-1-1:2004 and AC:2010, Annex C	Bars and de-coiled rods, class B or C with f <sub>yk</sub> and k according to NDP or NCL according to EN 1992-1-1/NA f <sub>uk</sub> = f <sub>tk</sub> = k · f <sub>yk</sub>		
9	fischer rebar anchor FRA	Rebar part: Bars and de-coiled rods class B or C with f <sub>yk</sub> and k according to NDP or NCL of EN 1992-1-1:2004+AC:2010 f <sub>uk</sub> = f <sub>tk</sub> = k · f <sub>yk</sub>	Threaded part: Property class 70 or 80 EN ISO 3506-1:2009 1.4401, 1.4404, 1.4571, 1.4578, 1.4439, 1.4362, 1.4062 acc. to EN 10088-1:2014 Corrosion resistance class CRC III acc. to EN 1993-1-4:2015 1.4565; 1.4529 acc. to EN 10088-1:2014 Corrosion resistance class CRC V acc. to EN 1993-1-4:2015	
fischer Superbond				Annex A 7
Product description Materials				






## Specifications of intended use (part 1)

**Table B1.1:** Overview use and performance categories, injection mortar system FIS SB

Anchorages subject to		FIS SB with ...							
		anchor rod 		fischer internal threaded anchor RG MI 		Reinforcing bar 		fischer rebar anchor FRA 	
Hammer drilling with standard drill bit 		all sizes							
Hammer drilling with hollow drill bit (fischer "FHD", Heller "Duster Expert"; Bosch „Speed Clean“; Hilti "TE-CD, TE-YD", DreBo „D-Plus“, DreBo „D-Max“) 		Nominal drill bit diameter ( $d_0$ ) 12 mm to 35 mm							
Diamond drilling 		not permitted							
Static and quasi static load, in	uncracked concrete	all sizes	Tables: C1.1 C4.1 C5.1 C11.1	all sizes	Tables: C2.1 C4.1 C7.1 C11.2	all sizes	Tables: C3.1 C4.1 C9.1 C12.1	all sizes	Tables: C3.2 C4.1 C10.1 C12.2
	cracked concrete								
Seismic performance category (only hammer drilling with standard / hollow drill bits)	C1	all sizes	Tables: C13.1 C14.2 C15.1	_1)		all sizes	Tables: C14.1 C14.2 C15.2	_1)	
	C2	M12 M16 M20 M24	Tables: C13.1 C14.2 C16.1			_1)	_1)		
Use category	I1 dry or wet concrete	all sizes							
	I2 water filled hole	not permitted							
Installation direction		D3 (downward and horizontal and upwards (overhead) installation)							
Installation method		pre-positioned or push through installation							
Installation temperature		FIS SB: $T_{i,min} = -15\text{ °C}$ to $T_{i,max} = +40\text{ °C}$ FIS SB High Speed: $T_{i,min} = -20\text{ °C}$ to $T_{i,max} = +40\text{ °C}$							
In-service temperature	Temperature range I	-40 °C to +40 °C		$T_{st} = +40\text{ °C}$ / $T_{lt} = +24\text{ °C}$					
	Temperature range II	-40 °C to +80 °C		$T_{st} = +80\text{ °C}$ / $T_{lt} = +50\text{ °C}$					
	Temperature range III	-40 °C to +120 °C		$T_{st} = +120\text{ °C}$ / $T_{lt} = +72\text{ °C}$					
	Temperature range IV	-40 °C to +150 °C		$T_{st} = +150\text{ °C}$ / $T_{lt} = +90\text{ °C}$					
1) No performance assessed									
fischer Superbond								Annex B 1	
Intended use Specifications (part 1), fischer injection mortar system FIS SB									

## Specifications of intended use (part 2)

**Table B2.1:** Overview use and performance categories, resin capsule system RSB

Anchorages subject to		RSB with ...			
		fischer anchor rod RG M 		fischer internal threaded anchor RG MI 	
Hammer drilling with standard drill bit 		all sizes			
Hammer drilling with hollow drill bit (fischer "FHD", Heller "Duster Expert"; Bosch „Speed Clean“; Hilti "TE-CD, TE-YD", DreBo „D-Plus“, DreBo „D-Max“) 		Nominal drill bit diameter (d <sub>0</sub> ) 12 mm to 35 mm		all sizes	
Diamond drilling 		all sizes <sup>1)</sup>			
Static and quasi static load, in	uncracked concrete	all sizes	Tables: C1.1 C4.1 C6.1 C11.1	all sizes	Tables: C2.1 C4.1 C8.1 C11.2
	cracked concrete	all sizes <sup>1)</sup>		all sizes <sup>1)</sup>	
Seismic performance category (only hammer drilling with standard / hollow drill bits)	C1	all sizes	Tables: C13.1 C14.2 C15.1	_2)	
	C2	_2)			
Use category	I1 dry or wet concrete	all sizes			
	I2 water filled hole	all sizes			
Installation direction		D3 (downward and horizontal and upwards (overhead) installation)			
Installation method		only pre-positioned installation			
Installation temperature		T <sub>i,min</sub> = -30 °C to T <sub>i,max</sub> = +40 °C			
In-service temperature	Temperature range I	-40 °C to +40 °C	T <sub>st</sub> = +40 °C / T <sub>lt</sub> = +24 °C		
	Temperature range II	-40 °C to +80 °C	T <sub>st</sub> = +80 °C / T <sub>lt</sub> = +50 °C		
	Temperature range III	-40 °C to +120 °C	T <sub>st</sub> = +120 °C / T <sub>lt</sub> = +72 °C		
	Temperature range IV	-40 °C to +150 °C	T <sub>st</sub> = +150 °C / T <sub>lt</sub> = +90 °C		
<sup>1)</sup> For diamond drilling in cracked concrete only nominal drill bit diameters (d <sub>0</sub> ) ≥ 18 mm are permitted <sup>2)</sup> No performance assessed					
fischer Superbond					Annex B 2
Intended use Specifications (part 2), fischer resin capsule system RSB					

### Specifications of intended use (part 3)

#### Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres of strength classes C20/25 to C50/60 according to EN 206:2013+A1:2016

#### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- For all other conditions according to EN1993-1-4:2015 corresponding to corrosion resistance classes to Annex A 7 table A7.1.

#### Design:

- Anchorages have to be designed by a responsible engineer with experience of concrete anchor design.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed in accordance with:  
EN 1992-4:2018 and EOTA Technical Report TR 055, Edition February 2018.

#### Installation:

- Anchor installation is to be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- In case of aborted hole: The hole shall be filled with mortar
- Anchorage depth should be marked and adhered to on installation
- Overhead installation is allowed

fischer Superbond


**Intended use**  
Specifications (part 3)

**Annex B 3**

**Table B4.1: Installation parameters for anchor rods in combination with injection mortar system FIS SB**

Anchor rods		Thread	M8	M10	M12	M16	M20	M24	M27	M30
Width across flats	SW	[mm]	13	17	19	24	30	36	41	46
Nominal drill hole diameter	$d_0$		10	12	14	18	24	28	30	35
Drill hole depth	$h_0$		$h_0 = h_{ef}$							
Effective embedment depth	$h_{ef, min}$		60	60	70	80	90	96	108	120
	$h_{ef, max}$		160	200	240	320	400	480	540	600
Minimum spacing and minimum edge distance	$s_{min} = c_{min}$		40	45	55	65	85	105	120	140
Diameter of the clearance hole of the fixture	pre-positioned installation $d_f$		9	12	14	18	22	26	30	33
	push through installation $d_f$		11	14	16	20	26	30	33	40
Min. thickness of concrete member	$h_{min}$		$h_{ef} + 30 \quad (\geq 100)$			$h_{ef} + 2d_0$				
Maximum setting torque	$\max T_{inst}$	[Nm]	10	20	40	60	120	150	200	300

**fischer anchor rod**

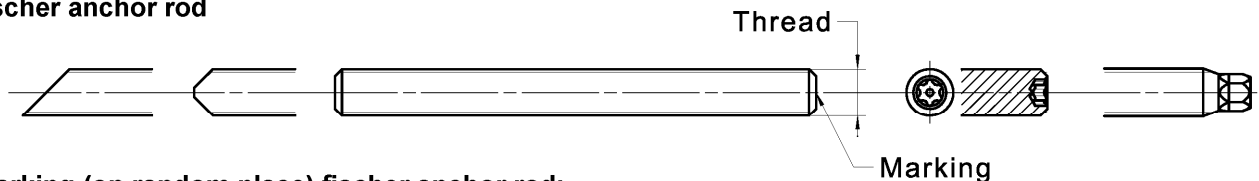


**Marking (on random place) fischer anchor rod:**

Steel zinc plated PC <sup>1)</sup> 8.8	• or +	Steel hot-dip PC <sup>1)</sup> 8.8	•
High corrosion resistant steel HCR PC <sup>1)</sup> 50	•	High corrosion resistant steel HCR PC <sup>1)</sup> 70	-
High corrosion resistant steel HCR PC <sup>1)</sup> 80	(	Stainless steel R property class 50	~
Stainless steel R property class 80	*		

Alternatively: Colour coding according to DIN 976-1:2016

<sup>1)</sup> PC = property class

**Installation conditions:**

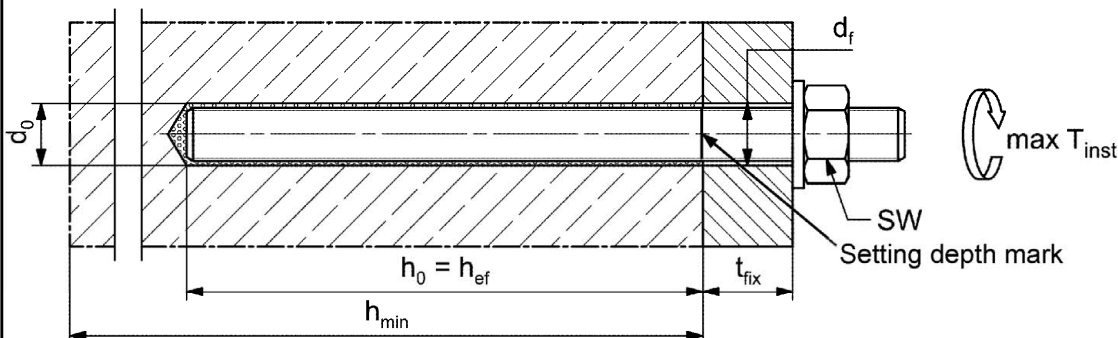

**Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:**

- Materials, dimensions and mechanical properties according to Annex A 7, Table A7.1
- Inspection certificate 3.1 according to EN 10204:2004, the documents have to be stored
- Setting depth is marked

Figures not to scale

fischer Superbond

**Intended use**

Installation parameters for anchor rods in combination with injection mortar system FIS SB


**Annex B 4**



**Table B5.1:** Installation parameters for **fischer anchor rods RG M** in combination with **resin capsule system RSB**

Anchor rod RG M		Thread	M8	M10	M12	M16	M20	M24	M30
Width across flats	SW	[mm]	13	17	19	24	30	36	46
Nominal drill hole diameter	$d_0$		10	12	14	18	25	28	35
Drill hole depth	$h_0$		$h_0 = h_{ef}$						
Effective embedment depth	$h_{ef,1}$		---	75	75	95	---	---	---
	$h_{ef,2}$		80	90	110	125	170	210	280
	$h_{ef,3}$		---	150	150	190	210	---	---
Minimum spacing and minimum edge distance	$s_{min} = C_{min}$		40	45	55	65	85	105	140
Diameter of the clearance hole of the pre-positioned fixture	$d_f$		9	12	14	18	22	26	33
Min. thickness of concrete member	$h_{min}$	$h_{ef} + 30$ ( $\geq 100$ )			$h_{ef} + 2d_0$				
Maximum setting torque	$\max T_{inst}$	[Nm]	10	20	40	60	120	150	300


**fischer anchor rod RG M**

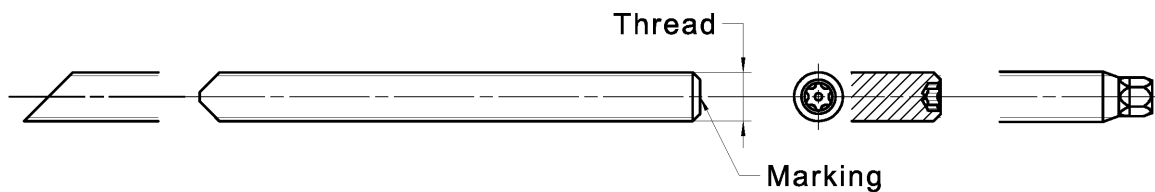

**Marking (on random place) fischer anchor rod RG M:**

Steel zinc plated PC <sup>1)</sup> 8.8	• or +	Steel hot-dip PC <sup>1)</sup> 8.8	•
High corrosion resistant steel HCR PC <sup>1)</sup> 50	•	High corrosion resistant steel HCR PC <sup>1)</sup> 70	-
High corrosion resistant steel HCR PC <sup>1)</sup> 80	(	Stainless steel R property class 50	~
Stainless steel R property class 80	*		
Alternatively: Colour coding according to DIN 976-1:2016		<sup>1)</sup> PC = property class	

**Installation conditions:**

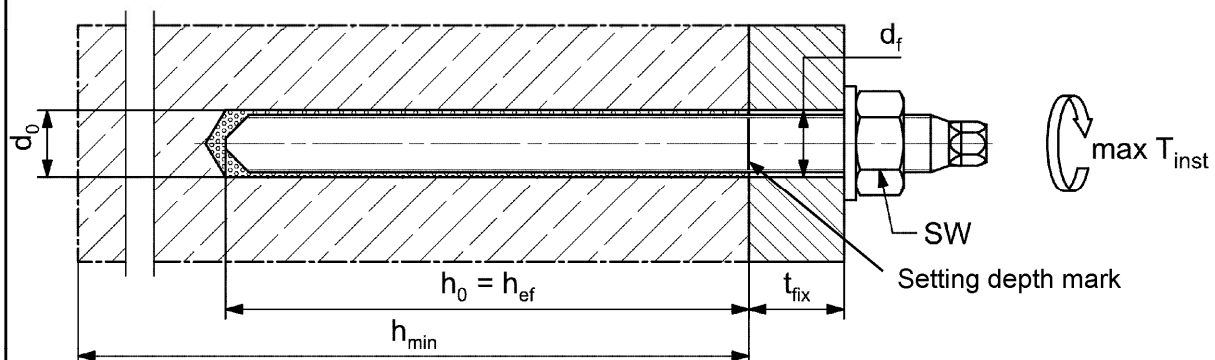

Figures not to scale

fischer Superbond

**Intended use**

Installation parameters for fischer anchor rods RG M in combination with resin capsule system RSB



**Annex B 5**



**Table B6.1:** Installation parameters for **fischer internal threaded anchors RG MI**

Internal threaded anchor RG MI		Thread	M8	M10	M12	M16	M20
Sleeve diameter	$d = d_H$	[mm]	12	16	18	22	28
Nominal drill hole diameter	$d_0$		14	18	20	24	32
Drill hole depth	$h_0$		$h_0 = h_{ef} = L_H$				
Effective embedment depth ( $h_{ef} = L_H$ )	$h_{ef}$		90	90	125	160	200
Minimum spacing and minimum edge distance	$s_{min}$ = $c_{min}$		55	65	75	95	125
Diameter of clearance hole in the fixture	$d_f$		9	12	14	18	22
Minimum thickness of concrete member	$h_{min}$		120	125	165	205	260
Maximum screw-in depth	$l_{E,max}$		18	23	26	35	45
Minimum screw-in depth	$l_{E,min}$		8	10	12	16	20
Maximum installation torque	$\max T_{inst}$	[Nm]	10	20	40	80	120


**fischer internal threaded anchor RG MI**

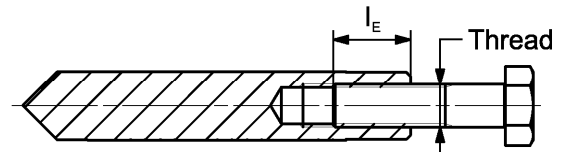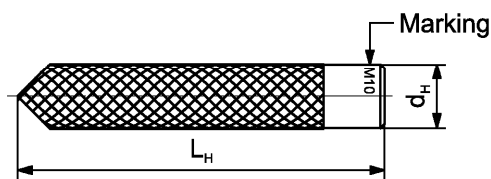

**Marking:** Anchor size e. g.: **M10**  
Stainless steel → additional R; e.g.: **M10 R**  
High corrosion resistant steel R → additional C; e.g.: **M10 HCR**

Retaining bolt or threaded rods (including nut and washer) must comply with the appropriate material and strength class of Annex A 7, Table A7.1

**Installation conditions:**

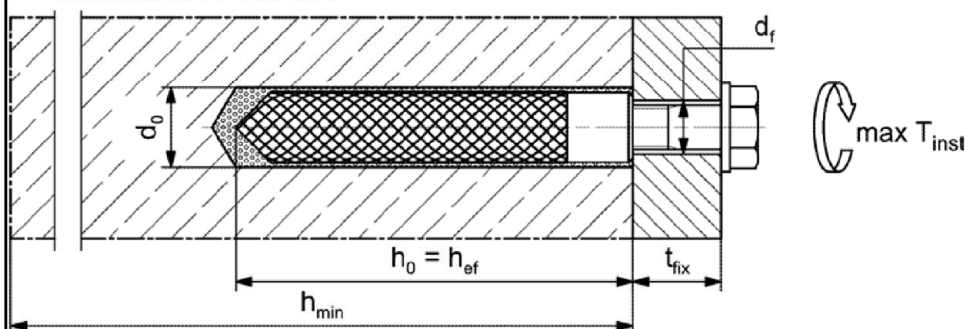

Figures not to scale

fischer Superbond

**Intended use**

Installation parameters for fischer internal threaded anchors RG MI

**Annex B 6**

**Table B7.1:** Installation parameters for reinforcing bars

Nominal diameter of the bar		$\phi$	8 <sup>1)</sup>		10 <sup>1)</sup>		12 <sup>1)</sup>		14	16	20	25	28	32
Nominal drill hole diameter	d <sub>0</sub>	[mm]	10	12	12	14	14	16	18	20	25	30	35	40
Drill hole depth	h <sub>0</sub>		h <sub>0</sub> = h <sub>ef</sub>											
Effective embedment depth	h <sub>ef,min</sub>		60	60		70		75		80	90	100	112	128
	h <sub>ef,max</sub>		160	200		240		280		320	400	500	560	640
Minimum spacing and minimum edge distance	$\begin{matrix} s_{min} \\ = \\ c_{min} \end{matrix}$		40	45		55		60		65	85	110	130	160
Minimum thickness of concrete member	h <sub>min</sub>		h <sub>ef</sub> + 30 (≥ 100)				h <sub>ef</sub> + 2d <sub>0</sub>							


<sup>1)</sup> Both drill hole diameters can be used

#### Reinforcing bar



- The minimum value of related rib area  $f_{R,min}$  must fulfil the requirements of EN 1992-1-1:2004+AC:2010
- The rib height must be within the range:  $0,05 \cdot \phi \leq h_{rib} \leq 0,07 \cdot \phi$   
( $\phi$  = Nominal diameter of the bar,  $h_{rib}$  = rib height)

#### Installation conditions:

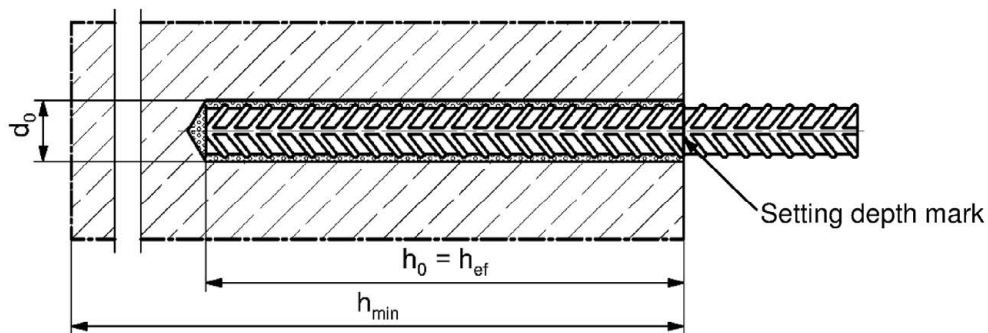

Figures not to scale

fischer Superbond

#### Intended use

Installation parameters reinforcing bars


**Annex B 7**

**Table B8.1:** Installation parameters for **fischer rebar anchor FRA**

Rebar anchor FRA		Thread	M12 <sup>1)</sup>	M16	M20	M24
Nominal diameter of the bar	$\phi$	[mm]	12	16	20	25
Width across flats	SW		19	24	30	36
Nominal drill hole diameter	$d_0$		14   16	20	25	30
Drill hole depth	$h_0$		$h_{ef} + l_e$			
Effective embedment depth	$h_{ef,min}$		70	80	90	96
	$h_{ef,max}$		140	220	300	380
Distance concrete surface to welded joint	$l_e$		100			
Minimum spacing and minimum edge distance	$s_{min} = c_{min}$		55	65	85	105
Diameter of clearance hole in the fixture	pre-positioned anchorage $\leq d_f$		14	18	22	26
	push through anchorage $\leq d_f$		18	22	26	32
Minimum thickness of concrete member	$h_{min}$		$h_0 + 30$	$h_0 + 2d_0$		
Maximum installation torque	$\max T_{inst}$	[Nm]	40	60	120	150

<sup>1)</sup> Both drill hole diameters can be used

**fischer rebar anchor FRA**

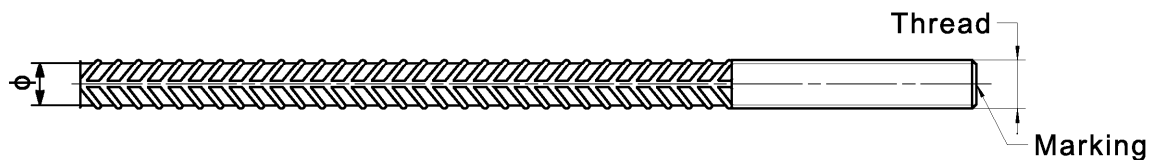


Marking frontal e. g:

FRA (for stainless steel);

FRA HCR (for high corrosion resistant steel)

**Installation conditions:**

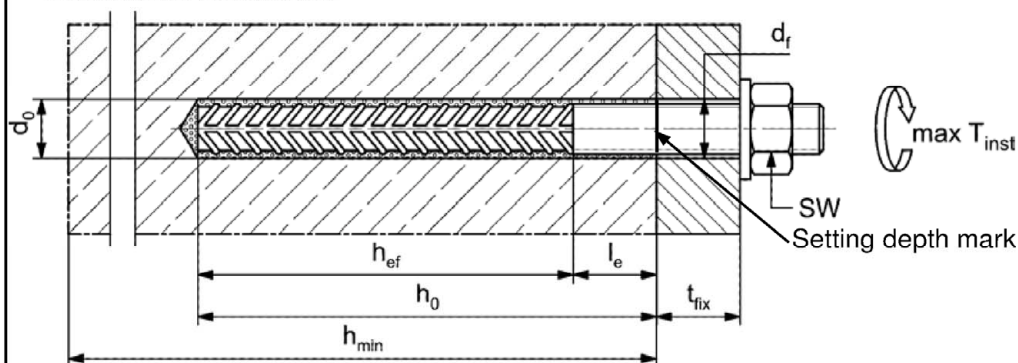

Figures not to scale

fischer Superbond

**Intended use**  
Installation parameters rebar anchor FRA

**Annex B 8**

**Table B9.1:** Dimension of resin capsule RSB

Resin capsule RSB		RSB 8	RSB 10 mini	RSB 10	RSB 12 mini	RSB 12	RSB 16 mini	RSB 16	RSB 16 E	RSB 20	RSB 20 E / 24	RSB 30
Capsule diameter	$d_P$	9,0	10,5		12,5		16,5			23,0		27,5
Capsule length	$L_P$	85	72	90	72	97	72	95	123	160	190	260



**Table B9.2:** Assignment of resin capsule RSB to fischer anchor rod RG M

Anchor rod RG M		M8	M10	M12	M16	M20	M24	M30
Effective embedment depth	$h_{ef, 1}$ [mm]	---	75	75	95	---	---	---
Related capsule RSB	[-]	---	10 mini	12 mini	16 mini	---	---	---
Effective embedment depth	$h_{ef, 2}$ [mm]	80	90	110	125	170	210	280
Related capsule RSB	[-]	8	10	12	16	20	20 E / 24	30
Effective embedment depth	$h_{ef, 3}$ [mm]	---	150	150	190	210	---	---
Related capsule RSB	[-]	---	2 x 10 mini	2 x 12 mini	2 x 16 mini	20 E / 24	---	---

**Table B9.3:** Assignment of resin capsule RSB to fischer internal threaded anchor RG MI

Internal threaded anchor RG MI		M8	M10	M12	M16	M20
Effective embedment depth	$h_{ef}$ [mm]	90	90	125	160	200
Related capsule RSB	[-]	10	12	16	16 E	20 E / 24

Figures not to scale

fischer Superbond

**Intended use**

Dimensions of the capsules; Assignment of the capsule to the fischer anchor rod RG M and fischer internal threaded anchor RG MI

**Annex B 9**

**Table B10.1:** Parameters of the cleaning brush BS / BSB (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

Nominal drill hole diameter	$d_0$		10	12	14	16	18	20	24	25	28	30	32	35	40
Steel brush diameter BS	$d_b$	[mm]	11	14	16	20		25	26	27	30	40		-	
Steel brush diameter BSB	$d_b$		-	-	-	-		-	-	-	-	-		42	



**Table B10.2:** Maximum **processing time** of the mortar and minimum **curing time**  
(During the curing time of the mortar the concrete temperature may not fall below the listed minimum temperature. Minimal cartridge temperature +5 °C; minimal resin capsule temperature -15 °C)

Temperature at anchoring base [°C]	Maximum processing time $t_{work}$		Minimum curing time $t_{cure}$		
	FIS SB	FIS SB High Speed	FIS SB	FIS SB High Speed	RSB
-30 to -20	---	---	---	---	120 h
> -20 to -15	---	60 min	---	24 h	48 h
> -15 to -10	60 min	30 min	36 h	8 h	30 h
> -10 to -5	30 min	15 min	24 h	3 h	16 h
> -5 to 0	20 min	10 min	8 h	2 h	10 h
> 0 to 5	13 min	5 min	4 h	1 h	45 min
> 5 to 10	9 min	3 min	2 h	45 min	30 min
> 10 to 20	5 min	2 min	1 h	30 min	20 min
> 20 to 30	4 min	1 min	45 min	15 min	5 min
> 30 to 40	2 min	---	30 min	---	3 min

Figures not to scale

fischer Superbond







**Intended use**

Cleaning brush (steel brush)  
Processing time and curing time

**Annex B 10**


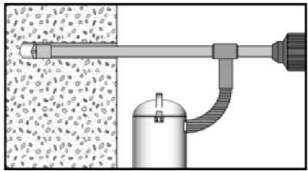
## Installation instructions part 1; Injection mortar system FIS SB

### Drilling and cleaning the hole (hammer drilling with standard drill bit)

1		Drill the hole. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B4.1, B6.1, B7.1, B8.1</b>	
2		Clean the drill hole: Blow out the drill hole twice, with oil free compressed air ( $p \geq 6$ bar) In uncracked concrete the use of the manual blow-out pump ABG is possible (Installation parameters: $d_0 < 18$ mm and $h_{ef} < 10d$ )	
3		Brush the drill hole twice. For drill hole diameter $\geq 30$ mm use a power drill. For deep holes use an extension. Corresponding brushes see <b>table B10.1</b>	
4		Clean the drill hole: Blow out the drill hole twice, with oil free compressed air ( $p \geq 6$ bar) In uncracked concrete the use of the manual blow-out pump ABG is possible (Installation parameters: $d_0 < 18$ mm and $h_{ef} < 10d$ )	

Go to step 5 (Annex B 12)

### Drilling and cleaning the hole (hammer drilling with hollow drill bit)

1		Check a suitable hollow drill (see <b>table B1.1</b> ) for correct operation of the dust extraction	
2		Use a suitable dust extraction system, e. g. fischer FVC 35 M or a comparable dust extraction system with equivalent performance data.  Drill the hole with hollow drill bit. The dust extraction system has to extract the drill dust nonstop during the drilling process and must be adjusted to maximum power. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B4.1, B6.1, B7.1, B8.1</b>	

Go to step 5 (Annex B 12)

fischer Superbond

#### Intended use




Installation instructions part 1; injection mortar system FIS SB

**Annex B 11**






## Installation instructions part 2; injection mortar system FIS SB

### Preparing the cartridge

5		Remove the sealing cap Screw on the static mixer (the spiral in the static mixer must be clearly visible)
6		Place the cartridge into the dispenser
7		Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey

### Injection of the mortar

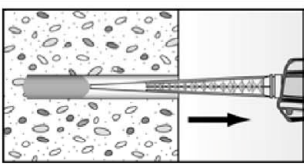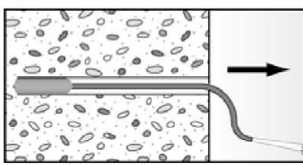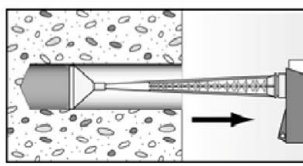8		Fill approximately 2/3 of the drill hole with mortar. Always begin from the bottom of the hole and avoid bubbles
		For drill hole depth $\geq 150$ mm use an extension tube
		For overhead installation, deep holes ( $h_0 > 250$ mm) or drill hole diameter ( $d_0 \geq 40$ mm) use an injection-adapter

Go to step 9 (Annex B 13)

fischer Superbond







#### Intended use

Installation instructions part 2; injection mortar system FIS SB




**Annex B 12**

### Installation instructions part 3; injection mortar system FIS SB
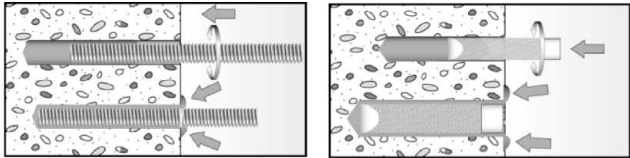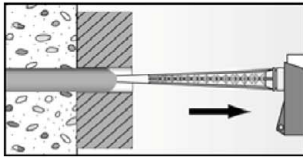
#### Installation of anchor rods or fischer internal threaded anchors RG MI

9		<p>Only use clean and oil-free metal part. Mark the setting depth of the metal part. Push the anchor rod or fischer internal threaded RG MI anchor down to the bottom of the hole, turning it slightly while doing so. After inserting the metal part, excess mortar must be emerged around the anchor element. If not, pull out the metal part immediately and reinject mortar.</p>
	 <p>For overhead installations support the metal part with wedges. (e. g. fischer centering wedges)</p>	 <p>For push through installation fill the annular gap with mortar</p>
11	 <p>Wait for the specified curing time <math>t_{cure}</math> see <b>table B10.2</b></p>	<p>12</p>  <p>Mounting the fixture <math>\max T_{inst}</math> see <b>tables B4.1 and B6.1</b></p>
Option		<p>After the minimum curing time is reached, the gap between metal part and fixture (annular clearance) may be filled with mortar via the fischer filling disc. Compressive strength <math>\geq 50 \text{ N/mm}^2</math> (e.g. fischer injection mortars FIS HB, FIS SB, FIS V, FIS EM Plus) ATTENTION: Using fischer filling disc reduces <math>t_{fix}</math> (usable length of the anchor)</p>

#### Installation reinforcing bars and fischer rebar anchor FRA

10		<p>Only use clean and oil-free reinforcing bars or fischer FRA. Mark the setting depth. Turn while using force to push the reinforcement bar or the fischer FRA into the filled hole up to the setting depth mark</p> <p>When the setting depth mark is reached, excess mortar must be emerged from the mouth of the drill hole. If not, pull out the anchor element immediately and reinject mortar.</p>
11	 <p>Wait for the specified curing time <math>t_{cure}</math> see <b>table B10.2</b></p>	<p>12</p>  <p>Mounting the fixture <math>\max T_{inst}</math> see <b>table B8.1</b></p>

fischer Superbond

#### Intended use




Installation instructions part 3; injection mortar system FIS SB

**Annex B 13**









## Installation instructions part 4; resin capsule RSB

### Drilling and cleaning the hole (hammer drilling with standard drill bit)

1		Drill the hole. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B5.1</b> and <b>B6.1</b>	
2		Clean the drill hole: Blow out the drill hole four times, with oil free compressed air ( $p \geq 6$ bar) In uncracked concrete the use of the manual blow-out pump ABG is possible (Installation parameters: $d_0 < 18$ mm and $h_{ef} < 10d$ )	

Go to step 6 (Annex B 15)

### Drilling and cleaning the hole (wet drilling with diamond drill bit)

1		Drill the hole. Drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B5.1</b> and <b>B6.1</b>	
2		Flush the drill hole with clean water until it flows clear	
3		Blow out the drill hole twice, using oil-free compressed air ( $p > 6$ bar)	
4		Brush the drill hole twice using a power drill. Corresponding brushes see <b>table B10.1</b>	
5		Blow out the drill hole twice, using oil-free compressed air ( $p > 6$ bar)	

Go to step 6 (Annex B 15)

fischer Superbond


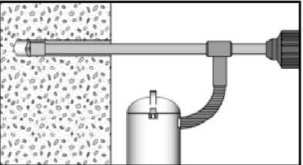
#### Intended use

Installation instructions part 4; resin capsule RSB

**Annex B 14**







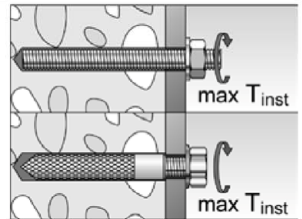
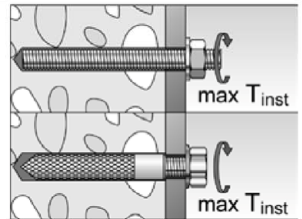
## Installation instructions part 5; resin capsule RSB

### Drilling and cleaning the hole (hammer drilling with hollow drill bit)

1		Check a suitable hollow drill (see <b>table B2.1</b> ) for correct operation of the dust extraction
2		<p>Use a suitable dust extraction system, e. g. fischer FVC 35 M or a comparable dust extraction system with equivalent performance data.</p> <p>Drill the hole with hollow drill bit. The dust extraction system has to extract the drill dust nonstop during the drilling process and must be adjusted to maximum power. Nominal drill hole diameter <math>d_0</math> and drill hole depth <math>h_0</math> see <b>tables B5.1</b> and <b>B6.1</b></p>

Go to step 6 (Annex B 15)

### Installation fischer anchor rod RG M or fischer internal threaded anchor RG MI

6		<p>Insert the resin capsule into the drill hole by hand. Suitable resin capsule RSB or RSB mini see <b>table B9.2</b>.</p>	 <p>Depending on the metal part being installed, use a suitable setting tool</p>			
7			<p>Only use clean and grease-free metal parts. Using a suitable adapter, drive the fischer anchor rod RG M or the fischer internal threaded anchor RG MI into the capsule using a hammer drill set on rotary hammer action. Stop when the metal parts reaches the bottom of the hole and is set to the correct embedment depth</p>			
8		<p>When reaching the correct embedment depth, excess mortar must emerge from the mouth of the drill hole. If not, the metal parts must be pulled out directly and a second resin capsule must be pushed into the drill hole. Setting process must be repeated (Step 7)</p>				
9		Wait for the specified curing time, $t_{cure}$ see <b>table B10.2</b>	<td>10</td> <td></td> <td> <p>Mounting the fixture <math>max T_{inst}</math> see <b>tables B5.1</b> and <b>B6.1</b></p> </td>	10		<p>Mounting the fixture <math>max T_{inst}</math> see <b>tables B5.1</b> and <b>B6.1</b></p>

fischer Superbond

#### Intended use

Installation instructions part 5; resin capsule RSB

**Annex B 15**

**Table C1.1:** Characteristic values for **steel failure** under tension / shear load of **fischer anchor rods** and **standard threaded rods**

Anchor rod / standard threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Bearing capacity under tension load, steel failure <sup>3)</sup>												
Characteristic resistance N <sub>Rk,s</sub>	Steel zinc plated	Property class	4.8	[kN]	15(13)	23(21)	33	63	98	141	184	224
			5.8		19(17)	29(27)	43	79	123	177	230	281
			8.8		29(27)	47(43)	68	126	196	282	368	449
	Stainless steel R and high corrosion resistant steel HCR		50		19	29	43	79	123	177	230	281
			70		26	41	59	110	172	247	322	393
			80		30	47	68	126	196	282	368	449
Partial factors <sup>1)</sup>												
Partial factor γ <sub>Ms,N</sub>	Steel zinc plated	Property class	4.8	[-]	1,50							
			5.8		1,50							
			8.8		1,50							
	Stainless steel R and high corrosion resistant steel HCR		50		2,86							
			70		1,50 <sup>2)</sup> / 1,87							
			80		1,60							
Bearing capacity under shear load, steel failure <sup>3)</sup>												
without lever arm												
Characteristic resistance V <sup>0</sup> <sub>Rk,s</sub>	Steel zinc plated	Property class	4.8	[kN]	9(8)	14(13)	20	38	59	85	110	135
			5.8		11(10)	17(16)	25	47	74	106	138	168
			8.8		15(13)	23(21)	34	63	98	141	184	225
	Stainless steel R and high corrosion resistant steel HCR		50		9	15	21	39	61	89	115	141
			70		13	20	30	55	86	124	161	197
			80		15	23	34	63	98	141	184	225
Ductility factor			k <sub>7</sub>	[-]	1,0							
with lever arm												
Characteristic resistance M <sup>0</sup> <sub>Rk,s</sub>	Steel zinc plated	Property class	4.8	[Nm]	15(13)	30(27)	52	133	259	448	665	899
			5.8		19(16)	37(33)	65	166	324	560	833	1123
			8.8		30(26)	60(53)	105	266	519	896	1333	1797
	Stainless steel R and high corrosion resistant steel HCR		50		19	37	65	166	324	560	833	1123
			70		26	52	92	232	454	784	1167	1573
			80		30	60	105	266	519	896	1333	1797
Partial factors <sup>1)</sup>												
Partial factor γ <sub>Ms,V</sub>	Steel zinc plated	Property class	4.8	[-]	1.25							
			5.8		1.25							
			8.8		1.25							
	Stainless steel R and high corrosion resistant steel HCR		50		2.38							
			70		1.25 <sup>2)</sup> / 1.56							
			80		1.33							
<div><div><sup>1)</sup> In absence of other national regulations</div><div><sup>2)</sup> Only admissible for high corrosion resistant steel C, with f<sub>yk</sub> / f<sub>uk</sub> ≥ 0.8 and A<sub>5</sub> &gt; 12 % (e.g. fischer anchor rods)</div><div><sup>3)</sup> Values in brackets are valid for undersized threaded rods with smaller stress area A<sub>s</sub> for hotdip galvanized standard threaded rods according to EN ISO 10684:2004+AC:2009</div></div>												
fischer Superbond									Annex C 1			
<b>Performances</b> Characteristic values for steel failure capacity of fischer anchor rods and standard threaded rods												

**Table C2.1:** Characteristic values for **steel failure** under tension / shear load of **fischer internal threaded anchors RG MI**

fischer internal threaded anchors RG MI				M8	M10	M12	M16	M20	
Bearing capacity under tension load, steel failure									
Charact. resistance with screw	N <sub>Rk,s</sub>	Property class	5.8	[kN]	19	29	43	79	123
			8.8		29	47	68	108	179
		Property class 70	R		26	41	59	110	172
			HCR		26	41	59	110	172
Partial factors <sup>1)</sup>									
Partial factors	γ <sub>Ms,N</sub>	Property class	5.8	[-]	1,50				
			8.8		1,50				
		Property class 70	R		1,87				
			HCR		1,87				
Bearing capacity under shear load, steel failure									
Without lever arm									
Charact. resistance with screw	V <sup>0</sup> <sub>Rk,s</sub>	Property class	5.8	[kN]	9,2	14,5	21,1	39,2	62,0
			8.8		14,6	23,2	33,7	54,0	90,0
		Property class 70	R		12,8	20,3	29,5	54,8	86,0
			HCR		12,8	20,3	29,5	54,8	86,0
Ductility factor			k <sub>7</sub>	[-]	1,0				
With lever arm									
Charact. resistance with screw	M <sup>0</sup> <sub>Rk,s</sub>	Property class	5.8	[Nm]	20	39	68	173	337
			8.8		30	60	105	266	519
		Property class 70	R		26	52	92	232	454
			HCR		26	52	92	232	454
Partial factors <sup>1)</sup>									
Partial factors	γ <sub>Ms,V</sub>	Property class	5.8	[-]	1,25				
			8.8		1,25				
		Property class 70	R		1,56				
			HCR		1,56				
<sup>1)</sup> In absence of other national regulations									
fischer Superbond								Annex C 2	
Performances									
Characteristic values for steel failure under tension / shear load fischer internal threaded anchor RG MI									

**Table C3.1:** Characteristic values for **steel failure** under tension / shear load of **reinforcing bars**

Nominal diameter of the bar	$\phi$	8	10	12	14	16	20	25	28	32
Bearing capacity under tension load, steel failure										
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$							
Bearing capacity under shear load, steel failure										
Without lever arm										
Characteristic resistance	$V_{Rk,s}$	[kN]	$0,5 \cdot A_s \cdot f_{uk}^{1)}$							
Ductility factor	$k_7$	[-]	1,0							
With lever arm										
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}^{1)}$							

<sup>1)</sup>  $f_{uk}$  or  $f_{yk}$  respectively must be taken from the specifications of the reinforcing bar

**Table C3.2:** Characteristic values for **steel failure** under tension / shear load of **fischer rebar anchors FRA**

fischer rebar anchor FRA			M12	M16	M20	M24
Bearing capacity under tension load, steel failure						
Characteristic resistance	N <sub>Rk,s</sub>	[kN]	63	111	173	270
Partial factor <sup>1)</sup>						
Partial factor	γ <sub>Ms,N</sub>	[-]	1,4			
Bearing capacity under shear load, steel failure						
Without lever arm						
Characteristic resistance	V <sub>Rk,s</sub>	[kN]	30	55	86	124
Ductility factor	k <sub>7</sub>	[-]	1,0			
With lever arm						
Characteristic resistance	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	92	233	454	785
Partial factor <sup>1)</sup>						
Partial factor	γ <sub>Ms,V</sub>	[-]	1,56			

<sup>1)</sup> In absence of other national regulations

fischer Superbond

**Performances**

Characteristic values for steel failure under tension / shear load of reinforcing bars and fischer rebar anchors FRA

**Annex C 3**

**Table C4.1:** Characteristic values for **concrete failure** under tension / shear load

Size			All sizes										
Tension load													
Installation factor		$\gamma_{\text{inst}}$	[-]	See annex C 5 to C 10 and C 15 to C 16									
Factors for the compressive strength of concrete > C20/25													
Increasing factor for $\tau_{\text{Rk}}$	C25/30	$\Psi_c$	[-]	1,02									
	C30/37			1,04									
	C35/45			1,07									
	C40/50			1,08									
	C45/55			1,09									
	C50/60			1,10									
Splitting failure													
Edge distance	$h / h_{\text{ef}} \geq 2,0$	$C_{\text{cr,sp}}$	[mm]	1,0 $h_{\text{ef}}$									
	$2,0 > h / h_{\text{ef}} > 1,3$			4,6 $h_{\text{ef}} - 1,8 h$									
	$h / h_{\text{ef}} \leq 1,3$			2,26 $h_{\text{ef}}$									
Spacing		$S_{\text{cr,sp}}$		2 $C_{\text{cr,sp}}$									
Concrete cone failure													
Uncracked concrete		$k_{\text{ucr,N}}$	[-]	11,0									
Cracked concrete		$k_{\text{cr,N}}$		7,7									
Edge distance		$C_{\text{cr,N}}$	[mm]	1,5 $h_{\text{ef}}$									
Spacing		$S_{\text{cr,N}}$		2 $C_{\text{cr,N}}$									
Factors for sustained tension load													
Temperature range			[-]	24 °C / 40 °C	50 °C / 80 °C		72 °C / 120 °C		90 °C / 150 °C				
Factor			$\Psi_{\text{sus}}^0$	[-]	0,84	0,86		0,84		0,91			
Shear load													
Installation factor		$\gamma_{\text{inst}}$	[-]	1,0									
Concrete pry-out failure													
Factor for pry-out failure		$k_8$	[-]	2,0									
Concrete edge failure													
Effective length of fastener in shear loading		$l_f$	[mm]	for $d_{\text{nom}} \leq 24 \text{ mm}$ : min ( $h_{\text{ef}}$ ; 12 $d_{\text{nom}}$ ) for $d_{\text{nom}} > 24 \text{ mm}$ : min ( $h_{\text{ef}}$ ; 8 $d_{\text{nom}}$ ; 300 mm)									
Calculation diameters													
Size				M8	M10	M12	M16	M20	M24	M27	M30		
fisher anchor rods and standard threaded rods		$d_{\text{nom}}$	[mm]	8	10	12	16	20	24	27	30		
fisher internal threaded anchors RG MI		$d_{\text{nom}}$		12	16	18	22	28	- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>		
fisher rebar anchor FRA		$d_{\text{nom}}$		- <sup>1)</sup>	- <sup>1)</sup>	12	16	20	25	- <sup>1)</sup>	- <sup>1)</sup>		
Size (nominal diameter of the bar)			$\phi$	8	10	12	14	16	20	25	28	32	
Reinforcing bar			$d_{\text{nom}}$	[mm]	8	10	12	14	16	20	25	28	32
<sup>1)</sup> Anchor type not part of the ETA													
fisher Superbond										Annex C 4			
Performances Characteristic values for concrete failure under tension / shear load													



**Table C5.1:** Characteristic values for combined pull-out and concrete failure for **fischer anchor rods** and **standard threaded rods** in hammer drilled holes in combination with **injection mortar FIS SB; uncracked or cracked concrete**

Anchor rod / standard threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Combined pullout and concrete cone failure											
Thread diameter		d	[mm]	8	10	12	16	20	24	27	30
Uncracked concrete											
Characteristic bond resistance in uncracked concrete C20/25											
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)											
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm²]	12	13	13	13	13	12	10	10
	II: 50 °C / 80 °C			12	12	12	13	13	12	10	10
	III: 72 °C / 120 °C			10	11	11	11	11	11	9,0	9,0
	IV: 90 °C / 150 °C			10	10	10	11	10	10	8,0	8,0
Installation factors											
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0							
Cracked concrete											
Characteristic bond resistance in cracked concrete C20/25											
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)											
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm²]	6,5	7,0	7,5	7,5	7,5	7,5	7,5	7,5
	II: 50 °C / 80 °C			6,0	6,5	7,5	7,5	7,5	7,5	7,0	7,0
	III: 72 °C / 120 °C			5,5	6,0	6,5	6,5	6,5	6,5	6,0	6,0
	IV: 90 °C / 150 °C			5,0	5,5	6,0	6,0	6,0	6,0	5,5	5,5
Installation factors											
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0							
fischer Superbond									Annex C 5		
<b>Performances</b> Characteristic values for combined pull-out and concrete failure for fischer anchor rod and standard threaded rods with injection mortar FIS SB											

**Table C6.1:** Characteristic values for **combined pull-out** and concrete failure for **fischer anchor rods RG M** in hammer or diamond drilled holes in combination with **resin capsule RSB; uncracked or cracked concrete**

Anchor rod RG M			M8	M10	M12	M16	M20	M24	M30	
Combined pullout and concrete cone failure										
Thread diameter		d	[mm]	8	10	12	16	20	24	30
Uncracked concrete										
Characteristic bond resistance in uncracked concrete C20/25										
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete as well as water filled hole)										
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	12	13	13	13	13	12	10
	II: 50 °C / 80 °C			12	12	12	13	13	12	10
	III: 72 °C / 120 °C			10	11	11	11	11	11	9,0
	IV: 90 °C / 150 °C			10	10	10	11	10	10	8,0
Diamond-drilling (dry or wet concrete as well as water filled hole)										
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	13	13	14	14	14	13	11
	II: 50 °C / 80 °C			12	13	13	14	13	13	10
	III: 72 °C / 120 °C			11	12	12	12	12	11	9,5
	IV: 90 °C / 150 °C			10	11	11	11	11	10	8,5
Installation factors										
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0						
Water filled hole				1,2		1,0				
Cracked concrete										
Characteristic bond resistance in cracked concrete C20/25										
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete as well as water filled hole)										
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	6,5	7,0	7,5	7,5	7,5	7,5	7,5
	II: 50 °C / 80 °C			6,0	6,5	7,5	7,5	7,5	7,5	7,0
	III: 72 °C / 120 °C			5,5	6,0	6,5	6,5	6,5	6,5	6,0
	IV: 90 °C / 150 °C			5,0	5,5	6,0	6,0	6,0	6,0	5,5
Diamond-drilling (dry or wet concrete as well as water filled hole)										
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>	7,5	7,5	7,5	7,5
	II: 50 °C / 80 °C			- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>	7,5	7,5	7,5	7,0
	III: 72 °C / 120 °C			- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>	6,5	6,5	6,5	6,5
	IV: 90 °C / 150 °C			- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>	6,0	6,0	6,0	6,0
Installation factors										
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0						
Water filled hole				1,2		1,0				
1) No performance assessed										
fischer Superbond								Annex C 6		
Performances										
Characteristic values for combined pull-out and concrete failure for fischer anchor rod RG M with resin capsule RSB										



**Table C7.1:** Characteristic values for **combined pull-out** and concrete failure for **fischer internal threaded anchors RG MI** in hammer drilled holes in combination with **injection mortar FIS SB; uncracked or cracked concrete**

Internal threaded anchor RG MI			M8	M10	M12	M16	M20	
Combined pullout and concrete cone failure								
Sleeve diameter		d	[mm]	12	16	18	22	28
Uncracked concrete								
Characteristic bond resistance in uncracked concrete C20/25								
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)								
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm²]	12	12	11	11	9,5
	II: 50 °C / 80 °C			12	11	11	10	9,0
	III: 72 °C / 120 °C			11	10	10	9,0	8,0
	IV: 90 °C / 150 °C			10	9,5	9,0	8,5	7,5
Installation factors								
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0				
Cracked concrete								
Characteristic bond resistance in cracked concrete C20/25								
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)								
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm²]	5,0				
	II: 50 °C / 80 °C			5,0				
	III: 72 °C / 120 °C			4,5				
	IV: 90 °C / 150 °C			4,0				
Installation factors								
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0				

**Table C8.1:** Characteristic values for **combined pull-out** and concrete failure for **fischer internal threaded anchors RG MI** in hammer or diamond drilled holes in combination with **resin capsule RSB**; **uncracked or cracked concrete**

Internal threaded anchor RG MI			M8	M10	M12	M16	M20	
Combined pullout and concrete cone failure								
Sleeve diameter		d	[mm]	12	16	18	22	28
Uncracked concrete								
Characteristic bond resistance in uncracked concrete C20/25								
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete as well as water filled hole)								
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	12	12	11	11	9,5
	II: 50 °C / 80 °C			12	11	11	10	9,0
	III: 72 °C / 120 °C			11	10	10	9,0	8,0
	IV: 90 °C / 150 °C			10	9,5	9,0	8,5	7,5
Diamond-drilling (dry or wet concrete as well as water filled hole)								
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	13	12	12	11	10
	II: 50 °C / 80 °C			13	12	12	11	9,5
	III: 72 °C / 120 °C			11	11	10	9,5	8,5
	IV: 90 °C / 150 °C			10	10	9,5	9,0	8,0
Installation factors								
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0				
Water filled hole				1,2	1,0			
Cracked concrete								
Characteristic bond resistance in cracked concrete C20/25								
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete as well as water filled hole)								
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	5,0				
	II: 50 °C / 80 °C			5,0				
	III: 72 °C / 120 °C			4,5				
	IV: 90 °C / 150 °C			4,0				
Diamond-drilling (dry or wet concrete as well as water filled hole)								
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	1)	5,0			
	II: 50 °C / 80 °C			1)	5,0			
	III: 72 °C / 120 °C			1)	4,5			
	IV: 90 °C / 150 °C			1)	4,0			
Installation factors								
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0				
Water filled hole				1,2	1,0			
1) No performance assessed								
fischer Superbond							Annex C 8	
Performances Characteristic values for combined pull-out and concrete failure for fischer internal threaded anchor RG MI with resin capsule RSB								

**Table C9.1:** Characteristic values for **combined pull-out** and concrete failure for **reinforcing bars** in hammer drilled holes in combination with **injection mortar FIS SB; uncracked or cracked concrete**

Nominal diameter of the bar $\phi$			8	10	12	14	16	20	25	28	32	
Combined pullout and concrete cone failure												
Bar diameter		d	[mm]	8	10	12	14	16	20	25	28	32
Uncracked concrete												
Characteristic bond resistance in uncracked concrete C20/25												
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)												
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	8,0	8,5	9,0	9,5	9,5	10	9,5	9,0	7,5
	II: 50 °C / 80 °C			8,0	8,5	9,0	9,0	9,5	9,5	9,0	8,5	7,5
	III: 72 °C / 120 °C			7,0	7,5	8,0	8,0	8,5	8,5	8,0	7,5	6,5
	IV: 90 °C / 150 °C			6,5	7,0	7,0	7,5	7,5	8,0	7,5	7,0	6,0
Installation factors												
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0								
Cracked concrete												
Characteristic bond resistance in cracked concrete C20/25												
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)												
Tem- perature range	I: 24 °C / 40 °C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	4,5	6,0	6,0	6,0	7,0	6,0	6,0	6,0	6,0
	II: 50 °C / 80 °C			4,5	5,5	5,5	5,5	6,5	6,0	6,0	6,0	6,0
	III: 72 °C / 120 °C			4,0	5,0	5,0	5,0	6,0	5,5	5,5	5,5	5,5
	IV: 90 °C / 150 °C			3,5	4,5	4,5	4,5	5,5	5,0	5,0	5,0	5,0
Installation factors												
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0								



**Table C11.1: Displacements for anchor rods**

Anchor rod		M8	M10	M12	M16	M20	M24	M27	M30
Displacement-Factors for tension load <sup>1)</sup>									
Uncracked or cracked concrete; Temperature range I, II, III, IV									
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	0,07	0,08	0,09	0,10	0,11	0,12	0,12	0,13
δ <sub>N∞</sub> -Factor		0,13	0,14	0,15	0,17	0,17	0,18	0,19	0,19
Displacement-Factors for shear load <sup>2)</sup>									
Uncracked or cracked concrete; Temperature range I, II, III, IV									
δ <sub>V0</sub> -Factor	[mm/kN]	0,18	0,15	0,12	0,09	0,07	0,06	0,05	0,05
δ <sub>V∞</sub> -Factor		0,27	0,22	0,18	0,14	0,11	0,09	0,08	0,07

<sup>1)</sup> Calculation of effective displacement:

$$\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$$

( $\tau_{Ed}$ : Design value of the applied tensile stress)

<sup>2)</sup> Calculation of effective displacement:

$$\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$$

( $V_{Ed}$ : Design value of the applied shear force)

**Table C11.2: Displacements for fischer internal threaded anchors RG MI**

Internal threaded anchor RG MI		M8	M10	M12	M16	M20
Displacement-Factors for tension load <sup>1)</sup>						
Uncracked or cracked concrete; Temperature range I, II, III, IV						
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,10	0,10	0,11	0,19
δ <sub>N∞</sub> -Factor		0,13	0,15	0,15	0,17	0,19
Displacement-Factors for shear load <sup>2)</sup>						
Uncracked or cracked concrete; Temperature range I, II, III, IV						
δ <sub>V0</sub> -Factor	[mm/kN]	0,12	0,09	0,08	0,07	0,05
δ <sub>V∞</sub> -Factor		0,18	0,14	0,12	0,10	0,08

<sup>1)</sup> Calculation of effective displacement:

$$\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$$

( $\tau_{Ed}$ : Design value of the applied tensile stress)

<sup>2)</sup> Calculation of effective displacement:

$$\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$$

( $V_{Ed}$ : Design value of the applied shear force)

fischer Superbond

**Performances**

Displacements for anchor rods and fischer internal threaded anchors RG MI

**Annex C 11**

**Table C12.1: Displacements for reinforcing bars**

Nominal diameter of the bar $\phi$		8	10	12	14	16	20	25	28	32
Displacement-Factors for tension load <sup>1)</sup>										
Uncracked or cracked concrete; Temperature range I, II, III, IV										
$\delta_{N0}$ -Factor	[mm/(N/mm <sup>2</sup> )]	0,07	0,08	0,09	0,09	0,10	0,11	0,12	0,13	0,13
$\delta_{N\infty}$ -Factor		0,11	0,13	0,13	0,15	0,16	0,16	0,18	0,20	0,20
Displacement-Factors for shear load <sup>2)</sup>										
Uncracked or cracked concrete; Temperature range I, II, III, IV										
$\delta_{V0}$ -Factor	[mm/kN]	0,18	0,15	0,12	0,10	0,09	0,07	0,06	0,05	0,05
$\delta_{V\infty}$ -Factor		0,27	0,22	0,18	0,16	0,14	0,11	0,09	0,08	0,06
1) Calculation of effective displacement: $\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$ $\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$ ( $\tau_{Ed}$ : Design value of the applied tensile stress)					2) Calculation of effective displacement: $\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$ $\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$ ( $V_{Ed}$ : Design value of the applied shear force)					

**Table C12.2: Displacements for fischer rebar anchors FRA**

fischer rebar anchor FRA		M12	M16	M20	M24
Displacement-Factors for tension load <sup>1)</sup>					
Uncracked or cracked concrete; Temperature range I, II, III, IV					
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,10	0,11	0,12
δ <sub>N∞</sub> -Factor		0,13	0,15	0,16	0,18
Displacement-Factors for shear load <sup>2)</sup>					
Uncracked or cracked concrete; Temperature range I, II, III, IV					
δ <sub>V0</sub> -Factor	[mm/kN]	0,12	0,09	0,07	0,06
δ <sub>V∞</sub> -Factor		0,18	0,14	0,11	0,09
1) Calculation of effective displacement:  δ <sub>N0</sub> = δ <sub>N0</sub> -Factor · τ <sub>Ed</sub>  δ <sub>N∞</sub> = δ <sub>N∞</sub> -Factor · τ <sub>Ed</sub>  (τ <sub>Ed</sub> : Design value of the applied tensile stress)			2) Calculation of effective displacement:  δ <sub>V0</sub> = δ <sub>V0</sub> -Factor · V <sub>Ed</sub>  δ <sub>V∞</sub> = δ <sub>V∞</sub> -Factor · V <sub>Ed</sub>  (V <sub>Ed</sub> : Design value of the applied shear force)		

fischer Superbond

**Performances**

Displacements for reinforcing bars and fischer rebar anchors FRA

**Annex C 12**

**Table C13.1:** Characteristic values for **steel failure** under tension / shear load of **fischer anchor rods** and **standard threaded rods** under seismic action performance category **C1** or **C2**

Anchor rod / standard threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Bearing capacity under tension load, steel failure <sup>1)</sup>												
fischer anchor rods and standard threaded rods, performance category C1 <sup>2)</sup>												
Characteristic resistance $N_{Rk,s,C1}$	Steel zinc plated	Property class	5.8	[kN]	19(17)	29(27)	43	79	123	177	230	281
			8.8		29(27)	47(43)	68	126	196	282	368	449
	Stainless steel R and high corrosion resistant steel HCR		50		19	29	43	79	123	177	230	281
			70		26	41	59	110	172	247	322	393
			80		30	47	68	126	196	282	368	449
fischer anchor rods and standard threaded rods, performance category C2 <sup>2)</sup>												
Characteristic resistance $N_{Rk,s,C2}$	Steel zinc plated	Property class	5.8	[-]	- <sup>4)</sup>	- <sup>4)</sup>	39	72	108	177	- <sup>4)</sup>	- <sup>4)</sup>
			8.8		- <sup>4)</sup>	- <sup>4)</sup>	61	116	173	282	- <sup>4)</sup>	- <sup>4)</sup>
	Stainless steel R and high corrosion resistant steel HCR		50		- <sup>4)</sup>	- <sup>4)</sup>	39	72	108	177	- <sup>4)</sup>	- <sup>4)</sup>
			70		- <sup>4)</sup>	- <sup>4)</sup>	53	101	152	247	- <sup>4)</sup>	- <sup>4)</sup>
			80		- <sup>4)</sup>	- <sup>4)</sup>	61	116	173	282	- <sup>4)</sup>	- <sup>4)</sup>
Bearing capacity under shear load, steel failure without lever arm <sup>1)</sup>												
fischer anchor rods, performance category C1 <sup>2)</sup>												
Characteristic resistance $V_{Rk,s,C1}$	Steel zinc plated	Property class	5.8	[kN]	11(10)	17(16)	25	47	74	106	138	168
			8.8		15(13)	23(21)	34	63	98	141	184	225
	Stainless steel R and high corrosion resistant steel HCR		50		9	15	21	39	61	89	115	141
			70		13	20	30	55	86	124	161	197
			80		15	23	34	63	98	141	184	225
Standard threaded rods, performance category C1 <sup>2)</sup>												
Characteristic resistance $V_{Rk,s,C1}$	Steel zinc plated	Property class	5.8	[kN]	8(7)	12(11)	17	33	52	74	97	118
			8.8		11	16(14)	24	44	69	99	129	158
	Stainless steel R and high corrosion resistant steel HCR		50		6	11	15	27	43	62	81	99
			70		9	14	21	39	60	87	113	138
			80		11	16	24	44	69	99	129	158
fischer anchor rods and standard threaded rods, performance category C2												
Characteristic resistance $V_{Rk,s,C2}$	Steel zinc plated	Property class	5.8	[-]	- <sup>4)</sup>	- <sup>4)</sup>	14	27	43	62	- <sup>4)</sup>	- <sup>4)</sup>
			8.8		- <sup>4)</sup>	- <sup>4)</sup>	22	44	69	99	- <sup>4)</sup>	- <sup>4)</sup>
	Stainless steel R and high corrosion resistant steel HCR		50		- <sup>4)</sup>	- <sup>4)</sup>	14	27	43	62	- <sup>4)</sup>	- <sup>4)</sup>
			70		- <sup>4)</sup>	- <sup>4)</sup>	20	39	60	87	- <sup>4)</sup>	- <sup>4)</sup>
			80		- <sup>4)</sup>	- <sup>4)</sup>	22	44	69	99	- <sup>4)</sup>	- <sup>4)</sup>
Factor for the annular gap		$\alpha_{gap}$	[-]	0,5 (1,0) <sup>3)</sup>								
<div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div><div></div><div></div><div></div></div><div><div><div><div><div></div><div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div></div>												

**Table C14.1:** Characteristic values for **steel failure** under tension / shear load for of **reinforcing bars (B500B)** under seismic action performance category **C1**

Nominal diameter of the bar	$\phi$	8	10	12	14	16	20	25	28	32	
Bearing capacity under tension load, steel failure <sup>1)</sup>											
Reinforcing bar B500B acc. to DIN 488-2:2009-08, performance category C1											
Characteristic resistance	N <sub>Rk,s,C1</sub>	[kN]	28	44	63	85	111	173	270	339	443
Bearing capacity under shear load, steel failure without lever arm <sup>1)</sup>											
Reinforcing bar B500B acc. to DIN 488-2:2009-08, performance category C1											
Characteristic resistance	V <sub>Rk,s,C1</sub>	[kN]	10	15	22	30	39	61	95	119	155

<sup>1)</sup> Partial factors for performance category C1 see table C14.2

**Table C14.2:** Partial factors for **fischer anchor rods, standard threaded rods** and **reinforcing bars (B500B)** under seismic action performance category **C1 or C2**

Anchor rod / standard threaded rod			M8	M10	M12	M16	M20	M24	M27	M30		
Nominal diameter of the bar			φ	8	10	12	14	16	20	25	28	32
Tension load, steel failure <sup>1)</sup>												
Partial factor γ <sub>Ms,N</sub>	Steel zinc plated	Property class	5.8	[-]	1,50							
			8.8		1,50							
	Stainless steel R and high corrosion resistant steel HCR	50	2,86									
		70	1,50 <sup>2)</sup> / 1,87									
		80	1,60									
	Reinforcing bar	B500B			1,40							
Shear load, steel failure <sup>1)</sup>												
Partial factor γ <sub>Ms,V</sub>	Steel zinc plated	Property class	5.8	[-]	1,25							
			8.8		1,25							
	Stainless steel R and high corrosion resistant steel HCR	50	2,38									
		70	1,25 <sup>2)</sup> / 1,56									
		80	1,33									
	Reinforcing bar	B500B			1,50							

<sup>1)</sup> In absence of other national regulations

<sup>2)</sup> Only admissible for high corrosion resistant steel HCR, with  $f_{yk} / f_{uk} \geq 0,8$  and  $A_5 > 12 \%$  (e.g. fischer anchor rods)

fischer Superbond

**Performances**

Characteristic values for steel failure under tension / shear load for reinforcing bars under seismic action (performance category C1); partial factors (performance category C1 / C2)

**Annex C 14**



**Table C15.1:** Characteristic values for **combined pull-out** and concrete failure for **fischer anchor rods** and **standard threaded rods** in hammer drilled holes with **injection mortar FIS SB** or **resin capsule RSB** under seismic action performance category **C1**

Anchor rod / standard threaded rod		M8	M10	M12	M16	M20	M24	M27 <sup>1)</sup>	M30
Characteristic bond resistance, combined pullout and concrete cone failure									
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete; resin capsule RSB additional in water filled holes)									
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,C1}$ [N/mm <sup>2</sup> ]	4,6	5,0	5,6	5,6	5,6	5,6	6,4
	II: 50 °C / 80 °C		4,3	4,6	5,6	5,6	5,6	5,3	6,0
	III: 72 °C / 120 °C		3,9	4,3	4,9	4,9	4,9	4,5	5,1
	IV: 90 °C / 150 °C		3,6	3,9	4,5	4,5	4,5	4,1	4,7

**Installation factors**

Dry or wet concrete	$\gamma_{inst}$	[-]	1,0						
Water filled hole			1,2 <sup>2)</sup>		1,0 <sup>2)</sup>				

<sup>1)</sup> Only use with injection mortar FIS SB

<sup>2)</sup> Only use with resin capsule RSB in water filled hole

**Table C15.2:** Characteristic values for **combined pull-out** and concrete failure for **reinforcing bars** in hammer drilled holes with **injection mortar FIS SB** under seismic action performance category **C1**

Nominal diameter of the bar $\phi$		8	10	12	14	16	20	25	28	32
Characteristic bond resistance, combined pullout and concrete cone failure										
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)										
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,C1}$ [N/mm <sup>2</sup> ]	3,2	4,3	4,5	4,5	5,3	4,5	4,5	5,1
	II: 50 °C / 80 °C		3,2	3,9	4,1	4,1	4,9	4,5	4,5	5,1
	III: 72 °C / 120 °C		2,8	3,6	3,8	3,8	4,5	4,1	4,1	4,7
	IV: 90 °C / 150 °C		2,5	3,2	3,4	3,4	4,1	3,8	3,8	4,3

**Installation factors**

Dry or wet concrete	$\gamma_{inst}$	[-]	1,0							
---------------------	-----------------	-----	-----	--	--	--	--	--	--	--

fischer Superbond

**Performances**

Characteristic values for combined pull-out and concrete failure under seismic action (performance category C1) for fischer anchor rods, standard threaded rods and reinf. bars

**Annex C 15**

**Table C16.1:** Characteristic values for **combined pull-out** and concrete failure for **fischer anchor rods** and **standard threaded rods** in hammer drilled holes with **injection mortar FIS SB** under seismic action performance category **C2**

Anchor rod / standard threaded rod		M12	M16	M20	M24		
Characteristic bond resistance, combined pullout and concrete cone failure							
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)							
Temperature range	I: 24 °C / 40 °C	$\tau_{Rk,C2}$	[N/mm <sup>2</sup> ]	4,5	3,2	2,6	3,0
	II: 50 °C / 80 °C			4,5	3,2	2,6	3,0
	III: 72 °C / 120 °C			3,9	2,7	2,3	2,6
	IV: 90 °C / 150 °C			3,6	2,5	2,1	2,4
Installation factors							
Dry or wet concrete		$\gamma_{inst}$	[-]	1,0			
Displacement-Factors for tension load <sup>1)</sup>							
$\delta_{N,C2}$ (DLS)-Factor		[mm/(N/mm <sup>2</sup> )]	0,09	0,10	0,11	0,12	
$\delta_{N,C2}$ (ULS)-Factor			0,15	0,17	0,17	0,18	
Displacement-Factors for shear load <sup>2)</sup>							
$\delta_{V,C2}$ (DLS)-Factor		[mm/kN]	0,18	0,10	0,07	0,06	
$\delta_{V,C2}$ (ULS)-Factor			0,25	0,14	0,11	0,09	
1) Calculation of effective displacement: $\delta_{N,C2}$ (DLS) = $\delta_{N,C2}$ (DLS)-Factor · $\tau_{Ed}$ $\delta_{N,C2}$ (ULS) = $\delta_{N,C2}$ (ULS)-Factor · $\tau_{Ed}$ ( $\tau_{Ed}$ : Design value of the applied tensile stress)			2) Calculation of effective displacement: $\delta_{V,C2}$ (DLS) = $\delta_{V,C2}$ (DLS)-Factor · $V_{Ed}$ $\delta_{V,C2}$ (ULS) = $\delta_{V,C2}$ (ULS)-Factor · $V_{Ed}$ ( $V_{Ed}$ : Design value of the applied shear force)				
fischer Superbond					Annex C 16		
Performances Characteristic values for combined pull-out and concrete failure under seismic action (performance category C2) for fischer anchor rods and standard threaded rods							