



Approval body for construction products and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and Laender Governments



European Technical Assessment

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of Deutsches Institut für Bautechnik

ETA-20/0238

of 23 July 2020

FlamoX

Cap with intumescent inlay for recessed luminaires in fire resistant suspended ceilings

KAISER GmbH & Co. KG Ramsloh 4 58579 Schalksmühle DEUTSCHLAND

KAISER GmbH & Co. KG Ramsloh 4 58579 Schalksmühle DEUTSCHLAND

11 pages including 7 annexes which form an integral part of this assessment

EAD 351281-00-1104

Deutsches Institut für Bautechnik Kolonnenstraße 30 B | 10829 Berlin | GERMANY | Phone: +49 30 78730-0 | Fax: +49 30 78730-320 | Email: dibt@dibt.de | www.dibt.de



European Technical Assessment ETA-20/0238 English translation prepared by DIBt

Page 2 of 11 | 23 July 2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 11 | 23 July 2020

European Technical Assessment ETA-20/0238 English translation prepared by DIBt

Specific part

1 Technical description of the product

The construction product "FlamoX" consists of a moulded part made of sheet steel. a fireprotective inlay made of an intumescent material, which expands under heat exposure, and a fire-protective board.

The construction product is manufactured in different sizes as given in Annexes 2 and 3.

A detailed technical description of the fire safety related performance criteria (e.g. dimensions) of the construction product is given in Annexes 1 to 3.

Detailed information on the construction product's components is deposited with DIBt. NOTE:

The characteristics listed are suitable both for identifying the construction product as well as for performing the manufacturer's factory production control.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The construction product "FlamoX" is used as a component of penetration seals for recessed lights (downlights) in fire-resistant suspended ceilings.

These penetration seals are used to seal openings in fire-resistant suspended walls in which recessed lights are installed. Their aim is to preserve the resistance to fire of the fire-resistant suspended ceiling in the area of the recessed lights.

This ETA has served to verify the resistance to fire of penetration seals containing a construction product of type "FlamoX".

The construction product "FlamoX" may be used in penetration seals of use category Z_2 (product intended for use under dry internal conditions without frost (relative humidity between 50 % and 85 % and temperatures between +5 °C and 90 °C ± 5 °C) provided that the other components of the penetration seal meet the durability requirements. The resistance to fire of the penetration seals shall be verified on a case-by case basis.

More detailed information and data on the verified penetration seals are given in Annexes 4 to 7.

The performance data given in Section 3 relates exclusively to these penetration seals (e.g. with respect to the design and arrangement of the penetration seal components and the type and position of the recessed lights).



European Technical Assessment

ETA-20/0238 English translation prepared by DIBt

Page 4 of 11 | 23 July 2020

3 Performance of the product and references to the methods used for its assessment

3.1 Intended use: use in penetration seals

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Fire behavior of the "Housing"; sheet steel, DX 51 D+Z	Class A1 according to the commission decision 96/603/EC (current version))
Fire behavior of the "Inlay"; intumescent building material ¹	Class E acc. to EN 13501-1
Fire behavior of the "Plate"; "Rigips Feuerschutzplatte DF" acc. to declaration of performance no.Rigips_Feuerschutzplatte_RF_12,5_LE_0613 of 23.04.2013	Class A2, s1, d0 acc. To EN 13501-1
Resistance to fire of a penetration seal containing the product	The resistance to fire depends on the design and installation of the penetration seal and on the other components that make up the penetration seal. More details on the tested penetration seals and the related fire resistance classes are given in Annexes 1 to 7.

3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content and release of dangerous substances	No dangerous substances ²

4 Assessment and verification of constancy of performance system applied, with reference to its legal basis

In accordance with European Assessment Document (EAD) no. 351281-00-1104, the following legal basis shall apply: 1999/454/EC.

The system to be applied is: 1 for all uses except uses subject to reaction-to-fire requirements.

For uses subject to reaction-to-fire requirements, AVCP system 1, 3 or 4 shall apply depending on the conditions set out in the relevant decision.

In accordance with Regulation (EC) No 1272/2008 of the European Parliament and the European Council of 16 December 2008 (published in the Official Journal of the European Communities L 353 of 31 December 2008, p. 1)

¹ The composition of the materials is deposited at DIBt. ² In accordance with Regulation (EC) No 1272/2000



European Technical Assessment ETA-20/0238 English translation prepared by DIBt

Page 5 of 11 | 23 July 2020

5 Technical details necessary for the implementation of the AVCP system as provided for in the applicable EAD

The technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with DIBt.

Issued in Berlin on 23 July 2020 by Deutsches Institut für Bautechnik

Maja Tiemann Head of Department *beglaubigt:* Bisemeier English translation prepared by DIBt



The factory manufactured construction products "FlamoX" consists of a moulded part made of sheet steel, an insert of an intumescent building material and a fire protective board

Properties and performance criteria of the components of the construction product "FlamoX"

Component	Description		
"Housing"	Dimensions: see 2 and 3		
	Material: sheet steel, DX 51 D+Z		
	Thickness: 0,6 mm		
	Classification of the fire behavior: Class A1 according to the commission decision 96/603/EC (current version))		
"Inlay"	Dimensions: see Annexes 2 and 3		
	Material: Intumescent building material*		
	Classification of the fire behavior according to EN 13501-1: Class E		
"Plate"	Material: Rigips Feuerschutzplatte DF; Rigips GmbH, 40549 Düsseldorf		
	acc. to DIN EN 520		
	Declaration of performance: Rigips_Feuerschutzplatte_RF_12,5_LE_0613		
	Classification of the fire behavior according to EN 13501-1: Class A2, s1, d0		

The properties listed can be used for the identification of the construction product and for the implementation of the factory production control of the manufacturer.

Implementation details for the factory production control are included in the inspection plan.

* The composition of the materials is deposited at DIBt.

Performance of penetration seals, tested with the construction product "FlamoX"

Essential requirement	Test method	Construction of the sample	Performance
Resistance to fire	EN 1366-3	Penetration seal used in conjunction with a suspended ceiling in accordance with P-3966/9669-MPA-BS (national technical test certificate; AbP); linings consisting of 2 x 12,5 mm gypsum plasterboards; flame application from the bottom side of the suspended ceiling (see Annex 4 with 6 resp. 7)	Fire resistance (integrity and thermal insulation): 30 minutes
Resistance to fire	EN 1366-3	Penetration seal used in conjunction with a suspended ceiling in accordance with AbP P-3005/3024-MPA-BS (national technical test certificate; AbP); linings consisting of 2 x 12,5 mm gypsum plasterboards; flame application from the bottom side of the suspended ceiling (see Annex 5 with 6 resp. 7)	Fire resistance (integrity and thermal insulation): 30 minutes

The illustrations on Annexes 2 to 7 are without guarantee for completeness.


The use of the construction product "FlamoX" shall be in accordance with national requirements for planning, design and execution and in accordance with the installation instruction of the manufacturer. The tested/ illustrated seals are only examples.

FlamoX


Description of the construction products, properties and performances

Annex 1



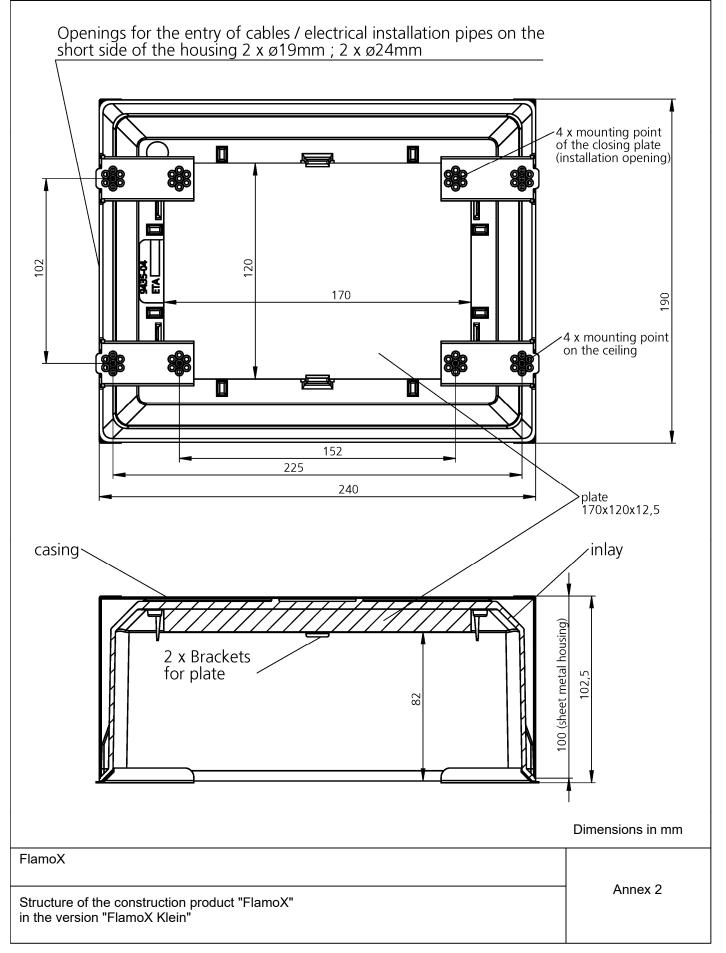




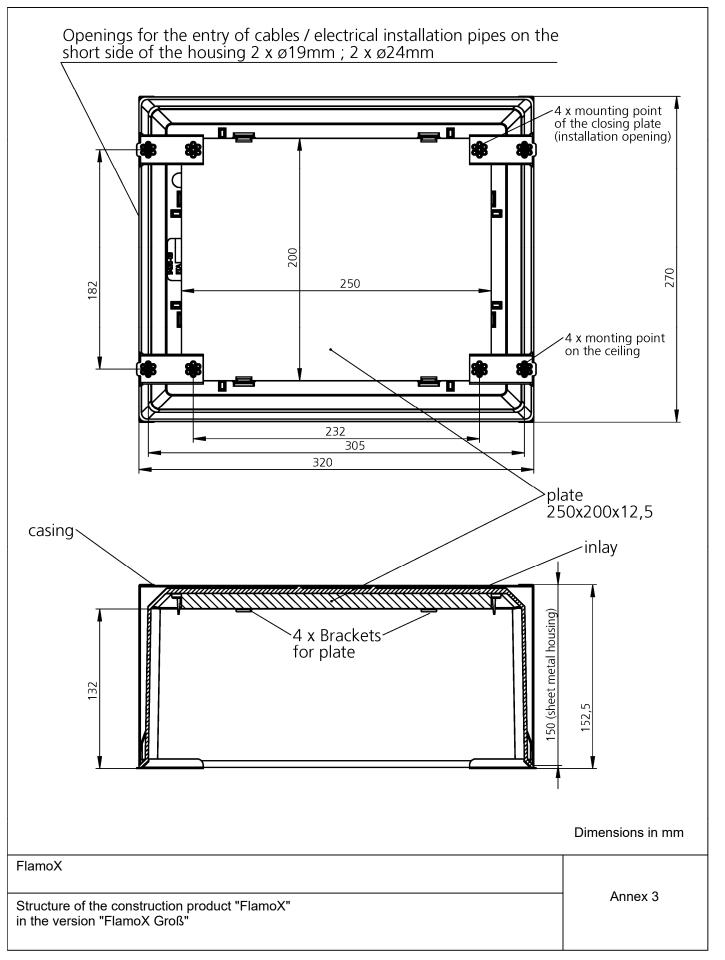


Page 8 of European Technical Assessment ETA-20/0238 of 23 July 2020



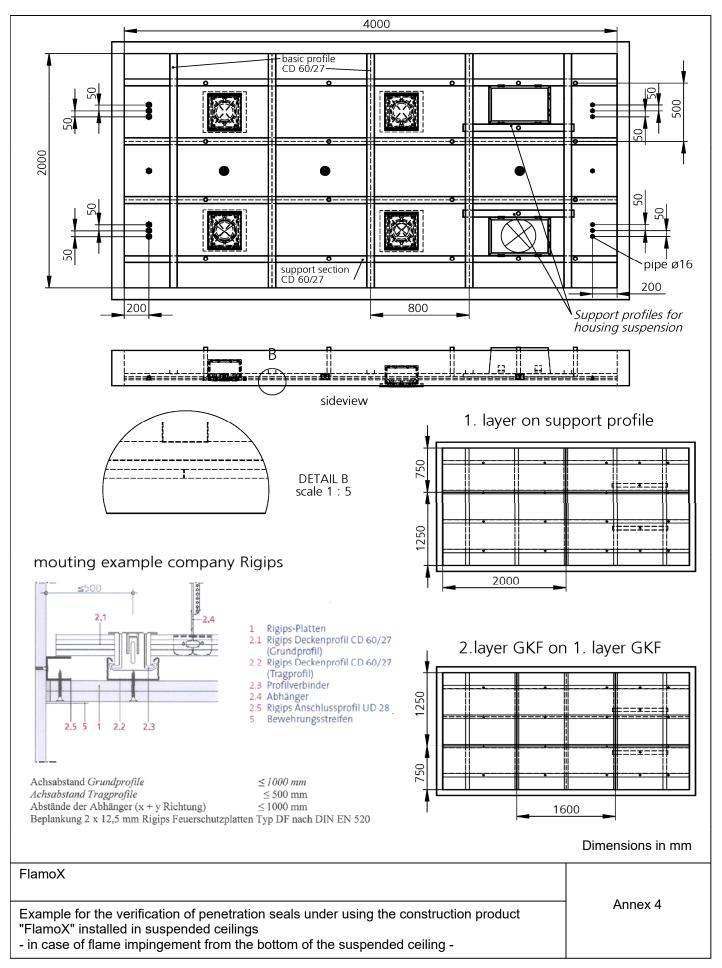


Page 9 of European Technical Assessment ETA-20/0238 of 23 July 2020



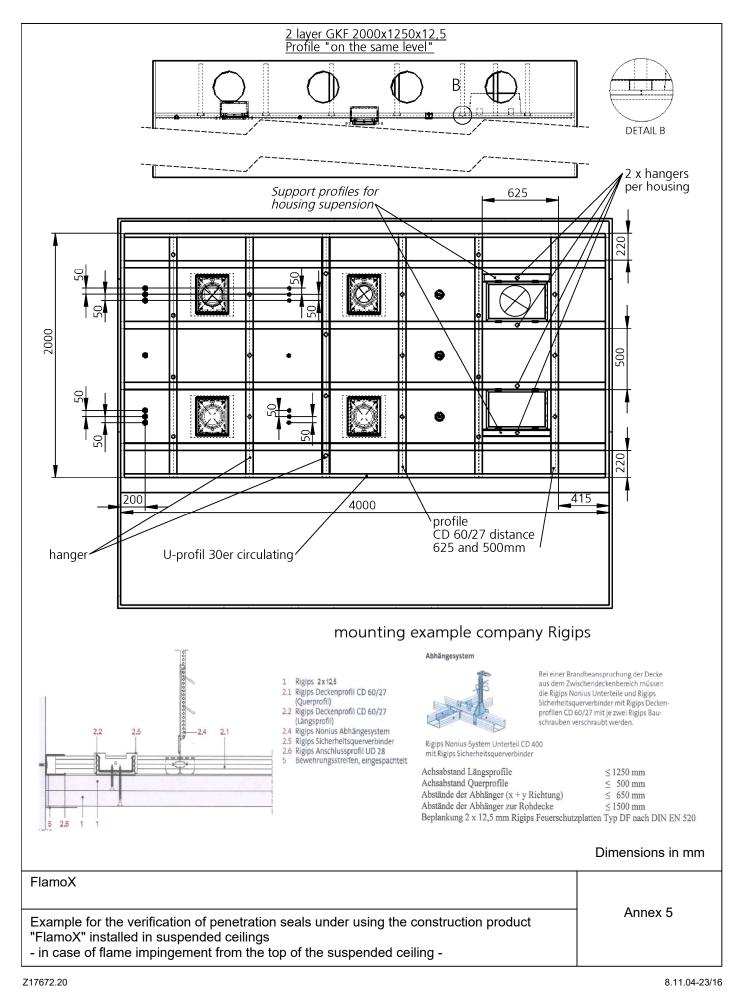

Page 10 of European Technical Assessment ETA-20/0238 of 23 July 2020



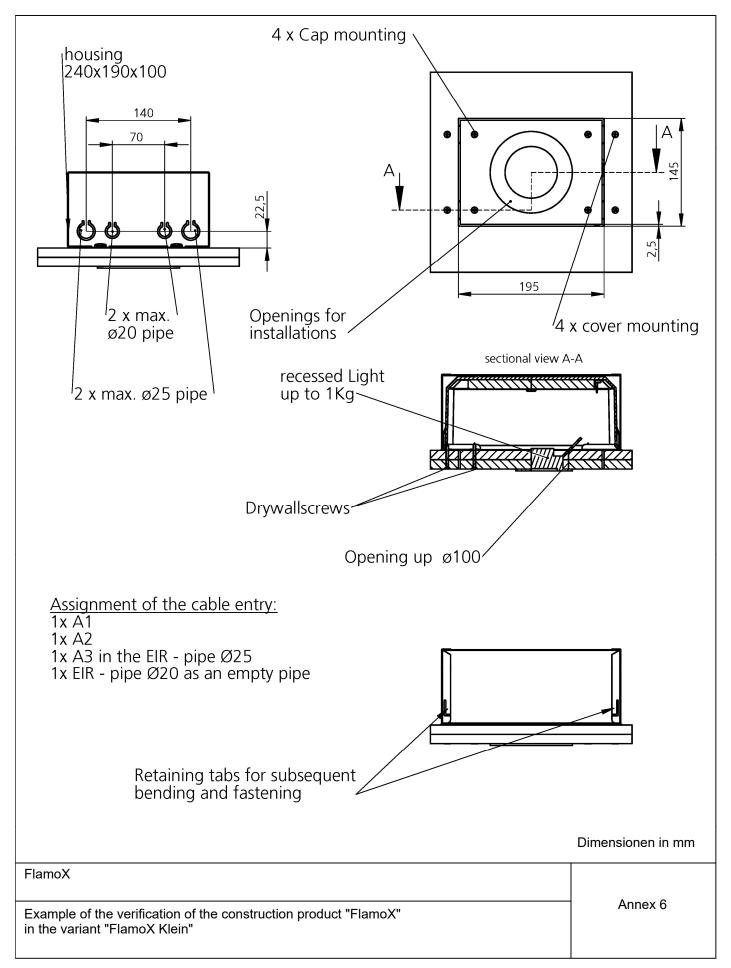

Page 11 of European Technical Assessment ETA-20/0238 of 23 July 2020



