

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-10/0171**  
**of 28 April 2021**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Injection system UPM 33

Product family  
to which the construction product belongs

Bonded anchor for use in concrete

Manufacturer

Upat Vertriebs GmbH  
Bebelstraße 11  
79108 Freiburg im Breisgau  
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment  
contains

23 pages including 4 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601, Edition 04/2020

This version replaces

ETA-10/0171 issued on 27 August 2015

**European Technical Assessment**

**ETA-10/0171**

English translation prepared by DIBt

**Page 2 of 23 | 28 April 2021**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The "Injection system UPM 33" is a bonded fastener consisting of a cartridge with injection mortar UPM 33, UPM 33 Relax or UPM 33 Express and a steel element according to Annex A4. The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete. The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B 3 and B 4, C 1 to C 5
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1 to C 3
Displacements under short-term and long-term loading	See Annex C 6
Characteristic resistance and displacements for seismic performance categories C1 and C2	No performance assessed

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 28 April 2021 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock  
Head of Section

*beglaubigt:*  
Baderschneider


## Installation conditions part 1

### Upat anchor rod


#### Pre-positioned installation

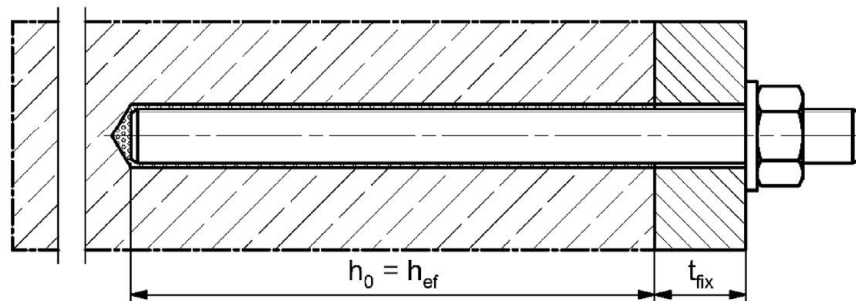

#### Push through installation (annular gap filled with mortar)

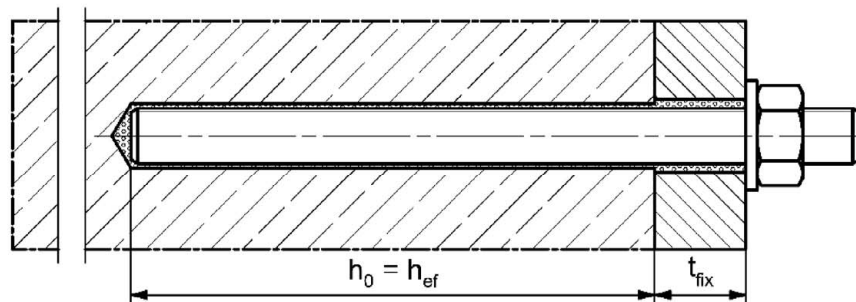

#### Pre-positioned or push through installation with subsequently injected filling disc (annular gap filled with mortar)

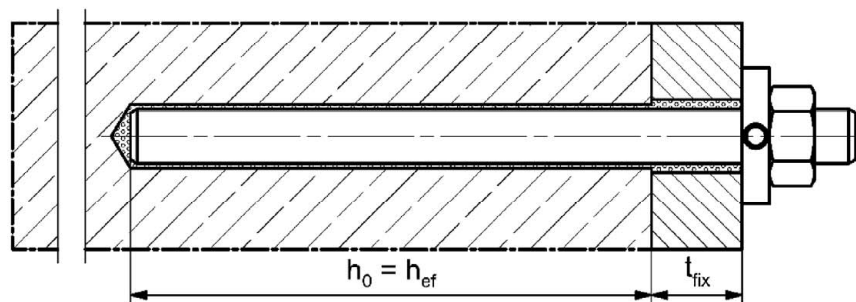

Figures not to scale

$h_0$  = drill hole depth

$h_{ef}$  = effective embedment depth

$t_{fix}$  = thickness of fixture

Injection system UPM 33

#### Product description


Installation conditions part 1

**Annex A 1**


Installation conditions part 2

Upat internal threaded anchor IST

Pre-positioned installation

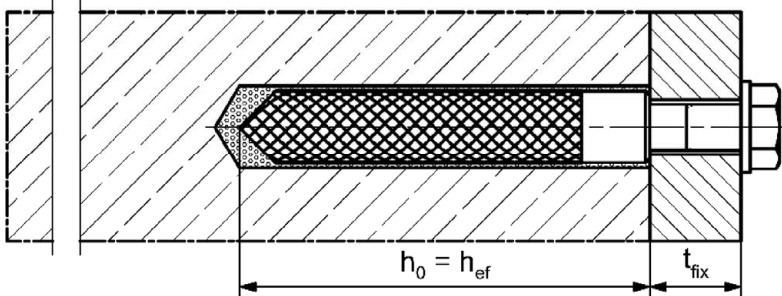

Pre-positioned installation with subsequently injected filling disc (annular gap filled with mortar)

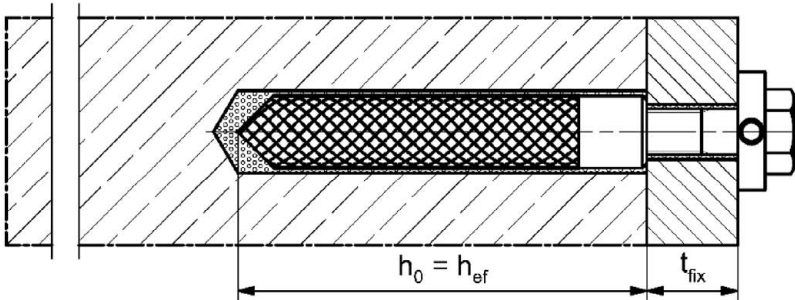

Figures not to scale

$h_0$  = drill hole depth  
 $t_{fix}$  = thickness of fixture

$h_{ef}$  = effective embedment depth


Injection system UPM 33

Product description  
Installation conditions part 2


Annex A 2

## Overview system components part 1


**Injection cartridge (shuttle cartridge) with sealing cap; Sizes: 350 ml, 360 ml, 390 ml, 550 ml, 1100 ml, 1500 ml**

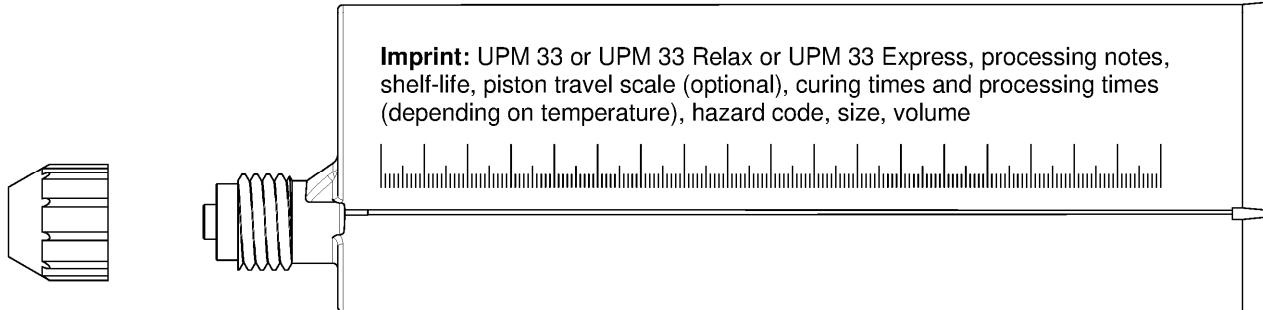


**Injection cartridge (coaxial cartridge) with sealing cap; Sizes: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml**

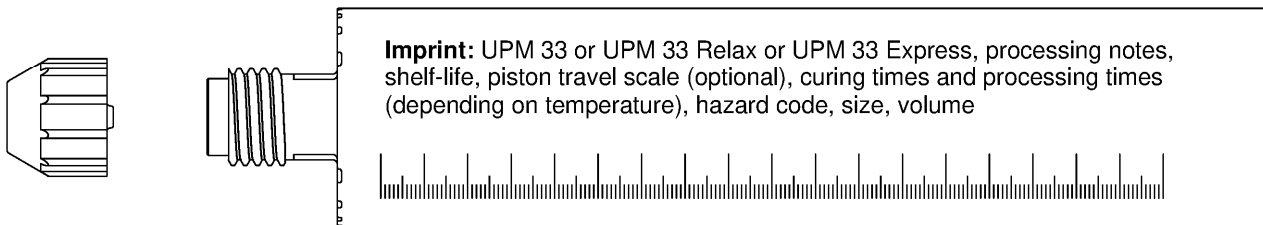

**Static mixer Upat MR Plus**




**Injection adapter and Extension tube for static mixer**



**Cleaning brush UP BS**



**Blow-out pump UPM or ABP**

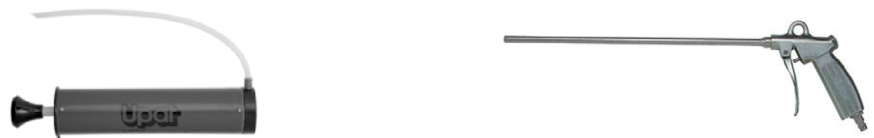

Figures not to scale

Injection system UPM 33

### Product description


Overview system components part 1;  
cartridges / static mixer / accessories

**Annex A 3**

## Overview system components part 2

### Upat anchor rod

Size: M6, M8, M10, M12, M16, M20, M24, M27, M30




### Upat internal threaded anchor IST


Size: M8, M10, M12, M16, M20



### Screw / threaded rod / washer / hexagon nut

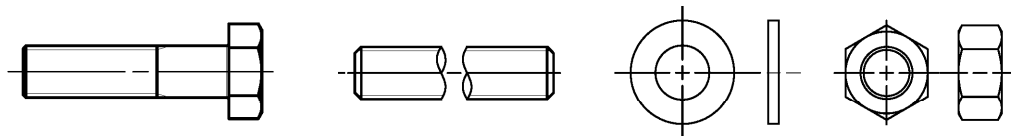

### filling disc with injection adapter

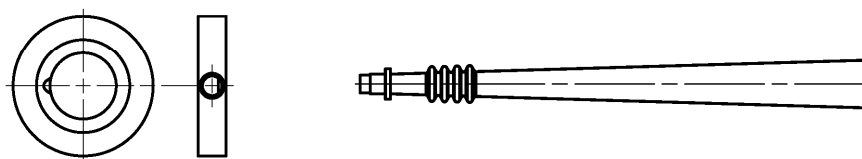

Figures not to scale

Injection system UPM 33

#### Product description

Overview system components part 2;  
steel components

**Annex A 4**







**Table A5.1: Materials**

Part	Designation	Material		
1	Injection cartridge	Mortar, hardener, filler		
	Steel grade	Steel	Stainless steel R	High corrosion resistant steel HCR
		zinc plated	acc. to EN 10088-1:2014 Corrosion resistance class CRC III acc. to EN 1993-1-4:2015	acc. to EN 10088-1:2014 Corrosion resistance class CRC V acc. to EN 1993-1-4:2015
2	Anchor rod	Property class 4.8, 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 8% fracture elongation	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062, 1.4662, 1.4462; EN 10088-1:2014 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 8% fracture elongation	Property class 50 or 80 EN ISO 3506-1:2009 or property class 70 with f <sub>yk</sub> = 560 N/mm <sup>2</sup> 1.4565; 1.4529; EN 10088-1:2014 f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup> A <sub>5</sub> > 8% fracture elongation
3	Washer ISO 7089:2000	zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hotdip galvanised ≥ 40 µm EN ISO 10684:2004	1.4401; 1.4404; 1.4578;1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565; 1.4529; EN 10088-1:2014
4	Hexagon nut	Property class 4, 5 or 8; EN ISO 898-2:2012 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 50, 70 or 80 EN ISO 3506-1:2009 1.4565; 1.4529 EN 10088-1:2014
5	Upat internal threaded anchor IST	Property class 5.8 ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K)	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014
6	Commercial standard screw or threaded rod for Upat internal threaded anchor IST	Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) A <sub>5</sub> > 8 % fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 A <sub>5</sub> > 8 % fracture elongation	Property class 70 EN ISO 3506-1:2009 1.4565; 1.4529; EN 10088-1:2014 A <sub>5</sub> > 8 % fracture elongation
7	filling disc similar to DIN 6319-G	zinc plated ≥ 5 µm, ISO 4042:2018/Zn5/An(A2K) or hot dip galvanised ≥ 40 µm EN ISO 10684:2004	1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014	1.4565;1.4529; EN 10088-1:2014
Injection system UPM 33				Annex A 5
Product description Materials				

## Specifications of intended use (part 1)

**Table B1.1:** Overview use and performance categories

Anchorages subject to		UPM 33 with ...			
		Anchor rod 		Upat internal threaded anchor IST 	
Hammer drilling with standard drill bit 		all sizes			
Hammer drilling with hollow drill bit (fischer FHD, Heller "Duster Expert"; Bosch „Speed Clean“; Hilti "TE-CD, TE-YD", DreBo „D-Plus“, DreBo „D-Max“) 		Nominal drill bit diameter (d <sub>0</sub> ) 12 mm to 35 mm			
Static and quasi static load, in	uncracked concrete	all sizes	Tables: C1.1 C3.1 C4.1 C6.1	all sizes	Tables: C2.1 C3.1 C5.1 C6.2
	cracked concrete	M10 bis M20		_2)	
Use category	I1 dry or wet concrete	all sizes			
	I2 water filled hole <sup>1)</sup>	M 12 to M 30		M 8 bis M 20	
Installation direction		D3 (downward and horizontal and upwards (e.g. overhead) installation)			
Installation temperature		T <sub>i,min</sub> = -10 °C to T <sub>i,max</sub> = +40 °C for the standard variation of temperature after installation			
In-service temperature	Temperature range I	-40 °C to +80 °C		(max. short term temperature +80 °C; max. long term temperature +50 °C)	
	Temperature range II	-40 °C to +120 °C		(max. short term temperature +120 °C; max. long term temperature +72 °C)	
<div><div><sup>1)</sup> Only with coaxial cartridges: 380ml, 400 ml, 410 ml</div><div><sup>2)</sup> No performance assessed</div></div>					
Injection system UPM 33					Annex B 1
Intended use Specifications (part 1)					

## Specifications of intended use (part 2)

### Base materials:

- Compacted reinforced or unreinforced normal weight concrete without fibres of strength classes C20/25 to C50/60 according to EN 206:2013+A1:2016

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel or high corrosion resistant steel).
- For all other conditions according to EN1993-1-4:2015 corresponding to corrosion resistance classes to Annex A 5 table A5.1.

### Design:

- Anchorages have to be designed by a responsible engineer with experience of concrete anchor design.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed in accordance with:  
EN 1992-4:2018 and EOTA Technical Report TR 055, Edition February 2018.

### Installation:

- Anchor installation is to be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- In case of aborted hole: The hole shall be filled with mortar
- Anchorage depth should be marked and adhered to on installation
- Overhead installation is allowed

Injection system UPM 33


**Intended use**  
Specifications (part 2)

**Annex B 2**

**Table B3.1:** Installation parameters for **anchor rods**

Anchor rods		Thread	M6	M8	M10	M12	M16	M20	M24	M27	M30
Width across flats	SW	[mm]	10	13	17	19	24	30	36	41	46
Nominal drill hole diameter	$d_0$		8	10	12	14	18	24	28	30	35
Drill hole depth	$h_0$		$h_0 = h_{ef}$								
Effective embedment depth	$h_{ef, min}$		50	60	60	70	80	90	96	108	120
	$h_{ef, max}$		72	160	200	240	320	400	480	540	600
Minimum spacing and minimum edge distance	$s_{min} = c_{min}$		40	40	45	55	65	85	105	125	140
Diameter of the clearance hole of the fixture	pre-positioned installation		7	9	12	14	18	22	26	30	33
	push through installation		9	12	14	16	20	26	30	33	40
Minimum thickness of concrete member	$h_{min}$		$h_{ef} + 30 (\geq 100)$				$h_{ef} + 2d_0$				
Maximum installation torque	$\max T_{inst}$	[Nm]	5	10	20	40	60	120	150	200	300

**Upat anchor rod**

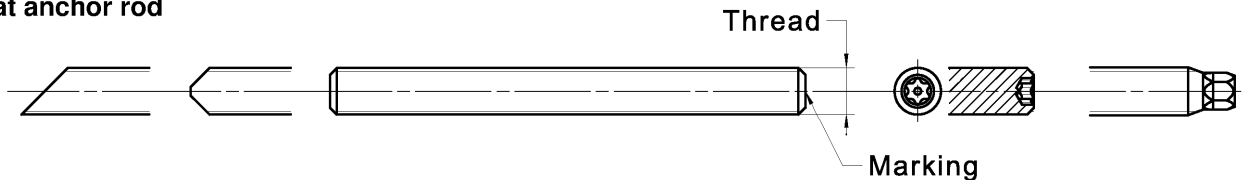


**Marking (on random place) Upat anchor rod:**

Steel zinc plated PC <sup>1)</sup> 8.8	• or +	Steel hot-dip PC <sup>1)</sup> 8.8	•
High corrosion resistant steel HCR PC <sup>1)</sup> 50	•	High corrosion resistant steel HCR PC <sup>1)</sup> 70	-
High corrosion resistant steel HCR PC <sup>1)</sup> 80	(	Stainless steel R property class 50	~
Stainless steel R property class 80	*		

Alternatively: Colour coding according to DIN 976-1:2016

<sup>1)</sup> PC = property class

**Installation conditions:**

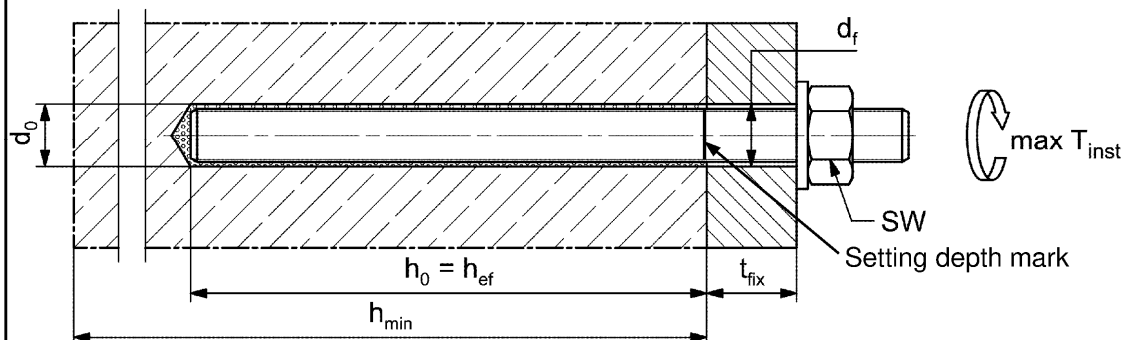

**Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled**

- Materials, dimensions and mechanical properties according to Annex A 5, Table A5.1
- Inspection certificate 3.1 according to EN 10204:2004, the documents have to be stored
- Setting depth is marked

Figures not to scale

Injection system UPM 33



**Intended use**  
Installation parameters anchor rods

**Annex B 3**

**Table B4.1:** Installation parameters for **Upat internal threaded anchors IST**

Internal threaded anchors IST		Thread	M8	M10	M12	M16	M20
Diameter of anchor	$d_{nom} = d_H$	[mm]	12	16	18	22	28
Nominal drill hole diameter	$d_0$		14	18	20	24	32
Drill hole depth	$h_0$		$h_0 = h_{ef} = L_H$				
Effective embedment depth ( $h_{ef} = L_H$ )	$h_{ef}$		90	90	125	160	200
Minimum spacing and minimum edge distance	$S_{min}$ = $C_{min}$		55	65	75	95	125
Diameter of clearance hole in the fixture	$d_f$		9	12	14	18	22
Minimum thickness of concrete member	$h_{min}$		120	125	165	205	260
Maximum screw-in depth	$l_{E,max}$		18	23	26	35	45
Minimum screw-in depth	$l_{E,min}$		8	10	12	16	20
Maximum installation torque	$\max T_{inst}$	[Nm]	10	20	40	80	120


**Upat internal threaded anchor IST**

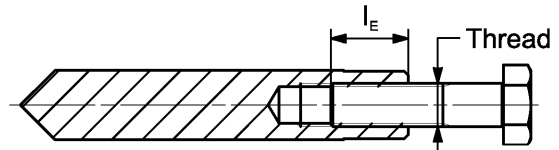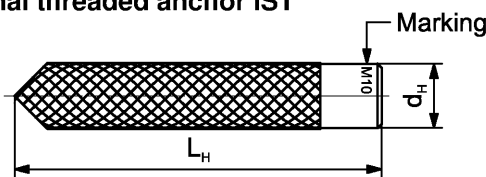

**Marking:** Anchor size e. g.: **M10**  
Stainless steel → additional **R**; e.g.: **M10 R**  
High corrosion resistant steel → additional **HCR**; e.g.: **M10 HCR**

Retaining bolt or threaded rods (including nut and washer) must comply with the appropriate material and strength class of Annex A 5, Table A5.1

**Installation conditions:**

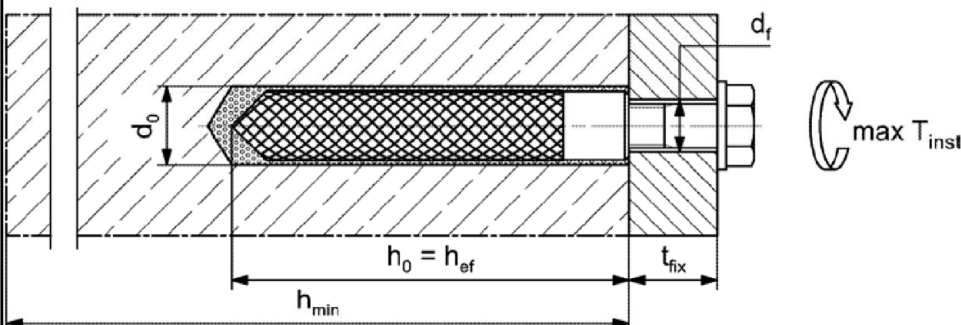

Figures not to scale

Injection system UPM 33

**Intended use**  
Installation parameters Upat internal threaded anchors IST

**Annex B 4**

**Table B5.1:** Parameters of the **cleaning brush UP BS** (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

Nominal drill hole diameter	$d_0$		8	10	12	14	16	18	20	24	25	28	30	35
Steel brush diameter BS	$d_b$	[mm]	9	11	14	16	20	25	26	27	30	40		



**Table B5.2** **Maximum processing time** of the mortar and **minimum curing time**  
(During the curing time of the mortar the concrete temperature may not fall below the listed minimum temperature)

Temperature at anchoring base [°C]	Maximum processing time $t_{work}$			Minimum curing time <sup>1)</sup> $t_{cure}$		
	UPM 33 Express	UPM 33	UPM 33 Relax	UPM 33 Express	UPM 33	UPM 33 Relax
-10 to -5 <sup>2)</sup>	-	-	-	12 h	-	-
> -5 to 0 <sup>2)</sup>	5 min	-	-	3 h	24 h	-
> 0 to 5 <sup>2)</sup>	5 min	13 min	-	3 h	3 h	6 h
> 5 to 10	3 min	9 min	20 min	50 min	90 min	3 h
> 10 to 20	1 min	5 min	10 min	30 min	60 min	2 h
> 20 to 30	-	4 min	6 min	-	45 min	60 min
> 30 to 40	-	2 min	4 min	-	35 min	30 min

<sup>1)</sup> In wet concrete or water filled holes the curing times must be doubled

<sup>2)</sup> Minimal cartridge temperature +5°C

Injection system UPM 33







**Intended use**

Cleaning brush (steel brush)  
Processing time and curing time

**Annex B 5**



## Installation instructions part 1

### Drilling and cleaning the hole (hammer drilling with standard drill bit)

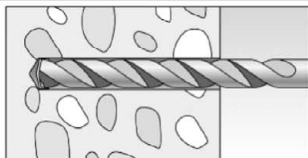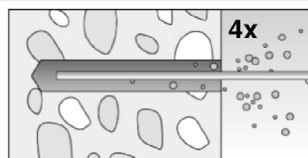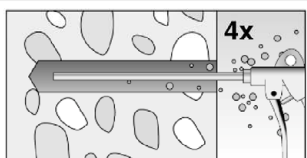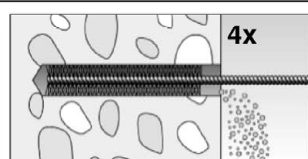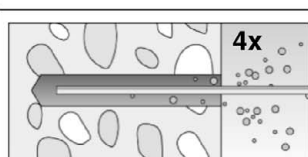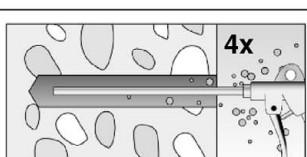1		Drill the hole. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B3.1, B4.1</b>		
2		Clean the drill hole: For $h_{ef} \leq 12d$ and $d_0 < 18$ mm blow out the hole four times by hand		For $h_{ef} > 12d$ and / or $d_0 \geq 18$ mm blow out the hole four times with oil-free compressed air ( $p \geq 6$ bar)
3		Brush the drill hole four times. For deep holes use an extension. Corresponding brushes see <b>table B5.1</b>		
4		Clean the drill hole: For $h_{ef} \leq 12d$ and $d_0 < 18$ mm blow out the hole four times by hand		For $h_{ef} > 12d$ and / or $d_0 \geq 18$ mm blow out the hole four times with oil-free compressed air ( $p \geq 6$ bar)

Go to step 5

### Drilling and cleaning the hole (hammer drilling with hollow drill bit)

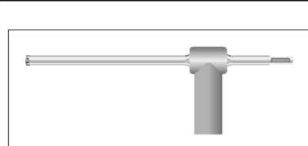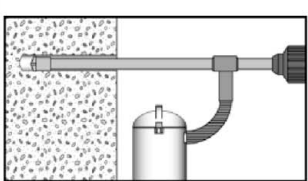1		Check a suitable hollow drill (see <b>table B1.1</b> ) for correct operation of the dust extraction
2		Use a suitable dust extraction system, e. g. fischer FVC 35 M or a comparable dust extraction system with equivalent performance data  Drill the hole with hollow drill bit. The dust extraction system has to extract the drill dust nonstop during the drilling process and must be adjusted to maximum power. Nominal drill hole diameter $d_0$ and drill hole depth $h_0$ see <b>tables B3.1, B4.1</b>

Go to step 5

Injection system UPM 33






**Intended use**  
Installation instructions part 1

**Annex B 6**






## Installation instructions part 2

### Preparing the cartridge

5		Remove the sealing cap Screw on the static mixer (the spiral in the static mixer must be clearly visible)	
6			Place the cartridge into the dispenser
7			Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey

Go to step 8

### Injection of the mortar

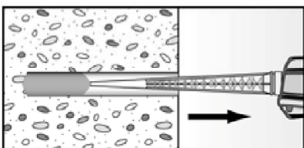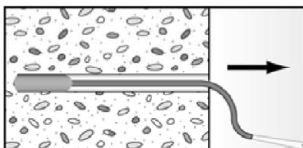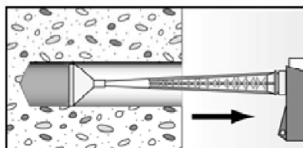8				Fill approximately 2/3 of the drill hole with mortar. Always begin from the bottom of the hole and avoid bubbles  For drill hole depth $\geq 150$ mm use an extension tube  For overhead installation, deep holes ( $h_0 > 250$ mm) or drill hole diameter ( $d_0 \geq 40$ mm) use an injection adapter
---	--	--	--	---

Go to step 9

Injection system UPM 33







**Intended use**  
Installation instructions part 2

**Annex B 7**



### Installation instructions part 3

#### Installation of anchor rods or Upat internal threaded anchors IST

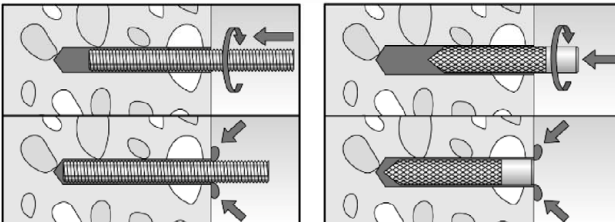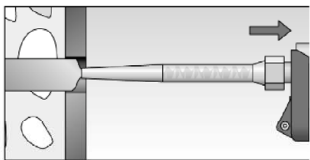9		<p>Only use clean and oil-free metal parts. Mark the setting depth of the metal part. Push the anchor rod or Upat internal threaded IST anchor down to the bottom of the hole, turning it slightly while doing so. After inserting the metal parts, excess mortar must be emerged around the anchor element.</p>
	 <p>For overhead installations support the metal part with wedges (e.g. centering wedges) or overhead clips.</p>	 <p>For push through installation fill the annular gap with mortar</p>
10	 <p>Wait for the specified curing time <math>t_{cure}</math> see table B5.2</p>	<p>11</p>  <p>Mounting the fixture max <math>T_{inst}</math> see tables B3.1 and B4.1</p>
Option		<p>After the minimum curing time is reached, the gap between metal part and fixture (annular clearance) may be filled with mortar via the filling disc. Compressive strength <math>\geq 50 \text{ N/mm}^2</math> (e.g. Upat injection mortars UPM 33, UPM 44, UPM 55). ATTENTION: Using filling disc reduces <math>t_{fix}</math> (usable length of the anchor)</p>

Injection system UPM 33

**Intended use**  
Installation instructions part 3

**Annex B 8**

**Table C1.1: Characteristic values for under tension / shear load of Upat anchor rods and standard threaded rods**

Anchor rod / standard threaded rod				M6	M8	M10	M12	M16	M20	M24	M27	M30	
Bearing capacity under tension load, steel failure <sup>3)</sup>													
Characteristic resistance $N_{Rk,s}$	Steel zinc plated	Property class	4.8	[kN]	8	15(13)	23(21)	33	63	98	141	184	224
			5.8		10	19(17)	29(27)	43	79	123	177	230	281
			8.8		16	29(27)	47(43)	68	126	196	282	368	449
	Stainless steel R and high corrosion resistant steel HCR		50		10	19	29	43	79	123	177	230	281
			70		14	26	41	59	110	172	247	322	393
			80		16	30	47	68	126	196	282	368	449
Partial factors <sup>1)</sup>													
Partial factor $\gamma_{Ms,N}$	Steel zinc plated	Property class	4.8	[-]	1,50								
			5.8		1,50								
			8.8		1,50								
	Stainless steel R and high corrosion resistant steel HCR		50		2,86								
			70		1,50 <sup>2)</sup> / 1,87								
			80		1,60								
Bearing capacity under shear load, steel failure <sup>3)</sup>													
without lever arm													
Characteristic resistance $V_{Rk,s}$	Steel zinc plated	Property class	4.8	[kN]	4	9(8)	14(13)	20	38	59	85	110	135
			5.8		6	11(10)	17(16)	25	47	74	106	138	168
			8.8		8	15(13)	23(21)	34	63	98	141	184	225
	Stainless steel R and high corrosion resistant steel HCR		50		5	9	15	21	39	61	89	115	141
			70		7	13	20	30	55	86	124	161	197
			80		8	15	23	34	63	98	141	184	225
Ductility factor			$k_7$	[-]	1,0								
with lever arm													
Charact. resistance $M_{Rk,s}^0$	Steel zinc plated	Property class	4.8	[Nm]	6	15(13)	30(27)	52	133	259	448	665	899
			5.8		7	19(16)	37(33)	65	166	324	560	833	1123
			8.8		12	30(26)	60(53)	105	266	519	896	1333	1797
	Stainless steel R and high corrosion resistant steel HCR		50		7	19	37	65	166	324	560	833	1123
			70		10	26	52	92	232	454	784	1167	1573
			80		12	30	60	105	266	519	896	1333	1797
Partial factors <sup>1)</sup>													
Partial factor $\gamma_{Ms,V}$	Steel zinc plated	Property class	4.8	[-]	1.25								
			5.8		1.25								
			8.8		1.25								
	Stainless steel R and high corrosion resistant steel HCR		50		2.38								
			70		1.25 <sup>2)</sup> / 1.56								
			80		1.33								
<sup>1)</sup> In absence of other national regulations													
<sup>2)</sup> Only admissible for high corrosion resistant steel HCR, with $f_{yk} / f_{uk} \geq 0,8$ and $A_5 > 12 \%$ (e.g. Upat anchor rods)													
<sup>3)</sup> Values in brackets are valid for undersized threaded rods with smaller stress area $A_s$ for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009													
Injection system UPM 33									Annex C 1				
Performances Characteristic values for steel failure under tension / shear load of Upat anchor rods and standard threaded rods													

**Table C2.1: Characteristic values for steel failure under tension / shear load of Upat internal threaded anchors IST**

Upat internal threaded anchors IST				M8	M10	M12	M16	M20	
Bearing capacity under tension load, steel failure									
Charact. resistance with screw	N <sub>Rk,s</sub>	Property class	5.8	[kN]	19	29	43	79	123
			8.8		29	47	68	108	179
		Property class 70	R		26	41	59	110	172
			HCR		26	41	59	110	172
Partial factors <sup>1)</sup>									
Partial factors	γ <sub>Ms,N</sub>	Property class	5.8	[-]	1,50				
			8.8		1,50				
		Property class 70	R		1,87				
			HCR		1,87				
Bearing capacity under shear load, steel failure									
Without lever arm									
Charact. resistance with screw	V <sup>0</sup> <sub>Rk,s</sub>	Property class	5.8	[kN]	9,2	14,5	21,1	39,2	62,0
			8.8		14,6	23,2	33,7	54,0	90,0
		Property class 70	R		12,8	20,3	29,5	54,8	86,0
			HCR		12,8	20,3	29,5	54,8	86,0
Ductility factor			k <sub>7</sub>	[-]	1,0				
With lever arm									
Charact. resistance with screw	M <sup>0</sup> <sub>Rk,s</sub>	Property class	5.8	[Nm]	20	39	68	173	337
			8.8		30	60	105	266	519
		Property class 70	R		26	52	92	232	454
			HCR		26	52	92	232	454
Partial factors <sup>1)</sup>									
Partial factors	γ <sub>Ms,V</sub>	Property class	5.8	[-]	1,25				
			8.8		1,25				
		Property class 70	R		1,56				
			HCR		1,56				
<sup>1)</sup> In absence of other national regulations									
Injection system UPM 33								Annex C 2	
<b>Performances</b> Characteristic values for steel failure under tension / shear load of Upat internal threaded anchor IST									

Table C3.1: Characteristic values for concrete failure under tension / shear load													
Size				All sizes									
Tension load													
Installation factor			$\gamma_{inst}$	[-]	See annex C 4 to C 5								
Factors for the compressive strength of concrete > C20/25													
Increasing factor for $\tau_{Rk}$	C25/30		$\Psi_c$	[-]	1,05								
	C30/37				1,10								
	C35/45				1,15								
	C40/50				1,19								
	C45/55				1,22								
	C50/60				1,26								
Splitting failure													
Edge distance	$h / h_{ef} \geq 2,0$		$C_{cr,sp}$	[mm]	$1,0 h_{ef}$								
	$2,0 > h / h_{ef} > 1,3$				$4,6 h_{ef} - 1,8 h$								
	$h / h_{ef} \leq 1,3$				$2,26 h_{ef}$								
Spacing			$S_{cr,sp}$		$2 C_{cr,sp}$								
Concrete cone failure													
Uncracked concrete			$k_{ucr,N}$	[-]	11,0								
Cracked concrete			$k_{cr,N}$		7,7								
Edge distance			$C_{cr,N}$	[mm]	$1,5 h_{ef}$								
Spacing			$S_{cr,N}$		$2 C_{cr,N}$								
Factors for sustained tension load													
Temperature range				[-]	50 °C / 80 °C			72 °C / 120 °C					
Factor			$\Psi^0_{sus}$	[-]	0,74			0,87					
Shear load													
Installation factor			$\gamma_{inst}$	[-]	1,2								
Concrete pry-out failure													
Factor for pry-out failure			$k_8$	[-]	2,0								
Concrete edge failure													
Effective length of fastener in shear loading			$l_f$	[mm]	for $d_{nom} \leq 24$ mm: min ( $h_{ef}$ ; $12 d_{nom}$ ) for $d_{nom} > 24$ mm: min ( $h_{ef}$ ; $8 d_{nom}$ ; 300 mm)								
Calculation diameters													
Size				M6	M8	M10	M12	M16	M20	M24	M27	M30	
Upat anchor rods and standard threaded rods			$d_{nom}$	[mm]	6	8	10	12	16	20	24	27	30
Upat internal threaded anchors IST			$d_{nom}$		- <sup>1)</sup>	12	16	18	22	28	- <sup>1)</sup>	- <sup>1)</sup>	- <sup>1)</sup>
<sup>1)</sup> Anchor type not part of the assessment													
Injection system UPM 33									Annex C 3				
Performances Characteristic values for concrete failure under tension / shear load													

**Table C4.1: Characteristic values for combined pull-out and concrete failure for Upat anchor rods and standard threaded rods in hammer drilled holes; uncracked or cracked concrete**

Anchor rod / standard threaded rod			M6	M8	M10	M12	M16	M20	M24	M27	M30	
Combined pullout and concrete cone failure												
Calculation diameter		d	[mm]	6	8	10	12	16	20	24	27	30
Uncracked concrete												
Characteristic bond resistance in uncracked concrete C20/25												
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)												
Temperature range	I: 50 °C / 80 °C	$\tau_{Rk,ucr}$	[N/mm²]	9,0	11,0	11,0	11,0	10,0	9,5	9,0	8,5	8,5
	II: 72 °C / 120 °C			6,5	9,5	9,5	9,0	8,5	8,0	7,5	7,0	7,0
Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup>												
Temperature range	I: 50 °C / 80 °C	$\tau_{Rk,ucr}$	[N/mm²]	-2)	-2)	-2)	9,5	8,5	8,0	7,5	7,0	7,0
	II: 72 °C / 120 °C			-2)	-2)	-2)	7,5	7,0	6,5	6,0	6,0	6,0
Installation factors												
Dry or wet concrete		$\gamma_{inst}$	[-]	1,2								
Water filled hole				-2)	-2)	-2)	1,4 <sup>1)</sup>					
Cracked concrete												
Characteristic bond resistance in cracked concrete C20/25												
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)												
Temperature range	I: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm²]	-2)	-2)	6,0	6,0	6,0	5,5	-2)	-2)	-2)
	II: 72 °C / 120 °C			-2)	-2)	5,0	6,0	6,0	5,0	-2)	-2)	-2)
Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup>												
Temperature range	I: 50 °C / 80 °C	$\tau_{Rk,cr}$	[N/mm²]	-2)	-2)	-2)	5,0	5,0	4,5	-2)	-2)	-2)
	II: 72 °C / 120 °C			-2)	-2)	-2)	4,0	4,0	4,0	-2)	-2)	-2)
Installation factors												
Dry or wet concrete		$\gamma_{inst}$	[-]	1,2								
Water filled hole				-2)	-2)	-2)	1,4 <sup>1)</sup>					
<div><div><sup>1)</sup> Only with coaxial cartridges: 380ml, 400 ml, 410 ml</div><div><sup>2)</sup> No Performance assessed</div></div>												
Injection system UPM 33									Annex C 4			
<div>Performances</div> <div>Characteristic values for combined pull-out and concrete failure for Upat anchor rod and standard threaded rods</div>												

**Table C5.1: Characteristic values for combined pull-out and concrete failure for Upat internal threaded anchors IST in hammer drilled holes; uncracked concrete**

Internal threaded anchor IST			M8	M10	M12	M16	M20		
Combined pullout and concrete cone failure									
Calculation diameter		d	[mm]	12	16	18	22	28	
Uncracked concrete									
Characteristic bond resistance in uncracked concrete C20/25									
Hammer-drilling with standard drill bit or hollow drill bit (dry or wet concrete)									
Temperature range	I: 50 °C / 80 °C		$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10,5	10,0	9,5	9,0	8,5
	II: 72 °C / 120 °C				9,0	8,0	8,0	7,5	7,0
Hammer-drilling with standard drill bit or hollow drill bit (water filled hole) <sup>1)</sup>									
Temperature range	I: 50 °C / 80 °C		$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	10,0	9,0	9,0	8,5	8,0
	II: 72 °C / 120 °C				7,5	6,5	6,5	6,0	6,0
Installation factors									
Dry or wet concrete		$\gamma_{inst}$	[-]	1,2					
Water filled hole				1,4 <sup>1)</sup>					

<sup>1)</sup> Only with coaxial cartridges: 380 ml, 400 ml, 410 ml

Injection system UPM 33

**Performances**

Characteristic values for combined pull-out and concrete failure for Upat internal threaded anchors IST

**Annex C 5**

**Table C6.1: Displacements for anchor rods**

Anchor rod		M6	M8	M10	M12	M16	M20	M24	M27	M30
Displacement-Factors for tension load <sup>1)</sup>										
Uncracked concrete; Temperature range I, II										
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	0,09	0,09	0,09	0,10	0,10	0,10	0,10	0,11	0,12
δ <sub>N∞</sub> -Factor		0,10	0,10	0,10	0,12	0,12	0,12	0,12	0,13	0,13
Cracked concrete; Temperature range I, II										
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	₋³)	₋³)	0,12	0,12	0,13	0,13	₋³)	₋³)	₋³)
δ <sub>N0</sub> -Factor		₋³)	₋³)	0,27	0,30	0,30	0,30	₋³)	₋³)	₋³)
Displacement-Factors for shear load <sup>2)</sup>										
Uncracked or cracked concrete; Temperature range I, II										
δ <sub>V0</sub> -Factor	[mm/kN]	0,11	0,11	0,11	0,10	0,10	0,09	0,09	0,08	0,07
δ <sub>V∞</sub> -Factor		0,12	0,12	0,12	0,11	0,11	0,10	0,10	0,09	0,09

1) Calculation of effective displacement:

$$\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$$

( $\tau_{Ed}$ : Design value of the applied tensile stress)

3) No performance assessed

2) Calculation of effective displacement:

$$\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$$

( $V_{Ed}$ : Design value of the applied shear force)

**Table C6.2: Displacements for Upat internal threaded anchors IST**

Internal threaded anchor IST		M8	M10	M12	M16	M20
Displacement-Factors for tension load <sup>1)</sup>						
Uncracked concrete; Temperature range I, II						
δ <sub>N0</sub> -Factor	[mm/(N/mm <sup>2</sup> )]	0,10	0,11	0,12	0,13	0,14
δ <sub>N∞</sub> -Factor		0,13	0,14	0,15	0,16	0,18
Displacement-Factors for shear load <sup>2)</sup>						
Uncracked concrete; Temperature range I, II						
δ <sub>V0</sub> -Factor	[mm/kN]	0,12	0,12	0,12	0,12	0,12
δ <sub>V∞</sub> -Factor		0,14	0,14	0,14	0,14	0,14

1) Calculation of effective displacement:

$$\delta_{N0} = \delta_{N0\text{-Factor}} \cdot \tau_{Ed}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-Factor}} \cdot \tau_{Ed}$$

( $\tau_{Ed}$ : Design value of the applied tensile stress)

2) Calculation of effective displacement:

$$\delta_{V0} = \delta_{V0\text{-Factor}} \cdot V_{Ed}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-Factor}} \cdot V_{Ed}$$

( $V_{Ed}$ : Design value of the applied shear force)

Injection system UPM 33

**Performances**

Displacements for anchor rods and Upat internal threaded anchors IST

**Annex C 6**