

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-17/0991**  
**of 19 January 2021**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

ejotherm S1 and ejotherm S1 short

Product family  
to which the construction product belongs

Screwed-in plastic anchor for fixing of external thermal  
insulation composite systems with rendering in concrete  
and masonry

Manufacturer

EJOT Baubefestigungen GmbH  
In der Stockwiese 35  
57334 Bad Laasphe  
DEUTSCHLAND

Manufacturing plant

manufacturing plant EJOT 1, 2, 3 and 4

This European Technical Assessment  
contains

18 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330196-01-0604

This version replaces

ETA-17/0991 issued on 10 September 2019

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The screwed-in anchor ejotherm S1 and ejotherm S1 short consists of an anchor sleeve made of polyethylene (virgin material), an anchor plate made of polyethylene (virgin material) and an accompanying specific screw made of polyamide (virgin material).

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic load bearing capacity <ul style="list-style-type: none"> <li>- Characteristic resistance under tension load</li> <li>- Minimum edge distance and spacing</li> </ul>	See Annex C 1 See Annex B 2
Displacements	See Annex C 2
Plate stiffness	See Annex C 2

#### 3.2 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance
Point thermal transmittance	See Annex C 2

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 330196-01-0604, the applicable European legal act is: [97/463/EC].

The system to be applied is: 2+

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 19 January 2021 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock  
Head of Section

*beglaubigt:*  
Ziegler

**ejotherm S1**

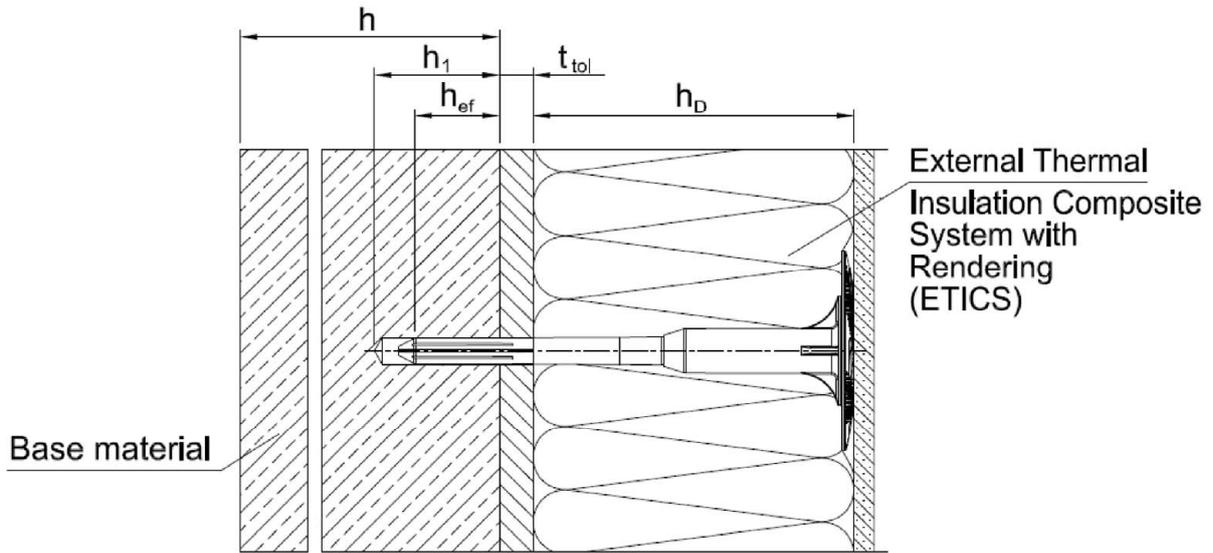

**ejotherm S1 short**

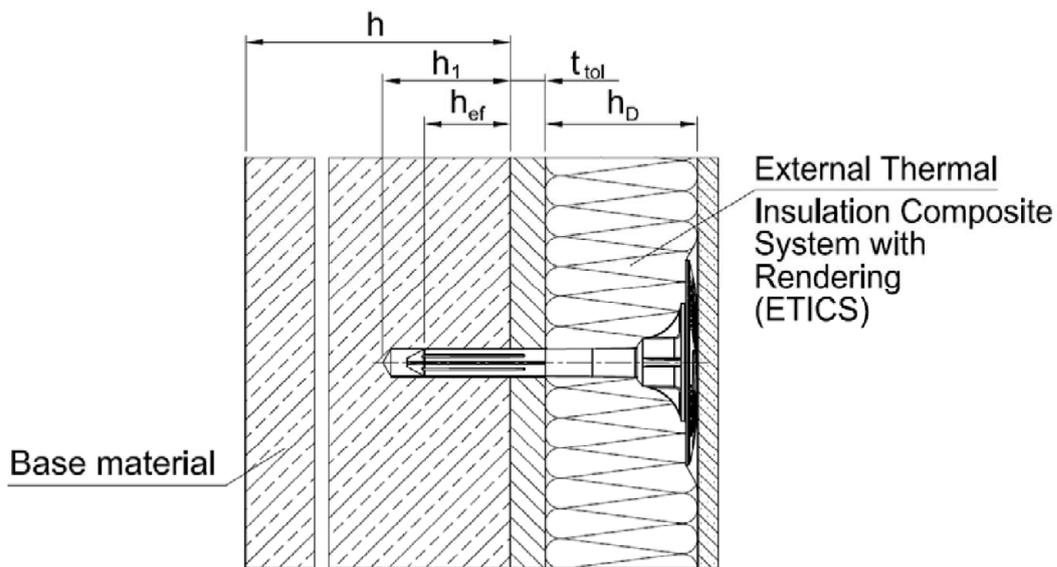

**Intended use**

- Anchorage of ETICS in concrete and masonry
- Anchorage of ETICS in autoclaved aerated concrete and lightweight aggregate concrete

Legend:


- $h_D$  = thickness of insulation material
- $h_{ef}$  = effective anchorage depth
- $h$  = thickness of member (wall)
- $h_1$  = depth of drilled hole to deepest point
- $t_{tol}$  = thickness of equalizing layer or non-load-bearing coating

**ejotherm S1 and ejotherm S1 short**

**Product description**  
Installed condition

**Annex A 1**

**ejotherm S1 in base material group A, B, C, D**

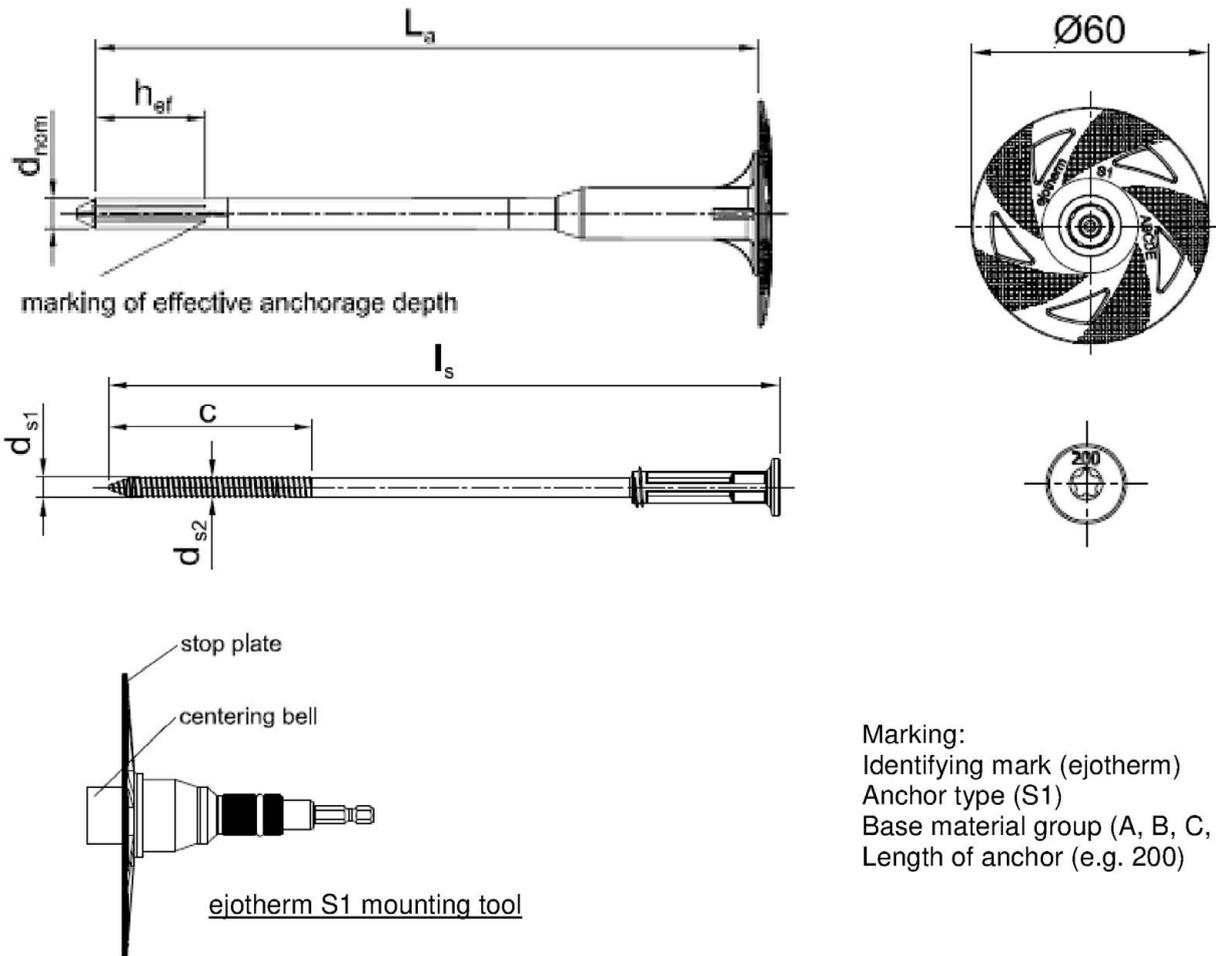

Marking:  
Identifying mark (ejotherm)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 200)

**Table A1: Dimensions**

Anchor Type	Anchor sleeve			Plastic screw			min $l_s$ max $l_s$ [mm]
	$d_{nom}$ [mm]	$h_{ef}$ [mm]	min $L_a$ max $L_a$ [mm]	$d_{s1}$ [mm]	$d_{s2}$ [mm]	$c$ [mm]	
ejotherm S1	8	30	100 300	5,7	5,0	55	100 300

Determination of maximum thickness of insulation  $h_D$  [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 200 - 10 - 30$   
 $h_{Dmax} = 160$


**ejotherm S1 and ejotherm S1 short**

**Product description**

Marking and dimension of the anchor sleeve from ejotherm S1;  
base material group: A, B, C, D; plastic screw

**Annex A 2**

**ejotherm S1 in base material group A, B, C, D – large version**

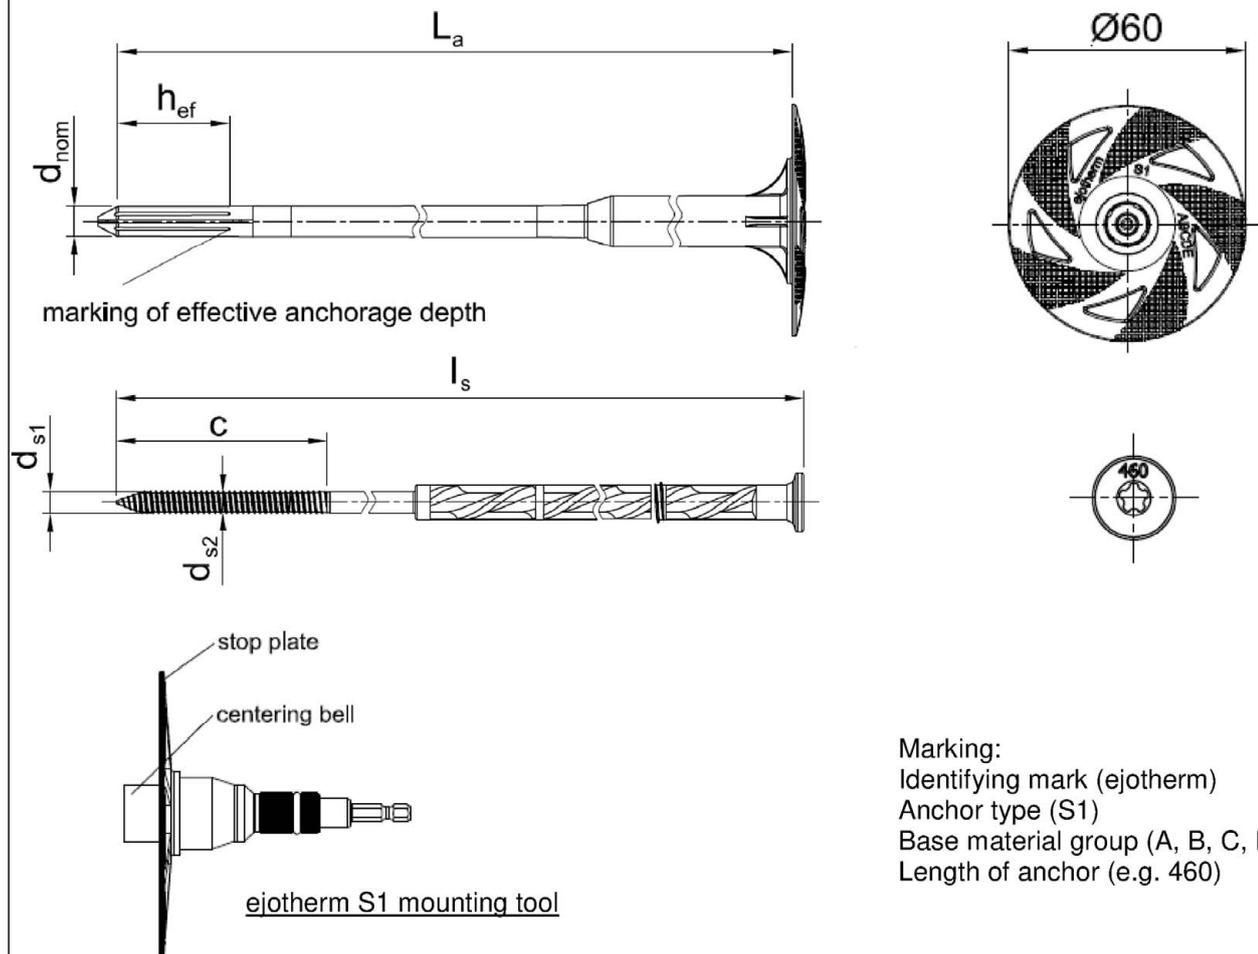

Marking:  
Identifying mark (ejotherm)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 460)

**Table A2: Dimensions**

Anchor Type	Anchor Sleeve			Plastic screw			
	$d_{nom}$ [mm]	$h_{ef}$ [mm]	min $L_a$ max $L_a$ [mm]	$d_{s1}$ [mm]	$d_{s2}$ [mm]	$c$ [mm]	min $l_s$ max $l_s$ [mm]
ejotherm S1	8	30	320 460	5,7	5,0	55	320 460

Determination of maximum thickness of insulation  $h_D$  [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 460 - 10 - 30$   
 $h_{Dmax} = 420$


**ejotherm S1 and ejotherm S1 short**

**Product description**

Marking and dimension of the anchor sleeve ejotherm S1- large version;  
base material group: A, B, C, D; plastic screw

**Annex A 3**

**ejotherm S1 in base material group E**

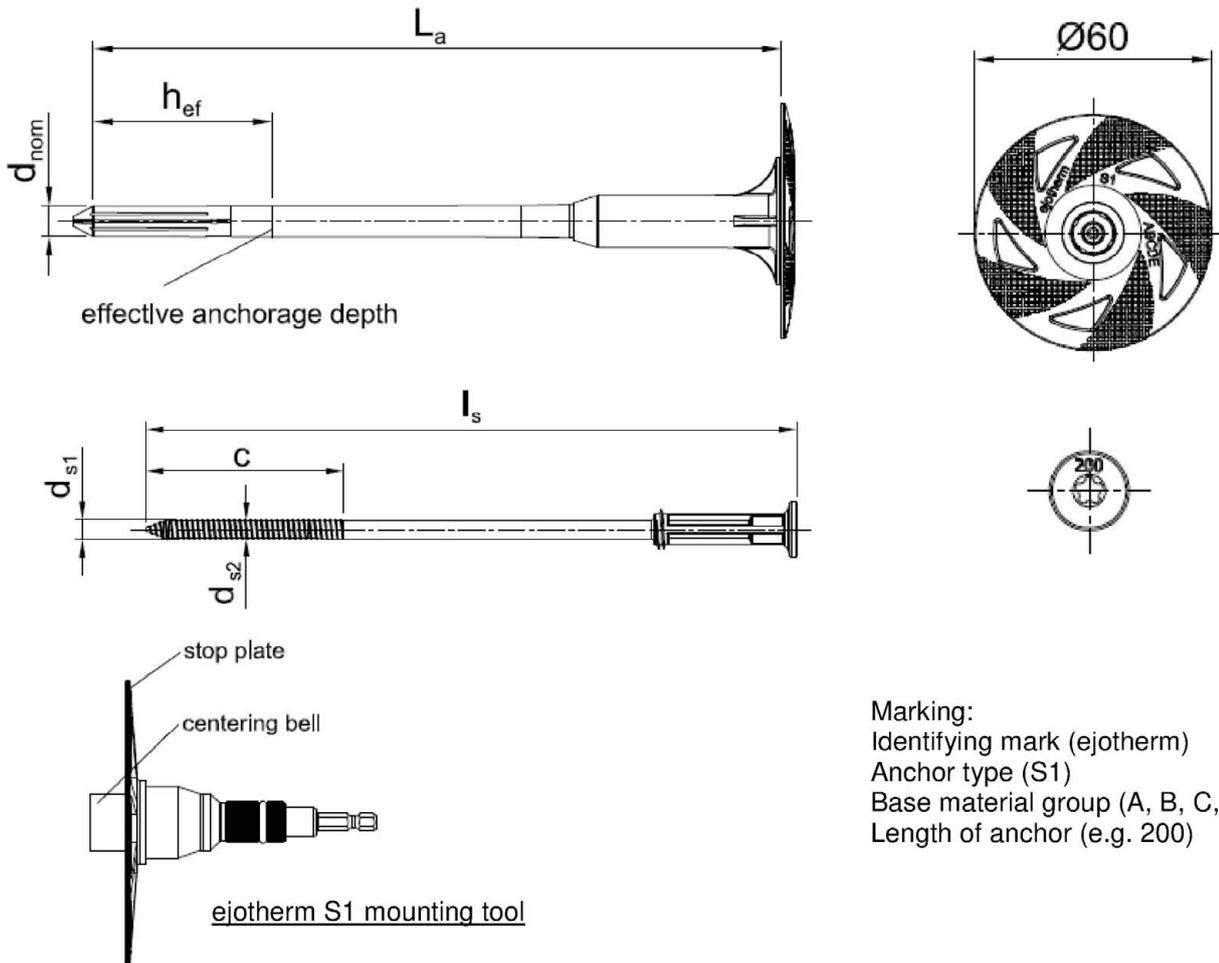

Marking:  
Identifying mark (ejotherm)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 200)

**Table A3: Dimensions**

Anchor Type	Anchor Sleeve			Plastic screw			min l <sub>s</sub> max l <sub>s</sub> [mm]
	d <sub>nom</sub> [mm]	h <sub>ef</sub> [mm]	min L <sub>a</sub> max L <sub>a</sub> [mm]	d <sub>s1</sub> [mm]	d <sub>s2</sub> [mm]	c [mm]	
ejotherm S1	8	50	100 300	5,7	5,0	55	100 300

Determination of maximum thickness of insulation h<sub>D</sub> [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 200 - 10 - 50$   
 $h_{Dmax} = 140$


**ejotherm S1 and ejotherm S1 short**

**Product description**

Marking and dimension of the anchor sleeve ejotherm S1; base material group: E;  
plastic screw

**Annex A 4**

**ejotherm S1 in base material group E – large version**

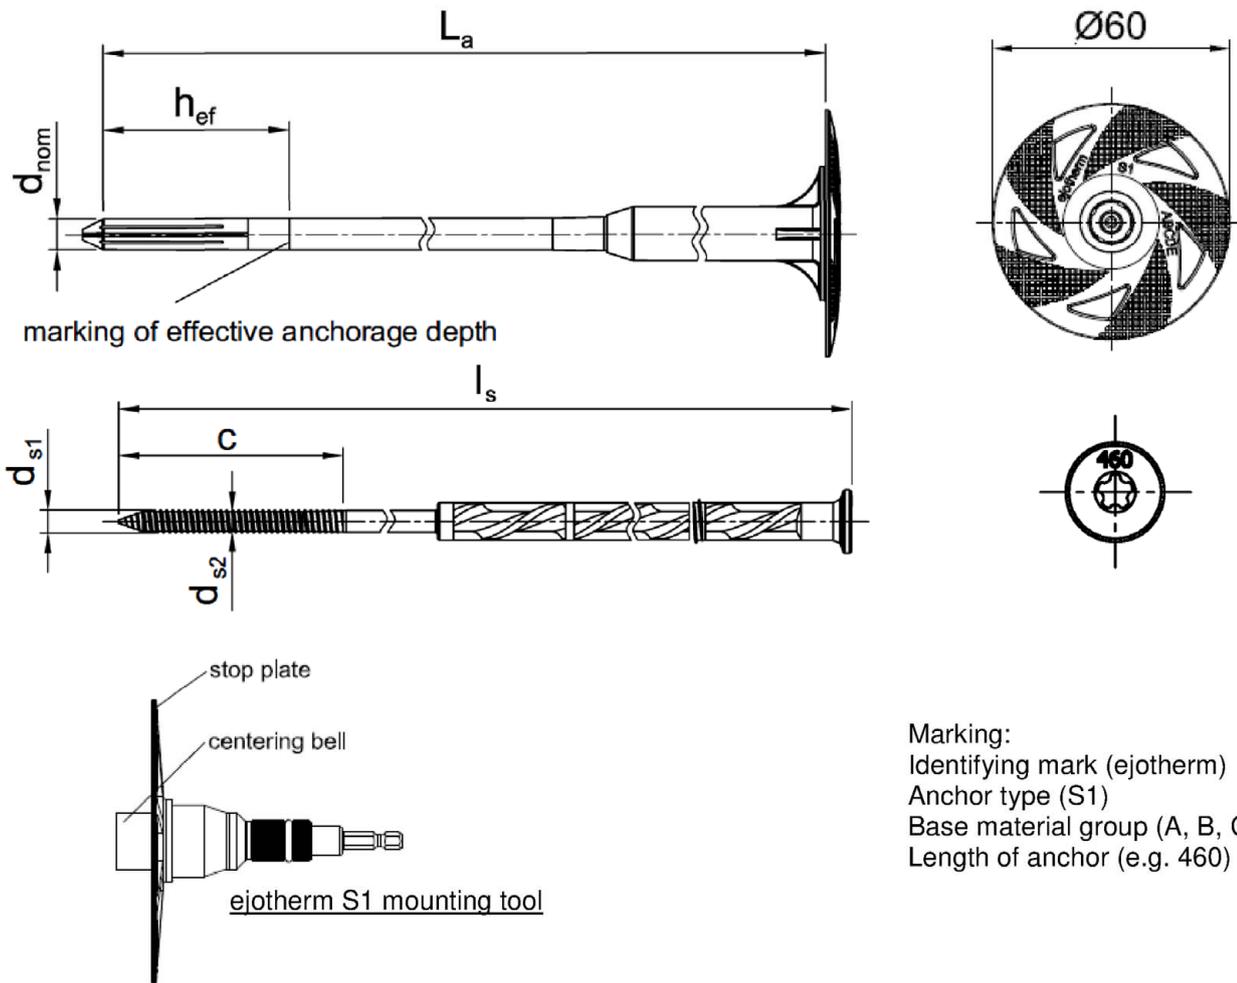

Marking:  
Identifying mark (ejotherm)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 460)

**Table A4: Dimensions**

Anchor Type	Anchor Sleeve			Plastic screw			min l <sub>s</sub> max l <sub>s</sub> [mm]
	d <sub>nom</sub> [mm]	h <sub>ef</sub> [mm]	min L <sub>a</sub> max L <sub>a</sub> [mm]	d <sub>s1</sub> [mm]	d <sub>s2</sub> [mm]	c [mm]	
ejotherm S1	8	50	320 460	5,7	5,0	55	320 460

Determination of maximum thickness of insulation h<sub>D</sub> [mm] ejotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 460 - 10 - 50$   
 $h_{Dmax} = 400$





**ejotherm S1 and ejotherm S1 short**

**Product description**

Marking and dimension of the anchor sleeve ejotherm S1- large version; base material group: E; plastic screw

**Annex A 5**

**ejothem S1 short in base material group A, B, C, D**

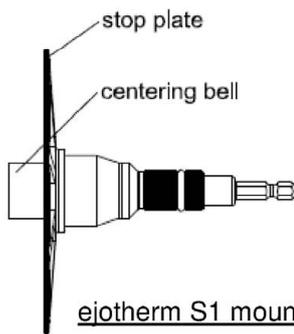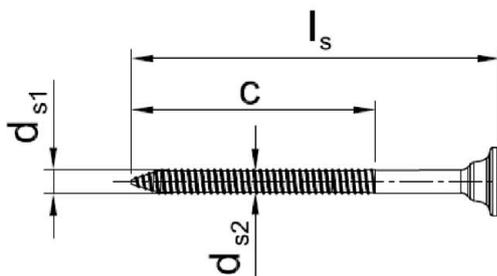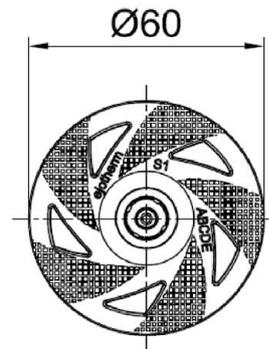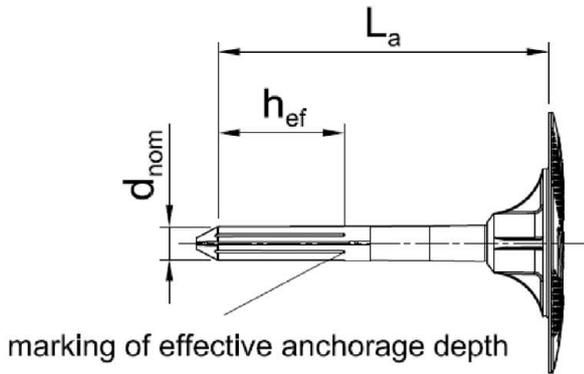

Marking:  
Identifying mark (ejothem)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 100)  
Marking (short)

**Table A5: Dimensions**

Anchor Type	Anchor Sleeve			Plastic screw			
	$d_{nom}$ [mm]	$h_{ef}$ [mm]	min $L_a$ max $L_a$ [mm]	$d_{s1}$ [mm]	$d_{s2}$ [mm]	$c$ [mm]	min $l_s$ max $l_s$ [mm]
ejothem S1 short	8	30	60 100	5,7	5,0	55	65 105

Determination of maximum thickness of insulation  $h_D$  [mm] ejothem S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 60 - 10 - 30$   
 $h_{Dmax} = 20$


**ejothem S1 and ejothem S1 short**

**Product description**



Marking and dimension of the anchor sleeve ejothem S1 short;  
base material group: A, B, C, D; plastic screw

**Annex A 6**


**eiotherm S1 short in base material group E**

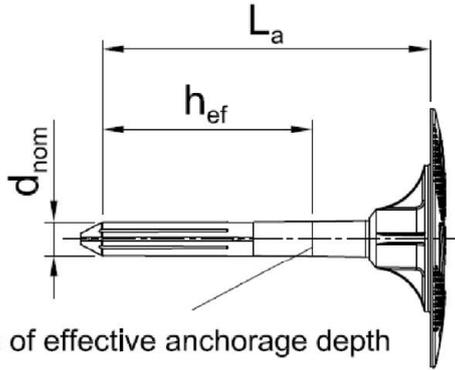

marking of effective anchorage depth

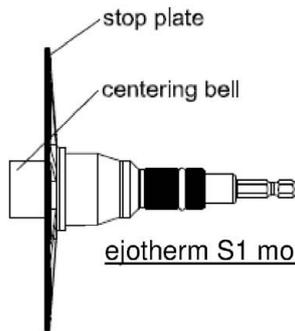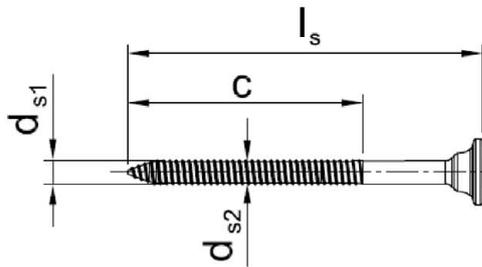

**eiotherm S1 mounting tool**

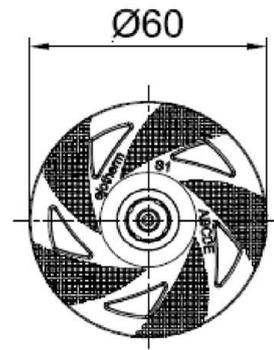

Marking:  
Identifying mark (eiotherm)  
Anchor type (S1)  
Base material group (A, B, C, D, E)  
Length of anchor (e.g. 100)  
Marking (short)

**Table A6: Dimensions**

Anchor Type	Anchor Sleeve			Plastic screw			
	d <sub>nom</sub> [mm]	h <sub>ef</sub> [mm]	min L <sub>a</sub> max L <sub>a</sub> [mm]	d <sub>s1</sub> [mm]	d <sub>s2</sub> [mm]	c [mm]	min l <sub>s</sub> max l <sub>s</sub> [mm]
eiotherm S1 short	8	50	80 100	5,7	5,0	55	85 105

Determination of maximum thickness of insulation h<sub>D</sub> [mm] eiotherm S1:

$$h_D = L_a - t_{tol} - h_{ef}$$

e.g.  $h_D = 80 - 10 - 50$   
 $h_{Dmax} = 20$

**eiotherm S1 and eiotherm S1 short**

**Product description**



Marking and dimension of the anchor sleeve eiotherm S1 short; base material group: E; plastic screw

**Annex A 7**

**Table A7: Materials ejotherm S1 / ejotherm S1 short**



Anchor plate	Polyethylene (virgin material) PE-HD nature, yellow, orange, red, blue, grey, white, green, anthracite
Anchor sleeve	Polyethylene (virgin material) PE-HD nature, yellow, orange, red, blue, grey, white, green, anthracite
Plastic screw	Polyamide (virgin material) PA 6 GF 50 colour: nature, black

**SBL 140 plus**

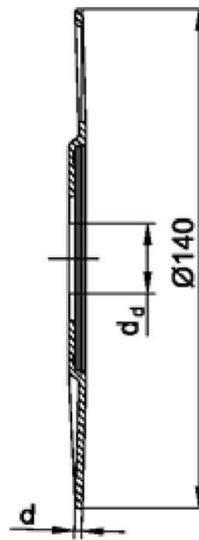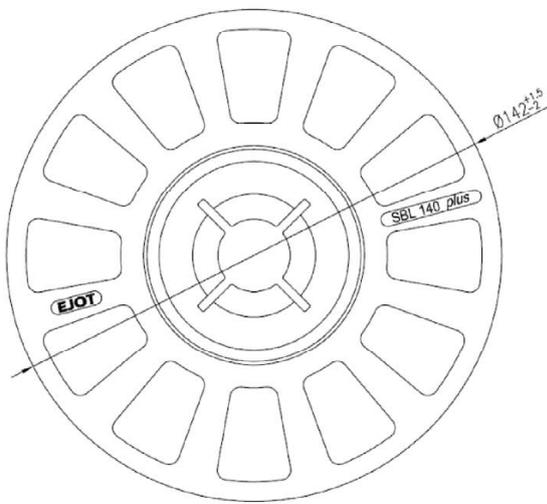

SBL 140 plus	
colour	nature
d <sub>d</sub> [mm]	21,0
d [mm]	2,0
Material	1) 2)

**VT 90**

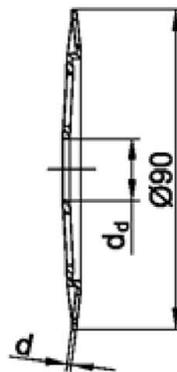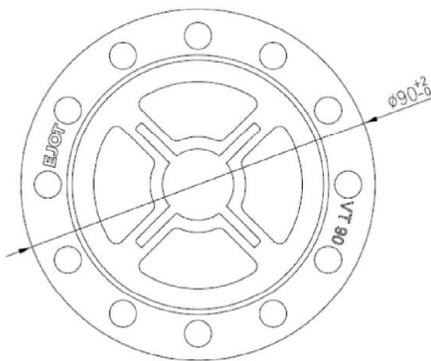

VT 90	
colour	nature
d <sub>d</sub> [mm]	18,5
d [mm]	1,2
Material	1) 2)

- 1) polyamide, PA 6
- 2) polyamide, PA GF 50

**ejotherm S1 and ejotherm S1 short**

**Product description**  
Materials and slip on plates

**Annex A 8**

### Specifications of intended use

**Anchorage subject to:**

- The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the thermal insulation composite system.

**Base materials:**

- Normal weight concrete (base material group A) according to Annex C 1.
- Solid masonry (base material group B), according to Annex C 1.
- Hollow or perforated masonry (base material group C), according to Annex C 1.
- Prefabricated reinforced components of lightweight aggregate concrete (LAC) (base material group D), according to Annex C 1.
- Autoclaved aerated concrete (base material group E), according to Annex C 1.
- For other base materials of base material groups A, B, C, D or E the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 51 edition December 2016.

**Temperature Range:**

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)

**Design:**

- The anchorages are designed under the responsibility of an engineer experienced in accordance and masonry work with the partial safety factors  $\gamma_m = 2,0$  and  $\gamma_F = 1,5$  if there are no other regulations.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Fasteners are only to be used for multiple fixings of thermal insulation composite systems.

**Installation:**

- Hole drilling by the drill modes according to Annex C 1.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature from 0°C to +40°C
- Exposure to UV due to solar radiation of the anchor not protected by rendering  $\leq 6$  weeks

<b>ejothem S1 and ejothem S1 short</b>	<b>Annex B 1</b>
<b>Intended use Specifications</b>	


**Table B1: Installation parameters**

Anchor type	ejotherm S1 / ejotherm S1 short		
	Base material group		
		A, B, C, D	E
Drill hole diameter	$d_0$ [mm] =	8	8
Cutting diameter of drill bit	$d_{cut}$ [mm] ≤	8,45	8,45
Depth of drilled hole to deepest point	$h_1$ [mm] ≥	40	60
Effective anchorage depth	$h_{ef}$ [mm] ≥	30	50

**Table B2: Anchor distances and dimensions of members**

Anchor type	ejotherm S1 / ejotherm S1 short		
Minimum spacing	$s_{min} \geq$ [mm]	100	
Minimum edge distance	$c_{min} \geq$ [mm]	100	
Minimum thickness of member	$h \geq$ [mm]	100	

Scheme of distance and spacing

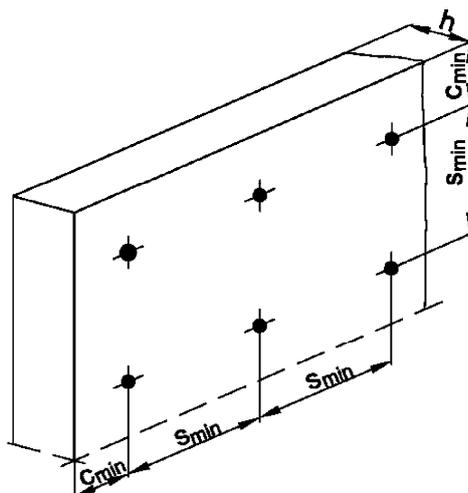


ejotherm S1 and ejotherm S1 short

**Intended use**  
Installations parameters,  
Edge distances and spacing

**Annex B 2**

**Installation instructions: ejothem S1**

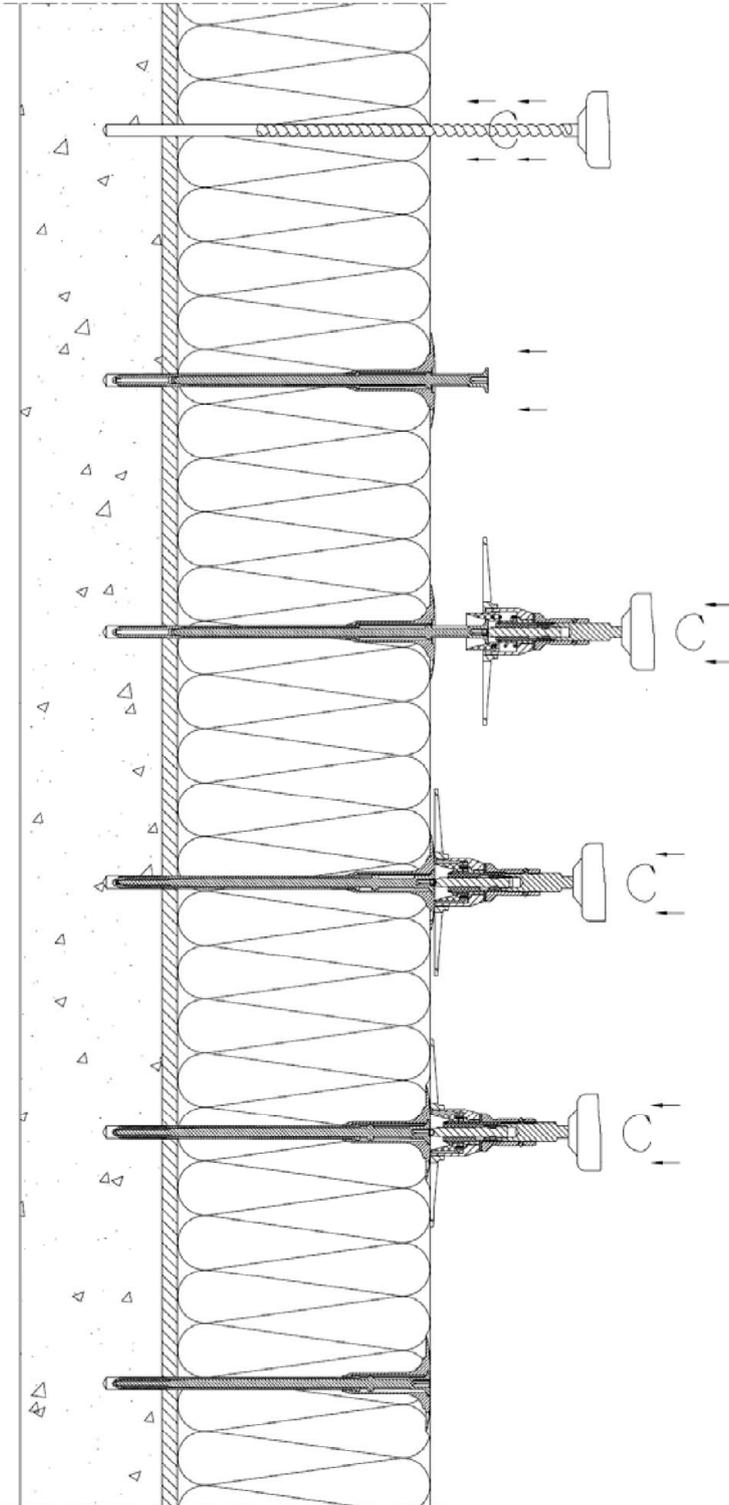

Drill the hole perpendicular to the substrate surface.  
Clean the drill hole 3x.

Place the anchor into the drill hole.  
The bottom side of the plate must be flush with the insulation.

Placing the mounting tool on the dowel screw

Mounting the screw

Top side of the anchor plate mounted flush with the insulation board surface. Assembly tool decoupled.


Installed conditions ejothem S1

**ejothem S1 and ejothem S1 short**

**Intended use**  
Installation instructions ejothem S1

**Annex B 3**

**Installation instructions: ejotherm S1 short**

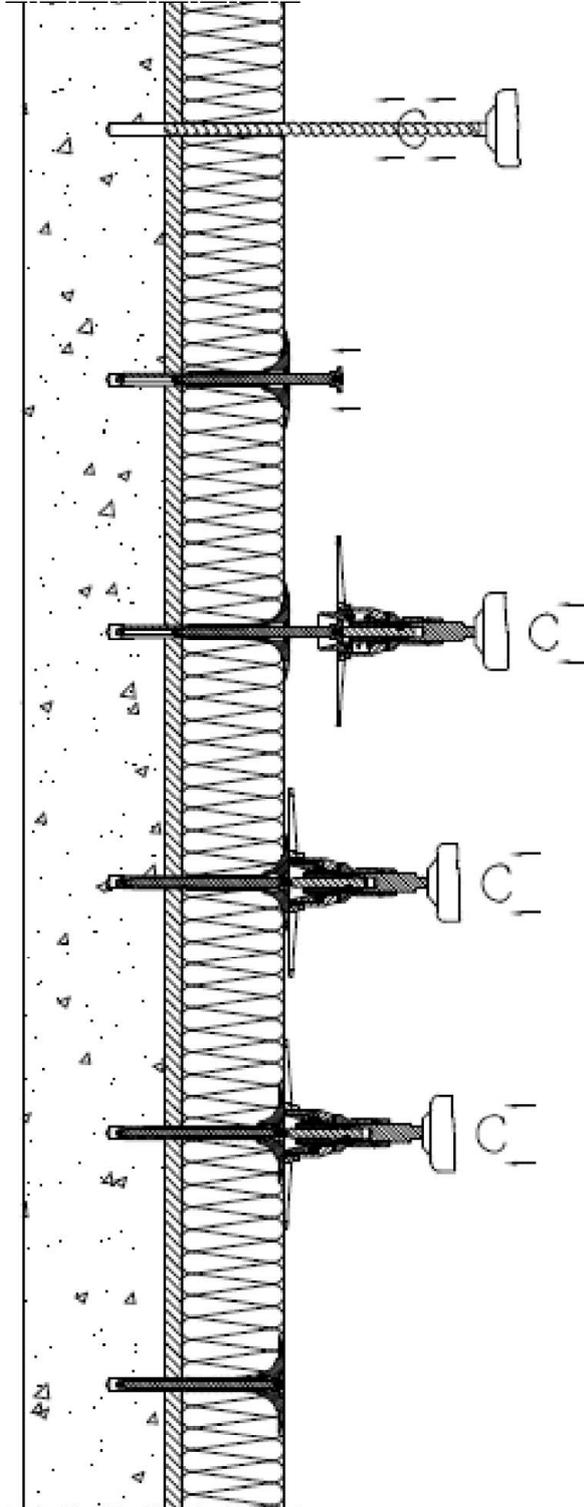

Drill the hole perpendicular to the substrate surface.  
Clean the drill hole 3x.

Place the anchor into the drill hole.  
The bottom side of the plate must be flush with the insulation.

Placing the mounting tool on the dowel screw

Mounting the screw

Top side of the anchor plate mounted flush with the insulation board surface. Assembly tool decoupled.

Installed conditions ejotherm S1

**ejotherm S1 and ejotherm S1 short**

**Intended use**  
Installation instructions, ejotherm S1 short

**Annex B 4**

<b>Table C1: Characteristic resistance to tension loads <math>N_{Rk}</math> in concrete and masonry for a single anchor in kN</b>						
Anchor type					ejothem S1	ejothem S1 short
Base materials	Bulk density $\rho$ [kg/dm <sup>3</sup> ]	minimum compressive strength $f_b$ [N/mm <sup>2</sup> ]	General remarks	Drill method	$N_{Rk}$ [kN]	$N_{Rk}$ [kN]
Concrete C12/15 – C50/60 EN 206-1:2000				hammer	1,5	1,5
Thin concrete members (e.g. weather resistant skin) Concrete C16/20 – C50/60 EN 206-1:2000			Thickness of the thin skin: 100 mm > h ≥ 40 mm	hammer	1,4	1,4
Clay bricks, Mz EN 771-1:2011	≥ 1,8	12	Vertically perforation up to 15 %.	hammer	1,5	1,5
Sand-lime solid bricks, KS EN 771-2:2011	≥ 1,8	12	Vertically perforation up to 15 %.	hammer	1,5	1,5
Vertically perforated clay bricks, HLz EN 771-1:201	≥ 1,6	20	Vertically perforation > 15 % and ≤ 50 %.	hammer	1,5 <sup>1)</sup>	1,5 <sup>1)</sup>
Sand-lime perforated bricks, KSL EN 771-2:201	≥ 1,6	12	Vertically perforation more than 15 %.	hammer	1,5 <sup>2)</sup>	1,5 <sup>2)</sup>
Lightweight concrete hollow blocks, Hbl EN 771-3:2011	≥ 1,2	6		hammer	0,9 <sup>3)</sup>	0,9 <sup>3)</sup>
lightweight aggregate concrete, LAC EN 1520:2011 / EN 771-3:2011	≥ 0,7	4		rotary	0,9	0,9
Autoclaved aerated concrete EN 771-4:2011	≥ 0,55	4		rotary	0,75	0,75
<b>ejothem S1 and ejothem S1 short</b>					<b>Annex C 1</b>	
<b>Performances</b> Characteristic resistance						

<sup>1)</sup> The value applies only for outer web thickness ≥ 25 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

<sup>2)</sup> The value applies only for outer web thickness ≥ 20 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

<sup>3)</sup> The value applies only for outer web thickness ≥ 40 mm; otherwise the characteristic resistance shall be determined by job site pull-out tests.

**Table C2: Point thermal transmittance according EOTA Technical Report TR 025:2016-05**

anchor type	insulation thickness $h_D$ [mm]	point thermal transmittance $\chi$ [W/K]
ejothem S1	80 – 460	0,000
ejothem S1 short	20 – 60	..1)

1) no performance assessed

**Table C3: Plate stiffness according EOTA Technical Report TR 026:2016-05**

anchor type	diameter of the anchor plate [mm]	load resistance of the anchor plate [mm]	plate stiffness [kN/mm]
ejothem S1	60	1,5	0,7
ejothem S1 short	60	1,5	0,7

**Table C4: Displacements ejothem S1 / ejothem S1 short**

Base materials	Bulk density $\rho$ [kg/dm <sup>3</sup> ]	minimum compressive strength $f_b$ [N/mm <sup>2</sup> ]	Tension load N [kN]	Displacements $\Delta\delta_N$ [mm]	
				$L_a =$ 60 – 300 mm	$L_a =$ 320 – 460 mm
Concrete C12/15 – C50/60 EN 206-1:2000			0,5	0,6	0,9
Thin concrete members (e.g. weather resistant skin) Concrete C16/20 – C50/60 EN 206-1:2000			0,45	0,6	0,9
Clay bricks, Mz EN 771-1:2011	$\geq 1,8$	12	0,5	0,6	0,9
Sand-lime solid bricks, KS EN 771-2:2011	$\geq 1,8$	12	0,5	0,6	0,9
Vertically perforated clay bricks, HLz; EN 771-1:2011	$\geq 1,6$	20	0,5	0,6	0,9
Sand-lime perforated bricks, KSL; EN 771-2:2011	$\geq 1,6$	12	0,5	0,6	0,9
Lightweight concrete hollow blocks, Hbl EN 771-3:2011	$\geq 1,2$	6	0,3	0,4	0,6
Lightweight aggregate concrete, LAC; EN 1520:2011 / EN 771-3:2011	$\geq 0,7$	4	0,3	0,4	0,6
Autoclaved aerated concrete EN 771-4:2011	$\geq 0,55$	4	0,25	0,3	0,4

**ejothem S1 and ejothem S1 short**

**Performances**  
Point thermal transmittance, plate stiffness, displacements

**Annex C 2**