

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-20/0529
of 16 July 2021

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Peikko Bolda® Column Shoe

Product family
to which the construction product belongs

Column Shoe

Manufacturer

PEIKKO GROUP CORPORATION
Voimakatu 3
15101 Lahti
FINNLAND

Manufacturing plant

Peikko Herstellwerke
Peikko Manufacturing plants

This European Technical Assessment
contains

12 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 200102-00-0302, Edition 06/2020

This version replaces

ETA-20/0529 issued on 14 December 2020

European Technical Assessment

ETA-20/0529

English translation prepared by DIBt

Page 2 of 12 | 16 July 2021

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part**1 Technical description of the product**

The Peikko Bolda® column shoe consists of a base plate and a side plate of steel, which are welded together. Anchor bars made of reinforcing steel are welded to the side plate.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The column shoes serve as connectors of e.g. between a reinforced concrete column and a foundation or between two reinforced concrete columns or between two reinforced concrete beams.

The performances given in Section 3 are only valid if the column shoe is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the column shoe of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment**3.1 Mechanical resistance and stability (BWR 1)**

| Essential characteristic | Performance |
|---------------------------------------|-------------|
| Resistance to tension and shear loads | See Annex C |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|---|-------------|
| Reaction to fire | Class A1 |
| Resistance to fire – steel temperature time table under fire exposure | See Annex C |

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 200102-00-0302 the applicable European legal act is Commission Decision 2000/606/EC.

The system to be applied is: 2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 16 July 2021 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Baderschneider

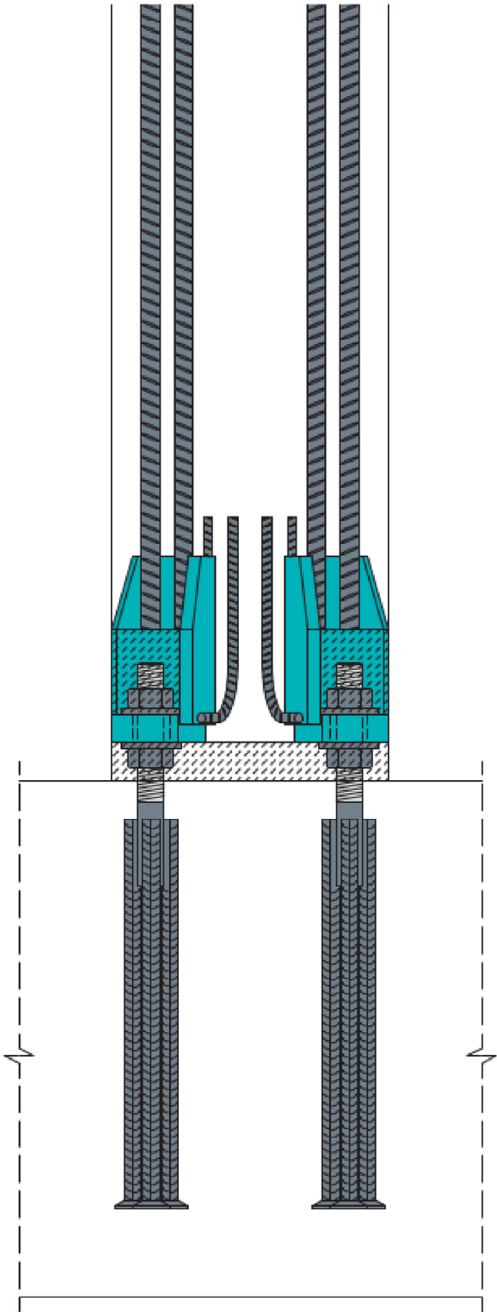


Figure A1. Application example

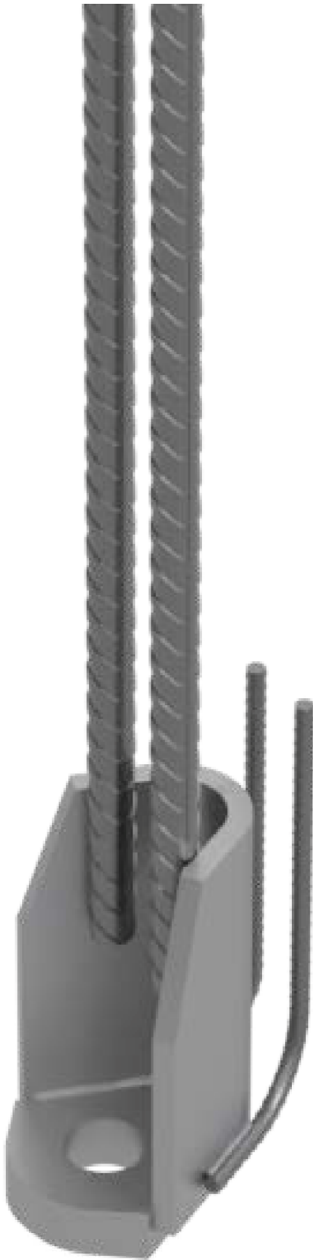


Figure A2. BOLDA® Column Shoe

Electronic copy of the ETA by DIBt: ETA-20/0529

| | |
|---|----------|
| Peikko BOLDA® Column Shoe | Annex A1 |
| Product description Application example | |

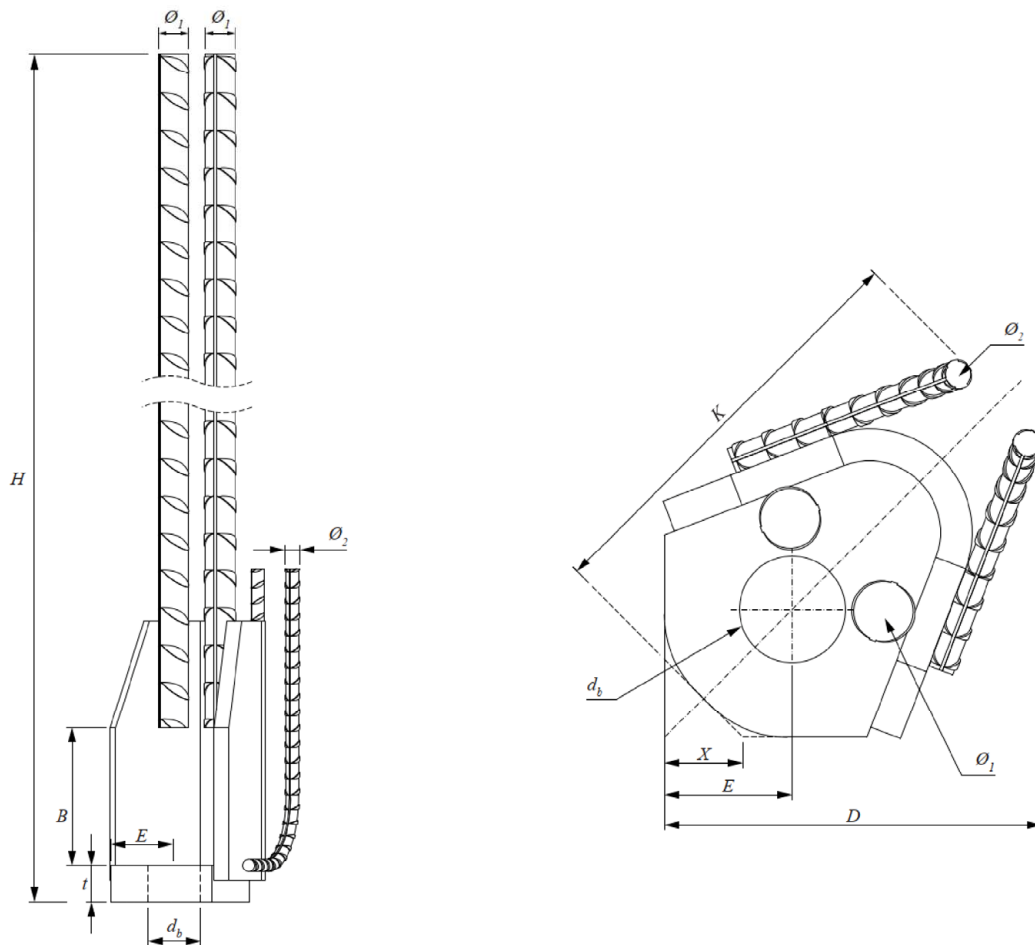


Figure A3. Dimensions of BOLDA® Column Shoes

Table A1: Dimensions All values are specified in mm units.

| Column Shoe | BOLDA® 30 | BOLDA® 36 | BOLDA® 39 | BOLDA® 45 | BOLDA® 52 |
|-----------------|-----------|-----------|-----------|-----------|-----------|
| H | 1058 | 1365 | 1600 | 1852 | 2190 |
| t | 30 | 35 | 40 | 50 | 55 |
| B | 100 | 130 | 130 | 140 | 170 |
| E | 50 | 60 | 60 | 60 | 70 |
| db | 40 | 50 | 55 | 60 | 70 |
| $\varnothing 1$ | 25 | 28 | 28 | 32 | 40 |
| $\varnothing 2$ | 10 | 12 | 14 | 16 | 16 |
| X | 30 | 37 | 37 | 37 | 42 |
| D | 153 | 178 | 195 | 217 | 245 |
| K | 173 | 200 | 220 | 250 | 269 |

Peikko BOLDA® Column Shoe

Product description
Dimensions

Annex A2

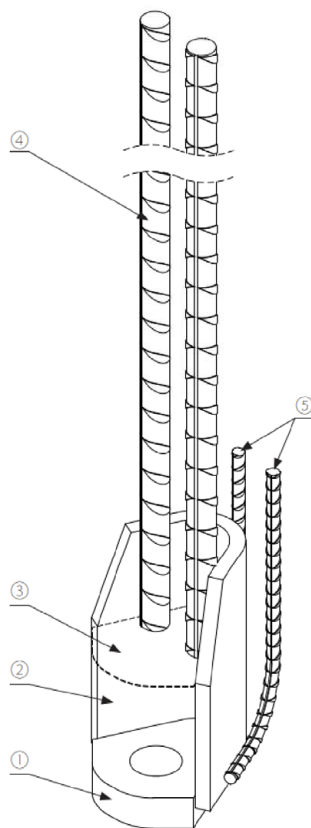


Figure A4. Materials of BOLDA® Column Shoes

Table A2: Materials The steel plates and the the fillet material shall meet the requirements of EN 10025:2019

| Item | Component | Steel | Optional Steel | Standards |
|------|--------------------|----------|--------------------|---|
| 1 | Base plate | S355J2+N | S355K2+N; S420J2+N | EN 10025:2019 |
| 2 | Side plate | S355J2+N | S355K2+N; S420J2+N | EN 10025:2019 |
| 3 | Top plate (option) | S235JR | DC01 | EN 10025:2019, EN 10130:2006 |
| 4 | Anchor bar | Table A3 | B500C | EN 10080:2005 and EN 1992-1-1:2004+AC10, Annex C |
| 5 | Rear bar | Table A3 | B500C | EN 10080:2005 and EN 1992-1-1:2004+AC10, Annex C |

Table A3. Minimum requirements for reinforcing steel.

| | |
|------------|--|
| General | All requirements set in EN 10080:2005 and EN 1992-1-1:2004+AC10, Annex C for the reinforcing steel of Class B or Class C, strength class 500 MPa |
| Additional | The steel shall be weldable |

Peikko BOLDA® Column Shoe

Product description
Materials

Annex A3

Specifications of intended use

Design value of loads

- Static and quasi-static load.
- Tension loads, compression loads and shear loads or any combination thereof.

Anchoring base material

- The grade of the reinforced concrete used for the column shall be in the range C35/45 to C70/85 according to EN 1992-1-1:2004 + AC:2010.
- In the region of the BOLDA® Column Shoes the concrete may be cracked or uncracked.

Use conditions (environmental conditions)

- Normal applications when BOLDA® Column Shoes are installed normally to the concrete surface without any additional measures or surface treatments and when applications fall within the scope of the EN 1992-1-1:2004+AC10 series. In applications where particular special aggressive considerations apply, e.g. marine environment or chemical exposure environment, modifications can be necessary.
- The European standard EN 1992-1-1:2004 + AC:2010, section 4 applies to BOLDA® Column Shoes, that are planned to be installed with concrete cover.
- The lowest temperature in use is -20°C.

Design

- The dimensioning of column shoes is carried out under the responsibility of an engineer experienced in the field of structural design and concrete constructions.
- The design is based on the Technical Report TR 068: *Design of Structural Connections with Column Shoes*.
- Verifiable calculations and construction drawings shall be made by taking into account the actions to be transferred.
- The position of the column shoes including the reinforcement required according to Annex C has to be specified on the construction drawings and execution specifications.
- The splice laps between main reinforcement bars and anchor bars of BOLDA® Column Shoes are designed according to the EN 1992-1-1:2004 + AC:2010.
- The dimensioning and design of connected structural concrete members shall be done according to the EN 1992-1-1:2004 + AC:2010.
- The load bearing resistances of the column connections with BOLDA® Column Shoes under fire exposure is based on the Technical Report TR 068: *Design of Structural Connections with Column Shoes*.

Peikko BOLDA® Column Shoe

Intended use
Specifications

Annex B1

Installation

- Installation of the BOLDA® Column Shoes in accordance with Technical Manual of BOLDA® Column Shoes is carried out by appropriately qualified workers under the supervision of the person responsible for technical matters on site.
- Usage of the BOLDA® Column Shoes as supplied by the manufacturer without any manipulations, repositioning or exchanging of the components.
- Installation of the BOLDA® Column Shoes in accordance with the manufacturer's specifications given in Annex B3 and Technical Manual of BOLDA® Column Shoes
- BOLDA® Column Shoes have to be fixed to the formwork so that no movement occurs during the time of laying the main and supplementary reinforcement and casting and compacting the concrete.
- Correct and proper compaction of the concrete in the area of the BOLDA® Column Shoes.
- The BOLDA® Column Shoes have to be protected against penetration of concrete, water and oil.
- The spacing and clear distances between BOLDA® Column Shoes must be selected according to EN 1992-1-1:2004+AC10 and shall be such that the concrete can be placed and compacted satisfactorily for the development of adequate bond.
- Examples of spacings and arrangements of BOLDA® Column Shoes are given in Fig. B1 and Table B1.
- The BOLDA® Column Shoes may be used in any cross section of concrete columns, for example: square, rectangle, L-form, oval and circle.

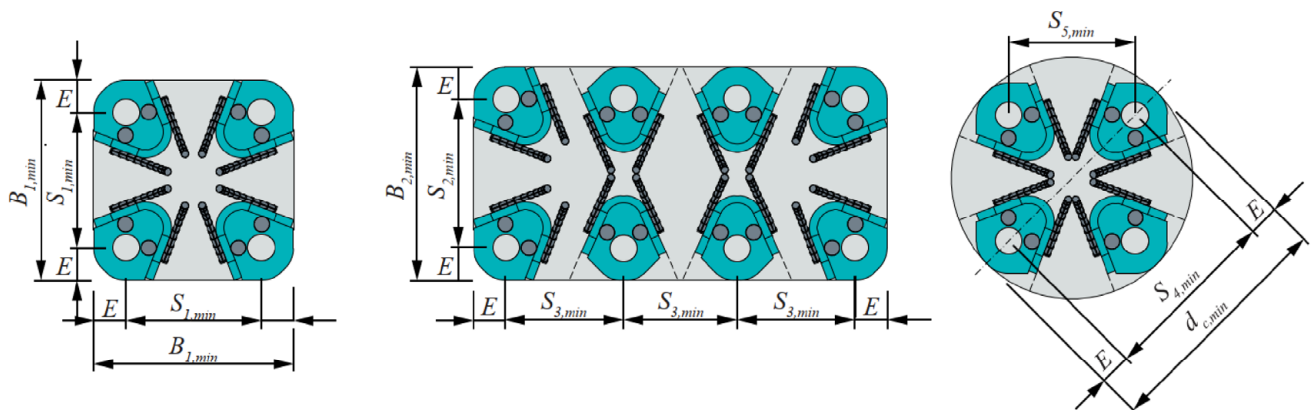


Figure B1. Examples of geometries and minimum spacings of BOLDA® Column Shoes

Table B1: Minimum distances

All values are specified in mm units.

| Column Shoe | BOLDA® 30 | BOLDA® 36 | BOLDA® 39 | BOLDA® 45 | BOLDA® 52 |
|--------------------|-----------|-----------|-----------|-----------|-----------|
| B _{1,min} | 310 | 360 | 395 | 440 | 500 |
| B _{2,min} | 350 | 405 | 450 | 510 | 550 |
| S _{1,min} | 210 | 240 | 275 | 320 | 360 |
| S _{2,min} | 250 | 285 | 330 | 390 | 410 |
| S _{3,min} | 160 | 180 | 205 | 230 | 275 |
| S _{4,min} | 300 | 340 | 390 | 455 | 510 |
| S _{5,min} | 212 | 240 | 276 | 322 | 361 |
| E | 50 | 60 | 60 | 60 | 70 |
| d _{c,min} | 400 | 460 | 510 | 575 | 650 |

Peikko BOLDA® Column Shoe


Intended use

Installation and spacing parameters

Annex B2


Installation instructions

1. Positioning

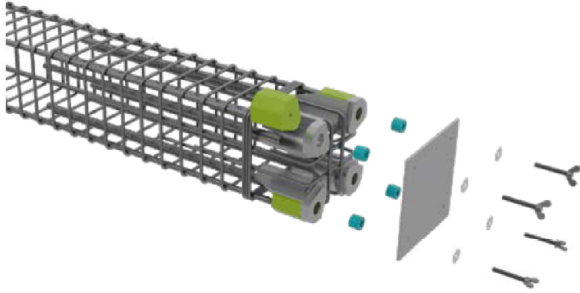


1. The BOLDA® Column Shoes are placed into the reinforcement of the column into planned location and fixed through the holes of their base plates to the end plate of the formwork with recess boxes and wing screws.
2. Supplementary reinforcement must be placed at the area of column base, according to drawings
3. Fasten and tie the anchor bars of the BOLDA® Column Shoes to the main reinforcement of column

2. Casting and compacting

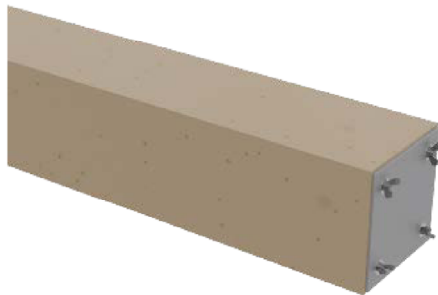

1. Carefully pour in concrete paying attention to built-in BOLDA® Column Shoes and reinforcements
 2. Compact concrete properly, avoid contact between vibrating device and BOLDA® Column Shoes and reinforcements
- Do not move or damage BOLDA® Column Shoes

3. Removal from formwork

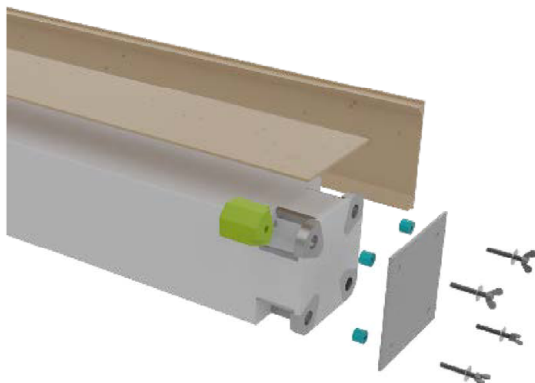

1. Loosen the wing screws of the BOLDA® Column Shoes
2. Remove formwork
3. Check the adjacent concrete for gravel pockets etc.
4. Remove the concrete slurry on the column shoes.




Peikko BOLDA® Column Shoe

Intended use
Installation instructions

Annex B3




Installation instructions - precast element

1. Column is installed directly on the pre-leveled washers and the lower nuts
2. Upper washers are installed on the base plate and upper nuts are screwed on the bolts
3. After the upper nuts are tightened, the crane hook and lifting slings can be released

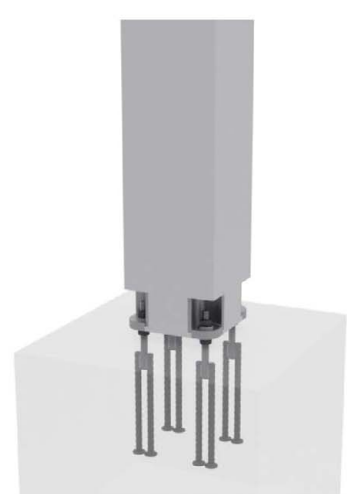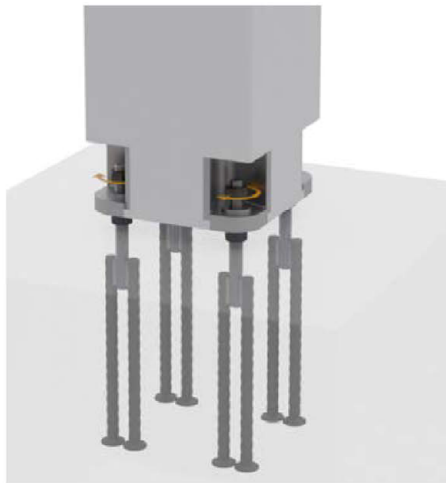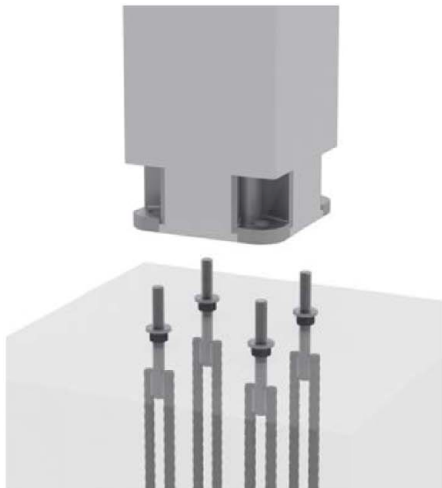

NOTE ! Joint has to be grouted with non-shrink mortar (grout) and grout has to reach the designed strength before the column is loaded by other structures.

4. Install formwork for grouting joint and recesses, joint has to be grouted with non-shrink mortar (grout)
5. Alternative (filling pipe for grouting) where grouting is aligned with column face
6. The finalized connection after grouting has hardened

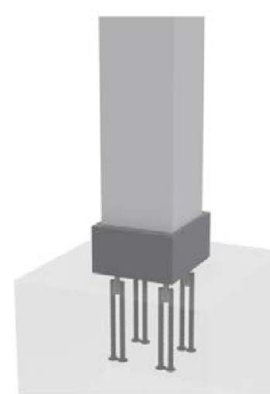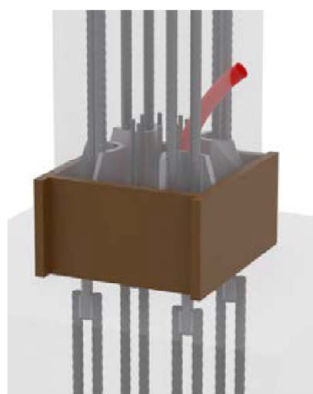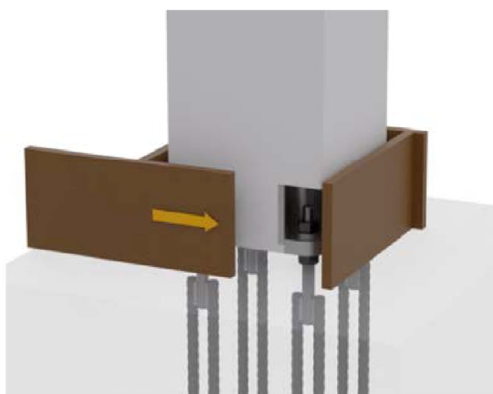

Peikko BOLDA® Column Shoe

Intended use
Installation instructions

Annex B4

Table C1: Resistances to tension, compression, and shear loads under static and quasi-static loading

| | | BOLDA® 30 | BOLDA® 36 | BOLDA® 39 | BOLDA® 45 | BOLDA® 52 |
|---------------------------|-----------------|----------------------|----------------------|----------------------|----------------------|----------------------|
| Steel failure | | | | | | |
| Resistance | $N_{Rd,s}$ [kN] | 299 | 436 | 521 | 697 | 938 |
| Bending resistance factor | η_d [-] | 1,0 | | | | |
| Bending stiffness factor | k_L [-] | 1,0 | | | | |
| Shear resistance factor | k_s [-] | 1,0 | | | | |

Note:

Laps with the welded reinforcing steel bars (Pos. 4 according to Annex A3) are designed according EN 1992-1-1:2004+AC10.

Table C2: Steel temperature timetable under fire exposure - $T_{cr}(t_i)$ [°C]

| Time | BOLDA® 30 | BOLDA® 36 | BOLDA® 39 | BOLDA® 45 | BOLDA® 52 |
|-------------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|-----------------------------|
| t_i [min] | Minimum column size 310x310 | Minimum column size 360x360 | Minimum column size 395x395 | Minimum column size 440x440 | Minimum column size 500x500 |
| 30 | 206 | 171 | 182 | 178 | 147 |
| 60 | 387 | 336 | 349 | 340 | 293 |
| 90 | 530 | 475 | 488 | 470 | 412 |
| 120 | 641 | 588 | 594 | 571 | 508 |

Peikko BOLDA® Column Shoe

Performances

Resistances to tension and shear loads under static and quasi-static loading
Fire resistances

Annex C