

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments

★ ★ ★
★ Designated
according to
Article 29 of Regula-
tion (EU) No 305/2011
and member of EOTA
(European Organi-
sation for Technical
Assessment)
★ ★ ★
★ ★

European Technical Assessment

ETA-21/0267
of 27 August 2021

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Trade name of the construction product

Product family
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment
contains

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

Deutsches Institut für Bautechnik

fischer Injection system FIS V Zero for use in masonry

Metal Injection anchors for use in masonry

fischerwerke GmbH & Co. KG
Otto-Hahn-Straße 15
79211 Denzlingen
DEUTSCHLAND

fischerwerke

40 pages including 3 annexes which form an integral part
of this assessment

EAD 330076-01-0604, Edition 05/2021

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The fischer injection system FIS V Zero for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with injection mortar fischer FIS V Zero, a perforated sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|---|
| Characteristic resistance to steel failure of a single anchor under tension loading | See Annexes C 1 and C 3 |
| Characteristic resistance to steel failure of a single anchor under shear loading with and without lever arm | See Annex C 2 and C 3 |
| Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading, Reduction factor | See Annex C 5, C 7, C 10, C 13, C 15 and C 16 |
| Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading | See Annex C 5, C 7, C 11, C 13 and C 15 |
| Characteristic resistance to brick breakout failure of an anchor group under tension loading | See Annex B 13, B 14, C 4, C 6, C 8, C 9, C 12 and C 14 |
| Characteristic resistance to local brick failure or brick edge failure of an anchor group under shear loading | See Annex B 13, B 14, C 4, C 6, C 8, C 9, C 12 and C 14 |
| Edge distances, spacing, member thickness | See Annex B 2, B 13, C 4, C 6, C 8, C 9, C 12 and C 14 |
| Displacements under tension and shear loading | See Annex C 17 |
| Maximum installation torque | See Annex C 4, C 6, C 8, C 9, C 12 and C 14 |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|---|-------------------------|
| Reaction to fire | Class A1 |
| Resistance to fire under tension and shear loading with and without lever arm, minimum edge distances and spacing | No performance assessed |

3.3 Hygiene, health and the environment (BWR 3)

| Essential characteristic | Performance |
|--|-------------------------|
| Content, emission and/or release of dangerous substances | No performance assessed |

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330076-01-0604 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 27 August 2021 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Baderschneider


Installation conditions part 1

Anchor rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned installation:

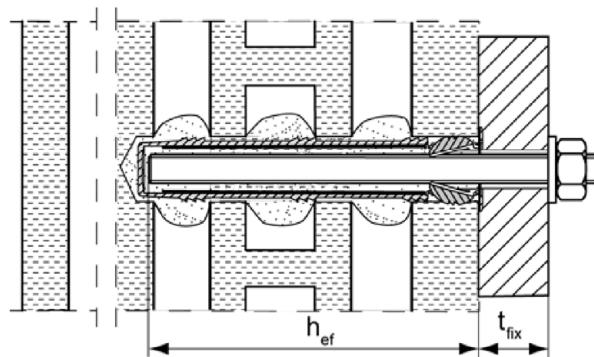


Installation with render bridge

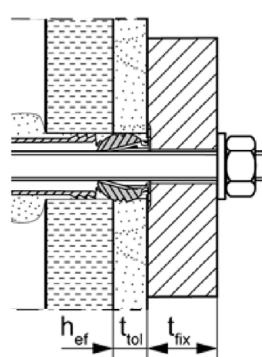


Size of the perforated sleeve:

FIS H 12x50 K FIS H 16x85 K FIS H 20x85 K
FIS H 12x85 K FIS H 16x130 K FIS H 20x130 K

Push through installation:

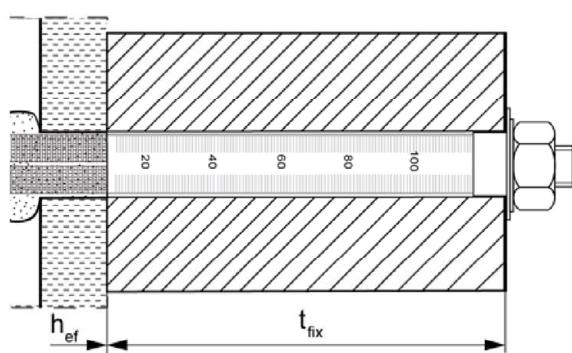

Installation with render bridge

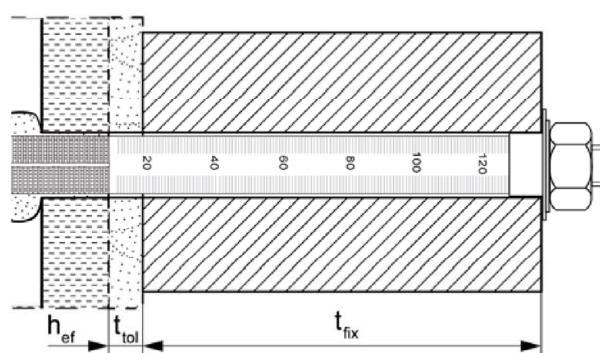


Size of the perforated sleeve:


FIS H 18x130/200 K FIS H 22x130/200 K

Internal threaded anchor FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

Pre-positioned installation:

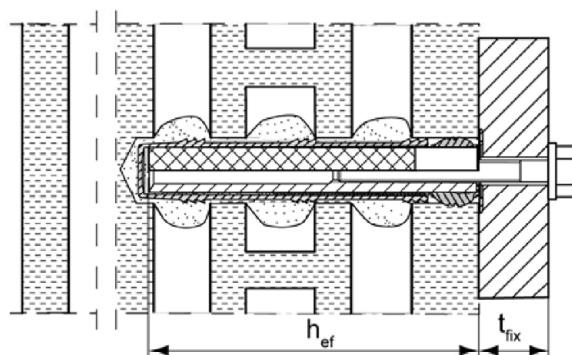

Installation with render bridge

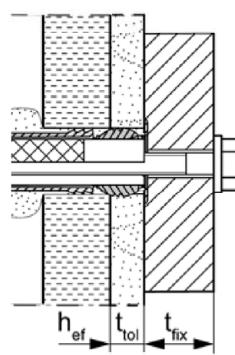

Figures not to scale

h_{ef} = effective embedment depth

t_{fix} = thickness of fixture

t_{tol} = thickness of unbearing layer (e.g. plaster)

fischer injection system FIS V Zero for masonry

Product description


Installation conditions part 1,
Anchor rods and internal threaded anchor with perforated sleeve

Annex A 1



Installation conditions part 2

Anchor rods without perforated sleeve FIS H K; installation in solid brick masonry

Pre-positioned installation:

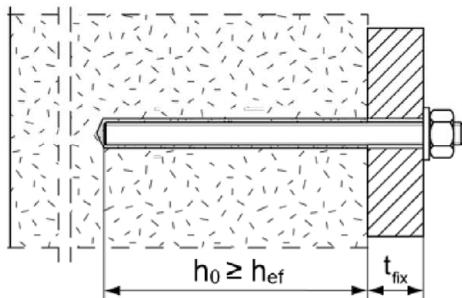


Push through installation: Annular gap filled with mortar




Installation with render bridge

Internal threaded anchors FIS E without perforated sleeve FIS H K; installation in solid brick masonry

Pre-positioned installation:

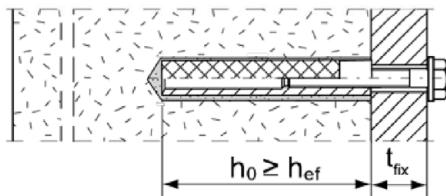

Installation with render bridge

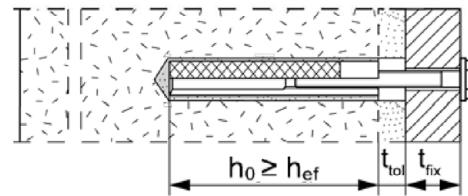

Figures not to scale

h_0 = depth of drill hole

t_{tol} = thickness of unbearing layer (e.g. plaster)

h_{ef} = effective embedment depth

t_{fix} = thickness of fixture

fischer injection system FIS V Zero for masonry

Product description

Installation conditions part 2,

Anchor rods and internal threaded anchor without perforated sleeve




Annex A 2

Overview system components part 1

Injection cartridge (shuttle cartridge) with sealing cap

Size: 360 ml, 825 ml



Imprint: fischer FIS V Zero, processing notes, shelf-life, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume

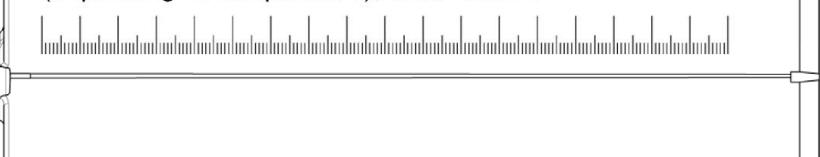

Injection cartridge (coaxial cartridge) with sealing cap


Size: 100 ml, 150 ml, 300 ml, 380 ml, 400 ml, 410 ml

Imprint: fischer FIS V Zero, processing notes, shelf-life, piston travel scale (optional), curing time and processing time (depending on temperature), size, volume



Static mixer MR Plus or FIS JMR (only 825ml) and extension tube


Static mixer MR Plus




Static mixer JMR Plus




Extension tube



Cleaning brush BS

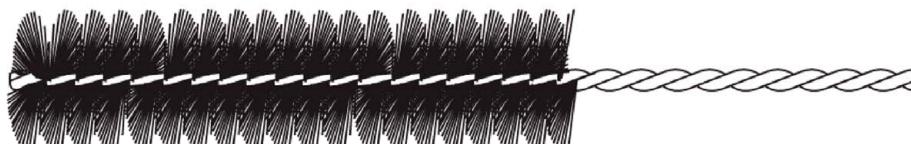

Blow-out pump ABG or ABP

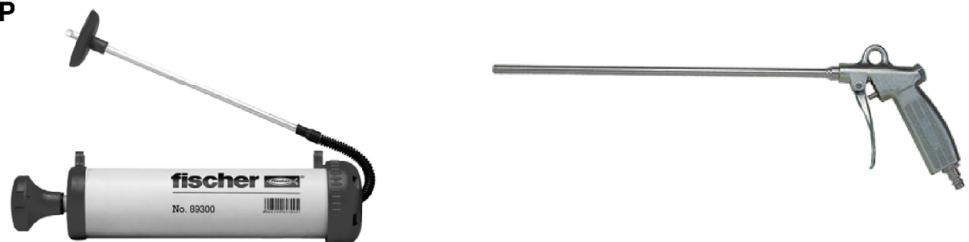

Figures not to scale

fischer injection system FIS V Zero for masonry


Product description

Overview system components part 1: cartridge / static mixer / cleaning tools

Annex A 3

Overview system components part 2

fischer anchor rod




Size: M8, M10, M12, M16

Internal threaded anchor FIS E



Size: 11x85 M8
15x85 M10 / M12

Perforated sleeve FIS H K




Size: FIS H 12x50 K
FIS H 12x85 K
FIS H 16x85 K
FIS H 20x85 K



Size: FIS H 16x130 K
FIS H 20x130 K

Perforated sleeve FIS H K (push through installation)



Size:
FIS H 18x130/200 K
FIS H 22x130/200 K

Washer



Hexagon nut



Figures not to scale

fischer injection system FIS V Zero for masonry

Product description

Overview system components part 2: Metal parts / perforated sleeves

Annex A 4

Table A5.1: Materials

| Part | Designation | Material | | |
|---|--|---|---|--|
| 1 | Injection cartridge | Mortar, hardener; filler | | |
| Steel grade | | Steel | Stainless steel R | High corrosion-resistant steel HCR |
| | | zinc plated | acc. to EN 10088-1:2014 Corrosion resistance class CRC III acc. to EN 1993-1-4:2015 | acc. to EN 10088-1:2014 Corrosion resistance class CRC V acc. to EN 1993-1-4:2015 |
| 2 | Anchor rod | Property class 4.6; 4.8; 5.8 or 8.8; EN ISO 898-1: 2013 zinc plated $\geq 5\mu\text{m}$, ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised EN ISO 10684:2004 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation | Property class 50, 70 or 80 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; 1.4062; 1.4662; 1.4462; EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation | Property class 50 or 80 EN ISO 3506-1:2020 or property class 70 with $f_{yk} = 560 \text{ N/mm}^2$ 1.4565; 1.4529 EN 10088-1:2014 $f_{uk} \leq 1000 \text{ N/mm}^2$ $A_5 > 8\%$ fracture elongation |
| 3 | Washer ISO 7089:2000 | zinc plated $\geq 5\mu\text{m}$, ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised EN ISO 10684:2004 | 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 | 1.4565; 1.4529 EN 10088-1:2014 |
| 4 | Hexagon nut | Property class 5 or 8; EN ISO 898-2:2012 zinc plated $\geq 5\mu\text{m}$, ISO 4042:2018 Zn5/An(A2K) or hot-dip galvanised ISO 10684:2004 | Property class 50, 70 or 80 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 | Property class 50, 70 or 80 EN ISO 3506-1:2020 1.4565; 1.4529 EN 10088-1:2014 |
| 5 | Internal threaded anchor FIS E | Property class 5.8; EN 10277-1:2008-06 zinc plated $\geq 5\mu\text{m}$, ISO 4042:2018 Zn5/An(A2K) | Property class 70 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2020 1.4565; 1.4529 EN 10088-1:2014 |
| 6 | Commercial standard screw or threaded rod for internal threaded anchor FIS E | Property class 5.8 or 8.8; EN ISO 898-1:2013 zinc plated $\geq 5\mu\text{m}$, ISO 4042:2018 Zn5/An(A2K) | Property class 70 EN ISO 3506-1:2020 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362; EN 10088-1:2014 | Property class 70 EN ISO 3506-1:2020 1.4565; 1.4529 EN 10088-1:2014 |
| 7 | Perforated sleeve and centring sleeve | PP / PE | | |
| fischer injection system FIS V Zero for masonry | | | | |
| Product description Materials | | | | Annex A 5 |

Specifications of intended use (part 1)

Table B1.1: Overview installation and use

| | | fischer injection system FIS V Zero for masonry | |
|---|---|---|---|
| Hole drilling with hammer drill mode |  | | all bricks |
| Hole drilling with rotary drill mode |  | | all bricks |
| Static and quasi-static load | | | all bricks |
| Use conditions | dry masonry | | all bricks |
| Installation | Pre-positioned | Anchor rod or internal threaded anchor (in solid brick masonry) | Perforated sleeve with anchor rod or internal threaded anchor (in perforated and solid brick masonry) Size: FIS H 12x50 K FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K |
| | Push through | Anchor rod (in solid brick masonry) | Perforated sleeve with anchor rod (in perforated and solid brick masonry) Size: FIS H 18x130/200 K FIS H 22x130/200 K |
| Installation and use conditions | condition d/d (dry/dry) | | all bricks |
| Installation temperature | | | $T_{i,min} = -10^{\circ}\text{C}$ to $T_{i,max} = +40^{\circ}\text{C}$ |
| Service temperature | Temperature range Ta | -40 °C to +40 °C | (max. short term temperature +40 °C max. long term temperature +24 °C) |
| | Temperature range Tb | -40 °C to +80 °C | (max. short term temperature +80 °C max. long term temperature +50 °C) |
| | Temperature range Tc | -40 °C to +120 °C | (max. short term temperature +120 °C; max. long term temperature +72 °C) |
| | | | |
| fischer injection system FIS V Zero for masonry | | | |
| Intended use Specifications (part 1) | | Annex B 1 | |

Specifications of intended use (part 2)

Anchorage subject to:

- Static and quasi-static loads

Base materials:

- Solid brick masonry (base material group b), acc. to Annex B 12
- Hollow brick masonry (base material group c), according to Annex B 12
- Minimum thickness of masonry member is $h_{\text{eff}}+30\text{mm}$
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 053:2016-04 under consideration of the β -factor according to Annex C 16, Table C16.1

Note (only applies to solid bricks):

The characteristic resistance is also valid for larger brick sizes, higher mean compressive strength and higher mean gross dry density of the masonry unit.

Temperature Range:

- **Ta:** from -40°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C)
- **Tb:** from -40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)
- **Tc:** from -40°C to +120°C (max. short term temperature +120°C and max. long term temperature +72°C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel)
- For all other conditions according to EN 1993-1-4:2015 corresponding to corrosion resistance classes to Annex A 5, Table A5.1.

fischer injection system FIS V Zero for masonry

Intended use
Specifications (part 2)

Annex B 2

Specifications of intended use (part 2 continued)

Design:

- The anchorages have to be designed in accordance with EOTA Technical Report TR 054:2021-05, Design method A under the responsibility of an engineer experienced in anchorages and masonry work.
Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,b} = N_{Rk,p} = N_{Rk,b,c} = N_{Rk,p,c}$$

$$V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$$

For the Calculation of pulling out a brick under tension load $N_{Rk,pb}$ or pushing out a brick under shear load $V_{Rk,pb}$ see EOTA Technical Report TR 054:2021-05.

$N_{Rk,s}$, $V_{Rk,s}$ and $M^0_{Rk,s}$ see annex C1-C3

Factors for job site tests and displacements see Annex C16

- Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.

Installation:

- Condition d/d: Installation and use in structures subject to dry, internal conditions
- Hole drilling see **Annex B1.1**
- In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) at perforated brick masonry see Annex B 6, Table B6.1
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or anchor rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E.
- Minimum curing time see Annex B 8, Table B8.2
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A 5, Table 5.1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored

Marking of the anchor rod with the effective embedment depth. This may be done by the manufacturer of the rod or by a person on job site

fischer injection system FIS V Zero for masonry

Intended use
Specifications (part 2 continued)


Annex B 3

Table B4.1: Installation parameters for anchor rods in solid bricks without perforated sleeves

| Anchor rod | Thread | M8 | M10 | M12 | M16 |
|---|---|----|-----|---------------------------------|-----|
| Nominal drill hole diameter | d_0 [mm] | 10 | 12 | 14 | 18 |
| Effective embedment depth h_{ef} ¹⁾ in solid brick (depth of drill hole $h_0 = h_{ef}$) | $h_{ef,min}$ [mm] | | 50 | | |
| | $h_{ef,max}$ [mm] | | | h-30, ≤200 | |
| Diameter of clearance hole in the fixture | pre-positioned installation $d_f \leq$ [mm] | 9 | 12 | 14 | 18 |
| | push through installation $d_f \leq$ [mm] | 11 | 14 | 16 | 20 |
| Diameter of cleaning brush | $d_b \geq$ [mm] | | | see Table B8.1 | |
| Maximum installation torque | max T_{inst} [Nm] | | | see parameters of brick Annex C | |

¹⁾ $h_{ef,min} \leq h_{ef} \leq h_{ef,max}$ is possible.

fischer anchor rods M8, M10, M12, M16

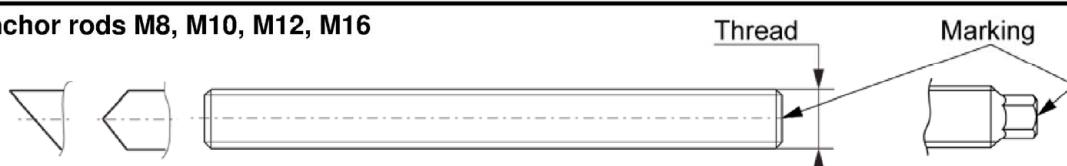

Marking (on random place) fischer anchor rod:

| | | | |
|--|--------|--|---|
| Steel zinc plated PC ¹⁾ 8.8 | • or + | Steel hot-dip galvanised PC ¹⁾ 8.8 | • |
| High corrosion resistant steel HCR PC ¹⁾ 50 | • | High corrosion resistant steel HCR PC ¹⁾ 70 | - |
| High corrosion resistant steel HCR PC ¹⁾ 80 | (| Stainless steel R property class 50 | ~ |
| Stainless steel R property class 80 | * | | |


Alternatively: Colour coding according to DIN 976-1: 2016;

property class 4.6 marking according to EN ISO 898-1:2013

¹⁾ PC = property class

Installation conditions:

Anchor rod

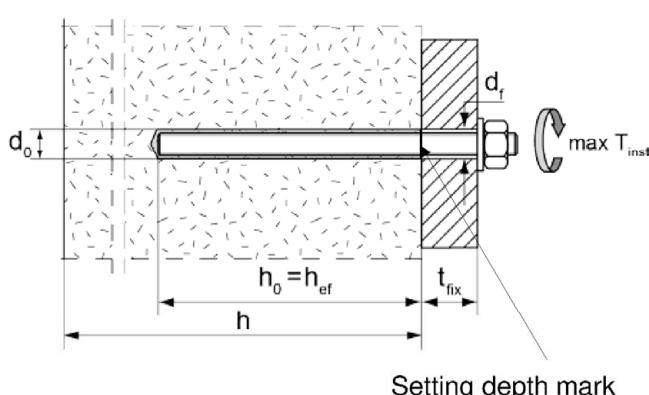

Figures not to scale

fischer injection system FIS V Zero for masonry

Intended use


Installation parameters for anchor rods without perforated sleeve

Annex B 4

Table B5.1: Installation parameters for internal threaded anchors FIS E in solid bricks without perforated sleeves

| Internal threaded anchor FIS E | 11x85 M8 | 15x85 M10 | 15x85 M12 |
|--|----------|---------------------------------|-----------|
| Diameter of anchor d_H [mm] | 11 | 15 | |
| Nominal drill hole diameter d_0 [mm] | 14 | 18 | |
| Length of anchor L_H [mm] | | 85 | |
| Effective embedment depth $h_0 = h_{ef}$ [mm] | | 85 | |
| Diameter of cleaning brush $d_b \geq$ [mm] | | see Table B8.1 | |
| Maximum installation torque $\max T_{inst}$ [Nm] | | see parameters of brick Annex C | |
| Diameter of clearance hole in the fixture d_f [mm] | 9 | 12 | 14 |
| Screw-in depth $l_{E,min}$ [mm] | 8 | 10 | 12 |
| $l_{E,max}$ [mm] | | 60 | |

fischer Internal threaded anchor FIS E

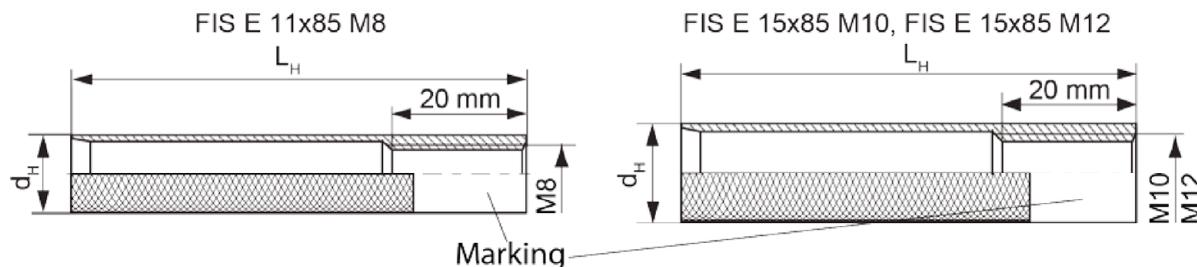


Marking:

Size, e.g. **M8**, Stainless steel: R, e.g. **M8 R**, High corrosion-resistant steel: HCR, e.g. **M8 HCR**

Installation conditions:

Internal threaded anchor

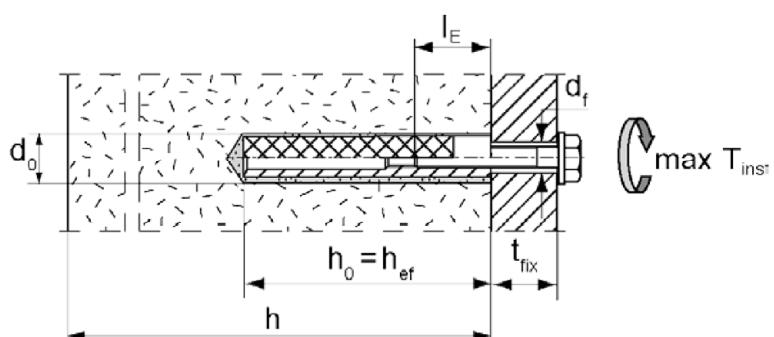

Figures not to scale

fischer injection system FIS V Zero for masonry

Intended use

Installation parameters for internal threaded rods FIS E without perforated sleeve

Annex B 5

Table B6.1: Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeves (pre-positioned installation)

| perforated sleeve FIS H K | 12x50 | 12x85 ²⁾ | 16x85 | 16x130 ²⁾ | 20x85 | 20x130 ²⁾ |
|--|----------------------------|---------------------------------|------------|----------------------|-------|----------------------|
| Nominal drill hole diameter $d_0 = D_{\text{sleeve,nom}}$ | d ₀ [mm] | 12 | 16 | 20 | | |
| Depth of drill hole | h ₀ [mm] | 55 | 90 | 90 | 135 | 135 |
| Effective embedment depth | h _{ef,min} [mm] | 50 | 65 | 85 | 110 | 85 |
| | h _{ef,max} [mm] | 50 | 85 | 85 | 130 | 130 |
| Size of threaded rod | [-] | M8 | M8 and M10 | M12 and M16 | | |
| Size of internal threaded anchor FIS E | - | - | 11x85 | - | 15x85 | - |
| Diameter of cleaning brush ¹⁾ | d _b ≥ [mm] | see Table B8.1 | | | | |
| Maximum installation torque | max T _{inst} [Nm] | see parameters of brick Annex C | | | | |

¹⁾ Only for solid areas in hollow bricks and solid bricks.


²⁾ Bridging of unbearing layer (e.g. plaster) is possible. When reducing the effective embedment depth h_{ef,min}, the values of the next shorter perforated sleeve of the same diameter must be used. The smaller value of characteristic resistance must be taken.

Perforated sleeve


FIS H 12x50 K; FIS H 12x85 K; FIS H 16x85 K; FIS H 16x130 K;
FIS H 20x85 K; FIS H 20x130 K

Marking:

Size D_{sleeve,nom} x L_{sleeve}
(e.g.: 16x85)




D_{sleeve,nom}

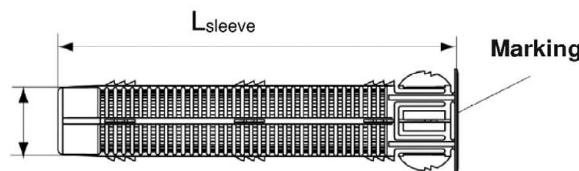


fischer Internal threaded anchor FIS E

FIS E 11x85 M8

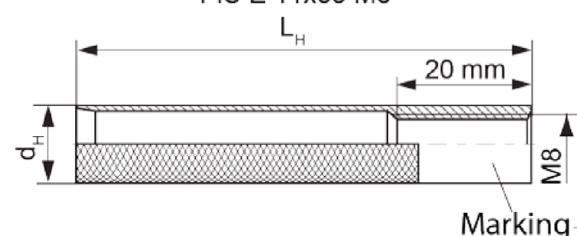


FIS E 15x85 M10, FIS E 15x85 M12

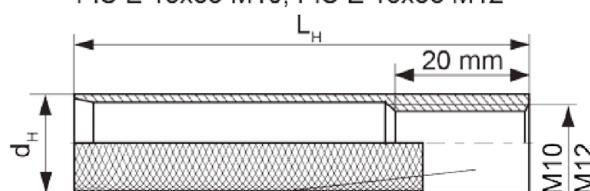


Installation conditions:

Anchor rod with perforated sleeve

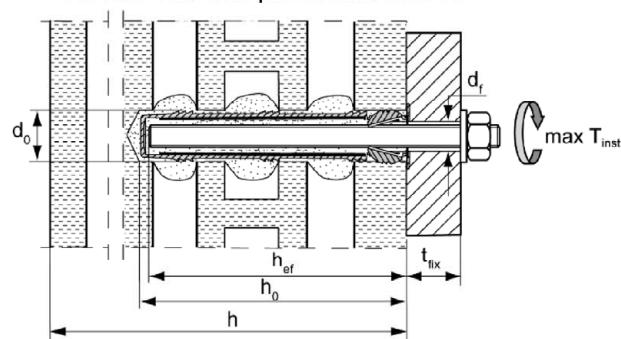

Internal threaded anchor with perforated sleeve

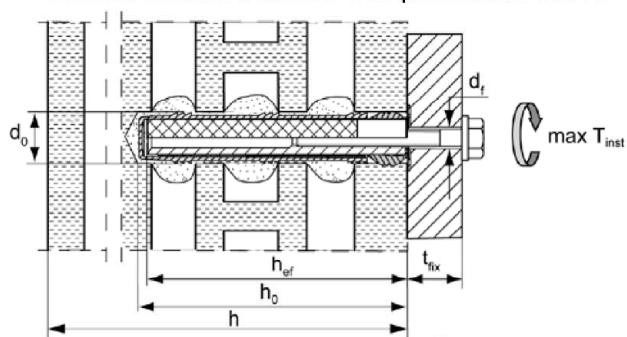

Figures not to scale

fischer injection system FIS V Zero for masonry

Intended use

Installation parameters for anchor rods and internal threaded anchors FIS E with perforated sleeve (pre-positioned installation)

Annex B 6


Table B7.1: Installation parameters for anchor rods with perforated sleeves (push through installation)

| Perforated sleeve FIS H K | 18x130/200 | 22x130/200 |
|--|------------|---------------------------------|
| Nominal sleeve diameter $D_{sleeve,nom}$ [mm] | 16 | 20 |
| Nominal drill hole diameter d_0 [mm] | 18 | 22 |
| Depth of drill hole h_0 [mm] | 135 | |
| Effective embedment depth h_{ef} [mm] | | ≥ 130 |
| Diameter of cleaning brush ¹⁾ $d_b \geq$ [mm] | | see Table B8.1 |
| Size of threaded rod [-] | M10 | M12 |
| Maximum installation torque $\max T_{inst}$ [Nm] | | see parameters of brick Annex C |
| Thickness of fixture $t_{fix,max}$ [mm] | | 200 |

¹⁾ Only for solid areas in hollow bricks and solid bricks.


Perforated sleeve

FIS H 18x130/200 K; FIS H 22x130/200 K

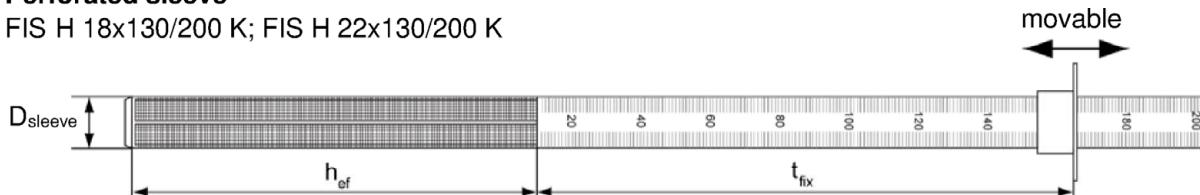

Installation conditions:

Anchor rod with perforated sleeve

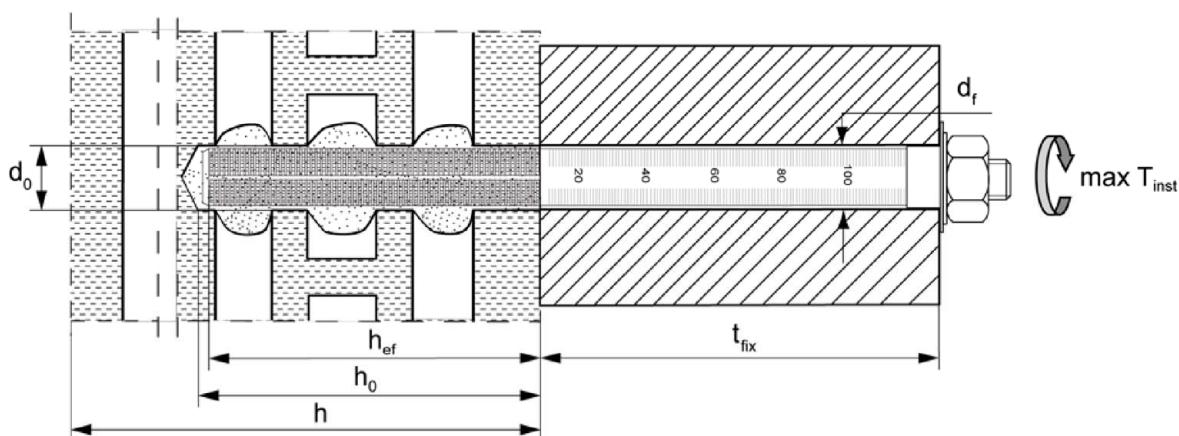

Figures not to scale

fischer injection system FIS V Zero for masonry

Intended use


Installation parameters for anchor rods with perforated sleeves (push through installation)

Annex B 7

Table B8.1: Parameters of the cleaning brush BS (steel brush with steel bristles)

The size of the cleaning brush refers to the drill hole diameter

| | | | | | | | | |
|-----------------------------|------------|----|----|----|----|----|----|----|
| Nominal drill hole diameter | d_0 [mm] | 10 | 12 | 14 | 16 | 18 | 20 | 22 |
| Steel brush diameter | d_b [mm] | 11 | 14 | 16 | 20 | 20 | 25 | 25 |

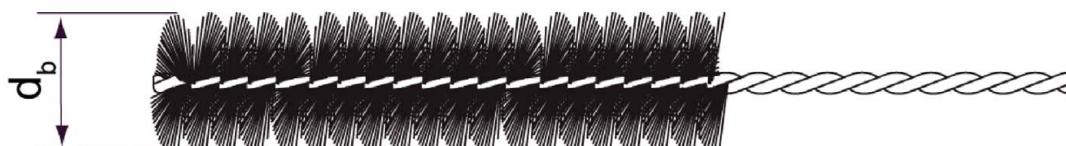

Only for solid areas in hollow bricks and solid bricks

Table B8.2: Maximum processing times and minimum curing times
(During the curing time of the mortar the temperature of the anchoring base may not fall below the listed minimum temperature)

| Temperature at anchoring base [°C] | Maximum processing time t_{work} | Minimum curing time t_{cure} |
|------------------------------------|------------------------------------|--------------------------------|
| | FIS V Zero | |
| -10 to -5 ¹⁾ | 6 h | 72 h |
| > -5 to 0 ¹⁾ | 2 h | 24 h |
| > 0 to 5 ¹⁾ | 45 min | 12 h |
| > 5 to 10 | 20 min | 6 h |
| > 10 to 15 | 8 min | 3 h |
| > 15 to 20 | 5 min | 2 h |
| > 20 to 25 | 3 min | 1 h |
| > 25 to 30 | 2 min | 45 min |
| > 30 to 40 | 1 min | 30 min |

¹⁾ Minimum cartridge temperature +5°C

Figures not to scale

| | |
|---|-----------|
| fischer injection system FIS V Zero for masonry | Annex B 8 |
| Intended use Parameters of the cleaning brush (steel brush) Processing time and curing time | |







Installation instruction part 1

Installation in solid brick without perforated sleeve

| | | | | |
|---|--|--|------------------|---|
| 1 | | Drill the hole (drilling method see Annex C of the respective brick) depth of drill hole h_0 and nominal drill hole diameter d_0 see Table B4.1; B5.1 | | |
| 2 | | | | Blow out the drill hole twice. Brush twice and blow out twice again. |
| 3 | | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | | |
| 4 | | Place the cartridge into a suitable dispenser | | Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey. |
| 5 | | Fill approximately 2/3 of the drill hole with mortar beginning from the bottom of the hole ¹⁾ . Avoid bubbles. | | For push through installation fill the annular gap with mortar. |
| 6 | | Only use clean and oil-free metal parts. Mark the setting depth. Insert the anchor rod or internal threaded anchor FIS E by hand. Recommendation: Rotation back and forth of the anchor rod or internal threaded anchor FIS E makes pushing easy. When reaching the setting depth mark, excess mortar must emerge from the mouth of the drill hole. | | |
| 7 | | Do not touch. Minimum curing time see Table B8.2 | | Mounting the fixture. max T_{inst} see parameter of brick. |
| 1) Exact volume of mortar see manufacturer's specifications | | | | |
| fischer injection system FIS V Zero for masonry | | | | |
| Intended use Installation instruction part 1 Installation in solid brick without perforated sleeve | | | Annex B 9 | |

Installation instruction part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned installation)
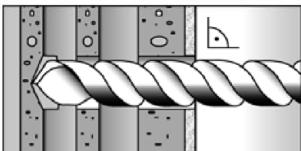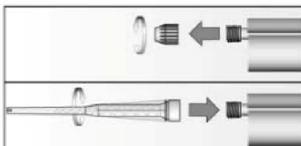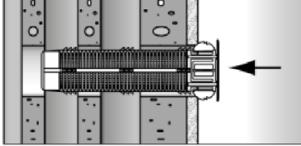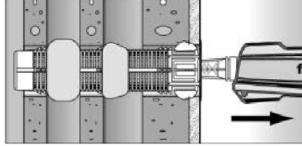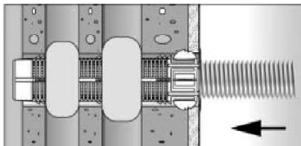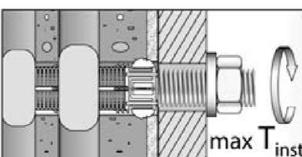
| | | | |
|---|---|---|---|
| 1 |  | Drill the hole (drilling method see Annex C of the respective brick). depth of drill hole h_0 and nominal drill hole diameter d_0 see Table B6.1 | When install perforated sleeves in solid bricks or solid areas of hollow bricks, also clean the hole by blowing out and brushing. |
| 2 |  | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | |
| 3 |  | Place the cartridge into a suitable dispenser. |  Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey. |
| 4 |  | Insert the perforated sleeve flush with the surface of the masonry or plaster. |  Fill the perforated sleeve completely with mortar beginning from the bottom of the hole. ¹⁾ |
| 5 |  | Only use clean and oil-free metal parts. Mark the setting depth. Insert the anchor rod or the internal threaded anchor FIS E by hand. Recommendation: Rotation back and forth of the anchor rod or internal threaded anchor FIS E makes pushing easy until reaching the setting depth mark (anchor rod) or flush with the surface (internal threaded anchor). | |
| 6 |  | Do not touch. Minimum curing time see Table B8.2 |  Mounting the fixture. max T_{inst} see parameter of brick. |

¹⁾ Exact volume of mortar see manufacturer's specification.

fischer injection system FIS V Zero for masonry

Intended use








Installation instruction part 2

Installation in perforated or solid brick with perforated sleeve (pre-positioned installation)

Annex B 10

Installation instruction part 3

Installation in perforated or solid brick with perforated sleeve (push through installation)
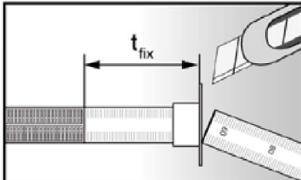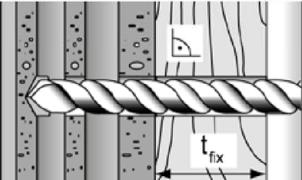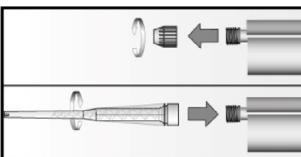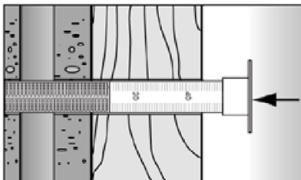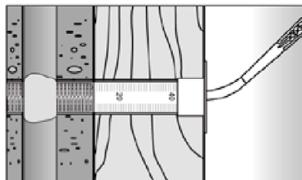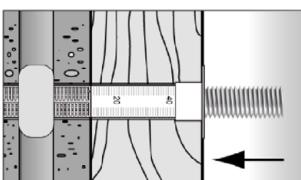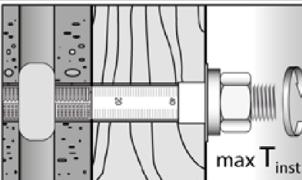
| | | | | |
|---|---|--|--|---|
| 1 |  | Push the movable stop up to the correct thickness of fixture and cut the overlap. |  | Drill the hole through the fixture. Depth of drill hole ($h_0 + t_{fix}$) and nominal drill hole diameter d_0 see Table B7.1 |
| 2 |  | Remove the sealing cap. Screw on the static mixer. (the spiral in the static mixer must be clearly visible) | | |
| 3 |  | Place the cartridge into a suitable dispenser. |  | Extrude approximately 10 cm of material out until the resin is evenly grey in colour. Do not use mortar that is not uniformly grey. |
| 4 |  | Insert the perforated sleeve flush with the surface of the fixture into the drill hole. |  | Fill the sleeve with mortar beginning from the bottom of the hole. ¹⁾ For deep drill holes use an extension tube. |
| 5 |  | Only use clean and oil-free metal parts. Mark the setting depth. Insert the anchor rod by hand. Recommendation: Rotation back and forth of the anchor rod makes pushing easy until reaching the setting depth mark (anchor rod). | | |
| 6 |  | Do not touch. Minimum curing time see Table B8.2 |  | Mounting the fixture. max T_{inst} see parameter of brick. |



¹⁾ Exact volume of mortar see manufacturer's specification.

Table B12.1: Overview of assessed bricks


| Kind of masonry | Brick format [mm] | Mean compressive strength [N/mm ²] | Main country of origin | Mean gross dry density ρ [kg/dm ³] | Annex |
|--|-------------------|--|------------------------|--|---------|
| Solid brick Mz | | | | | |
| Solid brick Mz | ≥ 230x108x55 | 36 - 48 | Denmark | ≥2,0 | C4/C5 |
| Solid calcium silicate (sand - lime) brick KS / perforated calcium silicate (sand - lime) brick KSL | | | | | |
| Solid calcium silicate brick KS | NF | ≥240x115x71 | 8- 20 | Germany | ≥2,0 |
| Perforated calcium silicate brick KSL | 3DF | 240x175x113 | 8 - 16 | Germany | ≥1,6 |
| Vertical perforated brick HLz | | | | | |
| Vertical perforated brick HLz | 230x108x55 | 6 - 16 | Denmark | ≥1,6 | C12/C13 |
| Lightweight aggregate concrete hollow block Hbl | | | | | |
| Lightweight aggregate concrete hollow block Hbl | 500x200x200 | 2 - 4 | France | ≥1,0 | C14/C15 |

Picture B12.1: Overview dimensions of perforated and hollow bricks

Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015; e.g. KS Wemding according to Annex C 8 Vertical perforated brick HLz, EN 771-1:2015; e.g. Wienerberger according to Annex C 12

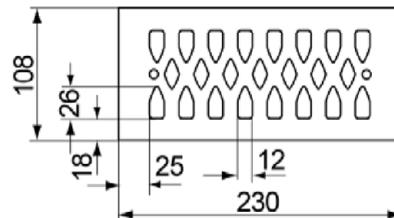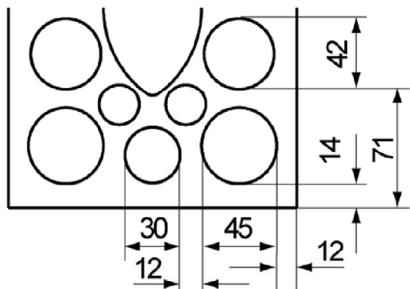

Lightweight aggregate concrete hollow block Hbl, EN 771-3:2015; e.g. Sepa according to Annex C 14

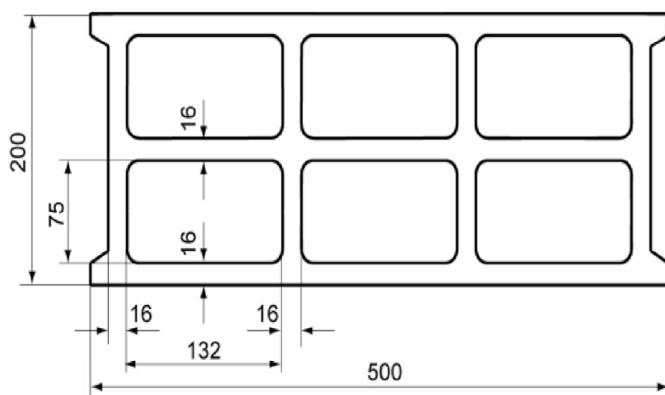

Measures in [mm]

Figures not to scale

fischer injection system FIS V Zero for masonry


Intended use

Overview of assessed bricks

Overview dimensions of perforated and hollow bricks

Annex B 12

Spacing and edge distance

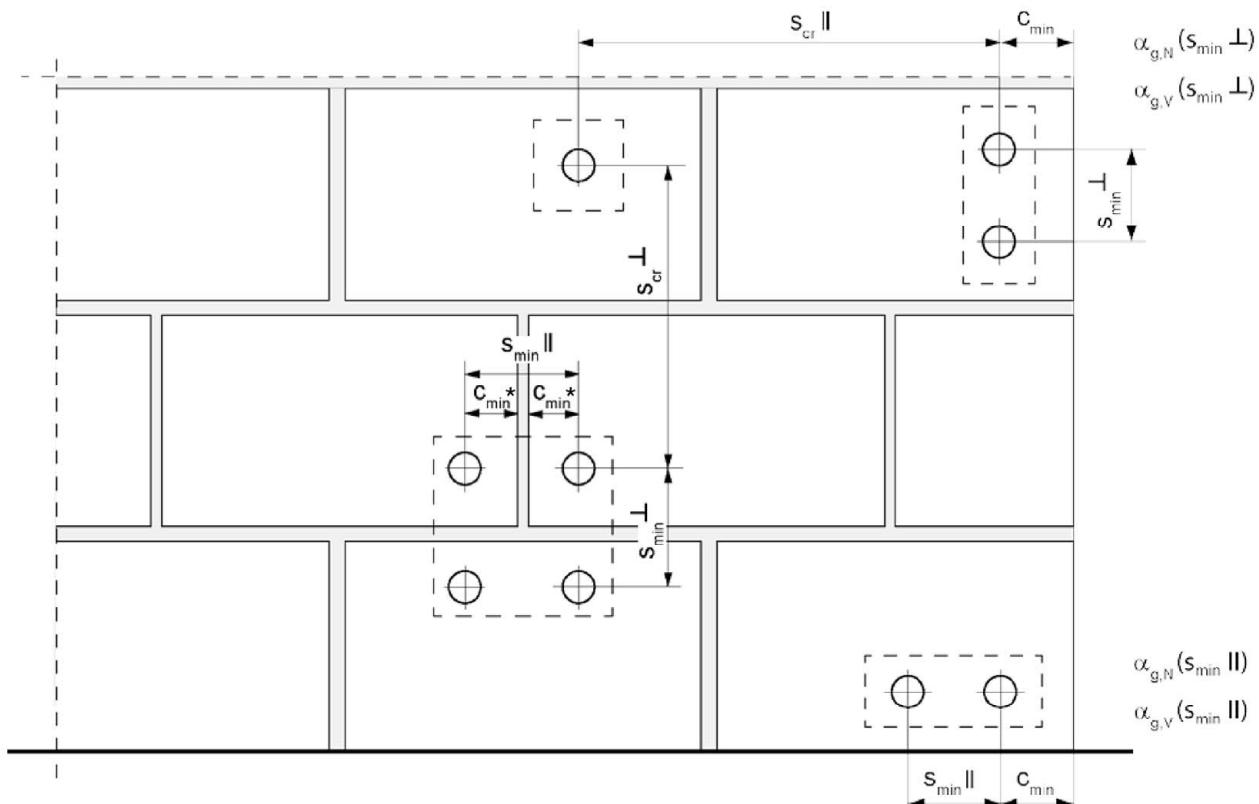

* Only, if vertical joints are not completely filled with mortar

| | |
|------------------------------------|--|
| $s_{\min \parallel}$ | = Minimum spacing parallel to horizontal joint |
| $s_{\min \perp}$ | = Minimum spacing perpendicular to horizontal joint |
| $s_{cr \parallel}$ | = Characteristic spacing parallel to horizontal joint |
| $s_{cr \perp}$ | = Characteristic spacing perpendicular to horizontal joint |
| $c_{cr} = c_{\min}$ | = Edge distance |
| $\alpha_{g,N}(s_{\min \parallel})$ | = Group factor for tension load, anchor group parallel to horizontal joint |
| $\alpha_{g,V}(s_{\min \parallel})$ | = Group factor for shear load, anchor group parallel to horizontal joint |
| $\alpha_{g,N}(s_{\min \perp})$ | = Group factor for tension load, anchor group vertical to horizontal joint |
| $\alpha_{g,V}(s_{\min \perp})$ | = Group factor for shear load, anchor group vertical to horizontal joint |

Spacing and edge distance (continuation)

For $s \geq s_{cr}$ $\alpha_g = 2$

For $s_{min} \leq s < s_{cr}$ α_g according to installation parameters of brick Annex C

Group of 2 anchors

$$N^g_{Rk} = \alpha_{g,N} \cdot N_{Rk}; \quad V^g_{Rk,b} = V^g_{Rk,c,II} = V^g_{Rk,c,\perp} = \alpha_{g,V} \cdot V_{Rk}$$

Group of 4 anchors

$$N^g_{Rk} = \alpha_{g,N} (s_{min,II}) \cdot \alpha_{g,N} (s_{min,\perp}) \cdot N_{Rk};$$

$$V^g_{Rk,b} = V^g_{Rk,c,II} = V^g_{Rk,c,\perp} = \alpha_{g,V} (s_{min,II}) \cdot \alpha_{g,V} (s_{min,\perp}) \cdot V_{Rk}$$

with N_{Rk} and $\alpha_{g,N}$ depending on $s_{min,II}$ or $s_{min,\perp}$ acc. to Annex C

with V_{Rk} and $\alpha_{g,V}$ depending on $s_{min,II}$ or $s_{min,\perp}$ acc. to Annex C

fischer injection system FIS V Zero for masonry

Intended use
Spacing and edge distance (continuation)

Annex B 14

Table C1.1: Characteristic resistance to **steel failure** of a single anchor under **tension loading** of **fischer anchor rods** and **standard threaded rods**

| Anchor rod / standard threaded rod | | M8 ³⁾ | M10 ³⁾ | M12 | M16 |
|---|--|------------------|-------------------|---------------------------|-----|
| Characteristic resistance to steel failure under tension loading | | | | | |
| Characteristic resistance $N_{Rk,s}$ | Steel zinc plated | 4.6 | 15(13) | 23(21) | 33 |
| | | 4.8 | 15(13) | 23(21) | 33 |
| | | 5.8 | 19(17) | 29(27) | 43 |
| | | 8.8 | 29(27) | 47(43) | 68 |
| | | 50 | 19 | 29 | 43 |
| | Stainless steel R and High corrosion resistant steel HCR | 70 | 26 | 41 | 59 |
| | | 80 | 30 | 47 | 68 |
| | | | | | 126 |
| Partial factors¹⁾ | | | | | |
| $\gamma_{Ms,N}$ | Steel zinc plated | 4.6 | [-] | 2,00 | |
| | | 4.8 | | 1,50 | |
| | | 5.8 | | 1,50 | |
| | | 8.8 | | 1,50 | |
| | | 50 | | 2,86 | |
| | Stainless steel R and High corrosion resistant steel HCR | 70 | | 1,50 ²⁾ / 1,87 | |
| | | 80 | | 1,60 | |

¹⁾ In absence of other national regulations

²⁾ Only for fischer FIS A made of high corrosion-resistant steel HCR

³⁾ Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hot dip galvanised standard threaded rods according to EN ISO 10684:2004+AC:2009

fischer injection system FIS V Zero for masonry

Performances

Characteristic resistance to steel failure of a single anchor under tension loading of fischer anchor rods and standard threaded rods

Annex C 1


Table C2.1: Characteristic resistance to **steel failure** of a single anchor under **shear loading** with and without lever arm of **fischer anchor rods** and **standard threaded rods**

| Anchor rod / standard threaded rod | | M8 ³⁾ | M10 ³⁾ | M12 | M16 | |
|--|----------------|------------------|-------------------|---------------------------|-----|--|
| Characteristic resistance to steel failure under shear loading | | | | | | |
| without lever arm | | | | | | |
| Characteristic resistance $V_{Rk,s}$ | Property class | 4.6 | 9(8) | 14(13) | 20 | |
| | | 4.8 | 9(8) | 14(13) | 38 | |
| | | 5.8 | 11(10) | 17(16) | 25 | |
| | | 8.8 | 15(13) | 23(21) | 47 | |
| | | 50 | 9 | 15 | 34 | |
| | | 70 | 13 | 20 | 63 | |
| | | 80 | 15 | 23 | 39 | |
| | | | | | 55 | |
| with lever arm | | | | | | |
| Characteristic resistance $M_{Rk,s}^0$ | Property class | 4.6 | 15(13) | 30(27) | 52 | |
| | | 4.8 | 15(13) | 30(27) | 133 | |
| | | 5.8 | 19(16) | 37(33) | 65 | |
| | | 8.8 | 30(26) | 60(53) | 166 | |
| | | 50 | 19 | 37 | 105 | |
| | | 70 | 26 | 52 | 266 | |
| | | 80 | 30 | 60 | 166 | |
| | | | | | 232 | |
| Partial factors¹⁾ | | | | | | |
| Partial factors $\gamma_{Ms,V}$ | Property class | 4.6 | | 1,67 | | |
| | | 4.8 | | 1,25 | | |
| | | 5.8 | | 1,25 | | |
| | | 8.8 | | 1,25 | | |
| | | 50 | | 2,38 | | |
| | | 70 | | 1,25 ²⁾ / 1,56 | | |
| | | 80 | | 1,33 | | |
| | | | | | | |
| fischer injection system FIS V Zero for masonry | | | | | | |
| Performances | | | | | | |
| Characteristic resistance to steel failure of a single anchor under shear loading with and without lever arm of fischer anchor rods and standard threaded rods | | | | | | |
| Annex C 2 | | | | | | |

Table C3.1: Characteristic resistance to **steel failure** of a single anchor under **tension / shear loading** of internal threaded anchors FIS E

| fischer internal threaded anchor FIS E | | | M8 | M10 | M12 | |
|---|-------------------|-----|------|------------------|-----|--|
| Characteristic resistance to steel failure under tension loading | | | | | | |
| Characteristic resistance with screw $N_{Rk,s}$ | Property class | 5.8 | [kN] | 18 | 29 | |
| | Property class R | R | | 26 | 41 | |
| | Property class 70 | HCR | | 26 | 41 | |
| Partial factors¹⁾ | | | | | | |
| Partial factors $\gamma_{Ms,N}$ | Property class | 5.8 | [-] | 1,50 | | |
| | Property class R | R | | 1,87 | | |
| | Property class 70 | HCR | | 1,87 | | |
| Characteristic resistance to steel failure under shear loading | | | | | | |
| without lever arm | | | | | | |
| Characteristic resistance with screw $V_{Rk,s}$ | Property class | 5.8 | [kN] | 9 | 15 | |
| | Property class R | R | | 13 | 20 | |
| | Property class 70 | HCR | | 13 | 20 | |
| with lever arm | | | | | | |
| Characteristic resistance $M_{Rk,s}^0$ | Property class | 5.8 | [Nm] | 19 | 37 | |
| | Property class R | R | | 26 | 52 | |
| | Property class 70 | HCR | | 26 | 52 | |
| Partial factors¹⁾ | | | | | | |
| Partial factors $\gamma_{Ms,V}$ | Property class | 5.8 | [-] | 1,25 | | |
| | Property class R | R | | 1,56 | | |
| | Property class 70 | HCR | | 1,56 | | |
| ¹⁾ In absence of other national regulations | | | | | | |
| fischer injection system FIS V Zero for masonry | | | | | | |
| Performances Characteristic resistance to steel failure of a single anchor under tension / shear loading of internal threaded anchors FIS E | | | | | | |
| | | | | Annex C 3 | | |

Solid brick Mz, EN 771-1:2015

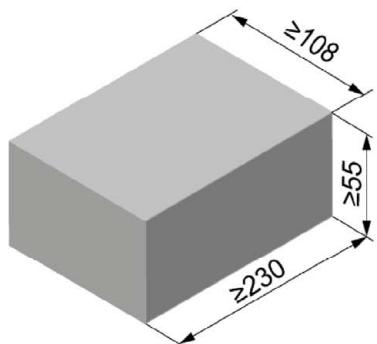

| Solid brick Mz, EN 771-1:2015 | | |
|---|-------------------|---------|
| Producer | e.g. Wienerberger | |
| Nominal dimensions [mm] | length L | width W |
| ≥ 230 | ≥ 108 | ≥ 55 |
| Mean gross dry density ρ [kg/dm ³] | ≥ 2,0 | |
| Mean compressive strength [N/mm ²] | 36 / 48 | |
| Standard | EN 771-1:2015 | |

Table C4.1: Installation parameters

| Anchor rod | M8 | M10 | M12 | M16 | - | - | | | | | |
|--|------|---------------------|-----|-----|----|---------|--|--|--|--|--|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 | | | | | |
| Anchor rod and internal threaded anchor FIS E without perforated sleeve | | | | | | | | | | | |
| Effective embedment depth h_{ef} [mm] | 50 | 80 | 50 | 80 | 50 | 85 | | | | | |
| Max. installation torque $\max T_{\text{inst}}$ [Nm] | | | 10 | | | 10 | | | | | |
| General installation parameters | | | | | | | | | | | |
| Edge distance C_{\min} | [mm] | 100 | | | | | | | | | |
| $s_{\min \parallel}$ | | 100 | | | | | | | | | |
| $s_{\text{cr} \parallel}$ | | 3 x h_{ef} | | | | | | | | | |
| $s_{\min \perp}$ | | 100 | | | | | | | | | |
| $s_{\text{cr} \perp}$ | | 3 x h_{ef} | | | | | | | | | |
| Drilling method | | | | | | | | | | | |
| Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill | | | | | | | | | | | |

Table C4.2: Group factors

| Anchor rods | M8 | M10 | M12 | M16 | - | - | |
|--|-------------------------------------|-----|------|-----|------------------|---------|--|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 | |
| | | | | | 11x85 | 15x85 | |
| Group factors | $\alpha_{g,N} (s_{\min \parallel})$ | [-] | 1,81 | | | | |
| | $\alpha_{g,V} (s_{\min \parallel})$ | | 1,49 | | | | |
| | $\alpha_{g,N} (s_{\min \perp})$ | | 1,74 | | | | |
| | $\alpha_{g,V} (s_{\min \perp})$ | | 1,49 | | | | |
| fischer injection system FIS V Zero for masonry | | | | | | | |
| Performances Solid brick Mz, dimensions, installation parameters | | | | | Annex C 4 | | |

Solid brick Mz, EN 771-1:2015

Table C5.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

| Anchor rod | M8 | M10 | M12 | M16 | - | - |
|--------------------------------|----|-----|-----|-----|-------|---------|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 |
| | | | | | 11x85 | 15x85 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 |
| 36 N/mm ² | 2,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 4,5 |
| 48 N/mm ² | 3,0 | 3,5 | 3,5 | 3,5 | 3,5 | 3,5 | 3,5 | 5,0 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 50/80°C and 72/120°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 |
| 36 N/mm ² | 1,5 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 3,5 |
| 48 N/mm ² | 1,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 4,0 |

Table C5.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

| Anchor rod | M8 | M10 | M12 | M16 | - | - |
|--------------------------------|----|-----|-----|-----|-------|---------|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 |
| | | | | | 11x85 | 15x85 |

Shear resistance $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C, 50/80°C and 72/120°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 |
| 36 N/mm ² | 2,5 | 4,5 | 2,5 | 4,5 | 2,5 | 4,5 | 2,5 | 4,5 |
| 48 N/mm ² | 3,0 | 5,0 | 3,0 | 5,0 | 3,0 | 5,0 | 3,0 | 5,0 |


Factor for job site tests see annex C16 and displacements see annex C17

fischer injection system FIS V Zero for masonry

Performances
Solid brick Mz, Characteristic resistance under tension and shear loading

Annex C 5

Solid calcium silicate (sand-lime) brick KS, NF, EN 771-2:2015

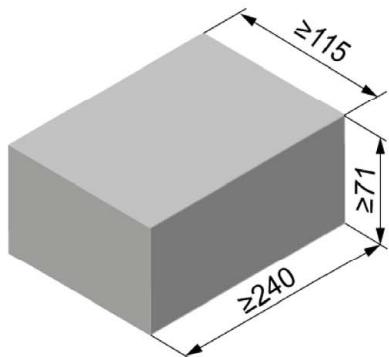

| Solid calcium silicate (sand-lime) brick KS, NF, EN 771-2:2015 | | | |
|---|---------------|--|------------|
| Producer | --- | | |
| Nominal dimensions [mm] | length L | | width W |
| | ≥ 240 | | ≥ 115 |
| Mean gross dry density [kg/dm ³] | $\geq 2,0$ | | |
| Mean compressive strength [N/mm ²] | 12 / 16 / 20 | | |
| Standard | EN 771-2:2015 | | |

Table C6.1: Installation parameters

| Anchor rod | M8 | M10 | M12 | M16 | - | - | | | | | | |
|--|------|---------------------|-----|-----|-----------|------------|--|--|--|--|--|--|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 | | | | | | |
| Anchor rod and internal threaded anchor FIS E without perforated sleeve | | | | | | | | | | | | |
| Effective embedment depth h_{ef} [mm] | 50 | 80 | 50 | 80 | 50 | 85 | | | | | | |
| Max. installation torque $\max T_{\text{inst}}$ [Nm] | 8 | | 10 | | 8 | 10 | | | | | | |
| General installation parameters | | | | | | | | | | | | |
| Edge distance c_{\min} | [mm] | 100 | | | | | | | | | | |
| $s_{\min \parallel}$ | | 100 | | | | | | | | | | |
| $s_{\text{cr} \parallel}$ | | 3 x h_{ef} | | | | | | | | | | |
| $s_{\min \perp}$ | | 100 | | | | | | | | | | |
| $s_{\text{cr} \perp}$ | | 3 x h_{ef} | | | | | | | | | | |
| Drilling method | | | | | | | | | | | | |
| Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill | | | | | | | | | | | | |

Table C6.2: Group factors

| Anchor rod | M8 | M10 | M12 | M16 | - | - | |
|---------------------------------------|-------------------------------------|-----|------|-----|-----------|------------|--|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 | |
| Group factors | $\alpha_{g,N} (s_{\min \parallel})$ | [-] | 1,67 | | | | |
| | $\alpha_{g,V} (s_{\min \parallel})$ | | 1,26 | | | | |
| | $\alpha_{g,N} (s_{\min \perp})$ | | 1,67 | | | | |
| | $\alpha_{g,V} (s_{\min \perp})$ | | 2,0 | | | | |

fischer injection system FIS V Zero for masonry

Performances
Solid calcium silicate (sand-lime) brick KS, NF, dimensions, installation parameters

Annex C 6

Solid calcium silicate (sand-lime) brick KS, NF, EN 771-2:2015

Table C7.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

| Anchor rod | M8 | M10 | M12 | M16 | - | - |
|--------------------------------|----|-----|-----|-----|-------|---------|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 |
| | | | | | 11x85 | 15x85 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d (temperature range 24/40°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 | 85 | 85 |
| 12 N/mm ² | 2,0 | 2,0 | 2,5 | 4,5 | 2,0 | 4,5 | 2,0 | 2,0 | | 2,0 |
| 16 N/mm ² | 2,5 | 2,5 | 2,5 | 5,0 | 2,5 | 5,0 | 2,5 | 2,5 | | 2,5 |
| 20 N/mm ² | 2,5 | 3,0 | 3,0 | 6,0 | 2,5 | 6,0 | 2,5 | 3,0 | | 2,5 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d (temperature range 50/80°C and 72/120°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 | 85 | 85 |
| 12 N/mm ² | 1,5 | 1,5 | 1,5 | 3,0 | 1,5 | 3,0 | 1,5 | 1,5 | | 1,5 |
| 16 N/mm ² | 1,5 | 1,5 | 2,0 | 3,5 | 1,5 | 3,5 | 1,5 | 1,5 | | 1,5 |
| 20 N/mm ² | 2,0 | 2,0 | 2,0 | 4,0 | 2,0 | 4,0 | 2,0 | 2,0 | | 2,0 |

Table C7.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

| Anchor rod | M8 | M10 | M12 | M16 | - | - |
|--------------------------------|----|-----|-----|-----|-------|---------|
| Internal threaded anchor FIS E | - | - | - | - | M8 | M10 M12 |
| | | | | | 11x85 | 15x85 |

Shear resistance $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d (temperature range 24/40°C, 50/80°C and 72/120°C)

| Mean compressive strength f_b | Effective embedment depth h_{ef} [mm] | | | | | | | | | |
|---------------------------------|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| | 50 | 80 | 50 | 80 | 50 | 80 | 50 | 80 | 85 | 85 |
| 12 N/mm ² | 3,5 | 3,5 | 4,5 | 4,5 | 3,5 | 4,0 | 3,5 | 4,0 | 3,5 | 3,5 |
| 16 N/mm ² | 4,0 | 4,0 | 5,0 | 5,0 | 4,0 | 4,5 | 4,0 | 4,5 | 4,0 | 4,0 |
| 20 N/mm ² | 4,5 | 4,5 | 6,0 | 6,0 | 4,5 | 5,0 | 4,5 | 5,0 | 4,5 | 4,5 |

Factor for job site tests see annex C16 and displacements see annex C17


fischer injection system FIS V Zero for masonry

Performances


Solid calcium silicate (sand-lime) brick KS, NF, Characteristic resistance under tension and shear loading

Annex C 7

Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015

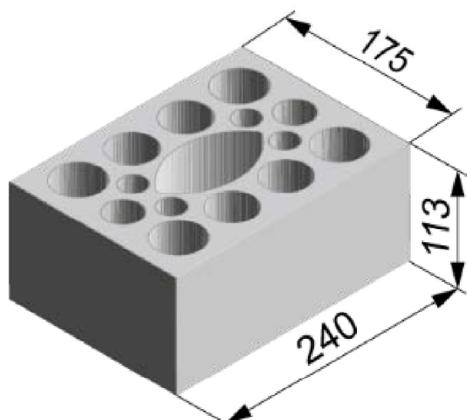

| Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015 | | |
|--|----------------------|---------|
| Producer | e.g. KS Wemding | |
| Nominal dimensions [mm] | length L | width W |
| | 240 | 113 |
| Mean gross dry density ρ [kg/dm ³] | $\geq 1,6$ | |
| Mean compressive strength [N/mm ²] | 6 / 8 / 10 / 12 / 16 | |
| Standard | EN 771-2:2015 | |

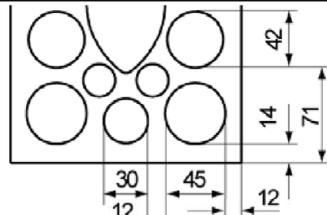

Dimensions see
also Annex B 12

Table C8.1: Installation parameters
(Pre-positioned installation with perforated sleeve FIS H K)

| | | | | | | | | | | | | |
|--------------------------------|-------|-------|----|-------|-----|--------|-----|-------|-----|--------|-----|-----|
| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | - | M8 | - | - | - | - | M10 | M12 | - | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | | 16x85 | | 16x130 | | 20x85 | | 20x130 | | |

Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

| | | | | | | | | | | | | |
|--------------------------|---------------------|---|---|---|---|----|---|----|----|--|--|--|
| Max. installation torque | max T_{inst} [Nm] | 8 | 8 | 8 | 8 | 10 | 8 | 10 | 10 | | | |
|--------------------------|---------------------|---|---|---|---|----|---|----|----|--|--|--|

General installation parameters

| | | | |
|---------------|---------------------|------|-----|
| Edge distance | C_{min} | [mm] | 100 |
| | $S_{min \parallel}$ | | 100 |
| Spacing | $S_{cr \parallel}$ | | 240 |
| | $S_{min \perp}$ | | 100 |
| | $S_{cr \perp}$ | | 115 |

Drilling method

Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill

Table C8.2: Group factors

| | | | | | | | | | | | | |
|--------------------------------|------------------------------------|-------|----|-------|-----|--------|-----|-------|-----|--------|-----|-----|
| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | - | - | M8 | - | - | - | - | M10 | M12 | - | - | - |
| Perforated sleeve FIS H K | 12x50 | 12x85 | | 16x85 | | 16x130 | | 20x85 | | 20x130 | | |
| Group factors | $\alpha_{g,N} (S_{min \parallel})$ | [-] | | | | | | 1,14 | | | | |
| | $\alpha_{g,V} (S_{min \parallel})$ | | | | | | | 1,51 | | | | |
| | $\alpha_{g,N} (S_{min \perp})$ | | | | | | | 1,14 | | | | |
| | $\alpha_{g,V} (S_{min \perp})$ | | | | | | | 1,54 | | | | |

fischer injection system FIS V Zero for masonry

Performances

Perforated calcium silicate (sand-lime) brick KSL, 3DF, dimensions, installation parameters

Annex C 8

Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015

Table C9.1: Installation parameters
(Push through installation with perforated sleeve FIS H K)

| Anchor rod | M10 | M12 | M16 | |
|--|---------------------|------|------------|--|
| Perforated sleeve FIS H K | 18x130/200 | | 22x130/200 | |
| Anchor rod with perforated sleeve FIS H K | | | | |
| Max. installation torque | max T_{inst} [Nm] | | 10 | |
| General installation parameters | | | | |
| Edge distance | C_{min} | | 100 | |
| Spacing | $S_{min \parallel}$ | [mm] | 100 | |
| | $S_{cr \parallel}$ | | 240 | |
| | $S_{min \perp}$ | | 100 | |
| | $S_{cr \perp}$ | | 115 | |
| Drilling method | | | | |
| Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill | | | | |

Table C9.2: Group factors

| Anchor rod | M10 | M12 | M16 |
|---------------------------|------------------------------------|-----|------------|
| Perforated sleeve FIS H K | 18x130/200 | | 22x130/200 |
| Group factors | $\alpha_{g,N} (S_{min \parallel})$ | [-] | 1,14 |
| | $\alpha_{g,v} (S_{min \parallel})$ | | 1,51 |
| | $\alpha_{g,N} (S_{min \perp})$ | | 1,14 |
| | $\alpha_{g,v} (S_{min \perp})$ | | 1,54 |

fischer injection system FIS V Zero for masonry

Performances

Perforated calcium silicate (sand-lime) brick KSL, 3DF, dimensions, installation parameters

Annex C 9

Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015

Table C10.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading (Pre-positioned installation)

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|--------------------------------|-------|-------|-------------|-------|-----|--------|-----|--------------|-----|--------|-----|-----|
| Internal threaded anchor FIS E | - | - | M8 11x85 | - | - | - | - | M10 15x85 | M12 | - | - | - |
| | | | | | | | | | | | | |
| | | | | | | | | | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | | 16x85 | | 16x130 | | 20x85 | | 20x130 | | |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C)

| Mean compressive strength f_b | 6 N/mm ² | 8 N/mm ² | 10 N/mm ² | 12 N/mm ² | 16 N/mm ² |
|---------------------------------|---------------------|---------------------|----------------------|----------------------|----------------------|
| | 1,2 | 0,9 | 2,0 | 0,9 | 2,0 |
| | 1,5 | 1,2 | 2,5 | 1,2 | 2,5 |
| | 1,5 | 1,5 | 3,0 | 1,5 | 3,0 |
| | 2,0 | 1,5 | 3,5 | 1,5 | 3,5 |
| | 2,5 | 2,0 | 4,5 | 2,0 | 4,5 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 50/80°C and 72/120°C)

| Mean compressive strength f_b | 6 N/mm ² | 8 N/mm ² | 10 N/mm ² | 12 N/mm ² | 16 N/mm ² |
|---------------------------------|---------------------|---------------------|----------------------|----------------------|----------------------|
| | 0,6 | 0,75 | 1,5 | 0,75 | 1,5 |
| | 0,75 | 0,9 | 2,0 | 0,9 | 2,0 |
| | 0,9 | 0,9 | 2,5 | 0,9 | 2,5 |
| | 0,9 | 1,2 | 2,5 | 1,2 | 2,5 |
| | 1,2 | 1,5 | 3,5 | 1,5 | 3,5 |

Table C10.2: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading (Push through installation)

| Anchor rod | M10 | M12 | M16 |
|---------------------------|------------|-----|------------|
| Perforated sleeve FIS H K | 18x130/200 | | 22x130/200 |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C)

| Mean compressive strength f_b | 6 N/mm ² | 8 N/mm ² | 10 N/mm ² | 12 N/mm ² | 16 N/mm ² |
|---------------------------------|---------------------|---------------------|----------------------|----------------------|----------------------|
| | | 2,0 | | | |
| | | 2,5 | | | |
| | | 3,0 | | | |
| | | 3,5 | | | |
| | | 4,5 | | | |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 50/80°C and 72/120°C)

| Mean compressive strength f_b | 6 N/mm ² | 8 N/mm ² | 10 N/mm ² | 12 N/mm ² | 16 N/mm ² |
|---------------------------------|---------------------|---------------------|----------------------|----------------------|----------------------|
| | | 1,5 | | | |
| | | 2,0 | | | |
| | | 2,5 | | | |
| | | 2,5 | | | |
| | | 3,5 | | | |

Factor for job site tests see annex C16 and displacements see annex C17

| | |
|--|------------|
| fischer injection system FIS V Zero for masonry | Annex C 10 |
| Performances Perforated calcium silicate (sand-lime) brick KSL, 3DF, Characteristic resistance under tension loading | |

Perforated calcium silicate (sand-lime) brick KSL, 3DF, EN 771-2:2015

Table C11.1: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading (Pre-positioned installation)

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 | | | | | |
|---|-------|-------|--------------|----|---------------|----|--------------|------------|---------------|------------|-----|------------|--|--|--|--|--|
| Internal threaded anchor FIS E | - | - | M8 | - | - | - | M10 | M12 | - | M12 | - | M16 | | | | | |
| | | | | | | | | | | | | | | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 16x85 | | 16x130 | | 20x85 | | 20x130 | | | | | | | | |
| Shear resistance $V_{RK} = V_{RK,b} = V_{RK,c,II} = V_{RK,c,\perp}$ [kN] depending on the mean compressive strength f_b; Installation and use condition d/d; (temperature range 24/40°C, 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | | |
| Mean compressive strength f_b | | | | | | | | | | | | | | | | | |
| 6 N/mm ² | | 1,5 | | | 2,0 | | | | | 3,0 | | | | | | | |
| 8 N/mm ² | | 2,0 | | | 2,5 | | | | | 3,5 | | | | | | | |
| 10 N/mm ² | | 2,5 | | | 3,0 | | | | | 4,5 | | | | | | | |
| 12 N/mm ² | | 2,5 | | | 3,5 | | | | | 5,0 | | | | | | | |
| 16 N/mm ² | | 3,5 | | | 4,0 | | | | | 6,5 | | | | | | | |


Table C11.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading (Push through installation)

| Anchor rod | M10 | M12 | M16 |
|---|------------|-----|------------|
| Perforated sleeve FIS H K | 18x130/200 | | 22x130/200 |
| Shear resistance $V_{RK} = V_{RK,b} = V_{RK,c,II} = V_{RK,c,\perp}$ [kN] depending on the mean compressive strength f_b; Installation and use condition d/d; (temperature range 24/40°C, 50/80°C and 72/120°C) | | | |
| Mean compressive strength f_b | | | |
| 6 N/mm ² | 2,0 | | 3,0 |
| 8 N/mm ² | 2,5 | | 3,5 |
| 10 N/mm ² | 3,0 | | 4,5 |
| 12 N/mm ² | 3,5 | | 5,0 |
| 16 N/mm ² | 4,0 | | 6,5 |


Factor for job site tests see annex C16 and displacements see annex C17

| | |
|--|------------|
| fischer injection system FIS V Zero for masonry | Annex C 11 |
| Performances Perforated calcium silicate (sand-lime) brick KSL, 3DF, Characteristic resistance under shear loading | |

Vertical perforated brick HLz, EN 771-1:2015

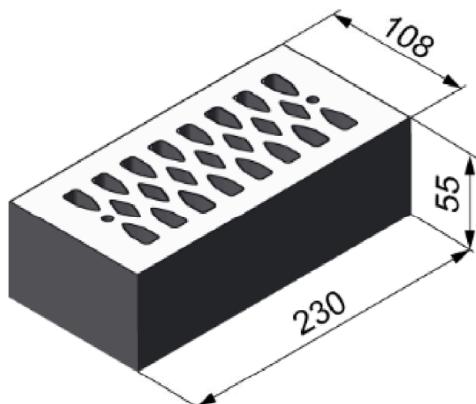

| Vertical perforated brick HLz, EN 771-1:2015 | | |
|---|--------------------|---------|
| Producer | e.g. Wienerberger. | |
| Nominal dimensions [mm] | length L | width W |
| | 230 | 108 |
| Mean gross dry density ρ [kg/dm ³] | $\geq 1,6$ | |
| Mean compressive strength [N/mm ²] | 8 / 10 / 12 / 16 | |
| Standard | EN 771-1:2015 | |

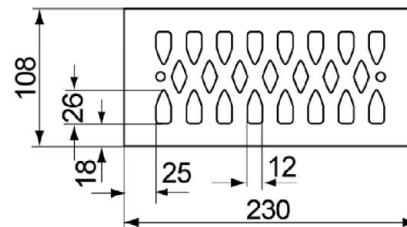

Dimensions see also Annex B 12

Table C12.1: Installation parameters

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|--------------------------------|-------|-------|-------------|--------|--------|-------|--------|--------------|--------|--------|--------|--------|
| Internal threaded anchor FIS E | - | - | M8 11x85 | - | - | - | - | M10 15x85 | M12 | - | - | - |
| | 12x50 | 12x85 | | | | | | | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | 16x85 | 16x130 | 16x130 | 20x85 | 20x130 | 20x130 | 20x130 | 20x130 | 20x130 | 20x130 |

Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

| | | |
|--------------------------|---------------------|---|
| Max. installation torque | max T_{inst} [Nm] | 5 |
|--------------------------|---------------------|---|

General installation parameters

| | | |
|---------------|--------------------------|-----|
| Edge distance | C _{min} | 100 |
| Spacing | S _{min} II | 100 |
| | S _{cr} II [mm] | 230 |
| | S _{min} \perp | 60 |
| | S _{cr} \perp | 60 |

Drilling method

Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill

Table C12.2: Group factors

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 | | | | | | | | | |
|--------------------------------|--------------------------------------|-------|-------------|----|-----|----|-----|--------------|-----|-----|-----|-----|--|--|--|--|--|--|--|--|--|
| Internal threaded anchor FIS E | - | - | M8 11x85 | - | - | - | - | M10 15x85 | M12 | - | - | - | | | | | | | | | |
| | 12x50 | 12x85 | | | | | | | | | | | | | | | | | | | |
| Group factors | $\alpha_{g,N}$ (S_{min} II) | [-] | 1,65 | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,v}$ (S_{min} II) | | 1,64 | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,N}$ (S_{min} \perp) | | 1,65 | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,v}$ (S_{min} \perp) | | 2,00 | | | | | | | | | | | | | | | | | | |

fischer injection system FIS V Zero for masonry

Performances
Vertical perforated brick HLz, dimensions, installation parameters

Annex C 12

Vertical perforated brick HLz, EN 771-1:2015

Table C13.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|--------------------------------|-------|-------|-------|-------|-----|--------|-----|-------|-----|--------|-----|-----|
| Internal threaded anchor FIS E | - | - | M8 | - | - | - | - | M10 | M12 | - | - | - |
| | | | 11x85 | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | | 16x85 | | 16x130 | | 20x85 | | 20x130 | | |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C)

| Mean compressive strength f_b | | | | | | | |
|---------------------------------|-----|-----|-----|-----|-----|-----|--|
| 8 N/mm ² | 1,2 | 1,5 | 1,5 | 2,5 | 1,5 | 2,5 | |
| 10 N/mm ² | 1,2 | 2,0 | 2,0 | 2,5 | 2,0 | 2,5 | |
| 12 N/mm ² | 1,5 | 2,0 | 2,0 | 3,0 | 2,0 | 3,0 | |
| 16 N/mm ² | 1,5 | 2,5 | 2,5 | 3,5 | 2,5 | 3,5 | |

Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 50/80°C and 72/120°C)

| Mean compressive strength f_b | | | | | | | |
|---------------------------------|------|-----|-----|-----|-----|-----|--|
| 8 N/mm ² | 0,6 | 1,2 | 1,2 | 1,5 | 1,2 | 1,5 | |
| 10 N/mm ² | 0,75 | 1,2 | 1,2 | 2,0 | 1,2 | 2,0 | |
| 12 N/mm ² | 0,75 | 1,5 | 1,5 | 2,0 | 1,5 | 2,0 | |
| 16 N/mm ² | 0,9 | 1,5 | 1,5 | 2,5 | 1,5 | 2,5 | |

Table C13.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

| Anchor rod | M8 | M8 | - | M8 | M10 | M8 | M10 | - | M12 | M16 | M12 | M16 |
|--------------------------------|-------|-------|-------|-------|-----|--------|-----|-------|-----|--------|-----|-----|
| Internal threaded anchor FIS E | - | - | M8 | - | - | - | - | M10 | M12 | - | - | - |
| | | | 11x85 | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 12x50 | 12x85 | | 16x85 | | 16x130 | | 20x85 | | 20x130 | | |

Shear resistance $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN] depending on the mean compressive strength f_b ; Installation and use condition d/d; (temperature range 24/40°C, 50/80°C and 72/120°C)

| Mean compressive strength f_b | | | | | | | | | | | | |
|---------------------------------|-----|-----|-----|-----|-----|-----|--|--|--|--|--|--|
| 8 N/mm ² | 2,0 | 3,5 | 2,5 | 3,5 | 2,5 | 3,5 | | | | | | |
| 10 N/mm ² | 2,0 | 4,0 | 3,0 | 4,0 | 3,0 | 4,0 | | | | | | |
| 12 N/mm ² | 2,0 | 4,0 | 3,0 | 4,5 | 3,0 | 4,5 | | | | | | |
| 16 N/mm ² | 2,5 | 5,0 | 3,5 | 5,0 | 3,5 | 5,0 | | | | | | |


Factor for job site tests see annex C16 and displacements see annex C17

fischer injection system FIS V Zero for masonry


Performances
Vertical perforated brick HLz, Characteristic resistance under tension and shear loading

Annex C 13

Lightweight aggregate concrete hollow block Hbl , EN 771-3:2015

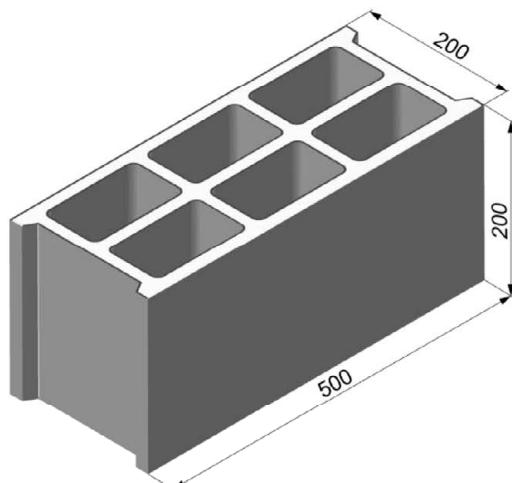

| Lightweight aggregate concrete hollow block Hbl, EN 771-3:2015 | | |
|---|---------------|---------|
| Producer | e.g. Sepa | |
| Nominal dimensions [mm] | length L | width W |
| | 500 | 200 |
| height H | 200 | |
| Mean gross dry density ρ [kg/dm ³] | $\geq 1,0$ | |
| Mean compressive strength [N/mm ²] | 2 / 4 | |
| Standard | EN 771-1:2015 | |

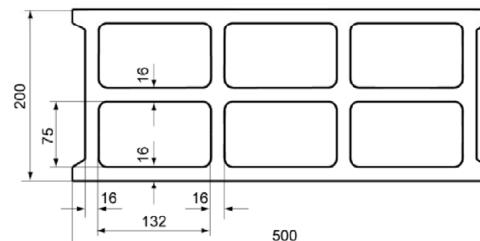

Dimensions see also Annex B 12

Table C14.1: Installation parameters

| | | | | | | | | | | | | |
|--------------------------------|-------|----|-----|--------|-----|------------|-----|-------|-----|-----|--------|-----|
| Anchor rod | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 | M12 | M16 |
| Internal threaded anchor FIS E | M8 | - | | - | | - | | M10 | M12 | - | | - |
| | 11x85 | | | | | | | 15x85 | | | | |
| Perforated sleeve FIS H K | 16x85 | | | 16x130 | | 18x130/200 | | 20x85 | | | 20x130 | |

Anchor rod and internal threaded anchor FIS E with perforated sleeve FIS H K

| | | |
|--------------------------|---------------------|---|
| Max. installation torque | max T_{inst} [Nm] | 2 |
|--------------------------|---------------------|---|

General installation parameters

| | | | |
|---------------|---------------------|------|-----|
| Edge distance | C_{min} | [mm] | 100 |
| | $S_{min \parallel}$ | | 100 |
| Spacing | $S_{cr \parallel}$ | | 500 |
| | $S_{min \perp}$ | | 100 |
| | $S_{cr \perp}$ | | 200 |

Drilling method

Hole drilling with rotary drill mode or hammer drilling with hard metal hammer drill

Table C14.2: Group factors

| | | | | | | | | | | | | | | | | | | | | | | |
|--------------------------------|------------------------------------|-----|------|--------|-----|------------|-----|-------|-----|-----|--------|-----|--|--|--|--|--|--|--|--|--|--|
| Anchor rod | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 | M12 | M16 | | | | | | | | | | |
| Internal threaded anchor FIS E | M8 | - | | - | | - | | M10 | M12 | - | | - | | | | | | | | | | |
| | 11x85 | | | | | | | 15x85 | | | | | | | | | | | | | | |
| Perforated sleeve FIS H K | 16x85 | | | 16x130 | | 18x130/200 | | 20x85 | | | 20x130 | | | | | | | | | | | |
| Group factors | $\alpha_{g,N} (S_{min \parallel})$ | [-] | 2,00 | | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,V} (S_{min \parallel})$ | | 1,28 | | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,N} (S_{min \perp})$ | | 1,40 | | | | | | | | | | | | | | | | | | | |
| | $\alpha_{g,V} (S_{min \perp})$ | | 2,00 | | | | | | | | | | | | | | | | | | | |

fischer injection system FIS V Zero for masonry

Performances

Lightweight aggregate concrete hollow block Hbl, dimensions, installation parameters

Annex C 14

Lightweight aggregate concrete hollow block Hbl, EN 771-3:2015

Table C15.1: Characteristic resistance to pull-out failure or brick breakout failure of a single anchor under tension loading

| Anchor rod | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 | M12 | M16 | | | | | | | | | | | | | | |
|--|--------------------------|-------|-----|--------|-----|------------|-----|-------|-------|--------|-----|--------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| Internal threaded anchor FIS E | M8 | - | - | - | - | - | - | M10 | M12 | - | - | - | | | | | | | | | | | | | | |
| | 11x85 | | | | | | | 15x85 | 15x85 | | | | | | | | | | | | | | | | | |
| | Perforated sleeve FIS HK | 16x85 | | 16x130 | | 18x130/200 | | 20x85 | | 20x130 | | 20x130 | | | | | | | | | | | | | | |
| Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b; Installation and use condition d/d; (temperature range 24/40°C) | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Mean compressive strength f_b | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 N/mm ² | 0,4 | | | | | | | | | | | 0,6 | | | | | | | | | | | | | | |
| 4 N/mm ² | 0,5 | | | | | | | | | | | 0,75 | | | | | | | | | | | | | | |
| Tension resistance $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,p,c} = N_{Rk,b,c}$ [kN] depending on the mean compressive strength f_b; Installation and use condition d/d; (temperature range 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Mean compressive strength f_b | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 N/mm ² | 0,3 | | | | | | | | | | | 0,5 | | | | | | | | | | | | | | |
| 4 N/mm ² | 0,4 | | | | | | | | | | | 0,6 | | | | | | | | | | | | | | |

Table C15.2: Characteristic resistance to local brick failure or brick edge failure of a single anchor under shear loading

| Anchor rod | - | M8 | M10 | M8 | M10 | M10 | M12 | - | M12 | M16 | M12 | M16 | | | | | | | | | | | | | | | |
|---|--------------------------|-------|-----|--------|-----|------------|-----|-------|-------|--------|-----|--------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| Internal threaded anchor FIS E | M8 | - | - | - | - | - | - | M10 | M12 | - | - | - | | | | | | | | | | | | | | | |
| | 11x85 | | | | | | | 15x85 | 15x85 | | | | | | | | | | | | | | | | | | |
| | Perforated sleeve FIS HK | 16x85 | | 16x130 | | 18x130/200 | | 20x85 | | 20x130 | | 20x130 | | | | | | | | | | | | | | | |
| Shear resistance $V_{Rk} = V_{Rk,b} = V_{Rk,c,II} = V_{Rk,c,\perp}$ [kN] depending on the mean compressive strength f_b; Installation and use condition d/d; (temperature range 24/40°C, 50/80°C and 72/120°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Mean compressive strength f_b | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 N/mm ² | 1,5 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 N/mm ² | 2,0 | | | | | | | | | | | | | | | | | | | | | | | | | | |

Factor for job site tests see annex C16 and displacements see annex C17

| | |
|---|------------|
| fischer injection system FIS V Zero for masonry | Annex C 15 |
| Performances Lightweight aggregate concrete hollow block Hbl Characteristic resistance under tension and shear loading | |

β-factors for job site tests

Table C16.1: β-factors for job site tests

| Installation and use conditions | d/d | | |
|---------------------------------|-------|-------|--------|
| temperature range [°C] | 24/40 | 50/80 | 72/120 |
| M8 | 0,81 | 0,47 | 0,45 |
| M10 | 0,62 | 0,49 | 0,45 |
| M12 / FIS E 11x85 | 0,62 | 0,49 | 0,52 |
| M16 / FIS E 15x85 | 0,56 | 0,45 | 0,59 |

Table C17.1: Displacements

| Material | Size | Effective embedment depth [mm] | N [kN] | δN_0 [mm] | δN_∞ [mm] | V [kN] | δV_0 [mm] | δV_∞ [mm] | |
|---|------|--------------------------------|--------|-------------------|------------------------|--------|-------------------|------------------------|--|
| Solid brick acc. to C4-C5 | M8 | 50 | 0,57 | 0,00 | 0,00 | 0,71 | 0,08 | 0,12 | |
| | | 80 | 1,00 | 0,00 | 0,00 | 1,71 | 0,32 | 0,48 | |
| | M10 | 50 | 0,57 | 0,00 | 0,00 | 0,71 | 0,18 | 0,27 | |
| | | 80 | 1,00 | 0,01 | 0,02 | 1,71 | 0,50 | 0,75 | |
| | M12 | 50 | 1,29 | 0,03 | 0,06 | 0,71 | 0,05 | 0,08 | |
| | | 80 | 1,00 | 0,01 | 0,02 | 1,71 | 0,75 | 1,13 | |
| | M16 | 50 | 1,29 | 0,03 | 0,06 | 0,71 | 0,35 | 0,53 | |
| | | 80 | 1,71 | 0,04 | 0,08 | 1,71 | 0,20 | 0,30 | |
| Solid calcium silicate (sand-lime) brick acc. to C6-C7 | M8 | 50 | 0,86 | 0,03 | 0,06 | 1,43 | 0,32 | 0,48 | |
| | | 80 | 0,86 | 0,00 | 0,00 | 1,43 | | | |
| | M10 | 50 | 0,86 | 0,00 | 0,00 | 1,43 | 0,34 | 0,51 | |
| | | 80 | 1,71 | 0,02 | 0,04 | 1,43 | | | |
| | M12 | 50 | 0,86 | 0,03 | 0,06 | 1,43 | 0,12 | 0,18 | |
| | | 80 | 1,71 | 0,04 | 0,08 | 1,43 | 0,32 | 0,48 | |
| | M16 | 50 | 0,86 | 0,03 | 0,06 | 1,43 | 0,57 | 0,86 | |
| | | 80 | 1,14 | 0,02 | 0,04 | 1,43 | 0,20 | 0,03 | |
| Perforated calcium silicate (sand-lime) brick acc. to C8-C11 | M8 | 12x50 | 0,71 | 0,01 | 0,02 | 1,00 | 0,16 | 0,24 | |
| | | 12x85 | | 0,02 | 0,04 | 1,14 | 0,57 | 0,86 | |
| | M8 | 16x85 | 0,57 | 0,02 | 0,04 | 1,14 | 1,03 | 1,55 | |
| | M10 | 16x130 | 1,29 | 0,06 | 0,12 | 1,86 | 1,15 | 1,73 | |
| | M12 | 20x85 | 0,57 | 0,03 | 0,06 | 1,86 | 1,24 | 1,86 | |
| | M16 | 20x130 | 1,29 | 0,04 | 0,08 | | | | |
| | M8 | 12x50 | 0,43 | 0,00 | 0,00 | 0,71 | 0,25 | 0,38 | |
| | | 12x85 | 0,71 | 0,00 | 0,00 | 1,43 | 0,61 | 0,92 | |
| Perforated brick Hlz acc. to C12-C13 | M8 | 16x85 | 0,71 | 0,03 | 0,06 | 1,00 | 0,36 | 0,54 | |
| | | 16x130 | 1,00 | 0,02 | 0,04 | 1,43 | 0,30 | 0,45 | |
| | M12 | 20x85 | 0,71 | 0,00 | 0,00 | 1,00 | 0,22 | 0,33 | |
| | M16 | 20x130 | 1,00 | 0,04 | 0,08 | 1,43 | 0,17 | 0,26 | |
| | M8 | 16x85 | 0,14 | 0,03 | 0,06 | 0,57 | 1,54 | 2,31 | |
| | | 16x130 | 0,14 | 0,02 | 0,04 | 0,57 | 1,01 | 1,52 | |
| Lightweight aggregate concrete hollow block Hbl acc. to C14-C15 | M12 | 20x85 | 0,14 | 0,06 | 0,12 | 0,57 | 1,31 | 1,97 | |
| | | 20x130 | 0,21 | 0,04 | 0,08 | 0,57 | 0,82 | 1,23 | |
| <i>fischer injection system FIS V Zero for masonry</i> | | | | | | | | | |
| Performances displacements | | | | | | | | | |
| Annex C 17 | | | | | | | | | |