

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-18/0682
of 19 April 2022

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

BAU!ES Ceiling Anchor DN-Z

Product family
to which the construction product belongs

Fasteners for use in concrete for
redundant non-structural systems

Manufacturer

BAUKING GmbH
Phönixseestraße 11
44263 Dortmund
DEUTSCHLAND

Manufacturing plant

BAUKING

This European Technical Assessment
contains

8 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330747-00-0601, Edition 06/2018

This version replaces

ETA-18/0682 issued on 22 March 2019

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The BAUIES Ceiling Anchor DN-Z is an anchor made of galvanized steel which is placed into a drilled hole and anchored by deformation-controlled expansion.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 1

3.2 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance for all load directions and modes of failure for simplified design	See Annex C 1
Durability	See Annex B 1

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330747-00-0601, the applicable European legal act is: [97/161/EC].

The system to be applied is: 2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 19 April 2022 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Baderschneider

Product installation conditions, product marking and product dimensions


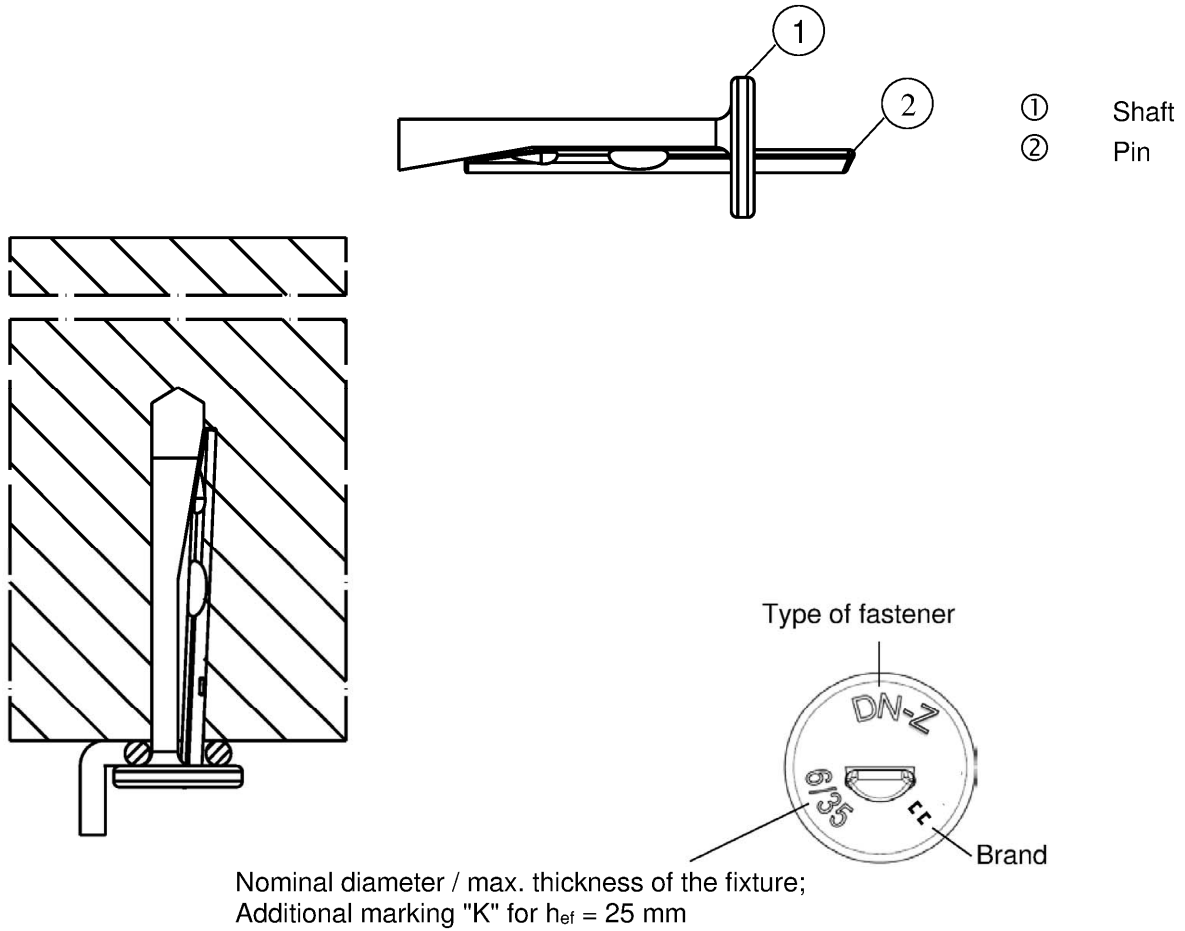


Table A1.1: Dimensions

Size	DN-Z			
	6/5 K	6/5	6/35 K	6/35
Length of the $\frac{\text{pin}}{\text{shaft}}$ $\frac{L_1}{L_2}$ [mm]	36	43	66	73
Diameter of the head $D \geq$	13			

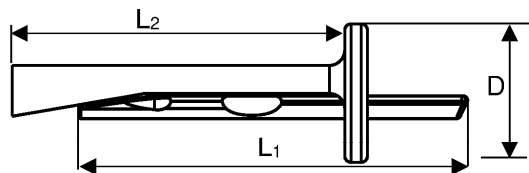

(Fig. not to scale)

BAUIES Ceiling Anchor DN-Z

Product description


Product installation conditions, product marking and product dimensions

Annex A 1

Specifications of intended use	
Anchorage subject to:	
Size	DN-Z 6
Static and quasi-static loads	✓
Only for use in concrete for redundant non-structural systems	
Fire exposure	
<p>Base materials:</p> <ul style="list-style-type: none"> • Compacted reinforced and unreinforced normal weight concrete without fibres according to EN 206:2013 • Strength classes C12/15 to C50/60 according to EN 206:2013 • Cracked and non-cracked concrete <p>Use conditions (Environmental conditions):</p> <ul style="list-style-type: none"> • Anchorage subject to dry internal conditions <p>Design:</p> <ul style="list-style-type: none"> • Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work • Verifiable calculation notes and drawings have to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.). • Design of fastenings according to EN 1992-4:2018, Design method B and Technical Report TR 055, Edition February 2018. 	
BAU!ES Ceiling Anchor DN-Z	
Intended use	Annex B 1
Specifications	


Table B2.1: Installation parameters

Size			DN-Z			
			6/5 K	6/5	6/35 K	6/35
Thickness of the fixture	t_{fix}	\leq	5		35	
Nominal drill hole diameter	d_0		6			
Diameter of clearance hole in the fixture	d_f	\leq	7			
Maximum bit diameter	$d_{cut,max}$		6,40			
Effective embedment depth	h_{ef}	[mm]	25	32	25	32
Depth of drill hole to deepest point	with hole cleaning	h_1	30	37	30	37
	without hole cleaning		35	42	35	42
Minimum thickness of concrete member	h_{min}		80			

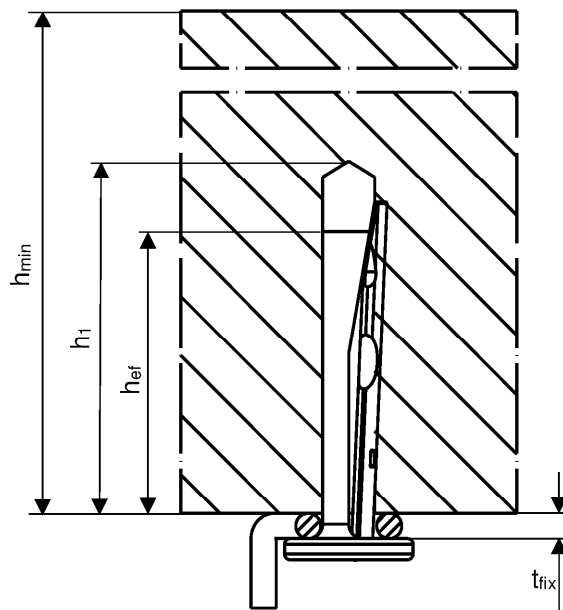


Installation instructions


- Hammer or hollow drilling only
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Positioning of the drill holes without damaging the reinforcement
- In case of aborted hole: New drilling at a minimum distance twice the depth of aborted hole away of or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of the load application




1: Drill the hole



2: Set the fastener



3: Set the pin, until flush to the surface



4: Installed fastener

(Fig. not to scale)

BAUIES Ceiling Anchor DN-Z

Intended use

Installation parameters and installation instructions

Annex B 2

Table C1.1: Characteristic resistance

Size	DN-Z 6	
For all load directions and for all failures modes		
Effective embedment depth	h_{ef} [mm]	25 32
Characteristic resistance in cracked and non- cracked concrete	C12/15	1,0 1,5
	C20/25 to C50/60	1,5 2,0
Characteristic edge distance	$C_{cr,N} = C_{min}$	70 60
	spacing	$S_{cr,N} = S_{min}$
Partial factor	γ_M [-]	1,5
Installation factor	γ_{inst} [-]	1,0
Shear load with lever arm		
Characteristic bending resistance	$M^0_{Rk,s}$ [Nm]	4,4
Partial factor for steel failure	$\gamma_{Ms}^{1)}$ [-]	1,25

¹⁾ In absence of other national regulations

Table C1.2: Characteristic resistance under fire exposure for all effective embedment depths

Size	DN-Z 6		
Steel failure for tension and shear load			
R30	$F_{Rk,s,fi30}^{1)}$	1,00	
R60	$F_{Rk,s,fi60}^{1)}$	0,50	
R90	$F_{Rk,s,fi90}^{1)}$	0,34	
R120	$F_{Rk,s,fi120}^{1)}$	0,26	
R30 – R120	Characteristic resistance with lever arm	$M^0_{Rk,s,fi}$ [Nm]	No performance assessed
Spacing and edge distance			
R30 – R120	$S_{cr,fi}$	200	
	$C_{cr,fi}$	150	

¹⁾ $N_{Rk,s,fi} = N_{Rk,p,fi} = V_{Rk,s,fi} = F_{Rk,s,fi}$
For fire exposure from more than one side $C_{min} \geq 300$ mm

BAU!ES Ceiling Anchor DN-Z

Performances

Characteristic resistance and characteristic resistance under fire exposure

Annex C 1