

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-21/0969**  
**of 16 May 2022**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Connector Hilti HUS4-H

Product family  
to which the construction product belongs

Connector for Strengthening of existing concrete  
structures by concrete overlay

Manufacturer

Hilti AG Liechtenstein  
Feldkircherstraße 100  
9494 Schaan  
FÜRSTENTUM LIECHTENSTEIN

Manufacturing plant

Hilti Cooperation

This European Technical Assessment  
contains

17 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 332347-00-0601-v01, Edition 03/2021

This version replaces

ETA-21/0969 issued on 27 January 2022

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The Connector Hilti HUS4-H is a concrete screw made of galvanized steel anchored into a predrilled cylindrical drill hole in existing concrete. The special thread of the concrete screw cuts an internal thread into the member while setting. The Hilti HUS4-H is connecting two layers of concrete cast at different times (existing concrete and concrete overlay). The side with head of concrete screw is finally embedded in the concrete overlay.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Existing concrete, characteristic resistance to tension load (static and quasi-static loading): - resistances, robustness, edge distance to prevent splitting - minimum edge distance and spacing	See Annex C1 and C2 See Annex B2, B3 and B4
Existing concrete, characteristic resistance for seismic performance categories C1 and C2	See Annex C4
Concrete overlay, characteristic resistance to tension load (static and quasi-static loading): - resistances, edge distance to prevent splitting - minimum edge distance and spacing	See Annex C3 See Annex B2, B3 and B4
Concrete overlay, characteristic resistance for seismic performance categories C1 and C2	See Annex C5
Shear interface parameter under static and quasi-static, fatigue and seismic cyclic loading - material and geometric parameters - factor for fatigue cyclic loading	See Annex C6 No performance assessed

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1

English translation prepared by DIBt

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with European Assessment Document EAD No. 332347-00-0601-v01 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 16 May 2022 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock  
Referatsleiterin


*beglaubigt:*  
Tempel

## Installed condition

Connector Hilti HUS4-H

Existing concrete

Concrete overlay

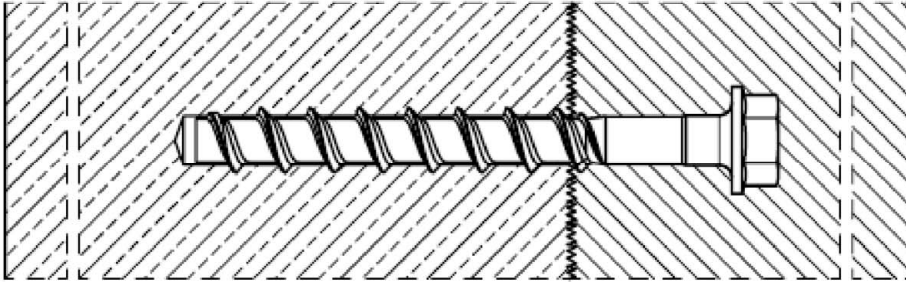


Connector Hilti HUS4-H

Product description  
Installed condition

Annex A1

**Product description: Connector**

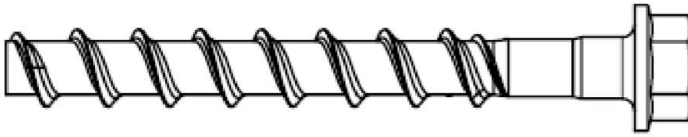


**Table A1: Materials**

Part	Material
Connector HUS4-H	Carbon steel Rupture elongation $A_5 \leq 8\%$

**Table A2: Connector dimensions and marking HUS4-H**

Connector HUS4-H	8			10			12			14			16	
Nominal diameter d [mm]	8			10			12			14			16	
Nominal embedment depth $h_{nom}$ [mm]	1	2	3	1	2	3	1	2	3	1	2	3	1	2
	40	60	70	55	75	85	60	80	100	65	85	100	85	130
Length of connector min / max L [mm]	100 / 150			100 / 305			100 / 150			130 / 150			140 / 205	
Thickness of head $t_h$ [mm]	7,6			9,1			10,4			11,8			14,5	

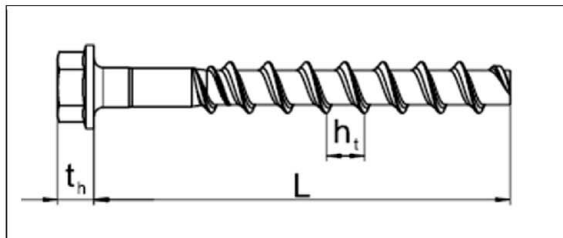

<b>HUS4:</b>	Hilti Universal Screw 4 <sup>th</sup> generation
<b>H:</b>	Hexagonal head, galvanized
<b>HF:</b>	Hexagonal head, multilayer coating
<b>10:</b>	Nominal screw diameter d [mm]
<b>100:</b>	Length of screw L [mm]

**Connector Hilti HUS4-H**

**Annex A2**

**Product description**  
Materials and connector dimensions

## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loadings
- Seismic performance category C1 and C2
- Surface roughness “very smooth” to “very rough” of the shear interface acc. to EOTA Technical Report TR 066, Edition November 2020

### Base materials:

Connector for use to strengthen existing concrete by concrete overlay. Both concrete is compacted reinforced or unreinforced normal weight concrete without fibres with strength classes in the range C20/25 to C50/60 all in accordance with EN 206:2013+A1:2016; cracked and uncracked concrete.


### Design:

- The design of an anchorage and the specification of the fastener is under the control of an engineer experienced in anchorages and concrete work.
- Post-installed shear connections are designed in accordance with EOTA Technical Report TR 066, Edition November 2020.
- For the concrete overlay following requirements on the mixture apply:
  - Concrete compressive strength of the new concrete shall be higher than the concrete compressive strength of the existing concrete.
  - Use of concrete with low shrinkage is recommended.
  - Slump of fresh concrete  $f \geq 380$  mm, a slump value  $f \geq 450$  mm is recommended, if applicable.

### Installation:

- The fastener installation is executed by trained personnel, ensuring that the Installation instruction and the specifications are observed.
- Hammer drilling with cleaning for sizes 8 to 16.
- Hammer drilling with Hilti hollow drill bit TE-CD for sizes 12 and 14.
- Hammer drilling without cleaning for sizes 8 to 14.
- The requirements for construction works given in EOTA Technical Report TR 066, Edition November 2020 have to be considered.

## Installation parameters

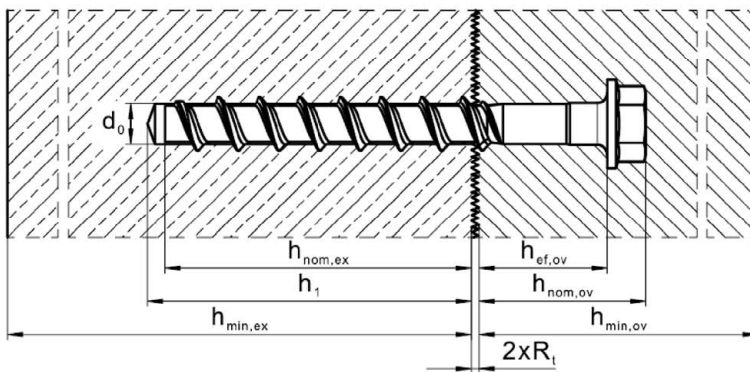

$h_{nom,ex}$  Nominal embedment depth in existing concrete  
 $h_1$  Depth of drill hole  
 $h_{ex}$  Thickness of existing concrete  
 $R_t$  Roughness according EOTA Technical Report TR 066:2020-11

$h_{ef,ov}$  Effective embedment depth in concrete overlay  
 $h_{nom,ov}$  Overall embedment depth in concrete overlay  
 $h_{ov}$  Thickness of concrete overlay

**Connector Hilti HUS4-H**

**Intended Use**  
Specifications and Installation parameters

**Annex B1**

**Table B1: Installation parameters HUS4-H size 8 and 10**

Connector HUS4-H			8			10		
<b>Existing concrete</b>								
			$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$	$h_{nom3}$
Nominal embedment depth	$h_{nom,ex}$	[mm]	40	60	70	55	75	85
Nominal drill hole diameter	$d_0$	[mm]	8			10		
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	8,45			10,45		
Wrench size	s	[mm]	13			15		
Depth of drill hole for cleaned hole hammer drilling	$h_1 \geq$	[mm]	$(h_{nom} + 10 \text{ mm})$					
			50	70	80	65	85	95
Depth of drill hole for uncleanded hole hammer drilling	$h_1 \geq$	[mm]	$(h_{nom} + 10 \text{ mm}) + 2 \cdot d_0$					
			66	86	96	85	105	115
Minimum thickness of concrete member	$h_{min,ex} \geq$	[mm]	$(h_1 + 30 \text{ mm})$					
			80	100	120	100	130	140
Minimum spacing	$s_{min,ex} \geq$	[mm]	35			40		
Minimum edge distance	$c_{min,ex} \geq$	[mm]	35			40		
Hilti Setting tool <sup>1)</sup>			SIW 6 AT-A22 SIW 6.2 AT-A22 gear 1			SIW 22T-A SIW 6 AT-A22 SIW 6.2 AT-A22 SIW 8.1 AT gear 1 SIW 9-A22		
<b>Concrete overlay</b>								
Effective embedment depth	$\frac{\min}{\max} h_{ef,ov}$	[mm]	40					
			$L - h_{nom,ex} - 2 \cdot R_t$ <sup>2)</sup>					
Overall embedment depth	$h_{nom,ov}$	[mm]	$h_{ef,ov} + t_h$					
Min. thickness of concrete overlay	$h_{min,ov} \geq$	[mm]	$h_{nom,ov} + c_{nom}$ <sup>3)</sup>					
Minimum spacing	$s_{min,ov} \geq$	[mm]	40			45		
Minimum edge distance	$c_{min,ov} \geq$	[mm]	$10 + c_{nom}$ <sup>3)</sup>			$15 + c_{nom}$ <sup>3)</sup>		

<sup>1)</sup> Installation with other impact screw driver of equivalent power is possible.

<sup>2)</sup> "R<sub>t</sub>" Roughness according to EOTA Technical Report TR 066:2020-11.

<sup>3)</sup> "c<sub>nom</sub>" Nominal concrete cover according to EN 1992-1-1:2004 + AC:2010

Connector Hilti HUS4-H

Intended use  
Installation parameters

Annex B2



**Table B2: Installation parameters HUS4-H size 12 and 14**

Connector size HUS4-H			12			14			
<b>Existing concrete</b>									
			$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	
Nominal embedment depth	$h_{nom,ex}$	[mm]	60	80	100	65	85	100	
Nominal drill hole diameter	$d_0$	[mm]	12			14			
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	12,5			14,5			
Wrench size	s	[mm]	17			21			
Depth of drill hole for cleaned hole hammer drilling	$h_1 \geq$	[mm]	$(h_{nom} + 10 \text{ mm})$						
			70	90	110	75	95	110	
Depth of drill hole for uncleanded hole hammer drilling	$h_1 \geq$	[mm]	$(h_{nom} + 10 \text{ mm}) + 2 \cdot d_0$						
			94	114	134	103	123	138	
Minimum thickness of concrete member	$h_{min,ex} \geq$	[mm]	$(h_1 + 30 \text{ mm})$						
			110	130	150	120	160	200	
Minimum spacing	$s_{min,ex} \geq$	[mm]	50			60			
Minimum edge distance	$c_{min,ex} \geq$	[mm]	50			60			
Hilti Setting tool <sup>1)</sup>			SIW 22T-A SIW 6.2 AT-A22 SIW 8.1 AT SIW 9-A22			SIW 22T-A SIW 6.2 AT-A22 SIW 8.1 AT SIW 9-A22			
<b>Concrete overlay</b>									
Effective embedment depth	$\frac{\min}{\max}$	$h_{ef,ov}$	[mm]	40					
				$L - h_{nom,ex} - 2 \cdot R_t$ <sup>2)</sup>					
Overall embedment depth		$h_{nom,ov}$	[mm]	$h_{ef,ov} + t_h$					
Min. thickness of concrete overlay		$h_{min,ov} \geq$	[mm]	$h_{nom,ov} + c_{nom}$ <sup>3)</sup>					
Minimum spacing		$s_{min,ov} \geq$	[mm]	50			60		
Minimum edge distance		$c_{min,ov} \geq$	[mm]	$15 + c_{nom}$ <sup>3)</sup>			$15 + c_{nom}$ <sup>3)</sup>		

<sup>1)</sup> Installation with other impact screw driver of equivalent power is possible.

<sup>2)</sup> "R<sub>t</sub>" Roughness according to EOTA Technical Report TR 066:2020-11.

<sup>3)</sup> "c<sub>nom</sub>" Nominal concrete cover according to EN 1992-1-1:2004 + AC:2010

Connector Hilti HUS4-H

Intended use  
Installation parameters

Annex B3

**Table B3: Installation parameters HUS4-H size 16**

Connector size HUS4-H				16	
<b>Existing concrete</b>					
Nominal embedment depth	$h_{nom,ex}$	[mm]		$h_{nom1}$	$h_{nom2}$
				85	130
Nominal drill hole diameter	$d_0$	[mm]	16		
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	16,5		
Wrench size	s	[mm]	24		
Depth of drill hole for cleaned hole hammer drilling	$h_1 \geq$	[mm]		$(h_{nom} + 10 \text{ mm})$	
				95	140
Minimum thickness of concrete member	$h_{min,ex} \geq$	[mm]		$(h_1 + 30 \text{ mm})$	
				130	195
Minimum spacing	$s_{min,ex} \geq$	[mm]	90		
Minimum edge distance	$c_{min,ex} \geq$	[mm]	65		
Hilti Setting tool <sup>1)</sup>				SIW 22T-A SIW 6.2 AT-A22 SIW 8.1 AT SIW 9-A22	
<b>Concrete overlay</b>					
Effective embedment depth	$\frac{\min}{\max}$	$h_{ef,ov}$	[mm]	40	
				$L - h_{nom,ex} - 2 \cdot R_t$ <sup>2)</sup>	
Overall embedment depth	$h_{nom,ov}$	[mm]	$h_{ef,ov} + t_h$		
Min. thickness of concrete overlay	$h_{min,ov} \geq$	[mm]	$h_{nom,ov} + c_{nom}$ <sup>3)</sup>		
Minimum spacing	$s_{min,ov} \geq$	[mm]	65		
Minimum edge distance	$c_{min,ov} \geq$	[mm]	$20 + c_{nom}$ <sup>3)</sup>		

<sup>1)</sup> Installation with other impact screw driver of equivalent power is possible.

<sup>2)</sup> "R<sub>t</sub>" Roughness according to EOTA Technical Report TR 066:2020-11.

<sup>3)</sup> "c<sub>nom</sub>" Nominal concrete cover according to EN 1992-1-1:2004 + AC:2010

**Connector Hilti HUS4-H**


**Intended use**  
Installation parameters

**Annex B4**


## Installation instructions

### Hole drilling and cleaning

Hammer drilling (HD) all sizes (size 16 with cleaning only)




With cleaning  
Drill hole depth  $h_1$  according to Table B1 to B3.




No cleaning is allowed when 3x ventilation<sup>1)</sup> after drilling is executed.  
Drill hole depth  $h_1 = h_{nom} + 10 \text{ mm} + 2 * d_0$  according to Table B1 to B3.  
<sup>1)</sup> moving the drill bit in and out of the drill hole 3 times after the recommended drilling depth  $h_1$  is achieved. This procedure shall be done with both revolution and hammer functions activated in the drilling machine. For more details read the relevant installation instruction (MPII).

Hammer drilling with Hilti hollow drill bit (HDB) TE-CD size 12 to 14.




No cleaning needed.  
Drill hole depth  $h_1$  according to Table B1 to B3


### Connector setting

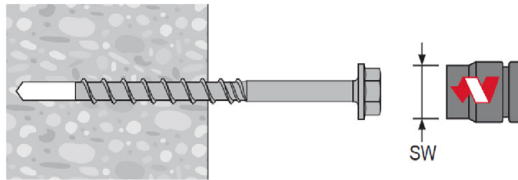


Install the screw anchor by impact screw driver.

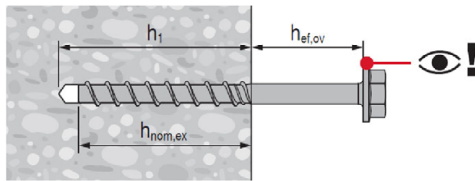

Set the HUS4-H to the desired anchoring embedment depth  $h_{nom,ex}$  in existing concrete and ensure the desired embedment depth  $h_{ef,ov}$  for concrete overlay.

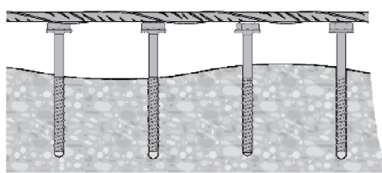

After connector installation, the rebar connections can be done to the connectors.

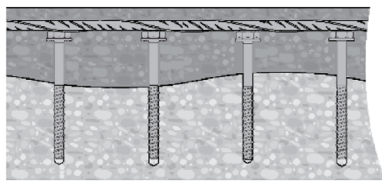

Observe the required condition of the surface before casting and the use of the correct concrete composition.

Connector Hilti HUS4-H

Intended use  
Installation instructions

Annex B5

**Table C1: Essential characteristics of connector Hilti HUS4-H in existing concrete under static and quasi-static tension load**

Connector HUS4-H			8			10		
			$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$	$h_{nom3}$
Nominal embedment depth	$h_{nom,ex}$	[mm]	40	60	70	55	75	85
<b>Steel failure</b>								
Characteristic resistance	$N_{Rk,s,ex}$	[kN]	36,0			55,0		
Partial factor	$\gamma_{Ms,N,ex}^{1)}$	[-]	1,5					
<b>Pull-out failure</b>								
Characteristic resistance in uncracked concrete C20/25	$N_{Rk,p,ex}$	[kN]	$\geq N_{Rk,c}^{2)}$			13	22	$\geq N_{Rk,c}^{2)}$
Characteristic resistance in cracked concrete C20/25	$N_{Rk,p,ex}$	[kN]	5,5	$\geq N_{Rk,c}^{2)}$				
Increasing factor for $N_{Rk,p} = N_{Rk,p(C20/25)} * \psi_{c,ex}$	$\psi_{c,ex}$	[-]	$(f_{ck}/20)^{0,5}$					
<b>Concrete cone failure</b>								
Effective embedment depth	$h_{ef,ex}$	[mm]	30,6	47,6	56,1	42,5	59,5	68,0
Factor for	uncracked concrete	$k_{ucr,N,ex}$	11,0					
	cracked concrete	$k_{cr,N,ex}$	7,7					
Concrete cone failure	Edge distance	$c_{cr,N,ex}$	$1,5 h_{ef}$					
	Spacing	$s_{cr,N,ex}$	$3 h_{ef}$					
Splitting failure	Edge distance	$c_{cr,sp,ex}$	$1,5 h_{ef}$			$1,65 h_{ef}$		
	Spacing	$s_{cr,sp,ex}$	$3 h_{ef}$			$3,3 h_{ef}$		
Installation factor	$\gamma_{inst,ex}$	[-]	1,0			1,2	1,0	

<sup>1)</sup> In absence of other national regulations.

<sup>2)</sup>  $N_{Rk,c}$  according to EN 1992-4:2018

Connector Hilti HUS4-H

**Performances**

Essential characteristics in existing concrete under static and quasi-static tension load

**Annex C1**

**Table C2: Essential characteristics of connector Hilti HUS4-H in existing concrete under static and quasi-static tension load**

Connector HUS4-H			12			14			16		
			$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$	
Nominal embedment depth	$h_{nom,ex}$	[mm]	60	80	100	65	85	100	85	130	
<b>Steel failure</b>											
Characteristic resistance	$N_{Rk,s,ex}$	[kN]	79,0			101,5			107,7		
Partial factor	$\gamma_{Ms,N,ex}^{1)}$	[-]	1,5								
<b>Pull-out failure</b>											
Characteristic resistance in uncracked concrete C20/25	$N_{Rk,p,ex}$	[kN]	$\geq N_{Rk,c}^{2)}$						22	46	
Characteristic resistance in cracked concrete C20/25	$N_{Rk,p,ex}$	[kN]	10	$\geq N_{Rk,c}^{2)}$						17	34
Increasing factor for $N_{Rk,p} = N_{Rk,p(C20/25)} * \psi_{c,ex}$	$\psi_{c,ex}$	[-]	$(f_{ck}/20)^{0,5}$								
<b>Concrete cone and splitting failure</b>											
Effective embedment depth	$h_{ef,ex}$	[mm]	45,9	62,9	79,9	49,3	66,3	79,1	66,6	104,9	
Factor for	uncracked concrete	$k_{ucr,N,ex}$	11,0								
	cracked concrete	$k_{cr,N,ex}$	7,7								
Concrete cone failure	Edge distance	$c_{cr,N,ex}$	$1,5 h_{ef}$								
	Spacing	$s_{cr,N,ex}$	$3 h_{ef}$								
Splitting failure	Edge distance	$c_{cr,sp,ex}$	$1,65 h_{ef}$			$1,60 h_{ef}$					
	Spacing	$s_{cr,sp,ex}$	$3,30 h_{ef}$			$3,20 h_{ef}$					
Installation factor	$\gamma_{inst,ex}$	[-]	1,0								

<sup>1)</sup> In absence of other national regulations.

<sup>2)</sup>  $N_{Rk,c}$  according to EN 1992-4:2018

Connector Hilti HUS4-H

**Performances**

Essential characteristics in existing concrete under static and quasi-static tension load

**Annex C2**

**Table C3: Essential characteristics of connector Hilti HUS4-H in concrete overlay under static and quasi-static tension load**

Connector HUS4			8	10	12	14	16
<b>Steel failure</b>							
Characteristic resistance	$N_{Rk,s,ov}$	[kN]	36,0	55,0	79,0	101,5	107,7
Partial factor	$\gamma_{Ms,N,ov}$	[-]	1,5				
<b>Pull-out failure</b>							
Projected area of the head	$A_h$	[mm <sup>2</sup> ]	187,1	249,1	320,5	510,9	637,3
Factor for	$k_2$	uncracked concrete	10,5				
		cracked concrete	7,5				
<b>Concrete cone failure</b>							
Effective embedment depth	$h_{ef,ov}$	min	40				
		max	$L - h_{nom,ex} - 2 \cdot R_t^{1)}$				
Factor for	$k_{ucr,N,ov}$	uncracked concrete	12,7				
		cracked concrete	8,9				
Edge distance	$c_{cr,N,ov}$	[mm]	1,5 $h_{ef}$				
Spacing	$s_{cr,N,ov}$	[mm]	3,0 $h_{ef}$				
<b>Splitting failure</b>							
Edge distance	$c_{cr,sp,ov}$	[mm]	3,0 $h_{ef}$				
Spacing	$s_{cr,sp,ov}$	[mm]	6,0 $h_{ef}$				
<b>Blow-out failure</b>							
Projected area of the head	$A_h$	[mm <sup>2</sup> ]	187,1	249,1	320,5	510,9	637,3
Factor for uncracked concrete	$k_5$	[-]	12,2				
Factor for cracked concrete		[-]	8,7				

<sup>1)</sup> "R<sub>t</sub>" Roughness according to EOTA Technical Report TR 066:2020-11

Connector Hilti HUS4-H

**Performances**

Essential characteristics in concrete overlay under static and quasi-static tension load

**Annex C3**

**Table C4: Essential characteristics of connector Hilti HUS4-H in existing concrete under seismic performance category C1**

Connector HUS4-H			8		10		12	
			$h_{nom2}$	$h_{nom3}$	$h_{nom2}$	$h_{nom3}$	$h_{nom2}$	$h_{nom3}$
Nominal embedment depth	$h_{nom,ex}$	[mm]	60	70	75	85	80	100
<b>Steel failure for tension load</b>								
Characteristic resistance	$N_{Rk,s,C1,ex}$	[kN]	36,0		55,0		79,0	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5					
<b>Pull-out failure</b>								
Characteristic resistance in cracked concrete	$N_{Rk,p,C1,ex}$	[kN]	$\geq N_{Rk,c}^{0,2)}$					

Connector HUS4-H			14		16	
			$h_{nom2}$	$h_{nom3}$	$h_{nom1}$	$h_{nom2}$
Nominal embedment depth	$h_{nom,ex}$	[mm]	85	110	85	130
<b>Steel failure for tension load</b>						
Characteristic resistance	$N_{Rk,s,C1,ex}$	[kN]	101,5		107,7	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5			
<b>Pull-out failure</b>						
Characteristic resistance in cracked concrete	$N_{Rk,p,C1,ex}$	[kN]	$\geq N_{Rk,c}^{0,2)}$		7,5	19,0

<sup>1)</sup> In absence of other national regulations.

<sup>2)</sup>  $N_{Rk,c}^0$  according to EN 1992-4:2018

**Table C5: Essential characteristics of connector Hilti HUS4-H in existing concrete under seismic performance category C2**

Connector HUS4-H			8	10	12	14
			$h_{nom3}$	$h_{nom3}$	$h_{nom3}$	$h_{nom3}$
Nominal embedment depth	$h_{nom,ex}$	[mm]	70	85	100	100
<b>Steel failure for tension</b>						
Characteristic resistance	$N_{Rk,s,C2,ex}$	[kN]	36,0	55,0	79,0	101,5
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5			
<b>Pull-out failure</b>						
Characteristic resistance in cracked concrete	$N_{Rk,p,C2,ex}$	[kN]	2,7	5,4	11,4	11,4

<sup>1)</sup> In absence of other national regulations.

<b>Connector Hilti HUS4-H</b>	<b>Annex C4</b>
<b>Performances</b> Essential characteristics in existing concrete under seismic performance category C1 and C2	

**Table C6: Essential characteristics of connector Hilti HUS4-H in concrete overlay under seismic performance category C1**

Connector HUS4-H			8	10	12
<b>Steel failure for tension load</b>					
Characteristic resistance	$N_{Rk,s,C1,ov}$	[kN]	36,0	55,0	79,0
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5		
<b>Pull-out failure</b>					
Characteristic resistance in cracked concrete	$N_{Rk,p,C1,ov}$	[kN]	$\geq N_{Rk,p,C1,ex}$		

Connector HUS4-H			14	16
<b>Steel failure for tension load</b>				
Characteristic resistance	$N_{Rk,s,C1,ov}$	[kN]	101,5	107,7
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5	
<b>Pull-out failure</b>				
Characteristic resistance in cracked concrete	$N_{Rk,p,C1,ov}$	[kN]	$\geq N_{Rk,p,C1,ex}$	

<sup>1)</sup> In absence of other national regulations.

**Table C7: Essential characteristics of connector Hilti HUS4-H in concrete overlay under seismic performance category C2**

Connector HUS4-H			8	10	12	14
<b>Steel failure for tension</b>						
Characteristic resistance	$N_{Rk,s,C2,ov}$	[kN]	36,0	55,0	79,0	101,5
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5			
<b>Pull-out failure</b>						
Characteristic resistance in cracked concrete	$N_{Rk,p,C2,ov}$	[kN]	$\geq N_{Rk,p,C2,ex}$			

<sup>1)</sup> In absence of other national regulations.

**Connector Hilti HUS4-H**

**Performances**  
Essential characteristics in concrete overlay under seismic performance category C1 and C2

**Annex C5**



**Table C8: Essential characteristics of connector Hilti HUS4-H size 8 to 16 for the shear interface under static and quasi-static loading and seismic performance category**

Connector size HUS4-H			8	10	12	
Characteristic yield strength	$f_{yk}$	[N/mm <sup>2</sup> ]	606	639	613	
Product specific factor for ductility	$\alpha_{k1}$	[-]	0,8			
Stressed cross section	$A_s$	[mm <sup>2</sup> ]	47,5	68,9	103,1	
Product specific factor for geometry	$\alpha_{k2}$	[-]	1,0			
<b>Factor for seismic cyclic loading and related minimum embedment depth in existing concrete and concrete overlay</b>						
Nominal embedment depth	$h_{nom,ex} \geq$	[mm]	60	75	80	85
Effective embedment depth	$h_{ef,ov} \geq$	[mm]	40	40	40	60,5
Factor for seismic cyclic loading	$\alpha_{seis}$	[-]	0,46	0,50	0,50	0,52

Connector size HUS4-H			14		16	
Characteristic yield strength	$f_{yk}$	[N/mm <sup>2</sup> ]	582		494	
Product specific factor for ductility	$\alpha_{k1}$	[-]	0,8			
Stressed cross section	$A_s$	[mm <sup>2</sup> ]	139,5		173,2	
Product specific factor for geometry	$\alpha_{k2}$	[-]	1,0			
<b>Factor for seismic cyclic loading and related minimum embedment depth in existing concrete and concrete overlay</b>						
Nominal embedment depth	$h_{nom,ex} \geq$	[mm]	85	85	85	85
Effective embedment depth	$h_{ef,ov} \geq$	[mm]	40	60,5	40	60,5
Factor for seismic cyclic loading	$\alpha_{seis}$	[-]	0,50	0,52	0,50	0,52

Connector Hilti HUS4-H

**Performances**  
Essential characteristics for the shear interface under shear load

**Annex C6**