

#### **Approval body for construction products and types of construction**

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



# European Technical Assessment

ETA-22/0332  
of 20 June 2022

English translation prepared by DIBt - Original version in German language

General Part

## Technical Assessment Body issuing the European Technical Assessment:

Deutsches Institut für Bautechnik

### Trade name of the construction product

TOX screw anchor Sumo Max 1

**Product family**  
to which the construction product belongs

## Mechanical fasteners for use in concrete

## Manufacturer

TOX-Dübel-Technik GmbH

## Manufacturing plant

Werk 1

This European Technical Assessment contains

22 pages including 3 annexes which form an integral part of this assessment

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

EAD 330232-01-0601, Edition 05/2021

**European Technical Assessment**  
**ETA-22/0332**  
English translation prepared by DIBt

Page 2 of 22 | 20 June 2022

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

**European Technical Assessment****ETA-22/0332**

English translation prepared by DIBt

Page 3 of 22 | 20 June 2022

**Specific Part****1 Technical description of the product**

The TOX screw anchor Sumo Max 1 concrete screw is an anchor in size 6, 8, 10, 12 and 14 mm made of galvanised steel respectively steel with zinc flake coating, made of stainless or high corrosion resistant steel. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

Product and product description are given in Annex A.

**2 Specification of the intended use in accordance with the applicable European Assessment Document**

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

**3 Performance of the product and references to the methods used for its assessment****3.1 Mechanical resistance and stability (BWR 1)**

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B4, C1 and C2
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C1 and C2
Displacements (static and quasi-static loading)	See Annex C7
Characteristic resistance and displacements for seismic performance category C1 and C2	See Annex C3 to C5, C8

**3.2 Safety in case of fire (BWR 2)**

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C6

**3.3 Aspects of durability linked with the Basic Works Requirements**

Essential characteristic	Performance
Durability	See Annex B1

**European Technical Assessment**

**ETA-22/0332**

English translation prepared by DIBt

Page 4 of 22 | 20 June 2022

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with European Assessment Document EAD No. 330232-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 20 June 2022 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock

Referatsleiterin


*beglaubigt:*

Tempel


## Product in installed condition

### TOX screw anchor Sumo Max 1


- Galvanized carbon steel
- Zinc flakes coated carbon steel

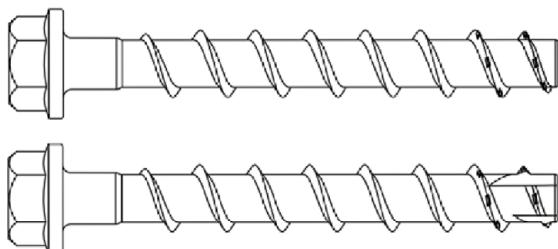

- Stainless steel A4
- Stainless steel HCR



e.g. TOX screw anchor, zinc flakes coated, with hexagon head and fixture

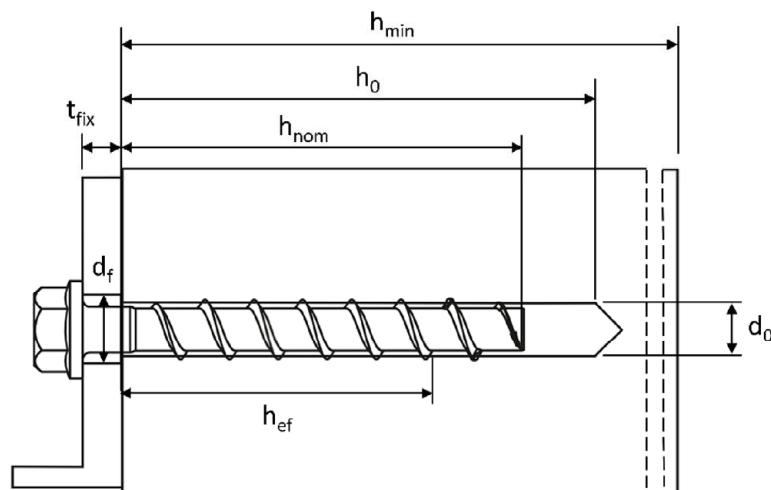

$d_0$  = nominal drill hole diameter

$t_{fix}$  = thickness of fixture

$d_f$  = clearance hole diameter


$h_{min}$  = minimum thickness of member

$h_{nom}$  = nominal embedment depth

$h_0$  = drill hole depth

$h_{ef}$  = effective embedment depth

Filling washer (optional)  
to fill annular gap

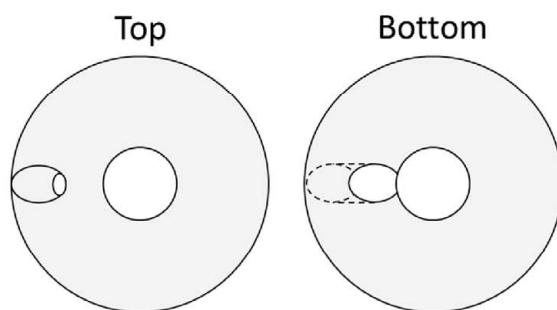

### TOX screw anchor Sumo Max 1

#### Product description

Product in installed condition

#### Annex A1


		Configuration with metric connection threat and hexagon socket e.g. TSM 8x105 M10 SW5; Type ST
		Configuration with metric connection threat and hexagon drive e.g. TSM 8x105 M10 SW7; Type ST
		Configuration with washer and hexagon head e.g. TSM 8x80 SW13 VZ 40; Type S
		Configuration with washer, hexagon head and TORX drive e.g. TSM 8x80 SW13; Type S
		Configuration with washer and bund e.g. TSM BC ST 14x130 SW24 VZ 40; Type BND
		Configuration with hexagon head e.g. TSM 8x80 SW13 OS; Type S
		Configuration with countersunk head and TORX drive e.g. TSM 8x80 C VZ 40; Type SK
		Configuration with pan head and TORX drive e.g. TSM 8x80 P VZ 40; Type P
		Configuration with large pan head and TORX drive e.g. TSM 8x80 LP VZ 40; Type P
		Configuration with connection thread and hexagon drive e.g. TSM 6x55 AG M8; Type ST-6
		Configuration with hexagon drive and connection thread e.g. TSM 6x55 M8 SW10; Type ST-6
		Configuration with internal thread and hexagon drive e.g. TSM 6x55 IM M8/10; Type I
<b>TOX screw anchor Sumo Max 1</b>		
<b>Product description</b> Screw types		<b>Annex A2</b>

Table 1: Material

Part	Product name	Material		
all types	TSM	- Steel EN 10263-4:2017 galvanized acc. to EN ISO 4042:2018 - Zinc flake coating according to EN ISO 10683:2018 ( $\geq 5\mu\text{m}$ ) - Zinc flake coating according to EN ISO 10683:2018 special coating TOX KORR ( $\geq 20\mu\text{m}$ )		
	TS A4	1.4401; 1.4404; 1.4571; 1.4578		
	TSM HCR	1.4529		
Part	Product name	Nominal characteristic steel Yield strength $f_{yk} [\text{N/mm}^2]$	Ultimate strength $f_{uk} [\text{N/mm}^2]$	Rupture elongation $A_5 [\%]$
all types	TSM	560	700	$\leq 8$
	TSM A4			
	TSM HCR			

Table 2: Dimensions

Anchor size		6	8			10			12			14			
Nominal embedment depth	$h_{\text{nom}}$ [mm]	1	2	1	2	3	1	2	3	1	2	3	1	2	3
		40	55	45	55	65	55	75	85	65	85	100	75	100	115
Screw length	$\leq L$ [mm]	500													
Core diameter	$d_K$ [mm]	5,1		7,1			9,1			11,1			13,1		
Thread outer diameter	$d_s$ [mm]	7,5		10,6			12,6			14,6			16,6		
Thickness of filling washer	$t_v$ [mm]	-		5			5			5			5		

**Marking:**

**TSM**

Screw type: TSM  
Screw size: 10  
Screw length: 100



**TSM A4**

Screw type: TSM  
Screw size: 10  
Screw length: 100  
Material: A4




**TSM BC ST**

Screw type: TSM BC ST  
Screw size: 10  
Screw length: 100



**TSM HCR**

Screw type: TSM  
Screw size: 10  
Screw length: 100  
Material: HCR

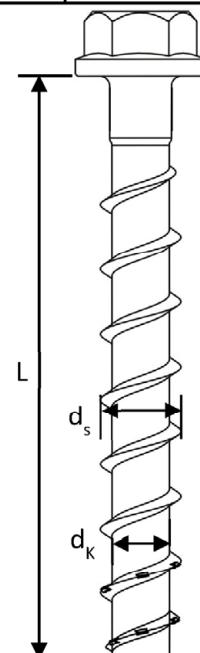

**TOX screw anchor Sumo Max 1**

**Product description**  
Material, Dimensions and markings

**Annex A3**

## Specification of Intended use

Table 3: Anchorages subject to

TSM screw anchor size		6		8			10			12			14				
Nominal embedment depth	[mm]	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom3}$											
		40	55	45	55	65	55	75	85	65	85	100	65	85	115		
Static and quasi-static loads		All sizes and all embedment depths															
Fire exposure																	
C1 category - seismic		ok	ok	1)		ok		1)		ok		1)		ok			
C2 category – seismic (A4 and HCR: no performance assessed)		1)		ok		1)		ok		1)		ok		1)			

1) no performance assessed

### Base materials:

- Compacted reinforced and unreinforced concrete without fibers according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Cracked and uncracked concrete.

### Use conditions (Environmental conditions):

- Concrete screws subject to dry internal conditions: all screw types.
- For all other conditions corresponding to corrosion resistance classes CRC according to EN 1993-1-4:2006 + A1:2015
  - Stainless steel according to Annex A3, screw with marking A4: CRC III
  - High corrosion resistant steel according to Annex A3, screw with marking HCR: CRC V

## Specification of Intended use - continuation

### Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed according to EN 1992-4:2018 and EOTA Technical Report TR 055, Version February 2018.

The design for shear load according to EN 1992-4:2018, Section 6.2.2 applies for all specified diameters  $d_f$  of clearance hole in the fixture in Annex B3, Table 4.

### Installation:

- Hammer drilling or hollow drilling, hollow drilling only for sizes 8-14.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on site.
- In case of aborted hole: new drilling must be drilled at a minimum distance of twice the depth of aborted hole or closer, if the aborted hole is filled with high strength mortar and only if the hole is not in the direction of the oblique tensile or shear load.
- After installation further turning of the anchor must not be possible. The head of the anchor is supported in the fixture and is not damaged.
- The borehole may be filled with injection mortar CF-T 300V or ATA 2004C.
- Adjustability according to Annex B6 for sizes 6-14, all embedment depths except for seismic application.
- Cleaning of borehole is not necessary, if using a hollow drill.

TOX screw anchor Sumo Max 1


Intended use  
Specification continuation

Annex B2

Table 4: Installation parameters

TSM screw anchor size			6		8			10		
Nominal embedment depth		$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
		[mm]	40	55	45	55	65	55	75	85
Nominal drill hole diameter	$d_0$	[mm]	6			8			10	
Cutting diameter of drill bit	$d_{\text{cut}} \leq$	[mm]	6,40			8,45			10,45	
Drill hole depth	$h_0 \geq$	[mm]	45	60	55	65	75	65	85	95
Clearance hole diameter	$d_f \leq$	[mm]	8			12			14	
Installation torque (version with connection thread)	$T_{\text{inst}}$	[Nm]	10			20			40	
Torque impact screw driver		[Nm]	Max. torque according to manufacturer's instructions							
			160			300			400	

TSM screw anchor size			12			14		
Nominal embedment depth	$h_{\text{nom}}$		$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
	[mm]		65	85	100	75	100	115
Nominal drill hole diameter	$d_0$	[mm]	12			14		
Cutting diameter of drill bit	$d_{\text{cut}} \leq$	[mm]	12,50			14,50		
Drill hole depth	$h_0 \geq$	[mm]	75	95	110	85	110	125
Clearance hole diameter	$d_f \leq$	[mm]	16			18		
Installation torque (version with connection thread)	$T_{\text{inst}}$	[Nm]	60			80		
Torque impact screw driver		[Nm]	Max. torque according to manufacturer's instructions					
			650			650		

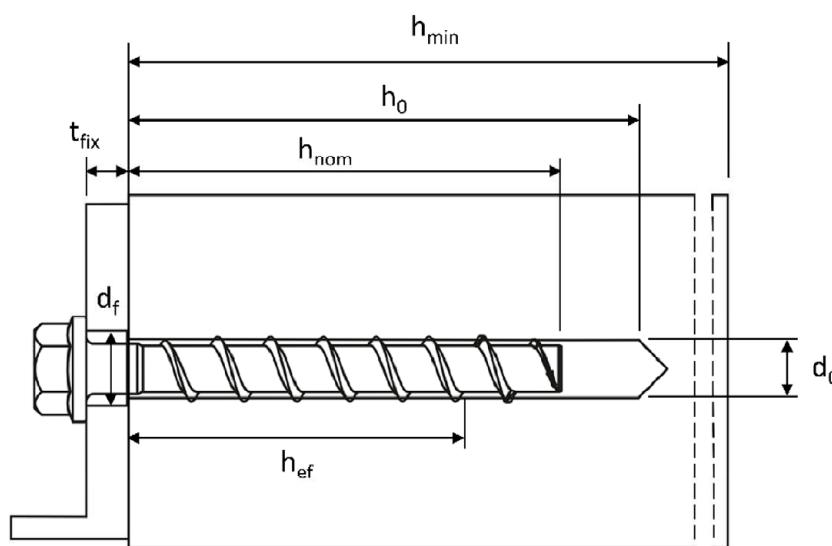


**TOX screw anchor Sumo Max 1**

**Intended use**  
Installation parameters

**Annex B3**

Table 5: Minimum thickness of member, minimum edge distance and minimum spacing

TSM screw anchor size		6		8			10		
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
	[mm]	40	55	45	55	65	55	75	85
Minimum thickness of member	$h_{\text{min}}$	[mm]	100		100		120	100	130
Minimum edge distance	$c_{\text{min}}$	[mm]	40		40	50		50	
Minimum spacing	$s_{\text{min}}$	[mm]	40		40	50		50	
TSM screw anchor size		12			14				
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$		
	[mm]	65	85	100	75	100	115		
Minimum thickness of member	$h_{\text{min}}$	[mm]	120	130	150	130	150	170	
Minimum edge distance	$c_{\text{min}}$	[mm]	50		70	50	70		
Minimum spacing	$s_{\text{min}}$	[mm]	50		70	50	70		

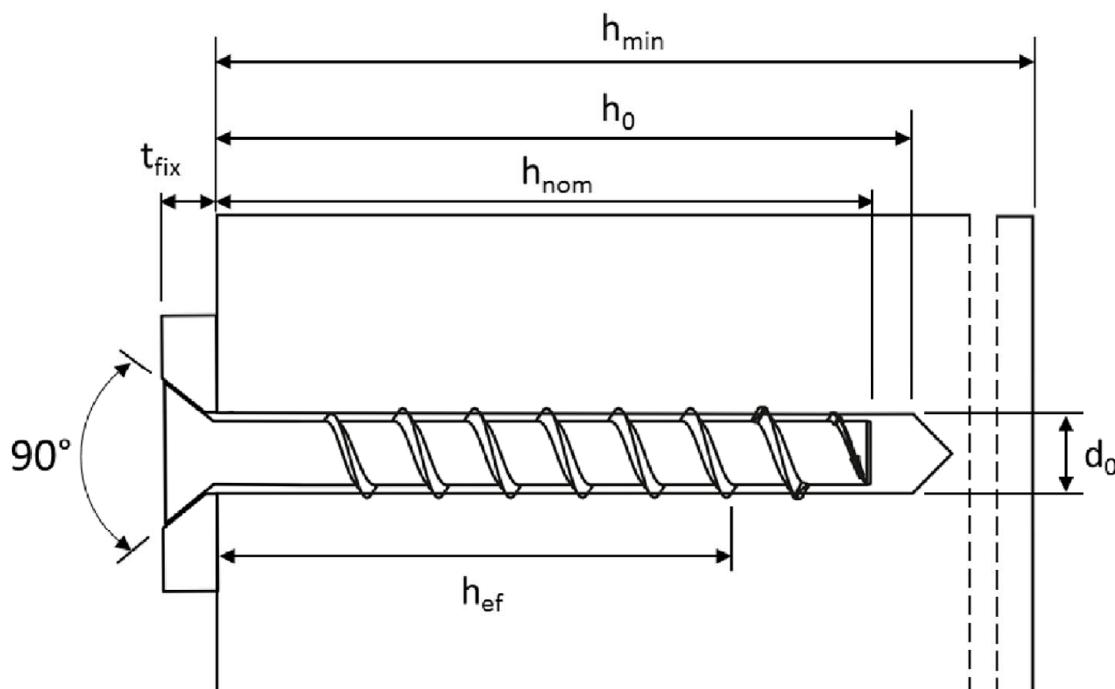


**TOX screw anchor Sumo Max 1**

**Intended use**


Minimum thickness of member, minimum edge distance and minimum spacing

**Annex B4**


## Installation Instructions

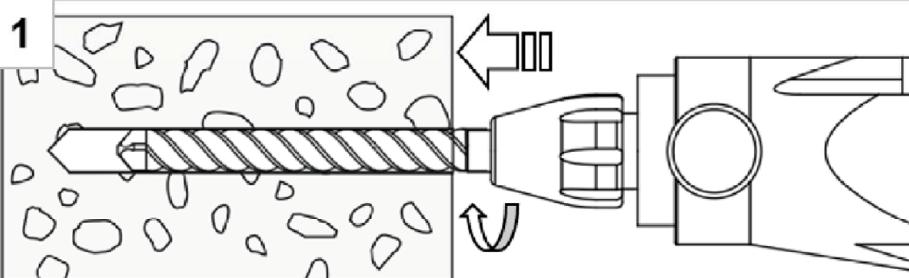


Create hammer drilled or hollow drilled borehole

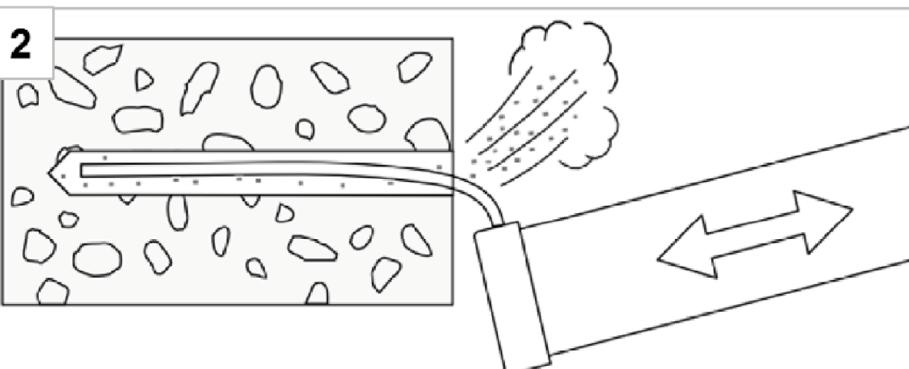

Remove drill dust by  
vacuuming or blowing off

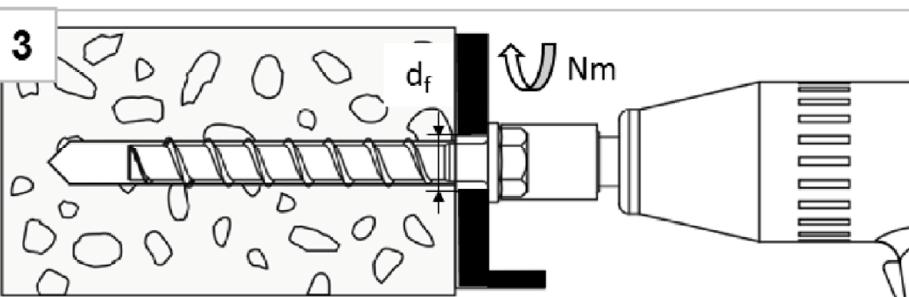

Install with torque  
impact screw driver  
or torque wrench

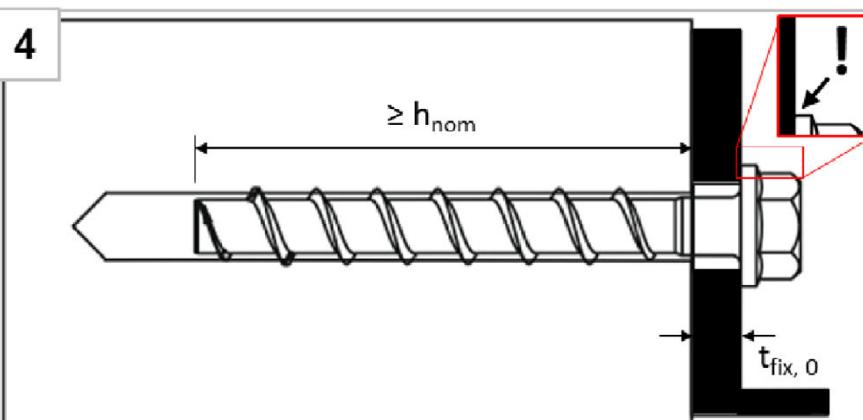

The head must be  
undamaged and in  
contact with the fixture

### Note:

Cleaning of borehole is not necessary when using a hollow drill


**TOX screw anchor Sumo Max 1**

**Intended use**  
Installation instructions

**Annex B5**


## Installation Instructions – Adjustment

### 1. Adjustment

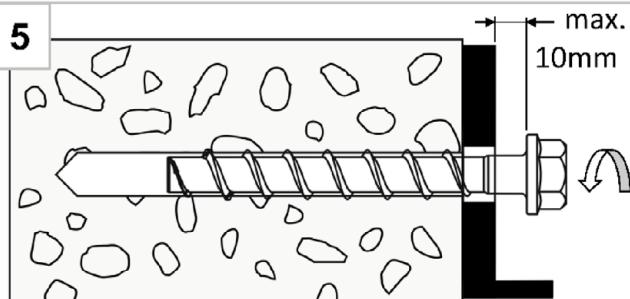


Screw may be untightened maximum 10mm


### 2. Adjustment

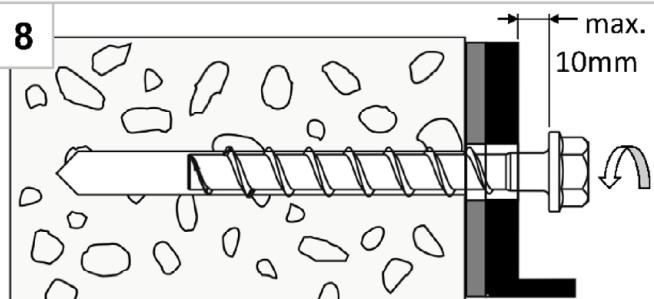


Screw may be untightened maximum 10mm

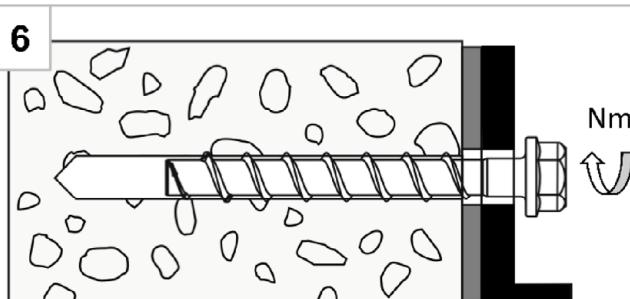


After adjustment, tighten the screw again

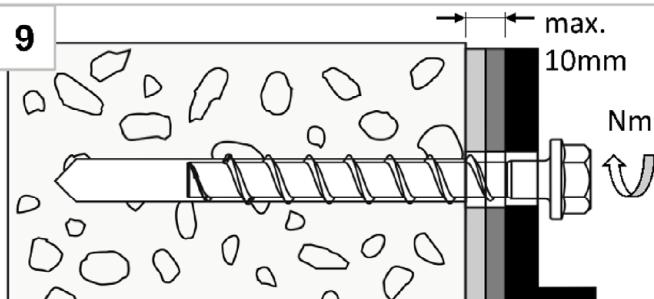

After adjustment, tighten the screw again

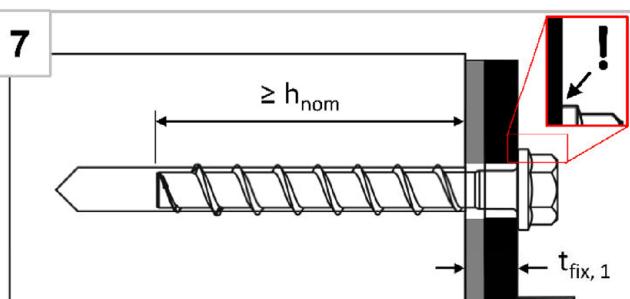

The head must be undamaged and in contact with the fixture

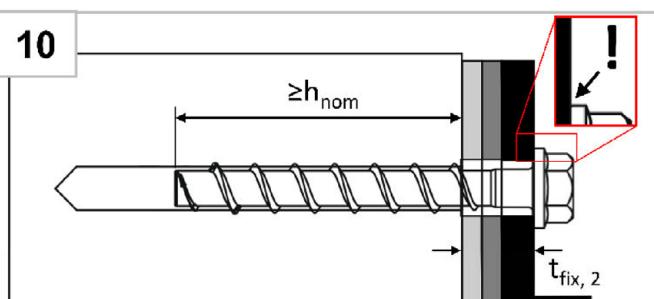

The head must be undamaged and in contact with the fixture

#### Note:

The fastener can be adjusted maximum two times. The total allowed thickness of shims added during the adjustment process is 10mm. The final embedment depth after adjustment process must be larger or equal than  $h_{nom}$ .


**TOX screw anchor Sumo Max 1**

**Intended use**  
Installation instructions - Adjustment


**Annex B6**

## Installation Instructions – Filling annular gap


### Positioning of fixture and filling washer

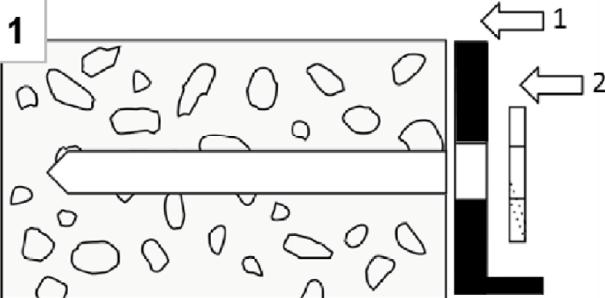


After preparing borehole (Annex B5, figure 1+2), position first fixture (1), than filling washer (2)

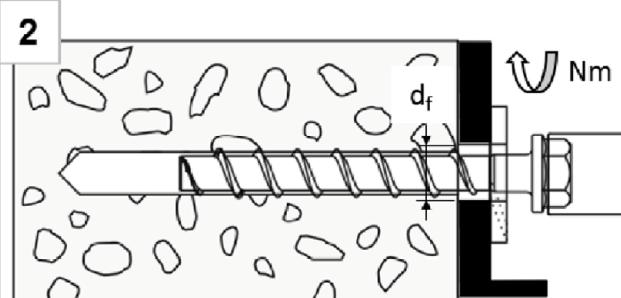

Install with torque impact screw driver  
or torque wrench

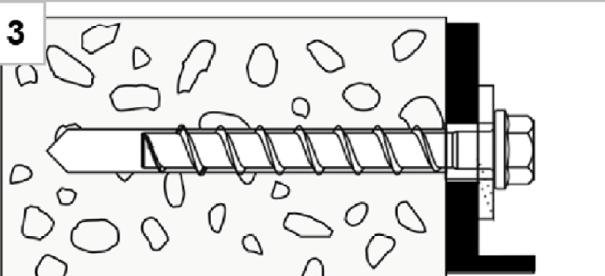


Installed condition without injected  
mortar in the filling washer

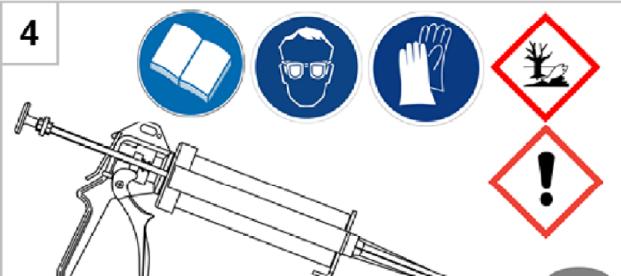

Discard 3x full strokes of mortar till  
color is constant

### Filling the annular gap

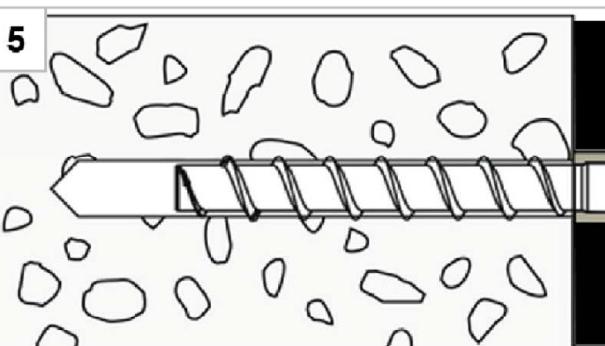

Fill the annular gap with injection mortar  
(minimum compression strength of  $40 \text{ N/mm}^2$ )

Note:

For seismic loading the installation with filled and without filled annular gap is approved.  
Differences in performance can be found in Annex C5 - C7.

**TOX screw anchor Sumo Max 1**

**Intended use**

Installation instructions - Filling annular gap

**Annex B7**

Table 6: Characteristic values for static and quasi-static loading, sizes 6-10

TSM screw anchor size			6		8			10								
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$							
	[mm]	40	55	45	55	65	55	75	85							
<b>Steel failure for tension and shear loading</b>																
Characteristic tension load	$N_{Rk,s}$	[kN]	14,0		27,0		45,0									
Partial factor	$\gamma_{Ms,N}$	[-]	1,5													
Characteristic shear load	$V_{Rk,s}^0$	[kN]	7,0		13,5		17,0	22,5	34,0							
Partial factor	$\gamma_{Ms,V}$	[-]	1,25													
Ductility factor	$k_7$	[-]	0,8													
Characteristic bending load	$M_{Rk,s}^0$	[Nm]	10,9		26,0		56,0									
<b>Pull-out failure</b>																
Characteristic tension load C20/25	cracked	$N_{Rk,p}$	[kN]	2,0	4,0	5,0	9,0	12,0	9,0	$\geq N_{Rk,c}^0$ <sup>1)</sup>						
	uncracked	$N_{Rk,p}$	[kN]	4,0	9,0	7,5	12,0	16,0	12,0	20,0						
Increasing factor for $N_{Rk,p} =$ $N_{Rk,p}(C20/25) * \Psi_c$	C25/30	$\Psi_c$	[-]	1,12												
	C30/37			1,22												
	C40/50			1,41												
	C50/60			1,58												
<b>Concrete failure: Splitting failure, concrete cone failure and pry-out failure</b>																
Effective embedment depth	$h_{\text{ef}}$	[mm]	31	44	35	43	52	43	60	68						
k-factor	cracked	$k_{cr}$	[-]	7,7												
	uncracked	$k_{ucr}$	[-]	11,0												
Concrete cone failure	spacing	$s_{cr,N}$	[mm]	3 x $h_{\text{ef}}$												
	edge distance	$c_{cr,N}$	[mm]	1,5 x $h_{\text{ef}}$												
Splitting failure	resistance	$N_{Rk,sp}^0$	[kN]	4,0	9,0	7,5	12,0	16,0	12,0	20,0						
	spacing	$s_{cr,sp}$	[mm]	120	160	120	140	150	140	180						
	edge distance	$c_{cr,sp}$	[mm]	60	80	60	70	75	70	90						
Factor for pry-out failure	$k_8$	[-]	1,0							2,0						
Installation factor	$\gamma_{inst}$	[-]	1,0													
<b>Concrete edge failure</b>																
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	31	44	35	43	52	43	60	68						
Nominal outer diameter of screw	$d_{\text{nom}}$	[mm]	6		8		10									
<sup>1)</sup> $N_{Rk,c}^0$ according to EN 1992-4:2018																
<b>TOX screw anchor Sumo Max 1</b>																
<b>Performances</b> Characteristic values for static and quasi-static loading, sizes 6-10								<b>Annex C1</b>								

Table 7: Characteristic values for static and quasi-static loading, sizes 12-14

TSM screw anchor size		12			14					
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$			
	[mm]	65	85	100	75	100	115			
<b>Steel failure for tension and shear loading</b>										
Characteristic tension load	$N_{Rk,s}$	[kN]	67,0		94,0					
Partial factor	$\gamma_{Ms,N}$	[-]	1,5							
Characteristic shear load	$V^0_{Rk,s}$	[kN]	33,5	42,0	56,0					
Partial factor	$\gamma_{Ms,V}$	[-]	1,25							
Ductility factor	$k_7$	[-]	0,8							
Characteristic bending load	$M^0_{Rk,s}$	[Nm]	113,0		185,0					
<b>Pull-out failure</b>										
Characteristic tension load C20/25	cracked	$N_{Rk,p}$	[kN]	12,0	$\geq N^0_{Rk,c}$ <sup>1)</sup>					
	uncracked	$N_{Rk,p}$	[kN]	16,0						
Increasing factor for $N_{Rk,p} =$ $N_{Rk,p}(C20/25) * \Psi_c$	C25/30	$\Psi_c$	[-]	1,12						
	C30/37			1,22						
	C40/50			1,41						
	C50/60			1,58						
	<b>Concrete failure: Splitting failure, concrete cone failure and pry-out failure</b>									
Effective embedment depth	$h_{\text{ef}}$	[mm]	50	67	80	58	79	92		
k-factor	cracked	$k_1 = k_{cr}$	[-]	7,7						
	uncracked	$k_1 = k_{ucr}$	[-]	11,0						
Concrete cone failure	spacing	$s_{cr,N}$	[mm]	3 x $h_{\text{ef}}$						
	edge distance	$c_{cr,N}$	[mm]	1,5 x $h_{\text{ef}}$						
Splitting failure	resistance	$N^0_{Rk,sp}$	[kN]	16,0	27,0	35,0	21,5	34,5	43,5	
	spacing	$s_{cr,Sp}$	[mm]	150	210	240	180	240	280	
	edge distance	$c_{cr,Sp}$	[mm]	75	105	120	90	120	140	
Factor for pry-out failure	$k_8$	[-]	1,0	2,0		1,0	2,0			
Installation factor	$\gamma_{inst}$	[-]	1,0							
<b>Concrete edge failure</b>										
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	50	67	80	58	79	92		
Nominal outer diameter of screw	$d_{\text{nom}}$	[mm]	12			14				
<sup>1)</sup> $N^0_{Rk,c}$ according to EN 1992-4:2018										
<b>TOX screw anchor Sumo Max 1</b>										
<b>Performances</b> Characteristic values for static and quasi-static loading, sizes 12-14										
<b>Annex C2</b>										

**Table 8: Seismic category C1 – Characteristic load values (type S, type SK, type ST, type ST-6<sup>1)</sup>, type P and type I<sup>1)</sup>**

TSM screw anchor size		6		8		10		12	14
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}3}$	$h_{\text{nom}3}$	$h_{\text{nom}3}$	$h_{\text{nom}3}$
	[mm]	40	55	65	55	85	100	100	115
<b>Steel failure for tension and shear load (version type S, type SK, type ST, type ST-6<sup>1)</sup>, type P, type I<sup>1)</sup></b>									
Characteristic load	$N_{Rk,s,C1}$ [kN]	14,0		27,0		45,0		67,0	94,0
Partial factor	$\gamma_{Ms,N}$ [-]	1,5							
Characteristic load	$V_{Rk,s,C1}$ [kN]	4,7	5,5	8,5	13,5	15,3	21,0	22,4	
Partial factor	$\gamma_{Ms,V}$ [-]	1,25							
With filling of the annular gap <sup>2)</sup>	$\alpha_{\text{gap}}$ [-]	1,0							
Without filling of the annular gap <sup>3)</sup>	$\alpha_{\text{gap}}$ [-]	0,5							
<b>Pull-out failure (version type S, type SK, type ST, type ST-6<sup>1)</sup>, type P, type I<sup>1)</sup></b>									
Characteristic tension load in cracked concrete C20/25	$N_{Rk,p,C1}$ [kN]	2,0	4,0	12,0	9,0	$\geq N^0_{Rk,c}$ <sup>4)</sup>			
<b>Concrete cone failure (version type S, type SK, type ST, type ST-6<sup>1)</sup>, type P, type I<sup>1)</sup></b>									
Effective embedment depth	$h_{\text{ef}}$ [mm]	31	44	52	43	68	80	92	
Edge distance	$c_{cr,N}$ [mm]	1,5 x $h_{\text{ef}}$							
Spacing	$s_{cr,N}$ [mm]	3 x $h_{\text{ef}}$							
Installation safety factor	$\gamma_{\text{inst}}$ [-]	1,0							
<b>Concrete pry-out failure (version type S, type SK, type ST, type P)</b>									
Factor for pry-out failure	$k_8$ [-]	1,0		2,0					
<b>Concrete edge failure (version type S, type SK, type ST, type P)</b>									
Effective length in concrete	$l_f = h_{\text{ef}}$ [mm]	31	44	52	43	68	80	92	
Nominal outer diameter of screw	$d_{\text{nom}}$ [mm]	6	6	8	10	10	12	14	
<b>TOX screw anchor Sumo Max 1</b>									
<b>Performances</b> Seismic category C1 – Characteristic load values							<b>Annex C3</b>		

<sup>1)</sup> only tension load

<sup>2)</sup> With filling of the annular gap according to annex B7, figure 5

<sup>3)</sup> Without filling of the annular gap according to annex B5

<sup>4)</sup>  $N^0_{Rk,c}$  according to EN 1992-4:2018

**Table 9: Seismic category C2<sup>1)</sup> – Characteristic load values with filled annular gap according to annex B7, figure 5 (type S, type ST, type P)**

TSM screw anchor size		8	10	12	14
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom3}}$			
	[mm]	65	85	100	115
<b>Steel failure for tension and shear load (version type S, type ST, type P)</b>					
Characteristic load	$N_{Rk,s,C2}$	[kN]	27,0	45,0	67,0
Partial factor	$\gamma_{Ms,N}$	[-]	1,5		
Characteristic load	$V_{Rk,s,C2}$	[kN]	9,9	18,5	31,6
Partial factor	$\gamma_{Ms,V}$	[-]	1,25		
With filling of the annular gap	$\alpha_{\text{gap}}$	[-]	1,0		
<b>Pull-out failure (version type S, type ST, type P)</b>					
Characteristic load in cracked concrete	$N_{Rk,p,C2}$	[kN]	2,4	5,4	7,1
<b>Concrete cone failure (version type S, type ST, type P)</b>					
Effective embedment depth	$h_{\text{ef}}$	[mm]	52	68	80
Edge distance	$c_{cr,N}$	[mm]	$1,5 \times h_{\text{ef}}$		
Spacing	$s_{cr,N}$	[mm]	$3 \times h_{\text{ef}}$		
Installation safety factor	$\gamma_{\text{inst}}$	[-]	1,0		
<b>Concrete pry-out failure (version type S, type ST, type P)</b>					
Factor for pry-out failure	$k_8$	[-]	1,0	2,0	
<b>Concrete edge failure (version type S, type ST, type P)</b>					
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	52	68	80
Nominal outer diameter of screw	$d_{\text{nom}}$	[mm]	8	10	12

1) A4 and HCR not suitable

#### TOX screw anchor Sumo Max 1

#### Performances

Seismic category C2 – Characteristic load values with filled annular gap

#### Annex C4

**Table 10: Seismic category C2<sup>1)</sup> – Characteristic load values **without filled annular gap according to annex B5 (type S, type ST, type P)****

TSM screw anchor size			8	10	12	14		
Nominal embedment depth		$h_{\text{nom}}$	$h_{\text{nom3}}$					
		[mm]	65	85	100	115		
<b>Steel failure for tension and shear load (version type S, type ST, type P)</b>								
Characteristic load	$N_{Rk,s,C2}$	[kN]	27,0	45,0	67,0	94,0		
Partial factor	$\gamma_{Ms,N}$	[-]	1,5					
Characteristic load	$V_{Rk,s,C2}$	[kN]	10,3	21,9	24,4	23,3		
Partial factor	$\gamma_{Ms,V}$	[-]	1,25					
Without filling of the annular gap	$\alpha_{\text{gap}}$	[-]	0,5					
<b>Pull-out failure (version type S, type ST, type P)</b>								
Characteristic load in cracked concrete	$N_{Rk,p,C2}$	[kN]	2,4	5,4	7,1	10,5		
<b>Steel failure for tension and shear load (version type SK)</b>								
Characteristic load	$N_{Rk,s,C2}$	[kN]	27,0	45,0	no performance assessed			
Partial factor	$\gamma_{Ms,N}$	[-]	1,5					
Characteristic load	$V_{Rk,s,C2}$	[kN]	3,6	13,7				
Partial factor	$\gamma_{Ms,V}$	[-]	1,25					
Without filling of the annular gap	$\alpha_{\text{gap}}$	[-]	0,5					
<b>Pull-out failure (version type SK)</b>								
Characteristic load in cracked concrete	$N_{Rk,p,C2}$	[kN]	2,4	5,4	no performance assessed			
<b>Concrete cone failure (version type S, type SK, type ST, type P)</b>								
Effective embedment depth	$h_{\text{ef}}$	[mm]	52	68	80	92		
Edge distance	$c_{cr,N}$	[mm]	1,5 x $h_{\text{ef}}$					
Spacing	$s_{cr,N}$	[mm]	3 x $h_{\text{ef}}$					
Installation safety factor	$\gamma_{\text{inst}}$	[-]	1,0					
<b>Concrete pry-out failure (version type S, type SK, type ST, type P)</b>								
Factor for pry-out failure	$k_8$	[-]	1,0	2,0				
<b>Concrete edge failure (version type S, type SK, type ST, type P)</b>								
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	52	68	80	92		
Nominal outer diameter of screw	$d_{\text{nom}}$	[mm]	8	10	12	14		

<sup>1)</sup> A4 and HCR not suitable

#### TOX screw anchor Sumo Max 1

#### Performances

Seismic category C2 – Characteristic load values without filled annular gap

#### Annex C5

Table 11: Fire exposure – characteristic values of resistance

TSM screw anchor size		6		8			10			12			14														
Nominal embedment depth	$h_{\text{nom}}$	1	2	1	2	3	1	2	3	1	2	3	1	2	3												
	[mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115												
Steel failure for tension and shear load																											
characteristic Resistance	R30	$N_{Rk,s,fi30}$	[kN]	0,9	2,4			4,4			7,3			10,3													
	R60	$N_{Rk,s,fi60}$	[kN]	0,8	1,7			3,3			5,8			8,2													
	R90	$N_{Rk,s,fi90}$	[kN]	0,6	1,1			2,3			4,2			5,9													
	R120	$N_{Rk,s,fi120}$	[kN]	0,4	0,7			1,7			3,4			4,8													
	R30	$V_{Rk,s,fi30}$	[kN]	0,9	2,4			4,4			7,3			10,3													
	R60	$V_{Rk,s,fi60}$	[kN]	0,8	1,7			3,3			5,8			8,2													
	R90	$V_{Rk,s,fi90}$	[kN]	0,6	1,1			2,3			4,2			5,9													
	R120	$V_{Rk,s,fi120}$	[kN]	0,4	0,7			1,7			3,4			4,8													
	R30	$M^0_{Rk,s,fi30}$	[Nm]	0,7	2,4			5,9			12,3			20,4													
	R60	$M^0_{Rk,s,fi60}$	[Nm]	0,6	1,8			4,5			9,7			15,9													
	R90	$M^0_{Rk,s,fi90}$	[Nm]	0,5	1,2			3,0			7,0			11,6													
	R120	$M^0_{Rk,s,fi120}$	[Nm]	0,3	0,9			2,3			5,7			9,4													
Pull-out failure																											
Characteristic Resistance	R30- R90	$N_{Rk,p,fi}$	[kN]	0,5	1,0	1,3	2,3	3,0	2,3	4,0	4,8	3,0	4,7	6,2	3,8	6,0	7,6										
	R120	$N_{Rk,p,fi}$	[kN]	0,4	0,8	1,0	1,8	2,4	1,8	3,2	3,9	2,4	3,8	4,9	3,0	4,8	6,1										
Concrete cone failure																											
Characteristic Resistance	R30- R90	$N^0_{Rk,c,fi}$	[kN]	0,9	2,2	1,2	2,1	3,4	2,1	4,8	6,6	3,0	6,3	9,9	4,4	9,6	14,0										
	R120	$N^0_{Rk,c,fi}$	[kN]	0,7	1,8	1,0	1,7	2,7	1,7	3,8	5,3	2,4	5,1	7,9	3,5	7,6	11,2										
Edge distance																											
R30 bis R120		$c_{cr,fi}$	[mm]	$2 \times h_{ef}$																							
In case of fire attack from more than one side, the minimum edge distance shall be $\geq 300\text{mm}$ .																											
Spacing																											
R30 bis R120		$s_{cr,fi}$	[mm]	$4 \times h_{ef}$																							
Pry-out failure																											
R30 bis R120		$k_8$	[-]	1,0			2,0			1,0			2,0		1,0		2,0										
The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value.																											
TOX screw anchor Sumo Max 1																											
Performances												Annex C6															
Fire exposure – characteristic values of resistance																											

English translation prepared by DIBt

Table 12: Displacements under static and quasi-static tension load

TSM screw anchor size			6		8			10			
Nominal embedment depth			$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
			[mm]	40	55	45	55	65	55	75	85
Cracked concrete	tension load	N	[kN]	0,95	1,9	2,4	4,3	5,7	4,3	7,9	9,6
	displacement	$\delta_{\text{N}0}$	[mm]	0,3	0,6	0,6	0,7	0,8	0,6	0,5	0,9
		$\delta_{\text{N}\infty}$	[mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2	1,2
Uncracked concrete	tension load	N	[kN]	1,9	4,3	3,6	5,7	7,6	5,7	9,5	11,9
	displacement	$\delta_{\text{N}0}$	[mm]	0,4	0,6	0,7	0,9	0,5	0,7	1,1	1,0
		$\delta_{\text{N}\infty}$	[mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2	1,2
TSM screw anchor size			12				14				
Nominal embedment depth			$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$		
			[mm]	65	85	100	75	100	115		
Cracked concrete	tension load	N	[kN]	5,7	9,4	12,3	7,6	12,0	15,1		
	displacement	$\delta_{\text{N}0}$	[mm]	0,9	0,5	1,0	0,5	0,8	0,7		
		$\delta_{\text{N}\infty}$	[mm]	1,0	1,2	1,2	0,9	1,2	1,0		
Uncracked concrete	tension load	N	[kN]	7,6	13,2	17,2	10,6	16,9	21,2		
	displacement	$\delta_{\text{N}0}$	[mm]	1,0	1,1	1,2	0,9	1,2	0,8		
		$\delta_{\text{N}\infty}$	[mm]	1,0	1,2	1,2	0,9	1,2	1,0		

Table 13: Displacements under static and quasi-static shear load

TSM screw anchor size			6		8			10			
Nominal embedment depth			$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
			[mm]	40	55	45	55	65	55	75	85
Cracked and uncracked concrete	shear load	V	[kN]	3,3		8,6			16,2		
	displacement	$\delta_{\text{v}0}$	[mm]	1,55		2,7			2,7		
		$\delta_{\text{v}\infty}$	[mm]	3,1		4,1			4,3		
TSM screw anchor size			12				14				
Nominal embedment depth			$h_{\text{nom}}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$		
			[mm]	65	85	100	75	100	115		
Cracked and uncracked concrete	shear load	V	[kN]	20,0				30,5			
	displacement	$\delta_{\text{v}0}$	[mm]	4,0				3,1			
		$\delta_{\text{v}\infty}$	[mm]	6,0				4,7			

### TOX screw anchor Sumo Max 1

**Performances**  
Displacements under static and quasi-static loads

Annex C7

**Table 14: Seismic category C2<sup>1)</sup> – Displacements with filled annular gap according to annex B7, figure 5 (type S, type ST, type P)**

TSM screw anchor size	8	10	12	14
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom3}}$		
	[mm]	65	85	100

**Displacements under tension loads (version type S, type ST, type P)**

Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	0,57	1,16
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	2,36	4,39

**Displacements under shear loads (version type S, type ST, type P with hole clearance)**

Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	1,68	2,91	1,88	2,42
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	5,19	6,72	5,37	9,27

**Table 15: Seismic category C2<sup>1)</sup> – Displacements without filled annular gap according to annex B5 (only version type S, type SK, type ST, type P)**

TSM screw anchor size	8	10	12	14
Nominal embedment depth	$h_{\text{nom}}$	$h_{\text{nom3}}$		
	[mm]	65	85	100

**Displacements under tension loads (version type S, type ST, type P)**

Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	0,57	1,16
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	2,36	4,39

**Displacements under tension loads (version type SK)**

Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	no performance assessed
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	

**Displacements under shear loads (version type S, type ST, type P with hole clearance)**

Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	4,21	4,71	4,42	5,60
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	7,13	8,83	6,95	12,63

**Displacements under shear loads (version type SK with hole clearance)**

Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	2,51	2,98	no performance assessed
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	7,76	6,25	

<sup>1)</sup> A4 and HCR not suitable

**TOX screw anchor Sumo Max 1**

**Performances**

Displacements under seismic loads

**Annex C8**