

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-22/0671
of 10 January 2023

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Injection System FME plus

Product family
to which the construction product belongs

Bonded fastener for use in concrete

Manufacturer

Market Tech (Beijing) Co., Ltd
Room 121211, unit 2, building 3, No. 1
Futong East Street
BEIJING, CHAOYANG DISTRICT
VOLKSREPUBLIK CHINA

Manufacturing plant

Manufacturing plant no. 1
Manufacturing plant no. 2

This European Technical Assessment
contains

39 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330499-01-0601, Edition 04/2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The "Injection system FME plus for concrete" is a bonded anchor consisting of a cartridge with injection mortar Injection mortar FME plus and a steel element according to Annex A 3 and A 5. The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete. The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B. The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 and/or 100 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B3, C1, C3 to C6, C9 to C11 and C13 to C15
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C2, C7, C12 and C16
Displacements under short-term and long-term loading	See Annex C18 to C21
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C8, C17 to C19

3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 10 January 2023 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section


beglaubigt:
Baderschneider

Installation threaded rod M8 to M30


Pre-setting installation or through-setting installation (optional annular gap filled with mortar)

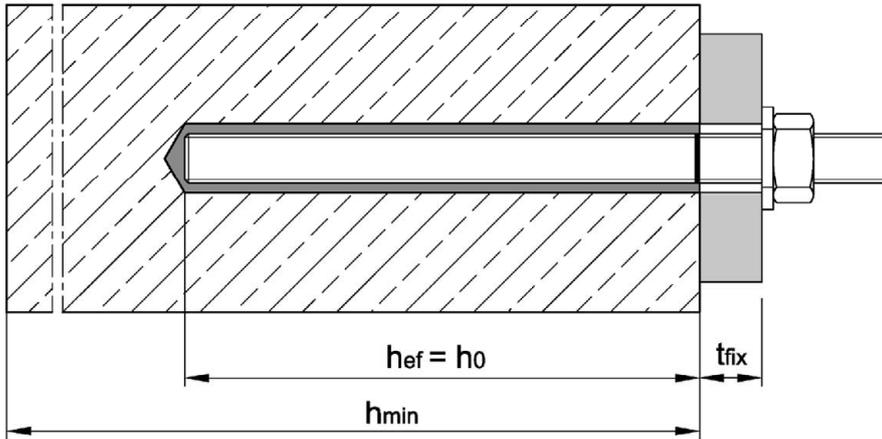

Installation internally threaded anchor rod FMZ-IG M6 to FMZ-IG M20

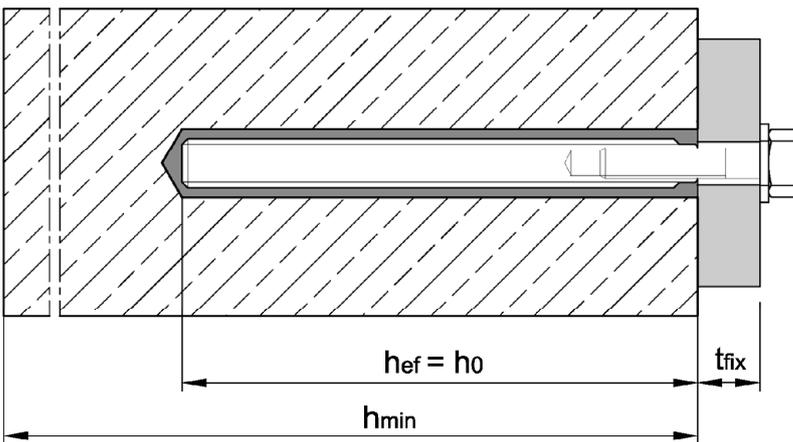

Installation reinforcing bar $\varnothing 8$ to $\varnothing 32$

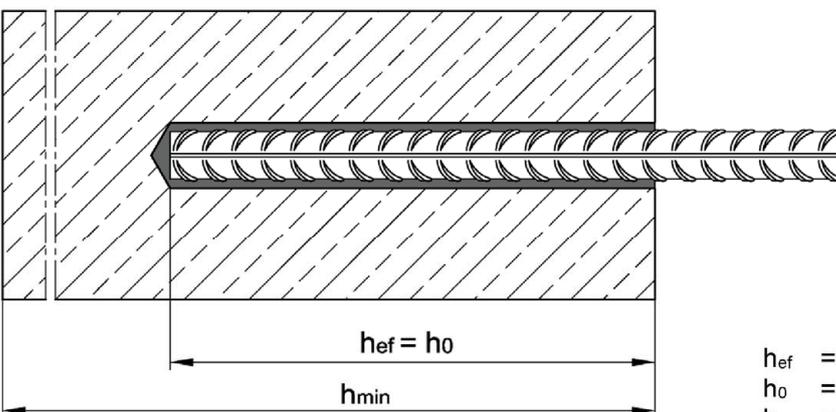

h_{ef} = effective anchorage depth
 h_o = depth of drill hole
 h_{min} = minimum thickness of member
 t_{fix} = thickness of fixture

Electronic copy of the ETA by DIBt: ETA-22/0671

Injection System FME plus Keine Indexeinträge gefunden.


Product description
Installation situation

Annex A1

Cartridge Injection Mortar FME plus

Side-by-side cartridge


440 ml
585 ml
1400 ml

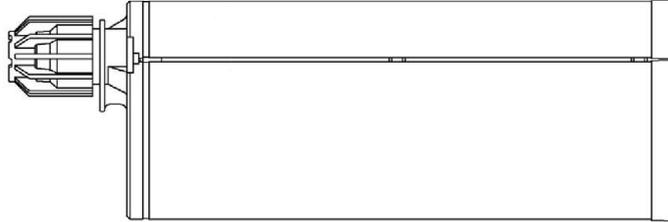


Imprint:

FME plus,
processing notes, batch number, shelf life, hazard-number, storage temperature, curing- and
processing time, optional with travel scale

Static Mixer



Retaining washer and extension nozzle

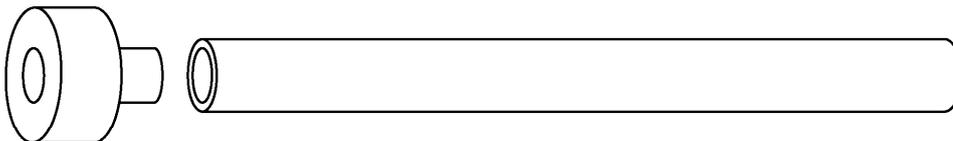

Injection System FME plus

Product description


Cartridge, static mixer and retaining washer with extension nozzle

Annex A2


Threaded rod

Threaded rod FMZ-A, HFZ with washer and hexagon nut
M8, M10, M12, M16, M20, M24, M27, M30 (zinc plated, A4, HCR)

FMZ-A

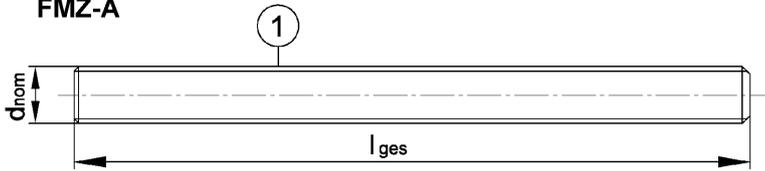

HFZ

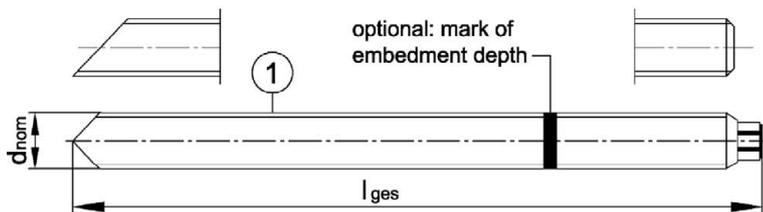

Marking e.g.: \diamond M10

\diamond identifying mark of manufacturing plant

M10 size of thread

additional marking:

A4 stainless steel

HC high corrosion resistant steel

Threaded rod HFT (material sold by the meter, to be cut at the required length)


M8, M10, M12, M16, M20, M24, M27, M30 (zinc plated, A2, A4, HCR)

Commercial standard threaded rod


M8, M10, M12, M16, M20, M24, M27, M30 (zinc plated, A2, A4, HCR) with:

- Materials, dimensions and mechanical properties see Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004

Washer with bore and reducing adapter for filling the gap between threaded rod and fixture




Thickness of washer with bore for diameter
< M24: $t = 5$ mm
 \geq M24: $t = 6$ mm



Internally threaded anchor rod

FMZ-IG M6, FMZ-IG M8, FMZ-IG M10, FMZ-IG M12, FMZ-IG M16, FMZ-IG M20

(zinc plated, A4, HCR)

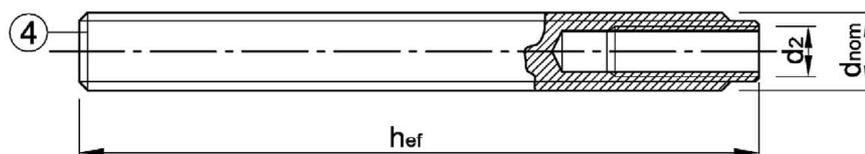

Marking e.g.: \diamond M8

\diamond identifying mark of manufacturing plant

I internal thread

M8 size of internal thread

additional marking:

A4 stainless steel

HCR high corrosion resistant steel

Injection System FME plus

Product description

Threaded rod, internally threaded anchor rod and washer with bore

Annex A3

Table A1: Materials - Threaded rod and internally threaded anchor rod

Part	Designation	Material						
Steel, zinc plated electroplated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:2018 or hot-dip galvanized $\geq 40 \mu\text{m}$ (50 μm in average) acc. to EN ISO 1461:2009 and EN ISO 10684:2004+AC:2009 or sherardized $\geq 45 \mu\text{m}$ acc. to EN ISO 17668:2016								
1	Threaded rod	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation	EN ISO 683-4:2018, EN 10263:2001; commercial standard threaded rod: EN ISO 898-1:2013
		4.6	f_{uk} [N/mm ²]	400	f_{yk} [N/mm ²]	240	$A_5 > 8 \%$	
		4.8		400		320	$A_5 > 8 \%$	
		5.6		500		300	$A_5 > 8 \%$	
		5.8		500		400	$A_5 > 8 \%$	
8.8	800	640		$A_5 \geq 12\% ^1)$				
2	Hexagon nut	4	for class 4.6 or 4.8 rods				EN ISO 898-2:2012	
		5	for class 4.6, 4.8, 5.6, 5.8 rods					
		8	for class 4.6, 4.8, 5.6, 5.8, 8.8 rods					
3a	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000, EN ISO 887:2006						
3b	Washer with bore	steel, zinc plated						
4	Internally threaded anchor rod	5.8	steel, electroplated or sherardized			$A_5 > 8\%$	EN ISO 683-4:2018	
		8.8				$A_5 > 8\%$		
Stainless steel A2 ²⁾ Stainless steel A4 High corrosion resistant steel HCR			CRC II (Materials 1.4301 / 1.4307 / 1.4311 / 1.4567 / 1.4541) CRC III (Materials 1.4401 / 1.4404 / 1.4571 / 1.4578) CRC IV (Materials 1.4529 / 1.4565)					
1	Threaded rod ³⁾	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation	EN 10088-1:2014 EN ISO 3506-1:2020
		50	f_{uk} [N/mm ²]	500	f_{yk} [N/mm ²]	210	$A_5 > 8\%$	
		70		700		450	$A_5 \geq 12\% ^1)$	
80	800	600		$A_5 \geq 12\% ^1)$				
2	Hexagon nut ³⁾	50	for class 50 rods				EN 10088-1:2014 EN ISO 3506-2:2020	
		70	for class 50 or 70 rods					
		80	for class 50, 70 or 80 rods					
3a	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000; EN ISO 887:2006						
3b	Washer with bore	stainless steel A4; high corrosion resistant steel HCR						
4	Internally threaded anchor rod	50	IG-M20			$A_5 > 8 \%$	EN 10088-1:2014	
		70	IG-M6 to IG-M16			$A_5 > 8 \%$		

¹⁾ Fracture elongation $A_5 > 8 \%$ for applications without requirements for seismic performance category C2

²⁾ Property classes 50 and 70

³⁾ Property classes 70 and 80 up to M24


Injection System FME plus

Product description
Materials - Threaded rod and internally threaded anchor rod

Annex A4

Reinforcing bar

Ø 8, Ø 10, Ø 12, Ø 14, Ø 16, Ø 20, Ø 24, Ø 25, Ø 28, Ø 32

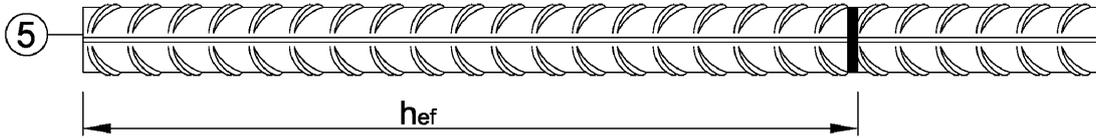

- Minimum value of related rip area $f_{R,min}$ according to EN 1992-1-1:2004+AC:2010
- Rip height of the bar shall be in the range $0,05d \leq h \leq 0,07d$
(d: Nominal diameter of the bar; h: Rip height of the bar)

Table A2: Material reinforcing bar

Part	Designation	Material
Rebar		
5	Rebar EN 1992-1-1:2004+AC:2010, Annex C	Bars and de-coiled rods class B or C f_{yk} and k according to NDP or NCI acc. EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

Injection System FME plus

Product description

Product description and material reinforcing bar

Annex A5

Specification of intended use		
Static and quasi-static action	working life 50 years	working life 100 years
Threaded rod Internally threaded anchor rod Rebar	M8 - M30 FMZ-IG M6 - FMZ-IG M20 Ø8 - Ø32	
Base material	cracked or uncracked concrete	
	strength classes C20/25 to C50/60 compacted, reinforced or unreinforced normal weight concrete (without fibers) acc. to EN 206:2013+A1:2016	
Hole drilling	cracked concrete: hammer drilling / compressed air drilling / vaccum drilling	
	uncracked concrete: hammer drilling / compressed air drilling / vaccum drilling / diamond drilling	
Temperature range ¹⁾	I: -40°C to +40°C II: -40°C to +72°C	I: -40°C to +40°C II: -40°C to +72°C
Seismic action		
	performance category C1	performance category C2
Threaded rod Rebar	M8 - M30 Ø8 - Ø32	M12 - M24 ---
Base material	cracked or uncracked concrete	
	strength classes C20/25 to C50/60 compacted, reinforced or unreinforced normal weight concrete (without fibers) acc. to EN 206:2013+A1:2016	
Hole drilling	hammer drilling / compressed air drilling / vaccum drilling	
Temperature range ¹⁾	I: -40°C to +40°C II: -40°C to +72°C	I: -40°C to +40°C II: -40°C to +72°C
¹⁾ Temperature Range I: max. long term temperature +24°C and max. short term temperature +40°C Temperature Range II: max. long term temperature +50°C and max. short term temperature +72°C		
Injection System FME plus		Annex B1
Intended use Specifications		

Specification of intended use

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions: all materials
- For all other conditions:
Intended use of Materials according to Annex A4, Table A1 corresponding corrosion resistance classes CRC according to EN 1993-1-4:2006+A1:2015

Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work
- Anchorages are designed in accordance with EN 1992-4:2018 or Technical Report TR 055, February 2018

Installation:

- Dry or wet concrete or waterfilled drillholes (not seawater)
- Hole drilling by hammer drill, compressed air drill, vacuum drill or diamond drill mode
- Overhead installation allowed
- Anchor installation carried out by appropriately qualified personnel and under the responsibility of the person responsible for technical matters of the site
- Internally threaded anchor rod: Screws and threaded rods (incl. nut and washer) must at least correspond to the material and strength class of the internally threaded anchor rod used

Injection System FME plus

Intended use
Specifications

Annex B2

Table B1: Installation parameters for threaded rods

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Diameter of threaded rod	$d=d_{nom}$	[mm]	8	10	12	16	20	24	27	30
Nominal drill hole diameter	d_0	[mm]	10	12	14	18	22	28	30	35
Effective anchorage depth	$h_{ef,min}$	[mm]	60	60	70	80	90	96	108	120
	$h_{ef,max}$	[mm]	160	200	240	320	400	480	540	600
Diameter of clearance hole in the fixture	Pre-setting installation $d_f \leq$	[mm]	9	12	14	18	22	26	30	33
	Through setting installation $d_f \leq$	[mm]	12	14	16	20	24	30	33	40
Maximum installation torque	$max.T_{inst} \leq$	[Nm]	10	20	40 (35) ¹⁾	60	100	170	250	300
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30mm \geq 100mm$			$h_{ef} + 2d_0$				
Minimum spacing	s_{min}	[mm]	40	50	60	75	95	115	125	140
Minimum edge distance	c_{min}	[mm]	35	40	45	50	60	65	75	80

¹⁾ max. installation torque for property class 4.6

Table B2: Installation parameters for internally threaded anchor rods

Internally threaded anchor rod			IG-M 6	IG-M 8	IG-M 10	IG-M 12	IG-M 16	IG-M 20
Inner diameter of threaded rod	d_2	[mm]	6	8	10	12	16	20
Outer diameter of threaded rod ¹⁾	$d=d_{nom}$	[mm]	10	12	16	20	24	30
Nominal drill hole diameter	d_0	[mm]	12	14	18	22	28	35
Effective anchorage depth	$h_{ef,min}$	[mm]	60	70	80	90	96	120
	$h_{ef,max}$	[mm]	200	240	320	400	480	600
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7	9	12	14	18	22
Maximum installation torque	$max.T_{inst} \leq$	[Nm]	10	10	20	40	60	100
Minimum screw-in depth	l_{IG}	[mm]	8	8	10	12	16	20
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30mm \geq 100mm$			$h_{ef} + 2d_0$		
Minimum spacing	s_{min}	[mm]	50	60	75	95	115	140
Minimum edge distance	c_{min}	[mm]	40	45	50	60	65	80

¹⁾ with metric thread acc. to EN 1993-1-8:2005+AC:2009

Table B3: Installation parameters for rebar

Rebar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Diameter of rebar	$d=d_{nom}$	[mm]	8	10	12	14	16	20	24	25	28	32
Nominal drill hole diameter ¹⁾	d_0	[mm]	10 12	12 14	14 16	18	20	25	30 32	30 32	35	40
Effective anchorage depth	$h_{ef,min}$	[mm]	60	60	70	75	80	90	96	100	112	128
	$h_{ef,max}$	[mm]	160	200	240	280	320	400	480	500	560	640
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30 mm \geq 100 mm$				$h_{ef} + 2d_0$					
Minimum spacing	s_{min}	[mm]	40	50	60	70	75	95	120	120	130	150
Minimum edge distance	c_{min}	[mm]	35	40	45	50	50	60	70	70	75	85

¹⁾ for Ø8, Ø10, Ø12, Ø24 and Ø25 both nominal drill hole diameter can be used

Injection System FME plus

Intended use
Installation parameters

Annex B3

Table B4: Parameter for cleaning and setting tools

Threaded rod	Internally threaded anchor rod	Rebar	Drill bit Ø	Brush Ø	min. Brush Ø
					
[-]	[-]	Ø [mm]	d ₀ [mm]	d _b [mm]	d _{b,min} [mm]
M8		8	10	11,5	10,5
M10	FMZ-IG M6	8 / 10	12	13,5	12,5
M12	FMZ-IG M8	10 / 12	14	15,5	14,5
		12	16	17,5	16,5
M16	FMZ-IG M10	14	18	20,0	18,5
		16	20	22,0	20,5
M20	FMZ-IG M12		22	24,0	22,5
		20	25	27,0	25,5
M24	FMZ-IG M16		28	30,0	28,5
M27		24 / 25	30	31,8	30,5
		24 / 25	32	34,0	32,5
M30	FMZ-IG M20	28	35	37,0	35,5
		32	40	43,5	40,5

Table B5: Retaining washer

Drill bit Ø		Installation direction and use		
d ₀ [mm]	[-]	↓	→	↑
10	No retaining washer required			
12				
14				
16				
18	VM-IA 18	h _{ef} > 250mm	h _{ef} > 250mm	all
20	VM-IA 20			
22	VM-IA 22			
25	VM-IA 25			
28	VM-IA 28			
30	VM-IA 30			
32	VM-IA 32			
35	VM-IA 35			
40	VM-IA 40			



Vacuum drill bit

Vacuum drill bit (MKT Hollow drill bit SB, Würth Hammer drill bit with suction or Heller Duster Expert hollow drill bit system) and a vacuum cleaner with minimum negative pressure of 253 hPa and flow rate of minimum 42 l/s (150 m³/h)



Recommended compressed air tool (min 6 bar)

Drill bit diameter (d₀): all diameters

Injection System FME plus

Intended use
Cleaning and setting tools

Annex B4

Table B6: Working time and curing time

Concrete temperature	Working time	Minimum curing time	
		dry concrete	wet concrete
0°C to +4°C	90 min	144 h	288 h
+5°C to +9°C	80 min	48 h	96 h
+10°C to +14°C	60 min	28 h	56 h
+15°C to +19°C	40 min	18 h	36 h
+20°C to +24°C	30 min	12 h	24 h
+25°C to +34°C	12 min	9 h	18 h
+35°C to +39°C	8 min	6 h	12 h
+40°C	8 min	4 h	8 h
Cartridge temperature	+5°C to +40°C		

Injection System FME plus


Intended use
Working and curing time

Annex B5

Installation instructions

Drilling of the drill hole and cleaning: Hammer drilling, compressed air drilling and vacuum drilling

1

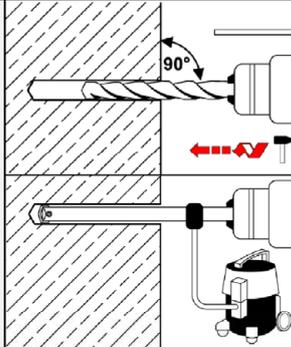

Hammer drilling or compressed air drilling:

Drill with hammer drill or compressed air drill a hole into the base material with prescribed nominal drill hole diameter (Table B1, B2 or B3) and selected drillhole depth. Continue with [step 2](#).

In case of aborted drill hole, the drill hole shall be filled with mortar.

Vacuum drilling: see Annex B4


Drill drillhole with prescribed nominal drill hole diameter (Table B1, B2 or B3) and selected drillhole depth. This drilling method removes dust and cleans the drillhole during drilling. Continue with [step 3](#).

In case of aborted drill hole, the drill hole shall be filled with mortar.

Attention! Standing water in the drill hole must be removed before cleaning!

Cleaning: dry, wet and water-filled drill holes with all diameter in uncracked and cracked concrete (Cleaning not applicable when using vacuum drilling)


2a



Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) a minimum of **two** times until return air stream is free of noticeable dust.

If the drillhole ground is not reached, an extension must be used.


2b



Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush $\geq d_{b,min}$ (Table B4) a minimum of **two** times.

If the drillhole ground is not reached with the brush, an appropriate brush extension must be used.

2c



Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) again a minimum of **two** times until return air stream is free of noticeable dust.

If the drillhole ground is not reached, an extension must be used.

After cleaning, the drillhole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the drillhole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the drillhole again.









Injection System FME plus

Intended use

Installation instructions – Drilling and cleaning: Hammer drilling, compressed air drilling and vacuum drilling

Annex B6

Installation instructions (continuation)






Drilling of the drill hole and cleaning: Diamond drilling		
1		Drill a hole into the base material with prescribed nominal drill hole diameter (Table B1, B2 or B3) and selected drillhole depth. Continue with step 2. In case of aborted drill hole, the drill hole shall be filled with mortar.
Cleaning: dry, wet and water-filled drill holes with all diameter in uncracked concrete		
2a		Remove drill core at least up to the nominal drill hole depth and check drill hole depth.
2b		Flush drill hole with water, starting from the bottom until clear water gets out of the drill hole.
2c		Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush $\geq d_{b,min}$ (Table B4) a minimum of two times. If the drillhole ground is not reached with the brush, an appropriate brush extension must be used.
2d		Flush drill hole again with water, starting from the bottom until clear water gets out of the drill hole.
2e		Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) again a minimum of two times until return air stream is free of noticeable dust. If the drillhole ground is not reached, an extension must be used.
2f		Check brush diameter (Table B4). Brush the hole again with an appropriate sized wire brush $\geq d_{b,min}$ (Table B4) a minimum of two times. If the drillhole ground is not reached with the brush, an appropriate brush extension must be used.
2g		Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) again a minimum of two times until return air stream is free of noticeable dust. If the drillhole ground is not reached, an extension must be used.

Injection System FME plus

Intended use
Installation instructions – Drilling and cleaning: Diamond drilling

Annex B7

Installation instructions (continuation)

Injection		
3		Attach the supplied static-mixing nozzle to the cartridge and load the cartridge into the correct dispensing tool. For every working interruption longer than the recommended working time (Table B6) as well as for new cartridges, a new static-mixer shall be used.
4		Prior to inserting the rod into the filled drillhole, the position of the embedment depth shall be marked on the threaded rod or rebar.
5		Prior to dispensing into the drill hole, squeeze out separately a minimum of three full strokes and discard non-uniformly mixed adhesive components until the mortar shows a consistent grey or red colour.
6		Starting from the bottom or back of the cleaned drill hole fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid air pockets. If the drill hole ground is not reached, an appropriate extension nozzle shall be used. Observe temperature dependent working times given in Table B6.
7		Retaining washer and mixer nozzle extensions shall be used according to Table B5 for the following applications: <ul style="list-style-type: none"> • Horizontal installation (horizontal direction) and ground installation (vertical downwards direction): Drill bit-\varnothing $d_0 \geq 18$ mm and anchorage depth $h_{ef} > 250$mm • Overhead installation: Drill bit-\varnothing $d_0 \geq 18$ mm

Injection System FME plus

Intended use
Installation instructions – Injection

Annex B8

Installation instructions (continuation)

Setting the fastening element		
8		<p>Push the threaded rod or reinforcing bar into the hole while turning slightly to ensure proper distribution of the adhesive until the embedment depth is reached.</p> <p>The anchor shall be free of dirt, grease, oil or other foreign material.</p>
9		<p>Make sure that excess mortar is visible at the top of the hole and in case of through-setting installation also in the fixture. If these requirements are not maintained, repeat application before end of working time! For overhead installation, the anchor should be fixed (e.g. by wedges).</p>
10		<p>Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the anchor until it is fully cured (attend Table B6).</p>
11		<p>Remove excess mortar.</p>
12		<p>The fixture can be mounted after curing time. Apply installation torque T_{inst} according to Table B1 or B2.</p>
13		<p>In case of pre-setting installation the annular gap between anchor rod and fixture can optionally be filled with mortar. Therefore, replace regular washer by washer with drill and plug on reducing adapter on static mixer. Annular gap is completely filled, when excess mortar seeps out.</p>

Injection System FME plus

Intended use

Installation instructions – Setting the fastening element

Annex B9

Table C1: Characteristic steel resistance for threaded rods under tension load

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
Steel failure											
Cross sectional area A_s [mm ²]				36,6	58,0	84,3	157	245	353	459	561
Characteristic resistance under tension load ¹⁾											
Steel, zinc plated	Property class 4.6 and 4.8	$N_{Rk,s}$	[kN]	15 (13)	23 (21)	34	63	98	141	184	224
	Property class 5.6 and 5.8	$N_{Rk,s}$	[kN]	18 (17)	29 (27)	42	78	122	176	230	280
	Property class 8.8	$N_{Rk,s}$	[kN]	29 (27)	46 (43)	67	125	196	282	368	449
Stainless steel	A2, A4 and HCR Property class 50	$N_{Rk,s}$	[kN]	18	29	42	79	123	177	230	281
	A2, A4 and HCR Property class 70	$N_{Rk,s}$	[kN]	26	41	59	110	171	247	_ ³⁾	_ ³⁾
	A4 and HCR Property class 80	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	_ ³⁾	_ ³⁾
Partial factors ²⁾											
Steel, zinc plated	Property class 4.6	$\gamma_{Ms,N}$	[-]	2,0							
	Property class 4.8	$\gamma_{Ms,N}$	[-]	1,5							
	Property class 5.6	$\gamma_{Ms,N}$	[-]	2,0							
	Property class 5.8	$\gamma_{Ms,N}$	[-]	1,5							
	Property class 8.8	$\gamma_{Ms,N}$	[-]	1,5							
Stainless steel	A2, A4 and HCR Property class 50	$\gamma_{Ms,N}$	[-]	2,86							
	A2, A4 and HCR Property class 70	$\gamma_{Ms,N}$	[-]	1,87						_ ³⁾	_ ³⁾
	A4 and HCR Property class 80	$\gamma_{Ms,N}$	[-]	1,6						_ ³⁾	_ ³⁾

¹⁾ The characteristic resistances apply for all anchor rods with the cross sectional area A_s specified here: FMZ-A, HFZ, HFT. For commercial standard threaded rods with a smaller cross sectional area (e.g. hot-dip galvanized threaded rods M8, M10 according to EN ISO 10684:2004 + AC:2009), the values in brackets are valid.

²⁾ In absence of national regulation

³⁾ Anchor type not part of the ETA

Injection System FME plus

Performance
Characteristic steel resistance for **threaded rods** under **tension load**

Annex C1

Table C2: Characteristic steel resistance for threaded rods under shear load

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Steel failure										
Cross sectional area A_s [mm ²]			36,6	58,0	84,3	157	245	353	459	561
Characteristic resistance under shear load ¹⁾										
Steel failure <u>without</u> lever arm										
Steel, zinc plated	Property class 4.6 and 4.8	$V_{Rk,s}^0$ [kN]	9 (8)	14 (13)	20	38	59	85	110	135
	Property class 5.6 and 5.8	$V_{Rk,s}^0$ [kN]	11 (10)	17 (16)	25	47	74	106	138	168
	Property class 8.8	$V_{Rk,s}^0$ [kN]	15 (13)	23 (21)	34	63	98	141	184	224
Stainless steel	A2, A4 and HCR, property class 50	$V_{Rk,s}^0$ [kN]	9	15	21	39	61	88	115	140
	A2, A4 and HCR, property class 70	$V_{Rk,s}^0$ [kN]	13	20	30	55	86	124	₋₃₎	₋₃₎
	A4 and HCR, property class 80	$V_{Rk,s}^0$ [kN]	15	23	34	63	98	141	₋₃₎	₋₃₎
Steel failure <u>with</u> lever arm										
Steel, zinc plated	Property class 4.6 and 4.8	$M_{Rk,s}^0$ [Nm]	15 (13)	30 (27)	52	133	260	449	666	900
	Property class 5.6 and 5.8	$M_{Rk,s}^0$ [Nm]	19 (16)	37 (33)	65	166	324	560	833	1123
	Property class 8.8	$M_{Rk,s}^0$ [Nm]	30 (26)	60 (53)	105	266	519	896	1333	1797
Stainless steel	A2, A4 and HCR, property class 50	$M_{Rk,s}^0$ [Nm]	19	37	66	167	325	561	832	1125
	A2, A4 and HCR, property class 70	$M_{Rk,s}^0$ [Nm]	26	52	92	232	454	784	₋₃₎	₋₃₎
	A4 and HCR, property class 80	$M_{Rk,s}^0$ [Nm]	30	59	105	266	519	896	₋₃₎	₋₃₎
Partial factor ²⁾										
Steel, zinc plated	Property class 4.6	$\gamma_{Ms,V}$ [-]				1,67				
	Property class 4.8	$\gamma_{Ms,V}$ [-]				1,25				
	Property class 5.6	$\gamma_{Ms,V}$ [-]				1,67				
	Property class 5.8	$\gamma_{Ms,V}$ [-]				1,25				
	Property class 8.8	$\gamma_{Ms,V}$ [-]				1,25				
Stainless steel	A2, A4 and HCR, property class 50	$\gamma_{Ms,V}$ [-]				2,38				
	A2, A4 and HCR, property class 70	$\gamma_{Ms,V}$ [-]				1,56		₋₃₎	₋₃₎	
	A4 and HCR, property class 80	$\gamma_{Ms,V}$ [-]				1,33		₋₃₎	₋₃₎	

¹⁾ The characteristic resistances apply for all anchor rods with the cross sectional area A_s specified here: FMZ-A, HFZ, HFT.
For commercial standard threaded rods with a smaller cross sectional area (e.g. hot-dip galvanized threaded rods M8, M10 according to EN ISO 10684:2004 + AC:2009), the values in brackets are valid.

²⁾ In absence of national regulation

³⁾ Anchor type not part of the ETA

Injection System FME plus

Performance
Characteristic **steel resistance** for threaded rods under **shear load**

Annex C2

Table C3: Characteristic values for concrete cone and splitting failure

Threaded rods / Internally threaded anchor rods / Rebars			all sizes	
Concrete cone failure				
Factor k_1	uncracked concrete	$k_{ucr,N}$	[-]	11,0
	cracked concrete	$k_{cr,N}$	[-]	7,7
Edge distance		$c_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$
Spacing		$s_{cr,N}$	[mm]	$2 \cdot c_{cr,N}$
Splitting failure				
Characteristic resistance		$N_{RK,sp}^0$	[kN]	$\min (N_{RK,p} ; N_{RK,c}^0)$
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 \cdot h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} (2,5 - h / h_{ef})$
	$h/h_{ef} \leq 1,3$			$2,4 \cdot h_{ef}$
Spacing		$s_{cr,sp}$	[mm]	$2 \cdot c_{cr,sp}$

Injection System FME plus

Performance
Characteristic values for **concrete cone** and **splitting failure**

Annex C3

Table C4: Characteristic values of tension load for threaded rods, static and quasi-static action, working life 50 years

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
Steel failure											
Characteristic resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)							
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1							
Combined pull-out and concrete failure											
Characteristic bond resistance in <u>uncracked</u> concrete C20/25											
Temperature range I: 40°C / 24°C	hammer- or compressed air drilling	$\tau_{Rk,ucr}$	[N/mm ²]	20	20	19	19	18	17	16	16
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	15	15	15	14	13	13	12	12
Temperature range I: 40°C / 24°C	vacuum drilling	$\tau_{Rk,ucr}$	[N/mm ²]	17 (16) ¹⁾	16	16	16 (15) ¹⁾	15	14	14	13
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	14	14	14	13	13	12	12	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25											
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr}$	[N/mm ²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,cr}$	[N/mm ²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0
Reductionfactor ψ^0_{sus}											
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	ψ^0_{sus}	[-]	0,80							
Temperature range II: 72°C / 50°C		ψ^0_{sus}	[-]	0,68							
Increasing factor ψ_c											
for τ_{Rk} depending on the concrete strength class		ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$							
$\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$											
Concrete cone failure											
Relevant parameter				see Table C3							
Splitting failure											
Relevant parameter				see Table C3							
Installation factor											
dry or wet concrete		γ_{inst}	[-]	1,0							
waterfilled drill hole		γ_{inst}	[-]	1,2							

¹⁾ Value in brackets: characteristic bond resistance for waterfilled drill holes

Injection System FME plus

Performance

Characteristic values of **tension loads** for **threaded rods**, working life 50 years

Annex C4

Table C5: Characteristic values of tension load for threaded rods, static and quasi-static action, working life 100 years

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
Steel failure											
Characteristic resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)							
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1							
Combined pull-out and concrete failure											
Characteristic bond resistance in <u>uncracked</u> concrete C20/25											
Temperature range I: 40°C / 24°C	Hammer- or compressed air drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	20	20	19	19	18	17	16	16
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	15	15	15	14	13	13	12	12
Temperature range I: 40°C / 24°C	Vacuum drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	17 (16) ¹⁾	16	16	16 (15) ¹⁾	15	14	14	13
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	14	14	14	13	13	12	12	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25											
Temperature range I: 40°C / 24°C	Hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr,100}$	[N/mm ²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,cr,100}$	[N/mm ²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5
Reduction factor ψ_{sus}^0											
Temperature range I: 40°C / 24°C	Hammer-, compressed air or vacuum drilling	$\psi_{sus,100}^0$	[-]	0,80							
Temperature range II: 72°C / 50°C		$\psi_{sus,100}^0$	[-]	0,68							
Increasing factor ψ_c											
for τ_{Rk} depending on the concrete strength class		ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$							
$\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$											
Concrete cone failure											
Relevant parameter				see Table C3							
Splitting failure											
Relevant parameter				see Table C3							
Installation factor											
dry or wet concrete		γ_{inst}	[-]	1,0							
waterfilled drill hole		γ_{inst}	[-]	1,2							

¹⁾ Value in brackets: characteristic bond resistance for waterfilled drill holes

Injection System FME plus

Performance
Characteristic values of tension loads for threaded rods, working life 100 years

Annex C5

**Table C6: Characteristic values of tension load for threaded rods,
static and quasi-static action, working life 50 and 100 years,
diamond drilling in uncracked concrete**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Steel failure										
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)							
Partial factor	$\gamma_{Ms,N}$	[-]	see Table C1							
Combined pull-out and concrete failure										
Characteristic bond resistance in <u>uncracked</u> concrete C20/25										
Working life 50 years										
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr}$ [N/mm ²]	15	14	14	13	12	12	11	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$ [N/mm ²]	12	12	11	10	9,5	9,5	9,0	9,0
Reduction factor ψ^0_{sus} in <u>uncracked</u> concrete C20/25										
Temperature range I: 40°C / 24°C	diamond drilling	ψ^0_{sus}	0,77							
Temperature range II: 72°C / 50°C		ψ^0_{sus}	0,72							
Characteristic bond resistance in <u>uncracked</u> concrete C20/25										
Working life 100 years										
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr,100}$ [N/mm ²]	15	14	14	13	12	12	11	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$ [N/mm ²]	11	11	10	10	9,5	9,0	8,5	8,5
Reduction factor ψ^0_{sus} in <u>uncracked</u> concrete C20/25										
Temperature range I: 40°C / 24°C	diamond drilling	$\psi^0_{sus,100}$	0,73							
Temperature range II: 72°C / 50°C		$\psi^0_{sus,100}$	0,70							
Increasing factor ψ_c										
Working life 50 and 100 years										
for τ_{Rk} depending on the concrete strength class $\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$	ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,2}$							
Concrete cone failure										
Relevant parameter	see Table C3									
Splitting failure										
Relevant parameter	see Table C3									
Installation factor										
dry or wet concrete	γ_{inst}	[-]	1,0							
waterfilled drill hole	γ_{inst}	[-]	1,2				1,4			

Injection System FME plus

Performance
Characteristic values of tension loads for threaded rods,
working life 50 and 100 years, diamond drilling

Annex C6

**Table C7: Characteristic values of shear loads for threaded rods,
static and quasi-static action**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure <u>without</u> lever arm											
Characteristic shear resistance Steel, property class 4.6, 4.8, 5.6 and 5.8	$V_{RK,S}^0$	[kN]	0,6 · A _s · f _{uk} or see Table C2								
Characteristic shear resistance Steel, property class 8.8 Stainless steel A2, A4 and HCR (all property classes)	$V_{RK,S}^0$	[kN]	0,5 · A _s · f _{uk} or see Table C2								
Ductility factor	k ₇	[-]	1,0								
Partial factor	γ _{Ms,V}	[-]	see Table C2								
Steel failure <u>with</u> lever arm											
Characteristic bending resistance	$M_{RK,S}^0$	[Nm]	1,2 · W _{el} · f _{uk} or see Table C2								
Elastic section modulus	W _{el}	[mm ³]	31	62	109	277	541	935	1387	1874	
Partial factor	γ _{Ms,V}	[-]	see Table C2								
Concrete pry-out failure											
Pry-out factor	k ₈	[-]	2,0								
Concrete edge failure											
Effective length of anchor	l _f	[mm]	min (h _{ef} , 12 d _{nom})							min (h _{ef} , 300mm)	
Outside diameter of anchor	d _{nom}	[mm]	8	10	12	16	20	24	27	30	
Installation factor	γ _{inst}	[-]	1,0								

Injection System FME plus

Performance
Characteristic values of **shear loads** for **threaded rods**

Annex C7

**Table C8: Characteristic values of tension load for threaded rods,
seismic action (performance category C1 + C2), working life 50 and 100 years**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Tension loads											
Steel failure											
Characteristic resistance C1	$N_{Rk,s,C1}$	[kN]	$1,0 \cdot N_{Rk,s}$								
Characteristic resistance C2 steel, zinc plated, property class 8.8 stainless steel A4 and HCR, property class ≥ 70	$N_{Rk,s,C2}$	[kN]	- ¹⁾	$1,0 \cdot N_{Rk,s}$						- ¹⁾	
Partial factor	$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure											
Characteristic bond resistance in concrete C20/25 to C50/60											
Working life 50 years											
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1}$	[N/mm ²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5
		$\tau_{Rk,C2}$	[N/mm ²]	- ¹⁾		5,8	4,8	5,0	5,1	- ¹⁾	
Temperature range II: 72°C / 50°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1}$	[N/mm ²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0
		$\tau_{Rk,C2}$	[N/mm ²]	- ¹⁾		5,0	4,1	4,3	4,4	- ¹⁾	
Characteristic bond resistance in concrete C20/25 to C50/60											
Working life 100 years											
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1,100}$	[N/mm ²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5
		$\tau_{Rk,C2,100}$	[N/mm ²]	- ¹⁾		5,8	4,8	5,0	5,1	- ¹⁾	
Temperature range II: 72°C / 50°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1,100}$	[N/mm ²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5
		$\tau_{Rk,C2,100}$	[N/mm ²]	- ¹⁾		5,0	4,1	4,3	4,4	- ¹⁾	
Installation factor											
Dry or wet concrete	γ_{inst}	[-]	1,0								
Waterfilled drill hole	γ_{inst}	[-]	1,2								

¹⁾ No performance assessed

**Table C9: Characteristic values of shear loads for threaded rods,
seismic action (performance category C1 + C2)**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Shear loads										
Steel failure <u>without</u> lever arm										
Characteristic resistance C1	$V_{Rk,s,C1}$	[kN]	$0,7 \cdot V^0_{Rk,s}$							
Characteristic resistance C2 steel, zinc plated, property class 8.8 stainless steel A4 and HCR, property class ≥ 70	$V_{Rk,s,C2}$	[kN]	- ¹⁾	$0,7 \cdot V^0_{Rk,s}$						- ¹⁾
Partial factor	$\gamma_{Ms,N}$	[-]	see Table C2							
Factor for anchorages	without annular gap	α_{gap}	[-]	1,0						
	with annular gap between threaded rod and fixture			0,5						

¹⁾ No performance assessed

Injection System FME plus

Performance
Characteristic values for **threaded rods** under **seismic action**

Annex C8

Table C10: Characteristic values of tension loads for internally threaded anchor rod, static and quasi-static action, working life 50 years

Internally threaded anchor rod				FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20
Steel failure ¹⁾									
Characteristic resistance, steel, zinc plated, property class	5.8	$N_{Rk,s}$	[kN]	10	17	29	42	76	123
	8.8	$N_{Rk,s}$	[kN]	16	27	46	67	121	196
Partial factor 5.8 and 8.8		$\gamma_{Ms,N}$	[-]	1,5					
Characteristic resistance, Stainless steel A4 / HCR, property class 70		$N_{Rk,s}$	[kN]	14	26	41	59	110	124 ²⁾
	Partial factor		$\gamma_{Ms,N}$	[-]	1,87				
Combined pull-out and concrete failure									
Characteristic bond resistance in <u>uncracked</u> concrete C20/25									
Temperature range I: 40°C / 24°C	hammer- or compressed air drilling	$\tau_{Rk,ucr}$	[N/mm ²]	20	19	19	18	17	16
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	15	15	14	13	13	12
Temperature range I: 40°C / 24°C	vacuum drilling	$\tau_{Rk,ucr}$	[N/mm ²]	16	16	16 (15) ³⁾	15	14	13
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	14	14	13	13	12	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25									
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr}$	[N/mm ²]	7,0	8,5	8,5	8,5	8,5	8,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,cr}$	[N/mm ²]	6,0	7,0	7,0	7,0	7,0	7,0
Reduction factor ψ_{sus}^0									
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	ψ_{sus}^0	[-]	0,80					
Temperature range II: 72°C / 50°C		ψ_{sus}^0	[-]	0,68					
Increasing factor ψ_c									
for τ_{Rk} depending on the concrete strength class			ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$				
$\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$									
Concrete cone failure									
Relevant parameter				see Table C3					
Splitting failure									
Relevant parameter				see Table C3					
Installation factor									
dry or wet concrete		γ_{inst}	[-]	1,0					
waterfilled drill hole		γ_{inst}	[-]	1,2					

¹⁾ Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod. The characteristic tension resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element.

²⁾ For FMZ-IG M20: property class 50

³⁾ Value in bracket is valid for waterfilled drill hole

Injection System FME plus

Performance
Characteristic values of tension loads for internally threaded anchor rod,
working life 50 years

Annex C9

Table C11: Characteristic values of tension loads for internally threaded anchor rod static and quasi-static action, working life 100 years

Internally threaded anchor rod				FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20
Steel failure ¹⁾									
Characteristic resistance, steel, zinc plated, property class	5.8	$N_{Rk,s}$	[kN]	10	17	29	42	76	123
	8.8	$N_{Rk,s}$	[kN]	16	27	46	67	121	196
Partial factor 5.8 and 8.8		$\gamma_{Ms,N}$	[-]	1,5					
Characteristic resistance, Stainless steel A4 / HCR, property class 70		$N_{Rk,s}$	[kN]	14	26	41	59	110	124 ²⁾
	Partial factor		$\gamma_{Ms,N}$	[-]	1,87				
Combined pull-out and concrete failure									
Characteristic bond resistance in <u>uncracked</u> concrete C20/25									
Temperature range I: 40°C / 24°C	hammer- or compressed air drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	20	19	19	18	17	16
		$\tau_{Rk,ucr,100}$	[N/mm ²]	15	15	14	13	13	12
Temperature range I: 40°C / 24°C	vacuum drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	16	16	16 (15) ³⁾	15	14	13
		$\tau_{Rk,ucr,100}$	[N/mm ²]	14	14	13	13	12	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25									
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr,100}$	[N/mm ²]	6,5	7,5	7,5	7,5	7,5	7,5
		$\tau_{Rk,cr,100}$	[N/mm ²]	5,5	6,5	6,5	6,5	6,5	6,5
Reductionfactor ψ^0_{sus}									
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\psi^0_{sus,100}$	[-]	0,80					
		$\psi^0_{sus,100}$	[-]	0,68					
Increasing factor ψ_c									
for τ_{Rk} depending on the concrete strength class		ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$					
$\tau_{Rk} = \psi_c \cdot \tau_{Rk} (C20/25)$									
Concrete cone failure									
Relevant parameter				see Table C3					
Splitting failure									
Relevant parameter				see Table C3					
Installation factor									
dry or wet concrete		γ_{inst}	[-]	1,0					
waterfilled drill hole		γ_{inst}	[-]	1,2					

¹⁾ Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod. The characteristic tension resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element.

²⁾ For FMZ-IG M20: property class 50

³⁾ Value in bracket is valid for waterfilled drill hole

Injection System FME plus

Performance

Characteristic values of tension loads for internally threaded anchor rod, working life 100 years

Annex C10

Table C12: Characteristic values of tension loads for internally threaded anchor rod, static and quasi-static action, working life 50 and 100 years, diamond drilling

Internally threaded anchor rod				FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20
Steel failure ¹⁾									
Characteristic resistance, steel, zinc plated, property class	5.8	$N_{Rk,s}$	[kN]	10	17	29	42	76	123
	8.8	$N_{Rk,s}$	[kN]	16	27	46	67	121	196
Partial factor 5.8 and 8.8		$\gamma_{Ms,N}$	[-]	1,5					
Characteristic resistance, stainless steel A4 / HCR, property class 70		$N_{Rk,s}$	[kN]	14	26	41	59	110	124 ²⁾
	Partial factor		$\gamma_{Ms,N}$	[-]	1,87				
Combined pull-out and concrete failure									
Characteristic bond resistance in <u>uncracked</u> concrete C20/25 Working life 50 years									
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr}$	[N/mm ²]	14	14	13	12	12	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	12	11	10	9,5	9,5	9,0
Reductionfactor ψ^0_{sus}									
Temperature range I: 40°C / 24°C	diamond drilling	ψ^0_{sus}	[-]	0,77					
Temperature range II: 72°C / 50°C		ψ^0_{sus}	[-]	0,72					
Characteristic bond resistance in <u>uncracked</u> concrete C20/25 Working life 100 years									
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	14	14	13	12	12	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	11	10	10	9,5	9,0	8,5
Reductionfactor ψ^0_{sus}									
Temperature range I: 40°C / 24°C	diamond drilling	$\psi^0_{sus,100}$	[-]	0,73					
Temperature range II: 72°C / 50°C		$\psi^0_{sus,100}$	[-]	0,70					
Increasing factor ψ_c Working life 50 and 100 years									
for τ_{Rk} depending on the concrete strength class		ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,2}$					
$\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$									
Concrete cone failure									
Relevant parameter				see Table C3					
Splitting failure									
Relevant parameter				see Table C3					
Installation factor									
dry or wet concrete		γ_{inst}	[-]	1,0					
waterfilled drill hole		γ_{inst}	[-]	1,2			1,4		

¹⁾ Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod. The characteristic tension resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element.

²⁾ For FMZ-IG M20: property class 50

³⁾ Value in bracket is valid for waterfilled drill hole

Injection System FME plus

Performance

Characteristic values of tension loads for internally threaded anchor rod, working life 50 and 100 years, diamond drilling

Annex C11

Table C13: Characteristic values of shear loads for internally threaded anchor rod, static and quasi-static action

Internally threaded anchor rod				FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20	
Steel failure <u>without</u> lever arm ¹⁾										
Steel, zinc plated	Characteristic resistance, property class	5.8	$V_{Rk,s}^0$ [kN]	6	10	17	25	45	74	
		8.8	$V_{Rk,s}^0$ [kN]	8	14	23	34	60	98	
	Partial factor 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Stainless steel	Characteristic resistance, A4 / HCR, property class 70		$V_{Rk,s}^0$ [kN]	7	13	20	30	55	62 ²⁾	
	Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Ductility factor			k_7	[-]	1,0					
Steel failure <u>with</u> lever arm ¹⁾										
Steel, zinc plated	Characteristic bending resistance, property class	5.8	$M_{Rk,s}^0$ [Nm]	8	19	37	66	167	325	
		8.8	$M_{Rk,s}^0$ [Nm]	12	30	60	105	267	519	
	Partial factor 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Stainless steel	Characteristic bending resistance A4 / HCR, property class 70		$M_{Rk,s}^0$ [Nm]	11	26	53	92	234	643 ²⁾	
	Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Concrete pry-out failure										
Pry-out factor			k_8	[-]	2,0					
Concrete edge failure										
Effective length of anchor			l_f [mm]	min ($h_{ef}, 12 d_{nom}$)					min ($h_{ef}, 300mm$)	
Outside diameter of anchor			d_{nom} [mm]	10	12	16	20	24	30	
Installation factor			γ_{inst}	[-]	1,0					

¹⁾ Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod (exception: FMZ-IG M20). The characteristic shear resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element.

²⁾ For FMZ-IG M20: Internally threaded rod: property class 50;
Fastening screws or threaded rods (incl. nut and washer): property class 70

Injection System FME plus

Performance
Characteristic values of **shear loads** for **internally threaded anchor rod**

Annex C12

Table C14: Characteristic values of tension loads for rebar, static and quasi-static action, working life 50 years

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$										
Cross sectional area	A_s	[mm ²]	50	79	113	154	201	314	452	491	616	804	
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 ²⁾										
Combined pull-out and concrete failure													
Characteristic bond resistance in <u>uncracked</u> concrete C20/25													
Temperature range I: 40°C / 24°C	hammer- and compressed air drilling	$\tau_{Rk,ucr}$	[N/mm ²]	16	16	16	16	16	16	15	15	15	15
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	12	12	12	12	12	12	12	12	11	11
Temperature range I: 40°C / 24°C	vacuum drilling	$\tau_{Rk,ucr}$	[N/mm ²]	14 (13) ³⁾	14 (13) ³⁾	13	13	13	13	13	13	13	13
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	12 (11) ³⁾	12 (11) ³⁾	12 (11) ³⁾	11	11	11	11	11	11	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25													
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr}$	[N/mm ²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5	8,5	8,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,cr}$	[N/mm ²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0
Reductionfactor ψ_{sus}^0													
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	ψ_{sus}^0	[-]	0,80									
Temperature range II: 72°C / 50°C		ψ_{sus}^0	[-]	0,68									
Increasing factor ψ_c													
for τ_{Rk} depending on the concrete strength class $\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$	ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$										
Concrete cone failure													
Relevant parameter	see Table C3												
Splitting failure													
Relevant parameter	see Table C3												
Installation factor													
dry or wet concrete	γ_{inst}	[-]	1,0										
waterfilled drill hole	γ_{inst}	[-]	1,2										

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

³⁾ Value in brackets: characteristic bond resistance for waterfilled drill holes

Injection System FME plus

Performance

Characteristic values of **tension loads** for **rebar**, working life **50 years**

Annex C13

Table C15: Characteristic values of tension loads for rebar, static and quasi-static action, working life 100 years

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$										
Cross sectional area	A_s	[mm ²]	50	79	113	154	201	314	452	491	616	804	
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 ²⁾										
Combined pull-out and concrete failure													
Characteristic bond resistance in <u>uncracked</u> concrete C20/25													
Temperature range I: 40°C / 24°C	hammer- and compressed air drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	16	16	16	16	16	16	15	15	15	15
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	12	12	12	12	12	12	12	12	11	11
Temperature range I: 40°C / 24°C	vacuum drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	14 (13) ³⁾	14 (13) ³⁾	13	13	13	13	13	13	13	13
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	12 (11) ³⁾	12 (11) ³⁾	12 (11) ³⁾	11	11	11	11	11	11	11
Characteristic bond resistance in <u>cracked</u> concrete C20/25													
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,cr,100}$	[N/mm ²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,cr,100}$	[N/mm ²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5
Reduction factor ψ_{sus}^0													
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\psi_{sus,100}^0$	[-]	0,80									
Temperature range II: 72°C / 50°C		$\psi_{sus,100}^0$	[-]	0,68									
Increasing factor ψ_c													
for τ_{Rk} depending on the concrete strength class $\tau_{Rk} = \psi_c \cdot \tau_{Rk} (C20/25)$	ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,1}$										
Concrete cone failure													
Relevant parameter	see Table C3												
Splitting failure													
Relevant parameter	see Table C3												
Installation factor													
dry or wet concrete	γ_{inst}	[-]	1,0										
waterfilled drill hole	γ_{inst}	[-]	1,2										

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

³⁾ Value in brackets: characteristic bond resistance for waterfilled drill holes

Injection System FME plus

Performance
Characteristic values of **tension loads for rebar**, working life 100 years

Annex C14

**Table C16: Characteristic values of tension loads for rebar,
static and quasi-static action, working life 50 and 100 years,
diamond drilling**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$										
Cross sectional area	A_s	[mm ²]	50	79	113	154	201	314	452	491	616	804	
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 ²⁾										
Combined pull-out and concrete failure													
Characteristic bond resistance in <u>uncracked</u> concrete C20/25											Working life 50 years		
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr}$	[N/mm ²]	14	13	13	13	12	12	11	11	11	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr}$	[N/mm ²]	11	11	10	10	10	9,5	9,5	9,5	9,0	9,0
Reductionfactor ψ_{sus}^0													
Temperature range I: 40°C / 24°C	diamond drilling	ψ_{sus}^0	[-]	0,77									
Temperature range II: 72°C / 50°C		ψ_{sus}^0	[-]	0,72									
Characteristic bond resistance in <u>uncracked</u> concrete C20/25											Working life 100 years		
Temperature range I: 40°C / 24°C	diamond drilling	$\tau_{Rk,ucr,100}$	[N/mm ²]	14	13	13	13	12	12	11	11	11	11
Temperature range II: 72°C / 50°C		$\tau_{Rk,ucr,100}$	[N/mm ²]	11	10	10	10	9,5	9,0	9,0	9,0	8,5	8,5
Reductionfactor ψ_{sus}^0													
Temperature range I: 40°C / 24°C	diamond drilling	$\psi_{sus,100}^0$	[-]	0,73									
Temperature range II: 72°C / 50°C		$\psi_{sus,100}^0$	[-]	0,70									
Increasing factor ψ_c											Working life 50 and 100 years		
for τ_{Rk} depending on the concrete strength class		ψ_c	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,2}$									
$\tau_{Rk} = \psi_c \cdot \tau_{Rk} (C20/25)$													
Concrete cone failure													
Relevant parameter			see Table C3										
Splitting failure													
Relevant parameter			see Table C3										
Installation factor													
dry or wet concrete		γ_{inst}	[-]	1,0									
waterfilled drill hole		γ_{inst}	[-]	1,2				1,4					

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

Injection System FME plus

Performance

Characteristic values of tension loads for rebar,
working life 50 and 100 years, diamond drilling

Annex C15

Table C17: Characteristic values of shear loads for rebar, static and quasi-static action

Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure <u>without</u> lever arm												
Characteristic shear resistance	$V_{RK,s}^0$ [kN]	$0,50 \cdot A_s \cdot f_{uk}^{1)}$										
Cross sectional area	A_s [mm ²]	50	79	113	154	201	314	452	491	616	804	
Partial factor	$\gamma_{Ms,V}$ [-]	1,5 ²⁾										
Ductility factor	k_7 [-]	1,0										
Steel failure <u>with</u> lever arm												
Characteristic bending resistance	$M_{RK,s}^0$ [Nm]	$1,2 \cdot W_{el} \cdot f_{uk}^{1)}$										
Elastic section modulus	W_{el} [mm ³]	50	98	170	269	402	785	1357	1534	2155	3217	
Partial factor	$\gamma_{Ms,V}$ [-]	1,5 ²⁾										
Concrete pry-out failure												
Pry-out factor	k_8 [-]	2,0										
Concrete edge failure												
Effective length of rebar	l_r [mm]	min (h_{ef} ; 12 d_{nom})							min (h_{ef} ; 300mm)			
Outside diameter of rebar	d_{nom} [mm]	8	10	12	14	16	20	24	25	28	32	
Installation factor	γ_{inst} [-]	1,0										

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

Injection System FME plus

Performance
Characteristic values of **shear loads** for rebar

Annex C16

Table C18: Characteristic values of tension load for rebar, seismic action (performance category C1), working life 50 and 100 years

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure												
Characteristic resistance	$N_{Rk,s,C1}$	[kN]	$A_s \cdot f_{uk}^{1)}$									
Cross sectional area	A_s	[mm ²]	50	79	113	154	201	314	452	491	616	804
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 ²⁾									
Combined pull-out and concrete failure												
Characteristic bond resistance in concrete C20/25 to C50/60 Working life 50 years												
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1}$	[N/mm ²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5	8,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,C1}$	[N/mm ²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0
Characteristic bond resistance in concrete C20/25 to C50/60 Working life 100 years												
Temperature range I: 40°C / 24°C	hammer-, compressed air or vacuum drilling	$\tau_{Rk,C1,100}$	[N/mm ²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5
Temperature range II: 72°C / 50°C		$\tau_{Rk,C1,100}$	[N/mm ²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5
Installation factor												
dry or wet concrete	γ_{inst}	[-]	1,0									
waterfilled drill hole	γ_{inst}	[-]	1,2									

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

Table C19: Characteristic values of shear loads for rebar, seismic action (performance category C1)

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure <u>without</u> lever arm												
Characteristic resistance	$V_{Rk,s,C1}$	[kN]	$0,35 \cdot A_s \cdot f_{uk}^{1)}$									
Cross sectional area	A_s	[mm ²]	50	79	113	154	201	314	452	491	616	804
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 ²⁾									
Ductility factor	k_7	[-]	1,0									

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ In absence of national regulation

Injection System FME plus

Performance
Characteristic values for rebar under seismic action

Annex C17

Table C20: Displacements under tension load, threaded rod

Threaded rod	M8	M10	M12	M16	M20	M24	M27	M30		
Hammer-, compressed air or vacuum drilling										
Displacement factor¹⁾										
Uncracked concrete, static and quasi-static action, working life 50 and 100 years										
Temperature range I: 40°C / 24°C	δ_{N0} - factor	$\frac{\text{mm}}{[N/mm^2]}$	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
	$\delta_{N\infty}$ - factor		0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,038	0,039	0,040	0,044	0,047	0,051	0,052	0,055
	$\delta_{N\infty}$ - factor		0,047	0,049	0,051	0,055	0,059	0,064	0,067	0,070
Displacement factor¹⁾										
Cracked concrete, static and quasi-static action, working life 50 and 100 years										
Temperature range I: 40°C / 24°C	δ_{N0} - factor	$\frac{\text{mm}}{[N/mm^2]}$	0,069	0,071	0,072	0,074	0,076	0,079	0,081	0,082
	$\delta_{N\infty}$ - factor		0,100	0,115	0,122	0,128	0,135	0,142	0,155	0,171
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,092	0,095	0,096	0,099	0,102	0,106	0,109	0,110
	$\delta_{N\infty}$ - factor		0,134	0,154	0,163	0,172	0,181	0,189	0,207	0,229
Displacement										
Uncracked and cracked concrete, seismic action (C2)										
All temperature ranges	$\delta_{N,C2}$ (DLS)	[mm]	- ²⁾	0,21	0,24	0,27	0,36	- ²⁾		
	$\delta_{N,C2}$ (ULS)			0,54	0,51	0,54	0,63			
Diamond drilling										
Displacement factor¹⁾										
Uncracked concrete, static and quasi-static action, working life 50 years										
Temperature range I: 40°C / 24°C	δ_{N0} - factor	$\frac{\text{mm}}{[N/mm^2]}$	0,011	0,012	0,012	0,013	0,014	0,014	0,015	0,015
	$\delta_{N\infty}$ - factor		0,018	0,019	0,019	0,020	0,022	0,023	0,024	0,025
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,013	0,014	0,014	0,015	0,016	0,016	0,018	0,018
	$\delta_{N\infty}$ - factor		0,052	0,053	0,055	0,058	0,062	0,065	0,068	0,070
Displacement factor¹⁾										
Uncracked concrete, static and quasi-static action, working life 100 years										
Temperature range I: 40°C / 24°C	δ_{N0} - factor	$\frac{\text{mm}}{[N/mm^2]}$	0,011	0,012	0,012	0,013	0,014	0,014	0,015	0,015
	$\delta_{N\infty}$ - factor		0,020	0,021	0,021	0,023	0,024	0,025	0,026	0,027
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,013	0,014	0,014	0,015	0,016	0,016	0,018	0,018
	$\delta_{N\infty}$ - factor		0,038	0,039	0,040	0,043	0,045	0,047	0,049	0,051

¹⁾ Calculation of the displacement

$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau$; τ : acting bond stress under tension load

$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau$;

²⁾ No Performance assessed

Injection System FME plus

Performance
Displacements (threaded rod under tension load)

Annex C18

Table C21: Displacements under shear load, threaded rod

Threaded rod		M8	M10	M12	M16	M20	M24	M27	M30	
All drilling methods										
Displacement factor¹⁾										
Uncracked and cracked concrete, static and quasi-static action										
All temperature ranges	δ_{v0} - factor	[mm/(kN)]	0,06	0,06	0,05	0,04	0,04	0,03	0,03	0,03
	$\delta_{v\infty}$ - factor		0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05
Displacement										
Uncracked and cracked concrete, seismic action (C2)										
All temperature ranges	$\delta_{V,C2}$ (DLS)	[mm]	_2)	3,1	3,4	3,5	4,2	_2)		
	$\delta_{V,C2}$ (ULS)			6,0	7,6	7,3	10,9			

1) Calculation of the displacement

$$\delta_{v0} = \delta_{v0}\text{- factor} \cdot V; \quad V: \text{acting shear load}$$

$$\delta_{v\infty} = \delta_{v\infty}\text{- factor} \cdot V;$$

2) No Performance assessed

Injection System FME plus

Performance

Displacements (threaded rod under shear load)

Annex C19

Table C22: Displacement factors¹⁾ under tension load, internally threaded anchor rod

Internally threaded anchor rod		FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20	
Hammer-, compressed air or vaccum drilling								
Uncracked concrete, static and quasi-static action, working life 50 and 100 years								
Temperature range I: 40°C / 24°C	δ_{N0} - factor	[mm [N/mm ²]]	0,029	0,030	0,033	0,035	0,038	0,041
	$\delta_{N\infty}$ - factor		0,029	0,030	0,033	0,035	0,038	0,041
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,039	0,040	0,044	0,047	0,051	0,055
	$\delta_{N\infty}$ - factor		0,049	0,051	0,055	0,059	0,064	0,070
Cracked concrete, static and quasi-static action, working life 50 and 100 years								
Temperature range I: 40°C / 24°C	δ_{N0} - factor		[mm [N/mm ²]]	0,071	0,072	0,074	0,076	0,079
	$\delta_{N\infty}$ - factor	0,115		0,122	0,128	0,135	0,142	0,171
Temperature range II: 72°C / 50°C	δ_{N0} - factor	0,095		0,096	0,099	0,102	0,106	0,110
	$\delta_{N\infty}$ - factor	0,154		0,163	0,172	0,181	0,189	0,229
Diamond drilling								
Uncracked concrete, static and quasi-static action, working life 50 years								
Temperature range I: 40°C / 24°C	δ_{N0} - factor	[mm [N/mm ²]]	0,012	0,012	0,013	0,014	0,014	0,015
	$\delta_{N\infty}$ - factor		0,019	0,019	0,020	0,022	0,023	0,025
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,014	0,014	0,015	0,016	0,016	0,018
	$\delta_{N\infty}$ - factor		0,053	0,055	0,058	0,062	0,065	0,070
Cracked concrete, static and quasi-static action, working life 100 years								
Temperature range I: 40°C / 24°C	δ_{N0} - factor		[mm [N/mm ²]]	0,012	0,012	0,013	0,014	0,014
	$\delta_{N\infty}$ - factor	0,021		0,021	0,023	0,024	0,025	0,027
Temperature range II: 72°C / 50°C	δ_{N0} - factor	0,014		0,014	0,015	0,016	0,016	0,018
	$\delta_{N\infty}$ - factor	0,039		0,040	0,043	0,045	0,047	0,051

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{- factor} \cdot \tau; \quad \tau: \text{acting bond stress under tension load}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{- factor} \cdot \tau;$$

Table C23: Displacement factors¹⁾ under shear load: internally threaded anchor rod

Internally threaded anchor rod		FMZ-IG M 6	FMZ-IG M 8	FMZ-IG M 10	FMZ-IG M 12	FMZ-IG M 16	FMZ-IG M 20	
Uncracked and cracked concrete, static and quasi-static action								
All temperature ranges	δ_{V0} - factor	[mm/(kN)]	0,07	0,06	0,06	0,05	0,04	0,04
	$\delta_{V\infty}$ - factor		0,10	0,09	0,08	0,08	0,06	0,06

¹⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{- factor} \cdot V; \quad V: \text{acting shear load}$$

$$\delta_{V\infty} = \delta_{V\infty}\text{- factor} \cdot V;$$

Injection System FME plus

Performance
Displacements (internally threaded anchor rod)

Annex C20

Table C24: Displacement factors¹⁾ under tension load (rebar)

Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Hammer-, compressed air or vacuum drilling												
Uncracked concrete, static and quasi-static action, working life 50 and 100 years												
Temperature range I: 40°C / 24°C	δ_{N0} - factor	mm [N/mm ²]	0,028	0,029	0,030	0,031	0,033	0,035	0,038	0,038	0,040	0,043
	$\delta_{N\infty}$ - factor		0,015	0,015	0,016	0,017	0,017	0,019	0,020	0,020	0,021	0,023
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,038	0,039	0,040	0,042	0,044	0,047	0,051	0,051	0,054	0,058
	$\delta_{N\infty}$ - factor		0,047	0,049	0,051	0,053	0,055	0,059	0,065	0,065	0,068	0,072
Cracked concrete, static and quasi-static action, working life 50 and 100 years												
Temperature range I: 40°C / 24°C	δ_{N0} - factor	mm [N/mm ²]	0,069	0,071	0,072	0,073	0,074	0,076	0,079	0,079	0,081	0,084
	$\delta_{N\infty}$ - factor		0,115	0,122	0,128	0,135	0,142	0,155	0,171	0,171	0,181	0,194
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,092	0,095	0,096	0,098	0,099	0,102	0,106	0,106	0,109	0,113
	$\delta_{N\infty}$ - factor		0,154	0,163	0,172	0,181	0,189	0,207	0,229	0,229	0,242	0,260
Diamond drilling												
Uncracked concrete, static and quasi-static action, working life 50 years												
Temperature range I: 40°C / 24°C	δ_{N0} - factor	mm [N/mm ²]	0,008	0,009	0,009	0,010	0,011	0,012	0,013	0,013	0,014	0,015
	$\delta_{N\infty}$ - factor		0,018	0,018	0,019	0,020	0,021	0,024	0,027	0,027	0,028	0,031
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,009	0,011	0,011	0,012	0,013	0,014	0,015	0,015	0,016	0,018
	$\delta_{N\infty}$ - factor		0,048	0,051	0,054	0,058	0,061	0,068	0,076	0,076	0,081	0,088
Uncracked concrete, static and quasi-static action, working life 100 years												
Temperature range I: 40°C / 24°C	δ_{N0} - factor	mm [N/mm ²]	0,008	0,009	0,009	0,010	0,011	0,012	0,013	0,013	0,014	0,015
	$\delta_{N\infty}$ - factor		0,018	0,020	0,021	0,022	0,024	0,026	0,029	0,029	0,031	0,034
Temperature range II: 72°C / 50°C	δ_{N0} - factor		0,009	0,011	0,011	0,012	0,013	0,014	0,015	0,015	0,016	0,018
	$\delta_{N\infty}$ - factor		0,035	0,037	0,040	0,042	0,045	0,049	0,055	0,055	0,059	0,064

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{- factor} \cdot \tau; \quad \tau: \text{acting bond stress under tension load}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{- factor} \cdot \tau;$$

Table C25: Displacement factors¹⁾ under shear load (rebar)

Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Uncracked and cracked concrete, static and quasi-static action												
All temperature ranges	δ_{V0} - factor	[mm/(kN)]	0,06	0,05	0,05	0,04	0,04	0,04	0,03	0,03	0,03	0,03
	$\delta_{V\infty}$ - factor		0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05	0,04	0,04

¹⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{- factor} \cdot V; \quad V: \text{acting shear load}$$

$$\delta_{V\infty} = \delta_{V\infty}\text{- factor} \cdot V;$$

Injection System FME plus

Performance
Displacements (rebar)

Annex C21