

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-23/0140  
of 2 May 2023

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

SIKLA Injection System AN VME basic C

Product family  
to which the construction product belongs

Bonded fastener for use in concrete

Manufacturer

Sikla Holding GmbH  
Ägydiplatz 3  
A-4600 THALHEIM BEI WELS  
ÖSTERREICH

Manufacturing plant

Sikla Herstellwerk 1  
Sikla Herstellwerk 3

This European Technical Assessment  
contains

26 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601, Edition 04/2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The "SIKLA Injection system AN VME basic C" is a bonded anchor consisting of a cartridge with injection mortar Injection mortar AN VME basic C and a steel element according to Annex A3 and A5.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B 2, C 1, C 3 C 4, C 6 and C 8
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 2, C 5, C 7 and C 9
Displacements under short-term and long-term loading	See Annex C 10 and C 11
Characteristic resistance and displacements for seismic performance categories C1 and C2	No performance assessed

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

English translation prepared by DIBt

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

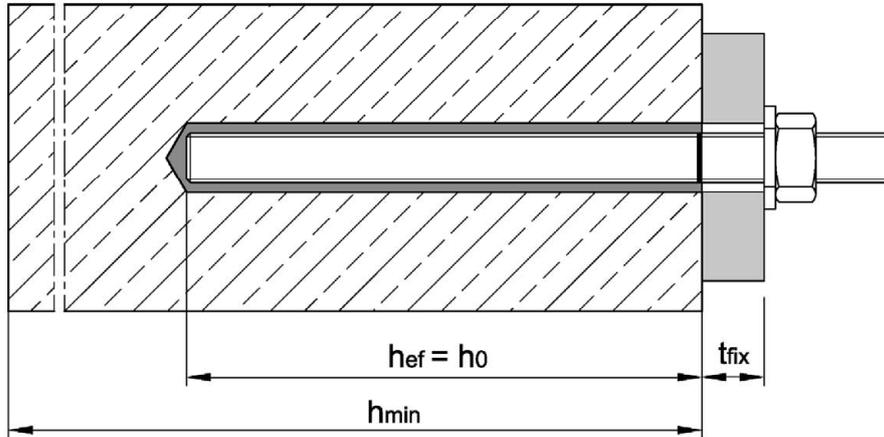
Issued in Berlin on 2 May 2023 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock  
Head of Section


*beglaubigt:*  
Baderschneider

### Installation threaded rod M8 to M30


Pre-setting installation or through-setting installation (optional annular gap filled with mortar)



### Installation internally threaded anchor rod VMU-IG M6 to VMU-IG M20

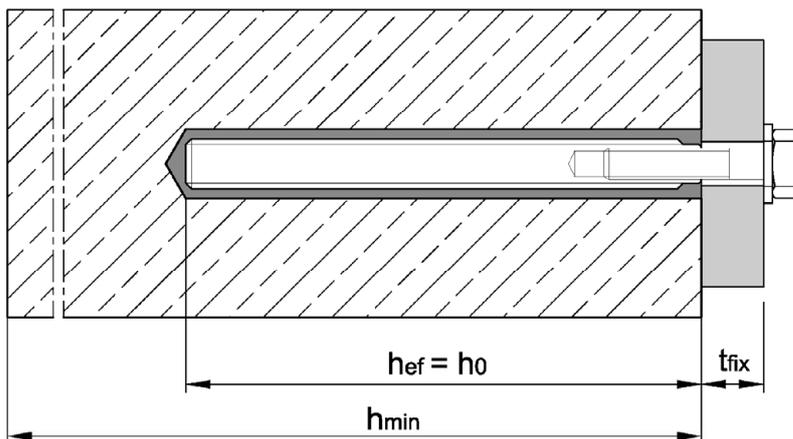

### Installation reinforcing bar $\varnothing 8$ to $\varnothing 32$

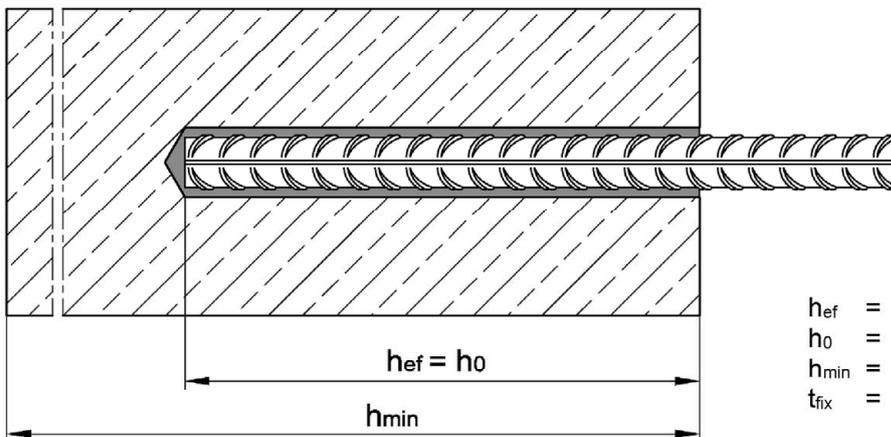

$h_{ef}$  = effective anchorage depth  
 $h_0$  = depth of drill hole  
 $h_{min}$  = minimum thickness of member  
 $t_{fix}$  = thickness of fixture

SIKLA Injection System AN VME basic C


Product description  
Installation situation

Annex A1

## Cartridge Injection Mortar AN VME basic C
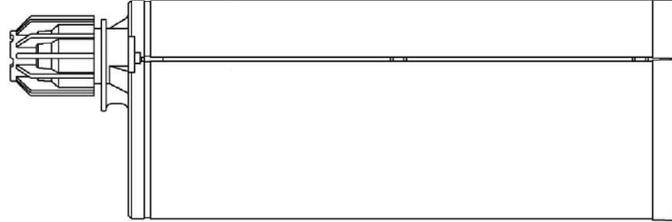
### Side-by-side cartridge


440 ml,  
585 ml,  
1400 ml




### Imprint:

VME basic  
processing notes, batch number, shelf life, hazard code, storage temperature, curing- and processing time,  
optional with travel scale

### Static mixer



### Retaining washer and extension nozzle

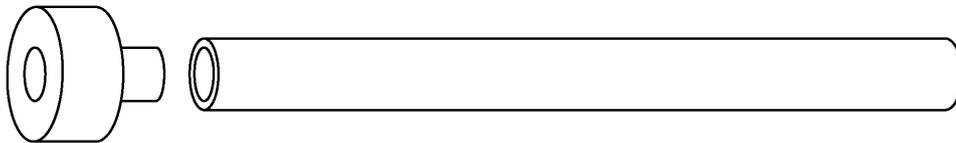

SIKLA Injection System AN VME basic C


### Product description

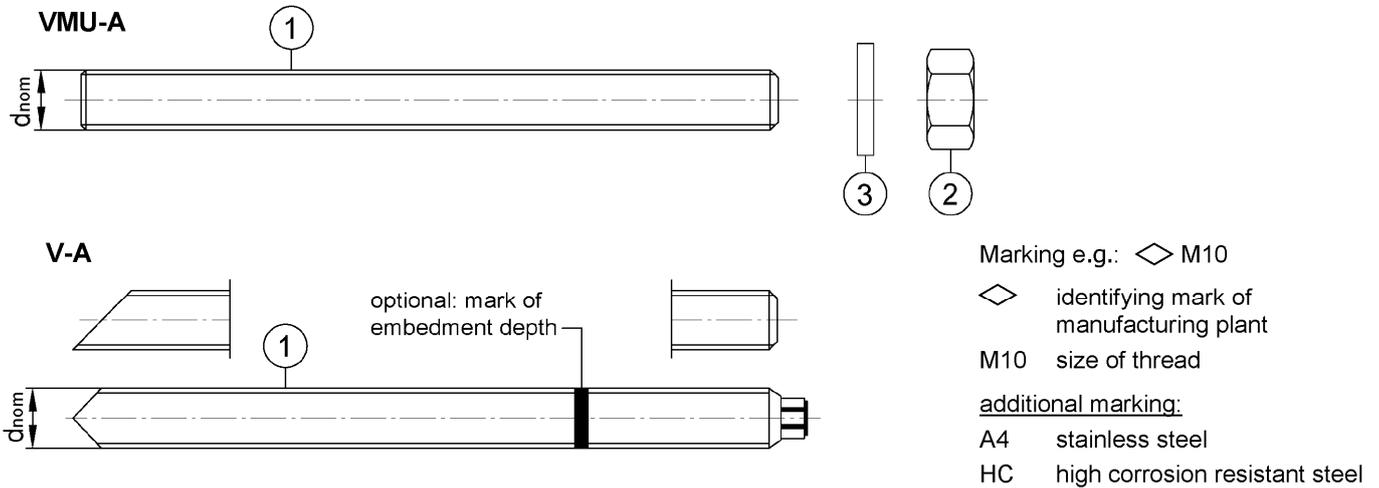Cartridge, static mixer and retaining washer

Annex A2

## Threaded rod

**Threaded rod VMU-A, V-A with washer and hexagon nut**  
**M8, M10, M12, M16, M20, M24, M27, M30** (zinc plated, A4, HCR)



**Threaded rod VM-A** (material sold by the metre, to be cut at the required length)  
**M8, M10, M12, M16, M20, M24, M27, M30** (zinc plated, A2, A4, HCR)


### Commercial standard threaded rod with:

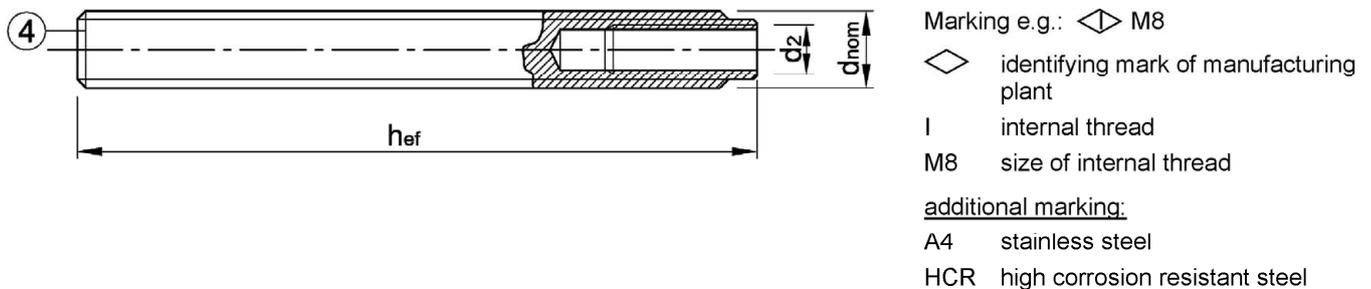**M8, M10, M12, M16, M20, M24, M27, M30** (zinc plated, A2, A4, HCR)

- Materials, dimensions and mechanical properties see Table A1
- Steel, zinc plated, according to EN ISO 898-1:2013; EN ISO 898-2:2022
- Stainless steel or high corrosion resistant steel according to EN ISO 3506-1:2020; EN ISO 3506-2:2020
- Inspection certificate 3.1 acc. to EN 10204:2004

## Internally threaded anchor rod

**VMU-IG M6, VMU-IG M8, VMU-IG M10, VMU-IG M12, VMU-IG M16, VMU-IG M20**  
(zinc plated, A4, HCR)



**SIKLA Injection System AN VME basic C**

### Product description

Threaded rod and internally threaded anchor rod

**Annex A3**

**Table A1: Materials - Threaded rod and internally threaded anchor rod**

Part	Designation	Material					
<b>Steel, zinc plated</b> electroplated $\geq 5 \mu\text{m}$ , hot-dip galvanized $\geq 40 \mu\text{m}$ (50 $\mu\text{m}$ in average) or sherardized $\geq 45 \mu\text{m}$							
1	Threaded rod	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation
		4.6	$f_{uk}$ [N/mm <sup>2</sup> ]	400	$f_{yk}$ [N/mm <sup>2</sup> ]	240	A <sub>5</sub> > 8 %
		4.8		400		320	A <sub>5</sub> > 8 %
		5.6		500		300	A <sub>5</sub> > 8 %
		5.8		500		400	A <sub>5</sub> > 8 %
8.8	800	640		A <sub>5</sub> > 8 %			
2	Hexagon nut	4	for class 4.6 or 4.8 rods				
		5	for class 4.6, 4.8, 5.6 or 5.8 rods				
		8	for class 4.6, 4.8, 5.6, 5.8 or 8.8 rods				
3	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000, EN ISO 887:2006					
4	Internally threaded anchor rod	5.8	Steel, electroplated or sherardized			A <sub>5</sub> > 8%	
		8.8				A <sub>5</sub> > 8%	
<b>Stainless steel A2</b> <sup>1)</sup>		<b>CRC II</b> (e.g. 1.4301 / 1.4307 / 1.4311 / 1.4567 / 1.4541)					
<b>Stainless steel A4</b>		<b>CRC III</b> (e.g. 1.4401 / 1.4404 / 1.4571 / 1.4578)					
<b>High corrosion resistant steel HCR</b>		<b>CRC V</b> (e.g. 1.4529 / 1.4565)					
1	Threaded rod <sup>2)</sup>	Property class	characteristic ultimate strength		characteristic yield strength		fracture elongation
		50	$f_{uk}$ [N/mm <sup>2</sup> ]	500	$f_{yk}$ [N/mm <sup>2</sup> ]	210	A <sub>5</sub> > 8%
		70		700		450	A <sub>5</sub> > 8%
80	800	600		A <sub>5</sub> > 8%			
2	Hexagon nut <sup>2)</sup>	50	for class 50 rods				
		70	for class 50 or 70 rods				
		80	for class 50, 70 or 80 rods				
3	Washer	e.g.: EN ISO 7089:2000, EN ISO 7093:2000, EN ISO 7094:2000; EN ISO 887:2006					
4	Internally threaded anchor rod	50	IG-M20			A <sub>5</sub> > 8 %	
		70	IG-M6 to IG-M16			A <sub>5</sub> > 8 %	

<sup>1)</sup> Property classes 50 and 70

<sup>2)</sup> Property classes 70 and 80 up to M24

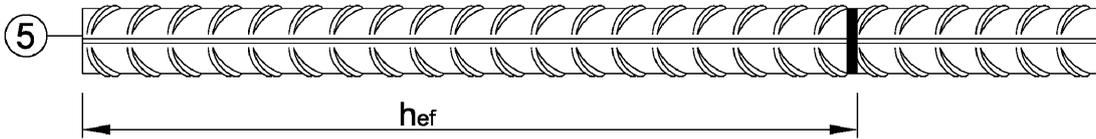
**SIKLA Injection System AN VME basic C**

**Product description**  
Materials - Threaded rod and internally threaded anchor rod

**Annex A4**

### Reinforcing bar

Ø 8, Ø 10, Ø 12, Ø 14, Ø 16, Ø 20, Ø 24, Ø 25, Ø 28, Ø 32



- Minimum value of related rip area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- Rip height of the bar shall be in the range  $0,05d \leq h \leq 0,07d$   
(d: Nominal diameter of the bar; h: Rip height of the bar)

**Table A2: Material reinforcing bar**

Part	Designation	Material
<b>Rebar</b>		
5	Rebar EN 1992-1-1:2004+AC:2010, Annex C	Bars and de-coiled rods class B or C $f_{yk}$ and $k$ according to NDP or NCI acc. EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

**SIKLA Injection System AN VME basic C**

**Product description**  
Product description and material reinforcing bar

**Annex A5**

### Specification of intended use

Injections System VME basic	Threaded rod	Internally threaded anchor rod	Rebar
Static and quasi-static action	M8 - M30	VMU-IG M6 – VMU-IG M20	Ø8 - Ø32
Base material	cracked or uncracked concrete		
	Concrete strength classes C20/25 to C50/60 compacted, reinforced or unreinforced normal weight concrete (without fibers) acc. to EN 206:2013+A1:2016		
Hole drilling	hammer drilling / compressed air drilling / vacuum drilling		
Temperature range I: -40°C to +40°C	max. long term temperature +24°C and max. short term temperature +40°C		
Temperature range II: -40°C to +60°C	max. long term temperature +35°C and max. short term temperature +60°C		
Temperature range III: -40°C to +70°C	max. long term temperature +43°C and max. short term temperature +70°C		

#### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions: all materials
- For all other conditions: Intended use of Materials according to Annex A4, Table A1 corresponding corrosion resistance classes CRC according to EN 1993-1-4:2006+A1:2015

#### Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be fastened. The position of the fastener is indicated on the design drawings (e. g. position of the fastener relative to reinforcement or to supports etc.)
- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work
- Fasteners are designed in accordance with EN 1992-4:2018 and Technical Report TR 055, Edition February 2018

#### Installation:

- Dry or wet concrete or waterfilled drill holes (not seawater)
- Hole drilling by hammer or compressed air drill or vacuum drill mode
- Overhead installation allowed
- Fastener installation carried out by appropriately qualified personnel and under the responsibility of the person competent for technical matters on site
- Internally threaded anchor rod: screws and threaded rods (incl. nut and washer) must at least correspond to the material and strength class of the internally threaded anchor rod

SIKLA Injection System AN VME basic C

Intended Use  
Specifications

Annex B1

**Table B1: Installation parameters for threaded rods**

Threaded rod		M8	M10	M12	M16	M20	M24	M27	M30
Diameter of threaded rod	$d=d_{nom}$ [mm]	8	10	12	16	20	24	27	30
Nominal drill hole diameter	$d_0$ [mm]	10	12	14	18	22	28	30	35
Effective anchorage depth	$h_{ef,min}$ [mm]	60	60	70	80	90	96	108	120
	$h_{ef,max}$ [mm]	160	200	240	320	400	480	540	600
Diameter of clearance hole in the fixture	Pre-setting installation $d_f \leq$ [mm]	9	12	14	18	22	26	30	33
	Through setting installation $d_f \leq$ [mm]	12	14	16	20	24	30	33	40
Installation torque	$max. T_{inst} \leq$ [Nm]	10	20	40 (35) <sup>1)</sup>	60	100	170	250	300
Minimum thickness of member	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$				
Minimum spacing	$s_{min}$ [mm]	40	50	60	75	95	115	125	140
Minimum edge distance	$c_{min}$ [mm]	35	40	45	50	60	65	75	80

<sup>1)</sup> Max. installation torque for M12 with steel grade 4.6

**Table B2: Installation parameters for internally threaded anchor rods**

Internally threaded anchor rod		IG-M 6	IG-M 8	IG-M 10	IG-M 12	IG-M 16	IG-M 20
Inner diameter of threaded rod	$d_2$ [mm]	6	8	10	12	16	20
Outer diameter of threaded rod <sup>1)</sup>	$d=d_{nom}$ [mm]	10	12	16	20	24	30
Nominal drill hole diameter	$d_0$ [mm]	12	14	18	22	28	35
Effective anchorage depth	$h_{ef,min}$ [mm]	60	70	80	90	96	120
	$h_{ef,max}$ [mm]	200	240	320	400	480	600
Diameter of clearance hole in the fixture	$d_f \leq$ [mm]	7	9	12	14	18	22
Installation torque	$max. T_{inst} \leq$ [Nm]	10	10	20	40	60	100
Minimum screw-in depth	$l_{IG}$ [mm]	8	8	10	12	16	20
Minimum thickness of member	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$		$h_{ef} + 2d_0$			
Minimum spacing	$s_{min}$ [mm]	50	60	75	95	115	140
Minimum edge distance	$c_{min}$ [mm]	40	45	50	60	65	80

<sup>1)</sup> With metric thread acc. to EN 1993-1-8:2005+AC:2009

**Table B3: Installation parameters for rebar**

Rebar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Diameter of rebar	$d=d_{nom}$ [mm]	8	10	12	14	16	20	24	25	28	32
Nominal drill hole diameter <sup>1)</sup>	$d_0$ [mm]	10   12	12   14	14   16	18	20	25	32	32	35	40
Effective anchorage depth	$h_{ef,min}$ [mm]	60	60	70	75	80	90	96	100	112	128
	$h_{ef,max}$ [mm]	160	200	240	280	320	400	480	500	560	640
Minimum thickness of member	$h_{min}$ [mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$						
Minimum spacing	$s_{min}$ [mm]	40	50	60	70	75	95	120	120	130	150
Minimum edge distance	$c_{min}$ [mm]	35	40	45	50	50	60	70	70	75	85

<sup>1)</sup> For diameter Ø8, Ø10 and Ø12 both nominal drill hole diameter can be used

**SIKLA Injection System AN VME basic C**

**Intended use**  
Installation parameters

**Annex B2**

**Table B4: Parameter cleaning and setting tools**

Threaded rod	Internally threaded anchor rod	Rebar	Drill bit Ø	Brush Ø	min. Brush Ø
					
[-]	[-]	Ø [mm]	d <sub>0</sub> [mm]	d <sub>b</sub> [mm]	d <sub>b,min</sub> [mm]
M8		8	10	11,5	10,5
M10	VMU-IG M 6	8 / 10	12	13,5	12,5
M12	VMU-IG M 8	10 / 12	14	15,5	14,5
		12	16	17,5	16,5
M16	VMU-IG M10	14	18	20,0	18,5
		16	20	22,0	20,5
M20	VMU-IG M12		22	24,0	22,5
		20	25	27,0	25,5
M24	VMU-IG M16		28	30,0	28,5
M27			30	31,8	30,5
		24 / 25	32	34,0	32,5
M30	VMU-IG M20	28	35	37,0	35,5
		32	40	43,5	40,5

**Table B5: Retaining washer**

Drill bit Ø		Installation direction and use		
d <sub>0</sub> [mm]	[-]	↓	→	↑
10		No retaining washer required		
12				
14				
16				
18	VM-IA 18	h <sub>ef</sub> > 250mm	h <sub>ef</sub> > 250mm	all
20	VM-IA 20			
22	VM-IA 22			
25	VM-IA 25			
28	VM-IA 28			
30	VM-IA 30			
32	VM-IA 32			
35	VM-IA 35			
40	VM-IA 40			



**Vacuum drill bit**

Drill bit diameter (d<sub>0</sub>): all diameters  
Vacuum drill bit (MKT Hollow drill bit SB, Würth Extraction Drill Bit or Heller Duster Expert) and a class M vacuum with minimum negative pressure of 253 hPa and a flow rate of minimum 42 l/s (150 m³/h)



**Recommended compressed air tool (min 6 bar)**

Drill bit diameter (d<sub>0</sub>): all diameters



**Blow-out pump (volume 750ml)**









Drill bit diameter (d<sub>0</sub>): 10 mm to 20 mm  
Drill hole depth (h<sub>0</sub>): ≤ 10 d<sub>nom</sub>  
for uncracked concrete

**SIKLA Injection System AN VME basic C**

**Intended Use**  
Cleaning and setting tools

**Annex B3**

## Installation Instructions






Drilling of the hole		
1		<p><b>Hammer drill or compressed air drill</b> Drill with hammer drill or compressed air drill a hole into the base material to the size required by the selected fastener (Table B1, B2 or B3). Continue with <u>step 2</u>. In case of aborted drill hole, the drill hole shall be filled with mortar.</p>
		<p><b>Vacuum drill bit: see Annex B3</b> Drill hole into the base material to the embedment size and embedment depth required by the selected fastener (Table B1, B2 or B3). This drilling system removes dust and cleans the drill hole during drilling. Continue with <u>step 3</u>. In case of aborted hole, the drill hole shall be filled with mortar.</p>
Cleaning (not applicable when using a vacuum drill)		
<b>Attention! Standing water in the drill hole must be removed before cleaning!</b>		
<b>Cleaning with compressed air</b>		
all substrates and diameters according to Annex B1		
2a		<p>Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) a minimum of <b>two</b> times until return air stream is free of noticeable dust. If the drill hole ground is not reached, an extension must be used.</p>
2b		<p>Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush <math>\geq d_{b,min}</math> (Table B4) a minimum of <b>two</b> times. If the drill hole ground is not reached with the brush, an appropriate brush extension must be used.</p>
2c		<p>Starting from the bottom or back of the drill hole, blow out the hole with compressed air (min. 6 bar) again a minimum of <b>two</b> times until return air stream is free of noticeable dust. If the drill hole ground is not reached, an extension must be used.</p>
2	<b>Manual cleaning</b>	
uncracked concrete, dry or wet drill holes; drill hole diameter $d_0 \leq 20\text{mm}$ and drill hole depth $h_0 \leq 10 d_{nom}$		
2a		<p>Starting from the bottom or back of the drill hole, blow out the hole with the blow-out pump a minimum of <b>four</b> times until return air stream is free of noticeable dust.</p>
2b		<p>Check brush diameter (Table B4). Brush the hole with an appropriate sized wire brush <math>\geq d_{b,min}</math> (Table B4) a minimum of <b>four</b> times. If the drill hole ground is not reached with the brush, an appropriate brush extension must be used.</p>
2c		<p>Starting from the bottom or back of the drill hole blow out the hole again a minimum of <b>four</b> times until return air stream is free of noticeable dust.</p>
<p>After cleaning, the drill hole has to be protected against re-contamination in an appropriate way, until dispensing the mortar in the drill hole. If necessary, the cleaning has to be repeated directly before dispensing the mortar. In-flowing water must not contaminate the drill hole again.</p>		

### SIKLA Injection System AN VME basic C

Intended Use  
Installation instructions

Annex B4

### Installation instructions (continuation)







Injection		
3		Attach the supplied static mixer to the cartridge and load the cartridge into the correct dispensing tool. For every working interruption longer than the recommended working time (Table B6) as well as for new cartridges, a new static-mixer shall be used.
4		Prior to inserting the rod into the filled drill hole, the position of the embedment depth shall be marked on the threaded rod or rebar.
5		Prior to dispensing into the drill hole, squeeze out separately a minimum of three full strokes and discard non-uniformly mixed adhesive components until the mortar shows a consistent grey or red colour.
6a		Starting from the bottom or back of the cleaned drill hole fill the hole up to approximately two-thirds with adhesive. Slowly withdraw the static mixing nozzle as the hole fills to avoid air pockets. If the drill hole ground is not reached, an appropriate extension nozzle shall be used. Observe working times given in Table B6.
6b		Retaining washer and mixer nozzle extensions shall be used according to Table B5 for the following applications: <ul style="list-style-type: none"> <li>• Horizontal installation (horizontal direction) and ground installation (vertical downwards direction): Drill bit-Ø <math>d_0 \geq 18</math> mm and anchorage depth <math>h_{ef} &gt; 250</math>mm</li> <li>• Overhead installation: Drill bit-Ø <math>d_0 \geq 18</math> mm</li> </ul>

SIKLA Injection System AN VME basic C

Intended Use  
Installation instructions (continuation)

Annex B5

## Installation instructions (continuation)

Setting the fastening element	
7	 <p>Push the fastening element into the hole while turning slightly to ensure proper distribution of the adhesive until the embedment depth is reached.</p> <p>The fastener shall be free of dirt, grease, oil or other foreign material.</p>
8	 <p>After installation, the annular gap between anchor rod and concrete must be completely filled with mortar, in the case of push-through installation also in the fixture. If these requirements are not fulfilled, repeat application before end of working time!</p> <p>For overhead installation, the fastener should be fixed (e.g. by wedges).</p>
9	 <p>Allow the adhesive to cure to the specified time prior to applying any load or torque. Do not move or load the fastener until it is fully cured (attend Table B6).</p>
10	 <p>Remove excess mortar.</p>
11	 <p>The fixture can be mounted after curing time. Apply installation torque <math>\leq \max. T_{inst}</math> according to Table B1 or B2.</p>
12	 <p>In case of pre-setting installation, the annular gap between anchor rod and fixture may optionally be filled with mortar. Therefore, replace regular washer by filling washer and plug on reducing adapter on static mixer. Annular gap is completely filled, when excess mortar seeps out.</p>

**Table B6: Working time and curing time**

Concrete temperature	Working time	Minimum curing time	
		dry concrete	wet concrete
+5°C to +9°C	80 min	60 h	120 h
+10°C to +14°C	60 min	48 h	96 h
+15°C to +19°C	40 min	24 h	48 h
+20°C to +24°C	30 min	12 h	24 h
+25°C to +34°C	12 min	10 h	20 h
+35°C to +39°C	8 min	7 h	14 h
+40°C	8 min	4 h	8 h
<b>Cartridge temperature</b>	+ 5°C to + 40°C		

### SIKLA Injection System AN VME basic C

**Intended Use**  
Installation instructions (continuation) / Working and curing time

**Annex B6**

**Table C1: Characteristic steel resistance for threaded rods under tension load**

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
<b>Steel failure</b>											
Cross sectional area $A_s$ [mm <sup>2</sup> ]				36,6	58,0	84,3	157	245	353	459	561
<b>Characteristic resistance under tension load <sup>1)</sup></b>											
Steel, zinc plated	Property class 4.6 and 4.8	$N_{Rk,s}$	[kN]	15 (13)	23 (21)	34	63	98	141	184	224
	Property class 5.6 and 5.8	$N_{Rk,s}$	[kN]	18 (17)	29 (27)	42	78	122	176	230	280
	Property class 8.8	$N_{Rk,s}$	[kN]	29 (27)	46 (43)	67	125	196	282	368	449
Stainless steel	A2, A4 and HCR Property class 50	$N_{Rk,s}$	[kN]	18	29	42	79	123	177	230	281
	A2, A4 and HCR Property class 70	$N_{Rk,s}$	[kN]	26	41	59	110	171	247	_ <sup>3)</sup>	_ <sup>3)</sup>
	A4 and HCR Property class 80	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	_ <sup>3)</sup>	_ <sup>3)</sup>
<b>Partial factor <sup>2)</sup></b>											
Steel, zinc plated	Property class 4.6	$\gamma_{Ms,N}$	[-]	2,0							
	Property class 4.8	$\gamma_{Ms,N}$	[-]	1,5							
	Property class 5.6	$\gamma_{Ms,N}$	[-]	2,0							
	Property class 5.8	$\gamma_{Ms,N}$	[-]	1,5							
	Property class 8.8	$\gamma_{Ms,N}$	[-]	1,5							
Stainless steel	A2, A4 and HCR Property class 50	$\gamma_{Ms,N}$	[-]	2,86							
	A2, A4 and HCR Property class 70	$\gamma_{Ms,N}$	[-]	1,87						_ <sup>3)</sup>	_ <sup>3)</sup>
	A4 and HCR Property class 80	$\gamma_{Ms,N}$	[-]	1,6						_ <sup>3)</sup>	_ <sup>3)</sup>

<sup>1)</sup> The characteristic resistances apply for all anchor rods with the cross sectional area  $A_s$  specified here: VMU-A, V-A, VM-A. For commercial standard threaded rods with a smaller cross sectional area (e.g. hot-dip galvanized threaded rods M8, M10 according to EN ISO 10684:2004 + AC:2009), the values in brackets are valid.

<sup>2)</sup> In absence of other national regulations

<sup>3)</sup> Fastener version not part of the ETA

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values for **threaded rods** under **tension loads**

**Annex C1**

**Table C2: Characteristic steel resistance for threaded rods under shear load**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
<b>Steel failure</b>											
Cross sectional area $A_s$ [mm <sup>2</sup> ]			36,6	58,0	84,3	157	245	353	459	561	
<b>Characteristic resistances under shear load<sup>1)</sup></b>											
<b>Steel failure <u>without</u> lever arm</b>											
Steel, zinc plated	Property class 4.6 and 4.8	$V^{0}_{Rk,s}$ [kN]	9 (8)	14 (13)	20	38	59	85	110	135	
	Property class 5.6 and 5.8	$V^{0}_{Rk,s}$ [kN]	11 (10)	17 (16)	25	47	74	106	138	168	
	Property class 8.8	$V^{0}_{Rk,s}$ [kN]	15 (13)	23 (21)	34	63	98	141	184	224	
Stainless steel	A2, A4 and HCR, property class 50	$V^{0}_{Rk,s}$ [kN]	9	15	21	39	61	88	115	140	
	A2, A4 and HCR, property class 70	$V^{0}_{Rk,s}$ [kN]	13	20	30	55	86	124	– <sup>3)</sup>	– <sup>3)</sup>	
	A4 and HCR, property class 80	$V^{0}_{Rk,s}$ [kN]	15	23	34	63	98	141	– <sup>3)</sup>	– <sup>3)</sup>	
<b>Steel failure <u>with</u> lever arm</b>											
Steel, zinc plated	Property class 4.6 and 4.8	$M^{0}_{Rk,s}$ [Nm]	15 (13)	30 (27)	52	133	260	449	666	900	
	Property class 5.6 and 5.8	$M^{0}_{Rk,s}$ [Nm]	19 (16)	37 (33)	65	166	324	560	833	1123	
	Property class 8.8	$M^{0}_{Rk,s}$ [Nm]	30 (26)	60 (53)	105	266	519	896	1333	1797	
Stainless steel	A2, A4 and HCR, property class 50	$M^{0}_{Rk,s}$ [Nm]	19	37	66	167	325	561	832	1125	
	A2, A4 and HCR, property class 70	$M^{0}_{Rk,s}$ [Nm]	26	52	92	232	454	784	– <sup>3)</sup>	– <sup>3)</sup>	
	A4 and HCR, property class 80	$M^{0}_{Rk,s}$ [Nm]	30	59	105	266	519	896	– <sup>3)</sup>	– <sup>3)</sup>	
<b>Partial factor <sup>2)</sup></b>											
Steel, zinc plated	Property class 4.6	$\gamma_{Ms,V}$ [-]	1,67								
	Property class 4.8	$\gamma_{Ms,V}$ [-]	1,25								
	Property class 5.6	$\gamma_{Ms,V}$ [-]	1,67								
	Property class 5.8	$\gamma_{Ms,V}$ [-]	1,25								
	Property class 8.8	$\gamma_{Ms,V}$ [-]	1,25								
Stainless steel	A2, A4 and HCR, property class 50	$\gamma_{Ms,V}$ [-]	2,38								
	A2, A4 and HCR, property class 70	$\gamma_{Ms,V}$ [-]	1,56						– <sup>3)</sup>	– <sup>3)</sup>	
	A4 and HCR, property class 80	$\gamma_{Ms,V}$ [-]	1,33						– <sup>3)</sup>	– <sup>3)</sup>	

<sup>1)</sup> The characteristic resistances apply for all anchor rods with the cross sectional area  $A_s$  specified here: VMU-A, V-A, VM-A. For commercial standard threaded rods with a smaller cross sectional area (e.g. hot-dip galvanized threaded rods M8, M10 according to EN ISO 10684:2004 + AC:2009), the values in brackets are valid

<sup>2)</sup> In absence of other national regulations

<sup>3)</sup> Fastener version is not part of the ETA

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values for **threaded rods** under **shear loads**

**Annex C2**

**Table C3: Characteristic values of concrete cone failure and splitting failure**

Threaded rods / Internally threaded anchor rods / Rebars			all sizes	
<b>Concrete cone failure</b>				
Factor $k_1$	uncracked concrete	$k_{ucr,N}$	[-]	11,0
	cracked concrete	$k_{cr,N}$	[-]	7,7
Edge distance		$c_{cr,N}$	[mm]	$1,5 \cdot h_{ef}$
Spacing		$s_{cr,N}$	[mm]	$2,0 \cdot c_{cr,N}$
<b>Splitting failure</b>				
Characteristic resistance		$N^0_{Rk,sp}$	[kN]	$\min ( N_{Rk,p} ; N^0_{Rk,c} )$
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 \cdot h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} ( 2,5 - h / h_{ef} )$
	$h/h_{ef} \leq 1,3$			$2,4 \cdot h_{ef}$
Spacing		$s_{cr,sp}$	[mm]	$2,0 \cdot c_{cr,sp}$

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **concrete cone failure** and **splitting failure**

**Annex C3**

**Table C4: Characteristic values of tension loads for threaded rods**

Threaded rod		M8	M10	M12	M16	M20	M24	M27	M30		
<b>Steel failure</b>											
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ or see Table C1								
Partial factor	$\gamma_{Ms,N}$	[-]	see Table C1								
<b>Combined pull-out and concrete failure</b>											
<b>Characteristic bond resistance in <u>uncracked</u> concrete C20/25</b>											
Temperature range	I 40°C / 24°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	15	15	14	14	13	13	
	II 60°C / 35°C			10	10	10	9,5	9,5	9,0	9,0	9,0
	III 70°C / 43°C			7,0	7,0	7,0	6,5	6,5	6,0	6,0	6,0
<b>Characteristic bond resistance in <u>cracked</u> concrete C20/25</b>											
Temperature range	I 40°C / 24°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	7,0	7,0	7,0	7,0	7,0	6,0	6,0	
	II 60°C / 35°C			5,0	5,0	5,0	5,0	5,0	4,5	4,5	4,5
	III 70°C / 43°C			3,5	3,5	3,5	3,5	3,5	3,0	3,0	3,0
<b>Reduction factor <math>\psi_{sus}^0</math> in concrete C20/25</b>											
Temperature range	I 40°C / 24°C	$\psi_{sus}^0$	[-]	0,60							
	II 60°C / 35°C										
	III 70°C / 43°C										
Increasing factors for $\tau_{Rk}$ $\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$	$\psi_c$		C25/30	1,02							
			C30/37	1,04							
			C35/45	1,07							
			C40/50	1,08							
			C45/55	1,09							
			C50/60	1,10							
<b>Concrete cone failure</b>											
Relevant parameter		see Table C3									
<b>Splitting failure</b>											
Relevant parameter		see Table C3									
<b>Installation factor</b>											
Dry or wet concrete or water filled drill hole	$\gamma_{inst}$	[-]	1,4								

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **tension loads for threaded rods**

**Annex C4**

**Table C5: Characteristic values of shear loads for threaded rods**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
<b>Steel failure <u>without</u> lever arm</b>											
Characteristic resistance steel, zinc plated, class 4.6, 4.8, 5.6 and 5.8	$V_{Rk,s}^0$	[kN]	0,6 · $A_s$ · $f_{uk}$ or see Table C2								
Characteristic resistance steel, zinc plated, class 8.8, stainless steel A2, A4 and HCR	$V_{Rk,s}^0$	[kN]	0,5 · $A_s$ · $f_{uk}$ or see Table C2								
Ductility factor	$k_7$	[-]	1,0								
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C2								
<b>Steel failure <u>with</u> lever arm</b>											
Characteristic bending resistance	$M_{Rk,s}^0$	[Nm]	1,2 · $W_{el}$ · $f_{uk}$ or see Table C2								
Elastic section modulus	$W_{el}$	[mm <sup>3</sup> ]	31	62	109	277	541	935	1387	1874	
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C2								
<b>Concrete pry-out failure</b>											
Pry-out factor	$k_8$	[-]	2,0								
<b>Concrete edge failure</b>											
Effective length of fastener	$l_f$	[mm]	min ( $h_{ef}$ ; 12 $d_{nom}$ )							min ( $h_{ef}$ ; 300mm)	
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	16	20	24	27	30	
Installation factor	$\gamma_{inst}$	[-]	1,0								

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **shear loads** for threaded rods

**Annex C5**

**Table C6: Characteristic values of tension loads for internally threaded anchor rod**

Internally threaded anchor rod				VMU-IG M6	VMU-IG M8	VMU-IG M10	VMU-IG M12	VMU-IG M16	VMU-IG M20
<b>Steel failure <sup>1)</sup></b>									
Characteristic resistance, steel, zinc plated, property class	5.8	$N_{Rk,s}$	[kN]	10	17	29	42	76	123
	8.8	$N_{Rk,s}$	[kN]	16	27	46	67	121	196
Partial factor		$\gamma_{Ms,N}$	[-]	1,5					
Characteristic resistance, stainless steel A4 / HCR, property class	70	$N_{Rk,s}$	[kN]	14	26	41	59	110	124 <sup>2)</sup>
		$\gamma_{Ms,N}$	[-]	1,87					
<b>Combined pull-out and concrete failure</b>									
<b>Characteristic bond resistance in <u>uncracked</u> concrete C20/25</b>									
Temperature range	I: 40°C / 24°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	15	14	14	13	13
	II: 60°C / 35°C			10	10	9,5	9,5	9,0	9,0
	III: 70°C / 43°C			7,0	7,0	6,5	6,5	6,0	6,0
<b>Characteristic bond resistance in <u>cracked</u> concrete C20/25</b>									
Temperature range	I: 40°C / 24°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	7,0	7,0	7,0	7,0	6,0	6,0
	II: 60°C / 35°C			5,0	5,0	5,0	5,0	4,5	4,5
	III: 70°C / 43°C			3,5	3,5	3,5	3,5	3,0	3,0
<b>Reduction factor <math>\psi^0_{sus}</math> in concrete C20/25</b>									
Temperature range	I: 40°C / 24°C	$\psi^0_{sus}$	[-]	0,60					
	II: 60°C / 35°C								
	III: 70°C / 43°C								
Increasing factors for $\tau_{Rk}$ $\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$		$\psi_c$		C25/30	1,02				
				C30/37	1,04				
				C35/45	1,07				
				C40/50	1,08				
				C45/55	1,09				
				C50/60	1,10				
<b>Concrete cone failure</b>									
Relevant parameter				see Table C3					
<b>Splitting failure</b>									
Relevant parameter				see Table C3					
<b>Installation factor</b>									
Dry or wet concrete or water filled drill hole		$\gamma_{inst}$	[-]	1,4					

<sup>1)</sup> Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod. The characteristic tension resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element

<sup>2)</sup> For VMU-IG M20: property class 50

**SIKLA Injection System AN VME basic C**

**Performance**

Characteristic values of tension loads for internally threaded anchor rod

**Annex C6**

**Table C7: Characteristic values of shear loads for internally threaded anchor rod**

Internally threaded anchor rod				VMU-IG M6	VMU-IG M8	VMU-IG M10	VMU-IG M12	VMU-IG M16	VMU-IG M20	
<b>Steel failure <u>without</u> lever arm <sup>1)</sup></b>										
Steel, zinc plated	Characteristic resistance	property class 5.8	$V_{Rk,s}^0$	[kN]	6	10	17	25	45	74
	Characteristic resistance	property class 8.8	$V_{Rk,s}^0$	[kN]	8	14	23	34	60	98
	Partial factor		$\gamma_{Ms,V}$	[-]		1,25				
Stainless steel	Characteristic resistance	property class 70	$V_{Rk,s}^0$	[kN]	7	13	20	30	55	62 <sup>2)</sup>
	Partial factor		$\gamma_{Ms,V}$	[-]		1,56				2,38
Ductility factor			$k_7$	[-]		1,0				
<b>Steel failure <u>with</u> lever arm <sup>1)</sup></b>										
Steel, zinc plated	Characteristic bending resistance	property class 5.8	$M_{Rk,s}^0$	[Nm]	8	19	37	66	167	325
	Characteristic bending resistance	property class 8.8	$M_{Rk,s}^0$	[Nm]	12	30	60	105	267	519
	Partial factor		$\gamma_{Ms,V}$	[-]		1,25				
Stainless steel	Characteristic bending resistance	property class 70	$M_{Rk,s}^0$	[Nm]	11	26	53	92	234	643 <sup>2)</sup>
	Partial factor		$\gamma_{Ms,V}$	[-]		1,56				2,38
<b>Concrete pry-out failure</b>										
Pry-out factor			$k_8$	[-]		2,0				
<b>Concrete edge failure</b>										
Effective length of fastener			$l_f$	[mm]	min ( $h_{ef}$ ; 12 $d_{nom}$ )					min ( $h_{ef}$ ; 300mm)
Outside diameter of fastener			$d_{nom}$	[mm]	10	12	16	20	24	30
Installation factor			$\gamma_{inst}$	[-]		1,0				

<sup>1)</sup> Fastening screws or threaded rods (incl. nut and washer) must comply with the appropriate material and property class of the internally threaded anchor rod (exception: VMU-IG M20). The characteristic shear resistance for steel failure of the given strength class are valid for the internally threaded anchor rod and the fastening element

<sup>2)</sup> For VMU-IG M20: Internally threaded rod: property class 50;  
Fastening screws or threaded rods (incl. nut and washer): property class 70

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **shear loads** for internally threaded anchor rod

**Annex C7**

**Table C8: Characteristic values of tension loads for rebar**

Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32				
<b>Steel failure</b>															
Characteristic resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$												
Cross sectional area	$A_s$	[mm <sup>2</sup> ]	50	79	113	154	201	314	452	491	616	804			
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 <sup>2)</sup>												
<b>Combined pull-out and concrete failure</b>															
<b>Characteristic bond resistance in <u>uncracked</u> concrete C20/25</b>															
Temperature range	I: 40°C / 24°C	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	14	14	14	12	12	12	12	11	11	11		
	II: 60°C / 35°C			9,5	9,5	9,5	8,5	8,5	8,5	7,5	7,5	7,5	7,5		
	III: 70°C / 43°C			6,0	6,0	6,0	6,0	6,0	5,5	5,5	5,5	5,0	5,0		
<b>Characteristic bond resistance in <u>cracked</u> concrete C20/25</b>															
Temperature range	I: 40°C / 24°C	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	6,0	7,0	7,0	6,5	6,5	6,0	6,0	6,0	5,5	5,5		
	II: 60°C / 35°C			4,0	4,5	4,5	4,5	4,0	4,0	4,0	4,0	3,5	3,5		
	III: 70°C / 43°C			2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5		
<b>Reduction factor <math>\psi_{sus}^0</math> in concrete C20/25</b>															
Temperature range	I: 40°C / 24°C	$\psi_{sus}^0$	[-]	0,60											
	II: 60°C / 35°C														
	III: 70°C / 43°C														
Increasing factor for $\tau_{Rk}$ $\tau_{Rk} = \psi_c \cdot \tau_{Rk}(C20/25)$	$\psi_c$	C25/30	1,02												
			C30/37	1,04											
				C35/45	1,07										
					C40/50	1,08									
						C45/55	1,09								
							C50/60	1,10							
<b>Concrete cone failure</b>															
Relevant parameter	see Table C3														
<b>Splitting failure</b>															
Relevant parameter	see Table C3														
<b>Installation factor</b>															
Dry or wet concrete or water filled drill hole	$\gamma_{inst}$	[-]	1,4												

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> In absence of national regulation

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **tension loads for rebar**

**Annex C8**

**Table C9: Characteristic values of shear loads for rebar**

Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Steel failure <u>without</u> lever arm</b>											
Characteristic shear resistance	$V_{Rk,s}^0$ [kN]	$0,50 \cdot A_s \cdot f_{uk}^{1)}$									
Cross sectional area	$A_s$ [mm <sup>2</sup> ]	50	79	113	154	201	314	452	491	616	804
Partial factor	$\gamma_{Ms,V}$ [-]	1,5 <sup>2)</sup>									
Ductility factor	$k_7$ [-]	1,0									
<b>Steel failure <u>with</u> lever arm</b>											
Characteristic bending resistance	$M_{Rk,s}^0$ [Nm]	$1,2 \cdot W_{el} \cdot f_{uk}^{1)}$									
Elastic section modulus	$W_{el}$ [mm <sup>3</sup> ]	50	98	170	269	402	785	1357	1534	2155	3217
Partial factor	$\gamma_{Ms,V}$ [-]	1,5 <sup>2)</sup>									
<b>Concrete pry-out failure</b>											
Pry-out factor	$k_8$ [-]	2,0									
<b>Concrete edge failure</b>											
Effective length of rebar	$l_f$ [mm]	min ( $h_{ef}$ ; 12 $d_{nom}$ )								min ( $h_{ef}$ ; 300mm)	
Outside diameter of rebar	$d_{nom}$ [mm]	8	10	12	14	16	20	24	25	28	32
Installation factor	$\gamma_{inst}$ [-]	1,0									

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> In absence of national regulation

**SIKLA Injection System AN VME basic C**

**Performance**  
Characteristic values of **shear loads** for rebar

**Annex C9**

**Table C10: Displacement factor under tension load**  
(threaded rod and internally threaded anchor rod)

Threaded rod		M8	M10 IG-M6	M12 IG-M8	M16 IG- M10	M20 IG-M12	M24 IG-M16	M27	M30 IG-M20	
<b>Displacement factor <sup>1)</sup></b> uncracked concrete, static and quasi-static action										
Temperature range I: 40°C / 24°C	$\delta_{N0}$ -factor	mm [N/mm <sup>2</sup> ]	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
	$\delta_{N\infty}$ -factor		0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
Temperature range II: 60°C / 35°C	$\delta_{N0}$ -factor		0,038	0,039	0,040	0,044	0,047	0,051	0,052	0,055
	$\delta_{N\infty}$ -factor		0,047	0,049	0,051	0,055	0,059	0,064	0,067	0,070
Temperature range III: 70°C / 43°C	$\delta_{N0}$ -factor		0,042	0,043	0,044	0,048	0,052	0,056	0,057	0,061
	$\delta_{N\infty}$ -factor		0,052	0,054	0,056	0,061	0,065	0,070	0,074	0,077
<b>Displacement factor <sup>1)</sup></b> cracked concrete, static and quasi-static action										
Temperature range I: 40°C / 24°C	$\delta_{N0}$ -factor	mm [N/mm <sup>2</sup> ]	0,069	0,071	0,072	0,074	0,076	0,079	0,081	0,082
	$\delta_{N\infty}$ -factor		0,193	0,115	0,122	0,128	0,135	0,142	0,155	0,171
Temperature range II: 60°C / 35°C	$\delta_{N0}$ -factor		0,092	0,095	0,096	0,099	0,102	0,106	0,109	0,110
	$\delta_{N\infty}$ -factor		0,259	0,154	0,163	0,172	0,181	0,189	0,207	0,229
Temperature range III: 70°C / 43°C	$\delta_{N0}$ -factor		0,101	0,105	0,106	0,109	0,112	0,117	0,120	0,121
	$\delta_{N\infty}$ -factor		0,285	0,169	0,179	0,189	0,199	0,208	0,228	0,252

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : acting bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C11: Displacement factor under shear load**  
(threaded rod and internally threaded anchor rod)

Threaded rod		M8	M10 IG-M6	M12 IG-M8	M16 IG- M10	M20 IG-M12	M24 IG-M16	M27	M30 IG-M20	
<b>Displacement factor <sup>1)</sup></b> cracked and uncracked concrete, static and quasi-static action										
All temperature ranges	$\delta_{V0}$ -factor	[mm/(kN)]	0,06	0,06	0,05	0,04	0,04	0,03	0,03	0,03
	$\delta_{V\infty}$ -factor		0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

V: acting shear load

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**SIKLA Injection System AN VME basic C**

**Performance**  
Displacements (threaded rod and internally threaded anchor rod)

**Annex C10**

**Table C12: Displacement factor under tension load (rebar)**

Rebar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
<b>Displacement factor <sup>1)</sup></b> uncracked concrete, static and quasi-static action												
Temperature range I: 40°C / 24°C	$\delta_{N0}$ -factor	mm [N/mm <sup>2</sup> ]	0,028	0,029	0,030	0,031	0,033	0,035	0,038	0,038	0,040	0,043
	$\delta_{N\infty}$ -factor		0,015	0,015	0,016	0,017	0,017	0,019	0,020	0,020	0,021	0,023
Temperature range II: 60°C / 35°C	$\delta_{N0}$ -factor		0,038	0,039	0,040	0,042	0,044	0,047	0,051	0,051	0,054	0,058
	$\delta_{N\infty}$ -factor		0,047	0,049	0,051	0,053	0,055	0,059	0,065	0,065	0,068	0,072
Temperature range III: 70°C / 43°C	$\delta_{N0}$ -factor		0,042	0,043	0,044	0,046	0,048	0,052	0,056	0,056	0,059	0,064
	$\delta_{N\infty}$ -factor		0,052	0,054	0,056	0,058	0,061	0,065	0,072	0,072	0,075	0,079
<b>Displacement factor <sup>1)</sup></b> cracked concrete, static and quasi-static action												
Temperaturbereich I: 40°C / 24°C	$\delta_{N0}$ -factor	mm [N/mm <sup>2</sup> ]	0,069	0,071	0,072	0,073	0,074	0,076	0,079	0,079	0,081	0,084
	$\delta_{N\infty}$ -factor		0,115	0,122	0,128	0,135	0,142	0,155	0,171	0,171	0,181	0,194
Temperaturbereich II: 60°C / 35°C	$\delta_{N0}$ -factor		0,092	0,095	0,096	0,098	0,099	0,102	0,106	0,106	0,109	0,113
	$\delta_{N\infty}$ -factor		0,154	0,163	0,172	0,181	0,189	0,207	0,229	0,229	0,242	0,260
Temperaturbereich III: 70°C / 43°C	$\delta_{N0}$ -factor		0,101	0,105	0,106	0,108	0,109	0,112	0,117	0,117	0,120	0,124
	$\delta_{N\infty}$ -factor		0,169	0,179	0,189	0,199	0,208	0,228	0,252	0,252	0,266	0,286

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau; \quad \tau: \text{acting bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C13: Displacement factor under shear load (rebar)**

Rebar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
<b>Displacement factor <sup>1)</sup></b> cracked and uncracked concrete, static and quasi-static action												
All temperature ranges	$\delta_{V0}$ -factor	[mm/(kN)]	0,06	0,05	0,05	0,04	0,04	0,04	0,03	0,03	0,03	0,03
	$\delta_{V\infty}$ -factor		0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05	0,04	0,04

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V; \quad V: \text{acting shear load}$$

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**SIKLA Injection System AN VME basic C**

**Performance**  
Displacements (rebar)

**Annex C11**