

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-23/0419**  
**of 31 July 2023**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Trade name of the construction product

Product family  
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment  
contains

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Rotho Blaas Injection System EPO-FIX Injection system

Bonded fastener for use in concrete

Rotho Blaas s.r.l  
Via dell'Adige 2/1  
39040 CORTACCIA (BZ)  
ITALIEN

Plant C2

46 pages including 3 annexes which form an integral part  
of this assessment

330499-01-0601; Edition 04/2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The "Rotho Blaas Injection system EPO-FIX for concrete" is a bonded anchor consisting of a mortar cartridge with injection mortar EPO-FIX and a steel element according to Annex A 3.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 and/or 100 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex C 1 to C 6, C 8 to C 11, C 13 to C 16, B 3
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1, C 7, C 12, C 17
Displacements under short-term and long-term loading	See Annex C 18 to C 20
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C 21 to C 28

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 31 July 2023 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock  
Head of Section

*beglaubigt:*  
Baderschneider




Installation threaded rod M8 up to M30


prepositioned installation or  
push through installation (annular gap filled with mortar)

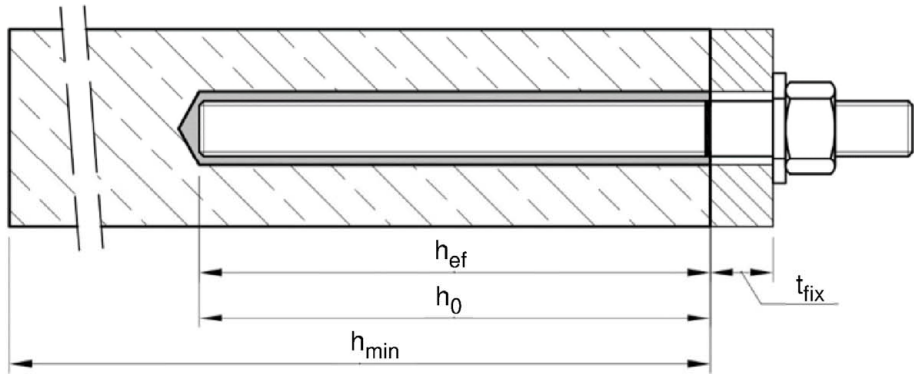

Installation reinforcing bar Ø8 up to Ø32

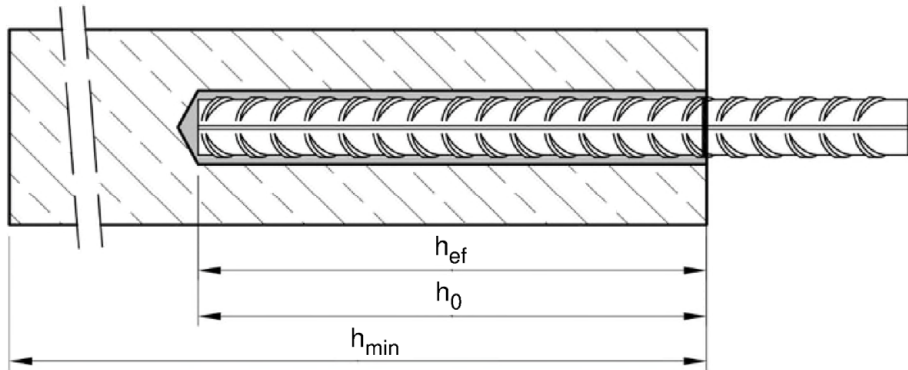

Installation internal threaded anchor rod IR-M6 up to IR-M20

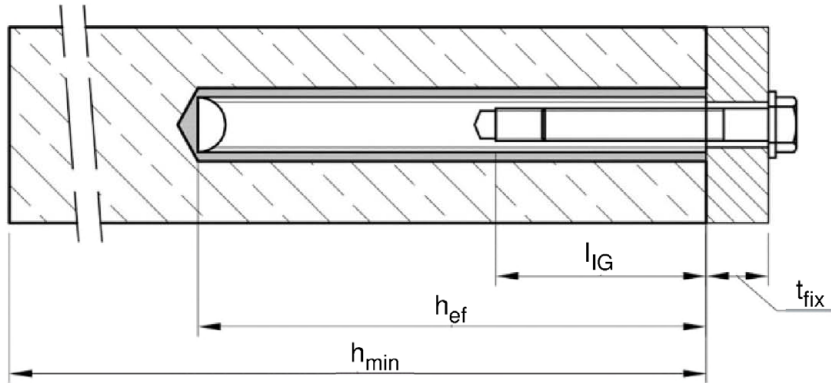

$T_{fix}$  = thickness of fixture  
 $h_{ef}$  = effective embedment depth  
 $h_{min}$  = minum thickness of member

$h_0$  = nominal drill hole diameter  
 $l_{IG}$  = thread engagement length


Rotho Blaas Injection System EPO-FIX Injection system

Product description  
Installed condition


Annex A 1

Cartridge system

Side-by-Side Cartridge:  
440 ml, 585 ml and 1400 ml

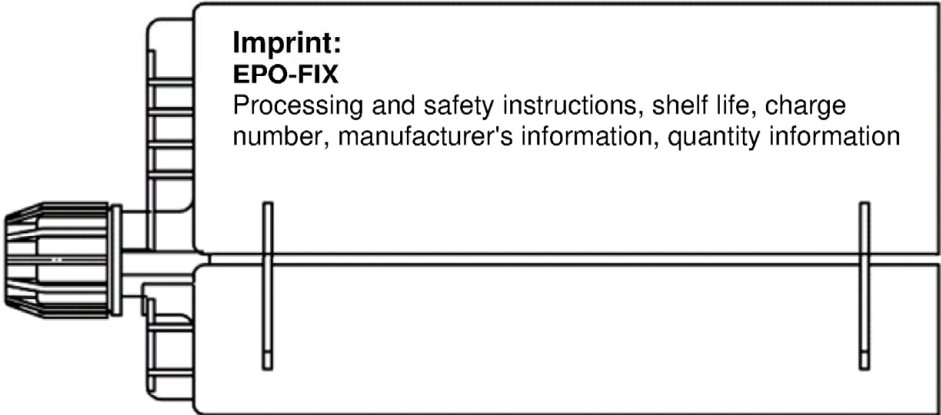

Static mixer



Piston plug PL and mixer extension




Rotho Blaas Injection System EPO-FIX Injection system

Product description  
Injection system

Annex A 2

## Threaded rod M8 up to M30 with washer and hexagon nut


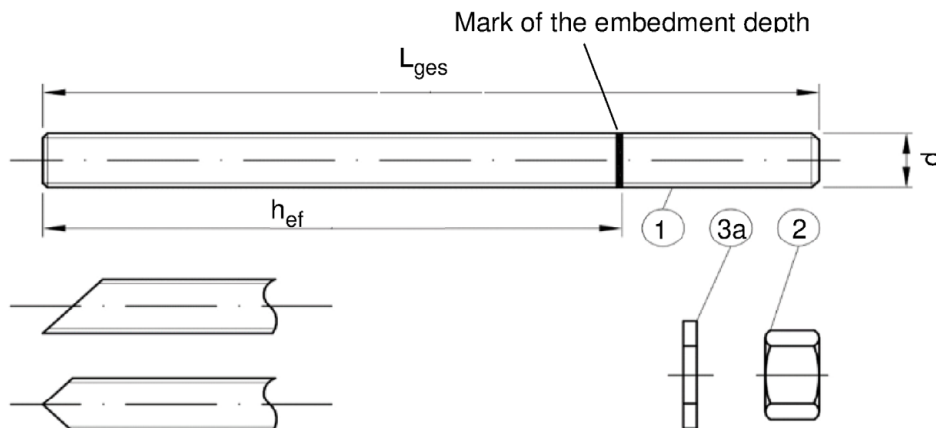



Commercial standard rod with:

- Materials, dimensions and mechanical properties acc. to Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004. The document shall be stored.
- Marking of embedment depth

## Internal threaded rod IR-M6 to IR-M10

Threaded rod or screw

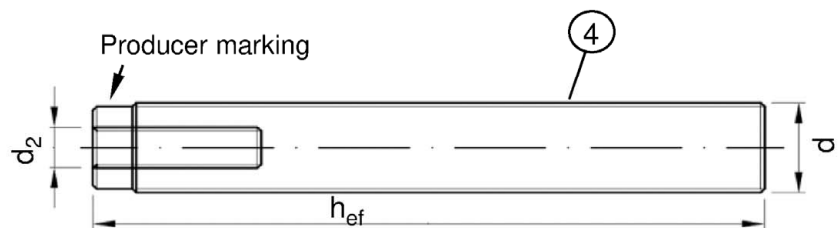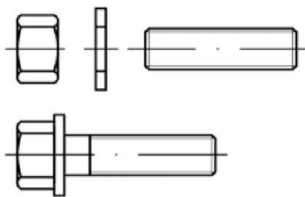

Producer marking: e.g.  M8



Marking Internal thread

Mark

M8

Thread size (Internal thread)


A4

additional mark for stainless steel

HCR

additional mark for high-corrosion resistance steel

## Filling washer

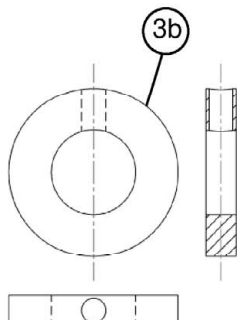

## Mixer reduction nozzle



## Rotho Blaas Injection System EPO-FIX Injection system

### Product description


Threaded rod; Internal threaded rod  
Filling washer; Mixer reduction nozzle

## Annex A 3

**Table A1: Materials**

Part	Designation	Material				
<b>Steel, zinc plated</b> (Steel acc. to EN ISO 683-4:2018 or EN 10263:2017)						
- zinc plated                    ≥ 5 µm    acc. to EN ISO 4042:2022 or						
- hot-dip galvanised        ≥ 40 µm    acc. to EN ISO 1461:2022 and EN ISO 10684:2004+AC:2009 or						
- sherardized                ≥ 45 µm    acc. to EN ISO 17668:2016						
1	Threaded rod	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 898-1:2013	4.6	f <sub>uk</sub> = 400 N/mm <sup>2</sup>	f <sub>yk</sub> = 240 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
			4.8	f <sub>uk</sub> = 400 N/mm <sup>2</sup>	f <sub>yk</sub> = 320 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
			5.6	f <sub>uk</sub> = 500 N/mm <sup>2</sup>	f <sub>yk</sub> = 300 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
			5.8	f <sub>uk</sub> = 500 N/mm <sup>2</sup>	f <sub>yk</sub> = 400 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
		8.8	f <sub>uk</sub> = 800 N/mm <sup>2</sup>	f <sub>yk</sub> = 640 N/mm <sup>2</sup>	A <sub>5</sub> ≥ 12% <sup>3)</sup>	
2	Hexagon nut	acc. to EN ISO 898-2:2012	4	for anchor rod class 4.6 or 4.8		
			5	for anchor rod class 5.6 or 5.8		
			8	for anchor rod class 8.8		
3a	Washer	Steel, zinc plated, hot-dip galvanised or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
3b	Filling washer	Steel, zinc plated, hot-dip galvanised or sherardized				
4	Internal threaded anchor rod	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 898-1:2013	5.8	f <sub>uk</sub> = 500 N/mm <sup>2</sup>	f <sub>yk</sub> = 400 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
			8.8	f <sub>uk</sub> = 800 N/mm <sup>2</sup>	f <sub>yk</sub> = 640 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
<b>Stainless steel A2</b> (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014)						
<b>Stainless steel A4</b> (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014)						
<b>High corrosion resistance steel</b> (Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014)						
1	Threaded rod <sup>1)4)</sup>	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 3506-1:2020	50	f <sub>uk</sub> = 500 N/mm <sup>2</sup>	f <sub>yk</sub> = 210 N/mm <sup>2</sup>	A <sub>5</sub> ≥ 8%
			70	f <sub>uk</sub> = 700 N/mm <sup>2</sup>	f <sub>yk</sub> = 450 N/mm <sup>2</sup>	A <sub>5</sub> ≥ 12% <sup>3)</sup>
		80	f <sub>uk</sub> = 800 N/mm <sup>2</sup>	f <sub>yk</sub> = 600 N/mm <sup>2</sup>	A <sub>5</sub> ≥ 12% <sup>3)</sup>	
2	Hexagon nut <sup>1)4)</sup>	acc. to EN ISO 3506-1:2020	50	for anchor rod class 50		
			70	for anchor rod class 70		
			80	for anchor rod class 80		
3a	Washer	A2: Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
3b	Filling washer	Stainless steel A4, High corrosion resistance steel				
4	Internal threaded anchor rod <sup>1)2)</sup>	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 3506-1:2020	50	f <sub>uk</sub> = 500 N/mm <sup>2</sup>	f <sub>yk</sub> = 210 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
			70	f <sub>uk</sub> = 700 N/mm <sup>2</sup>	f <sub>yk</sub> = 450 N/mm <sup>2</sup>	A <sub>5</sub> > 8%
1) Property class 70 or 80 for anchor rods and hexagon nuts up to M24 and Internal threaded anchor rods up to IR-M16						
2) for IR-M20 only property class 50						
3) A <sub>5</sub> > 8% fracture elongation if no use for seismic performance category C2						
4) Property class 80 only for stainless steel A4 and HCR						
Rotho Blaas Injection System EPO-FIX Injection system					Annex A 4	
Product description Materials threaded rod, Internal threaded anchor rod and filling washer						

Reinforcing bar: ø8 up to ø32

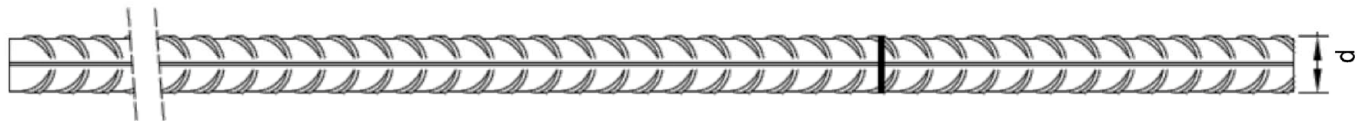

Minimum value of related rip area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010  
Rib height of the bar shall be in the range  $0,05d \leq h_{rib} \leq 0,07d$   
(d: Nominal diameter of the bar;  $h_{rib}$ : Rib height of the bar)

Table A2: Materials Reinforcing bar

Part	Designation	Material
Rebar		
1	Reinforcing steel according to EN 1992 1 1:2004+AC:2010, Annex C	Bars and rebars from ring class B or C $f_{yk}$ and $k$ according to NDP or NCI according to EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

Rotho Blaas Injection System EPO-FIX Injection system

Product description  
Materials reinforcing bar

Annex A 5

Specification of the intended use				
Fasteners subject to (Static and quasi-static loads):				
	Working life 50 years		Working life 100 years	
Base material	uncracked concrete	cracked concrete	uncracked concrete	cracked concrete
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 to M30, Ø8 to Ø32, IR-M6 to IR-M20		M8 to M30, Ø8 to Ø32, IR-M6 to IR-M20	
DD: Diamond drilling	M8 to M30, Ø8 to Ø32, IR-M6 to IR-M20	No performance assessed	M8 to M30, Ø8 to Ø32, IR-M6 to IR-M20	No performance assessed
Temperature Range:	I: - 40 C to +40 C <sup>1)</sup> II: - 40 C to +72 C <sup>2)</sup>		I: - 40 C to +40 C <sup>1)</sup> II: - 40 C to +72 C <sup>2)</sup>	
Fasteners subject to (seismic action):				
	Performance Category C1		Performance Category C2	
Base material	Cracked and uncracked concrete		Cracked and uncracked concrete	
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 to M30, Ø8 to Ø32		M12 to M24	
DD: Diamond drilling	No performance assessed		No performance assessed	
Temperature Range:	I: - 40 C to +40 C <sup>1)</sup> II: - 40 C to +72 C <sup>2)</sup>		I: - 40 C to +40 C <sup>1)</sup> II: - 40 C to +72 C <sup>2)</sup>	
<div>1) (max. long-term temperature +24°C and max. short-term temperature +40°C)</div> <div>2) (max. long-term temperature +50°C and max. short-term temperature +72°C)</div> <div>Base materials:</div> <div><div>-</div>Compacted, reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A1:2016.</div> <div><div>-</div>Strength classes C20/25 to C50/60 according to EN 206:2013 + A1:2016.</div> <div>Use conditions (Environmental conditions):</div> <div><div>-</div>Structures subject to dry internal conditions (all materials).</div> <div><div>-</div>For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance class:<div><div>•</div>Stainless steel Stahl A2 according to Annex A 4, Table A1: CRC II</div><div><div>•</div>Stainless steel Stahl A4 according to Annex A 4, Table A1: CRC III</div><div><div>•</div>High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V</div></div>				
Rotho Blaas Injection System EPO-FIX Injection system			Annex B 1	
Intended Use Specifications				

**Design:**

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e. g. position of the fastener relative to reinforcement or to supports, etc.).
- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work.
- The fasteners are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018

**Installation:**

- Dry, wet concrete or flooded bore holes (not sea-water).
- Hole drilling by hammer (HD), hollow (HDB), compressed air (CD) or diamond drill mode (DD).
- Overhead installation allowed.
- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

**Rotho Blaas Injection System EPO-FIX Injection system**

**Intended Use**  
Specifications (Continued)

**Annex B 2**



**Table B1: Installation parameters for threaded rod**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Diameter of element	$d = d_{nom}$	[mm]	8	10	12	16	20	24	27	30
Nominal drill hole diameter	$d_0$	[mm]	10	12	14	18	22	28	30	35
Effective embedment depth	$h_{ef,min}$	[mm]	60	60	70	80	90	96	108	120
	$h_{ef,max}$	[mm]	160	200	240	320	400	480	540	600
Diameter of clearance hole in the fixture	Prepositioned installation $d_f \leq$	[mm]	9	12	14	18	22	26	30	33
	Push through installation $d_f$	[mm]	12	14	16	20	24	30	33	40
Maximum installation torque	$\max T_{inst}$	[Nm]	10	20	40 <sup>1)</sup>	60	100	170	250	300
Minimum thickness of member	$h_{min}$	[mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$				
Minimum spacing	$s_{min}$	[mm]	40	50	60	75	95	115	125	140
Minimum edge distance	$c_{min}$	[mm]	35	40	45	50	60	65	75	80

<sup>1)</sup> Maximum installation torque for M12 with steel Grade 4.6 is 35 Nm

**Table B2: Installation parameters for reinforcing bar**

Reinforcing bar			Ø 8 <sup>1)</sup>	Ø 10 <sup>1)</sup>	Ø 12 <sup>1)</sup>	Ø 14	Ø 16	Ø 20	Ø 24 <sup>1)</sup>	Ø 25 <sup>1)</sup>	Ø 28	Ø 32
Diameter of element	d = d <sub>nom</sub>	[mm]	8	10	12	14	16	20	24	25	28	32
Nominal drill hole diameter	d <sub>0</sub>	[mm]	10   12	12   14	14   16	18	20	25	30   32	30   32	35	40
Effective embedment depth	h <sub>ef,min</sub>	[mm]	60	60	70	75	80	90	96	100	112	128
	h <sub>ef,max</sub>	[mm]	160	200	240	280	320	400	480	500	560	640
Minimum thickness of member	h <sub>min</sub>	[mm]	h <sub>ef</sub> + 30 mm ≥ 100 mm			h <sub>ef</sub> + 2d <sub>0</sub>						
Minimum spacing	s <sub>min</sub>	[mm]	40	50	60	70	75	95	120	120	130	150
Minimum edge distance	c <sub>min</sub>	[mm]	35	40	45	50	50	60	70	70	75	85

<sup>1)</sup> both nominal drill hole diameter can be used

**Table B3: Installation parameters for Internal threaded anchor rod**

Internal threaded anchor rod			IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20
Internal diameter of anchor rod	$d_2$	[mm]	6	8	10	12	16	20
Outer diameter of anchor rod <sup>1)</sup>	$d = d_{nom}$	[mm]	10	12	16	20	24	30
Nominal drill hole diameter	$d_0$	[mm]	12	14	18	22	28	35
Effective embedment depth	$h_{ef,min}$	[mm]	60	70	80	90	96	120
	$h_{ef,max}$	[mm]	200	240	320	400	480	600
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7	9	12	14	18	22
Maximum installation torque	$\max T_{inst}$	[Nm]	10	10	20	40	60	100
Thread engagement length min/max	$l_{IG}$	[mm]	8/20	8/20	10/25	12/30	16/32	20/40
Minimum thickness of member	$h_{min}$	[mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$		
Minimum spacing	$s_{min}$	[mm]	50	60	75	95	115	140
Minimum edge distance	$c_{min}$	[mm]	40	45	50	60	65	80

<sup>1)</sup> With metric threads according to EN 1993-1-8:2005+AC:2009










**Rotho Blaas Injection System EPO-FIX Injection system**

**Intended Use**  
Installation parameters

**Annex B 3**



**Table B4: Parameter cleaning and installation tools**

										
Threaded Rod	Re-inforcing bar	Internal threaded anchor rod	d <sub>0</sub> Drill bit - Ø HD, HDB, CD, DD	d <sub>b</sub> Brush - Ø		d <sub>b,min</sub> min. Brush - Ø	Piston plug	Installation direction and use of piston plug		
[mm]	[mm]	[mm]	[mm]	BRU	[mm]	[mm]				
M8	8		10	H10	11,5	10,5	No plug required			
M10	8 / 10	IR-M6	12	H12	13,5	12,5				
M12	10 / 12	IR-M8	14	H14	15,5	14,5				
	12		16	H16	17,5	16,5				
M16	14	IR-M10	18	H18	20,0	18,5	PL18	h <sub>ef</sub> > 250 mm	h <sub>ef</sub> > 250 mm	all
	16		20	H20	22,0	20,5	PL20			
M20		IR-M12	22	H22	24,0	22,5	PL22			
	20		25	H25	27,0	25,5	PL25			
M24		IR-M16	28	H28	30,0	28,5	PL28			
M27	24 / 25		30	H30	31,8	30,5	PL30			
	24 / 25		32	H32	34,0	32,5	PL32			
M30	28	IR-M20	35	H35	37,0	35,5	PL35			
	32		40	H40	43,5	40,5	PL40			

## Cleaning and installation tools

### HDB – Hollow drill bit system



The hollow drill system consists of Heller Duster Expert hollow drill bit and a class M Hoover with a minimum negative pressure of 253 hPa and a flow rate of minimum 150 m³/h (42 l/s).

### Compressed air tool

(min 6 bar)



### Brush BRUH



### Piston Plug PL



### Brush extension



## Rotho Blaas Injection System EPO-FIX Injection system

### Intended Use

Cleaning and installation tools

## Annex B 4

**Table B5: Working and curing time**

Temperature in base material			Maximum working time	Minimum curing time <sup>1)</sup>
T			t <sub>work</sub>	t <sub>cure</sub>
+ 0 °C	to	+ 4 °C	90 min	144 h
+ 5 °C	to	+ 9 °C	80 min	48 h
+ 10 °C	to	+ 14 °C	60 min	28 h
+ 15 °C	to	+ 19 °C	40 min	18 h
+ 20 °C	to	+ 24 °C	30 min	12 h
+ 25 °C	to	+ 34 °C	12 min	9 h
+ 35 °C	to	+ 39 °C	8 min	6 h
+ 40 °C			8 min	4 h
Cartridge temperature			+5 °C to +40 °C	

<sup>1)</sup> The minimum curing time is only valid for dry base material.  
In wet base material the curing time must be doubled.


**Rotho Blaas Injection System EPO-FIX Injection system**

**Intended Use**  
Working time and curing time

**Annex B 5**


## Installation instructions

### Drilling of the bore hole (HD, HDB, CD)

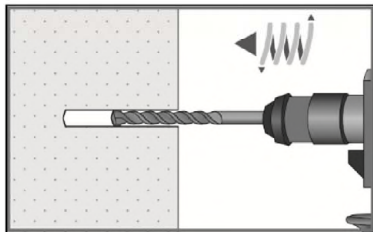

#### 1a. Hammer drilling (HD) / Compressed air drilling (CD)

Drill a hole to the required embedment depth.  
Drill bit diameter according to Table B1, B2 or B3.  
Aborted drill holes shall be filled with mortar.  
Proceed with Step 2. Proceed with Step 2.

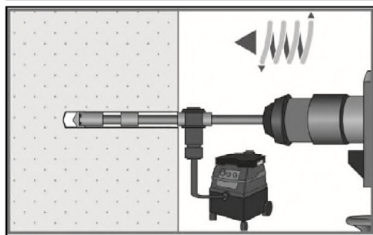


#### 1b. Hollow drill bit system (HDB) (see Annex B 4)

Drill a hole to the required embedment depth.  
Drill bit diameter according to Table B1, B2 or B3.  
The hollow drilling system removes the dust and cleans the bore hole.  
Proceed with Step 3.


**Attention! Standing water in the bore hole must be removed before cleaning.**

### Compressed Air Cleaning (CAC):


All diameter in cracked and uncracked concrete

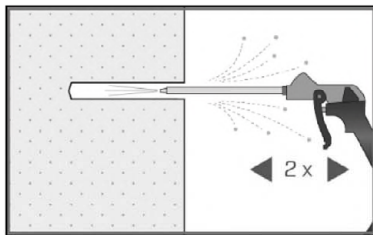

2a. Blow the bore hole clean minimum 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

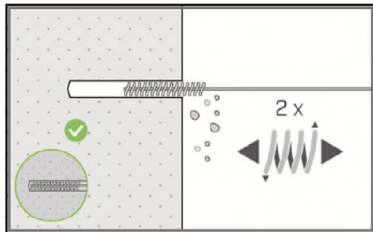

2b. Brush the bore hole minimum 2x with brush BRUH according to Table B4 over the entire embedment depth in a twisting motion. (If necessary, a brush extension shall be used.)

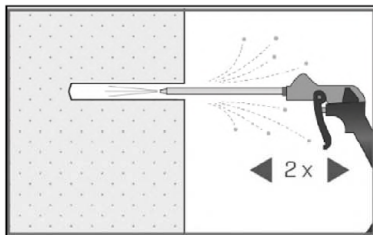

2c. Finally blow the bore hole clean minimum 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

**Cleaned bore hole has to be protected against re-contamination in an appropriate way,  
If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**


**Rotho Blaas Injection System EPO-FIX Injection system**

**Intended Use**  
Installation instructions

**Annex B 6**

## Installation instructions (continuation)


### Drilling of the bore hole (DD)

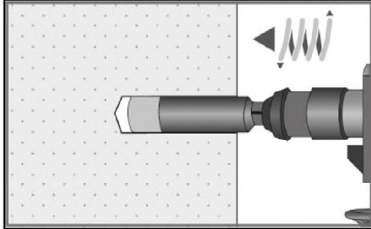


- 1a. Diamond drilling (DD)  
Drill a hole to the required embedment depth required  
Drill bit diameter according to Table B1, B2 or B3.  
Aborted drill holes shall be filled with mortar.  
Proceed with Step 2.

### Flush & Compressed Air Cleaning (SPCAC):


All diameter in uncracked concrete

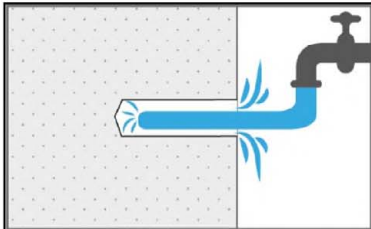


- 2a. Flushing with water until clear water comes out.

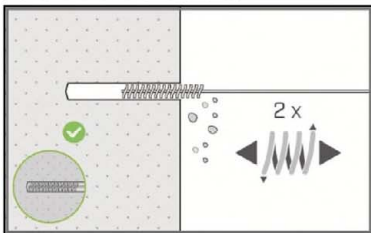


- 2b. Brush the bore hole minimum 2x with brush BRUH according to Table B4 over the entire embedment depth in a twisting motion. (If necessary, a brush extension shall be used.)

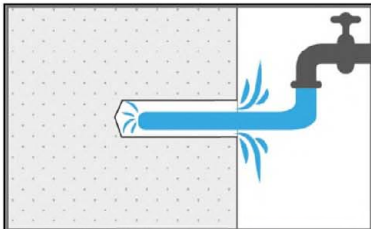

- 2c. Flushing again with water until clear water comes out.

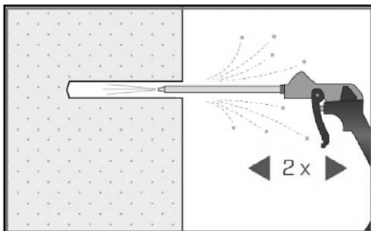

- 2d. Blow the bore hole clean minimum 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

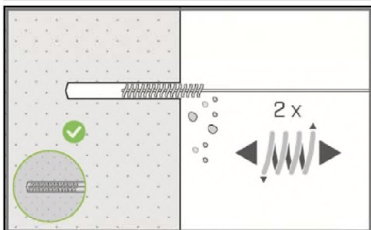

- 2e. Brush the bore hole minimum 2x with brush BRUH according to Table B4 over the entire embedment depth in a twisting motion. (If necessary, a brush extension shall be used.)


## Rotho Blaas Injection System EPO-FIX Injection system

### Intended Use

Installation instructions (continuation)


## Annex B 7

## Installation instructions (continuation)

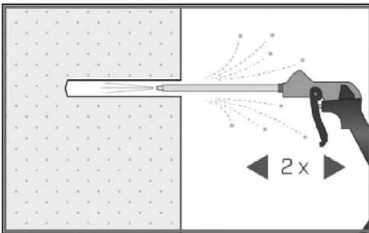


- 2f. Finally blow the bore hole clean minimum 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)


**Cleaned bore hole has to be protected against re-contamination in an appropriate way, If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**

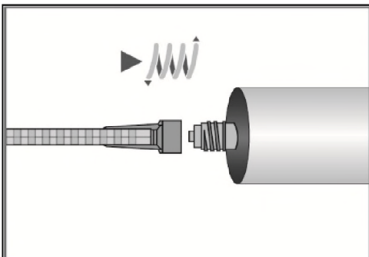


3. Screw on static-mixing nozzle and load the cartridge into an appropriate dispensing tool.  
For every working interruption longer than the maximum working time  $t_{work}$  (Annex B 5) as well as for new cartridges, a new static-mixer shall be used.

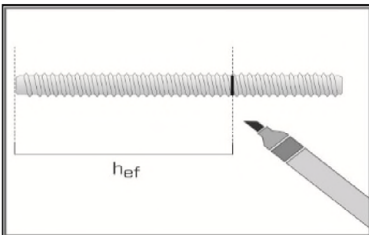


4. Mark embedment depth on the anchor rod.  
The anchor rod shall be free of dirt, grease, oil or other foreign material.

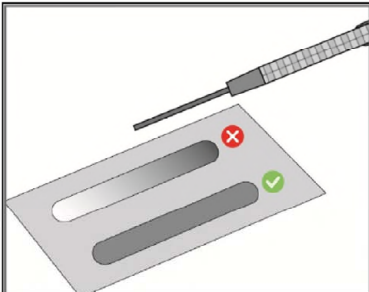

5. Not proper mixed mortar is not sufficient for fastening.  
Dispense and discard mortar until an uniform grey or red colour is shown (at least 3 full strokes).

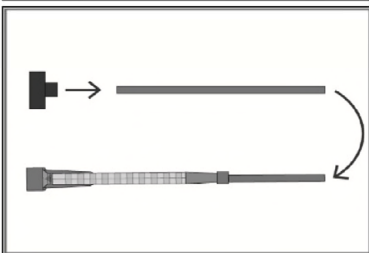

6. Piston plugs PL and mixer nozzle extensions shall be used according to Table B4 for the following applications:
- Horizontal and vertical downwards direction: Drill bit- $\varnothing d_0 \geq 18$  mm and embedment depth  $h_{ef} > 250$ mm
  - Vertical upwards direction: Drill bit- $\varnothing d_0 \geq 18$  mm
- Assemble mixing nozzle, mixer extension and piston plug before injecting mortar.

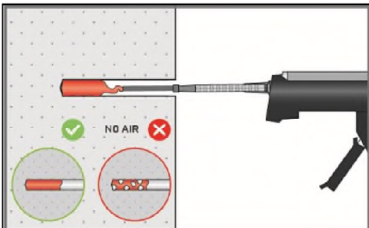

- 7a. **Injecting mortar without piston plug PL:**  
Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.)  
Slowly withdraw of the static mixing nozzle avoid creating air pockets  
Observe the temperature related working time  $t_{work}$  (Annex B 5).

## Rotho Blaas Injection System EPO-FIX Injection system


### Intended Use

Installation instructions (continuation)

## Annex B 8



## Installation instructions (continuation)

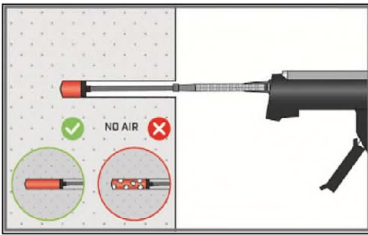


### 7b. Injecting mortar with piston plug PL:


Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.)

During injection the piston plug is pushed out of the bore hole by the back pressure of the mortar.

Observe the temperature related working time  $t_{work}$  (Annex B 5).

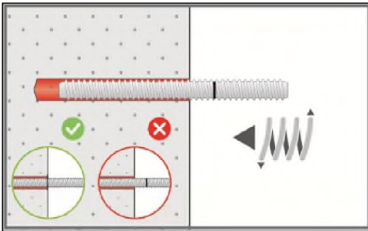


### 8. Insert the anchor rod while turning slightly up to the embedment mark.

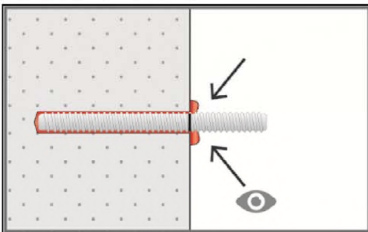


### 9. Annular gap between anchor rod and base material must be completely filled with mortar. In case of push through installation the annular gap in the fixture must be filled with mortar also.


Otherwise, the installation must be repeated starting from step 7 before the maximum working time  $t_{work}$  has expired.

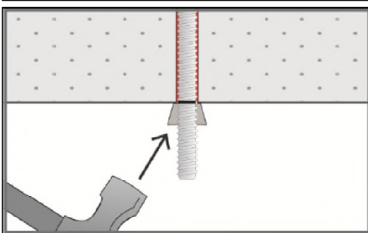

### 10. For application in vertical upwards direction the anchor rod shall be fixed (e.g. wedges).

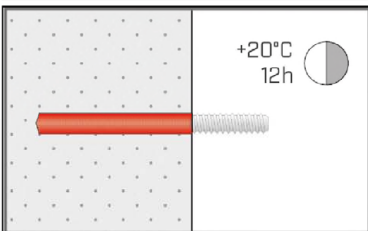

### 11. Temperature related curing time $t_{cure}$ (Annex B 5) must be observed. Do not move or load the fastener during curing time.

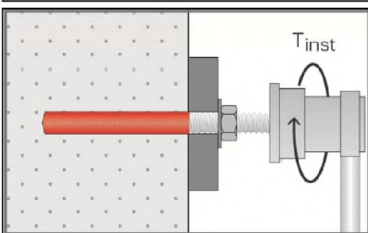

### 12. Install the fixture by using a calibrated torque wrench. Observe maximum installation torque (Table B1 or B3). In case of static requirements (e.g. seismic), fill the annular gap in the fixture with mortar (Annex A 2). Therefore replace the washer by the filling washer and use the mixer reduction nozzle.

## Rotho Blaas Injection System EPO-FIX Injection system

### Intended Use

Installation instructions (continuation)

## Annex B 9

**Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Cross section area	A <sub>S</sub>	[mm²]	36,6	58	84,3	157	245	353	459	561	
Characteristic tension resistance, Steel failure <sup>1)</sup>											
Steel, Property class 4.6 and 4.8	N <sub>Rk,s</sub>	[kN]	15 (13)	23 (21)	34	63	98	141	184	224	
Steel, Property class 5.6 and 5.8	N <sub>Rk,s</sub>	[kN]	18 (17)	29 (27)	42	78	122	176	230	280	
Steel, Property class 8.8	N <sub>Rk,s</sub>	[kN]	29 (27)	46 (43)	67	125	196	282	368	449	
Stainless steel A2, A4 and HCR, class 50	N <sub>Rk,s</sub>	[kN]	18	29	42	79	123	177	230	281	
Stainless steel A2, A4 and HCR, class 70	N <sub>Rk,s</sub>	[kN]	26	41	59	110	171	247	..3)	..3)	
Stainless steel A4 and HCR, class 80	N <sub>Rk,s</sub>	[kN]	29	46	67	126	196	282	..3)	..3)	
Characteristic tension resistance, Partial factor <sup>2)</sup>											
Steel, Property class 4.6 and 5.6	γ <sub>Ms,N</sub>	[-]	2,0								
Steel, Property class 4.8, 5.8 and 8.8	γ <sub>Ms,N</sub>	[-]	1,5								
Stainless steel A2, A4 and HCR, class 50	γ <sub>Ms,N</sub>	[-]	2,86								
Stainless steel A2, A4 and HCR, class 70	γ <sub>Ms,N</sub>	[-]	1,87								
Stainless steel A4 and HCR, class 80	γ <sub>Ms,N</sub>	[-]	1,6								
Characteristic shear resistance, Steel failure <sup>1)</sup>											
Without lever arm	Steel, Property class 4.6 and 4.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	9 (8)	14 (13)	20	38	59	85	110	135
	Steel, Property class 5.6 and 5.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	11 (10)	17 (16)	25	47	74	106	138	168
	Steel, Property class 8.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	15 (13)	23 (21)	34	63	98	141	184	224
	Stainless steel A2, A4 and HCR, class 50	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	9	15	21	39	61	88	115	140
	Stainless steel A2, A4 and HCR, class 70	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	13	20	30	55	86	124	..3)	..3)
	Stainless steel A4 and HCR, class 80	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	15	23	34	63	98	141	..3)	..3)
With lever arm	Steel, Property class 4.6 and 4.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	15 (13)	30 (27)	52	133	260	449	666	900
	Steel, Property class 5.6 and 5.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	19 (16)	37 (33)	65	166	324	560	833	1123
	Steel, Property class 8.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	30 (26)	60 (53)	105	266	519	896	1333	1797
	Stainless steel A2, A4 and HCR, class 50	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	19	37	66	167	325	561	832	1125
	Stainless steel A2, A4 and HCR, class 70	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	26	52	92	232	454	784	..3)	..3)
	Stainless steel A4 and HCR, class 80	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	30	59	105	266	519	896	..3)	..3)
Characteristic shear resistance, Partial factor <sup>2)</sup>											
Steel, Property class 4.6 and 5.6	γ <sub>Ms,V</sub>	[-]	1,67								
Steel, Property class 4.8, 5.8 and 8.8	γ <sub>Ms,V</sub>	[-]	1,25								
Stainless steel A2, A4 and HCR, class 50	γ <sub>Ms,V</sub>	[-]	2,38								
Stainless steel A2, A4 and HCR, class 70	γ <sub>Ms,V</sub>	[-]	1,56								
Stainless steel A4 and HCR, class 80	γ <sub>Ms,V</sub>	[-]	1,33								
<sup>1)</sup> Values are only valid for the given stress area A <sub>S</sub> . Values in brackets are valid for undersized threaded rods with smaller stress area A <sub>S</sub> for hot-dip galvanised threaded rods according to EN ISO 10684:2004+AC:2009.											
<sup>2)</sup> in absence of national regulation											
<sup>3)</sup> Fastener type not part of the ETA											
Rotho Blaas Injection System EPO-FIX Injection system							Annex C 1				
Performances Characteristic values for steel tension resistance and steel shear resistance of threaded rods											

**Table C2: Characteristic values of tension loads under static and quasi-static action for a working life of 50 and 100 years**

Fastener			All Fastener type and sizes	
Concrete cone failure				
Uncracked concrete	$k_{ucr,N}$	[-]	11,0	
Cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$	
Axial distance	$s_{cr,N}$	[mm]	$2 c_{cr,N}$	
Splitting				
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} \left( 2,5 - \frac{h}{h_{ef}} \right)$
	$h/h_{ef} \leq 1,3$			$2,4 h_{ef}$
Axial distance	$s_{cr,sp}$	[mm]	$2 c_{cr,sp}$	

**Rotho Blaas Injection System EPO-FIX Injection system**

**Annex C 2**

**Performances**

Characteristic values of tension loads under static and quasi-static action for a working life of 50 and 100 years



Table C3: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years												
Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr}$	[N/mm²]	20	20	19	19	18	17	16	16
	II: 72°C/50°C				15	15	15	14	13	13	12	12
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)												
Temperature range	I: 40°C/24°C	Dry, wet concrete	$\tau_{Rk,ucr}$	[N/mm²]	17	16	16	16	15	14	14	13
	II: 72°C/50°C				14	14	14	13	13	12	12	11
	I: 40°C/24°C	flooded bore hole			16	16	16	15	15	14	14	13
	II: 72°C/50°C				14	14	14	13	13	12	12	11
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD) , compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,cr}$	[N/mm²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5
	II: 72°C/50°C				6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0
Reduction factor $\psi_{sus}^0$ in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\psi_{sus}^0$	[-]	0,80							
	II: 72°C/50°C				0,68							
Increasing factors for concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,1}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr,(C20/25)}$								
		$\tau_{Rk,cr} =$		$\psi_c \cdot \tau_{Rk,cr,(C20/25)}$								
Concrete cone failure												
Relevant parameter				see Table C2								
Splitting												
Relevant parameter				see Table C2								
Installation factor												
for dry and wet concrete (HD; HDB, CD)		$\gamma_{inst}$	[-]	1,0								
for flooded bore hole (HD; HDB, CD)				1,2								
Rotho Blaas Injection System EPO-FIX Injection system									Annex C 3			
Performances Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (threaded rod)												

Table C4: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years												
Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr,100}$	[N/mm²]	20	20	19	19	18	17	16	16
	II: 72°C/50°C				15	15	15	14	13	13	12	12
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)												
Temperature range	I: 40°C/24°C	Dry, wet concrete	$\tau_{Rk,ucr,100}$	[N/mm²]	17	16	16	16	15	14	14	13
	II: 72°C/50°C				14	14	14	13	13	12	12	11
	I: 40°C/24°C	flooded bore hole			16	16	16	15	15	14	14	13
	II: 72°C/50°C				14	14	14	13	13	12	12	11
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD) , compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,cr,100}$	[N/mm²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5
	II: 72°C/50°C				5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5
Increasing factors for concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,1}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr,100} =$		$\psi_c \cdot \tau_{Rk,ucr,100,(C20/25)}$								
		$\tau_{Rk,cr,100} =$		$\psi_c \cdot \tau_{Rk,cr,100,(C20/25)}$								
Concrete cone failure												
Relevant parameter				see Table C2								
Splitting												
Relevant parameter				see Table C2								
Installation factor												
for dry and wet concrete (HD; HDB, CD)		$\gamma_{inst}$	[-]	1,0								
for flooded bore hole (HD; HDB, CD)				1,2								

**Table C5: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years**

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr}$	[N/mm²]	15	14	14	13	12	12	11	11
	II: 72°C/50°C				12	12	11	10	9,5	9,5	9,0	9,0
Reduction factor $\psi_{sus}^0$ in uncracked concrete C20/25 in diamond drilled holes (DD)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\psi_{sus}^0$	[-]	0,77							
	II: 72°C/50°C				0,72							
Increasing factors for concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,2}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr,(C20/25)}$								
Concrete cone failure												
Relevant parameter				see Table C2								
Splitting												
Relevant parameter				see Table C2								
Installation factor												
for dry and wet concrete (DD)		$\gamma_{inst}$	[-]	1,0								
for flooded bore hole (DD)				1,2				1,4				

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (threaded rod)

**Annex C 5**

**Table C6: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years**

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr,100}$	[N/mm <sup>2</sup> ]	15	14	14	13	12	12	11	11
	II: 72°C/50°C				11	11	10	10	9,5	9,0	8,5	8,5
Increasing factors for concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,2}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr,100} =$	$\psi_c \cdot \tau_{Rk,ucr,100,(C20/25)}$									
Concrete cone failure												
Relevant parameter				see Table C2								
Splitting												
Relevant parameter				see Table C2								
Installation factor												
for dry and wet concrete (DD)		$\gamma_{inst}$	[-]	1,0								
for flooded bore hole (DD)				1,2				1,4				

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Characteristic values of tension loads under static and quasi-static action for a working life of 100 years (threaded rod)

**Annex C 6**

**Table C7: Characteristic values of shear loads under static and quasi-static action for a working life of 50 and 100 years**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Steel failure without lever arm										
Characteristic shear resistance Steel, strength class 4.6, 4.8 and 5.6, 5.8	$V_{Rk,s}^0$	[kN]	0,6 · A <sub>s</sub> · f <sub>uk</sub> (or see Table C1)							
Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all strength classes	$V_{Rk,s}^0$	[kN]	0,5 · A <sub>s</sub> · f <sub>uk</sub> (or see Table C1)							
Partial factor	γ <sub>Ms,V</sub>	[-]	see Table C1							
Ductility factor	k <sub>7</sub>	[-]	1,0							
Steel failure with lever arm										
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	1,2 · W <sub>el</sub> · f <sub>uk</sub> (or see Table C1)							
Elastic section modulus	W <sub>el</sub>	[mm³]	31	62	109	277	541	935	1387	1874
Partial factor	γ <sub>Ms,V</sub>	[-]	see Table C1							
Concrete pry-out failure										
Factor	k <sub>8</sub>	[-]	2,0							
Installation factor	γ <sub>inst</sub>	[-]	1,0							
Concrete edge failure										
Effective length of fastener	l <sub>f</sub>	[mm]	min(h <sub>ef</sub> ; 12 · d <sub>nom</sub> )						min(h <sub>ef</sub> ; 300mm)	
Outside diameter of fastener	d <sub>nom</sub>	[mm]	8	10	12	16	20	24	27	30
Installation factor	γ <sub>inst</sub>	[-]	1,0							
</										



**Table C8: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years**

Internal threaded anchor rods				IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20	
Steel failure <sup>1)</sup>										
Characteristic tension resistance,	5.8	N <sub>Rk,s</sub>	[kN]	10	17	29	42	76	123	
Steel, strength class	8.8	N <sub>Rk,s</sub>	[kN]	16	27	46	67	121	196	
Partial factor, strength class 5.8 and 8.8		γ <sub>Ms,N</sub>	[-]	1,5						
Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		N <sub>Rk,s</sub>	[kN]	14	26	41	59	110	124	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,87					2,86	
Combined pull-out and concrete cone failure										
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	20	19	19	18	17	16
	II: 72°C/50°C				15	15	14	13	13	12
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)										
Temperature range	I: 40°C/24°C	Dry, wet concrete	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	16	16	16	15	14	13
	II: 72°C/50°C				14	14	13	13	12	11
	I: 40°C/24°C	flooded bore hole			16	16	15	15	14	13
	II: 72°C/50°C				14	14	13	13	12	11
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,cr</sub>	[N/mm <sup>2</sup> ]	7,0	8,5	8,5	8,5	8,5	8,5
	II: 72°C/50°C				6,0	7,0	7,0	7,0	7,0	7,0
Reduction factor ψ <sup>0</sup> <sub>sus</sub> in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	ψ <sup>0</sup> <sub>sus</sub>	[-]	0,80					
	II: 72°C/50°C				0,68					
Increasing factors for concrete			ψ <sub>C</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,1</sup>					
Characteristic bond resistance depending on the concrete strength class			τ <sub>Rk,ucr</sub> =		ψ <sub>C</sub> • τ <sub>Rk,ucr,(C20/25)</sub>					
			τ <sub>Rk,cr</sub> =		ψ <sub>C</sub> • τ <sub>Rk,cr,(C20/25)</sub>					
Concrete cone failure										
Relevant parameter				see Table C2						
Splitting failure										
Relevant parameter				see Table C2						
Installation factor										
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0						
for flooded bore hole (HD; HDB, CD)				1,2						
1) Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element.										
2) For IR-M20 strength class 50 is valid										

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (Internal threaded anchor rod)

**Annex C 8**

**Table C9: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years**

Internal threaded anchor rods				IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20	
Steel failure <sup>1)</sup>										
Characteristic tension resistance,	5.8	N <sub>Rk,s</sub>	[kN]	10	17	29	42	76	123	
Steel, strength class	8.8	N <sub>Rk,s</sub>	[kN]	16	27	46	67	121	196	
Partial factor, strength class 5.8 and 8.8		γ <sub>Ms,N</sub>	[-]	[-]						
Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		N <sub>Rk,s</sub>	[kN]	[kN]	26	41	59	110	124	
Partial factor		γ <sub>Ms,N</sub>	[-]	[-]						
2,86										
Combined pull-out and concrete cone failure										
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr,100</sub>	[N/mm <sup>2</sup> ]	20	19	19	18	17	16
	II: 72°C/50°C				15	15	14	13	13	12
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)										
Temperature range	I: 40°C/24°C	Dry, wet concrete	τ <sub>Rk,ucr,100</sub>	[N/mm <sup>2</sup> ]	16	16	16	15	14	13
	II: 72°C/50°C				14	14	13	13	12	11
	I: 40°C/24°C	flooded bore hole			16	16	15	15	14	13
	II: 72°C/50°C				14	14	13	13	12	11
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,cr,100</sub>	[N/mm <sup>2</sup> ]	6,5	7,5	7,5	7,5	7,5	7,5
	II: 72°C/50°C				5,5	6,5	6,5	6,5	6,5	6,5
Increasing factors for concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,1</sup>						
Characteristic bond resistance depending on the concrete strength class			τ <sub>Rk,ucr,100</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,100,(C20/25)</sub>					
			τ <sub>Rk,cr,100</sub> =		ψ <sub>c</sub> • τ <sub>Rk,cr,100,(C20/25)</sub>					
Concrete cone failure										
Relevant parameter				see Table C2						
Splitting failure										
Relevant parameter				see Table C2						
Installation factor										
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0						
for flooded bore hole (HD; HDB, CD)				1,2						

<sup>1)</sup> Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element.

<sup>2)</sup> For IR-M20 strength class 50 is valid

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension loads under static and quasi-static action for a working life of 100 years (Internal threaded anchor rod)

## Annex C 9

**Table C10: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years**

Internal threaded anchor rods				IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20	
Steel failure <sup>1)</sup>										
Characteristic tension resistance,	5.8	N <sub>Rk,s</sub>	[kN]	10	17	29	42	76	123	
Steel, strength class	8.8	N <sub>Rk,s</sub>	[kN]	16	27	46	67	121	196	
Partial factor, strength class 5.8 and 8.8		γ <sub>Ms,N</sub>	[-]	1,5						
Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		N <sub>Rk,s</sub>	[kN]	14	26	41	59	110	124	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,87					2,86	
Combined pull-out and concrete cone failure										
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr</sub>	[N/mm <sup>2</sup> ]	14	14	13	12	12	11
	II: 72°C/50°C				12	11	10	9,5	9,5	9,0
Reduction factor ψ <sup>0</sup> <sub>SUS</sub> in uncracked concrete C20/25 in diamond drilled holes (DD)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	ψ <sup>0</sup> <sub>SUS</sub>	[-]	0,77					
	II: 72°C/50°C				0,72					
Increasing factors for concrete			ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,2</sup>					
Characteristic bond resistance depending on the concrete strength class			τ <sub>Rk,ucr</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,(C20/25)</sub>					
Concrete cone failure										
Relevant parameter				see Table C2						
Splitting failure										
Relevant parameter				see Table C2						
Installation factor										
for dry and wet concrete (DD)		γ <sub>inst</sub>	[-]	1,0						
for flooded bore hole (DD)				1,2		1,4				

- 1) Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element.
- 2) For IR-M20 strength class 50 is valid

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (Internal threaded anchor rod)

## Annex C 10



**Table C11: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years**

Internal threaded anchor rods				IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20	
Steel failure <sup>1)</sup>										
Characteristic tension resistance,	5.8	N <sub>Rk,s</sub>	[kN]	10	17	29	42	76	123	
Steel, strength class	8.8	N <sub>Rk,s</sub>	[kN]	16	27	46	67	121	196	
Partial factor, strength class 5.8 and 8.8		γ <sub>Ms,N</sub>	[-]	1,5						
Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		N <sub>Rk,s</sub>	[kN]	14	26	41	59	110	124	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,87						2,86
Combined pull-out and concrete cone failure										
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)										
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr,100</sub>	[N/mm <sup>2</sup> ]	14	14	13	12	12	11
	II: 72°C/50°C				11	10	10	9,5	9,0	8,5
Increasing factors for concrete			ψ <sub>C</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,2</sup>					
Characteristic bond resistance depending on the concrete strength class			τ <sub>Rk,ucr,100</sub> =		ψ <sub>C</sub> * τ <sub>Rk,ucr,100,(C20/25)</sub>					
Concrete cone failure										
Relevant parameter				see Table C2						
Splitting failure										
Relevant parameter				see Table C2						
Installation factor										
for dry and wet concrete (DD)		γ <sub>inst</sub>	[-]	1,0						
for flooded bore hole (DD)				1,2		1,4				

<sup>1)</sup> Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element.

<sup>2)</sup> For IR-M20 strength class 50 is valid

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension loads under static and quasi-static action for a working life of 100 years (Internal threaded anchor rod)

## Annex C 11

**Table C12: Characteristic values of shear loads under static and quasi-static action for a working life of 50 and 100 years**

Internal threaded anchor rods				IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20
Steel failure without lever arm <sup>1)</sup>									
Characteristic shear resistance, Steel, strength class	5.8	$V_{Rk,s}^0$	[kN]	5	9	15	21	38	61
	8.8	$V_{Rk,s}^0$	[kN]	8	14	23	34	60	98
Partial factor, strength class 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Characteristic shear resistance, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		$V_{Rk,s}^0$	[kN]	7	13	20	30	55	40
Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Ductility factor		$k_7$	[-]	1,0					
Steel failure with lever arm <sup>1)</sup>									
Characteristic bending moment, Steel, strength class	5.8	$M_{Rk,s}^0$	[Nm]	8	19	37	66	167	325
	8.8	$M_{Rk,s}^0$	[Nm]	12	30	60	105	267	519
Partial factor, strength class 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Characteristic bending moment, Stainless Steel A4 and HCR, Strength class 70 <sup>2)</sup>		$M_{Rk,s}^0$	[Nm]	11	26	52	92	233	456
Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Concrete pry-out failure									
Factor		$k_8$	[-]	2,0					
Installation factor		$\gamma_{inst}$	[-]	1,0					
Concrete edge failure									
Effective length of fastener		$l_f$	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$					$\min(h_{ef}; 300\text{mm})$
Outside diameter of fastener		$d_{nom}$	[mm]	10	12	16	20	24	30
Installation factor		$\gamma_{inst}$	[-]	1,0					
<div>1) Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element.</div> <div>2) For IR-M20 strength class 50 is valid</div>									
Rotho Blaas Injection System EPO-FIX Injection system								Annex C 12	
<div>Performances</div> <div>Characteristic values of shear loads under static and quasi-static action for a working life of 50 and 100 years (Internal threaded anchor rod)</div>									

**Table C13: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure														
Characteristic tension resistance		N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> • f <sub>uk</sub> <sup>1)</sup>										
Cross section area		A <sub>s</sub>	[mm²]	50	79	113	154	201	314	452	491	616	804	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>										
Combined pull-out and concrete failure														
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr</sub>	[N/mm²]	16	16	16	16	16	16	15	15	15	15
	II: 72°C/50°C				12	12	12	12	12	12	12	12	11	11
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)														
Temperature range	I: 40°C/24°C	Dry, wet concrete	τ <sub>Rk,ucr</sub>	[N/mm²]	14	14	13	13	13	13	13	13	13	13
	II: 72°C/50°C				12	12	12	11	11	11	11	11	11	11
	I: 40°C/24°C	flooded bore hole			13	13	13	13	13	13	13	13	13	13
	II: 72°C/50°C				11	11	11	11	11	11	11	11	11	11
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,cr</sub>	[N/mm²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5	8,5	8,5
	II: 72°C/50°C				6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0
Reduction factor ψ <sup>0</sup> <sub>sus</sub> in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	ψ <sup>0</sup> <sub>sus</sub>	[-]	0,80									
	II: 72°C/50°C				0,68									
Increasing factors for concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,1</sup>										
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,ucr</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,(C20/25)</sub>										
		τ <sub>Rk,cr</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,(C20/25)</sub>										
Concrete cone failure														
Relevant parameter				see Table C2										
Splitting														
Relevant parameter				see Table C2										
Installation factor														
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0										
for flooded bore hole (HD; HDB, CD)				1,2										
1) f <sub>uk</sub> shall be taken from the specifications of reinforcing bars														
2) in absence of national regulation														
Rotho Blaas Injection System EPO-FIX Injection system										Annex C 13				
Performances														
Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (reinforcing bar)														

**Table C14: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure														
Characteristic tension resistance		N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> • f <sub>uk</sub> <sup>1)</sup>										
Cross section area		A <sub>s</sub>	[mm <sup>2</sup> ]	50	79	113	154	201	314	452	491	616	804	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>										
Combined pull-out and concrete failure														
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes (HD) and compressed air drilled holes (CD)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr,100</sub>	[N/mm <sup>2</sup> ]	16	16	16	16	16	16	15	15	15	15
	II: 72°C/50°C				12	12	12	12	12	12	12	12	11	11
Characteristic bond resistance in uncracked concrete C20/25 in hammer drilled holes with hollow drill bit (HDB)														
Temperature range	I: 40°C/24°C	Dry, wet concrete	τ <sub>Rk,ucr,100</sub>	[N/mm <sup>2</sup> ]	14	14	13	13	13	13	13	13	13	13
	II: 72°C/50°C				12	12	12	11	11	11	11	11	11	11
	I: 40°C/24°C	flooded bore hole			13	13	13	13	13	13	13	13	13	13
	II: 72°C/50°C				11	11	11	11	11	11	11	11	11	
Characteristic bond resistance in cracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,cr,100</sub>	[N/mm <sup>2</sup> ]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5
	II: 72°C/50°C				5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5
Increasing factors for concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,1</sup>										
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,ucr,100</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,100,(C20/25)</sub>										
		τ <sub>Rk,cr,100</sub> =		ψ <sub>c</sub> • τ <sub>Rk,cr,100,(C20/25)</sub>										
Concrete cone failure														
Relevant parameter				see Table C2										
Splitting														
Relevant parameter				see Table C2										
Installation factor														
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0										
for flooded bore hole (HD; HDB, CD)				1,2										

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> in absence of national regulation

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension loads under static and quasi-static action for a working life of 100 years (reinforcing bar)

## Annex C 14

**Table C15: Characteristic values of tension loads under static and quasi-static action for a working life of 50 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure														
Characteristic tension resistance		N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> • f <sub>uk</sub> <sup>1)</sup>										
Cross section area		A <sub>s</sub>	[mm²]	50	79	113	154	201	314	452	491	616	804	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>										
Combined pull-out and concrete failure														
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr</sub>	[N/mm²]	14	13	13	13	12	12	11	11	11	11
	II: 72°C/50°C				11	11	10	10	10	9,5	9,5	9,5	9,0	9,0
Reduction factor ψ <sup>0</sup> <sub>sus</sub> in uncracked concrete C20/25 in diamond drilled holes (DD)														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	ψ <sup>0</sup> <sub>sus</sub>	[-]	0,77									
	II: 72°C/50°C				0,72									
Increasing factors for concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,2</sup>										
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,ucr</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,(C20/25)</sub>										
Concrete cone failure														
Relevant parameter				see Table C2										
Splitting														
Relevant parameter				see Table C2										
Installation factor														
for dry and wet concrete (DD)		γ <sub>inst</sub>	[-]	1,0										
for flooded bore hole (DD)				1,2				1,4						
1) f <sub>uk</sub> shall be taken from the specifications of reinforcing bars 2) in absence of national regulation														
Rotho Blaas Injection System EPO-FIX Injection system										Annex C 15				
Performances Characteristic values of tension loads under static and quasi-static action for a working life of 50 years (reinforcing bar)														



**Table C16: Characteristic values of tension loads under static and quasi-static action for a working life of 100 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32	
Steel failure														
Characteristic tension resistance	N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> • f <sub>uk</sub> <sup>1)</sup>											
Cross section area	A <sub>s</sub>	[mm²]	50	79	113	154	201	314	452	491	616	804		
Partial factor	γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>											
Combined pull-out and concrete failure														
Characteristic bond resistance in uncracked concrete C20/25 in diamond drilled holes (DD)														
Temperature range I: 40°C/24°C II: 72°C/50°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,ucr,100</sub>	[N/mm²]	14	13	13	13	12	12	11	11	11	11	
				11	10	10	10	9,5	9,0	9,0	9,0	8,5	8,5	
Increasing factors for concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,2</sup>										
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,ucr,100</sub> =		ψ <sub>c</sub> • τ <sub>Rk,ucr,100,(C20/25)</sub>										
Concrete cone failure														
Relevant parameter				see Table C2										
Splitting														
Relevant parameter				see Table C2										
Installation factor														
for dry and wet concrete (DD)	γ <sub>inst</sub>	[-]	1,0											
for flooded bore hole (DD)			1,2					1,4						

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> in absence of national regulation

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension loads under static and quasi-static action for a working life of 100 years (reinforcing bar)

## Annex C 16

**Table C17: Characteristic values of shear loads under static and quasi-static action for a working life of 50 and 100 years**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure without lever arm												
Characteristic shear resistance	$V_{Rk,s}^0$	[kN]	$0,5 \cdot A_s \cdot f_{uk}^{1)}$									
Cross section area	$A_\sigma$	[mm²]	50	79	113	154	201	314	452	491	616	804
Partial factor	$\gamma_{Ms,V}$	[-]	$1,5^{2)}$									
Ductility factor	$k_7$	[-]	1,0									
Steel failure with lever arm												
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}^{1)}$									
Elastic section modulus	$W_{el}$	[mm³]	50	98	170	269	402	785	1357	1534	2155	3217
Partial factor	$\gamma_{Ms,V}$	[-]	$1,5^{2)}$									
Concrete pry-out failure												
Factor	$k_8$	[-]	2,0									
Installation factor	$\gamma_{inst}$	[-]	1,0									
Concrete edge failure												
Effective length of fastener	$l_f$	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$							$\min(h_{ef}; 300\text{mm})$		
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	14	16	20	24	25	28	32
Installation factor	$\gamma_{inst}$	[-]	1,0									
1) $f_{uk}$ shall be taken from the specifications of reinforcing bars 2) in absence of national regulation												
Rotho Blaas Injection System EPO-FIX Injection system									Annex C 17			
Performances Characteristic values of shear loads under static and quasi-static action for a working life of 50 and 100 years (reinforcing bar)												

**Table C18: Displacements under tension load<sup>1)</sup>  
in hammer drilled holes (HD), compressed air drilled holes (CD) and in  
hammer drilled holes with hollow drill bit (HDB)**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,038	0,039	0,040	0,044	0,047	0,051	0,052	0,055
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,047	0,049	0,051	0,055	0,059	0,064	0,067	0,070
<b>Cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,069	0,071	0,072	0,074	0,076	0,079	0,081	0,082
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,100	0,115	0,122	0,128	0,135	0,142	0,155	0,171
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,092	0,095	0,096	0,099	0,102	0,106	0,109	0,110
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,134	0,154	0,163	0,172	0,181	0,189	0,207	0,229

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C19: Displacements under tension load<sup>1)</sup>  
in diamond drilled holes (DD)**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked concrete under static and quasi-static action for a working life of 50 years</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,011	0,012	0,012	0,013	0,014	0,014	0,015	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,018	0,019	0,019	0,020	0,022	0,023	0,024	0,025
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,013	0,014	0,014	0,015	0,016	0,016	0,018	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,052	0,053	0,055	0,058	0,062	0,065	0,068	0,070
<b>Uncracked concrete under static and quasi-static action for a working life of 100 years</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,011	0,012	0,012	0,013	0,014	0,014	0,015	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,020	0,021	0,021	0,023	0,024	0,025	0,026	0,027
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,013	0,014	0,014	0,015	0,016	0,016	0,018	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,038	0,039	0,040	0,043	0,045	0,047	0,049	0,051

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C20: Displacements under shear load<sup>1)</sup>  
for all drilling methods**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked and cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>										
All temperature ranges	$\delta_{V0}$ -factor	[mm/kN]	0,06	0,06	0,05	0,04	0,04	0,03	0,03	0,03
	$\delta_{V\infty}$ -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

V: action shear load

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Displacements under static and quasi-static action  
for a working life of 50 and 100 years (threaded rod)

**Annex C 18**



**Table C21: Displacements under tension load<sup>1)</sup>  
in hammer drilled holes (HD), compressed air drilled holes (CD) and  
in hammer drilled holes with hollow drill bit (HDB)**

Internal threaded anchor rods			IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20
<b>Uncracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,029	0,030	0,033	0,035	0,038	0,041
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,029	0,030	0,033	0,035	0,038	0,041
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,039	0,040	0,044	0,047	0,051	0,055
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,049	0,051	0,055	0,059	0,064	0,070
<b>Cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,071	0,072	0,074	0,076	0,079	0,082
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,115	0,122	0,128	0,135	0,142	0,171
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,095	0,096	0,099	0,102	0,106	0,110
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,154	0,163	0,172	0,181	0,189	0,229

1) Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C22: Displacements under tension load<sup>1)</sup>  
in diamond drilled holes (DD)**

Internal threaded anchor rods			IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20
<b>Uncracked concrete under static and quasi-static action for a working life of 50 years</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,012	0,012	0,013	0,014	0,014	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,019	0,019	0,020	0,022	0,023	0,025
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,014	0,014	0,015	0,016	0,016	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,053	0,055	0,058	0,062	0,065	0,070
<b>Uncracked concrete under static and quasi-static action for a working life of 100 years</b>								
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,012	0,012	0,013	0,014	0,014	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,021	0,021	0,023	0,024	0,025	0,027
Temperature range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,014	0,014	0,015	0,016	0,016	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,039	0,040	0,043	0,045	0,047	0,051

1) Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C23: Displacements under shear load<sup>1)</sup>  
for all drilling methods**

Internal threaded anchor rods			IR-M6	IR-M8	IR-M10	IR-M12	IR-M16	IR-M20
<b>Uncracked and cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>								
All temperature ranges	$\delta_{V0}$ -factor	[mm/kN]	0,07	0,06	0,06	0,05	0,04	0,04
	$\delta_{V\infty}$ -factor	[mm/kN]	0,10	0,09	0,08	0,08	0,06	0,06

1) Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

V: action shear load

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Displacements under static and quasi-static action  
for a working life of 50 and 100 years (Internal threaded anchor rod)

**Annex C 19**

**Table C24: Displacements under tension load<sup>1)</sup>  
in hammer drilled holes (HD), compressed air drilled holes (CD) and in  
hammer drilled holes with hollow drill bit (HDB)**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Uncracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>												
Temp.- range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,031	0,033	0,035	0,038	0,038	0,040	0,043
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,031	0,033	0,035	0,038	0,038	0,040	0,043
Temp.- range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,038	0,039	0,040	0,042	0,044	0,047	0,051	0,051	0,054	0,058
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,047	0,049	0,051	0,053	0,055	0,059	0,065	0,065	0,068	0,072
<b>Cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>												
Temp.- range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,069	0,071	0,072	0,073	0,074	0,076	0,079	0,079	0,081	0,084
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,115	0,122	0,128	0,135	0,142	0,155	0,171	0,171	0,181	0,194
Temp.- range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,092	0,095	0,096	0,098	0,099	0,102	0,106	0,106	0,109	0,113
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,154	0,163	0,172	0,181	0,189	0,207	0,229	0,229	0,242	0,260

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C25: Displacements under tension load<sup>1)</sup>  
in diamond drilled holes (DD)**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Uncracked concrete under static and quasi-static action for a working life of 50 years</b>												
Temp.- range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,008	0,009	0,009	0,01	0,011	0,012	0,013	0,013	0,014	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,018	0,018	0,019	0,020	0,021	0,024	0,027	0,027	0,028	0,031
Temp.- range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,009	0,011	0,011	0,012	0,013	0,014	0,015	0,015	0,016	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,048	0,051	0,054	0,058	0,061	0,068	0,076	0,076	0,081	0,088
<b>Uncracked concrete under static and quasi-static action for a working life of 100 years</b>												
Temp.- range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,008	0,009	0,009	0,010	0,011	0,012	0,013	0,013	0,014	0,015
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,018	0,020	0,021	0,022	0,024	0,026	0,029	0,029	0,031	0,034
Temp.- range II: 72°C/50°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,009	0,011	0,011	0,012	0,013	0,014	0,015	0,015	0,016	0,018
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,035	0,037	0,040	0,042	0,045	0,049	0,055	0,055	0,059	0,064

<sup>1)</sup> Calculation of the displacement

$$\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$$

$\tau$ : action bond stress for tension

$$\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$$

**Table C26: Displacements under shear load<sup>1)</sup>  
for all drilling methods**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Uncracked and cracked concrete under static and quasi-static action for a working life of 50 and 100 years</b>												
All temperature ranges	$\delta_{V0}$ -factor	[mm/kN]	0,06	0,05	0,05	0,04	0,04	0,04	0,03	0,03	0,03	0,03
	$\delta_{V\infty}$ -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05	0,04	0,04

<sup>1)</sup> Calculation of the displacement

$$\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$$

V: action shear load

$$\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$$

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Displacements under static and quasi-static action  
for a working life of 50 and 100 years (reinforcing bar)

**Annex C 20**

**Table C27: Characteristic values of tension loads under seismic action (performance category C1) for a working life of 50 years**

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
Steel failure											
Characteristic tension resistance		$N_{Rk,s,eq,C1}$	[kN]	$1,0 \cdot N_{Rk,s}$							
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1							
Combined pull-out and concrete failure											
Characteristic bond resistance in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)											
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,eq,C1}$	[N/mm²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5
	II: 72°C/50°C		$\tau_{Rk,eq,C1}$	[N/mm²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0
Increasing factors for concrete		$\psi_c$	[-]	1,0							
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,eq,C1} =$		$\psi_c \cdot \tau_{Rk,eq,C1,(C20/25)}$							
Installation factor											
for dry and wet concrete (HD; HDB, CD)		$\gamma_{inst}$	[-]	1,0							
for flooded bore hole (HD; HDB, CD)				1,2							

**Table C28: Characteristic values of tension loads under seismic action (performance category C1) for a working life of 100 years**

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30
Steel failure											
Characteristic tension resistance		$N_{Rk,s,eq,C1}$	[kN]	$1,0 \cdot N_{Rk,s}$							
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1							
Combined pull-out and concrete failure											
Characteristic bond resistance in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)											
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,eq,C1}$	[N/mm²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5
	II: 72°C/50°C		$\tau_{Rk,eq,C1}$	[N/mm²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5
Increasing factors for concrete		$\psi_c$	[-]	1,0							
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,eq,C1} =$		$\psi_c \cdot \tau_{Rk,eq,C1,(C20/25)}$							
Installation factor											
for dry and wet concrete (HD; HDB, CD)		$\gamma_{inst}$	[-]	1,0							
for flooded bore hole (HD; HDB, CD)				1,2							

**Table C29: Characteristic values of shear loads under seismic action  
(performance category C1) for a working life of 50 and 100 years**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Steel failure</b>										
Characteristic shear resistance (Seismic C1)	$V_{Rk,s,eq,C1}$	[kN]	$0,70 \cdot V_{Rk,s}^0$							
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1							
<b>Factor for annular gap</b>	$\alpha_{gap}$	[-]	0,5 (1,0) <sup>1)</sup>							

<sup>1)</sup> Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended.

**Rotho Blaas Injection System EPO-FIX Injection system**

**Annex C 23**

**Performances**

Characteristic values of shear loads under seismic action (performance category C1)  
for a working life of 50 and 100 years (threaded rod)



**Table C30: Characteristic values of tension loads under seismic action (performance category C1) for a working life of 50 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure													
Characteristic tension resistance		N <sub>Rk,s,eq,C1</sub>	[kN]	1,0 · A <sub>s</sub> · f <sub>uk</sub> <sup>1)</sup>									
Cross section area		A <sub>s</sub>	[mm²]	50	79	113	154	201	314	452	491	616	804
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>									
Combined pull-out and concrete failure													
Characteristic bond resistance in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)													
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,eq,C1</sub>	[N/mm²]	7,0	7,0	8,5	8,5	8,5	8,5	8,5	8,5	8,5
	II: 72°C/50°C		τ <sub>Rk,eq,C1</sub>	[N/mm²]	6,0	6,0	7,0	7,0	7,0	7,0	7,0	7,0	7,0
Increasing factors for concrete		ψ <sub>c</sub>	[-]	1,0									
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,eq,C1</sub> =		ψ <sub>c</sub> · τ <sub>Rk,eq,C1</sub> , (C20/25)									
Installation factor													
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0									
for flooded bore hole (HD; HDB, CD)				1,2									

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> in absence of national regulation

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Characteristic values of tension loads under seismic action (performance category C1) for a working life of 50 years (reinforcing bar)

**Annex C 24**



**Table C31: Characteristic values of tension loads under seismic action (performance category C1) for a working life of 100 years**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure													
Characteristic tension resistance		N <sub>Rk,s,eq,C1</sub>	[kN]	1,0 · A <sub>s</sub> · f <sub>uk</sub> <sup>1)</sup>									
Cross section area		A <sub>s</sub>	[mm²]	50	79	113	154	201	314	452	491	616	804
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>									
Combined pull-out and concrete failure													
Characteristic bond resistance in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)													
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	τ <sub>Rk,eq,C1</sub>	[N/mm²]	6,5	6,5	7,5	7,5	7,5	7,5	7,5	7,5	7,5
	II: 72°C/50°C		τ <sub>Rk,eq,C1</sub>	[N/mm²]	5,5	5,5	6,5	6,5	6,5	6,5	6,5	6,5	6,5
Increasing factors for concrete		ψ <sub>c</sub>	[-]	1,0									
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,eq,C1</sub> =		ψ <sub>c</sub> · τ <sub>Rk,eq,C1,(C20/25)</sub>									
Installation factor													
for dry and wet concrete (HD; HDB, CD)		γ <sub>inst</sub>	[-]	1,0									
for flooded bore hole (HD; HDB, CD)				1,2									

<sup>1)</sup>  $f_{uk}$  shall be taken from the specifications of reinforcing bars

<sup>2)</sup> in absence of national regulation

**Rotho Blaas Injection System EPO-FIX Injection system**

**Performances**

Characteristic values of tension loads under seismic action (performance category C1) for a working life of 100 years (reinforcing bar)

**Annex C 25**

**Table C32: Characteristic values of shear loads under seismic action  
(performance category C1) for a working life of 50 and 100 years**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
Steel failure												
Characteristic shear resistance	$V_{Rk,s,eq,C1}$	[kN]	$0,35 \cdot A_s \cdot f_{uk}^{1)}$									
Cross section area	$A_s$	[mm²]	50	79	113	154	201	314	452	491	616	804
Partial factor	$\gamma_{Ms,V}$	[-]	$1,5^{2)}$									
Factor for annular gap	$\alpha_{gap}$	[-]	$0,5 (1,0)^{3)}$									
<div>1) <math>f_{uk}</math> shall be taken from the specifications of reinforcing bars</div> <div>2) in absence of national regulation</div> <div>3) Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended.</div>												
Rotho Blaas Injection System EPO-FIX Injection system									Annex C 26			
Performances Characteristic values of shear loads under seismic action (performance category C1) for a working life of 50 and 100 years (reinforcing bar)												

**Table C33: Characteristic values of tension loads under seismic action (performance category C2) for a working life of 50 and 100 years**

Threaded rod				M12	M16	M20	M24	
Steel failure								
Characteristic tension resistance, Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class ≥70		$N_{Rk,s,eq,C2}$	[kN]	$1,0 \cdot N_{Rk,s}$				
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1				
Combined pull-out and concrete failure								
Characteristic bond resistance in cracked and uncracked concrete C20/25 in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)								
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,eq,C2}$	[N/mm²]	5,8	4,8	5,0	5,1
	II: 72°C/50°C		$\tau_{Rk,eq,C2}$	[N/mm²]	5,0	4,1	4,3	4,4
Increasing factors for concrete		$\psi_c$	[-]	1,0				
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,eq,C2} =$		$\psi_c \cdot \tau_{Rk,eq,C2,(C20/25)}$				
Installation factor								
for dry and wet concrete (HD; HDB, CD)		$\gamma_{inst}$	[-]	1,0				
for flooded bore hole (HD; HDB, CD)				1,2				

**Table C34: Characteristic values of shear loads under seismic action (performance category C2) for a working life of 50 and 100 years**

Threaded rod			M12	M16	M20	M24
Steel failure						
Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class ≥70	$V_{Rk,s,eq,C2}$	[kN]	$0,70 \cdot V^0_{Rk,s}$			
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1			
Factor for annular gap	$\alpha_{gap}$	[-]	$0,5 (1,0)^1)$			

<sup>1)</sup> Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended.

## Rotho Blaas Injection System EPO-FIX Injection system

### Performances

Characteristic values of tension and shear loads under seismic action (performance category C2) for a working life of 50 and 100 years (threaded rod)

## Annex C 27

**Table C35: Displacements under tension load (threaded rod)**

Threaded rod			M12	M16	M20	M24
Uncracked and cracked concrete under seismic action (performance category C2) for a working life of 50 and 100 years						
All temperature ranges	$\delta_{N,eq,C2(DLS)}$	[mm]	0,21	0,24	0,27	0,36
	$\delta_{N,eq,C2(ULS)}$	[mm]	0,54	0,51	0,54	0,63

**Table C36: Displacements under shear load (threaded rod)**

Threaded rod			M12	M16	M20	M24
Uncracked and cracked concrete under seismic action (performance category C2) for a working life of 50 and 100 years						
All temperature ranges	$\delta_{V,eq,C2(DLS)}$	[mm]	3,1	3,4	3,5	4,2
	$\delta_{V,eq,C2(ULS)}$	[mm]	6,0	7,6	7,3	10,9

**Rotho Blaas Injection System EPO-FIX Injection system**

**Annex C 28**

**Performances**

Displacements under seismic action (performance category C2)  
for a working life of 50 and 100 years (threaded rod)