



Public-law institution jointly founded by the federal states and the Federation

European Technical Assessment Body for construction products



# **European Technical Assessment**

### ETA-05/0208 of 3 September 2025

English translation prepared by DIBt - Original version in German language

#### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family

to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

This version replaces

Deutsches Institut für Bautechnik

Roof waterproofing "REPOMA (S)"

Liquid applied roof waterproofing on the basis of polymethylmethacrylate

Alteco Technik GmbH Raiffeisenstraße 16 27239 Twistringen DEUTSCHLAND

Alteco Technik GmbH Raiffeisenstraße 16 27239 Twistringen DEUTSCHLAND

8 pages including 3 annexes which form an integral part of this assessment

EAD 030350-00-0402

ETA-05/0208 issued on 15 October 2014

DIBt | Kolonnenstraße 30 B | 10829 Berlin | GERMANY | Phone: +493078730-0 | FAX: +493078730-320 | Email: dibt@dibt.de | www.dibt.de Z200322.25

### **European Technical Assessment ETA-05/0208**

English translation prepared by DIBt



Page 2 of 8 | 3 September 2025

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 8 | 3 September 2025

#### Specific part

#### 1 Technical description of the product

The liquid applied roof waterproofing "REPOMA (S)" is a kit, which consists of the following components:

- Liquid applied roof waterproofing on the basis of polymethylmethacrylate.
- Polyester fleece as reinforcement.

As an assembled system these components form a homogeneous seamless roof waterproofing.

The minimum layer thickness of the roof waterproofing applied (with reinforcement) is 2.3 mm.

For the most substrates a primer is not required. In single cases the manufacturer is responsible to give guidance which pretreatment/primer is required.

The liquid applied roof waterproofing "REPOMA (S)" does not contain any substances that are intended to inhibit or prevent root penetration (root protection agents)<sup>1</sup>.

The components and the system build-up of the roof waterproofing are given in Annex A1.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The liquid applied roof waterproofing is used for the waterproofing of roof surfaces against penetration of atmospheric water.

In the technical documents<sup>2</sup> the manufacturer gives information concerning the substrates which the product is suitable for and on how these substrates shall be pre-treated.

The levels of use categories and the performance of the product are given in Annex A2.

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of working life of the product of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

The levels of use categories and performances given in Section 3 are only valid if the liquid applied roof waterproofing is used in compliance with the specifications and conditions given in Annex B and the installation instructions of the manufacturer stated in the technical documents.

#### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Safety in case of fire (BWR 2)

| Essential characteristic           | Performance  |
|------------------------------------|--------------|
| External fire performance of roofs | See Annex A2 |
| Reaction to fire                   | See Annex A2 |

<sup>1</sup> Manufacturer's statement.

The manufacturer's technical documents comprise all information necessary for the production and the installation of the product as well as for repair of the roof waterproofing made from that and it is deposited with DIBt.



Page 4 of 8 | 3 September 2025

#### 3.2 Hygiene, health and the environment (BWR 3)

| Essential characteristic   | Performance                      |  |
|--|----------------------------------|--|
| Content, emission and/or release of dangerous substances               |                                  |  |
| Substance/s classified as EU-cat. Carc. 1A and/or 1B a)                | None of these raw materials are  |  |
| Substance/s classified as EU-cat. Muta. 1A and/or 1B a)                | actively used in the manufacture |  |
| Substance/s classified as EU-cat. Repr. 1A and/or 1B a)                | of the construction product b)   |  |
| Release scenario regarding BWR 3: S/W 2                                |                                  |  |
| Resistance to water vapour   | See Annex A2                     |  |
| Watertightness   | See Annex A2                     |  |
| Resistance to wind loads   | See Annex A2                     |  |
| Resistance to mechanical damage (perforation)                          | See Annex A2                     |  |
| Resistance to fatigue movement   | See Annex A2                     |  |
| Resistance to the effects of low and high surface temperature          | See Annex A2                     |  |
| Resistance to ageing media (heat and water)                            | See Annex A2                     |  |
| Resistance to UV radiation in the presence of moisture (climatic zone) | See Annex A2                     |  |
| Resistance to plant roots  | No performance assessed          |  |
| Effects of variations in kit components and site practices             | See Annex A2                     |  |
| Effects of day joints  | See Annex A2                     |  |

a) In accordance with Regulation (EC) No 1272/2008

#### 3.3 Safety and accessibility in use (BWR 4)

| Essential characteristic | Performance             |  |
|--------------------------|-------------------------|--|
| Slipperiness             | No performance assessed |  |

#### 3.4 General aspects

The verification of durability and serviceability is part of testing the essential characteristics. Durability and serviceability are only ensured if the specifications of intended use according to Annex B and the specifications of the technical documents of the manufacturer are kept.

## 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 030350-00-0402, the applicable European legal act is: 98/599/EC as amended by Commission Decision 2001/596/EC.

The system to be applied is: 3

In addition, with regard to external fire performance of roofs and reaction to fire for products covered by this EAD the system to be applied is: 3

b) Assessment based on the detailed manufacturer's statements on dangerous substances.

### **European Technical Assessment ETA-05/0208**

English translation prepared by DIBt

Head of Section



Page 5 of 8 | 3 September 2025

| 5 | Technical details necessary for the implementation of the AVCP system, as provided for |
|---|--|
|   | in the applicable EAD  |

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Hannoun

Bettina Hemme beglaubigt:

Issued in Berlin on 3 September 2025 by Deutsches Institut für Bautechnik



### System built-up:

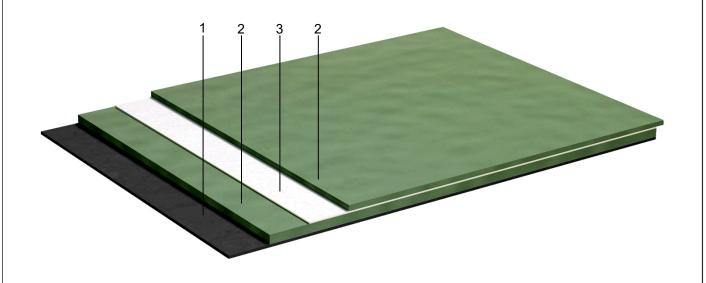

| No. | Description            | Consumption / weight per unit area / remarks                              |
|-----|------------------------|---|
| 1   | Substrate              | Primer not required   |
| 2   | Liquid waterproofing   | Total consumption of 1 <sup>st</sup> + 2 <sup>nd</sup> layer: ≥ 2.8 kg/m² |
| 3   | Polyester fleece layer | Nominal weight per unit area: 165 g/m²                                    |

| Roof waterproofing "REPOMA (S)" Alteco Technik GmbH |          |
|---|----------|
| System built-up                                     | Annex A1 |
|   |          |
|   |          |

Z200405.25 8.04.02-175/25



| Description of the pr  | oduct   |                  |  |                               |  |
|--|---|------------------|--|-------------------------------|--|
| Minimum thickness of   | the Waterp  | oroofing         |  | 2.3 mm                        |  |
| Minimum quantity con   | sumed:  |                  |  | 2.8 kg/m²                     |  |
| Roof slope   |   |                  |  | S1 to S4 (each slope)         |  |
| Essential characteris  | stics   |                  |  | Performance / Use category    |  |
| External fire performan  | nce of roofs  | s El             | N 13501-5                              | Class B <sub>ROOF</sub> (t1)* |  |
| Reaction to fire   |   | El               | N 13501-1                              | Class E                       |  |
| Content, emission and  | l/or release  | of dangerous     | substances                             | See section 3.2               |  |
| Water vapour diffusion resistance factor Watertightness  |   |                  | μ ≈ 5150<br>(23 °C, 0% / 85 % r.h.)    |                               |  |
|  |   |                  | Watertight                             |                               |  |
| Resistance to wind loads (for tear resistant substrates)   |   |                  | ≥ 50 kPa                               |                               |  |
| Resistance to mechanical damage (perforation)  | for compressible substrates (e.g., insulation boards) and non-compressible substrates (e.g., concrete/ steel) |                  | P1 to P4<br>(from low to high/special) |                               |  |
| Resistance to fatigue movement   |   |                  | W3                                     |                               |  |
| Desistance to the offe   | -tf   |                  | low surface temperature                | TL4 (-30 °C)                  |  |
| Resistance to the effe   | CIS OI  |                  | high surface temperature               | TH4 (+90 °C)                  |  |
| Working life according to the resistance to ageing media (heat and water)  UV resistance in presence of moisture (climatic zone) |   |                  | W3 (25 years)                          |                               |  |
|  |   |                  | M and S (moderate and severe climates) |                               |  |
| Resistance to plant ro   | ots   |                  |  | No performance assessed       |  |
| Effects of variations in   |   | at +0 °C         | Maximum tensile strength               | 9.5 MPa (±20 %)               |  |
| and process and  |   | and<br>at +30 °C | Elongation                             | 250 % (±20 %)                 |  |
| Effects of day joints  |   |                  | ≥ 50 kPa                               |                               |  |
| Resistance to slipperiness   |   |                  | No performance assessed                |                               |  |

- <sup>\*</sup> The classification B<sub>ROOF</sub> (t1) is valid for the following supporting decks:
  - Roof pitches < 20°.
  - Any wooden continuous deck with a minimum thickness of 16 mm and with gaps not exceeding 0.5 mm.
  - Any non-combustible continuous deck with a minimum thickness of 10 mm and with gaps not exceeding 0.5 mm.
  - Any other roof systems for which classification documents for B<sub>ROOF</sub> (t1) according EN 13501-5 are available.

| Roof waterproofing "REPOMA (S)" Alteco Technik GmbH                   |          |
|---|----------|
| Description, levels of use categories and performances of the product | Annex A2 |
|   |          |

Z200405.25 8.04.02-175/25



#### Installation

The levels of use categories and the performances of the roof waterproofing can be assumed only, if the installation is carried out according to the installation instructions stated in the technical documents of the manufacturer, in particular taking account of the following points:

- installation by appropriately trained personnel;
- installation of only those components which are marked components of the kit;
- installation with the required tools and adjuvants;
- precautions during installation;
- inspecting the roof surface for cleanliness and correct preparation, if need be, applying a primer before applying the product;
- inspecting compliance with suitable weather and curing conditions;
- finding out the mix ratio depending on the ambient temperature;
- ensuring a thickness of the cured waterproofing of at least 2.3 mm by processing appropriate minimum quantities of material;
- inspections during installation and of the finished product and documentation of the results.

| Roof waterproofing "REPOMA (S)" Alteco Technik GmbH |         |
|---|---------|
| Intended use Specifications for the installation    | Annex B |

Z200405.25 8.04.02-175/25