

Public-law institution jointly founded by the
federal states and the Federation

European Technical Assessment Body
for construction products



European Technical Assessment

ETA-17/0444
of 8 August 2025

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for
concrete

Product family
to which the construction product belongs

Bonded fasteners and bonded expansion fasteners for
use in concrete

Manufacturer

Ferrometal Oy
Karhutie 9
FI-01900 NURMIJÄRVI
FINNLAND

Manufacturing plant

Plant 1, Finland

This European Technical Assessment
contains

34 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330499-02-0601, Edition 12/2023

This version replaces

ETA-17/0444 issued on 6 October 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The "Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete" is a bonded anchor consisting of a cartridge with injection mortar Fix Master FIT-Ve 200 or Fix Master FIT-Wi 200 and a steel element. The steel element consists of a commercial threaded rod with washer and hexagon nut in the range of M8 to M30 or reinforcing bar in the range of \varnothing 8 to \varnothing 32 mm or an internal threaded anchor rod IG-M6 to IG-M20.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|---|---|
| Characteristic resistance to tension load (static and quasi-static loading) | See Annex B 3, C 1, C 2, C 3, C 5 and C 7 |
| Characteristic resistance to shear load (static and quasi-static loading) | See Annex C 1, C 4, C 6 and C 8 |
| Displacements (static and quasi-static loading) | See Annex C 9 to C 11 |
| Characteristic resistance for seismic performance categories C1 | See Annex C 12 and C 13 |
| Characteristic resistance and displacements for seismic performance categories C2 | No performance assessed |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|--------------------------|------------------------|
| Reaction to fire | Class A1 |
| Resistance to fire | See Annex C 14 to C 16 |

3.3 Hygiene, health and the environment (BWR 3)

| Essential characteristic | Performance |
|--|-------------------------|
| Content, emission and/or release of dangerous substances | No performance assessed |

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-02-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 8 August 2025 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section


beglaubigt:
Baderschneider

Installation threaded rod M8 up to M30


prepositioned installation or
push through installation (annular gap filled with mortar)

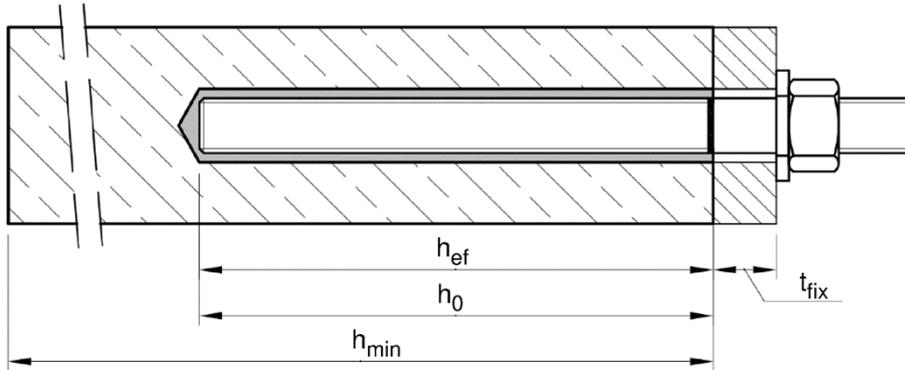

Installation reinforcing bar Ø8 up to Ø32

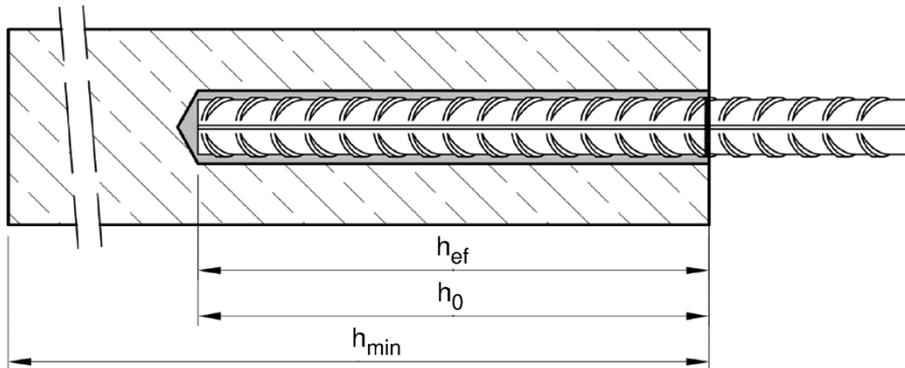

Installation internal threaded anchor rod IG-M6 up to IG-M20

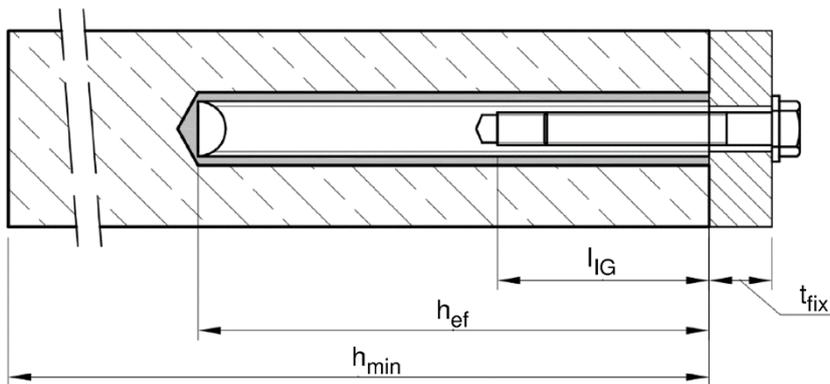

t_{fix} = thickness of fixture
 h_{ef} = effective embedment depth
 h_{min} = minium thickness of member

h_0 = nominal drill hole diameter
 l_{IG} = thread engagement length

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete


Product description
Installed condition

Annex A 1

Cartridge system

Coaxial Cartridge:

150 ml, 280 ml, 300 ml up to 333 ml and 380 ml up to 420 ml




Imprint:

Fix Master FIT-Ve 200 or Fix Master FIT-Wi 200

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Side-by-Side Cartridge:

235 ml, 345 ml up to 360 ml and 825 ml




Imprint:

Fix Master FIT-Ve 200 or Fix Master FIT-Wi 200

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Foil tube Cartridge:

165 ml and 300 ml




Imprint:


Fix Master FIT-Ve 200 or Fix Master FIT-Wi 200

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Static mixer CRW 14W

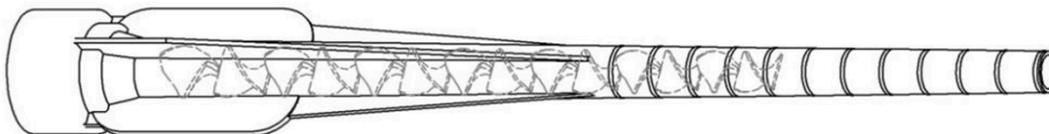

Static mixer PM-19E

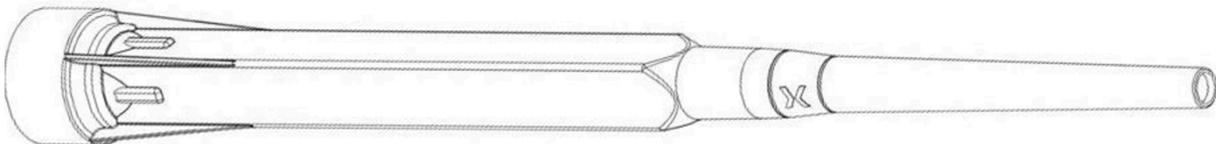

Piston plug VS and mixer extension VL




Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Product description

Injection system

Annex A 2

Threaded rod M8 up to M30 with washer and hexagon nut

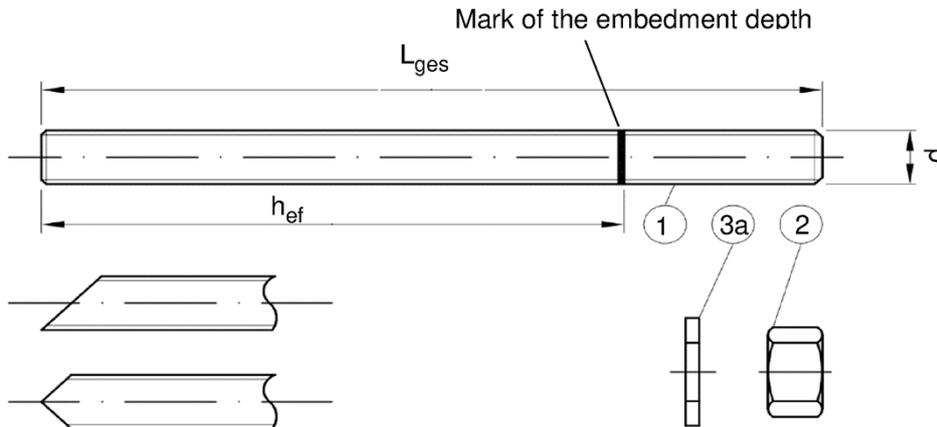



Commercial standard rod with:

- Materials, dimensions and mechanical properties acc. to Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004. The document shall be stored.
- Marking of embedment depth

For hot dip galvanized elements, the requirements with regards to the combination of nuts and rods according to EN ISO 10684:2004+AC:2009 Annex F shall be considered.

Internal threaded rod IG-M6 to IG-M20

Threaded rod or screw

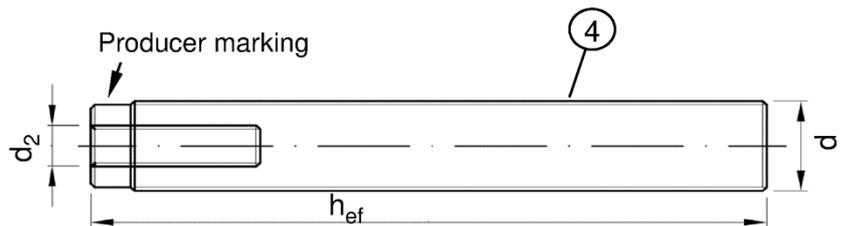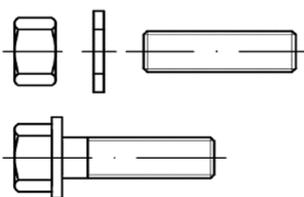

Producer marking: e.g.  M8

 Marking Internal thread (optional)


 Mark

M8 Thread size (Internal thread)

A4 additional mark for stainless steel

HCR additional mark for high-corrosion resistance steel

-8 additional mark for property class 8.8

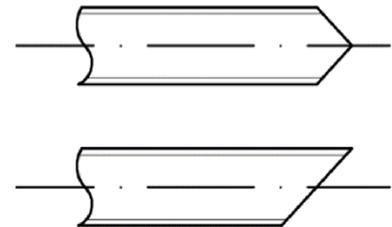

Filling washer VFS



Mixer reduction nozzle MR



Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete


Product description

Threaded rod; Internal threaded rod
Filling washer; Mixer reduction nozzle

Annex A 3

| Table A1: Materials | | | | | | |
|--|--|--|--|-------------------------------------|-------------------------------|----------------|
| Part | Designation | Material | | | | |
| Steel, zinc plated (Steel acc. to EN ISO 683-4:2018 or EN 10263:2017) | | | | | | |
| - zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:2022 or | | | | | | |
| - hot-dip galvanised $\geq 40 \mu\text{m}$ acc. to EN ISO 1461:2022 and EN ISO 10684:2004+AC:2009 or | | | | | | |
| - sherardized $\geq 45 \mu\text{m}$ acc. to EN ISO 17668:2016 | | | | | | |
| 1 | Threaded rod | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 898-1:2013 | 4.6 | $f_{uk} = 400 \text{ N/mm}^2$ | $f_{yk} = 240 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 4.8 | $f_{uk} = 400 \text{ N/mm}^2$ | $f_{yk} = 320 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 5.6 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 300 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 5.8 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 400 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| 8.8 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 640 \text{ N/mm}^2$ | $A_5 \geq 8\%$ | | | |
| 2 | Hexagon nut | acc. to EN ISO 898-2:2022 | 4 for anchor rod class 4.6 or 4.8 | | | |
| | | | 5 for anchor rod class 5.6 or 5.8 | | | |
| | | | 8 for anchor rod class 8.8 | | | |
| 3a | Washer | Steel, zinc plated, hot-dip galvanised or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000) | | | | |
| 3b | Filling washer | Steel, zinc plated, hot-dip galvanised or sherardized | | | | |
| 4 | Internal threaded anchor rod | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 898-1:2013 | 5.8 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 400 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 8.8 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 640 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| Stainless steel A2 (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2023) | | | | | | |
| Stainless steel A4 (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2023) | | | | | | |
| High corrosion resistance steel (Material 1.4529 or 1.4565, acc. to EN 10088-1:2023) | | | | | | |
| 1 | Threaded rod ¹⁾³⁾ | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 3506-1:2020 | 50 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 210 \text{ N/mm}^2$ | $A_5 \geq 8\%$ |
| | | | 70 | $f_{uk} = 700 \text{ N/mm}^2$ | $f_{yk} = 450 \text{ N/mm}^2$ | $A_5 \geq 8\%$ |
| | 80 | $f_{uk} = 800 \text{ N/mm}^2$ | $f_{yk} = 600 \text{ N/mm}^2$ | $A_5 \geq 8\%$ | | |
| 2 | Hexagon nut ¹⁾³⁾ | acc. to EN ISO 3506-1:2020 | 50 for anchor rod class 50 | | | |
| | | | 70 for anchor rod class 70 | | | |
| | | | 80 for anchor rod class 80 | | | |
| 3a | Washer | A2: Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2023 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2023 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1:2023 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000) | | | | |
| 3b | Filling washer | Stainless steel A4, High corrosion resistance steel | | | | |
| 4 | Internal threaded anchor rod ¹⁾²⁾ | Property class | Characteristic steel ultimate tensile strength | Characteristic steel yield strength | Elongation at fracture | |
| | | acc. to EN ISO 3506-1:2020 | 50 | $f_{uk} = 500 \text{ N/mm}^2$ | $f_{yk} = 210 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| | | | 70 | $f_{uk} = 700 \text{ N/mm}^2$ | $f_{yk} = 450 \text{ N/mm}^2$ | $A_5 > 8\%$ |
| 1) Property class 70 or 80 for anchor rods and hexagon nuts up to M24 and Internal threaded anchor rods up to IG-M16 | | | | | | |
| 2) for IG-M20 only property class 50 | | | | | | |
| 3) Property class 80 only for stainless steel A4 and HCR | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | |
| Product description Materials threaded rod and internal threaded rod | | | | Annex A 4 | | |

Reinforcing bar: $\varnothing 8$ up to $\varnothing 32$



Minimum value of related rip area $f_{R,min}$ according to EN 1992-1-1:2004+AC:2010

Rib height of the bar shall be in the range $0,05d \leq h_{rib} \leq 0,07d$

(d: Nominal diameter of the bar; h_{rib} : Rib height of the bar)

Table A2: Materials Reinforcing bar

| Part | Designation | Material |
|--------------|--|--|
| Rebar | | |
| 1 | Reinforcing steel according to EN 1992 1 1:2004+AC:2010, Annex C | Bars and rebars from ring class B or C f_{yk} and k according to NDP or NCI according to EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$ |

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Product description
Materials reinforcing bar

Annex A 5

| Specification of the intended use | | | | |
|---|--|------------------|-------------------------|------------------|
| Fasteners subject to (Static and quasi-static loads): | | | | |
| | Working life 50 years | | Working life 100 years | |
| Base material | uncracked concrete | cracked concrete | uncracked concrete | cracked concrete |
| HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling | M8 to M30, Ø8 to Ø32, IG-M6 to IG-M20 | | No performance assessed | |
| Temperature Range | I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾ | | No performance assessed | |
| Fasteners subject to (seismic action): | | | | |
| | Performance Category C1 | | Performance Category C2 | |
| Base material | Cracked and uncracked concrete | | | |
| HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling | M8 to M30, Ø8 to Ø32 | | No performance assessed | |
| Temperature Range | I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾ | | No performance assessed | |
| Fasteners subject to (fire exposure): | | | | |
| Base material | Cracked and uncracked concrete | | | |
| HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling | M8 to M30, Ø8 to Ø32, IG-M6 to IG-M20 | | | |
| Temperature Range: | I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾ | | | |
| <p>1) (max. long-term temperature +24°C and max. short-term temperature +40°C) 2) (max. long-term temperature +50°C and max. short-term temperature +80°C) 3) (max. long-term temperature +72°C and max. short-term temperature +120°C)</p> | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | Annex B 1 |
| Intended Use Specifications | | | | |

Base material:

- Compacted, reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A2:2021.
- Strength classes C20/25 to C50/60 according to EN 206:2013 + A2:2021.

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (all materials).
- For all other conditions according to EN 1993-1-4:2006 + A1:2015 corresponding to corrosion resistance class:
 - Stainless steel Stahl A2 according to Annex A 4, Table A1: CRC II
 - Stainless steel Stahl A4 according to Annex A 4, Table A1: CRC III
 - High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V

Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e.g. position of the fastener relative to reinforcement or to supports, etc.).
- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work.
- The fasteners are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018

Installation:

- Dry, wet concrete or flooded bore holes (not sea-water).
- Hole drilling by hammer (HD), hollow (HDB) or compressed air (CD).
- Overhead installation allowed.
- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature in concrete:
Fix Master FIT-Ve 200: -10°C up to +40°C for the standard variation of temperature after installation.
Fix Master FIT-Wi 200: -20°C up to +10°C for the standard variation of temperature after installation.

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Intended Use
Specifications (Continued)

Annex B 2

Table B1: Installation parameters for threaded rod

| Threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|---------------------------------------|------|--|-----|-----|-----------------|-----|-----|-----|-----|
| Diameter of element | $d = d_{nom}$ | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 |
| Nominal drill hole diameter | d_0 | [mm] | 10 | 12 | 14 | 18 | 24 | 28 | 32 | 35 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 60 | 70 | 80 | 90 | 96 | 108 | 120 |
| | $h_{ef,max}$ | [mm] | 160 | 200 | 240 | 320 | 400 | 480 | 540 | 600 |
| Diameter of clearance hole in the fixture | Prepositioned installation $d_f \leq$ | [mm] | 9 | 12 | 14 | 18 | 22 | 26 | 30 | 33 |
| | Push through installation d_f | [mm] | 12 | 14 | 16 | 20 | 24 | 30 | 33 | 40 |
| Maximum installation torque | $\max T_{inst}$ | [Nm] | 10 | 20 | 40 | 60 | 100 | 170 | 250 | 300 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | | |
| Minimum spacing | s_{min} | [mm] | 40 | 50 | 60 | 80 | 100 | 120 | 135 | 150 |
| Minimum edge distance | c_{min} | [mm] | 40 | 50 | 60 | 80 | 100 | 120 | 135 | 150 |

Table B2: Installation parameters for reinforcing bar

| Reinforcing bar | | | $\varnothing 8^1$ | $\varnothing 10^1$ | $\varnothing 12^1$ | $\varnothing 14$ | $\varnothing 16$ | $\varnothing 20$ | $\varnothing 25$ | $\varnothing 28$ | $\varnothing 32$ |
|-----------------------------|---------------|------|--|--------------------|--------------------|------------------|------------------|------------------|------------------|------------------|------------------|
| Diameter of element | $d = d_{nom}$ | [mm] | 8 | 10 | 12 | 14 | 16 | 20 | 25 | 28 | 32 |
| Nominal drill hole diameter | d_0 | [mm] | 10 12 | 12 14 | 14 16 | 18 | 20 | 25 | 32 | 35 | 40 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 60 | 70 | 75 | 80 | 90 | 100 | 112 | 128 |
| | $h_{ef,max}$ | [mm] | 160 | 200 | 240 | 280 | 320 | 400 | 500 | 560 | 640 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | | | |
| Minimum spacing | s_{min} | [mm] | 40 | 50 | 60 | 70 | 80 | 100 | 125 | 140 | 160 |
| Minimum edge distance | c_{min} | [mm] | 40 | 50 | 60 | 70 | 80 | 100 | 125 | 140 | 160 |

¹⁾ both nominal drill hole diameter can be used


Table B3: Installation parameters for Internal threaded anchor rod

| Internal threaded anchor rod | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 |
|--|-----------------|------|--|-------|--------|-----------------|--------|--------|
| Internal diameter of anchor rod | d_2 | [mm] | 6 | 8 | 10 | 12 | 16 | 20 |
| Outer diameter of anchor rod ¹⁾ | $d = d_{nom}$ | [mm] | 10 | 12 | 16 | 20 | 24 | 30 |
| Nominal drill hole diameter | d_0 | [mm] | 12 | 14 | 18 | 24 | 28 | 35 |
| Effective embedment depth | $h_{ef,min}$ | [mm] | 60 | 70 | 80 | 90 | 96 | 120 |
| | $h_{ef,max}$ | [mm] | 200 | 240 | 320 | 400 | 480 | 600 |
| Diameter of clearance hole in the fixture | $d_f \leq$ | [mm] | 7 | 9 | 12 | 14 | 18 | 22 |
| Maximum installation torque | $\max T_{inst}$ | [Nm] | 10 | 10 | 20 | 40 | 60 | 100 |
| Thread engagement length min/max | l_{IG} | [mm] | 8/20 | 8/20 | 10/25 | 12/30 | 16/32 | 20/40 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | |
| Minimum spacing | s_{min} | [mm] | 50 | 60 | 80 | 100 | 120 | 150 |
| Minimum edge distance | c_{min} | [mm] | 50 | 60 | 80 | 100 | 120 | 150 |

¹⁾ With metric threads according to EN 1993-1-8:2005+AC:2009

| | |
|--|------------------|
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | Annex B 3 |
| Intended Use Installation parameters | |

Table B4: Parameter cleaning and installation tools

|  |  |  |  |  | | |  | Installation direction and use of piston plug | | |
|---|---|---|---|--|------|--|---|---|---|---|
| Threaded Rod | Reinforcing bar | Internal threaded anchor rod | d_0 Drill bit - \emptyset HD, HDB, CD | d_b Brush - \emptyset | | $d_{b,min}$ min. Brush - \emptyset | Piston plug | | | |
| [mm] | [mm] | [mm] | [mm] | [mm] | [mm] | [mm] | |  |  |  |
| M8 | 8 | | 10 | RBT10 | 12 | 10,5 | | No plug required | | |
| M10 | 8 / 10 | IG-M6 | 12 | RBT12 | 14 | 12,5 | | | | |
| M12 | 10 / 12 | IG-M8 | 14 | RBT14 | 16 | 14,5 | | | | |
| | 12 | | 16 | RBT16 | 18 | 16,5 | | | | |
| M16 | 14 | IG-M10 | 18 | RBT18 | 20 | 18,5 | VS18 | $h_{ef} > 250$ mm | $h_{ef} > 250$ mm | all |
| | 16 | | 20 | RBT20 | 22 | 20,5 | VS20 | | | |
| M20 | | IG-M12 | 24 | RBT24 | 26 | 24,5 | VS24 | | | |
| | 20 | | 25 | RBT25 | 27 | 25,5 | VS25 | | | |
| M24 | | IG-M16 | 28 | RBT28 | 30 | 28,5 | VS28 | | | |
| M27 | 25 | | 32 | RBT32 | 34 | 32,5 | VS32 | | | |
| M30 | 28 | IG-M20 | 35 | RBT35 | 37 | 35,5 | VS35 | | | |
| | 32 | | 40 | RBT40 | 41,5 | 40,5 | VS40 | | | |

Cleaning and installation tools

Hand pump

(Volume 750 ml, $h_0 \leq 10 d_s$, $d_0 \leq 20$ mm)



Compressed air tool

(min 6 bar)



Brush RBT



Piston Plug VS



Brush extension RBL



Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Intended Use

Cleaning and installation tools

Annex B 4

Table B5: Working time and curing time Fix Master FIT-Ve 200

| Temperature in base material | | | Maximum working time | Minimum curing time ¹⁾ |
|------------------------------|----|---------|----------------------|-----------------------------------|
| T | | | t_{gel} | t_{cure} |
| - 10 °C | to | - 6 °C | 90 min ²⁾ | 24 h |
| - 5 °C | to | - 1 °C | 90 min | 14 h |
| 0 °C | to | + 4 °C | 45 min | 7 h |
| + 5 °C | to | + 9 °C | 25 min | 2 h |
| + 10 °C | to | + 19 °C | 15 min | 80 min |
| + 20 °C | to | + 29 °C | 6 min | 45 min |
| + 30 °C | to | + 34 °C | 4 min | 25 min |
| + 35 °C | to | + 39 °C | 2 min | 20 min |
| +40°C | | | 1,5 min | 15 min |
| Cartridge temperature | | | +5°C to +40°C | |

1) The minimum curing time is only valid for dry base material.
In wet base material the curing time must be doubled.

2) Cartridge temperature must be at least +15°C

Table B6: Working time and curing time Fix Master FIT-Wi 200

| Temperature in base material | | | Maximum working time | Minimum curing time ¹⁾ |
|------------------------------|----|---------|----------------------|-----------------------------------|
| T | | | t_{gel} | t_{cure} |
| - 20 °C | to | - 16 °C | 75 min | 24 h |
| - 15 °C | to | - 11 °C | 55 min | 16 h |
| - 10 °C | to | - 6 °C | 35 min | 10 h |
| - 5 °C | to | - 1 °C | 20 min | 5 h |
| 0 °C | to | + 4 °C | 10 min | 2,5 h |
| + 5 °C | to | + 9 °C | 6 min | 80 min |
| + 10 °C | | | 6 min | 60 min |
| Cartridge temperature | | | -20°C to +10°C | |

1) The minimum curing time is only valid for dry base material.
In wet base material the curing time must be doubled.


Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Intended Use
Working time and curing time

Annex B 5


Installation instructions

Drilling of the bore hole

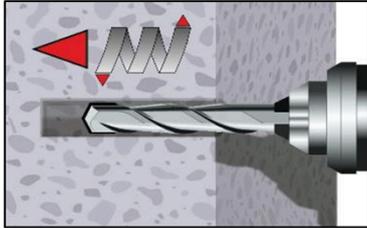

1a. Hammer drilling (HD) / Compressed air drilling (CD)

Drill a hole to the required embedment depth.
Drill bit diameter according to Table B1, B2 or B3.
Aborted drill holes shall be filled with mortar.
Proceed with Step 2 (CAC and MAC).

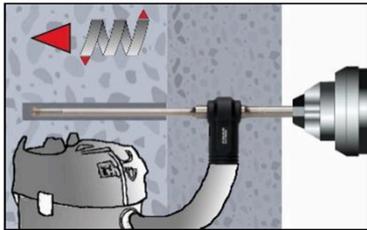


1b. Hollow drill bit system (HDB)

Drill a hole to the required embedment depth.
Drill bit diameter according to Table B1, B2 or B3.
Aborted drill holes shall be filled with mortar.
Proceed with Step 2 (CAC and MAC).


Attention! Standing water in the bore hole must be removed before cleaning

Manual Air Cleaning (MAC)


for bore hole diameter $d_0 \leq 20\text{mm}$ and bore hole depth $h_0 \leq 10d_{\text{nom}}$ ($d_0 < 14\text{mm}$ uncracked concrete only)
with drilling method HD, HDB and CD

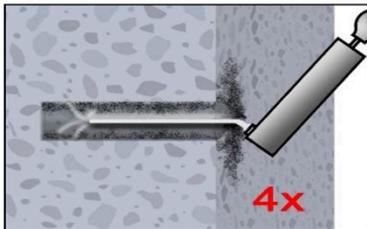

2a. Blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

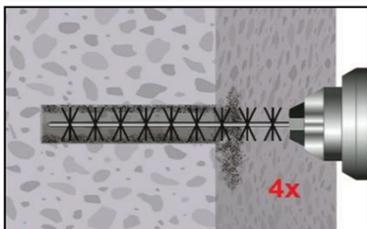

2b. Brush the bore hole minimum 4x with brush RBT according to Table B4 over the entire embedment depth in a twisting motion. (If necessary, a brush extension RBL shall be used.)

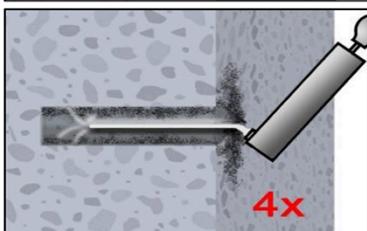

2c. Finally blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete


Intended Use
Installation instructions

Annex B 6


Installation instructions (continuation)

Compressed Air Cleaning (CAC):


All diameter with drilling method HD, HDB and CD

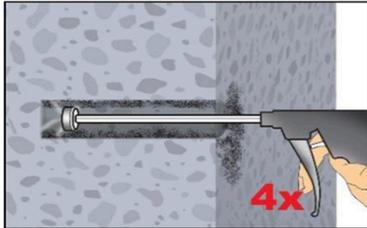

2a. Blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

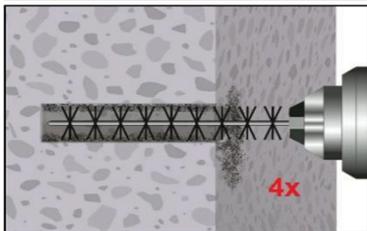


2b. Brush the bore hole minimum 4x with brush RBT according to Table B4 over the entire embedment depth in a twisting motion. (If necessary, a brush extension RBL shall be used.)

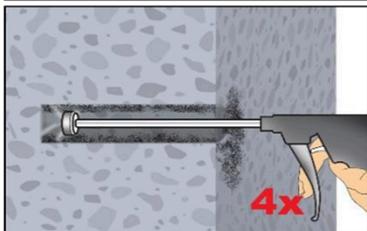


2c. Finally blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

**Cleaned bore hole has to be protected against re-contamination in an appropriate way,
If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**

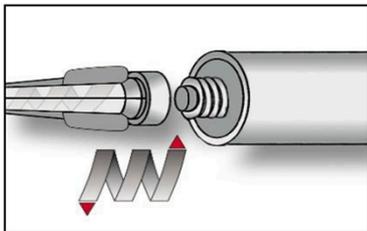

3. Screw on static-mixing nozzle CRW 14W/PM-19E and load the cartridge into an appropriate dispensing tool. With foil tube cartridges cut off the foil tube clip before use.
For every working interruption longer than the maximum working time t_{work} (Annex B 5) as well as for new cartridges, a new static-mixer shall be used.

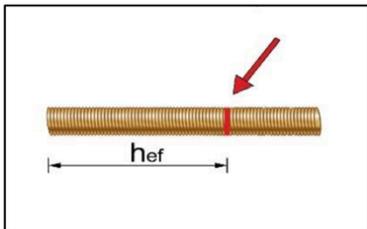


4. Mark embedment depth on the anchor rod.
The anchor rod shall be free of dirt, grease, oil or other foreign material.

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete


Intended Use
Installation instructions (continuation)

Annex B 7

Installation instructions (continuation)

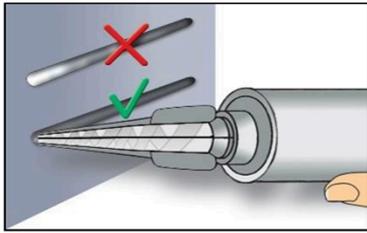


5. Not proper mixed mortar is not sufficient for fastening. Dispense and discard mortar until an uniform grey or red colour is shown (at least 3 full strokes, for foil tube cartridges at least 6 full strokes).

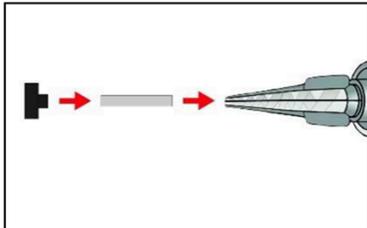


6. Piston plugs VS and mixer nozzle extensions VL shall be used according to Table B4 for the following applications:

- Horizontal and vertical downwards direction: Drill bit- \varnothing $d_0 \geq 18$ mm and embedment depth $h_{ef} > 250$ mm
- Vertical upwards direction: Drill bit- \varnothing $d_0 \geq 18$ mm


Assemble mixing nozzle, mixer extension and piston plug before injecting mortar.

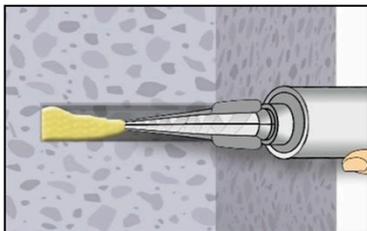

7a. **Injecting mortar without piston plug VS:**
Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) Slowly withdraw of the static mixing nozzle avoid creating air pockets. Observe the temperature related working time t_{work} (Annex B 5).

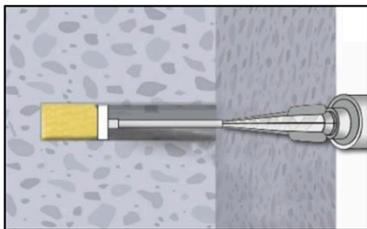

7b. **Injecting mortar with piston plug VS:**
Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) During injection the piston plug is pushed out of the bore hole by the back pressure of the mortar. Observe the temperature related working time t_{work} (Annex B 5).

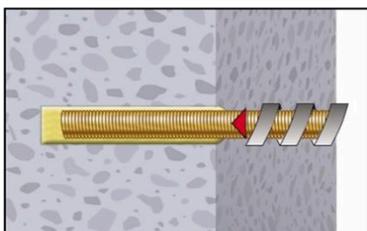


8. Insert the anchor rod while turning slightly up to the embedment mark.

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete


Intended Use
Installation instructions (continuation)

Annex B 8


Installation instructions (continuation)

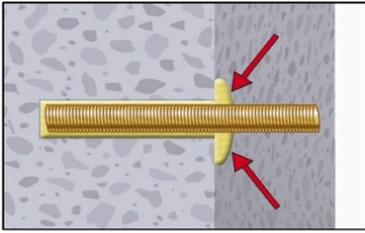


9. Annular gap between anchor rod and base material must be completely filled with mortar. In case of push through installation the annular gap in the fixture must be filled with mortar also. Otherwise, the installation must be repeated starting from step 7 before the maximum working time t_{work} has expired.

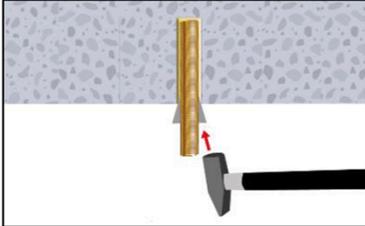

10. For application in vertical upwards direction the anchor rod shall be fixed (e.g. wedges).

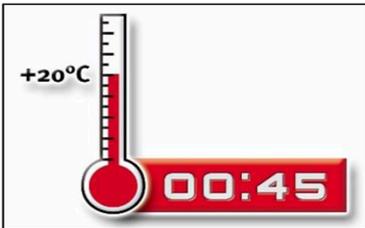

11. Temperature related curing time t_{cure} (Annex B 5) must be observed. Do not move or load the fastener during curing time.

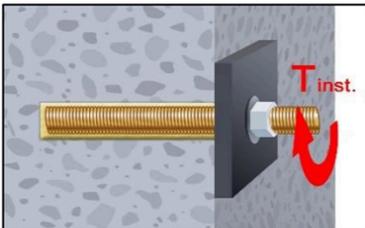

12. Install the fixture by using a calibrated torque wrench. Observe maximum installation torque (Table B1, B2 or B3). In case of static requirements (e.g. seismic), fill the annular gap in the fixture with mortar (Annex A 3). Therefore replace the washer by the filling washer VFS and use the mixer reduction nozzle MR.

Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete

Intended Use

Installation instructions (continuation)

Annex B 9

| Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods | | | | | | | | | | | |
|---|--|--------------------|-----------|------------|------------|------------|------------|------------|------------------|----------------|----------------|
| Threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Cross section area | A_s | [mm ²] | 36,6 | 58 | 84,3 | 157 | 245 | 353 | 459 | 561 | |
| Characteristic tension resistance, Steel failure ¹⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 4.8 | $N_{Rk,s}$ | [kN] | 15 (13) | 23 (21) | 34 | 63 | 98 | 141 | 184 | 224 | |
| Steel, Property class 5.6 and 5.8 | $N_{Rk,s}$ | [kN] | 18 (17) | 29 (27) | 42 | 78 | 122 | 176 | 230 | 280 | |
| Steel, Property class 8.8 | $N_{Rk,s}$ | [kN] | 29 (27) | 46 (43) | 67 | 125 | 196 | 282 | 368 | 449 | |
| Stainless steel A2, A4 and HCR, class 50 | $N_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 | |
| Stainless steel A2, A4 and HCR, class 70 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 171 | 247 | ⁻³⁾ | ⁻³⁾ | |
| Stainless steel A4 and HCR, class 80 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | ⁻³⁾ | ⁻³⁾ | |
| Characteristic tension resistance, Partial factor ²⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 5.6 | $\gamma_{Ms,N}$ | [-] | 2,0 | | | | | | | | |
| Steel, Property class 4.8, 5.8 and 8.8 | $\gamma_{Ms,N}$ | [-] | 1,5 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 50 | $\gamma_{Ms,N}$ | [-] | 2,86 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 70 | $\gamma_{Ms,N}$ | [-] | 1,87 | | | | | | | | |
| Stainless steel A4 and HCR, class 80 | $\gamma_{Ms,N}$ | [-] | 1,6 | | | | | | | | |
| Characteristic shear resistance, Steel failure ¹⁾ | | | | | | | | | | | |
| Without lever arm | Steel, Property class 4.6 and 4.8 | $V^0_{Rk,s}$ | [kN] | 9 (8) | 14 (13) | 20 | 38 | 59 | 85 | 110 | 135 |
| | Steel, Property class 5.6 and 5.8 | $V^0_{Rk,s}$ | [kN] | 11 (10) | 17 (16) | 25 | 47 | 74 | 106 | 138 | 168 |
| | Steel, Property class 8.8 | $V^0_{Rk,s}$ | [kN] | 15 (13) | 23 (21) | 34 | 63 | 98 | 141 | 184 | 224 |
| | Stainless steel A2, A4 and HCR, class 50 | $V^0_{Rk,s}$ | [kN] | 9 | 15 | 21 | 39 | 61 | 88 | 115 | 140 |
| | Stainless steel A2, A4 and HCR, class 70 | $V^0_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 | ⁻³⁾ | ⁻³⁾ |
| | Stainless steel A4 and HCR, class 80 | $V^0_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | ⁻³⁾ | ⁻³⁾ |
| With lever arm | Steel, Property class 4.6 and 4.8 | $M^0_{Rk,s}$ | [Nm] | 15 (13) | 30 (27) | 52 | 133 | 260 | 449 | 666 | 900 |
| | Steel, Property class 5.6 and 5.8 | $M^0_{Rk,s}$ | [Nm] | 19 (16) | 37 (33) | 65 | 166 | 324 | 560 | 833 | 1123 |
| | Steel, Property class 8.8 | $M^0_{Rk,s}$ | [Nm] | 30 (26) | 60 (53) | 105 | 266 | 519 | 896 | 1333 | 1797 |
| | Stainless steel A2, A4 and HCR, class 50 | $M^0_{Rk,s}$ | [Nm] | 19 | 37 | 66 | 167 | 325 | 561 | 832 | 1125 |
| | Stainless steel A2, A4 and HCR, class 70 | $M^0_{Rk,s}$ | [Nm] | 26 | 52 | 92 | 232 | 454 | 784 | ⁻³⁾ | ⁻³⁾ |
| | Stainless steel A4 and HCR, class 80 | $M^0_{Rk,s}$ | [Nm] | 30 | 59 | 105 | 266 | 519 | 896 | ⁻³⁾ | ⁻³⁾ |
| Characteristic shear resistance, Partial factor ²⁾ | | | | | | | | | | | |
| Steel, Property class 4.6 and 5.6 | $\gamma_{Ms,V}$ | [-] | 1,67 | | | | | | | | |
| Steel, Property class 4.8, 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 50 | $\gamma_{Ms,V}$ | [-] | 2,38 | | | | | | | | |
| Stainless steel A2, A4 and HCR, class 70 | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | | | | |
| Stainless steel A4 and HCR, class 80 | $\gamma_{Ms,V}$ | [-] | 1,33 | | | | | | | | |
| ¹⁾ Values are only valid for the given stress area A_s . Values in brackets are valid for undersized threaded rods with smaller stress area A_s for hot-dip galvanised threaded rods according to EN ISO 10684:2004+AC:2009. ²⁾ in absence of national regulation ³⁾ Fastener type not part of the ETA | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | Annex C 1 | | |
| Performances Characteristic values for steel tension resistance and steel shear resistance of threaded rods | | | | | | | | | | | |

| Table C2: Characteristic values of tension loads under static and quasi-static action | | | | |
|--|------------------------|----------------------------|---------------|--|
| Fastener | | All Anchor types and sizes | | |
| Concrete cone failure | | | | |
| Uncracked concrete | $k_{ucr,N}$ | [-] | 11,0 | |
| Cracked concrete | $k_{cr,N}$ | [-] | 7,7 | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | |
| Axial distance | $s_{cr,N}$ | [mm] | 2 $c_{cr,N}$ | |
| Splitting | | | | |
| Edge distance | $h/h_{ef} \geq 2,0$ | $c_{cr,sp}$ | [mm] | 1,0 h_{ef} |
| | $2,0 > h/h_{ef} > 1,3$ | | | $2 \cdot h_{ef} \left(2,5 - \frac{h}{h_{ef}} \right)$ |
| | $h/h_{ef} \leq 1,3$ | | | 2,4 h_{ef} |
| Axial distance | $s_{cr,sp}$ | [mm] | 2 $c_{cr,sp}$ | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | Annex C 2 | | |
| Performances Characteristic values for Concrete cone failure and Splitting with all kind of action | | | | |

| Table C3: Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | | | |
|---|-----------------|---|-----------------|--------------------------------------|-------------------------|-----|-----|-----|-------------------------|------------------|-----|-----|--|
| Threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | | |
| Steel failure | | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{UK}$ (or see Table C1) | | | | | | | | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | |
| Characteristic bond resistance in uncracked concrete C20/25 | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 10 | 12 | 12 | 12 | 12 | 11 | 10 | 9,0 | |
| | II: 80°C/50°C | | | | 7,5 | 9,0 | 9,0 | 9,0 | 9,0 | 8,5 | 7,5 | 6,5 | |
| | III: 120°C/72°C | | | | 5,5 | 6,5 | 6,5 | 6,5 | 6,5 | 6,5 | 5,5 | 5,0 | |
| | I: 40°C/24°C | flooded bore hole | | | 7,5 | 8,5 | 8,5 | 8,5 | No Performance Assessed | | | | |
| | II: 80°C/50°C | | | | 5,5 | 6,5 | 6,5 | 6,5 | | | | | |
| | III: 120°C/72°C | | | | 4,0 | 5,0 | 5,0 | 5,0 | | | | | |
| Characteristic bond resistance in cracked concrete C20/25 | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,cr}$ | [N/mm ²] | 4,0 | 5,0 | 5,5 | 5,5 | 5,5 | 5,5 | 6,5 | 6,5 | |
| | II: 80°C/50°C | | | | 2,5 | 3,5 | 4,0 | 4,0 | 4,0 | 4,0 | 4,5 | 4,5 | |
| | III: 120°C/72°C | | | | 2,0 | 2,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,5 | 3,5 | |
| | I: 40°C/24°C | flooded bore hole | | | 4,0 | 4,0 | 5,5 | 5,5 | No Performance Assessed | | | | |
| | II: 80°C/50°C | | | | 2,5 | 3,0 | 4,0 | 4,0 | | | | | |
| | III: 120°C/72°C | | | | 2,0 | 2,5 | 3,0 | 3,0 | | | | | |
| Reduktion factor ψ_{SUS}^0 in cracked and uncracked concrete C20/25 | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{SUS}^0 | [-] | 0,73 | | | | | | | | |
| | II: 80°C/50°C | | | | 0,65 | | | | | | | | |
| | III: 120°C/72°C | | | | 0,57 | | | | | | | | |
| Increasing factors for concrete | | ψ_c | [-] | $(f_{ck} / 20)^{0,11}$ | | | | | | | | | |
| Characteristic bond resistance depending on the concrete strength class | | $\tau_{Rk,ucr} =$ | | $\psi_c \cdot \tau_{Rk,ucr}(C20/25)$ | | | | | | | | | |
| | | $\tau_{Rk,cr} =$ | | $\psi_c \cdot \tau_{Rk,cr}(C20/25)$ | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | | |
| Splitting | | | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | |
| for dry and wet concrete | | γ_{inst} | [-] | 1,0 | 1,2 | | | | | | | | |
| for flooded bore hole | | | | 1,4 | No Performance Assessed | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | Annex C 3 | | | |
| Performances Characteristic values of tension loads under static and quasi-static action (Threaded rod) | | | | | | | | | | | | | |

Table C4: Characteristic values of shear loads under static and quasi-static action

| Threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
|---|------------------|--------------------|---|-----|-----|-----|-----|-----|------------------------------|------|--|
| Steel failure without lever arm | | | | | | | | | | | |
| Characteristic shear resistance Steel, strength class 4.6, 4.8, 5.6 and 5.8 | $V_{Rk,s}^0$ | [kN] | 0,6 · A _s · f _{uk} (or see Table C1) | | | | | | | | |
| Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all classes | $V_{Rk,s}^0$ | [kN] | 0,5 · A _s · f _{uk} (or see Table C1) | | | | | | | | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | |
| Ductility factor | k ₇ | [-] | 1,0 | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s}^0$ | [Nm] | 1,2 · W _{el} · f _{uk} (or see Table C1) | | | | | | | | |
| Elastic section modulus | W _{el} | [mm ³] | 31 | 62 | 109 | 277 | 541 | 935 | 1387 | 1874 | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | |
| Factor | k ₈ | [-] | 2,0 | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | |
| Effective length of fastener | l _f | [mm] | min(h _{ef} ; 12 · d _{nom}) | | | | | | min(h _{ef} ; 300mm) | | |
| Outside diameter of fastener | d _{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | | |
| Performances Characteristic values of shear loads under static and quasi-static action (Threaded rod) | | | | | | | | | | | |
| Annex C 4 | | | | | | | | | | | |

| Table C5: Characteristic values of tension loads under static and quasi-static action | | | | | | | | | | | |
|---|-----------------|---|-------------------|----------------------|--------------------------------------|-------------------------|---------------|-------------------------|---------------|-----|--|
| Internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | | |
| Steel failure¹⁾ | | | | | | | | | | | |
| Characteristic tension resistance, | 5.8 | $N_{Rk,s}$ | [kN] | 10 | 17 | 29 | 42 | 76 | 123 | | |
| Steel, strength class | 8.8 | $N_{Rk,s}$ | [kN] | 16 | 27 | 46 | 67 | 121 | 196 | | |
| Partial factor, strength class 5.8 and 8.8 | | $\gamma_{Ms,N}$ | [-] | 1,5 | | | | | | | |
| Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $N_{Rk,s}$ | [kN] | 14 | 26 | 41 | 59 | 110 | 124 | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | 1,87 | | | | | | | |
| Combined pull-out and concrete cone failure | | | | | | | | | | | |
| Characteristic bond resistance in uncracked concrete C20/25 | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 12 | 12 | 12 | 12 | 11 | 9,0 | |
| | II: 80°C/50°C | | | | 9,0 | 9,0 | 9,0 | 9,0 | 8,5 | 6,5 | |
| | III: 120°C/72°C | | | | 6,5 | 6,5 | 6,5 | 6,5 | 6,5 | 5,0 | |
| | I: 40°C/24°C | flooded bore hole | | | 8,5 | 8,5 | 8,5 | No Performance Assessed | | | |
| | II: 80°C/50°C | | | | 6,5 | 6,5 | 6,5 | | | | |
| | III: 120°C/72°C | | | | 5,0 | 5,0 | 5,0 | | | | |
| Characteristic bond resistance in cracked concrete C20/25 | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,cr}$ | [N/mm ²] | 5,0 | 5,5 | 5,5 | 5,5 | 5,5 | 6,5 | |
| | II: 80°C/50°C | | | | 3,5 | 4,0 | 4,0 | 4,0 | 4,0 | 4,5 | |
| | III: 120°C/72°C | | | | 2,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,5 | |
| | I: 40°C/24°C | flooded bore hole | | | 4,0 | 5,5 | 5,5 | No Performance Assessed | | | |
| | II: 80°C/50°C | | | | 3,0 | 4,0 | 4,0 | | | | |
| | III: 120°C/72°C | | | | 2,5 | 3,0 | 3,0 | | | | |
| Reduktion factor ψ_{SUS}^0 in cracked and uncracked concrete C20/25 | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{SUS}^0 | [-] | 0,73 | | | | | | |
| | II: 80°C/50°C | | | | 0,65 | | | | | | |
| | III: 120°C/72°C | | | | 0,57 | | | | | | |
| Increasing factors for concrete | | | ψ_c | [-] | $(f_{ck} / 20)^{0,11}$ | | | | | | |
| Characteristic bond resistance depending on the concrete strength class | | | $\tau_{Rk,ucr} =$ | | $\psi_c \cdot \tau_{Rk,ucr}(C20/25)$ | | | | | | |
| | | | $\tau_{Rk,cr} =$ | | $\psi_c \cdot \tau_{Rk,cr}(C20/25)$ | | | | | | |
| Concrete cone failure | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | |
| Splitting failure | | | | | | | | | | | |
| Relevant parameter | | | | see Table C2 | | | | | | | |
| Installation factor | | | | | | | | | | | |
| for dry and wet concrete | | | γ_{inst} | [-] | 1,2 | | | | | | |
| for flooded bore hole | | | | | 1,4 | No Performance Assessed | | | | | |
| ¹⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ²⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | Annex C 5 | | | |
| Performances Characteristic values of tension loads under static and quasi-static action (Internal threaded anchor rod) | | | | | | | | | | | |

| Table C6: Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | |
|--|-----------------|-----------------|----------------------------------|--------------|--------------|---------------|---------------|------------------------------|---------------|--|
| Internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
| Steel failure without lever arm¹⁾ | | | | | | | | | | |
| Characteristic shear resistance, Steel, strength class | 5.8 | $V_{Rk,s}^0$ | [kN] | 5 | 9 | 15 | 21 | 38 | 61 | |
| | 8.8 | $V_{Rk,s}^0$ | [kN] | 8 | 14 | 23 | 34 | 60 | 98 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | |
| Characteristic shear resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $V_{Rk,s}^0$ | [kN] | 7 | 13 | 20 | 30 | 55 | 40 | |
| | Partial factor | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | 2,38 | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | |
| Steel failure with lever arm¹⁾ | | | | | | | | | | |
| Characteristic bending moment, Steel, strength class | 5.8 | $M_{Rk,s}^0$ | [Nm] | 8 | 19 | 37 | 66 | 167 | 325 | |
| | 8.8 | $M_{Rk,s}^0$ | [Nm] | 12 | 30 | 60 | 105 | 267 | 519 | |
| Partial factor, strength class 5.8 and 8.8 | $\gamma_{Ms,V}$ | [-] | 1,25 | | | | | | | |
| Characteristic bending moment, Stainless Steel A4 and HCR, Strength class 70 ²⁾ | | $M_{Rk,s}^0$ | [Nm] | 11 | 26 | 52 | 92 | 233 | 456 | |
| | Partial factor | $\gamma_{Ms,V}$ | [-] | 1,56 | | | | | 2,38 | |
| Concrete pry-out failure | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Concrete edge failure | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | $\min(h_{ef}; 300\text{mm})$ | | |
| Outside diameter of fastener | d_{nom} | [mm] | 10 | 12 | 16 | 20 | 24 | 30 | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| ¹⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ²⁾ For IG-M20 strength class 50 is valid | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | Annex C 6 | | |
| Performances Characteristic values of shear loads under static and quasi-static action (Internal threaded anchor rod) | | | | | | | | | | |

Table C7: Characteristic values of tension loads under static and quasi-static action

| Reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | | | |
|--|-----------------|---|-------------------------|----------------------|--------------------------------------|------|------|------|------|-------------------------|-------------------------|-----|-----|--|
| Steel failure | | | | | | | | | | | | | | |
| Characteristic tension resistance | $N_{Rk,s}$ | [kN] | $A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 491 | 616 | 804 | | | |
| Partial factor | $\gamma_{Ms,N}$ | [-] | 1,4 ²⁾ | | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | | |
| Characteristic bond resistance in uncracked concrete C20/25 | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,ucr}$ | [N/mm ²] | 10 | 12 | 12 | 12 | 12 | 12 | 11 | 10 | 8,5 | |
| | II: 80°C/50°C | | | | 7,5 | 9,0 | 9,0 | 9,0 | 9,0 | 9,0 | 8,0 | 7,0 | 6,0 | |
| | III: 120°C/72°C | | | | 5,5 | 6,5 | 6,5 | 6,5 | 6,5 | 6,5 | 6,0 | 5,0 | 4,5 | |
| | I: 40°C/24°C | flooded bore hole | | | 7,5 | 8,5 | 8,5 | 8,5 | 8,5 | No Performance Assessed | | | | |
| | II: 80°C/50°C | | | | 5,5 | 6,5 | 6,5 | 6,5 | 6,5 | | | | | |
| | III: 120°C/72°C | | | | 4,0 | 5,0 | 5,0 | 5,0 | 5,0 | | | | | |
| Characteristic bond resistance in cracked concrete C20/25 | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,cr}$ | [N/mm ²] | 4,0 | 5,0 | 5,5 | 5,5 | 5,5 | 5,5 | 5,5 | 6,5 | 6,5 | |
| | II: 80°C/50°C | | | | 2,5 | 3,5 | 4,0 | 4,0 | 4,0 | 4,0 | 4,0 | 4,5 | 4,5 | |
| | III: 120°C/72°C | | | | 2,0 | 2,5 | 3,0 | 3,0 | 3,0 | 3,0 | 3,0 | 3,5 | 3,5 | |
| | I: 40°C/24°C | flooded bore hole | | | 4,0 | 4,0 | 5,5 | 5,5 | 5,5 | No Performance Assessed | | | | |
| | II: 80°C/50°C | | | | 2,5 | 3,0 | 4,0 | 4,0 | 4,0 | | | | | |
| | III: 120°C/72°C | | | | 2,0 | 2,5 | 3,0 | 3,0 | 3,0 | | | | | |
| Reduktion factor ψ_{SUS}^0 in cracked and uncracked concrete C20/25 | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete and flooded bore hole | ψ_{SUS}^0 | [-] | 0,73 | | | | | | | | | |
| | II: 80°C/50°C | | | | 0,65 | | | | | | | | | |
| | III: 120°C/72°C | | | | 0,57 | | | | | | | | | |
| Increasing factors for concrete | | | ψ_c | [-] | $(f_{ck} / 20)^{0,11}$ | | | | | | | | | |
| Characteristic bond resistance depending on the concrete strength class | | | $\tau_{Rk,ucr} =$ | | $\psi_c \cdot \tau_{Rk,ucr}(C20/25)$ | | | | | | | | | |
| | | | $\tau_{Rk,cr} =$ | | $\psi_c \cdot \tau_{Rk,cr}(C20/25)$ | | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | |
| Splitting | | | | | | | | | | | | | | |
| Relevant parameter | | | see Table C2 | | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | | |
| for dry and wet concrete | | | γ_{inst} | [-] | 1,0 | 1,2 | | | | | | | | |
| for flooded bore hole | | | | | 1,4 | | | | | | No Performance Assessed | | | |
| ¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars ²⁾ in absence of national regulation | | | | | | | | | | | | | | |

| | |
|--|------------------|
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | Annex C 7 |
| Performances Characteristic values of tension loads under static and quasi-static action (Reinforcing bar) | |

| Table C8: Characteristic values of shear loads under static and quasi-static action | | | | | | | | | | | | |
|--|-----------------|--------------------|--------------------------------------|------|------|------|------|------|------------------------------|------------------|------|--|
| Reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | |
| Steel failure without lever arm | | | | | | | | | | | | |
| Characteristic shear resistance | $V_{Rk,s}^0$ | [kN] | $0,50 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | |
| Cross section area | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 491 | 616 | 804 | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,5 ²⁾ | | | | | | | | | |
| Ductility factor | k_7 | [-] | 1,0 | | | | | | | | | |
| Steel failure with lever arm | | | | | | | | | | | | |
| Characteristic bending moment | $M_{Rk,s}^0$ | [Nm] | $1,2 \cdot W_{el} \cdot f_{uk}^{1)}$ | | | | | | | | | |
| Elastic section modulus | W_{el} | [mm ³] | 50 | 98 | 170 | 269 | 402 | 785 | 1534 | 2155 | 3217 | |
| Partial factor | $\gamma_{Ms,V}$ | [-] | 1,5 ²⁾ | | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | | |
| Factor | k_8 | [-] | 2,0 | | | | | | | | | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | |
| Concrete edge failure | | | | | | | | | | | | |
| Effective length of fastener | l_f | [mm] | $\min(h_{ef}; 12 \cdot d_{nom})$ | | | | | | $\min(h_{ef}; 300\text{mm})$ | | | |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 14 | 16 | 20 | 25 | 28 | 32 | |
| Installation factor | γ_{inst} | [-] | 1,0 | | | | | | | | | |
| <p>¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars</p> <p>²⁾ in absence of national regulation</p> | | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | Annex C 8 | | |
| Performances Characteristic values of shear loads under static and quasi-static action (Reinforcing bar) | | | | | | | | | | | | |

| Table C9: Displacements under tension load¹⁾ | | | | | | | | | | |
|---|----------------------------|---------------------------|-------|-------|-------|-------|-------|------------------|-------|-------|
| Threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Uncracked concrete C20/25 under static and quasi-static action | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,021 | 0,023 | 0,026 | 0,031 | 0,036 | 0,041 | 0,045 | 0,049 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,030 | 0,033 | 0,037 | 0,045 | 0,052 | 0,060 | 0,065 | 0,071 |
| Temperature range II: 80°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,050 | 0,056 | 0,063 | 0,075 | 0,088 | 0,100 | 0,110 | 0,119 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,072 | 0,081 | 0,090 | 0,108 | 0,127 | 0,145 | 0,159 | 0,172 |
| Temperature range III: 120°C/72°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,050 | 0,056 | 0,063 | 0,075 | 0,088 | 0,100 | 0,110 | 0,119 |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,072 | 0,081 | 0,090 | 0,108 | 0,127 | 0,145 | 0,159 | 0,172 |
| Cracked concrete C20/25 under static and quasi-static action | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,090 | | 0,070 | | | | | |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,105 | | 0,105 | | | | | |
| Temperature range II: 80°C/50°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,219 | | 0,170 | | | | | |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,255 | | 0,245 | | | | | |
| Temperature range III: 120°C/72°C | δ_{N0} -factor | [mm/(N/mm ²)] | 0,219 | | 0,170 | | | | | |
| | $\delta_{N\infty}$ -factor | [mm/(N/mm ²)] | 0,255 | | 0,245 | | | | | |
| ¹⁾ Calculation of the displacement $\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau$; τ : action bond stress for tension $\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau$; | | | | | | | | | | |
| Table C10: Displacements under shear load¹⁾ | | | | | | | | | | |
| Threaded rod | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Uncracked concrete C20/25 under static and quasi-static action | | | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,06 | 0,06 | 0,05 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,05 |
| Cracked concrete C20/25 under static and quasi-static action | | | | | | | | | | |
| All temperature ranges | δ_{V0} -factor | [mm/kN] | 0,12 | 0,12 | 0,11 | 0,10 | 0,09 | 0,08 | 0,08 | 0,07 |
| | $\delta_{V\infty}$ -factor | [mm/kN] | 0,18 | 0,18 | 0,17 | 0,15 | 0,14 | 0,13 | 0,12 | 0,10 |
| ¹⁾ Calculation of the displacement $\delta_{V0} = \delta_{V0}\text{-factor} \cdot V$; V: action shear load $\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V$; | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | Annex C 9 | | |
| Performances Displacements under static and quasi-static action (threaded rods) | | | | | | | | | | |

| Table C13: Displacements under tension load¹⁾ (rebar) | | | | | | | | | | | |
|---|-------------------------|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------------------|-------|
| Anchor size reinforcing bar | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | |
| Uncracked concrete C20/25 under static and quasi-static action | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,021 | 0,023 | 0,026 | 0,028 | 0,031 | 0,036 | 0,043 | 0,047 | 0,052 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,030 | 0,033 | 0,037 | 0,041 | 0,045 | 0,052 | 0,061 | 0,071 | 0,075 |
| Temperature range II: 80°C/50°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,050 | 0,056 | 0,063 | 0,069 | 0,075 | 0,088 | 0,104 | 0,113 | 0,126 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,072 | 0,081 | 0,090 | 0,099 | 0,108 | 0,127 | 0,149 | 0,163 | 0,181 |
| Temperature range III: 120°C/72°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,050 | 0,056 | 0,063 | 0,069 | 0,075 | 0,088 | 0,104 | 0,113 | 0,126 |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,072 | 0,081 | 0,090 | 0,099 | 0,108 | 0,127 | 0,149 | 0,163 | 0,181 |
| Cracked concrete C20/25 under static and quasi-static action | | | | | | | | | | | |
| Temperature range I: 40°C/24°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,090 | | | 0,070 | | | | | |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,105 | | | 0,105 | | | | | |
| Temperature range II: 80°C/50°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,219 | | | 0,170 | | | | | |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,255 | | | 0,245 | | | | | |
| Temperature range III: 120°C/72°C | δ _{N0} -factor | [mm/(N/mm ²)] | 0,219 | | | 0,170 | | | | | |
| | δ _{N∞} -factor | [mm/(N/mm ²)] | 0,255 | | | 0,245 | | | | | |
| ¹⁾ Calculation of the displacement $\delta_{N0} = \delta_{N0\text{-factor}} \cdot \tau;$ τ : action bond stress for tension $\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot \tau;$ | | | | | | | | | | | |
| Table C14: Displacement under shear load¹⁾ (rebar) | | | | | | | | | | | |
| Anchor size reinforcing bar | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | |
| Uncracked concrete C20/25 under static and quasi-static action | | | | | | | | | | | |
| All temperature ranges | δ _{V0} -factor | [mm/kN] | 0,06 | 0,05 | 0,05 | 0,04 | 0,04 | 0,04 | 0,03 | 0,03 | 0,03 |
| | δ _{V∞} -factor | [mm/kN] | 0,09 | 0,08 | 0,08 | 0,06 | 0,06 | 0,05 | 0,05 | 0,04 | 0,04 |
| Cracked concrete C20/25 under static and quasi-static action | | | | | | | | | | | |
| All temperature ranges | δ _{V0} -factor | [mm/kN] | 0,12 | 0,12 | 0,11 | 0,11 | 0,10 | 0,09 | 0,08 | 0,07 | 0,06 |
| | δ _{V∞} -factor | [mm/kN] | 0,18 | 0,18 | 0,17 | 0,16 | 0,15 | 0,14 | 0,12 | 0,11 | 0,10 |
| ¹⁾ Calculation of the displacement $\delta_{V0} = \delta_{V0\text{-factor}} \cdot V;$ V : action shear load $\delta_{V\infty} = \delta_{V\infty\text{-factor}} \cdot V;$ | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | Annex C 11 | |
| Performances Displacements under static and quasi-static action (Reinforcing bar) | | | | | | | | | | | |

| Table C15: Characteristic values of tension loads under seismic action (performance category C1) | | | | | | | | | | | | | |
|---|-----------------|---------------------|-------------------|--|-------------------------|-----|-----|-----|-------------------------|-------------------|-----|-----|--|
| Threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | | |
| Steel failure | | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s,eq,C1}$ | [kN] | $1,0 \cdot N_{Rk,s}$ | | | | | | | | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | see Table C1 | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | |
| Characteristic bond resistance in uncracked and cracked concrete C20/25 | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,eq,C1}$ | [N/mm ²] | 2,5 | 3,1 | 3,7 | 3,7 | 3,7 | 3,8 | 4,5 | 4,5 | |
| | II: 80°C/50°C | | | | 1,6 | 2,2 | 2,7 | 2,7 | 2,7 | 2,8 | 3,1 | 3,1 | |
| | III: 120°C/72°C | | | | 1,3 | 1,6 | 2,0 | 2,0 | 2,0 | 2,1 | 2,4 | 2,4 | |
| | I: 40°C/24°C | flooded bore hole | | | 2,5 | 2,5 | 3,7 | 3,7 | No Performance Assessed | | | | |
| | II: 80°C/50°C | | | | 1,6 | 1,9 | 2,7 | 2,7 | | | | | |
| | III: 120°C/72°C | | | | 1,3 | 1,6 | 2,0 | 2,0 | | | | | |
| Increasing factors for concrete | | Ψ_c | [-] | 1,0 | | | | | | | | | |
| Characteristic bond resistance depending on the concrete strength class | | $\tau_{Rk,eq,C1} =$ | | $\Psi_c \cdot \tau_{Rk,eq,C1}(C20/25)$ | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | |
| for dry and wet concrete | | γ_{inst} | [-] | 1,0 | 1,2 | | | | | | | | |
| for flooded bore hole | | | | 1,4 | No Performance Assessed | | | | | | | | |
| Table C16: Characteristic values of shear loads under seismic action (performance category C1) | | | | | | | | | | | | | |
| Threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | | |
| Steel failure without lever arm | | | | | | | | | | | | | |
| Characteristic shear resistance (Seismic C1) | | $V_{Rk,s,eq,C1}$ | [kN] | $0,70 \cdot V^0_{Rk,s}$ | | | | | | | | | |
| Partial factor | | $\gamma_{Ms,V}$ | [-] | see Table C1 | | | | | | | | | |
| Factor for annular gap | | α_{gap} | [-] | $0,5 (1,0)^1$ | | | | | | | | | |
| ¹⁾ Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended | | | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | Annex C 12 | | | |
| Performances Characteristic values of tension loads and shear loads under seismic action (performance category C1) (Threaded rod) | | | | | | | | | | | | | |

| Table C17: Characteristic values of tension loads under seismic action (performance category C1) | | | | | | | | | | | | | | |
|--|-----------------|---------------------|--------------------|--|-------------------------|------|------|------|------|------|-------------------|-----|-----|-------------------------|
| Reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | | | |
| Steel failure | | | | | | | | | | | | | | |
| Characteristic tension resistance | | $N_{Rk,s,eq,C1}$ | [kN] | $1,0 \cdot A_s \cdot f_{uk}^{1)}$ | | | | | | | | | | |
| Cross section area | | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 491 | 616 | 804 | | |
| Partial factor | | $\gamma_{Ms,N}$ | [-] | $1,4^{2)}$ | | | | | | | | | | |
| Combined pull-out and concrete failure | | | | | | | | | | | | | | |
| Characteristic bond resistance in uncracked and cracked concrete C20/25 | | | | | | | | | | | | | | |
| Temperature range | I: 40°C/24°C | Dry, wet concrete | $\tau_{Rk,eq,C1}$ | [N/mm ²] | 2,5 | 3,1 | 3,7 | 3,7 | 3,7 | 3,7 | 3,8 | 4,5 | 4,5 | No Performance Assessed |
| | II: 80°C/50°C | | | | 1,6 | 2,2 | 2,7 | 2,7 | 2,7 | 2,7 | 2,8 | 3,1 | 3,1 | |
| | III: 120°C/72°C | | | | 1,3 | 1,6 | 2,0 | 2,0 | 2,0 | 2,0 | 2,1 | 2,4 | 2,4 | |
| | I: 40°C/24°C | flooded bore hole | | | 2,5 | 2,5 | 3,7 | 3,7 | 3,7 | | | | | |
| | II: 80°C/50°C | | | | 1,6 | 1,9 | 2,7 | 2,7 | 2,7 | | | | | |
| | III: 120°C/72°C | | | | 1,3 | 1,6 | 2,0 | 2,0 | 2,0 | | | | | |
| Increasing factors for concrete | | ψ_c | [-] | 1,0 | | | | | | | | | | |
| Characteristic bond resistance depending on the concrete strength class | | $\tau_{Rk,eq,C1} =$ | | $\psi_c \cdot \tau_{Rk,eq,C1}(C20/25)$ | | | | | | | | | | |
| Installation factor | | | | | | | | | | | | | | |
| for dry and wet concrete | | γ_{inst} | [-] | 1,2 | 1,2 | | | | | | | | | |
| for flooded bore hole | | | | 1,4 | No Performance Assessed | | | | | | | | | |
| 1) f_{uk} shall be taken from the specifications of reinforcing bars | | | | | | | | | | | | | | |
| 2) in absence of national regulation | | | | | | | | | | | | | | |
| Table C18: Characteristic values of shear loads under seismic action (performance category C1) | | | | | | | | | | | | | | |
| Reinforcing bar | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 25 | Ø 28 | Ø 32 | | | |
| Steel failure without lever arm | | | | | | | | | | | | | | |
| Characteristic shear resistance | | $V_{Rk,s,eq,C1}$ | [kN] | $0,35 \cdot A_s \cdot f_{uk}^{2)}$ | | | | | | | | | | |
| Cross section area | | A_s | [mm ²] | 50 | 79 | 113 | 154 | 201 | 314 | 491 | 616 | 804 | | |
| Partial factor | | $\gamma_{Ms,V}$ | [-] | $1,5^{2)}$ | | | | | | | | | | |
| Factor for annular gap | | α_{gap} | [-] | $0,5 (1,0)^3)$ | | | | | | | | | | |
| 1) f_{uk} shall be taken from the specifications of reinforcing bars | | | | | | | | | | | | | | |
| 2) in absence of national regulation | | | | | | | | | | | | | | |
| 3) Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended | | | | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | | Annex C 13 | | | |
| Performances Characteristic values of tension loads and shear loads under seismic action (performance category C1) (Reinforcing bar) | | | | | | | | | | | | | | |

| Table C19: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | |
|--|------------------------|----------------------|---|-----|--|-----|-----|------|------|-------------------|------|------|
| Threaded rod | | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 | |
| Steel failure | | | | | | | | | | | | |
| Characteristic tension resistance; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher | $N_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 1,1 | 1,7 | 3,0 | 5,7 | 8,8 | 12,7 | 16,5 | 20,2 |
| | | | | 60 | 0,9 | 1,4 | 2,3 | 4,2 | 6,6 | 9,5 | 12,4 | 15,1 |
| | | | | 90 | 0,7 | 1,0 | 1,6 | 3,0 | 4,7 | 6,7 | 8,7 | 10,7 |
| | | | | 120 | 0,5 | 0,8 | 1,2 | 2,2 | 3,4 | 4,9 | 6,4 | 7,9 |
| Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ | | | | | | | | | | | | |
| Temperature reduction factor | $k_{fi,p}(\theta)$ | [-] | $\theta < 21^\circ\text{C}$ | | 1,0 | | | | | | | |
| | | | $21^\circ\text{C} \leq \theta \leq 331^\circ\text{C}$ | | $589,7 \cdot \theta^{-1,726} \leq 1,0$ | | | | | | | |
| | | | $\theta > 331^\circ\text{C}$ | | 0,0 | | | | | | | |
| | | | | | | | | | | | | |
| Characteristic bond resistance for a given temperature (θ) | $\tau_{Rk,fi}(\theta)$ | [N/mm ²] | $k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$ | | | | | | | | | |
| Steel failure without lever arm | | | | | | | | | | | | |
| Characteristic shear resistance; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher | $V_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 1,1 | 1,7 | 3,0 | 5,7 | 8,8 | 12,7 | 16,5 | 20,2 |
| | | | | 60 | 0,9 | 1,4 | 2,3 | 4,2 | 6,6 | 9,5 | 12,4 | 15,1 |
| | | | | 90 | 0,7 | 1,0 | 1,6 | 3,0 | 4,7 | 6,7 | 8,7 | 10,7 |
| | | | | 120 | 0,5 | 0,8 | 1,2 | 2,2 | 3,4 | 4,9 | 6,4 | 7,9 |
| Steel failure with lever arm | | | | | | | | | | | | |
| Characteristic bending moment; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher | $M^0_{Rk,s,fi}$ | [Nm] | Fire exposure time [min] | 30 | 1,1 | 2,2 | 4,7 | 12,0 | 23,4 | 40,4 | 59,9 | 81,0 |
| | | | | 60 | 0,9 | 1,8 | 3,5 | 9,0 | 17,5 | 30,3 | 44,9 | 60,7 |
| | | | | 90 | 0,7 | 1,3 | 2,5 | 6,3 | 12,3 | 21,3 | 31,6 | 42,7 |
| | | | | 120 | 0,5 | 1,0 | 1,8 | 4,7 | 9,1 | 15,7 | 23,3 | 31,5 |
| 1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range | | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | Annex C 14 | | |
| Performances Characteristic values of tension and shear loads under fire exposure (internal threaded anchor rod) | | | | | | | | | | | | |

| Table C20: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | |
|--|------------------------|----------------------|---|--------------|--|---------------|---------------|-------------------|---------------|------|
| Internal threaded anchor rods | | | | IG-M6 | IG-M8 | IG-M10 | IG-M12 | IG-M16 | IG-M20 | |
| Steel failure | | | | | | | | | | |
| Characteristic tension resistance; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70 | $N_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 0,3 | 1,1 | 1,7 | 3,0 | 5,7 | 8,8 |
| | | | | 60 | 0,2 | 0,9 | 1,4 | 2,3 | 4,2 | 6,6 |
| | | | | 90 | 0,2 | 0,7 | 1,0 | 1,6 | 3,0 | 4,7 |
| | | | | 120 | 0,1 | 0,5 | 0,8 | 1,2 | 2,2 | 3,4 |
| Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ | | | | | | | | | | |
| Temperature reduction factor | $k_{fi,p}(\theta)$ | [-] | $\theta < 21^\circ\text{C}$ | | 1,0 | | | | | |
| | | | $21^\circ\text{C} \leq \theta \leq 331^\circ\text{C}$ | | $589,7 \cdot \theta^{-1,726} \leq 1,0$ | | | | | |
| | | | $\theta > 331^\circ\text{C}$ | | 0,0 | | | | | |
| | | | | | | | | | | |
| Characteristic bond resistance for a given temperature (θ) | $\tau_{Rk,fi}(\theta)$ | [N/mm ²] | $k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$ | | | | | | | |
| Steel failure without lever arm | | | | | | | | | | |
| Characteristic shear resistance; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70 | $V_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 0,3 | 1,1 | 1,7 | 3,0 | 5,7 | 8,8 |
| | | | | 60 | 0,2 | 0,9 | 1,4 | 2,3 | 4,2 | 6,6 |
| | | | | 90 | 0,2 | 0,7 | 1,0 | 1,6 | 3,0 | 4,7 |
| | | | | 120 | 0,1 | 0,5 | 0,8 | 1,2 | 2,2 | 3,4 |
| Steel failure with lever arm | | | | | | | | | | |
| Characteristic bending moment; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70 | $M^0_{Rk,s,fi}$ | [Nm] | Fire exposure time [min] | 30 | 0,2 | 1,1 | 2,2 | 4,7 | 12,0 | 23,4 |
| | | | | 60 | 0,2 | 0,9 | 1,8 | 3,5 | 9,0 | 17,5 |
| | | | | 90 | 0,1 | 0,7 | 1,3 | 2,5 | 6,3 | 12,3 |
| | | | | 120 | 0,1 | 0,5 | 1,0 | 1,8 | 4,7 | 9,1 |
| 1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | Annex C 15 | | |
| Performances Characteristic values of tension and shear loads under fire exposure (internal threaded anchor rod) | | | | | | | | | | |

| Table C21: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB) | | | | | | | | | | | | | | |
|---|------------------------|----------------------|---|-----|---|------|------|------|------|------|------|-------------------|------|------|
| Reinforcing bar | | | | Ø 8 | Ø 10 | Ø 12 | Ø 14 | Ø 16 | Ø 20 | Ø 24 | Ø 25 | Ø 28 | Ø 32 | |
| Steel failure | | | | | | | | | | | | | | |
| Characteristic tension resistance; BSt 500 | $N_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 0,5 | 1,2 | 2,3 | 3,1 | 4,0 | 6,3 | 9,0 | 9,8 | 12,3 | 16,1 |
| | | | | 60 | 0,5 | 1,0 | 1,7 | 2,3 | 3,0 | 4,7 | 6,8 | 7,4 | 9,2 | 12,1 |
| | | | | 90 | 0,4 | 0,8 | 1,5 | 2,0 | 2,6 | 4,1 | 5,9 | 6,4 | 8,0 | 10,5 |
| | | | | 120 | 0,3 | 0,6 | 1,1 | 1,5 | 2,0 | 3,1 | 4,5 | 4,9 | 6,2 | 8,0 |
| Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ | | | | | | | | | | | | | | |
| Temperature reduction factor | $k_{fi,p}(\theta)$ | [-] | $\theta < 21^\circ\text{C}$ | | 1,0 | | | | | | | | | |
| | | | $21^\circ\text{C} \leq \theta \leq 243^\circ\text{C}$ | | $0,81 \cdot e^{-0,016 \cdot \theta} \leq 1,0$ | | | | | | | | | |
| | | | $\theta > 243^\circ\text{C}$ | | 0,0 | | | | | | | | | |
| <p>The graph shows the reduction factor $k_{fi}(\theta)$ on the y-axis (ranging from 0.0 to 1.0) against temperature θ in °C on the x-axis (ranging from 0 to 300). The curve is constant at 1.0 until θ_k (approximately 21°C), then drops to 0.6 at θ_k. From θ_k, the curve decays exponentially towards 0 as temperature increases, reaching 0 at θ_{max} (approximately 243°C).</p> | | | | | | | | | | | | | | |
| Characteristic bond resistance for a given temperature (θ) | $\tau_{Rk,fi}(\theta)$ | [N/mm ²] | $k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$ | | | | | | | | | | | |
| Steel failure without lever arm | | | | | | | | | | | | | | |
| Characteristic shear resistance; BSt 500 | $V_{Rk,s,fi}$ | [kN] | Fire exposure time [min] | 30 | 0,5 | 1,2 | 2,3 | 3,1 | 4,0 | 6,3 | 9,0 | 9,8 | 12,3 | 16,1 |
| | | | | 60 | 0,5 | 1,0 | 1,7 | 2,3 | 3,0 | 4,7 | 6,8 | 7,4 | 9,2 | 12,1 |
| | | | | 90 | 0,4 | 0,8 | 1,5 | 2,0 | 2,6 | 4,1 | 5,9 | 6,4 | 8,0 | 10,5 |
| | | | | 120 | 0,3 | 0,6 | 1,1 | 1,5 | 2,0 | 3,1 | 4,5 | 4,9 | 6,2 | 8,0 |
| Steel failure with lever arm | | | | | | | | | | | | | | |
| Characteristic bending moment; BSt 500 | $M^0_{Rk,s,fi}$ | [Nm] | Fire exposure time [min] | 30 | 0,6 | 1,8 | 4,1 | 6,5 | 9,7 | 18,8 | 32,6 | 36,8 | 51,7 | 77,2 |
| | | | | 60 | 0,5 | 1,5 | 3,1 | 4,8 | 7,2 | 14,1 | 24,4 | 27,6 | 38,8 | 57,9 |
| | | | | 90 | 0,4 | 1,2 | 2,6 | 4,2 | 6,3 | 12,3 | 21,2 | 23,9 | 33,6 | 50,2 |
| | | | | 120 | 0,3 | 0,9 | 2,0 | 3,2 | 4,8 | 9,4 | 16,3 | 18,4 | 25,9 | 38,6 |
| 1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range | | | | | | | | | | | | | | |
| Fix Master Injection system FIT-Ve 200 or FIT-Wi 200 for concrete | | | | | | | | | | | | Annex C 16 | | |
| Performances Characteristic values of tension and shear loads under fire exposure (reinforcing bar) | | | | | | | | | | | | | | |