

Public-law institution jointly founded by the  
federal states and the Federation

**European Technical Assessment Body  
for construction products**



## European Technical Assessment

**ETA-23/0099  
of 18 March 2025**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

TSM high performance

Product family  
to which the construction product belongs

Screw anchor for use in masonry

Manufacturer

TOGE Dübel GmbH & Co. KG  
Illesheimer Straße 10  
90431 Nürnberg  
DEUTSCHLAND

Manufacturing plant

TOGE Dübel

This European Technical Assessment  
contains

39 pages including 3 annexes which form an integral part  
of this assessment.

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330460-00-0604, Edition 08/2022

This version replaces

ETA-23/0099 issued on 1 August 2023

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The TOGE concrete screw TSM high performance is an anchor in size 5,6, 8 and 10 mm made of galvanised steel. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterized by mechanical interlock in the special thread.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchors of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to steel failure of a single screw anchor under tension loading	$N_{Rk,s}$ see Annex C1
Characteristic resistance to steel failure of a single screw anchor under shear loading	$V_{Rk,s}$ [kN], $M_{Rk,s}^0$ see Annex C1
Characteristic resistance to pull-out failure or brick breakout failure of a single screw anchor under tension loading	$N_{Rk,p}$ , $N_{Rk,b}$ , $N_{Rk,p,c}$ , $N_{Rk,b,c}$ see Annex B7, C4, C9, C14, C19, C23 $\alpha_{j,N}$ see Annex C3, C8, C13, C18, C23
Characteristic resistance to local brick failure and brick edge failure of a single screw anchor under shear loading	$V_{Rk,b,II}$ , $V_{Rk,b,\perp}$ , $V_{Rk,c,II}$ , $V_{Rk,c,\perp}$ see Annex B7, C4, C9, C14, C19, C23 $\alpha_{j,VII}$ , $\alpha_{j,V\perp}$ see Annex C3, C8, C13, C18, C23
Characteristic resistance to brick breakout failure of a screw anchor group under tension loading	$N_{Rk}^g$ see Annex B7 $\alpha_{g,N}$ see Annex B7, C2, C8, C13, C18, C22
Characteristic resistance to local brick failure and brick edge failure of a screw anchor group under shear loading	$V_{Rk,b,II}^g$ , $V_{Rk,b,\perp}^g$ , $V_{Rk,c,II}^g$ , $V_{Rk,c,\perp}^g$ see Annex B7 $\alpha_{g,VII}$ , $\alpha_{g,V\perp}$ see Annex B7, C2, C8, C13, C18, C22

Essential characteristic	Performance
Edge distances, joint distances, spacing, member thickness	$C_{cr}$ , $S_{crII}$ , $S_{cr\perp}$ see Annex B7 $C_{min}$ , $C_{jII}$ , $C_{j\perp}$ , $S_{minII}$ , $S_{min\perp}$ see Annex B7, C2, C8, C13, C18, C22 $h_{min}$ see Annex C2, C7, C12, C17, C22
Resistance to combined tension and shear loading (hollow and perforated bricks)	Limit value X for interaction see Annex C14
Displacements	$\delta_{N0}$ , $\delta_{N\infty}$ , $\delta_{V0}$ , $\delta_{V\infty}$ see Annex C5, C10, C15, C 20, C 24

### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A 1
Resistance to fire	$N_{Rk,s,fi}$ , $N_{Rk,p,fi}$ , $N_{Rk,b,fi}$ , $V_{Rk,s,fi}$ , $M^0_{Rk,s,fi}$ , $C_{min,fi}$ , $C_{j,fi}$ see Annex C6, C11, C16, C21 $N_{Rk,fi}$ , $S_{min,fi}$ , $C_{min,fi}$ , $C_{j,fi}$ see Annex C5, C10, C15, C20

### 3.3 Aspects of durability

Essential characteristic	Performance
Durability	see Annex B1

## 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330460-00-0604 the applicable European legal act is: 97/177/EC.

The system to be applied is: 1

## 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 18 March 2025 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock  
Head of Section


*beglaubigt:*  
Aksünger




Product in installed condition

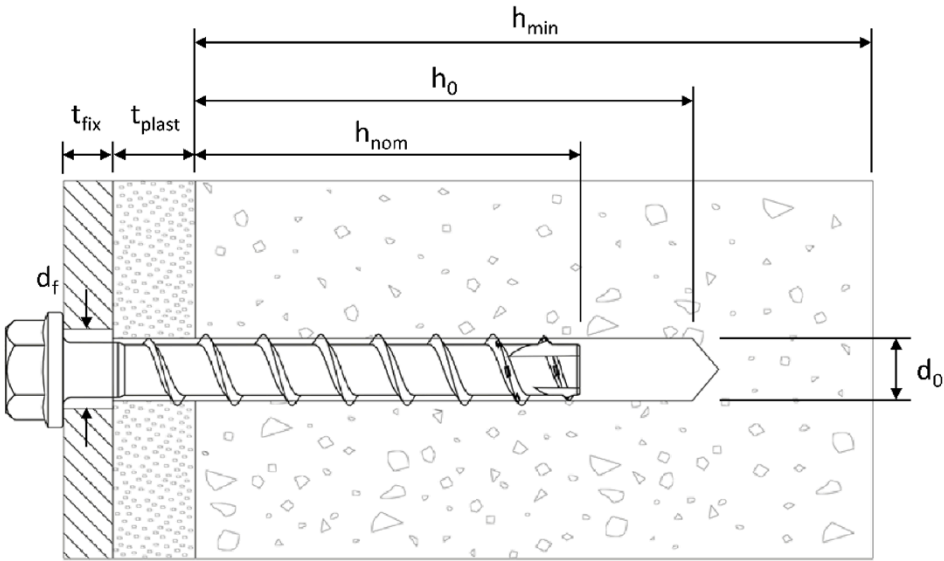

TOGE concrete screw  
TSM high performance  
in solid and perforated  
brick with non-load-  
bearing layer

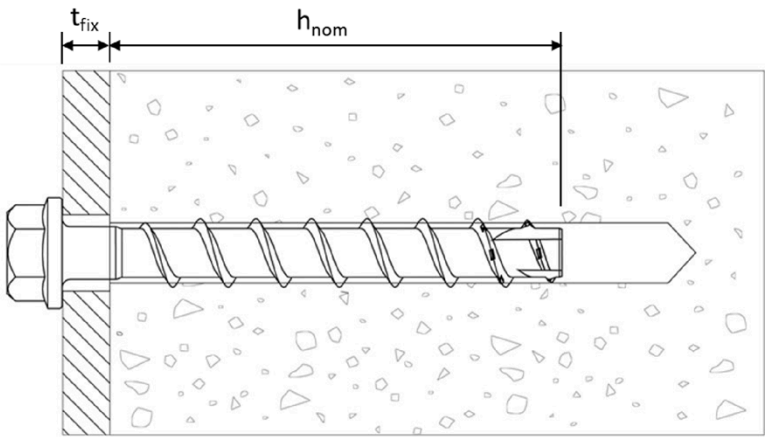

TOGE concrete screw  
TSM high performance  
in solid brick

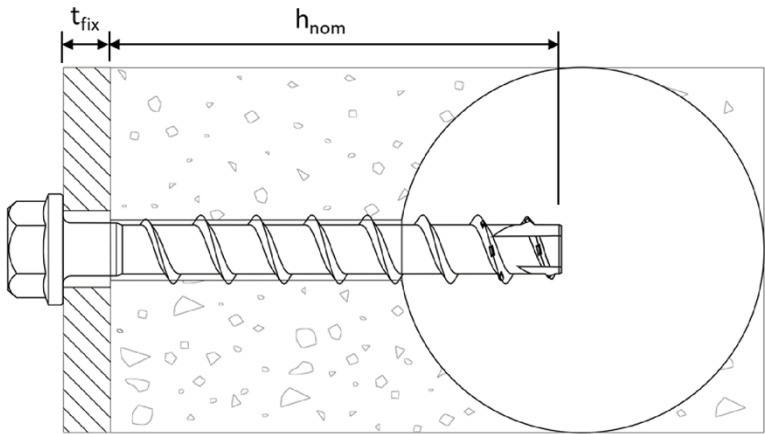

TOGE concrete screw  
TSM high performance  
in perforated brick

$d_0$  = nominal drill hole diameter  
 $t_{fix}$  = thickness of fixture  
 $d_f$  = clearance hole diameter  
 $t_{plast}$  = thickness of non-load-bearing layer

$h_{min}$  = minimum thickness of member  
 $h_{nom}$  = nominal embedment depth  
 $h_0$  = drill hole depth

TOGE concrete screw TSM high performance

Product description  
Product in installed condition

Annex A1





















		Configuration with metric connection thread and hexagon drive e.g. TSM 8x105 M10 SW7; Type ST
		Configuration with washer and hexagon head e.g. TSM 8x80 SW13 VZ 40; Type S
		Configuration with washer, hexagon head and TORX drive e.g. TSM 8x80 SW13; Type S
		Configuration with hexagon head e.g. TSM 8x80 SW13 OS; Type S
		Configuration with countersunk head and TORX drive e.g. TSM 8x80 C VZ 40; Type SK
		Configuration with pan head and TORX drive e.g. TSM 8x80 P VZ 40; Type P
		Configuration with large pan head and TORX drive e.g. TSM 8x80 LP VZ 40; Type P
		Configuration with countersunk head and connection thread e.g. TSM 6x55 AG M8; Type ST-6
		Configuration with hexagon drive and connection thread e.g. TSM 6x55 M8 SW10; Type ST-6
		Configuration with internal thread and hexagon drive e.g. TSM 6x55 IM M8/10; Type I
TOGE concrete screw TSM high performance		
Product description Screw types		Annex A2

Table 1: Material

Part	Product name	Material		
All types	TSM high performance	- Steel EN 10263-4:2017 galvanized acc. to EN ISO 4042:2018 - Zinc flake coating according to EN ISO 10683:2018 ( $\geq 5\mu\text{m}$ ) - Zinc flake coating according to EN ISO 10683:2018 special coating TOGE KORR ( $\geq 20\mu\text{m}$ )		
Part	Product name	Nominal characteristic steel		Elongation $A_5$ [%]
		Yield strength $f_{yk}$ [N/mm <sup>2</sup> ]	Ultimate strength $f_{uk}$ [N/mm <sup>2</sup> ]	
All types	TSM high performance	560	700	$\leq 8$


Table 2: Dimensions

TSM concrete screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Screw length	$\leq L$	[mm]	500						
Core diameter	$d_k$	[mm]	4,0	5,1		7,1		9,1	
Thread outer diameter	$d_s$	[mm]	6,5	7,5		10,6		12,6	

**Marking:**

**TSM high performance**

Screw type: TSM  
Screw size: 10  
Screw length: 100

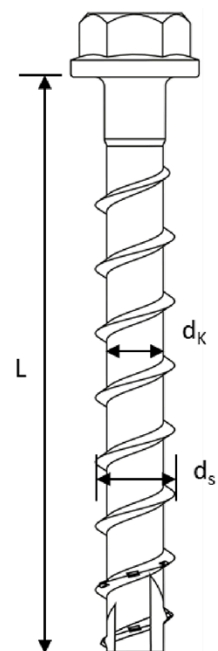

TOGE concrete screw TSM high performance

**Product description**  
Material, dimensions and marking

**Annex A3**

## Specification of Intended use

### Anchorage subject to:

- Static or quasi-static actions in tension, shear or combined tension and shear or bending
- Exposure to fire (for dry masonry only)

### Base materials:

- Masonry made of solid bricks and perforated bricks see Annex B3
- Minimum thickness of member  $h_{min}$  see Annexes C2, C7, C12, C17, C22
- Bearing joints must be completely filled with mortar of at least compressive strength class M5 according to EN 998-2:2016. Butt joints may, but do not have to be filled with mortar.
- In case of fire, all joints must be completely filled with mortar according to EN 998-2:2016 with strength class at minimum M5
- Dry or wet masonry (during installation)

### Use conditions (Environmental conditions):

- Concrete screws subject to dry internal conditions: all screw types.
- Temperature range of the masonry over the period of use: -40°C to +80°C

### Design:

- The anchorage is designed in accordance with EOTA Technical Report TR 054:2022-07.
- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and masonry work.
- Screws with nominal embedment depth smaller than 50 mm may only be used for anchoring of statically indeterminate systems
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor to supports, etc.).
- The screw may be placed in the wall side and in the reveal side of the masonry. The installation parameters for installation in the reveal side must be observed in accordance with Annex B8. In case of Silka XL solid calcium silicate brick KS 12DF, the installation is possible in the wall side only.
- For solid blocks, the characteristic load-bearing capacities also apply to larger block formats, greater compressive strengths and densities of the masonry blocks.
- Installation in the joint and close to the joint is not permitted; the distances to joints according annexes C3, C8, C13, C18, C23 must be observed.

TOGE concrete screw TSM high performance		Annex B1
Intended use Specification		

Specification of Intended use - continuation

Installation:

- Bridging of non-load-bearing layers (e.g. plaster) is possible. When selecting the screw length L, the thickness of the plaster layer  $t_{\text{plast}}$  must be taken into account.  
 $L \geq h_{\text{nom}} + t_{\text{plast}} + t_{\text{fix}}$  (see figures in Annex A1)
- During installation, the joint, axis and edge distances specified by the planner must be taken into account.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on site
- The borehole is drilled with hammer, percussion, suction or masonry drills in hammer mode or rotary mode. The masonry must not be damaged during hammer drilling. If cracks occur during drilling, the rotary mode must be used. In this case, the drill hole must be discarded.
- Incorrectly drilled holes must be filled with high-strength mortar.

TOGE concrete screw TSM high performance	Annex B2
Intended use Specification continuation	




Table 3: Solid and perforated bricks, dimensions and properties



Solid calcium silicate brick KS acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Annex
KS 20 - 2,0 - NF	L: ≥ 240 D: ≥ 115 H: ≥ 71	≥ 26,0	≥ 2,0	C2 – C6



Silka XL solid calcium silicate brick KS 12DF acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Annex
KS - R (P) 20 - 2,0 - 12DF	L: ≥ 498 D: ≥ 175 H: ≥ 248	≥ 14,0	≥ 1,8	C7 – C11

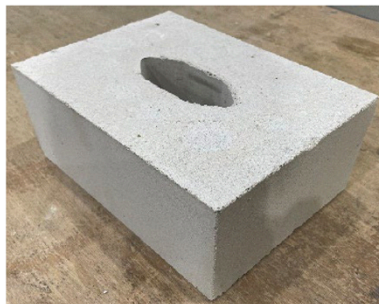

Perforated calcium silicate brick KSL 3DF acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Annex
SWKV KSL 12 - 1,6 - 3DF	L: ≥ 240 D: ≥ 175 H: ≥ 113	≥ 17,0	≥ 1,5	C12 – C16



Solid clay brick MZ acc. to DIN EN 771-1:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Annex
MZ 20 - 2,0 - NF	L: ≥ 240 D: ≥ 115 H: ≥ 71	≥ 21,0	≥ 2,1	C17 – C21



Solid light weight concrete brick acc. to DIN EN 771-3:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Annex
VBL 4 - 1,0 - 2DF	L: ≥ 240 D: ≥ 115 H: ≥ 113	≥ 4,0	≥ 1,5	C22 – C24

TOGE concrete screw TSM high performance

**Intended use**

Solid and perforated bricks, dimensions and properties

**Annex B3**

Table 4: General installation parameters


TSM screw size			5	6		8		10	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
		[mm]	35	35	55	45	65	55	75
Nominal drill hole diameter	d <sub>0</sub>	[mm]	5	6		8		10	
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	5,40	6,40		8,45		10,45	
Drill hole depth	h <sub>0</sub> ≥	[mm]	55	55	75	65	85	75	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	7	8		12		14	

TOGE concrete screw TSM high performance

Intended use  
General installation parameters

Annex B4

## Installation instructions

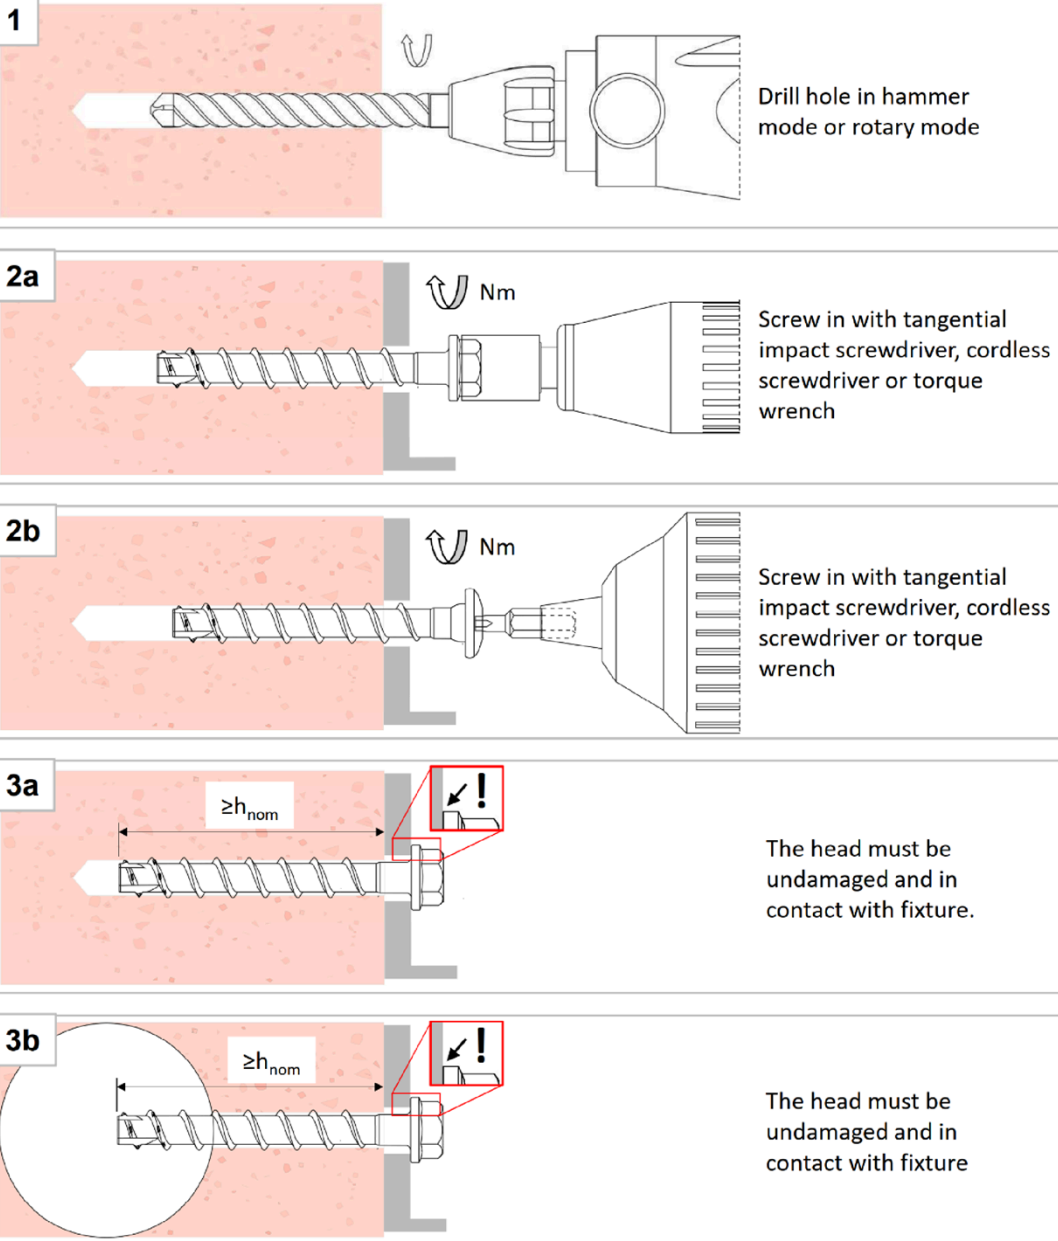

### Note:

- Step 1: Joint distances, spacing and edge distances must be taken into account.
- Step 2a + 2b: For further details on screwing in, see brick type related Annex C2 – C24.  
The tightening torque must not exceed  $T_{inst,max}$
- Step 3a + 3b: It must not be possible to turn the screw.  $T_{inst,max}$  must not be exceeded during the check.

TOGE concrete screw TSM high performance




**Intended use**  
Installation Instructions

**Annex B5**






## Installation Instructions - Adjustment

### 1. Adjustment

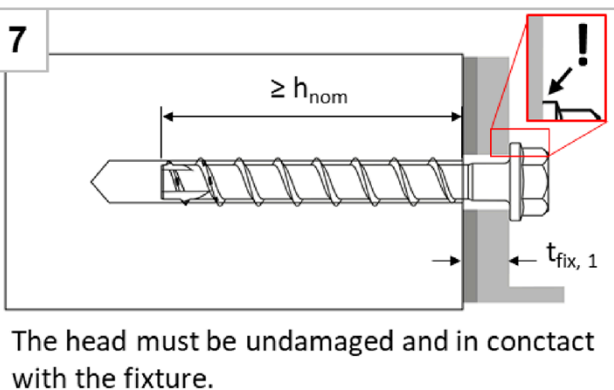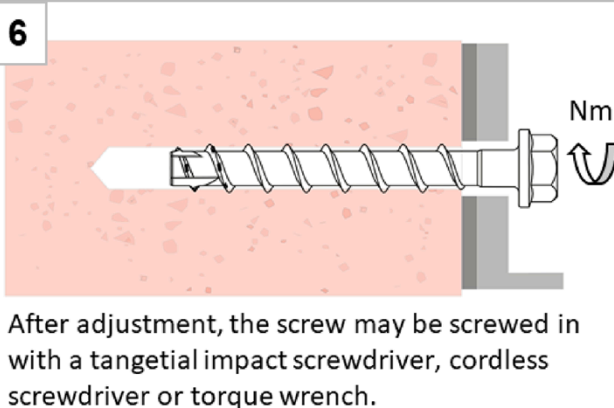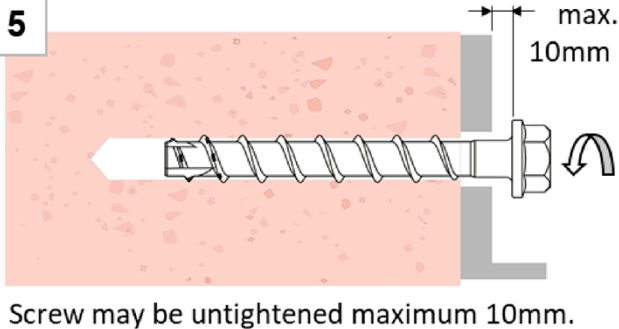

### 2. Adjustment

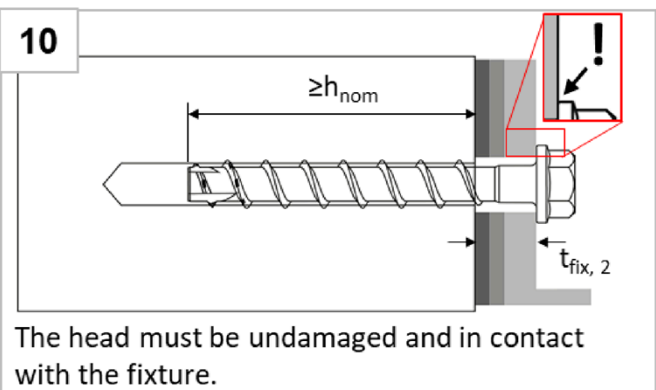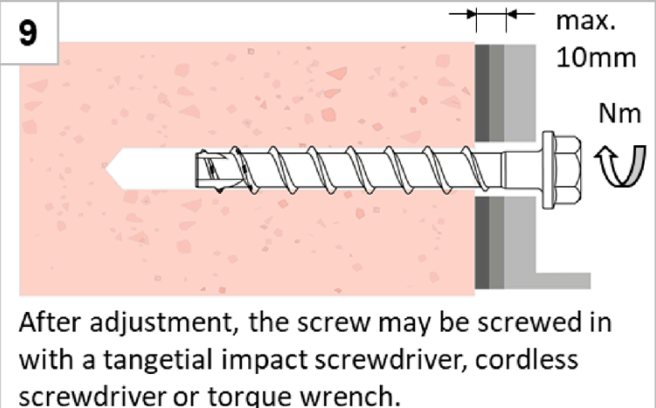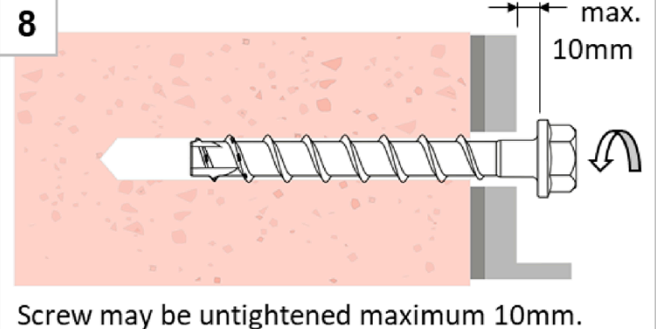

#### Note:


1. The screw can be adjusted maximum two times. The total allowed thickness of shims added during the adjustment process is 10mm. The final embedment depth after adjustment process must be larger or equal than  $h_{nom}$ .
2. For further details on screwing in, see brick type-related annexes C2 – C24

TOGE concrete screw TSM high performance

**Intended use**  
Installation instruction – adjustment

**Annex B6**

### Possible installation positions, the distance $c_j$ must be observed

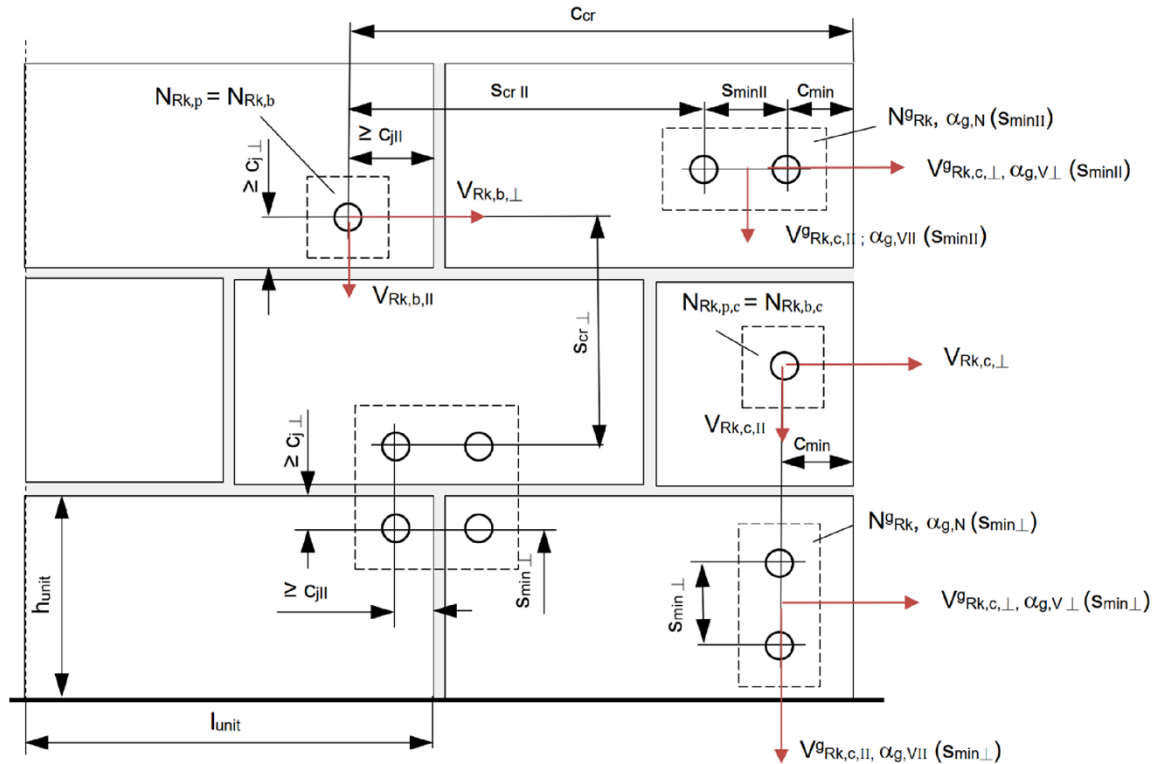

- $c_{min}$  = minimum edge distance to the free edge of the wall  
 $c_{j \parallel}$  = distance to the vertical joints without influence on resistance of the screw anchor  
 $c_{j \perp}$  = distance to the horizontal joints without influence on resistance of the screw anchor  
 $s_{min \parallel}$  = minimum spacing parallel to horizontal joint  
 $s_{min \perp}$  = minimum spacing perpendicular to the horizontal joint  
 $c_{cr}$  = edge distance for transmission of the characteristic resistance of single screw anchor =  $1,5h_{nom}$   
 $s_{cr \parallel}$  = characteristic spacing parallel to the horizontal joint =  $3,0h_{nom}$   
 $s_{cr \perp}$  = characteristic spacing perpendicular to the horizontal joint =  $3,0h_{nom}$   
 $l_{unit}$  = length of the masonry unit  
 $h_{unit}$  = height of the masonry unit  
 $\alpha_{g,N}(s_{min \parallel})$  = group factor under tension load for minimum spacing parallel to horizontal joint  
 $\alpha_{g,N}(s_{min \perp})$  = group factor under tension load for minimum spacing perpendicular to the horizontal joint  
 $\alpha_{g,V \parallel}$  = group factor under shear load parallel to the edge ( $\alpha_{g,V \parallel} = \alpha_{g,V \parallel}(s_{min \parallel}) = \alpha_{g,V \parallel}(s_{min \perp})$ )  
 $\alpha_{g,V \perp}$  = group factor under shear load perpendicular to the edge ( $\alpha_{g,V \perp} = \alpha_{g,V \perp}(s_{min \parallel}) = \alpha_{g,V \perp}(s_{min \perp})$ )

$$N_{Rk} = N_{Rk,b} = N_{Rk,p} = N_{Rk,b,c} = N_{Rk,p,c}$$

$$V_{Rk, \perp} = V_{Rk,b, \perp} = V_{Rk,c, \perp}; V_{Rk, \parallel} = V_{Rk,b, \parallel} = V_{Rk,c, \parallel}$$

Für  $s \geq s_{cr}$ :  $\alpha_{g,N}(s_{min \parallel}) = \alpha_{g,N}(s_{min \perp}) = \alpha_{g,V \parallel} = \alpha_{g,V \perp} = 2$

Für  $s_{min} \leq s \leq s_{cr}$ :  $\alpha_{g,N}(s_{min \parallel})$ ;  $\alpha_{g,N}(s_{min \perp})$ ;  $\alpha_{g,V \parallel}$ ;  $\alpha_{g,V \perp}$  according to installation parameters of brick in Annex C

$$N_{gRK}(s_{min \parallel}) = \alpha_{g,N}(s_{min \parallel}) \times N_{Rk} \quad (\text{group of 2 anchors with minimum spacing parallel to horizontal joint})$$

$$N_{gRK}(s_{min \perp}) = \alpha_{g,N}(s_{min \perp}) \times N_{Rk} \quad (\text{group of 2 anchors with minimum spacing perpendicular to horizontal joint})$$

$$V_{gRK \parallel} = \alpha_{g,V \parallel} \times V_{Rk, \parallel}; V_{gRK, \perp} = \alpha_{g,V \perp} \times V_{Rk, \perp} \quad (\text{group of 2 anchors})$$

$$N_{gRK} = \alpha_{g,N}(s_{min \parallel}) \times \alpha_{g,N}(s_{min \perp}) \times N_{Rk} \quad (\text{group of 4 anchors})$$

$$V_{gRK \parallel} = \alpha_{g,V \parallel}^2 \times V_{Rk, \parallel}; V_{gRK, \perp} = \alpha_{g,V \perp}^2 \times V_{Rk, \perp} \quad (\text{group of 4 anchors})$$


TOGE concrete screw TSM high performance

Intended use  
Possible installation position


Annex B7

Installations parameter for installation in the reveal site

Positioning in reveal in brick types KS NF, MZ NF, VBL 2DF

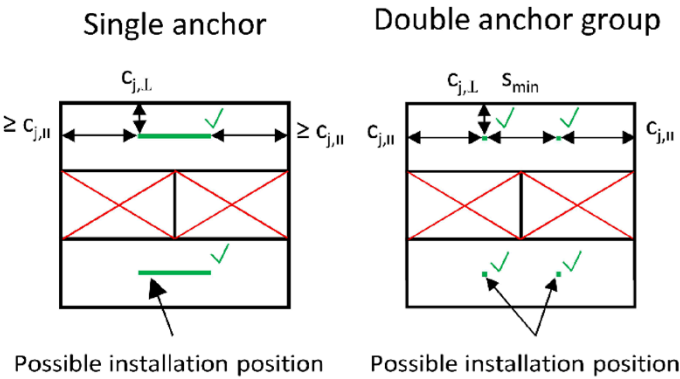

Positioning in reveal in brick type KSL 3DF

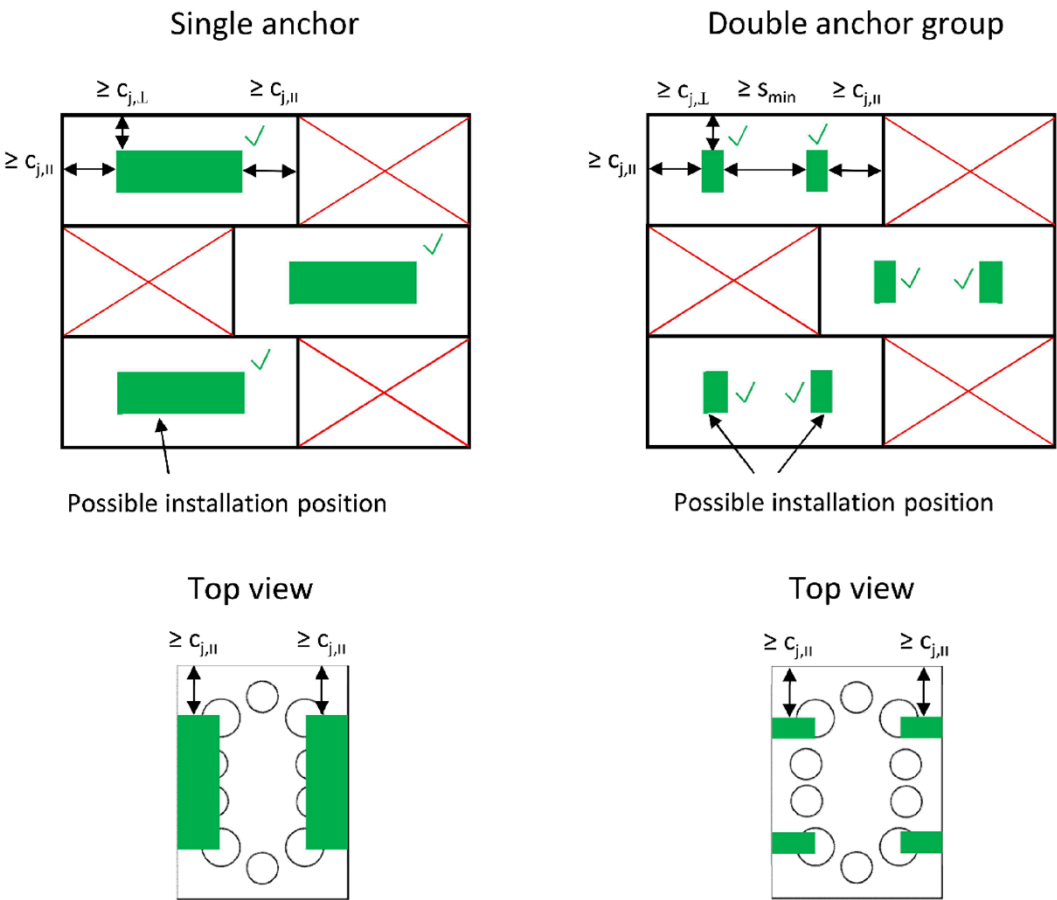

TOGE concrete screw TSM high performance

Intended use  
Possible installation in reveal

Annex B8

Table 5: Characteristic resistance to steel failure

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	
	[mm]	35	35	55	45	65	55	75	
Steel failure for tension and shear loading									
Characteristic resistance under tension loading	$N_{Rk,s}$	[kN]	8,7	14,0		27,0		45,0	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5						
Characteristic resistance under shear loading	$V_{Rk,s}$	[kN]	4,4	7,0		13,5	17,0	22,5	34,0
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25						
Characteristic bending moment	$M^0_{Rk,s}$	[Nm]	5,3	10,9		26,0		56,0	

<sup>1)</sup> In absence of other national regulations

TOGE concrete screw TSM high performance

Performances  
Characteristic resistance to steel failure

Annex C1

Table 6: Material characteristics solid calcium silicate brick KS

Solid calcium silicate brick KS acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Min. wall thickness h <sub>min</sub> [mm]
KS 20 - 2,0 - NF	L: ≥ 240 D: ≥ 115 H: ≥ 71	≥ 26,0	≥ 2,0	240



Table 7: Installation parameters solid calcium silicate brick KS

Use category (installation)			dry or wet						
TSM screw size			5	6		5		8	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
		[mm]	35	35	55	45	65	55	75
Nominal drill hole diameter	d <sub>0</sub>	[mm]	5	6		8		10	
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	5,40	6,40		8,45		10,45	
Drill hole depth	h <sub>0</sub> ≥	[mm]	55	55	75	65	85	75	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	7	8		12		14	
Torque for manual installation	max. T <sub>inst</sub>	[Nm]	6	11		27		37	46
Impact screw driver	T <sub>imp,max</sub>	[Nm]	Max. torque according to the manufacturer's instructions						
			185			300			

Table 8: Min. edge distance, spacing, group factors

TSM screw size			5		6		8		10	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	
		[mm]	35	35	55	45	65	55	75	
Min. edge distance	c <sub>min</sub>	[mm]	80							
Min. spacing	s <sub>min,II</sub> = s <sub>min, ⊥</sub>	[mm]	80							
Group factors	α <sub>g,N</sub> (s <sub>min,II</sub> )	[-]	1,65	1,70	1,05	1,15	1,15	1,05	1,65	
	α <sub>g,N</sub> (s <sub>min, ⊥</sub> )	[-]	1,55	1,70	1,05	1,15	1,20	1,10	1,20	
	α <sub>g,V,II</sub>	[-]	1,55	1,55	1,35	1,15	1,05	1,05	1,35	
	α <sub>g,V, ⊥</sub>	[-]	1,30							

TOGE concrete screw TSM high performance

### Performances

Solid calcium silicate brick KS – material characteristics, installation parameters, min. edge distance and spacing, group factors

Annex C2

Table 9: Reduction factors depending on the distance to joints

TSM screw size			5	6	8	10
Distance to joints	$c_{j \perp}$	[mm]	$\geq 35$			
	$c_{j \parallel}$		$\geq 80$			
Reduction factor	$\alpha_{j, N}$	[-]	1 (full resistance)			
	$\alpha_{j, V \parallel} = \alpha_{j, V \perp}$					
Distance to joints	$c_{j \perp}$	[mm]	$< 35$			
	$c_{j \parallel}$		$< 80$			
Reduction factor	$\alpha_{j, N}$	[-]	Screw must not be used			

TOGE concrete screw TSM high performance

**Performances**  
Solid calcium silicate brick KS – installation parameters close to the joints

Annex C3

Table 10: Characteristic resistances

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		≥ 26,0						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	3,5	3,1	4,9	4,1	4,3	3,8	4,5
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	5,3	5,3	8,6	6,3	11,3	7,7	13,0
	$V_{Rk,I}$	[kN]	3,3						
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		≥ 30,0						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	3,7	3,4	5,3	4,4	4,6	4,0	4,8
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	5,7	5,7	9,3	6,7	12,1	8,3	13,9
	$V_{Rk,I}$	[kN]	3,5						
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		≥ 35,0						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	4,0	3,7	5,7	4,8	5,0	4,4	5,2
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	6,1	6,1	10,0	7,3	13,1	8,9	15,0
	$V_{Rk,I}$	[kN]	3,8						
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		≥ 38,0						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	4,2	3,8	6,0	5,0	5,2	4,5	5,4
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	6,4	6,4	10,4	7,6	13,7	9,3	15,7
	$V_{Rk,I}$	[kN]	4,0						

TOGE concrete screw TSM high performance

**Performance**

Solid calcium silicate brick KS – characteristic resistances

**Annex C4**



Table 11: Displacements

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
		[mm]	35	35	55	45	65	55	75
Tension load	$F_N$	[kN]	1,00	0,89	1,40	1,17	1,23	1,09	1,29
Displacement in tension direction	$\delta_{N0}$	[mm]	0,02	0,04	0,04	0,04	0,03	0,02	0,01
	$\delta_{N\infty}$	[mm]	0,03	0,08	0,08	0,07	0,05	0,04	0,03
Shear load parallel to the edge	$F_{V,II}$	[kN]	1,51	1,51	2,46	1,80	3,23	2,20	3,71
Displacement in shear direction parallel to the edge	$\delta_{V0,II}$	[mm]	0,93	0,09	1,51	0,52	1,00	0,22	0,98
	$\delta_{V\infty,II}$	[mm]	1,40	0,13	2,26	0,78	1,50	0,33	1,46
Shear load perpendicular to the edge	$F_{V,\perp}$	[kN]	0,94						
Displacement in shear direction perpendicular to the edge	$\delta_{V0,\perp}$	[mm]	0,22			0,03			0,02
	$\delta_{V\infty,\perp}$	[mm]	0,33			0,05			0,03

Table 12: Performance under fire exposure for anchor groups

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Characteristic resistance to local brick failure of groups under fire exposure									
$N_{Rk,fi}^g = N_{Rk,b,fi}^g = N_{Rk,p,fi}^g$	[kN]	R30-R90	$0,09 \cdot N_{Rk,b}^g$	$0,09 \cdot N_{Rk,b}^g$	$0,15 \cdot N_{Rk,b}^g$	$0,12 \cdot N_{Rk,b}^g$	$0,18 \cdot N_{Rk,b}^g$	$0,15 \cdot N_{Rk,b}^g$	$0,24 \cdot N_{Rk,b}^g$
		R120	$0,08 \cdot N_{Rk,b}^g$	$0,08 \cdot N_{Rk,b}^g$	$0,12 \cdot N_{Rk,b}^g$	$0,10 \cdot N_{Rk,b}^g$	$0,15 \cdot N_{Rk,b}^g$	$0,12 \cdot N_{Rk,b}^g$	$0,19 \cdot N_{Rk,b}^g$
Min. edge distance and spacing	[mm]	$c_{min,fi} = c_{j,fi}$	$2 \times h_{nom}^{1)}$						
		$s_{min,fi}$	107						

<sup>1)</sup> At least the distances set out in Table 13 shall be observed

TOGE concrete screw TSM high performance

### Performances

Solid calcium silicate brick KS – displacements and performance under fire exposure for anchor groups

Annex C5



Table 13: Fire exposure – Characteristic resistance

TSM screw size				5	6		8		10	
Nominal embedment depth			h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
			[mm]	35	35	55	45	65	55	75
Steel failure for tension and shear load										
Characteristic resistance	R30	N <sub>Rk,s,fi30</sub>	[kN]	1,3	1,3	1,3	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,s,fi60</sub>	[kN]	1,0	1,0	1,0	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,s,fi90</sub>	[kN]	0,6	0,6	0,6	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,s,fi120</sub>	[kN]	0,5	0,5	0,5	0,5	0,5	1,7	1,7
	R30	V <sub>Rk,s,fi30</sub>	[kN]	1,3	1,3	1,3	1,3	1,3	3,4	3,4
	R60	V <sub>Rk,s,fi60</sub>	[kN]	1,0	1,0	1,0	1,0	1,0	2,7	2,7
	R90	V <sub>Rk,s,fi90</sub>	[kN]	0,6	0,6	0,6	0,6	0,6	2,0	2,0
	R120	V <sub>Rk,s,fi120</sub>	[kN]	0,5	0,5	0,5	0,5	0,5	1,7	1,7
	R30	M <sup>0</sup> <sub>Rk,s,fi30</sub>	[Nm]	0,8	1,1	1,1	1,5	1,5	4,9	4,9
	R60	M <sup>0</sup> <sub>Rk,s,fi60</sub>	[Nm]	0,5	0,8	0,8	1,1	1,1	4,0	4,0
	R90	M <sup>0</sup> <sub>Rk,s,fi90</sub>	[Nm]	0,3	0,5	0,5	0,8	0,8	3,0	3,0
	R120	M <sup>0</sup> <sub>Rk,s,fi120</sub>	[Nm]	0,2	0,4	0,4	0,6	0,6	2,5	2,5
Pull-out failure										
Characteristic resistance	R30	N <sub>Rk,p,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,p,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,p,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,p,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,7	1,7
Breakout failure										
Characteristic resistance	R30	N <sub>Rk,b,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,b,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,b,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,b,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,7	1,7
Edge and joint distance										
R30 - R120		c <sub>min,fi</sub> = c <sub>j,fi,II</sub>	[mm]	120						
		c <sub>j,fi,I</sub>	[mm]	35						
Spacing										
R30 - R120		s <sub>cr,fi</sub>	[mm]	4 x h <sub>nom</sub>						

TOGE concrete screw TSM high performance

### Performances

Solid calcium silicate brick KS – characteristic resistance under fire exposure

Annex C6

Table 14: Material characteristics Silka XL solid calcium silicate brick KS 12DF

Silka XL solid calcium silicate brick KS 12DF acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Min. wall thickness h <sub>min</sub> [mm]
KS - R (P) 20 - 2,0 - 12DF	L: ≥ 498 D: ≥ 175 H: ≥ 248	≥ 14,0	≥ 1,8	175

Table 15: Installation parameters Silka XL solid calcium silicate brick KS 12DF

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
		[mm]	35	35	55	45	65	55	75
Nominal drill hole diameter	d <sub>0</sub>	[mm]	5	6		8		10	
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	5,40	6,40		8,45		10,45	
Drill hole depth	h <sub>0</sub> ≥	[mm]	55	55	75	65	85	75	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	7	8		12		14	
Torque for manual installation	max. T <sub>inst</sub>	[Nm]	6	10		25		45	
Torque for rotary screwdriver installation	T <sub>imp,max</sub>	[Nm]	8	10	No performance assessed				
Impact screw driver	T <sub>imp,max</sub>	[Nm]	Max. torque according to the manufacturer's instructions						
			No performance assessed		185	300			

TOGE concrete screw TSM high performance

### Performances

Silka XL solid calcium silicate brick KS 12DF – material characteristics, installation parameters

Annex C7

Table 16: Min edge distance, spacing, group factors

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Min. edge distance	$c_{min}$	[mm]	80						
Min. spacing	$s_{min,II} = s_{min,\perp}$	[mm]	80						
Group factors	$\alpha_{g,N} (s_{min,II})$	[-]	1,65	1,65	1,75	1,40	1,40	1,60	1,30
	$\alpha_{g,N} (s_{min,\perp})$	[-]	1,30	1,30	1,80	1,25	1,25	1,40	1,25
	$\alpha_{g,V,II}$	[-]	2,00	2,00	1,65	2,00	1,65	1,40	1,40
	$\alpha_{g,V,\perp}$	[-]	2,00	2,00	1,45	2,00	1,10	1,40	1,05

Table 17: Reduction factors depending on the distance to joints

TSM screw size			5	6	8	10
Distance to joints	$c_{j,\perp}$	[mm]	$\geq 40$			
	$c_{j,II}$		$\geq 80$			
Reduction factor	$\alpha_{j,N}$	[-]	1 (full resistance)			
	$\alpha_{j,V,II} = \alpha_{j,V,\perp}$					
Distance to joints	$c_{j,\perp}$	[mm]	$< 40$			
	$c_{j,II}$		$< 40$			
Reduction factor	$\alpha_{j,N}$	[-]	Screw must not be used			

TOGE concrete screw TSM high performance

### Performances

Silka XL solid calcium silicate brick KS 12DF – min. edge distance and spacing, group factors group factors and installation parameters close to the joints

Annex C8

Table 18: Characteristic resistances

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 14,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	2,3	2,3	4,1	6,3	6,3	6,4	6,7
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,2	3,2	9,7	3,2	9,7	17,4	17,4
	$V_{Rk,I}$	[kN]	3,6	3,6	8,3	3,6	7,5	5,9	9,8
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 15,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	2,4	2,4	4,3	6,5	6,5	6,6	6,9
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,3	3,3	10,1	3,3	10,1	18,0	18,0
	$V_{Rk,I}$	[kN]	3,7	3,7	8,6	3,7	7,8	6,1	10,1
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 20,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	2,8	2,8	4,9	7,5	7,5	7,6	8,0
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,8	3,8	11,7	3,8	11,7	20,8	20,8
	$V_{Rk,I}$	[kN]	4,3	4,3	9,9	4,3	9,0	7,0	11,7

TOGE concrete screw TSM high performance

### Performances

Silka XL solid calcium silicate brick KS 12DF – characteristic resistances

Annex C9

Table 19: Displacements

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
		[mm]	35	35	55	45	65	55	75
Tension load	$F_N$	[kN]	0,66	0,66	1,17	1,80	1,80	1,83	1,91
Displacement in tension direction	$\delta_{N0}$	[mm]	0,02	0,02	0,04	0,01	0,01	0,01	0,02
	$\delta_{N\infty}$	[mm]	0,04	0,04	0,08	0,02	0,02	0,02	0,05
Shear load parallel to the edge	$F_{V,II}$	[kN]	0,91	0,91	2,77	0,91	2,77	4,97	4,97
Displacement in shear direction parallel to the edge	$\delta_{V0,II}$	[mm]	0,98	0,98	3,00	0,98	3,00	2,95	2,95
	$\delta_{V\infty,II}$	[mm]	1,47	1,47	4,50	1,47	4,50	4,42	4,42
Shear load perpendicular to the edge	$F_{V,I}$	[kN]	1,03	1,03	2,37	1,03	2,14	1,69	2,80
Displacement in shear direction perpendicular to the edge	$\delta_{V0,I}$	[mm]	0,42	0,42	0,03	0,42	1,00	0,05	0,44
	$\delta_{V\infty,I}$	[mm]	0,63	0,63	0,05	0,63	1,50	0,08	0,66

Table 20: Performance under fire exposure for anchor groups

TSM screw size		5	6		8		10		
Nominal embedment depth	$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	
	[mm]	35	35	55	45	65	55	75	
Characteristic resistance to local brick failure of groups under fire exposure									
$N^g_{Rk,fi} = N^g_{Rk,b,fi} = N^g_{Rk,p,fi}$	[kN]	R30-R90	$0,09 \cdot N^g_{Rk,b}$	$0,09 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,18 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,24 \cdot N^g_{Rk,b}$
		R120	$0,08 \cdot N^g_{Rk,b}$	$0,08 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,10 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,19 \cdot N^g_{Rk,b}$
Min. edge distance and spacing	[mm]	$C_{min,fi} = C_{j,fi}$	$2 \times h_{nom}^{1)}$						
		$S_{min,fi}$	107						

<sup>1)</sup> At least the distances set out in Table 21 shall be observed

TOGE concrete screw TSM high performance

### Performances

Silka XL solid calcium silicate brick KS 12DF – displacements and performance under fire exposure for anchor groups

Annex C10

Table 21: Fire exposure – Characteristic resistance

TSM screw size				5	6		8		10	
Nominal embedment depth			h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
			[mm]	35	35	55	45	65	55	75
Steel failure for tension and shear load										
Characteristic resistance	R30	N <sub>Rk,s,fi30</sub>	[kN]	1,1	1,5	1,5	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,s,fi60</sub>	[kN]	0,8	1,1	1,1	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,s,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,s,fi120</sub>	[kN]	0,3	0,4	0,4	0,5	0,5	1,7	1,7
	R30	V <sub>Rk,s,fi30</sub>	[kN]	1,1	1,5	1,5	1,3	1,3	3,4	3,4
	R60	V <sub>Rk,s,fi60</sub>	[kN]	0,8	1,1	1,1	1,0	1,0	2,7	2,7
	R90	V <sub>Rk,s,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	2,0	2,0
	R120	V <sub>Rk,s,fi120</sub>	[kN]	0,3	0,4	0,4	0,5	0,5	1,7	1,7
	R30	M <sup>0</sup> <sub>Rk,s,fi30</sub>	[Nm]	0,8	1,2	1,2	1,5	1,5	4,9	4,9
	R60	M <sup>0</sup> <sub>Rk,s,fi60</sub>	[Nm]	0,5	0,9	0,9	1,1	1,1	4,0	4,0
	R90	M <sup>0</sup> <sub>Rk,s,fi90</sub>	[Nm]	0,3	0,5	0,5	0,8	0,8	3,0	3,0
	R120	M <sup>0</sup> <sub>Rk,s,fi120</sub>	[Nm]	0,2	0,3	0,3	0,6	0,6	2,5	2,5
Pull-out failure										
Characteristic resistance	R30	N <sub>Rk,p,fi30</sub>	[kN]	1,1	0,4	0,72	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,p,fi60</sub>	[kN]	0,8	0,4	0,72	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,p,fi90</sub>	[kN]	0,5	0,4	0,72	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,p,fi120</sub>	[kN]	0,3	0,32	0,57	0,5	0,5	1,7	1,7
Breakout failure										
Characteristic resistance	R30	N <sub>Rk,b,fi30</sub>	[kN]	1,1	0,28	0,79	1,3	1,3	3,4	3,4
	R60	N <sub>Rk,b,fi60</sub>	[kN]	0,8	0,28	0,79	1,0	1,0	2,7	2,7
	R90	N <sub>Rk,b,fi90</sub>	[kN]	0,5	0,28	0,79	0,6	0,6	2,0	2,0
	R120	N <sub>Rk,b,fi120</sub>	[kN]	0,3	0,23	0,63	0,5	0,5	1,7	1,7
Edge and joint distance										
R30 - R120		c <sub>min,fi</sub> = c <sub>j,fi,II</sub>	[mm]	120						
		c <sub>j,fi,I</sub>	[mm]	35						
Spacing										
R30 - R120		s <sub>cr,fi</sub>	[mm]	4 x h <sub>nom</sub>						

TOGE concrete screw TSM high performance


### Performances

Silka XL solid calcium silicate brick KS 12DF - characteristic resistance under fire exposure

Annex C11



Table 22: Material characteristics perforated calcium silicate brick KSL 3DF

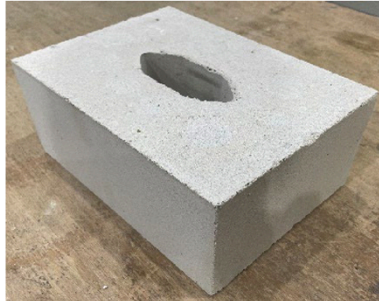

Perforated calcium silicate brick KSL 3DF acc. to DIN EN 771-2:2015-11				
Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Min. wall thickness h <sub>min</sub> [mm]
SWKV KSL 12 - 1,6 - 3DF	L: ≥ 240 D: ≥ 175 H: ≥ 113	≥ 17,0	≥ 1,5	175

Table 23: Installation parameters perforated calcium silicate brick KSL 3DF

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
		[mm]	35	35	55	45	65	55	75
Nominal drill hole diameter	d <sub>0</sub>	[mm]	5	6		8		10	
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	5,40	6,40		8,45		10,45	
Drill hole depth	h <sub>0</sub> ≥	[mm]	55	55	75	65	85	75	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	7	8		12		14	
Torque for manual installation	max. T <sub>inst</sub>	[Nm]	3	4		9		9	
Torque for rotary screwdriver installation	T <sub>imp,max</sub>	[Nm]	9	11	No performance assessed				
Impact screw driver	T <sub>imp,max</sub>	[Nm]	Max. torque according to the manufacturer's instructions						
			No performance assessed		100	200			

TOGE concrete screw TSM high performance

### Performances

Perforated calcium silicate brick KSL 3DF- material characteristics, installation parameters



Annex C12

Table 24: Min. edge distance, spacing, group factors

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Min. edge distance	$c_{min}$	[mm]	58						
Min. spacing	$s_{min,II} = s_{min, \perp}$	[mm]	80						
Group factors	$\alpha_{g,N} (s_{min,II})$	[-]	2,00	2,00	2,00	1,55	1,55	1,95	1,80
	$\alpha_{g,N} (s_{min, \perp})$	[-]	2,00	2,00	2,00	1,55	1,55	1,45	1,70
	$\alpha_{g,V,II}$	[-]	2,00	2,00	2,00	2,00	2,00	2,00	2,00
	$\alpha_{g,V, \perp}$	[-]	2,00	1,80	1,80	1,80	1,80	1,30	1,30

Table 25: Reduction factors depending on the distance to joints

TSM screw size			5	6	8	10
Distance to joints	$c_{j \perp}$	[mm]	$\geq 35$			
	$c_{j II}$		$\geq 58$			
Reduction factor	$\alpha_{j, N}$	[-]	1 (full resistance)			
	$\alpha_{j, VII} = \alpha_{j, VI}$					
Distance to joints	$c_{j \perp}$	[mm]	$< 35$			
	$c_{j II}$		$< 58$			
Reduction factor	$\alpha_{j, N}$	[-]	Screw must not be used			

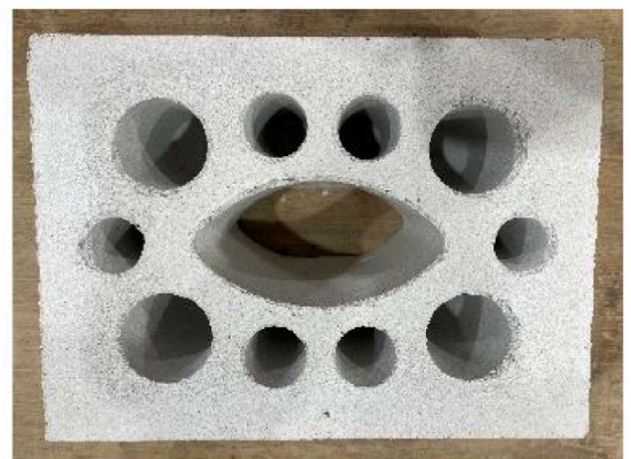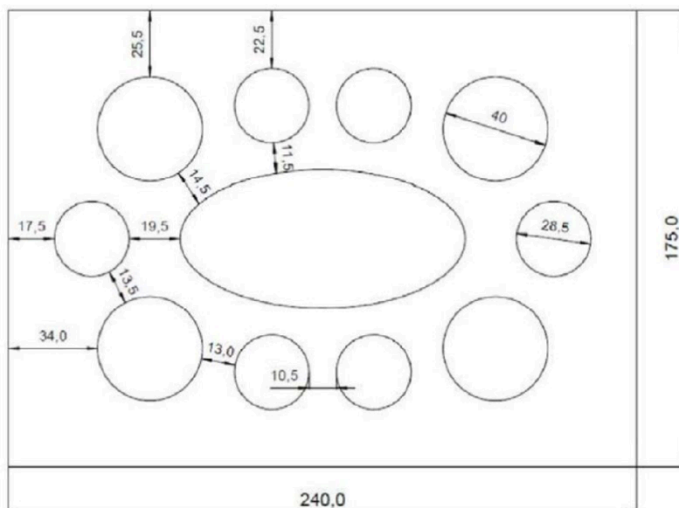

TOGE concrete screw TSM high performance

### Performance

Perforated calcium silicate brick KSL 3DF – min. edge distance and spacing, group factors and installation parameters close to the joints

Annex C13



Table 26: Characteristic resistances

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		≥ 17,0						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,1	1,1	1,1	1,6	1,6	2,2	2,2
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,4						
	$V_{Rk,I}$	[kN]	1,6	1,6	1,6	1,6	1,6	2,2	2,2
Compressive strength $f_{mean}$			[N/mm <sup>2</sup> ]		≥ 20,0				
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,3	1,3	1,3	1,9	1,9	2,5	2,5
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,8	3,8	3,8	3,8	3,8	3,9	3,9
	$V_{Rk,I}$	[kN]	1,8	1,8	1,8	1,8	1,8	2,5	2,5
Compressive strength $f_{mean}$			[N/mm <sup>2</sup> ]		≥ 25,0				
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,5	1,5	1,5	2,2	2,2	3,0	3,0
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	4,5	4,5	4,5	4,5	4,5	4,6	4,6
	$V_{Rk,I}$	[kN]	2,1	2,1	2,1	2,1	2,1	2,9	2,9
Interaction	X	[-]	1,0						

TOGE concrete screw TSM high performance

**Performance**

Perforated calcium silicate brick KSL 3DF – Characteristic resistances

**Annex C14**

Table 27: Displacements

Use category (Installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
		[mm]	35	35	55	45	65	55	75
Tension load	$F_N$	[kN]	0,31	0,31	0,31	0,46	0,46	0,63	0,63
Displacement in tension direction	$\delta_{N0}$	[mm]	0,01	0,01	0,01	0,01	0,01	0,01	0,01
	$\delta_{N\infty}$	[mm]	0,02	0,02	0,02	0,02	0,02	0,02	0,02
Shear load parallel to the edge	$F_{V,II}$	[kN]	0,97						
Displacement in shear direction parallel to the edge	$\delta_{V0,II}$	[mm]	0,80	0,80	0,80	0,80	0,80	1,42	1,42
	$\delta_{V\infty,II}$	[mm]	1,19	1,19	1,19	1,19	1,19	2,12	2,12
Shear load perpendicular to the edge	$F_{V,I}$	[kN]	0,46	0,46	0,46	0,46	0,46	0,63	0,63
Displacement in shear direction perpendicular to the edge	$\delta_{V0,I}$	[mm]	0,01	0,01	0,01	0,01	0,01	0,01	0,01
	$\delta_{V\infty,I}$	[mm]	0,02	0,02	0,02	0,02	0,02	0,02	0,02

Table 28: Performance under fire exposure for anchor groups

TSM screw size		5	6		
Nominal embedment depth		$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$
		[mm]	35	35	55
Characteristic resistance to local brick failure of groups under fire exposure					
$N^g_{Rk,fi} = N^g_{Rk,b,fi} = N^g_{Rk,p,fi}$	[kN]	R30-R90	$0,09 \cdot N^g_{Rk,b}$	$0,09 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$
		R120	$0,08 \cdot N^g_{Rk,b}$	$0,08 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$
Min. edge distance and spacing	[mm]	$c_{min,fi} = c_{j,fi}$	$2 \times h_{nom}^{1)}$		
		$s_{min,fi}$	107		

<sup>1)</sup> At least the distances set out in Table 29 shall be observed

TOGE concrete screw TSM high performance

### Performances

Perforated calcium silicate brick KSL 3DF – displacements and performance under fire exposure for anchor groups

Annex C15

Table 29: Fire exposure – Characteristic resistance

TSM screw size				5	6	
Nominal embedment depth			h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
			[mm]	35	35	55
Steel failure for tension and shear load						
Characteristic resistance	R30	N <sub>Rk,s,fi30</sub>	[kN]	0,7	1,0	1,0
	R60	N <sub>Rk,s,fi60</sub>	[kN]	0,6	0,8	0,8
	R90	N <sub>Rk,s,fi90</sub>	[kN]	0,4	0,5	0,5
	R120	N <sub>Rk,s,fi120</sub>	[kN]	0,3	0,4	0,4
	R30	V <sub>Rk,s,fi30</sub>	[kN]	0,7	1,0	1,0
	R60	V <sub>Rk,s,fi60</sub>	[kN]	0,6	0,8	0,8
	R90	V <sub>Rk,s,fi90</sub>	[kN]	0,4	0,5	0,5
	R120	V <sub>Rk,s,fi120</sub>	[kN]	0,3	0,4	0,4
	R30	M <sup>0</sup> <sub>Rk,s,fi30</sub>	[Nm]	0,5	0,8	0,8
	R60	M <sup>0</sup> <sub>Rk,s,fi60</sub>	[Nm]	0,4	0,6	0,6
	R90	M <sup>0</sup> <sub>Rk,s,fi90</sub>	[Nm]	0,2	0,4	0,4
	R120	M <sup>0</sup> <sub>Rk,s,fi120</sub>	[Nm]	0,2	0,3	0,3
Pull-out failure						
Characteristic resistance	R30	N <sub>Rk,p,fi30</sub>	[kN]	0,7	0,6	0,6
	R60	N <sub>Rk,p,fi60</sub>	[kN]	0,6	0,4	0,4
	R90	N <sub>Rk,p,fi90</sub>	[kN]	0,4	0,3	0,3
	R120	N <sub>Rk,p,fi120</sub>	[kN]	0,3	0,2	0,2
Breakout failure						
Characteristic resistance	R30	N <sub>Rk,b,fi30</sub>	[kN]	0,7	0,6	0,6
	R60	N <sub>Rk,b,fi60</sub>	[kN]	0,6	0,4	0,4
	R90	N <sub>Rk,b,fi90</sub>	[kN]	0,4	0,3	0,3
	R120	N <sub>Rk,b,fi120</sub>	[kN]	0,3	0,2	0,2
Edge and joint distance						
R30 - R120		c <sub>min,fi</sub> = c <sub>j,fi,II</sub>	[mm]	101		
		c <sub>j,fi,I</sub>	[mm]	56		
Spacing						
R30 - R120		s <sub>cr,fi</sub>	[mm]	4 x h <sub>nom</sub>		

TOGE concrete screw TSM high performance

### Performances

Perforated calcium silicate brick KSL 3DF – characteristic resistance under fire exposure

Annex C16

Table 30: Material characteristic solid clay brick MZ


	Solid clay brick MZ acc. to DIN EN 771-1:2015-11				
	Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Min. wall thickness h <sub>min</sub> [mm]
	MZ 20 - 2,0 - NF	L: ≥ 240 D: ≥ 115 H: ≥ 71	≥ 21,0	≥ 2,1	240

Table 31: Installation parameters solid clay brick MZ

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
		[mm]	35	35	55	45	65	55	75
Nominal drill hole diameter	d <sub>0</sub>	[mm]	5	6		8		10	
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	5,40	6,40		8,45		10,45	
Drill hole depth	h <sub>0</sub> ≥	[mm]	55	55	75	65	85	75	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	7	8		12		14	
Torque for manual installation	max. T <sub>inst</sub>	[Nm]	2	3		16		23	
Torque for rotary screwdriver installation	T <sub>imp,max</sub>	[Nm]	4	9		14		No performance assessed	
Impact screw drvier	T <sub>imp,max</sub>	[Nm]	Max. torque according to the manufacturer's instructions						
			No performance assessed					185	

TOGE concrete screw TSM high performance

### Performances

Solid clay brick MZ – material characteristic, installation parameters

Annex C17

Table 32: Min. edge distance, spacing, group factors

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Min. edge distance	$c_{min}$	[mm]	80						
Min. spacing	$s_{min,II} = s_{min,\perp}$	[mm]	80						
Group factors	$\alpha_{g,N} (s_{min,II})$	[-]	1,60	1,60	1,60	1,00	1,00	1,70	1,10
	$\alpha_{g,N} (s_{min,\perp})$	[-]	1,75	1,75	1,75	1,15	1,15	1,45	1,40
	$\alpha_{g,V,II}$	[-]	1,45	1,45	1,45	1,45	1,45	2,00	1,05
	$\alpha_{g,V,\perp}$	[-]	1,20	1,20	1,20	1,20	1,20	1,50	1,15

Table 33: Reduction factors depending on the distance to joints

TSM screw size			5	6	8	10
Distance to joints	$c_{j,\perp}$	[mm]	$\geq 35$			
	$c_{j,II}$		$\geq 80$			
Reduction factor	$\alpha_{j,N}$	[-]	1 (full resistance)			
	$\alpha_{j,V,II} = \alpha_{j,V,\perp}$					
Distance to joints	$c_{j,\perp}$	[mm]	$< 35$			
	$c_{j,II}$		$< 80$			
Reduction factor	$\alpha_{j,N}$	[-]	Screw must not be used			

TOGE concrete screw TSM high performance

### Performances

Solid clay brick MZ – min. edge distance, spacing, group factors and installation parameters close to the joints

Annex C18

Table 34: Characteristic resistances

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 21,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,6	1,6	1,6	2,3	2,3	3,1	3,2
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	2,5	2,5	2,5	2,5	2,5	2,6	8,1
	$V_{Rk,I}$	[kN]	2,1	2,1	2,1	2,1	2,1	2,1	2,7
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 25,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,7	1,7	1,7	2,5	2,5	3,4	3,5
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	2,7	2,7	2,7	2,7	2,7	2,8	8,9
	$V_{Rk,I}$	[kN]	2,3	2,3	2,3	2,3	2,3	2,3	3,0
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 30,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,9	1,9	1,9	2,8	2,8	3,7	3,8
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	2,9	2,9	2,9	2,9	2,9	3,1	9,7
	$V_{Rk,I}$	[kN]	2,5	2,5	2,5	2,5	2,5	2,5	3,2
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 31,0$						
Characteristic resistance to tension load	$N_{Rk}$	[kN]	1,9	1,9	1,9	2,8	2,8	3,8	3,9
Characteristic resistance to shear load	$V_{Rk,II}$	[kN]	3,0	3,0	3,0	3,0	3,0	3,2	9,9
	$V_{Rk,I}$	[kN]	2,5	2,5	2,5	2,5	2,5	2,6	3,3

TOGE concrete screw TSM high performance

**Performances**

Solid clay brick MZ – characteristic resistances

**Annex C19**

Table 35: Displacements

Use category (installation)			dry or wet						
TSM screw size			5	6		8		10	
Nominal embedment depth		$h_{nom}$	$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
		[mm]	35	35	55	45	65	55	75
Tension load	$F_N$	[kN]	0,46	0,46	0,46	0,66	0,66	0,89	0,91
Displacement in tension direction	$\delta_{N0}$	[mm]	0,01	0,01	0,01	0,01	0,01	0,03	0,02
	$\delta_{N\infty}$	[mm]	0,02	0,02	0,02	0,02	0,02	0,05	0,05
Shear load parallel to the edge	$F_{V,II}$	[kN]	0,71	0,71	0,71	0,71	0,71	0,74	2,31
Displacement in shear direction parallel to the edge	$\delta_{V0,II}$	[mm]	1,08	1,08	1,08	1,08	1,08	0,04	2,24
	$\delta_{V\infty,II}$	[mm]	1,61	1,61	1,61	1,61	1,61	0,07	3,36
Shear load perpendicular to the edge	$F_{V,I}$	[kN]	0,60	0,60	0,60	0,60	0,60	0,60	0,77
Displacement in shear direction perpendicular to the edge	$\delta_{V0,I}$	[mm]	1,13	1,13	1,13	1,13	1,13	0,03	0,34
	$\delta_{V\infty,I}$	[mm]	1,69	1,69	1,69	1,69	1,69	0,04	0,51

Table 36: Performance under fire exposure for anchor groups

TSM screw size			5	6		8		10	
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
	[mm]		35	35	55	45	65	55	75
Characteristic resistance to local brick failure of groups under fire exposure									
$N^g_{Rk,fi} = N^g_{Rk,b,fi} = N^g_{Rk,p,fi}$	[kN]	R30-R90	$0,09 \cdot N^g_{Rk,b}$	$0,09 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,18 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,24 \cdot N^g_{Rk,b}$
		R120	$0,08 \cdot N^g_{Rk,b}$	$0,08 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,10 \cdot N^g_{Rk,b}$	$0,15 \cdot N^g_{Rk,b}$	$0,12 \cdot N^g_{Rk,b}$	$0,19 \cdot N^g_{Rk,b}$
Min. edge distance and spacing	[mm]	$c_{min,fi} = c_{j,fi}$	$2 \times h_{nom}^{1)}$						
		$s_{min,fi}$	107						

<sup>1)</sup> At least the distances set out in Table 37 shall be observed

TOGE concrete screw TSM high performance

**Performances**

Solid clay brick MZ – displacements and performance under fire exposure for anchor groups

**Annex C20**



Table 37: Fire exposure – Characteristic resistance

TSM screw size				5	6		8		10	
Nominal embedment depth			h <sub>nom</sub>	h <sub>nom1</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>	h <sub>nom1</sub>	h <sub>nom2</sub>
			[mm]	35	35	55	45	65	55	75
Steel failure for tension and shear load										
Characteristic resistance	R30	N <sub>Rk,s,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	1,7	1,7
	R60	N <sub>Rk,s,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	1,6	1,6
	R90	N <sub>Rk,s,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	1,6	1,6
	R120	N <sub>Rk,s,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,5	1,5
	R30	V <sub>Rk,s,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	1,7	1,7
	R60	V <sub>Rk,s,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	1,6	1,6
	R90	V <sub>Rk,s,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	1,6	1,6
	R120	V <sub>Rk,s,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,5	1,5
	R30	M <sup>0</sup> <sub>Rk,s,fi30</sub>	[Nm]	0,8	1,1	1,1	1,5	1,5	2,5	2,5
	R60	M <sup>0</sup> <sub>Rk,s,fi60</sub>	[Nm]	0,5	0,8	0,8	1,1	1,1	2,4	2,4
	R90	M <sup>0</sup> <sub>Rk,s,fi90</sub>	[Nm]	0,3	0,5	0,5	0,8	0,8	2,3	2,3
	R120	M <sup>0</sup> <sub>Rk,s,fi120</sub>	[Nm]	0,2	0,4	0,4	0,6	0,6	2,2	2,2
Pull-out failure										
Characteristic resistance	R30	N <sub>Rk,p,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	1,7	1,7
	R60	N <sub>Rk,p,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	1,6	1,6
	R90	N <sub>Rk,p,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	1,6	1,6
	R120	N <sub>Rk,p,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,5	1,5
Breakout failure										
Characteristic resistance	R30	N <sub>Rk,b,fi30</sub>	[kN]	1,1	1,3	1,3	1,3	1,3	1,7	1,7
	R60	N <sub>Rk,b,fi60</sub>	[kN]	0,8	1,0	1,0	1,0	1,0	1,6	1,6
	R90	N <sub>Rk,b,fi90</sub>	[kN]	0,5	0,6	0,6	0,6	0,6	1,6	1,6
	R120	N <sub>Rk,b,fi120</sub>	[kN]	0,3	0,5	0,5	0,5	0,5	1,5	1,5
Edge and joint distance										
R30 - R120		c <sub>min,fi</sub> = c <sub>j,fi,II</sub>	[mm]	120						
		c <sub>j,fi,I</sub>	[mm]	35						
Spacing										
R30 - R120		s <sub>cr,fi</sub>	[mm]	4 x h <sub>nom</sub>						

TOGE concrete screw TSM high performance

**Performances**

Solid clay brick MZ – characteristic resistance under fire exposure

**Annex C21**



Table 38: Material characteristic solid light concrete brick VBL


	Solid light concrete brick VBL acc. to DIN EN 771-3:2015-11				
	Nomenclature	Dimensions [mm]	Mean compressive strength [N/mm <sup>2</sup> ]	Bulk density [kg/dm <sup>3</sup> ]	Min. wall thickness h <sub>min</sub> [mm]
	VBL 4 - 1,0 - 2DF	L: ≥ 240 D: ≥ 115 H: ≥ 113	≥ 4,0	≥ 1,5	240

Table 39: Installation parameters solid light concrete brick VBL

Use category (installation)			dry	
TSM screw size			8	10
Nominal embedment depth	h <sub>nom</sub> [mm]	h <sub>nom</sub>	h <sub>nom</sub>	h <sub>nom</sub>
		65	75	
Nominal drill hole diameter	d <sub>0</sub>	[mm]	8	10
Cutting diameter of drill bit	d <sub>cut</sub> ≤	[mm]	8,45	10,45
Drill hole depth	h <sub>0</sub> ≥	[mm]	85	95
Clearance hole diameter	d <sub>f</sub> ≤	[mm]	12	14
Torque for manual installation	max. T <sub>inst</sub>	[Nm]	6	5
Torque for rotary screwdriver installation	T <sub>imp,max</sub>	[Nm]	10	14

Table 40: Min. edge distance, spacing, group factors

TSM screw size			8	10
Nominal embedment depth	h <sub>nom</sub> [mm]	h <sub>nom</sub>	h <sub>nom</sub>	h <sub>nom</sub>
		65	75	
Min. edge distance	c <sub>min</sub>	[mm]	80	
Min. spacing	s <sub>min,II</sub> = s <sub>min,⊥</sub>	[mm]	80	
Group factors	α <sub>g,N</sub> (s <sub>min,II</sub> )	[-]	1,45	1,45
	α <sub>g,N</sub> (s <sub>min,⊥</sub> )	[-]	1,35	1,35
	α <sub>g,V,II</sub>	[-]	0,90	0,90
	α <sub>g,V,⊥</sub>	[-]	0,75	0,75

TOGE concrete screw TSM high performance

### Performances

Solid light concrete brick – material characteristics, installation parameters, min. edge distance and spacing, group factors

Annex C22

Table 41: Reduction factors depending on the distance to joints

TSM screw size			8	10
Distance to joints	$c_{j \perp}$	[mm]	$\geq 35$	
	$c_{j \parallel}$		$\geq 80$	
Reduction factor	$\alpha_{j, N}$	[-]	1 (full resistance)	
	$\alpha_{j, V \parallel} = \alpha_{j, V \perp}$			
Distance to joints	$c_{j \perp}$	[mm]	35	
	$c_{j \parallel}$		80	
Reduction factor	$\alpha_{j, N}$	[-]	Screw must not be used	

Table 42: Characteristic resistances

Use category (installation)			dry	
TSM screw size			8	10
Nominal embedment depth	$h_{nom}$		$h_{nom1}$	$h_{nom1}$
	[mm]		65	75
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 4,0$	
Characteristic tension load	$N_{Rk}$	[kN]	0,6	1,2
Characteristic shear load	$V_{Rk, \parallel}$	[kN]	4,0	5,1
	$V_{Rk, \perp}$	[kN]	2,3	3,3
Compressive strength $f_{mean}$	[N/mm <sup>2</sup> ]		$\geq 5,0$	
Characteristic resistance to tension load	$N_{Rk}$	[kN]	0,7	1,4
Characteristic resistance to shear load	$V_{Rk, \parallel}$	[kN]	4,4	5,7
	$V_{Rk, \perp}$	[kN]	2,6	3,7

TOGE concrete screw TSM high performance

### Performances

Solid light concrete brick – characteristic resistances and installation parameters close to the joints

Annex C23

Table 43: Displacements

Use category (installation)			dry	
TSM screw size			8	10
Nominal embedment depth	$h_{nom}$ [mm]		$h_{nom}$	$h_{nom}$
			65	75
Tension load	$F_N$	[kN]	0,17	0,34
Displacement in tension direction	$\delta_{N0}$	[mm]	0,01	0,01
	$\delta_{N\infty}$	[mm]	0,02	0,02
Shear load parallel to the edge	$F_{V,II}$	[kN]	1,14	1,46
Displacement in shear direction parallel to the edge	$\delta_{V0,II}$	[mm]	1,94	2,11
	$\delta_{V\infty,II}$	[mm]	2,92	3,16
Shear load perpendicular to the edge	$F_{V,\perp}$	[kN]	0,66	0,94
Displacement in shear direction perpendicular to the edge	$\delta_{V0,\perp}$	[mm]	0,36	1,92
	$\delta_{V\infty,\perp}$	[mm]	0,54	2,89

TOGE concrete screw TSM high performance

**Performances**

Solid light concrete brick – displacements

**Annex C24**