

Public-law institution jointly founded by the federal states and the Federation

European Technical Assessment Body
for construction products



European Technical Assessment

ETA-17/0514
of 10 February 2026

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Product family to which the construction product belongs

Bonded fasteners and bonded expansion fasteners for use in concrete

Manufacturer

SPIT
ANCHORS & PINS INDUSTRIAL UNIT
150 route de Lyon
26501 BOURG LES VALENCE CEDEX
FRANKREICH

Manufacturing plant

SPIT
Route de Lyon
26500 Bourg-Les-Valence
France

This European Technical Assessment contains

29 pages including 3 annexes which form an integral part of this assessment

This European Technical Assessment is issued in accordance with Article 95(4) of Regulation (EU) No 2024/3110, on the basis of

EAD 330499-02-0601

This version replaces

ETA-17/0514 issued on 14 December 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 36(3) of Regulation (EU) No 2024/3110.

Specific Part

1 Technical description of the product

The Injection system SPIT VIPER XTREM / SPIT VIPER XTREM TR is a bonded fastener consisting of a cartridge with injection mortar SPIT VIPER XTREM / SPIT VIPER XTREM TR and a steel element. The steel element consists of a threaded rod SPIT with washer and hexagon nut in sizes M8 to M30 or a SPIT MULTICONE stud in sizes M12, M16 and M20 or a reinforcing bar with diameters of \varnothing 8 to 20 mm.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B3 to B5 and C1 to C3
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C4 to C6
Displacements under short-term and long-term loading	See Annex C7
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C8 to C11

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	No performance assessed

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-02-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 10 February 2026 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section


beglaubigt:
Stiller

Product description: Steel elements

- Anchor rods SPIT M8 to M16 with washer and nut (Electroplated / A4)

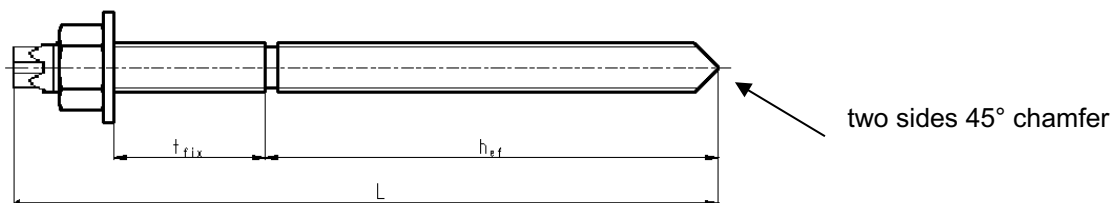

- Anchor rods SPIT M20 to M30 with washer and nut (Electroplated / A4)

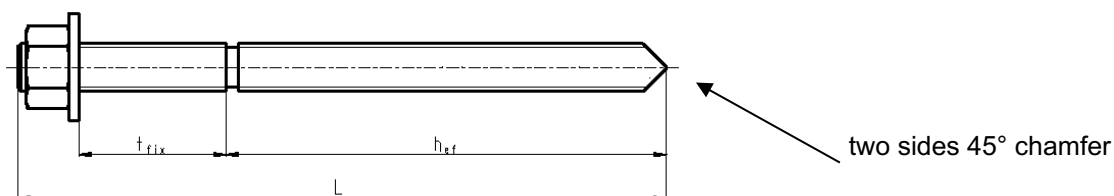

Marking on the anchor rod SPIT: letter S, bolt diameter and maximum thickness of the fixture: e.g.: S M10 / 20

Table 1: Dimensions anchor rods SPIT

Size	d	L	h_{ef}	max t_{fix}
	[mm]	[mm]	[mm]	[mm]
M8	8	110	80	15
M10	10	130	90	20
M12	12	160	110	25
M16	16	190	125	35
M20	20	260	170	65
M24	24	300	210	63
M30	30	380	280	70


SPIT VIPER XTREM / SPIT VIPER XTREM TR

Product description
Steel elements I

Annex A1


- **Commercial standard threaded rods M8 to M30** (with washer and nut) with inspection certificate 3.1 according to EN 10204:2004
 - Materials, dimensions and mechanical properties acc. to Table A1
 - For steel grade 10.9: Proof of passed preloading test for the detection of hydrogen embrittlement according to EN ISO 15330:1999

marking of the embedment depth

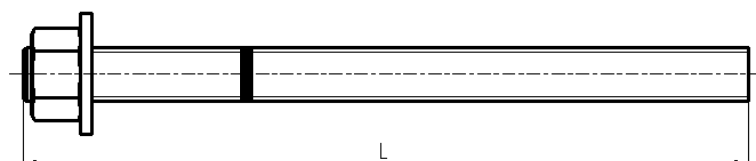


- **Rebars Ø8, Ø10, Ø12, Ø16, Ø20** with properties according to Annex C of EN 1992-1-1:2004+AC:2010

marking of the embedment depth



- **SPIT MULTICONE Studs M12, M16 and M20** (Carbon steel)

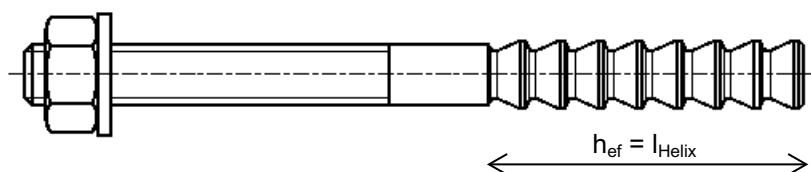

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Product description
Steel elements II

Annex A2

Injection mortar

Injection mortar SPIT VIPER XTREM 280 ml, 410 ml and 825 ml:

Vinylester adhesive - two components




Marking

- Trade name
 - **VIPER XTREM** for Regular version
 - **VIPER XTREM TR** for Tropical version
- Identifying mark of the producer **SPIT**
- Expire date
- Curing and processing time
- Charge code number

Static mixer


Turbo mixing nozzle



Standard Quadro mixing nozzle



High flow mixing nozzle

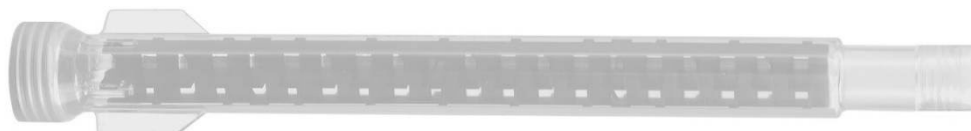

SPIT VIPER XTREM / SPIT VIPER XTREM TR


Product description
Injection mortar

Annex A3

Injection accessories for deep hole

Plastic extension Øext. 13x1000 must be used for hole deeper $h_0 > 250$ mm

Piston plug must be used for deeper holes when $h_0 > 350$ mm

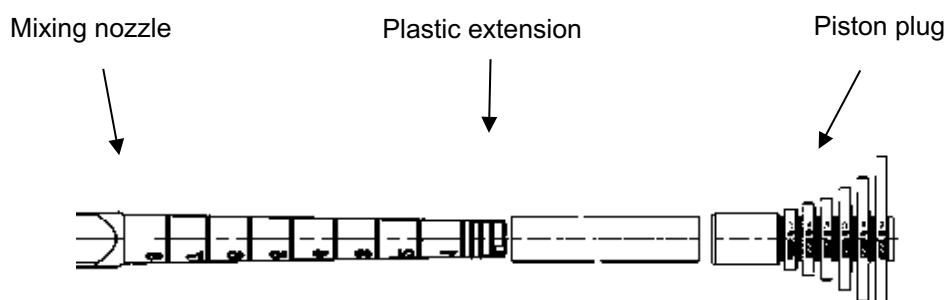

Cartridges

280 ml coaxial cartridge	
410 ml coaxial cartridge	
825 ml side-by-side cartridge	

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Product description
Injection accessories

Annex A4

Table A1: Materials

Part	Size	Material
Carbon steel		
Anchor rod SPIT Zn with nut and washer	M8 to M30	Carbon steel, grade 5.8, EN ISO 898-1:2013 - A ₅ ≥ 15%, Electroplated ≥ 5 µm acc. to EN ISO 4042:2022 or Hot dip galvanized ≥ 45 µm NF EN ISO 1461:2022
SPIT MULTICONE studs with nut and washer	M12, M16, M20	Carbon steel grade 8.8, A ₅ = 12% Electroplated ≥ 5 µm, NF E25-009:2022
Commercial threaded rods with nut and washer	M8 to M30	Carbon steel, grade 5.8 to 10.9 according to EN ISO 898-1:2013 A ₅ ≥ 15%, Electroplated ≥ 5 µm acc. to EN ISO 4042:2022
Stainless steel (A4)		
Anchor rod SPIT A4 with nut and washer	M8 to M30	Stainless steel 1.4404 according to EN ISO 3506-1:2020 Grade 70, A ₅ ≥ 15%
Commercial threaded rods with nut and washer	M8 to M30	Stainless steel grade 70: 1.4401; 1.4404; 1.4578; 1.4571; 1.4439; 1.4362 acc. to EN 10088-1:2023 A ₅ ≥ 15%
High corrosion resistant steel (HCR)		
Commercial threaded rods with nut and washer	M8 to M30	Stainless steel 1.4529 / 1.4565 acc. to EN 10088-1:2023, grade 70, A ₅ ≥ 15%
Ribbed reinforcing bar (rebar)		
ribbed rebar	Ø8 to Ø20	EN 1992-1-1:2004+AC:2010, bars and de-coiled rods class B or C, $f_{uk} = f_{tk} = k \cdot f_{yk}$, k according to NDP or NCI of EN 1992-1-1/NA, A ₅ ≥ 15%

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Product description
Materials

Annex A5

Specifications of intended use

Anchorage subject to:

- Static, quasi-static loading (all steel elements)
- Seismic performance category C1 (all steel elements)
- Seismic performance category C2 (only SPIT MULTICONE studs)

Base materials:

- Compacted, reinforced or unreinforced normal weight concrete without fibres with strength classes C20/25 to C50/60 according to EN 206:2013 + A2:2021
- Cracked or uncracked concrete

Temperature ranges:

Installation temperature: Temperature of base material: 0 °C to +40°C

In-service temperature:

SPIT VIPER XTREM may be used in the following temperature ranges:

- Temperature range I: -40°C to +40°C: max short-term temperature +40°C
max long-term temperature +24°C
- Temperature range II: -40°C to +80°C: max short-term temperature +80°C
max long-term temperature +50°C

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (all materials)
- For all other conditions according to EN 1993-1-4:2006 + A1:2015 corresponding to corrosion resistance class:
 - Stainless steel Stahl A4 according to Annex A5, Table A1: CRC III
 - High corrosion resistance steel HCR according to Annex A5, Table A1: CRC V

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Specifications

Annex B1

Design:

- Fastenings are designed in accordance with: EN 1992-4:2018.
- The structural design is conducted under responsibility of a designer experienced in the field of anchorages and concrete works.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e. g. position of the fastener relative to reinforcement or to supports, etc.).

Installation:


- Installation in dry or wet concrete (use category 1) and in flooded holes (use category 2).
- All installation directions (floor, wall, overhead).
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the anchor only as supplied by the manufacturer without exchanging the components of an anchor.
- Fastener installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools
- Effective anchorage depth, edge distances and spacing not less than the specified values without minus tolerances.

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Specifications

Annex B2

Table B1: Installation data for threaded rods

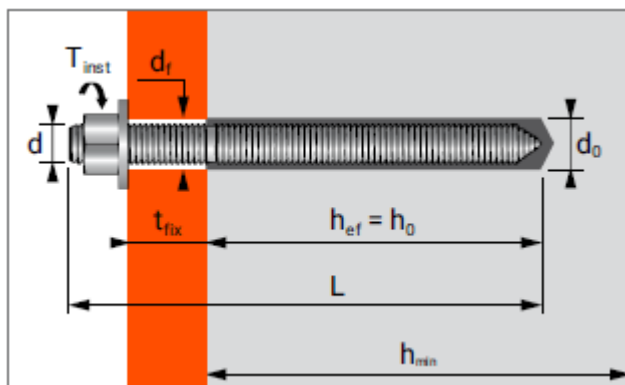

Nominal thread size	Nominal diameter of the drill bit		Tightening torque	Effective embedment depth and drill hole depth			minimum thickness of the concrete member		
	d ₀	d _r		h _{ef} = h ₀			h _{min}		
				Std ¹⁾	Min	Max ²⁾	Std ¹⁾	min	max
	[mm]	[mm]	T _{inst}	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
M8	10	9	10	80	56	160	110	h _{ef} + 30 mm ≥ 100 mm	
M10	12	12	20	90	70	200	120		
M12	14	14	30	110	84	240	140		
M16	18	18	60	125	112	320	160	h _{ef} + 2d ₀	
M20	25	22	120	170	140	400	220		
M24	28	26	200	210	168	480	265		
M30	35	33	400	280	210	360	350		

¹⁾ Values for anchor rods SPIT.

²⁾ The maximum embedment depth is limited to 12 d for installation in flooded holes

Table B2: Minimum spacing and edge distances for threaded rods

Threaded rods			M8	M10	M12	M16	M20	M24	M30
Minimum spacing	s _{min}	[mm]	40	50	60	75	90	115	140
Minimum edge distance	c _{min}	[mm]	40	45	45	50	55	60	80


SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Settings data and minimum distance

Annex B3

English translation prepared by DIBt

Table B3: Installation data for SPIT MULTICONE studs

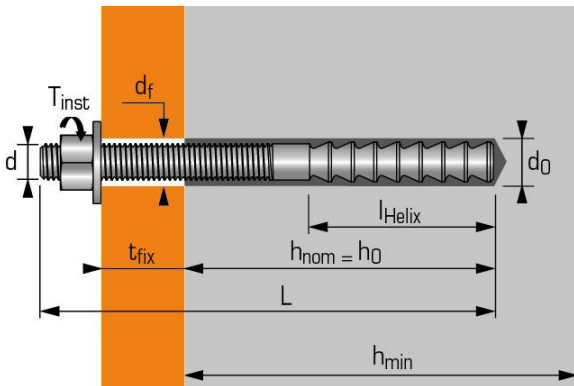

Nominal size	Nominal diameter of the drill bit		Clearance hole in the fixture	Tightening torque	Nominal embedment depth and drill hole depth $h_{nom} = h_0$			minimum thickness of the concrete member h_{min}		
	$\varnothing d_0$	d_f			Std	min	max	Std	min	max
	[mm]	[mm]	[Nm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	
M12	14	14	30	110	60	144	140	100	175	
M16	18	18	50	125	96	192	160	130	228	
M20	22	22	150	170	100	240	215	144	265	

Table B4: Minimum spacing and edge distances for SPIT MULTICONE studs

For the determination of minimum spacing and minimum edge distance of anchors, the projecting area with the effective dimensions shall be higher than the required projective area:


$$A_{sp,req} \leq A_{sp,ef}$$

$$A_{sp,ef} = h_{sp} \cdot b_{sp}$$

With $b_{sp} = (3c + s)$ for $s \leq 3c$ or

$$b_{sp} = 6c \text{ for } s > 3c$$

and $h_{sp} = \min\{(1,5c + h_{nom}); h\}$

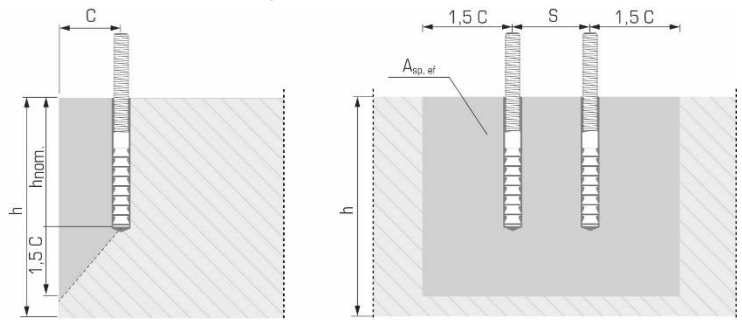


SPIT MULTICONE studs			M12	M16	M20
Absolute minimum edge distance and spacing	$s_{min} = c_{min}$	[mm]	55	60	120
Required area for uncracked concrete	$A_{sp,req}$	[mm ²]	31015	44640	134400
Required area for cracked concrete	$A_{sp,req}$	[mm ²]	27000	44640	134400

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Settings data and minimum distance

Annex B4

Table B5: Installation data for reinforcement bars

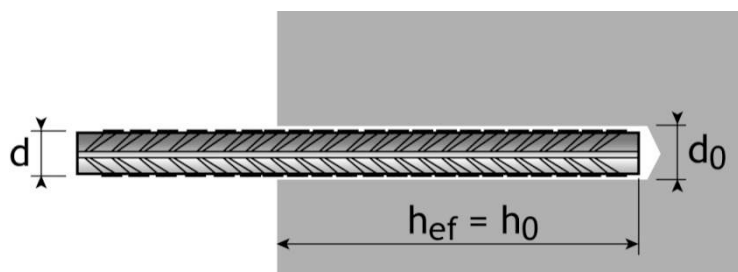

Nominal size of rebar	Nominal diameter of the drill bit	Effective embedment depth and drill hole depth $h_{ef} = h_0$		minimum thickness of the concrete member
	d_0	min	Max ¹⁾	h_{min}
	[mm]	[mm]	[mm]	[mm]
Ø8	10	56	160	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$
Ø10	12	70	200	
Ø12	15	84	240	
Ø16	20	112	320	$h_{ef} + 2d_0$
Ø20	25	140	400	

¹⁾ The maximum embedment depth shall be reduced to $12\varnothing$ for installation in flooded holes

Table B6: Minimum spacing and edge distances for reinforcement bars

Reinforcing bars			Ø8	Ø10	Ø12	Ø16	Ø20
Minimum spacing	s_{min}	[mm]	40	50	60	80	100
Minimum edge distance	c_{min}	[mm]	40	45	45	50	65

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Settings data and minimum distance

Annex B5

Table B7: Working time and curing time for Regular Version

Temperature of base material	Working time	Curing time in dry concrete ¹⁾
0°C	50 min	240 min
1°C to 5°C	25 min	120 min
6°C to 10°C	15 min	90 min
11°C to 20°C	7 min	60 min
21°C to 30°C	4 min	45 min
31°C to 40°C	2 min	30 min

¹⁾ In wet concrete the curing time must be doubled

Table B8: Working time and curing time for Tropical Version

Temperature of base material	Working time	Curing time in dry concrete ¹⁾
1°C to 5°C	60 min	240 min
6°C to 10°C	40 min	180 min
11°C to 20°C	15 min	120 min
21°C to 30°C	8 min	60 min
31°C to 40°C	4 min	60 min

¹⁾ In wet concrete the curing time must be doubled

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Minimum curing time

Annex B6

Table B9: Dimensions of the cleaning tools for threaded rods



Threaded rods				M8	M10	M12	M16	M20	M24	M30
Diameter of drill hole	d_0	[mm]		10	12	14	18	24	28	35
Air nozzle		\emptyset	[mm]	6	8	12	14	20	24	29
Steel brush		\emptyset	[mm]	11	13	15	20	26	30	37

Table B10: Dimensions of the cleaning tools for SPIT MULTICONE studs





SPIT MULTICONE Studs				M12	M16	M20
Diameter of drill hole	d_0	[mm]		14	18	22
Air nozzle		\emptyset	[mm]	12	14	20
Steel brush		\emptyset	[mm]	16	22	26

Table B11: Dimensions of the cleaning tools for reinforcing bars (rebars)

Reinforcing bars (rebars)				$\emptyset 8$	$\emptyset 10$	$\emptyset 12$	$\emptyset 16$	$\emptyset 20$
Diameter of drill hole	d_0	[mm]		10	12	15	20	25
Air nozzle		\emptyset	[mm]	6	8	12	14	20
Steel brush		\emptyset	[mm]	11	13	16	22	26

SPIT VIPER XTREM / SPIT VIPER XTREM TR


Intended use
Cleaning and installation tools

Annex B7

Installation instruction


Bore hole drilling

- 1 Drill hole of diameter (d_0) and depth (h_0) with a hammer drill set in rotation-hammer mode using an appropriately carbide drill bit.

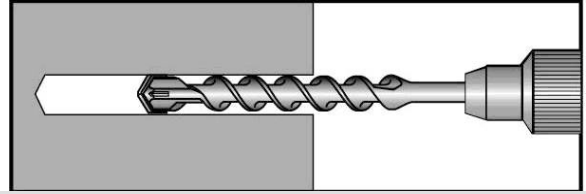


Bore hole cleaning


- 2 Using compress air cleaning (mini 6 bars), use the appropriate extension and air nozzle, starting from the bottom of the hole blow out at least 2 times and until no dust is evacuated

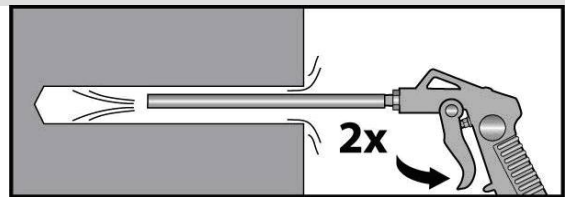

- 3 Using the relevant SPIT brush and extension fitted on a drilling machine (dimensions of the brush see table B9, B10 and B11), starting from the top of the hole in rotation, move downward to the bottom of the hole then move upward to the top of the hole. Repeat this operation. ($\varnothing_{\text{brush}} > \varnothing_{\text{hole}}$, if $\varnothing_{\text{brush}}$ is worn out, the brush must be replaced by a new brush)

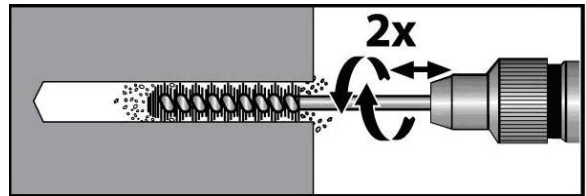


- 4 Using compress air cleaning (mini 6 bars), use the appropriate extension and air nozzle, starting from the bottom of the hole blow out at least 2 times and until no dust is evacuated.

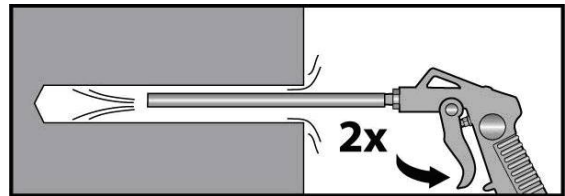

Injection

- 5 Screw the mixing nozzle onto the cartridge and dispense the first part to waste until an even color is achieved for each new cartridge or mixing nozzle. Use tube extensions for holes deeper than 250 mm. Starting from the bottom of the hole fill uniformly. In order to avoid air pocket, withdraw slowly the mixing nozzle while injecting the resin. Fill the hole until 1/2 full. for hole deeper than 350 mm use piston plug. For pneumatic dispenser with 410 ml cartridge, the maximum pressure is 6 bars.

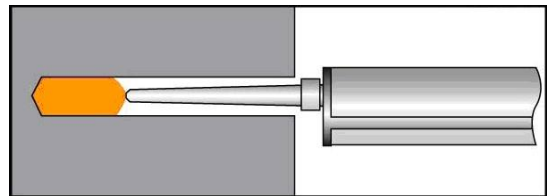



SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Installation instruction I

Annex B8

Setting the steel element

- 6** Insert the steel element (threaded rod, multicone studs or rebar), slowly and with a slight twisting motion in respect of the gel time indicated in table B7 or B8. Remove excess resin from around the mouth of the hole before it sets. Control the embedment depth
- 7** Do not disturb anchor between specified cure time (acc. to table B7 or B8) Attach the fixture and tight the nut at the specified torque as given in Annex B3 and B4.

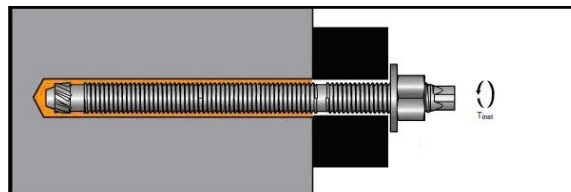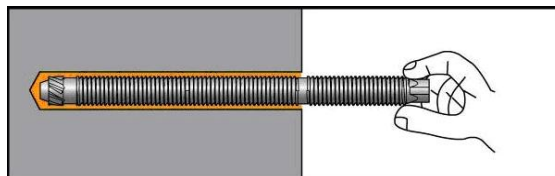

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Intended use
Installation instruction II

Annex B9

Table C1: Characteristic values of tension resistance for static and quasi-static action for threaded rods:

Threaded rods			M8	M10	M12	M16	M20	M24	M30	
Steel failure										
Characteristic resistance of anchor rod SPIT Zn	$N_{Rk,s}$	[kN]	18	29	42	79	123	177	281	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5							
Characteristic resistance of anchor rod SPIT A4	$N_{Rk,s}$	[kN]	26	41	59	110	172	247	281	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,87							2,86
Characteristic resistance for commercial standard rods	$N_{Rk,s}$	[kN]	$N_{Rk,s} = A_s \cdot f_{uk}$							
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	$\gamma_{Ms,N} = \max \{1,4; 1,2 f_{uk} / f_{yk}\}$							
Combined Pull-out and Concrete cone failure										
Nominal diameter	$d = d_{nom}$	[mm]	8	10	12	16	20	24	30	
Installation factor	γ_{inst}	[-]	1,0							
Characteristic bond resistance in uncracked concrete C20/25 (use category 1: dry and wet concrete)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	15	15	15	13	11	10	8,5	
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	14	14	14	12	10	9	8	
Characteristic bond resistance in cracked concrete C20/25 (use category 1: dry and wet concrete)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	6,5	6,5	6,5	6,5	6,5	6,5	6,0	
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	6,5	6,5	6,5	6,5	6,0	6,0	5,5	
Characteristic bond resistance in uncracked concrete C20/25 (use category 2: flooded holes)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	12,0	12,0	12,0	10,0	9,0	8,0	7,0	
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	11,0	11,0	11,0	9,5	8,0	7,5	6,5	
Characteristic bond resistance in cracked concrete C20/25 (use category 2: flooded holes)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	6,5	6,5	6,0	6,0	5,5	5,0	5,0	
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	6,0	6,0	6,0	5,5	5,0	5,0	4,5	
Increasing factor for τ_{Rk} in uncracked concrete $\tau_{Rk,ucr}(X,Y) = \psi_c \cdot \tau_{Rk,ucr}(C20/25)$	C30/37	ψ_c	[-]	1,04	1,04	1,04	1,04	1,12	1,12	1,17
	C40/50			1,07	1,07	1,07	1,07	1,23	1,23	1,32
	C50/60			1,09	1,09	1,09	1,09	1,30	1,30	1,42
Increasing factor for τ_{Rk} in cracked concrete $\tau_{Rk,cr}(X,Y) = \psi_c \cdot \tau_{Rk,cr}(C20/25)$	ψ_c	[-]	1,00							
Reduction factor for sustained tension loading (all temperature ranges)	ψ_{sus}^0	[-]	0,71							
Concrete cone failure and splitting failure										
Factor for uncracked concrete	k_{ucr}	[-]	11							
Factor for cracked concrete	k_{cr}	[-]	7,7							
Edge distance	$c_{cr,N}$	[mm]	1,5 h_{ef}							
Spacing	$s_{cr,N}$	[mm]	3 h_{ef}							
Edge distance to prevent splitting under load	$c_{cr,sp}$	[mm]	No performance assessed							

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance
Characteristic resistance under tension load – threaded rods

Annex C1

Table C2: Characteristic values of tension resistance for static and quasi-static action for SPIT MULTICONE studs:

Muticone Studs			M12	M16	M20	
Steel failure						
Characteristic resistance	$N_{Rk,s}$	[kN]	50	89	140	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5			
Combined Pull-out and Concrete cone failure						
Nominal diameter	$d = d_{nom}$	[mm]	12	16	20	
Effective embedment depth	$h_{ef} = l_{Helix}$	[mm]	60	96	100	
Installation factor	γ_{inst}	[-]	1,0			
Characteristic bond resistance in uncracked concrete C20/25 (use category 1: dry and wet concrete)						
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	17	17	17	
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	16	16	16	
Characteristic bond resistance in cracked concrete C20/25 (use category 1: dry and wet concrete)						
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	17	16	14	
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	16	14	13	
Characteristic bond resistance in uncracked concrete C20/25 (use category 2: flooded holes)						
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	17	17	17	
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	16	16	16	
Characteristic bond resistance in cracked concrete C20/25 (use category 2: flooded holes)						
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	17	16	14	
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	16	14	13	
Increasing factor for τ_{Rk} for uncracked and cracked concrete $\tau_{Rk}(X,Y) = \psi_c \cdot \tau_{Rk}(C20/25)$	C30/37	ψ_c	[-]	1,08	1,08	1,17
	C40/50		[-]	1,15	1,15	1,32
	C50/60		[-]	1,19	1,19	1,42
Reduction factor for sustained tension loading (all temperature ranges)	ψ_{sus}^0	[-]	0,6			
Concrete cone failure and						
Effective embedment depth	h_{ef}	[mm]	h_{nom}			
Factor for uncracked concrete	k_{ucr}	[-]	11			
Factor for cracked concrete	k_{cr}	[-]	7,7			
Edge distance	$c_{cr,N}$	[mm]	1,5 h_{ef}			
Spacing	$s_{cr,N}$	[mm]	3 h_{ef}			
Splitting failure						
Edge distance	$h / h_{nom} \geq 2$	$c_{cr,sp}$	[mm]	h_{nom}		
	$1,3 \leq h / h_{nom} \leq 2$			5,6 $h_{nom} - 2,3 h$		
	$h / h_{nom} \leq 1,3$			2,6 h_{nom}		
Spacing	$s_{cr,sp}$	[mm]	2 $c_{cr,sp}$			

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic resistance under tension load – SPIT MULTICONE studs

Annex C2

Table C3: Characteristic values of tension resistance for static and quasi-static action for reinforcing bars (rebars):

Reinforcing bars (rebars)			Ø8	Ø10	Ø12	Ø16	Ø20
Steel failure							
Characteristic resistance	$N_{Rk,s}$	[kN]	$N_{Rk,s} = A_s \cdot f_{uk}$				
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	$\gamma_{Ms,N} = \max \{1,4; 1,2 f_{uk} / f_{yk}\}$				
Combined pull-out and concrete cone failure							
Diameter of threaded rod	$d = d_{nom}$	[mm]	8	10	12	16	20
Installation factor	γ_{inst}	[-]	1,0				
Characteristic bond resistance in uncracked concrete C20/25 (use category 1: dry and wet concrete)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	13	13	13	13	13
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	12	12	12	12	12
Characteristic bond resistance in cracked concrete C20/25 (use category 1: dry and wet concrete)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	5	5	5,5	5,5	6
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	5	5	5,5	5,5	6
Characteristic bond resistance in uncracked concrete C20/25 (use category 2: flooded holes)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,ucr}$	[N/mm ²]	10	10	10	10	10
Temperature range II: 50°C / 80°C	$\tau_{Rk,ucr}$	[N/mm ²]	9,5	9,5	9,5	9,5	9,5
Characteristic bond resistance in cracked concrete C20/25 (use category 2: flooded holes)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,cr}$	[N/mm ²]	5	5	5	5	5,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,cr}$	[N/mm ²]	5	5	5	5	5
Increasing factor for τ_{Rk} in uncracked concrete $\tau_{Rk,ucr}(X,Y) = \psi_c \cdot \tau_{Rk,ucr}(C20/25)$	C30/37	ψ_c	[-]	1,04			
	C40/50			1,07			
	C50/60			1,09			
Increasing factor for τ_{Rk} in cracked concrete $\tau_{Rk,cr}(X,Y) = \psi_c \cdot \tau_{Rk,cr}(C20/25)$	ψ_c	[-]	1,00				
Reduction factor for sustained tension loading (all temperature ranges)	ψ_{sus}^0	[-]	0,71				
Concrete cone failure and splitting failure							
Factor for uncracked concrete	k_{ucr}	[-]	11				
Factor for cracked concrete	k_{cr}	[-]	7,7				
Edge distance	$c_{cr,N}$	[mm]	1,5 h_{ef}				
Spacing	$s_{cr,N}$	[mm]	3 h_{ef}				
Edge distance to prevent splitting under load	$c_{cr,sp}$	[mm]	No performance assessed				

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance
Characteristic resistance under tension load – rebar

Annex C3

Table C4: Characteristic values of shear resistance for static and quasi-static actions for threaded rods

Threaded rods			M8	M10	M12	M16	M20	M24	M30	
Steel failure without lever arm										
Characteristic resistance for anchor rods SPIT Zn	$V^0_{Rk,s}$	[kN]	9	15	21	39	61	88	140	
Characteristic resistance for anchor rods SPIT A4	$V^0_{Rk,s}$	[kN]	13	20	30	55	86	124	140	
Characteristic resistance for commercial threaded rods	$V^0_{Rk,s}$	[kN]	$V^0_{Rk,s} = 0,5 \cdot A_s \cdot f_{uk}$							
Ductility factor	k_7	[-]	1,0							
Steel failure with lever arm										
Characteristic resistance for anchor rods SPIT Zn	$M^0_{Rk,s}$	[Nm]	19	37	65	166	324	560	1123	
Characteristic resistance for anchor rods SPIT A4	$M^0_{Rk,s}$	[Nm]	26	52	92	233	454	786	1125	
Characteristic resistance for commercial threaded rods	$M^0_{Rk,s}$	[Nm]	$M^0_{Rk,s} = 1,2 \cdot W_{el} \cdot f_{uk}$							
Partial factor for anchor rod SPIT Zn	$\gamma_{Ms,V}^{1)}$	[-]	1,25							
Partial factor for anchor rod SPIT A4	$\gamma_{Ms,V}^{1)}$	[-]	1,56							2,38
Partial factor for commercial threaded rods	$\gamma_{Ms,V}^{1)}$	[-]	if $f_{uk} \leq 800 \text{ N/mm}^2$ and $f_{yk}/f_{uk} \leq 0,8$: $\gamma_{Ms,V} = \max \{1,25; f_{uk}/f_{yk}\}$ else $\gamma_{Ms,V} = 1,5$							
Concrete pryout failure										
Factor	K	[-]	1,0 for $h_{ef} < 60\text{mm}$ 2,0 for $h_{ef} \geq 60\text{mm}$							
Installation factor	γ_{inst}	[-]	1,0							
Concrete edge failure										
Effective length of anchor	ℓ_f	[mm]	$\ell_f = \min \{h_{ef}, 8 d_{nom}\}$							
Outside diameter of anchor	$d = d_{nom}$	[mm]	8	10	12	16	20	24	30	
Installation factor	γ_{inst}	[-]	1,0							

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic resistance under shear load – threaded rods

Annex C4

Table C5: Characteristic values of shear resistance for static and quasi-static actions for SPIT MULTICONE studs

SPIT MULTICONE studs			M12	M16	M20
Steel failure without lever arm					
Characteristic resistance	$V_{RK,S}^0$	[kN]	34	63	98
Ductility factor	k_7	[-]	1,0		
Steel failure without lever arm					
Characteristic resistance	$M_{RK,S}^0$	[Nm]	105	266	519
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25		
Concrete pryout failure					
Factor	k_8	[-]	1,0 for $h_{ef} < 60\text{mm}$ 2,0 for $h_{ef} \geq 60\text{mm}$		
Installation factor	γ_{inst}	[-]	1,0		
Concrete edge failure					
Effective length of anchor	ℓ_f	[mm]	$\ell_f = \min \{h_{nom}, 8 d_{nom}\}$		
Outside diameter of anchor	$d = d_{nom}$	[mm]	12	16	20
Installation factor	γ_{inst}	[-]	1,0		

¹⁾ in absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic resistance under shear load – SPIT MULTICONE studs

Annex C5

Table C6: Characteristic values of shear resistance for static and quasi-static actions for rebar

Reinforcing bars (rebars)			Ø8	Ø10	Ø12	Ø16	Ø20
Steel failure without lever arm							
Characteristic resistance	$V^0_{RK,s}$	[kN]	$V^0_{RK,s} = 0,5 N_{RK,s}$				
Ductility factor	k_7	[-]	1,0				
Steel failure with lever arm							
Characteristic resistance	$M^0_{RK,s}$	[Nm]	$M^0_{RK,s} = 1,2 \cdot W_{el} \cdot f_{uk}$				
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	if $f_{uk} \leq 800 \text{ N/mm}^2$ and $f_{yk}/f_{uk} \leq 0,8$: $\gamma_{Ms,V} = \max \{1,25; f_{uk}/f_{yk}\}$ else $\gamma_{Ms,V} = 1,5$				
Concrete pryout failure							
Factor	$k = k_3$	[-]	1,0 for $h_{ef} < 60\text{mm}$ 2,0 for $h_{ef} \geq 60\text{mm}$				
Installation factor	γ_{inst}	[-]	1,0				
Concrete edge failure							
Effective length of anchor	ℓ_f	[mm]	$\ell_f = \min \{h_{nom}, 8 d_{nom}\}$				
Outside diameter of anchor	d_{nom}	[mm]	8	10	12	16	20
Installation factor	γ_{inst}	[-]	1,0				

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance
Characteristic resistance under shear load – rebar

Annex C6

Table C7: Displacement under tension loads¹⁾ for threaded rods

Threaded rods			M8	M10	M12	M16	M20	M24	M30
Uncracked concrete									
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,01	0,02	0,02	0,02	0,03	0,02	0,04
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,05						
Cracked concrete									
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,02	0,03	0,03	0,05	0,05	0,06	0,06
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,08	0,13	0,12	0,14	0,09	0,10	0,09

Table C8: Displacement under tension loads¹⁾ for SPIT MULTICONE studs

SPIT MULTICONE studs			M12	M16	M20
Uncracked concrete					
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,02	0,03	0,02
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,05		
Cracked concrete					
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,03	0,05	0,05
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,09	0,07	0,08

Table C9: Displacement under tension loads¹⁾ for reinforcing bars

Reinforcing bars (rebars)			Ø8	Ø10	Ø12	Ø16	Ø20
Uncracked concrete							
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,01	0,01	0,07	0,06	0,3
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,05				
Cracked concrete							
Displacement	δ_{N0}	[mm/(N/mm ²)]	0,03	0,1	0,1	0,09	0,09
Displacement	$\delta_{N\infty}$	[mm/(N/mm ²)]	0,27	0,31	0,31	0,10	0,10

¹⁾ Calculation of displacement under tension load: τ acting bond stress.

Displacement under short term loading = $\delta_{N0} \cdot \tau$

Displacement under long term loading = $\delta_{N\infty} \cdot \tau$

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Displacements under static and quasi-static loading

Annex C7

Table C10: Characteristic tension resistance for seismic performance category C1 for threaded rods

Threaded rods			M8	M10	M12	M16	M20	M24	M30	
Steel failure										
Characteristic resistance for anchor rods SPIT Zn	$N_{Rk,s,C1}$	[kN]	18	29	42	79	123	177	281	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,5							
Characteristic resistance for anchor rods SPIT A4	$N_{Rk,s,C1}$	[kN]	26	41	59	110	172	247	281	
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	1,87							2,86
Characteristic resistance for commercial threaded rods	$N_{Rk,s,C1}$	[kN]	$N_{Rk,s,C1} = A_s \cdot f_{uk}$							
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	$\gamma_{Ms,N} = \max \{1,4; 1,2 f_{uk} / f_{yk}\}$							
Combined pull-out and concrete cone failure										
Characteristic bond resistance (use category 1: dry or wet concrete)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	6,0	6,2	6,5	6,1	6,2	6,5	6,0	
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	6,0	6,2	6,5	6,1	5,7	6,0	5,5	
Characteristic bond resistance (use category 2: flooded holes)										
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	6,0	6,2	6,0	5,7	5,3	5,0	5,0	
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	5,5	5,7	6,0	5,2	4,8	5,0	4,5	

¹⁾ In absence of other national regulation

Table C11: Characteristic shear resistance for seismic performance category C1 for threaded rods

Threaded rods			M8	M10	M12	M16	M20	M24	M30	
Steel failure without level arm										
Characteristic resistance for anchor rods SPIT Zn	$V_{Rk,s,C1}$	[kN]	6,4	10,2	14,8	27,5	42,9	61,8	84,2	
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,25							
Characteristic resistance for anchor rods SPIT A4	$V_{Rk,s,C1}$	[kN]	9	14	21	39	60	87	84	
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	1,56							2,38
Characteristic resistance for commercial threaded rods	$V_{Rk,s,C1}$	[kN]	$V_{Rk,s,C1} = 0,35 \cdot A_s \cdot f_{uk}$							
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	if $f_{uk} \leq 800 \text{ N/mm}^2$ and $f_{yk} / f_{uk} \leq 0,8$: $\gamma_{Ms,V} = \max \{1,25; f_{uk} / f_{yk}\}$ else: $\gamma_{Ms,V} = 1,5$							

¹⁾ In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic values for seismic performance category C1 – threaded rods

Annex C8

Table C12: Characteristic tension resistance for seismic performance category C1 for SPIT MULTICONE studs

SPIT MULTICONE Studs			M12	M16	M20
Steel failure					
Characteristic resistance	$N_{Rk,s,C1}$	[kN]	50	89	140
Partial factor	$\gamma_{Ms,N}$ ¹⁾	[-]	1.5		
Combined pull-out and concrete cone failure					
Characteristic bond resistance (use category 1: dry or wet concrete)					
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	17,0	13,5	12,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	16,0	12,0	11,0
Characteristic bond resistance (use category 2: flooded holes)					
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	17,0	13,5	12,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	16,0	12,0	11,0

¹⁾ In absence of other national regulation

Table C13: Characteristic shear resistance for seismic performance category C1 for SPIT MULTICONE studs

SPIT MULTICONE Studs			M12	M16	M20
Steel failure without level arm					
Characteristic resistance	$V_{Rk,s,C1}$	[kN]	23,6	44,0	68,6
Partial factor	$\gamma_{Ms,V}$ ¹⁾	[-]	1,25		

¹⁾ In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic values for seismic performance category C1 – SPIT MULTICONE studs

Annex C9

Table C14: Characteristic tension resistance for seismic performance category C1 for reinforcement bars (rebars)

Reinforcement bars (rebars)			Ø8	Ø10	Ø12	Ø16	Ø20
Steel failure							
Characteristic resistance	$N_{Rk,s,C1}$	[kN]	$N_{Rk,s,C1} = A_s \cdot f_{uk}$				
Partial factor	$\gamma_{Ms,N}^{1)}$	[-]	$\gamma_{Ms,N} = \max \{1,4; 1,2 f_{uk} / f_{yk}\}$				
Combined pull-out and concrete cone failure							
Characteristic bond resistance (use category 1: dry or wet concrete)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	3,5	3,8	5,5	5,5	6,0
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	3,5	3,8	5,5	5,5	6,0
Characteristic bond resistance (use category 2: flooded holes)							
Temperature range I: 24°C / 40°C	$\tau_{Rk,C1}$	[N/mm ²]	3,5	3,8	5,0	5,0	5,5
Temperature range II: 50°C / 80°C	$\tau_{Rk,C1}$	[N/mm ²]	3,5	3,8	5,0	5,0	5,5

1) In absence of other national regulation

Table C15: Characteristic shear resistance for seismic performance category C1 for reinforcement bars (rebars)

Reinforcement bars (rebars)			Ø8	Ø10	Ø12	Ø16	Ø20
Steel failure							
Characteristic resistance	$V_{Rk,s,C1}$	[kN]	$V_{Rk,s,C1} = 0,35 \cdot A_s \cdot f_{uk}$				
Partial factor	$\gamma_{Ms,V}^{1)}$	[-]	if $f_{uk} \leq 800 \text{ N/mm}^2$ and $f_{yk} / f_{uk} \leq 0,8$: $\gamma_{Ms,V} = \max \{1,25; f_{uk} / f_{yk}\}$ else: $\gamma_{Ms,V} = 1,5$				

1) In absence of other national regulation

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic values for seismic performance category C1 – rebar

Annex C10

Table C16: Characteristic tension resistance for seismic performance category C2 for SPIT MULTICONE studs

SPIT MULTICONE Studs			M12	M16	M20
Steel failure					
Characteristic resistance	$N_{Rk,s,C2}$	[kN]	50	89	140
Partial factor	$\gamma_{Ms,N}$	[-]	1.5		
Combined Pull-out and Concrete cone failure					
Characteristic bond resistance (use category 1: dry or wet concrete)					
Temperature range I: 24°C / 40°C	$\tau_{Rk,C2}$	[N/mm ²]	7,1	9,6	6,8
Temperature range II: 50°C / 80°C	$\tau_{Rk,C2}$	[N/mm ²]	6,6	8,9	6,3
Characteristic bond resistance (use category 2: flooded holes)					
Temperature range I: 24°C / 40°C	$\tau_{Rk,C2}$	[N/mm ²]	7,1	9,6	6,8
Temperature range II: 50°C / 80°C	$\tau_{Rk,C2}$	[N/mm ²]	6,6	8,9	6,3

1) In absence of other national regulation

Table C17: Characteristic shear resistance for seismic performance category C2 for SPIT MULTICONE studs

Multicone Studs			M12	M16	M20
Steel failure without level arm					
Characteristic resistance	$V_{Rk,s,C2}$	[kN]	23,6	44,0	68,6
Partial factor	$\gamma_{Ms,V}$	[-]	1,25		

1) In absence of other national regulation

Table C18: Displacements under seismic tension loading, seismic performance category C2 for SPIT MULTICONE studs

SPIT MULTICONE Studs			M12	M16	M20
Displacement DLS	$\delta_{N,C2(50\%)}$	[mm]	0,72	0,98	1,15
Displacement ULS	$\delta_{N,C2(100\%)}$	[mm]	1,65	2,07	3,20

Table C19: Displacements under seismic shear loading, seismic performance category C2 for SPIT MULTICONE studs

SPIT MULTICONE Studs			M12	M16	M20
Displacement DLS	$\delta_{V,C2(50\%)}$	[mm]	2,01	2,63	2,99
Displacement ULS	$\delta_{V,C2(100\%)}$	[mm]	3,57	4,67	4,53

SPIT VIPER XTREM / SPIT VIPER XTREM TR

Performance

Characteristic values for seismic performance category C2 – SPIT MULTICONE studs

Annex C11