

Public-law institution jointly founded by the
federal states and the Federation

**European Technical Assessment Body
for construction products**



European Technical Assessment

**ETA-25/0984
of 8 May 2026**

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

G&B Fissaggi Injection system Gebofix PRO SISMIK
VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Product family
to which the construction product belongs

Bonded fasteners and bonded expansion fasteners for
use in concrete
(Alternative drilling methods, seismic and fire in steel fibre
reinforced concrete, variable working life, time-to-failure
assessment)

Manufacturer

G&B Fissaggi Srl
Corso Savona, 22
10029 VILLASTELLONE (TO)
ITALY

Manufacturing plant

G&B Fissaggi S.r.l., Plant 4

This European Technical Assessment
contains

36 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Article 95(4) of
Regulation (EU) 2024/3110, on the basis of

EAD 330499-02-0601-v01

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 36(3) of Regulation (EU) No 2024/3110.

Specific Part

1 Technical description of the product

The "G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete" is a bonded anchor consisting of a cartridge with injection mortar Gebofix PRO SISMIK VE-SF or Gebofix PRO SISMIK VE-SF Nordic and a steel element. The steel element consists of a commercial threaded rod with washer and hexagon nut in the range of M8 to M30 or reinforcing bar in the range of Ø 8 to Ø 32 mm or an internal threaded anchor rod BI-M6 to BI-M20.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life according to Annex B2, use conditions. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B 3, C 1, C 2, C 3, C 5 and C 7
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1, C 4, C 6 and C 8
Displacements under short-term and long-term loading	See Annex C 9 to C 11
Characteristic resistance for seismic performance categories C1	See Annex C 12 and C 13
Characteristic resistance and displacements for seismic performance categories C2	See Annex C 14 and C 15

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 16 to C 18

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330499-02-0601-v01 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin on 8 May 2026 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section


beglaubigt:
Baderschneider

Installation threaded rod M8 up to M30


prepositioned installation or
push through installation (annular gap filled with mortar)

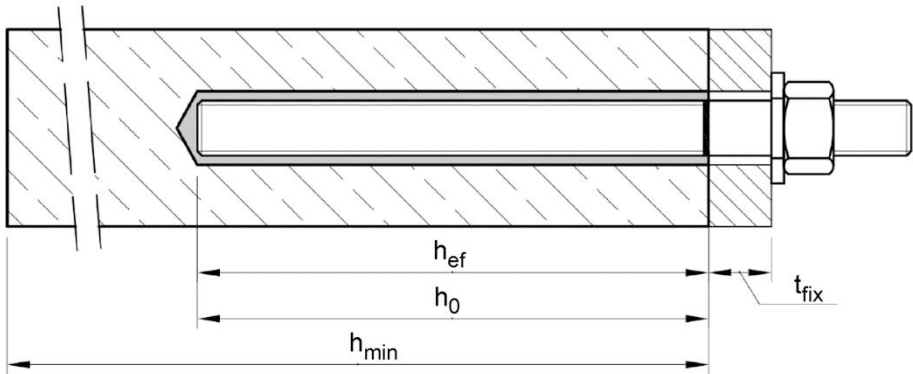

Installation reinforcing bar Ø8 up to Ø32

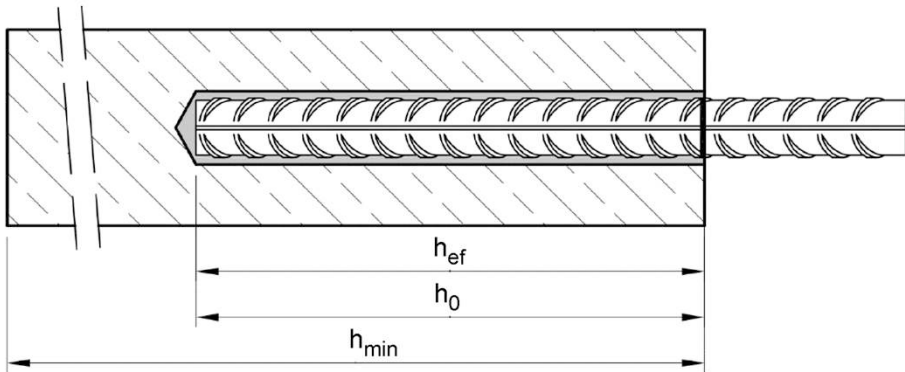

Installation internal threaded anchor rod BI-M6 up to BI-M20

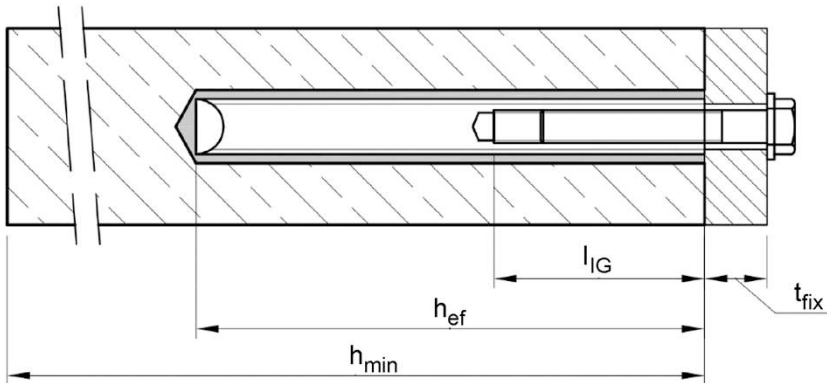

t_{fix} = thickness of fixture
 h_{ef} = effective embedment depth
 h_{min} = minum thickness of member

h_0 = nominal drill hole diameter
 l_{IG} = thread engagement length

G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO
SISMik VE-SF Nordic for concrete


Product description
Installed condition

Annex A 1

Cartridge system

Coaxial Cartridge:

150 ml, 280 ml, 300 ml up to 333 ml and 380 ml up to 420 ml




Imprint:

Gebofix PRO SISMIK VE-SF or Gebofix PRO SISMIK VE-SF Nordic

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Side-by-Side Cartridge:

235 ml, 345 ml up to 360 ml and 825 ml




Imprint:

Gebofix PRO SISMIK VE-SF or Gebofix PRO SISMIK VE-SF Nordic

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Foil tube Cartridge:

165 ml and 300 ml




Imprint:


Gebofix PRO SISMIK VE-SF or Gebofix PRO SISMIK VE-SF Nordic

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

Static mixer M21/14 and M17

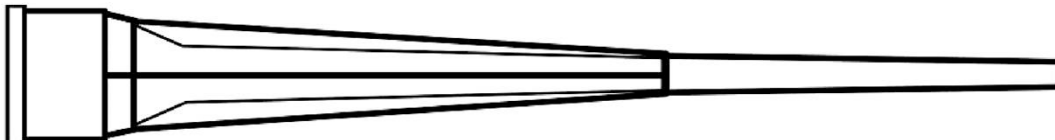

Static mixer M25/S

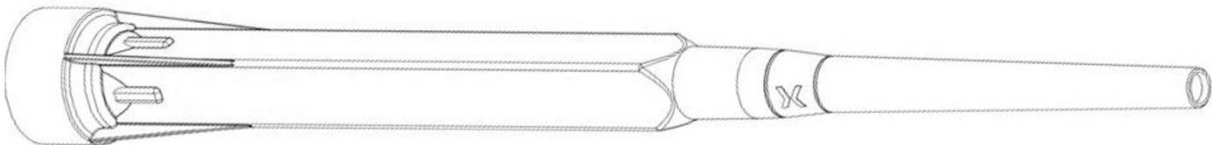

Piston plug MP and mixer extension ML




G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Product description
Injection system

Annex A 2

Threaded rod M8 up to M30 with washer and hexagon nut

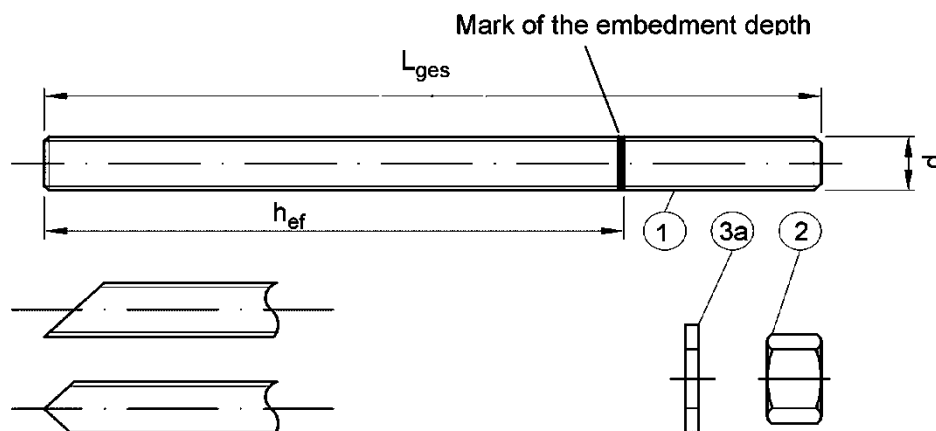


Commercial standard rod with:

- Materials, dimensions and mechanical properties acc. to Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004. The document shall be stored.
- Marking of embedment depth

For hot dip galvanized elements, the requirements with regards to the combination of nuts and rods according to EN ISO 10684:2004 + AC:2009 Annex F shall be considered.

Internal threaded rod BI-M6 to BI-M20

Threaded rod or screw

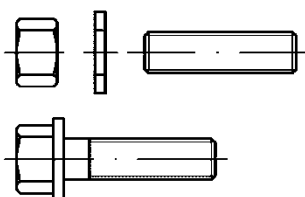

Producer marking: e.g.  M8

 Marking Internal thread (optional)


 Mark

M8 Thread size (Internal thread)


A4 additional mark for stainless steel

HCR additional mark for high-corrosion resistance steel


-8 additional mark for property class 8.8

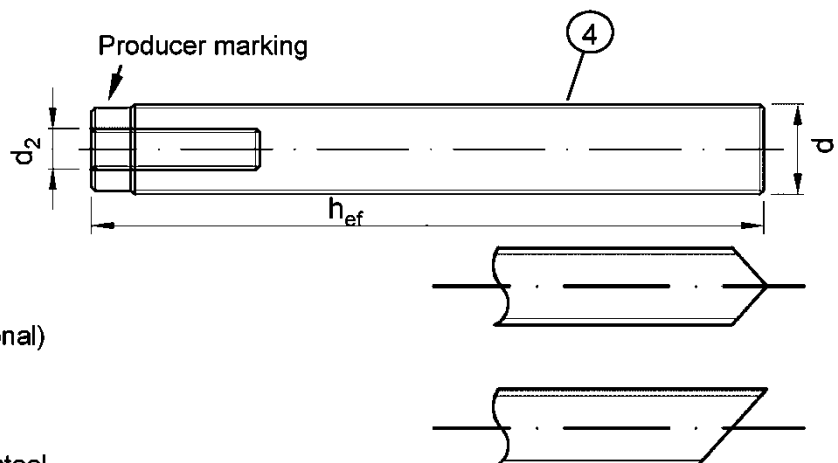

Filling washer KSW



Mixer reduction nozzle KSM



G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete

Product description


Threaded rod; Internal threaded rod
Filling washer; Mixer reduction nozzle

Annex A 3

Table A1: Materials

Part	Designation	Material			
Steel, zinc plated (Steel acc. to EN ISO 683-4:2018 or EN 10263:2017)					
- zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:2022 or					
- hot-dip galvanised $\geq 40 \mu\text{m}$ acc. to EN ISO 1461:2022 and EN ISO 10684:2004 + AC:2009 or					
- sherardized $\geq 45 \mu\text{m}$ acc. to EN ISO 17668:2016					
1	Threaded rod	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 898-1:2013	4.6 $f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 240 \text{ N/mm}^2$	$A_5 \geq 8\%$
			4.8 $f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 320 \text{ N/mm}^2$	$A_5 \geq 8\%$
			5.6 $f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 300 \text{ N/mm}^2$	$A_5 \geq 8\%$
			5.8 $f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 400 \text{ N/mm}^2$	$A_5 \geq 8\%$
	8.8 $f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 640 \text{ N/mm}^2$	$A_5 \geq 12\%$ 4)		
2	Hexagon nut	acc. to EN ISO 898-2:2022	4	for anchor rod class 4.6 or 4.8	
			5	for anchor rod class 5.6 or 5.8	
			8	for anchor rod class 8.8	
3a	Washer	Steel, zinc plated, hot-dip galvanised or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)			
3b	Filling washer	Steel, zinc plated, hot-dip galvanised or sherardized			
4	Internal threaded anchor rod	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 898-1:2013	5.8 $f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 400 \text{ N/mm}^2$	$A_5 \geq 8\%$
			8.8 $f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 640 \text{ N/mm}^2$	$A_5 \geq 8\%$
Stainless steel A2 (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2023)					
Stainless steel A4 (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2023)					
High corrosion resistance steel (Material 1.4529 or 1.4565, acc. to EN 10088-1:2023)					
1	Threaded rod ¹⁾³⁾	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 3506-1:2020	50 $f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 210 \text{ N/mm}^2$	$A_5 \geq 8\%$
			70 $f_{uk} = 700 \text{ N/mm}^2$	$f_{yk} = 450 \text{ N/mm}^2$	$A_5 \geq 12\%$ 4)
		80 $f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 600 \text{ N/mm}^2$	$A_5 \geq 12\%$ 4)	
2	Hexagon nut ¹⁾³⁾	acc. to EN ISO 3506-1:2020	50	for anchor rod class 50	
			70	for anchor rod class 70	
			80	for anchor rod class 80	
3a	Washer	A2: Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2023 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2023 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1:2023 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)			
3b	Filling washer	Stainless steel A4, High corrosion resistance steel			
4	Internal threaded anchor rod ¹⁾²⁾	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 3506-1:2020	50 $f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 210 \text{ N/mm}^2$	$A_5 \geq 8\%$
			70 $f_{uk} = 700 \text{ N/mm}^2$	$f_{yk} = 450 \text{ N/mm}^2$	$A_5 \geq 8\%$
1) Property class 70 or 80 for anchor rods and hexagon nuts up to M24 and Internal threaded anchor rods up to BI-M16					
2) for BI-M20 only property class 50					
3) Property class 80 only for stainless steel A4 and HCR					
4) $A_5 \geq 8\%$ fracture elongation if no use for seismic performance category C2					
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete					Annex A 4
Product description Materials threaded rod and internal threaded rod					

Reinforcing bar: ø8 up to ø32

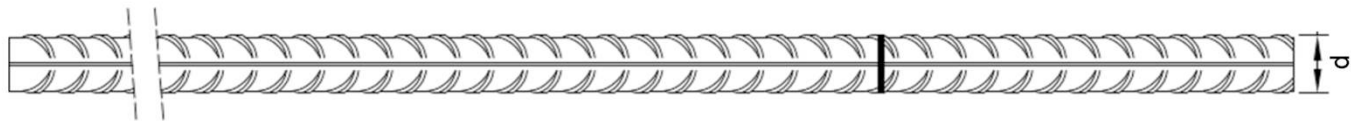

Minimum value of related rip area $f_{R,min}$ according to EN 1992-1-1:2004 + AC:2010
Rib height of the bar shall be in the range $0,05d \leq h_{rib} \leq 0,07d$
(d: Nominal diameter of the bar; h_{rib} : Rib height of the bar)

Table A2: Materials Reinforcing bar

Part	Designation	Material
Rebar		
1	Reinforcing steel according to EN 1992 1 1:2004 + AC:2010, Annex C	Bars and rebars from ring class B or C f_{yk} and k according to NDP or NCI according to EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Product description
Materials reinforcing bar

Annex A 5

Specification of the intended use				
Fasteners subject to (Static and quasi-static loads):				
	Working life 50 years		Working life 100 years	
Base material	uncracked concrete	cracked concrete	uncracked concrete	cracked concrete
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 to M30, Ø8 to Ø32, BI-M6 to BI-M20		No performance assessed	
Temperature Range	I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾		No performance assessed	
Fasteners subject to (seismic action):				
	Performance Category C1		Performance Category C2	
Base material	Cracked and uncracked concrete			
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 to M30, Ø8 to Ø32		M12 to M20	
Temperature Range	I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾		I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾	
Fasteners subject to (fire exposure):				
Base material	Cracked and uncracked concrete			
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 to M30, Ø8 to Ø32, BI-M6 to BI-M20			
Temperature Range:	I: - 40°C to +40°C ¹⁾ II: - 40°C to +80°C ²⁾ III: - 40°C to +120°C ³⁾			
1) (max. long-term temperature +24°C and max. short-term temperature +40°C) 2) (max. long-term temperature +50°C and max. short-term temperature +80°C) 3) (max. long-term temperature +72°C and max. short-term temperature +120°C)				
G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete			Annex B 1	
Intended Use Specifications				

Base material:

- Compacted, reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A2:2021.
- Strength classes C20/25 to C50/60 according to EN 206:2013 + A2:2021.

Use conditions (Environmental conditions):

For working life for at least 50 years

- Structures subject to dry internal conditions (all materials).
- For all other conditions according to EN 1993-1-4:2006 + A1:2015 corresponding to corrosion resistance class:
 - Stainless steel Stahl A2 according to Annex A 4, Table A1: CRC II
 - Stainless steel Stahl A4 according to Annex A 4, Table A1: CRC III
 - High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V

For variable working life

- Structures subject to internal and external conditions: Classification of atmospheric corrosivity, determination and estimation C1-CX according to EN ISO 9223:2012 Table C.1 for a variable working life according to Table B1.
 - Carbon steel, hot dip galvanized according to EN ISO 10684:2004 + AC:2009 with mean thickness $\geq 50 \mu\text{m}$

Table B1: Variable working life

Corrosivity category ¹⁾	Corrosivity	Working life (years)
C1	Very low	50
C2	Low	50
C3	Medium	25
C4	High	12,5
C5	Very High	5
CX	Extreme	2

¹⁾ Corrosivity categories according to EN ISO 9223:2012, Table C.1

Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e.g. position of the fastener relative to reinforcement or to supports, etc.).
- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work.
- The fasteners are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018

Installation:

- Dry, wet concrete or flooded bore holes (not sea-water).
- Hole drilling by hammer (HD), hollow (HDB) or compressed air (CD).
- Overhead installation allowed.
- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation temperature in concrete:
 - Gebofix PRO SISMIK VE-SF: -10°C up to +40°C for the standard variation of temperature after installation.
 - Gebofix PRO SISMIK VE-SF Nordic: -20°C up to +10°C for the standard variation of temperature after installation.

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Intended Use
Specifications (Continued)

Annex B 2

Table B2: Installation parameters for threaded rod

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Diameter of element	$d = d_{nom}$	[mm]	8	10	12	16	20	24	27	30
Nominal drill hole diameter	d_0	[mm]	10	12	14	18	24	28	32	35
Effective embedment depth	$h_{ef,min}$	[mm]	60	60	70	80	90	96	108	120
	$h_{ef,max}$	[mm]	160	200	240	320	400	480	540	600
Diameter of clearance hole in the fixture	Prepositioned installation $d_f \leq$	[mm]	9	12	14	18	22	26	30	33
	Push through installation d_f	[mm]	12	14	16	20	24	30	33	40
Maximum installation torque	$\max T_{inst}$	[Nm]	10	20	40	60	100	170	250	300
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$				
Minimum spacing	s_{min}	[mm]	40	50	60	80	100	120	135	150
Minimum edge distance	c_{min}	[mm]	40	50	60	80	100	120	135	150

Table B3: Installation parameters for reinforcing bar

Reinforcing bar			$\varnothing 8^1)$	$\varnothing 10^1)$	$\varnothing 12^1)$	$\varnothing 14$	$\varnothing 16$	$\varnothing 20$	$\varnothing 25$	$\varnothing 28$	$\varnothing 32$
Diameter of element	$d = d_{nom}$	[mm]	8	10	12	14	16	20	25	28	32
Nominal drill hole diameter	d_0	[mm]	10 12	12 14	14 16	18	20	25	32	35	40
Effective embedment depth	$h_{ef,min}$	[mm]	60	60	70	75	80	90	100	112	128
	$h_{ef,max}$	[mm]	160	200	240	280	320	400	500	560	640
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$					
Minimum spacing	s_{min}	[mm]	40	50	60	70	80	100	125	140	160
Minimum edge distance	c_{min}	[mm]	40	50	60	70	80	100	125	140	160

¹⁾ both nominal drill hole diameter can be used

Table B4: Installation parameters for Internal threaded anchor rod

Internal threaded anchor rod			BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20
Internal diameter of anchor rod	d_2	[mm]	6	8	10	12	16	20
Outer diameter of anchor rod ¹⁾	$d = d_{nom}$	[mm]	10	12	16	20	24	30
Nominal drill hole diameter	d_0	[mm]	12	14	18	24	28	35
Effective embedment depth	$h_{ef,min}$	[mm]	60	70	80	90	96	120
	$h_{ef,max}$	[mm]	200	240	320	400	480	600
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7	9	12	14	18	22
Maximum installation torque	$\max T_{inst}$	[Nm]	10	10	20	40	60	100
Thread engagement length min/max	l_{IG}	[mm]	8/20	8/20	10/25	12/30	16/32	20/40
Minimum thickness of member	h_{min}	[mm]	$h_{ef} + 30 \text{ mm}$ $\geq 100 \text{ mm}$			$h_{ef} + 2d_0$		
Minimum spacing	s_{min}	[mm]	50	60	80	100	120	150
Minimum edge distance	c_{min}	[mm]	50	60	80	100	120	150



¹⁾ With metric threads according to EN 1993-1-8:2005+AC:2009

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Intended Use
Installation parameters

Annex B 3

Table B5: Parameter cleaning and installation tools

										
Threaded Rod	Re-inforcing bar	Internal threaded anchor rod	d ₀ Drill bit - Ø HD, HDB, CD	d _b Brush - Ø		d _{b,min} min. Brush - Ø	Piston plug	Installation direction and use of piston plug		
[mm]	[mm]	[mm]	[mm]		[mm]	[mm]				
M8	8		10	SC10	12	10,5	No plug required			
M10	8 / 10	BI-M6	12	SC12	14	12,5				
M12	10 / 12	BI-M8	14	SC14	16	14,5				
	12		16	SC16	18	16,5				
M16	14	BI-M10	18	SC18	20	18,5	MP18	h _{ef} > 250 mm	h _{ef} > 250 mm	all
	16		20	SC20	22	20,5	MP20			
M20		BI-M12	24	SC24	26	24,5	MP24			
	20		25	SC25	27	25,5	MP25			
M24		BI-M16	28	SC28	30	28,5	MP28			
M27	25		32	SC32	34	32,5	MP32			
M30	28	BI-M20	35	SC35	37	35,5	MP35			
	32		40	SC40	41,5	40,5	MP40			

Cleaning and installation tools

HDB – Hollow drill bit system



The hollow drill system consists of:
Heller Duster Expert hollow drill bit and a Class M Hoover with a minimum negative pressure of 237 hPa and a flow rate of minimum 143 m³/h (40 l/s).

Hand pump

(Volume 750 ml, h₀ ≤ 10 d_s, d₀ ≤ 20mm)



Compressed air tool

(min 6 bar)



Brush SC



Piston Plug MP



Brush extension SL



G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Intended Use
Cleaning and installation tools

Annex B 4

Table B6: Working time and curing time Gebofix PRO SISMIK VE-SF

Temperature in base material			Maximum working time	Minimum curing time ¹⁾
T			t_{work}	t_{cure}
- 10 °C	to	- 6 °C	90 min ²⁾	24 h
- 5 °C	to	- 1 °C	90 min	14 h
0 °C	to	+ 4 °C	45 min	7 h
+ 5 °C	to	+ 9 °C	25 min	2 h
+ 10 °C	to	+ 19 °C	15 min	80 min
+ 20 °C	to	+ 29 °C	6 min	45 min
+ 30 °C	to	+ 34 °C	4 min	25 min
+ 35 °C	to	+ 39 °C	2 min	20 min
+40 °C			1,5 min	15 min
Cartridge temperature			+5 °C to +40 °C	

1) The minimum curing time is only valid for dry base material.
In wet base material the curing time must be doubled.

2) Cartridge temperature must be at least +15 °C

Table B6: Working time and curing time Gebofix PRO SISMIK VE-SF Nordic

Temperature in base material			Maximum working time	Minimum curing time ¹⁾
T			t_{gel}	t_{cure}
- 20 °C	to	- 16 °C	75 min	24 h
- 15 °C	to	- 11 °C	55 min	16 h
- 10 °C	to	- 6 °C	35 min	10 h
- 5 °C	to	- 1 °C	20 min	5 h
0 °C	to	+ 4 °C	10 min	2,5 h
+ 5 °C	to	+ 9 °C	6 min	80 min
+ 10 °C			6 min	60 min
Cartridge temperature			-20 °C to +10 °C	

1) The minimum curing time is only valid for dry base material.
In wet base material the curing time must be doubled.


G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Intended Use
Working time and curing time

Annex B 5


Installation instructions

Drilling of the bore hole

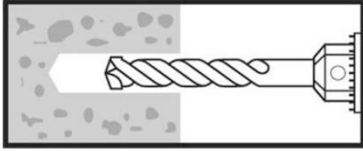

1a. Hammer drilling (HD) / Compressed air drilling (CD)

Drill a hole to the required embedment depth.
Drill bit diameter according to Table B2, B3 or B4.
Aborted drill holes shall be filled with mortar.
Proceed with Step 2 (CAC and MAC).

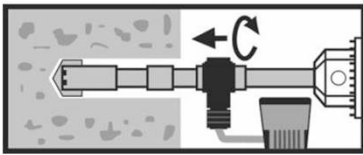


1b. Hollow drill bit system (HDB)

Drill a hole to the required embedment depth.
Drill bit diameter according to Table B2, B3 or B4.
Aborted drill holes shall be filled with mortar.
The hollow drilling system removes the dust and cleans the bore hole.
Proceed with Step 3.


Attention! Standing water in the bore hole must be removed before cleaning

Manual Air Cleaning (MAC)


for bore hole diameter $d_0 \leq 20\text{mm}$ and bore hole depth $h_0 \leq 10d_{\text{nom}}$ ($d_0 < 14\text{mm}$ uncracked concrete only)
with drilling method HD and CD

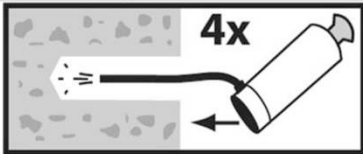

2a. Blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

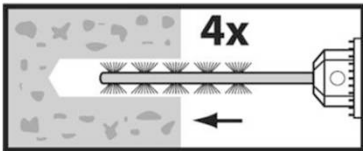

2b. Brush the bore hole minimum 4x with brush SC according to Table B5 over the entire embedment depth in a twisting motion. (If necessary, a brush extension SL shall be used.)

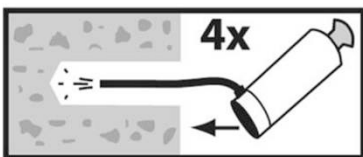

2c. Finally blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO
SISMIK VE-SF Nordic for concrete


Intended Use
Installation instructions

Annex B 6


Installation instructions (continuation)

Compressed Air Cleaning (CAC):


All diameter with drilling method HD and CD

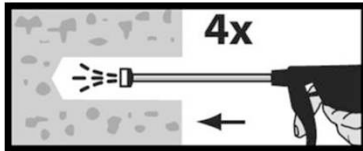

- 2a. Blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

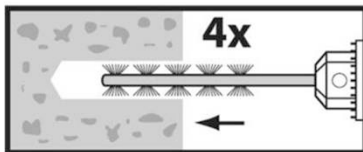


- 2b. Brush the bore hole minimum 4x with brush SC according to Table B5 over the entire embedment depth in a twisting motion. (If necessary, a brush extension SL shall be used.)

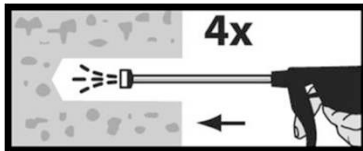


- 2c. Finally blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

Cleaned bore hole has to be protected against re-contamination in an appropriate way,

If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.

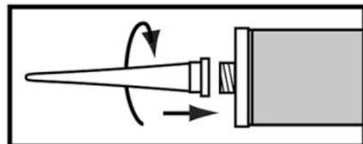

3. Screw on static-mixing nozzle M21/14 and M17 / M25/S and load the cartridge into an appropriate dispensing tool. With foil tube cartridges cut off the foil tube clip before use.
For every working interruption longer than the maximum working time t_{work} (Annex B 5) as well as for new cartridges, a new static-mixer shall be used.

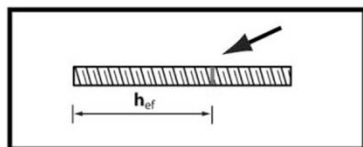


4. Mark embedment depth on the anchor rod.
The anchor rod shall be free of dirt, grease, oil or other foreign material.

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete


Intended Use
Installation instructions (continuation)

Annex B 7

Installation instructions (continuation)

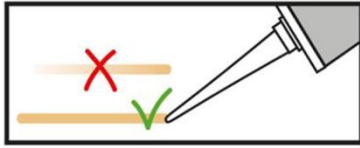


5. Not proper mixed mortar is not sufficient for fastening.
Dispense and discard mortar until an uniform grey or red colour is shown (at least 3 full strokes, for foil tube cartridges at least 6 full strokes).

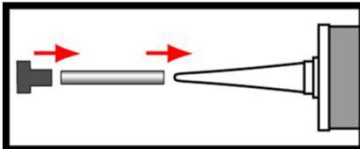

6. Piston plugs MP and mixer nozzle extensions ML shall be used according to Table B4 for the following applications:


- Horizontal and vertical downwards direction: Drill bit- $\varnothing d_0 \geq 18$ mm and embedment depth $h_{ef} > 250$ mm
- Vertical upwards direction: Drill bit- $\varnothing d_0 \geq 18$ mm

Assemble mixing nozzle, mixer extension and piston plug before injecting mortar.

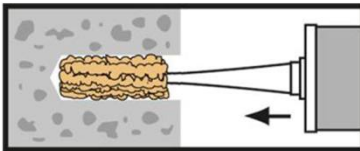


- 7a. **Injecting mortar without piston plug MP:**

Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) Slowly withdraw of the static mixing nozzle avoid creating air pockets. Observe the temperature related working time t_{work} (Annex B 5).

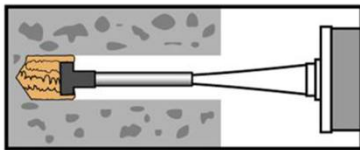

- 7b. **Injecting mortar with piston plug MP:**

Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) During injection the piston plug is pushed out of the bore hole by the back pressure of the mortar. Observe the temperature related working time t_{work} (Annex B 5).

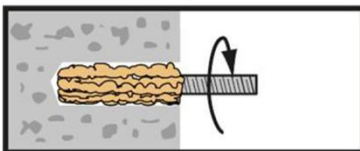


8. Insert the anchor rod while turning slightly up to the embedment mark.

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete


Intended Use
Installation instructions (continuation)

Annex B 8

Installation instructions (continuation)

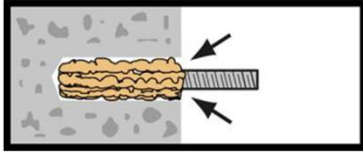


9. Annular gap between anchor rod and base material must be completely filled with mortar. In case of push through installation the annular gap in the fixture must be filled with mortar also. Otherwise, the installation must be repeated starting from step 7 before the maximum working time t_{work} has expired.

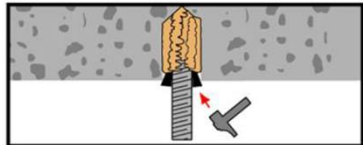

10. For application in vertical upwards direction the anchor rod shall be fixed (e.g. wedges).



11. Temperature related curing time t_{cure} (Annex B 5) must be observed. Do not move or load the fastener during curing time.

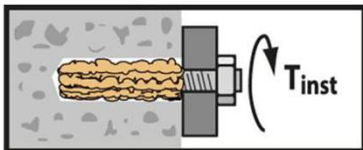

12. Install the fixture by using a calibrated torque wrench. Observe maximum installation torque (Table B2 or B4). In case of static requirements (e.g. seismic), fill the annular gap in the fixture with mortar (Annex A 3). Therefore replace the washer by the filling washer KSW and use the mixer reduction nozzle KSM.

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO
SISMIK VE-SF Nordic for concrete

Intended Use
Installation instructions (continuation)

Annex B 9

Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Cross section area	A _s	[mm²]	36,6	58	84,3	157	245	353	459	561	
Characteristic tension resistance, Steel failure ¹⁾											
Steel, Property class 4.6 and 4.8	N _{Rk,s}	[kN]	15 (13)	23 (21)	34	63	98	141	184	224	
Steel, Property class 5.6 and 5.8	N _{Rk,s}	[kN]	18 (17)	29 (27)	42	78	122	176	230	280	
Steel, Property class 8.8	N _{Rk,s}	[kN]	29 (27)	46 (43)	67	125	196	282	368	449	
Stainless steel A2, A4 and HCR, class 50	N _{Rk,s}	[kN]	18	29	42	79	123	177	230	281	
Stainless steel A2, A4 and HCR, class 70	N _{Rk,s}	[kN]	26	41	59	110	171	247	– ³⁾	– ³⁾	
Stainless steel A4 and HCR, class 80	N _{Rk,s}	[kN]	29	46	67	126	196	282	– ³⁾	– ³⁾	
Characteristic tension resistance, Partial factor ²⁾											
Steel, Property class 4.6 and 5.6	γ _{Ms,N}	[-]	2,0								
Steel, Property class 4.8, 5.8 and 8.8	γ _{Ms,N}	[-]	1,5								
Stainless steel A2, A4 and HCR, class 50	γ _{Ms,N}	[-]	2,86								
Stainless steel A2, A4 and HCR, class 70	γ _{Ms,N}	[-]	1,87								
Stainless steel A4 and HCR, class 80	γ _{Ms,N}	[-]	1,6								
Characteristic shear resistance, Steel failure ¹⁾											
Without lever arm	Steel, Property class 4.6 and 4.8	V ⁰ _{Rk,s}	[kN]	9 (8)	14 (13)	20	38	59	85	110	135
	Steel, Property class 5.6 and 5.8	V ⁰ _{Rk,s}	[kN]	11 (10)	17 (16)	25	47	74	106	138	168
	Steel, Property class 8.8	V ⁰ _{Rk,s}	[kN]	15 (13)	23 (21)	34	63	98	141	184	224
	Stainless steel A2, A4 and HCR, class 50	V ⁰ _{Rk,s}	[kN]	9	15	21	39	61	88	115	140
	Stainless steel A2, A4 and HCR, class 70	V ⁰ _{Rk,s}	[kN]	13	20	30	55	86	124	– ³⁾	– ³⁾
	Stainless steel A4 and HCR, class 80	V ⁰ _{Rk,s}	[kN]	15	23	34	63	98	141	– ³⁾	– ³⁾
With lever arm	Steel, Property class 4.6 and 4.8	M ⁰ _{Rk,s}	[Nm]	15 (13)	30 (27)	52	133	260	449	666	900
	Steel, Property class 5.6 and 5.8	M ⁰ _{Rk,s}	[Nm]	19 (16)	37 (33)	65	166	324	560	833	1123
	Steel, Property class 8.8	M ⁰ _{Rk,s}	[Nm]	30 (26)	60 (53)	105	266	519	896	1333	1797
	Stainless steel A2, A4 and HCR, class 50	M ⁰ _{Rk,s}	[Nm]	19	37	66	167	325	561	832	1125
	Stainless steel A2, A4 and HCR, class 70	M ⁰ _{Rk,s}	[Nm]	26	52	92	232	454	784	– ³⁾	– ³⁾
	Stainless steel A4 and HCR, class 80	M ⁰ _{Rk,s}	[Nm]	30	59	105	266	519	896	– ³⁾	– ³⁾
Characteristic shear resistance, Partial factor ²⁾											
Steel, Property class 4.6 and 5.6	γ _{Ms,V}	[-]	1,67								
Steel, Property class 4.8, 5.8 and 8.8	γ _{Ms,V}	[-]	1,25								
Stainless steel A2, A4 and HCR, class 50	γ _{Ms,V}	[-]	2,38								
Stainless steel A2, A4 and HCR, class 70	γ _{Ms,V}	[-]	1,56								
Stainless steel A4 and HCR, class 80	γ _{Ms,V}	[-]	1,33								
¹⁾ Values are only valid for the given stress area A _s . Values in brackets are valid for undersized threaded rods with smaller stress area A _s for hot-dip galvanised threaded rods according to EN ISO 10684:2004 + AC:2009.											
²⁾ in absence of national regulation											
³⁾ Fastener type not part of the ETA											
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete							Annex C 1				
Performances Characteristic values for steel tension resistance and steel shear resistance of threaded rods											

Table C2: Characteristic values of tension loads under static and quasi-static action

Fastener			All Anchor types and sizes	
Concrete cone failure				
Uncracked concrete	$k_{ucr,N}$	[-]	11,0	
Cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$	
Axial distance	$s_{cr,N}$	[mm]	$2 c_{cr,N}$	
Splitting				
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} \left(2,5 - \frac{h}{h_{ef}} \right)$
	$h/h_{ef} \leq 1,3$			$2,4 h_{ef}$
Axial distance	$s_{cr,sp}$	[mm]	$2 c_{cr,sp}$	

G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete

Performances

Characteristic values for Concrete cone failure and Splitting with all kind of action

Annex C 2

Table C3: Characteristic values of tension loads under static and quasi-static action												
Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked concrete C20/25												
Temperature range	I: 24°C/40°C	Dry, wet concrete	$\tau_{Rk,ucr}$	[N/mm²]	10	12	12	12	12	11	10	9,0
	II: 50°C/80°C				7,5	9,0	9,0	9,0	9,0	8,5	7,5	6,5
	III: 72°C/120°C				5,5	6,5	6,5	6,5	6,5	6,5	5,5	5,0
	I: 24°C/40°C	flooded bore hole			7,5	8,5	8,5	8,5	No Performance Assessed			
	II: 50°C/80°C				5,5	6,5	6,5	6,5				
	III: 72°C/120°C				4,0	5,0	5,0	5,0				
Characteristic bond resistance in cracked concrete C20/25												
Temperature range	I: 24°C/40°C	Dry, wet concrete	$\tau_{Rk,cr}$	[N/mm²]	4,0	5,0	5,5	5,5	5,5	5,5	6,5	6,5
	II: 50°C/80°C				2,5	3,5	4,0	4,0	4,0	4,0	4,5	4,5
	III: 72°C/120°C				2,0	2,5	3,0	3,0	3,0	3,0	3,5	3,5
	I: 24°C/40°C	flooded bore hole			4,0	4,0	5,5	5,5	No Performance Assessed			
	II: 50°C/80°C				2,5	3,0	4,0	4,0				
	III: 72°C/120°C				2,0	2,5	3,0	3,0				
Reduktion factor ψ_{sus}^0 in cracked and uncracked concrete C20/25												
Temperature range	I: 24°C/40°C	Dry, wet concrete and flooded bore hole	ψ_{sus}^0	[-]	0,73							
	II: 50°C/80°C				0,65							
	III: 72°C/120°C				0,57							
Increasing factors for concrete		ψ_c	[-]	$(f_{ck} / 20)^{0,11}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr,(C20/25)}$								
		$\tau_{Rk,cr} =$		$\psi_c \cdot \tau_{Rk,cr,(C20/25)}$								
Concrete cone failure												
Relevant parameter				see Table C2								
Splitting												
Relevant parameter				see Table C2								
Installation factor												
for dry and wet concrete (HD, CD)		γ_{inst}	[-]	1,0	1,2							
for dry and wet concrete (HDB)				1,2					1,4		-1)	
for flooded bore hole				1,4					No Performance Assessed			
1) No Performance Assessed												
G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete									Annex C 3			
Performances Characteristic values of tension loads under static and quasi-static action (Threaded rod)												

Table C4: Characteristic values of shear loads under static and quasi-static action

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure without lever arm											
Characteristic shear resistance Steel, strength class 4.6, 4.8, 5.6 and 5.8	$V_{Rk,s}^0$	[kN]	$0,6 \cdot A_s \cdot f_{uk}$ (or see Table C1)								
Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all classes	$V_{Rk,s}^0$	[kN]	$0,5 \cdot A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1								
Ductility factor	k_7	[-]	1,0								
Steel failure with lever arm											
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}$ (or see Table C1)								
Elastic section modulus	W_{el}	[mm³]	31	62	109	277	541	935	1387	1874	
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1								
Concrete pry-out failure											
Factor	k_8	[-]	2,0								
Installation factor	γ_{inst}	[-]	1,0								
Concrete edge failure											
Effective length of fastener	l_f	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$						$\min(h_{ef}; 300\text{mm})$		
Outside diameter of fastener	d_{nom}	[mm]	8	10	12	16	20	24	27	30	
Installation factor	γ_{inst}	[-]	1,0								
G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete								Annex C 4			
Performances Characteristic values of shear loads under static and quasi-static action (Threaded rod)											

Table C5: Characteristic values of tension loads under static and quasi-static action										
Internal threaded anchor rods				BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20	
Steel failure ¹⁾										
Characteristic tension resistance,		5.8	N _{Rk,s}	[kN]	10	17	29	42	76	123
Steel, strength class		8.8	N _{Rk,s}	[kN]	16	27	46	67	121	196
Partial factor, strength class 5.8 and 8.8			γ _{Ms,N}	[-]	1,5					
Characteristic tension resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾			N _{Rk,s}	[kN]	14	26	41	59	110	124
Partial factor			γ _{Ms,N}	[-]	1,87					2,86
Combined pull-out and concrete cone failure										
Characteristic bond resistance in uncracked concrete C20/25										
Temperature range	I: 24°C/40°C	Dry, wet concrete	τ _{Rk,ucr}	[N/mm²]	12	12	12	12	11	9,0
	II: 50°C/80°C				9,0	9,0	9,0	9,0	8,5	6,5
	III: 72°C/120°C				6,5	6,5	6,5	6,5	6,5	5,0
	I: 24°C/40°C	flooded bore hole			8,5	8,5	8,5	No Performance Assessed		
	II: 50°C/80°C				6,5	6,5	6,5			
	III: 72°C/120°C				5,0	5,0	5,0			
Characteristic bond resistance in cracked concrete C20/25										
Temperature range	I: 24°C/40°C	Dry, wet concrete	τ _{Rk,cr}	[N/mm²]	5,0	5,5	5,5	5,5	5,5	6,5
	II: 50°C/80°C				3,5	4,0	4,0	4,0	4,0	4,5
	III: 72°C/120°C				2,5	3,0	3,0	3,0	3,0	3,5
	I: 24°C/40°C	flooded bore hole			4,0	5,5	5,5	No Performance Assessed		
	II: 50°C/80°C				3,0	4,0	4,0			
	III: 72°C/120°C				2,5	3,0	3,0			
Reduktion factor ψ ⁰ _{sus} in cracked and uncracked concrete C20/25										
Temperature range	I: 24°C/40°C	Dry, wet concrete and flooded bore hole	ψ ⁰ _{sus}	[-]	0,73					
	II: 50°C/80°C				0,65					
	III: 72°C/120°C				0,57					
Increasing factors for concrete			ψ _c	[-]	(f _{ck} / 20) ^{0,11}					
Characteristic bond resistance depending on the concrete strength class			τ _{Rk,ucr} =		ψ _c * τ _{Rk,ucr,(C20/25)}					
			τ _{Rk,cr} =		ψ _c * τ _{Rk,cr,(C20/25)}					
Concrete cone failure										
Relevant parameter				see Table C2						
Splitting failure										
Relevant parameter				see Table C2						
Installation factor										
for dry and wet concrete (HD, CD)		γ _{inst}	[-]	1,2						
for dry and wet concrete (HDB)				1,2		1,4		- ³⁾		
for flooded bore hole				1,4		No Performance Assessed				
¹⁾ Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. ²⁾ For BI-M20 strength class 50 is valid ³⁾ No Performance Assessed										
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete								Annex C 5		
Performances Characteristic values of tension loads under static and quasi-static action (Internal threaded anchor rod)										

Table C6: Characteristic values of shear loads under static and quasi-static action

Internal threaded anchor rods				BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20
Steel failure without lever arm ¹⁾									
Characteristic shear resistance, Steel, strength class	5.8	$V_{Rk,s}^0$	[kN]	5	9	15	21	38	61
	8.8	$V_{Rk,s}^0$	[kN]	8	14	23	34	60	98
Partial factor, strength class 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Characteristic shear resistance, Stainless Steel A4 and HCR, Strength class 70 ²⁾		$V_{Rk,s}^0$	[kN]	7	13	20	30	55	40
Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Ductility factor		k_7	[-]	1,0					
Steel failure with lever arm ¹⁾									
Characteristic bending moment, Steel, strength class	5.8	$M_{Rk,s}^0$	[Nm]	8	19	37	66	167	325
	8.8	$M_{Rk,s}^0$	[Nm]	12	30	60	105	267	519
Partial factor, strength class 5.8 and 8.8		$\gamma_{Ms,V}$	[-]	1,25					
Characteristic bending moment, Stainless Steel A4 and HCR, Strength class 70 ²⁾		$M_{Rk,s}^0$	[Nm]	11	26	52	92	233	456
Partial factor		$\gamma_{Ms,V}$	[-]	1,56					2,38
Concrete pry-out failure									
Factor		k_8	[-]	2,0					
Installation factor		γ_{inst}	[-]	1,0					
Concrete edge failure									
Effective length of fastener		l_f	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$					$\min(h_{ef}; 300mm)$
Outside diameter of fastener		d_{nom}	[mm]	10	12	16	20	24	30
Installation factor		γ_{inst}	[-]	1,0					
1) Fastenings (incl. nut and washer) must comply with the appropriate material and property class of the internal threaded rod. The characteristic tension resistance for steel failure is valid for the internal threaded rod and the fastening element. 2) For BI-M20 strength class 50 is valid									
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete								Annex C 6	
Performances Characteristic values of shear loads under static and quasi-static action (Internal threaded anchor rod)									

Table C7: Characteristic values of tension loads under static and quasi-static action

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance		N _{Rk,s}	[kN]	A _s · f _{uk} ¹⁾									
Cross section area		A _s	[mm²]	50	79	113	154	201	314	491	616	804	
Partial factor		γ _{Ms,N}	[-]	1,4 ²⁾									
Combined pull-out and concrete failure													
Characteristic bond resistance in uncracked concrete C20/25													
Temperature range	I: 24°C/40°C	Dry, wet concrete	τ _{Rk,ucr}	[N/mm²]	10	12	12	12	12	12	11	10	8,5
	II: 50°C/80°C				7,5	9,0	9,0	9,0	9,0	9,0	8,0	7,0	6,0
	III: 72°C/120°C				5,5	6,5	6,5	6,5	6,5	6,5	6,0	5,0	4,5
	I: 24°C/40°C	flooded bore hole			7,5	8,5	8,5	8,5	8,5	No Performance Assessed			
	II: 50°C/80°C				5,5	6,5	6,5	6,5	6,5				
	III: 72°C/120°C				4,0	5,0	5,0	5,0	5,0				
Characteristic bond resistance in cracked concrete C20/25													
Temperature range	I: 24°C/40°C	Dry, wet concrete	τ _{Rk,cr}	[N/mm²]	4,0	5,0	5,5	5,5	5,5	5,5	5,5	6,5	6,5
	II: 50°C/80°C				2,5	3,5	4,0	4,0	4,0	4,0	4,0	4,5	4,5
	III: 72°C/120°C				2,0	2,5	3,0	3,0	3,0	3,0	3,0	3,5	3,5
	I: 24°C/40°C	flooded bore hole			4,0	4,0	5,5	5,5	5,5	No Performance Assessed			
	II: 50°C/80°C				2,5	3,0	4,0	4,0	4,0				
	III: 72°C/120°C				2,0	2,5	3,0	3,0	3,0				
Reduktion factor ψ ⁰ _{sus} in cracked and uncracked concrete C20/25													
Temperature range	I: 24°C/40°C	Dry, wet concrete and flooded bore hole	ψ ⁰ _{sus}	[-]	0,73								
	II: 50°C/80°C				0,65								
	III: 72°C/120°C				0,57								
Increasing factors for concrete		ψ _c	[-]	(f _{ck} / 20) ^{0,11}									
Characteristic bond resistance depending on the concrete strength class		τ _{Rk,ucr} =		ψ _c · τ _{Rk,ucr,(C20/25)}									
		τ _{Rk,cr} =		ψ _c · τ _{Rk,cr,(C20/25)}									
Concrete cone failure													
Relevant parameter				see Table C2									
Splitting													
Relevant parameter				see Table C2									
Installation factor													
for dry and wet concrete (HD, CD)		γ _{inst}	[-]	1,0	1,2								
for dry and wet concrete (HDB)				1,2						1,4		- ³⁾	
for flooded bore hole				1,4						No Performance Assessed			
1) f _{uk} shall be taken from the specifications of reinforcing bars 2) in absence of national regulation 3) No Performance Assessed													
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete										Annex C 7			
Performances Characteristic values of tension loads under static and quasi-static action (Reinforcing bar)													

Table C8: Characteristic values of shear loads under static and quasi-static action

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Steel failure without lever arm											
Characteristic shear resistance	$V^0_{Rk,s}$	[kN]	$0,50 \cdot A_s \cdot f_{uk}^{1)}$								
Cross section area	A_s	[mm²]	50	79	113	154	201	314	491	616	804
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 ²⁾								
Ductility factor	k_7	[-]	1,0								
Steel failure with lever arm											
Characteristic bending moment	$M^0_{Rk,s}$	[Nm]	$1.2 \cdot W_{el} \cdot f_{uk}^{1)}$								
Elastic section modulus	W_{el}	[mm³]	50	98	170	269	402	785	1534	2155	3217
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 ²⁾								
Concrete pry-out failure											
Factor	k_8	[-]	2,0								
Installation factor	γ_{inst}	[-]	1,0								
Concrete edge failure											
Effective length of fastener	l_f	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$						$\min(h_{ef}; 300mm)$		
Outside diameter of fastener	d_{nom}	[mm]	8	10	12	14	16	20	25	28	32
Installation factor	γ_{inst}	[-]	1,0								
1) f_{uk} shall be taken from the specifications of reinforcing bars 2) in absence of national regulation											
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete									Annex C 8		
Performances Characteristic values of shear loads under static and quasi-static action (Reinforcing bar)											

Table C9: Displacements under tension load ¹⁾										
Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Uncracked concrete C20/25 under static and quasi-static action										
Temperature range I: 24°C/40°C	δ _{N0} -factor	[mm/(N/mm²)]	0,021	0,023	0,026	0,031	0,036	0,041	0,045	0,049
	δ _{N∞} -factor	[mm/(N/mm²)]	0,030	0,033	0,037	0,045	0,052	0,060	0,065	0,071
Temperature range II: 50°C/80°C	δ _{N0} -factor	[mm/(N/mm²)]	0,050	0,056	0,063	0,075	0,088	0,100	0,110	0,119
	δ _{N∞} -factor	[mm/(N/mm²)]	0,072	0,081	0,090	0,108	0,127	0,145	0,159	0,172
Temperature range III: 72°C/120°C	δ _{N0} -factor	[mm/(N/mm²)]	0,050	0,056	0,063	0,075	0,088	0,100	0,110	0,119
	δ _{N∞} -factor	[mm/(N/mm²)]	0,072	0,081	0,090	0,108	0,127	0,145	0,159	0,172
Cracked concrete C20/25 under static and quasi-static action										
Temperature range I: 24°C/40°C	δ _{N0} -factor	[mm/(N/mm²)]	0,090		0,070					
	δ _{N∞} -factor	[mm/(N/mm²)]	0,105		0,105					
Temperature range II: 50°C/80°C	δ _{N0} -factor	[mm/(N/mm²)]	0,219		0,170					
	δ _{N∞} -factor	[mm/(N/mm²)]	0,255		0,245					
Temperature range III: 72°C/120°C	δ _{N0} -factor	[mm/(N/mm²)]	0,219		0,170					
	δ _{N∞} -factor	[mm/(N/mm²)]	0,255		0,245					
1) Calculation of the displacement δ_{N0} = δ_{N0}-factor · τ; τ: action bond stress for tension δ_{N∞} = δ_{N∞}-factor · τ;										
Table C10: Displacements under shear load ¹⁾										
Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Uncracked concrete C20/25 under static and quasi-static action										
All temperature ranges	δ _{V0} -factor	[mm/kN]	0,06	0,06	0,05	0,04	0,04	0,03	0,03	0,03
	δ _{V∞} -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05
Cracked concrete C20/25 under static and quasi-static action										
All temperature ranges	δ _{V0} -factor	[mm/kN]	0,12	0,12	0,11	0,10	0,09	0,08	0,08	0,07
	δ _{V∞} -factor	[mm/kN]	0,18	0,18	0,17	0,15	0,14	0,13	0,12	0,10
1) Calculation of the displacement δ_{V0} = δ_{V0}-factor · V; V: action shear load δ_{V∞} = δ_{V∞}-factor · V;										
G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete								Annex C 9		
Performances Displacements under static and quasi-static action (threaded rods)										

Table C11: Displacements under tension load¹⁾

Internal threaded anchor rod			BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20
Uncracked concrete C20/25 under static and quasi-static action								
Temperature range I: 24°C/40°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,023	0,026	0,031	0,036	0,041	0,049
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,033	0,037	0,045	0,052	0,060	0,071
Temperature range II: 50°C/80°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,056	0,063	0,075	0,088	0,100	0,119
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,081	0,090	0,108	0,127	0,145	0,172
Temperature range III: 72°C/120°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,056	0,063	0,075	0,088	0,100	0,119
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,081	0,090	0,108	0,127	0,145	0,172
Cracked concrete C20/25 under static and quasi-static action								
Temperature range I: 24°C/40°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,090	0,070				
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,105	0,105				
Temperature range II: 50°C/80°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,219	0,170				
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,255	0,245				
Temperature range III: 72°C/120°C	δ_{NO} -factor	[mm/(N/mm ²)]	0,219	0,170				
	$\delta_{N\infty}$ -factor	[mm/(N/mm ²)]	0,255	0,245				

1) Calculation of the displacement

$$\delta_{NO} = \delta_{NO\text{-factor}} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot \tau;$$

Table C12: Displacements under shear load¹

Internal threaded anchor rod			BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20
Uncracked and cracked concrete C20/25 under static and quasi-static action								
All temperature ranges	δ_{V0} -factor	[mm/kN]	0,07	0,06	0,06	0,05	0,04	0,04
	$\delta_{V\infty}$ -factor	[mm/kN]	0,10	0,09	0,08	0,08	0,06	0,06

1) Calculation of the displacement

$$\delta_{V0} = \delta_{V0\text{-factor}} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-factor}} \cdot V;$$

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Performances
Displacements under static and quasi-static action
(Internal threaded anchor rod)

Annex C 10

Table C13: Displacements under tension load¹⁾ (rebar)

Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Uncracked concrete C20/25 under static and quasi-static action											
Temperature range I: 24°C/40°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,021	0,023	0,026	0,028	0,031	0,036	0,043	0,047	0,052
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,030	0,033	0,037	0,041	0,045	0,052	0,061	0,071	0,075
Temperature range II: 50°C/80°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,050	0,056	0,063	0,069	0,075	0,088	0,104	0,113	0,126
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,072	0,081	0,090	0,099	0,108	0,127	0,149	0,163	0,181
Temperature range III: 72°C/120°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,050	0,056	0,063	0,069	0,075	0,088	0,104	0,113	0,126
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,072	0,081	0,090	0,099	0,108	0,127	0,149	0,163	0,181
Cracked concrete C20/25 under static and quasi-static action											
Temperature range I: 24°C/40°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,090		0,070						
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,105		0,105						
Temperature range II: 50°C/80°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,219		0,170						
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,255		0,245						
Temperature range III: 72°C/120°C	δ _{N0} -factor	[mm/(N/mm ²)]	0,219		0,170						
	δ _{N∞} -factor	[mm/(N/mm ²)]	0,255		0,245						

¹⁾ Calculation of the displacement

$$\delta_{N0} = \delta_{N0\text{-factor}} \cdot \tau; \quad \tau: \text{action bond stress for tension}$$

$$\delta_{N\infty} = \delta_{N\infty\text{-factor}} \cdot \tau;$$

Table C14: Displacement under shear load¹⁾ (rebar)

Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Uncracked concrete C20/25 under static and quasi-static action											
All temperature ranges	δ _{V0} -factor	[mm/kN]	0,06	0,05	0,05	0,04	0,04	0,04	0,03	0,03	0,03
	δ _{V∞} -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,04	0,04
Cracked concrete C20/25 under static and quasi-static action											
All temperature ranges	δ _{V0} -factor	[mm/kN]	0,12	0,12	0,11	0,11	0,10	0,09	0,08	0,07	0,06
	δ _{V∞} -factor	[mm/kN]	0,18	0,18	0,17	0,16	0,15	0,14	0,12	0,11	0,10

¹⁾ Calculation of the displacement

$$\delta_{V0} = \delta_{V0\text{-factor}} \cdot V; \quad V: \text{action shear load}$$

$$\delta_{V\infty} = \delta_{V\infty\text{-factor}} \cdot V;$$

G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete

Performances
Displacements under static and quasi-static action
(Reinforcing bar)

Annex C 11

**Table C15: Characteristic values of tension loads under seismic action
(performance category C1)**

Threaded rod					M8	M10	M12	M16	M20	M24	M27	M30
Steel failure												
Characteristic tension resistance		$N_{Rk,s,C1}$	[kN]	$1,0 \cdot N_{Rk,s}$								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
Combined pull-out and concrete failure												
Characteristic bond resistance in uncracked and cracked concrete C20/25												
Temperature range	I: 24°C/40°C	Dry, wet concrete	$\tau_{Rk,C1}$	[N/mm²]	2,5	3,1	3,7	3,7	3,7	3,8	4,5	4,5
	II: 50°C/80°C				1,6	2,2	2,7	2,7	2,7	2,8	3,1	3,1
	III: 72°C/120°C				1,3	1,6	2,0	2,0	2,0	2,1	2,4	2,4
	I: 24°C/40°C	flooded bore hole			2,5	2,5	3,7	3,7	No Performance Assessed			
	II: 50°C/80°C				1,6	1,9	2,7	2,7				
	III: 72°C/120°C				1,3	1,6	2,0	2,0				
Increasing factors for concrete		ψ_c	[-]	1,0								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,C1} =$		$\psi_c \cdot \tau_{Rk,C1,(C20/25)}$								
Installation factor												
for dry and wet concrete (HD, CD)		γ_{inst}	[-]	1,0	1,2							
for dry and wet concrete (HDB)				1,2						1,4		- ¹⁾
for flooded bore hole				1,4				No Performance Assessed				

1) No Performance Assessed

**Table C16: Characteristic values of shear loads under seismic action
(performance category C1)**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Steel failure without lever arm										
Characteristic shear resistance (Seismic C1)	$V_{Rk,s,C1}$	[kN]	$0,70 \cdot V^0_{Rk,s}$							
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1							
Factor for annular gap	α_{gap}	[-]	0,5 (1,0) ¹⁾							

1) Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended

G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete

Performances
Characteristic values of tension loads and shear loads under seismic action
(performance category C1) (Threaded rod)

Annex C 12

**Table C17: Characteristic values of tension loads under seismic action
(performance category C1)**

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance		$N_{Rk,s,C1}$	[kN]	$1,0 \cdot A_s \cdot f_{uk}^{(1)}$									
Cross section area		A_s	[mm²]	50	79	113	154	201	314	491	616	804	
Partial factor		$\gamma_{Ms,N}$	[-]	$1,4^{(2)}$									
Combined pull-out and concrete failure													
Characteristic bond resistance in uncracked and cracked concrete C20/25													
Temperature range	I: 24°C/40°C	Dry, wet concrete	$\tau_{Rk,C1}$	[N/mm²]	2,5	3,1	3,7	3,7	3,7	3,7	3,8	4,5	4,5
	II: 50°C/80°C				1,6	2,2	2,7	2,7	2,7	2,7	2,8	3,1	3,1
	III: 72°C/120°C				1,3	1,6	2,0	2,0	2,0	2,0	2,1	2,4	2,4
	I: 24°C/40°C	flooded bore hole			2,5	2,5	3,7	3,7	3,7	No Performance Assessed			
	II: 50°C/80°C				1,6	1,9	2,7	2,7	2,7				
	III: 72°C/120°C				1,3	1,6	2,0	2,0	2,0				
Increasing factors for concrete		ψ_c	[-]	1,0									
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,C1} =$		$\psi_c \cdot \tau_{Rk,C1,(C20/25)}$									
Installation factor													
for dry and wet concrete (HD, CD)		γ_{inst}	[-]	1,2	1,2								
for dry and wet concrete (HDB)				1,2					1,4		- ⁽³⁾		
for flooded bore hole				1,4					No Performance Assessed				

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ in absence of national regulation

³⁾ No Performance Assessed

**Table C18: Characteristic values of shear loads under seismic action
(performance category C1)**

Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32
Steel failure without lever arm											
Characteristic shear resistance	$V_{Rk,s,C1}$	[kN]	$0,35 \cdot A_s \cdot f_{uk}^{(1)}$								
Cross section area	A_s	[mm ²]	50	79	113	154	201	314	491	616	804
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 ⁽²⁾								
Factor for annular gap	α_{gap}	[-]	0,5 (1,0) ⁽³⁾								

¹⁾ f_{uk} shall be taken from the specifications of reinforcing bars

²⁾ in absence of national regulation

³⁾ Value in brackets valid for filled annular gap between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended

G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete

Performances

Characteristic values of tension loads and shear loads under seismic action
(performance category C1) (Reinforcing bar)

Annex C 13

Table C19: Characteristic values of tension loads under seismic action (performance category C2)							
Threaded rod				M12	M16	M20	
Steel failure							
Characteristic tension resistance		$N_{Rk,s,C2}$	[kN]	$1,0 \cdot N_{Rk,s}$			
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1			
Combined pull-out and concrete failure							
Characteristic bond resistance in cracked and uncracked concrete C20/25							
Temperature range	I: 24°C/40°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,C2}$	[N/mm²]	1,2	1,7	1,6
	II: 50°C/80°C		$\tau_{Rk,C2}$	[N/mm²]	0,9	1,3	1,2
	III: 72°C/120°C		$\tau_{Rk,C2}$	[N/mm²]	0,6	0,9	0,9
Increasing factors for concrete		ψ_c	[-]	$(f_{ck} / 20)^{0,11}$			
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,C2} =$		$\psi_c \cdot \tau_{Rk,C2,(C20/25)}$			
Installation factor							
for dry and wet concrete (HD, HDB, CD)		γ_{inst}	[-]	1,2			

Table C20: Characteristic values of shear loads under seismic action (performance category C2)

Threaded rod			M12	M16	M20
Steel failure					
Characteristic shear resistance	$V_{Rk,s,C2}$	[kN]	$0,70 \cdot V^0_{Rk,s}$		$0,66 \cdot V^0_{Rk,s}$
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1		
Factor for annular gap	α_{gap}	[-]	$0,5 (1,0)^1$		
1) Value in brackets valid for filled annular gab between fastener and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended					

Table C21: Displacements under tension load

Threaded rod			M12	M16	M20
Cracked and uncracked concrete under seismic action (performance category C2)					
All temperature ranges	$\delta_{N,C2(50\%)} =$	[mm]	0,1	0,1	0,1
	$\delta_{N,C2(DLS)}$				
	$\delta_{N,C2(100\%)} =$	[mm]	0,3	0,3	0,5
	$\delta_{N,C2(ULS)}$				

Table C22: Displacements under shear load

Threaded rod			M12	M16	M20
Cracked and uncracked concrete under seismic action (performance category C2)					
All temperature ranges	$\delta_{V,C2(50\%)} =$	[mm]	3,0	3,8	5,2
	$\delta_{V,C2(DLS)}$				
	$\delta_{V,C2(100\%)} =$	[mm]	5,2	6,3	10,3
	$\delta_{V,C2(ULS)}$				

G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete

Performances

Characteristic values of shear loads and displacements under seismic action (performance category C2) (threaded rod)

Annex C 15

Table C23: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)

Threaded rod				M8	M10	M12	M16	M20	M24	M27	M30	
Steel failure												
Characteristic tension resistance; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher	$N_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	1,1	1,7	3,0	5,7	8,8	12,7	16,5	20,2
				60	0,9	1,4	2,3	4,2	6,6	9,5	12,4	15,1
				90	0,7	1,0	1,6	3,0	4,7	6,7	8,7	10,7
				120	0,5	0,8	1,2	2,2	3,4	4,9	6,4	7,9
Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ												
Temperature reduction factor	$k_{fi,p}(\theta)$	[-]	$\theta < 21^{\circ}\text{C}$	1,0								
			$21^{\circ}\text{C} \leq \theta \leq 331^{\circ}\text{C}$	$589,7 \cdot \theta^{-1,726} \leq 1,0$								
			$\theta > 331^{\circ}\text{C}$	0,0								
Characteristic bond resistance for a given temperature (θ)	$\tau_{Rk,fi}(\theta)$	[N/mm ²]		$k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$								
Steel failure without lever arm												
Characteristic shear resistance; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher	$V_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	1,1	1,7	3,0	5,7	8,8	12,7	16,5	20,2
				60	0,9	1,4	2,3	4,2	6,6	9,5	12,4	15,1
				90	0,7	1,0	1,6	3,0	4,7	6,7	8,7	10,7
				120	0,5	0,8	1,2	2,2	3,4	4,9	6,4	7,9
Steel failure with lever arm												
Characteristic bending moment; Steel, Stainless Steel A2, A4 and HCR, strength class 5.8 resp. 50 and higher	$M^0_{Rk,s,fi}$	[Nm]	Fire exposure time [min]	30	1,1	2,2	4,7	12,0	23,4	40,4	59,9	81,0
				60	0,9	1,8	3,5	9,0	17,5	30,3	44,9	60,7
				90	0,7	1,3	2,5	6,3	12,3	21,3	31,6	42,7
				120	0,5	1,0	1,8	4,7	9,1	15,7	23,3	31,5
1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range												
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete									Annex C 16			
Performances Characteristic values of tension and shear loads under fire exposure (internal threaded anchor rod)												

Table C24: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)

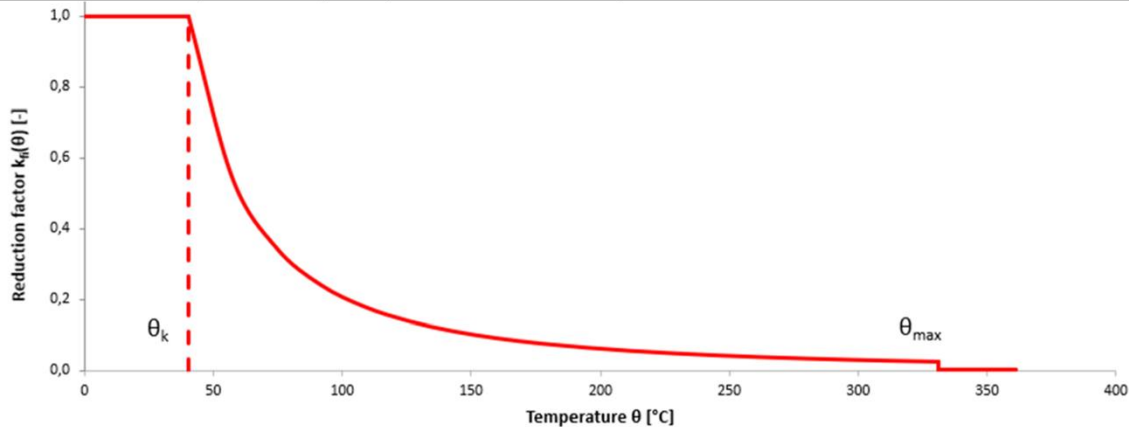
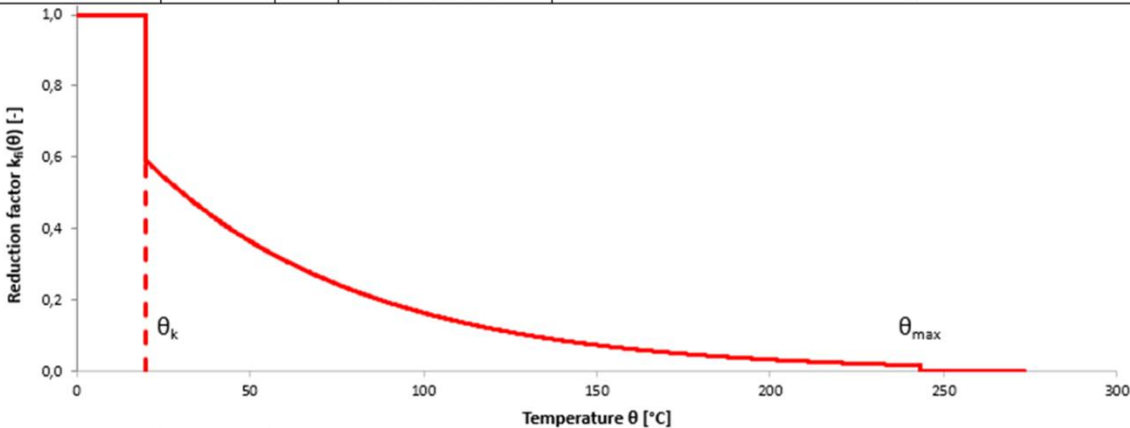
Internal threaded anchor rods					BI-M6	BI-M8	BI-M10	BI-M12	BI-M16	BI-M20
Steel failure										
Characteristic tension resistance; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70	$N_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	0,3	1,1	1,7	3,0	5,7	8,8
				60	0,2	0,9	1,4	2,3	4,2	6,6
				90	0,2	0,7	1,0	1,6	3,0	4,7
				120	0,1	0,5	0,8	1,2	2,2	3,4
Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ										
Temperature reduction factor	$k_{fi,p}(\theta)$	[-]	$\theta < 21^{\circ}\text{C}$		1,0					
			$21^{\circ}\text{C} \leq \theta \leq 331^{\circ}\text{C}$		$589,7 \cdot \theta^{-1,726} \leq 1,0$					
			$\theta > 331^{\circ}\text{C}$		0,0					
										
Characteristic bond resistance for a given temperature (θ)	$\tau_{Rk,fi}(\theta)$	[N/mm ²]			$k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$					
Steel failure without lever arm										
Characteristic shear resistance; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70	$V_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	0,3	1,1	1,7	3,0	5,7	8,8
				60	0,2	0,9	1,4	2,3	4,2	6,6
				90	0,2	0,7	1,0	1,6	3,0	4,7
				120	0,1	0,5	0,8	1,2	2,2	3,4
Steel failure with lever arm										
Characteristic bending moment; Steel, Stainless Steel A4 and HCR, strength class 5.8 and 8.8 resp. 70	$M^0_{Rk,s,fi}$	[Nm]	Fire exposure time [min]	30	0,2	1,1	2,2	4,7	12,0	23,4
				60	0,2	0,9	1,8	3,5	9,0	17,5
				90	0,1	0,7	1,3	2,5	6,3	12,3
				120	0,1	0,5	1,0	1,8	4,7	9,1
1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range										
G&B Fissaggi Injection system Gebofix PRO SISMIK VE-SF/ Gebofix PRO SISMIK VE-SF Nordic for concrete								Annex C 17		
Performances Characteristic values of tension and shear loads under fire exposure (internal threaded anchor rod)										

Table C25: Characteristic values of tension and shear loads under fire exposure in hammer drilled holes (HD), compressed air drilled holes (CD) and in hammer drilled holes with hollow drill bit (HDB)

Reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	Ø 28	Ø 32	
Steel failure													
Characteristic tension resistance; BSt 500	$N_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	0,5	1,2	2,3	3,1	4,0	6,3	9,8	12,3	16,1
				60	0,5	1,0	1,7	2,3	3,0	4,7	7,4	9,2	12,1
				90	0,4	0,8	1,5	2,0	2,6	4,1	6,4	8,0	10,5
				120	0,3	0,6	1,1	1,5	2,0	3,1	4,9	6,2	8,0
Characteristic bond resistance in cracked and uncracked concrete C20/25 up to C50/60 under fire conditions for a given temperature θ													
Temperature reduction factor	$k_{fi,p}(\theta)$	[-]	$\theta < 21^{\circ}\text{C}$		1,0								
			$21^{\circ}\text{C} \leq \theta \leq 243^{\circ}\text{C}$		$0,81 \cdot e^{-0,016 \cdot \theta} \leq 1,0$								
			$\theta > 243^{\circ}\text{C}$		0,0								
													
Characteristic bond resistance for a given temperature (θ)	$\tau_{Rk,fi}(\theta)$	[N/mm ²]		$k_{fi,p}(\theta) \cdot \tau_{Rk,cr,(C20/25)}^{1)}$									
Steel failure without lever arm													
Characteristic shear resistance; BSt 500	$V_{Rk,s,fi}$	[kN]	Fire exposure time [min]	30	0,5	1,2	2,3	3,1	4,0	6,3	9,8	12,3	16,1
				60	0,5	1,0	1,7	2,3	3,0	4,7	7,4	9,2	12,1
				90	0,4	0,8	1,5	2,0	2,6	4,1	6,4	8,0	10,5
				120	0,3	0,6	1,1	1,5	2,0	3,1	4,9	6,2	8,0
Steel failure with lever arm													
Characteristic bending moment; BSt 500	$M^0_{Rk,s,fi}$	[Nm]	Fire exposure time [min]	30	0,6	1,8	4,1	6,5	9,7	18,8	36,8	51,7	77,2
				60	0,5	1,5	3,1	4,8	7,2	14,1	27,6	38,8	57,9
				90	0,4	1,2	2,6	4,2	6,3	12,3	23,9	33,6	50,2
				120	0,3	0,9	2,0	3,2	4,8	9,4	18,4	25,9	38,6
1) $\tau_{Rk,cr,(C20/25)}$ characteristic bond resistance for cracked concrete for concrete strength class C20/25 for the relevant temperature range													
G&B Fissaggi Injection system Gebofix PRO SISMik VE-SF/ Gebofix PRO SISMik VE-SF Nordic for concrete									Annex C 18				
Performances Characteristic values of tension and shear loads under fire exposure (reinforcing bar)													